



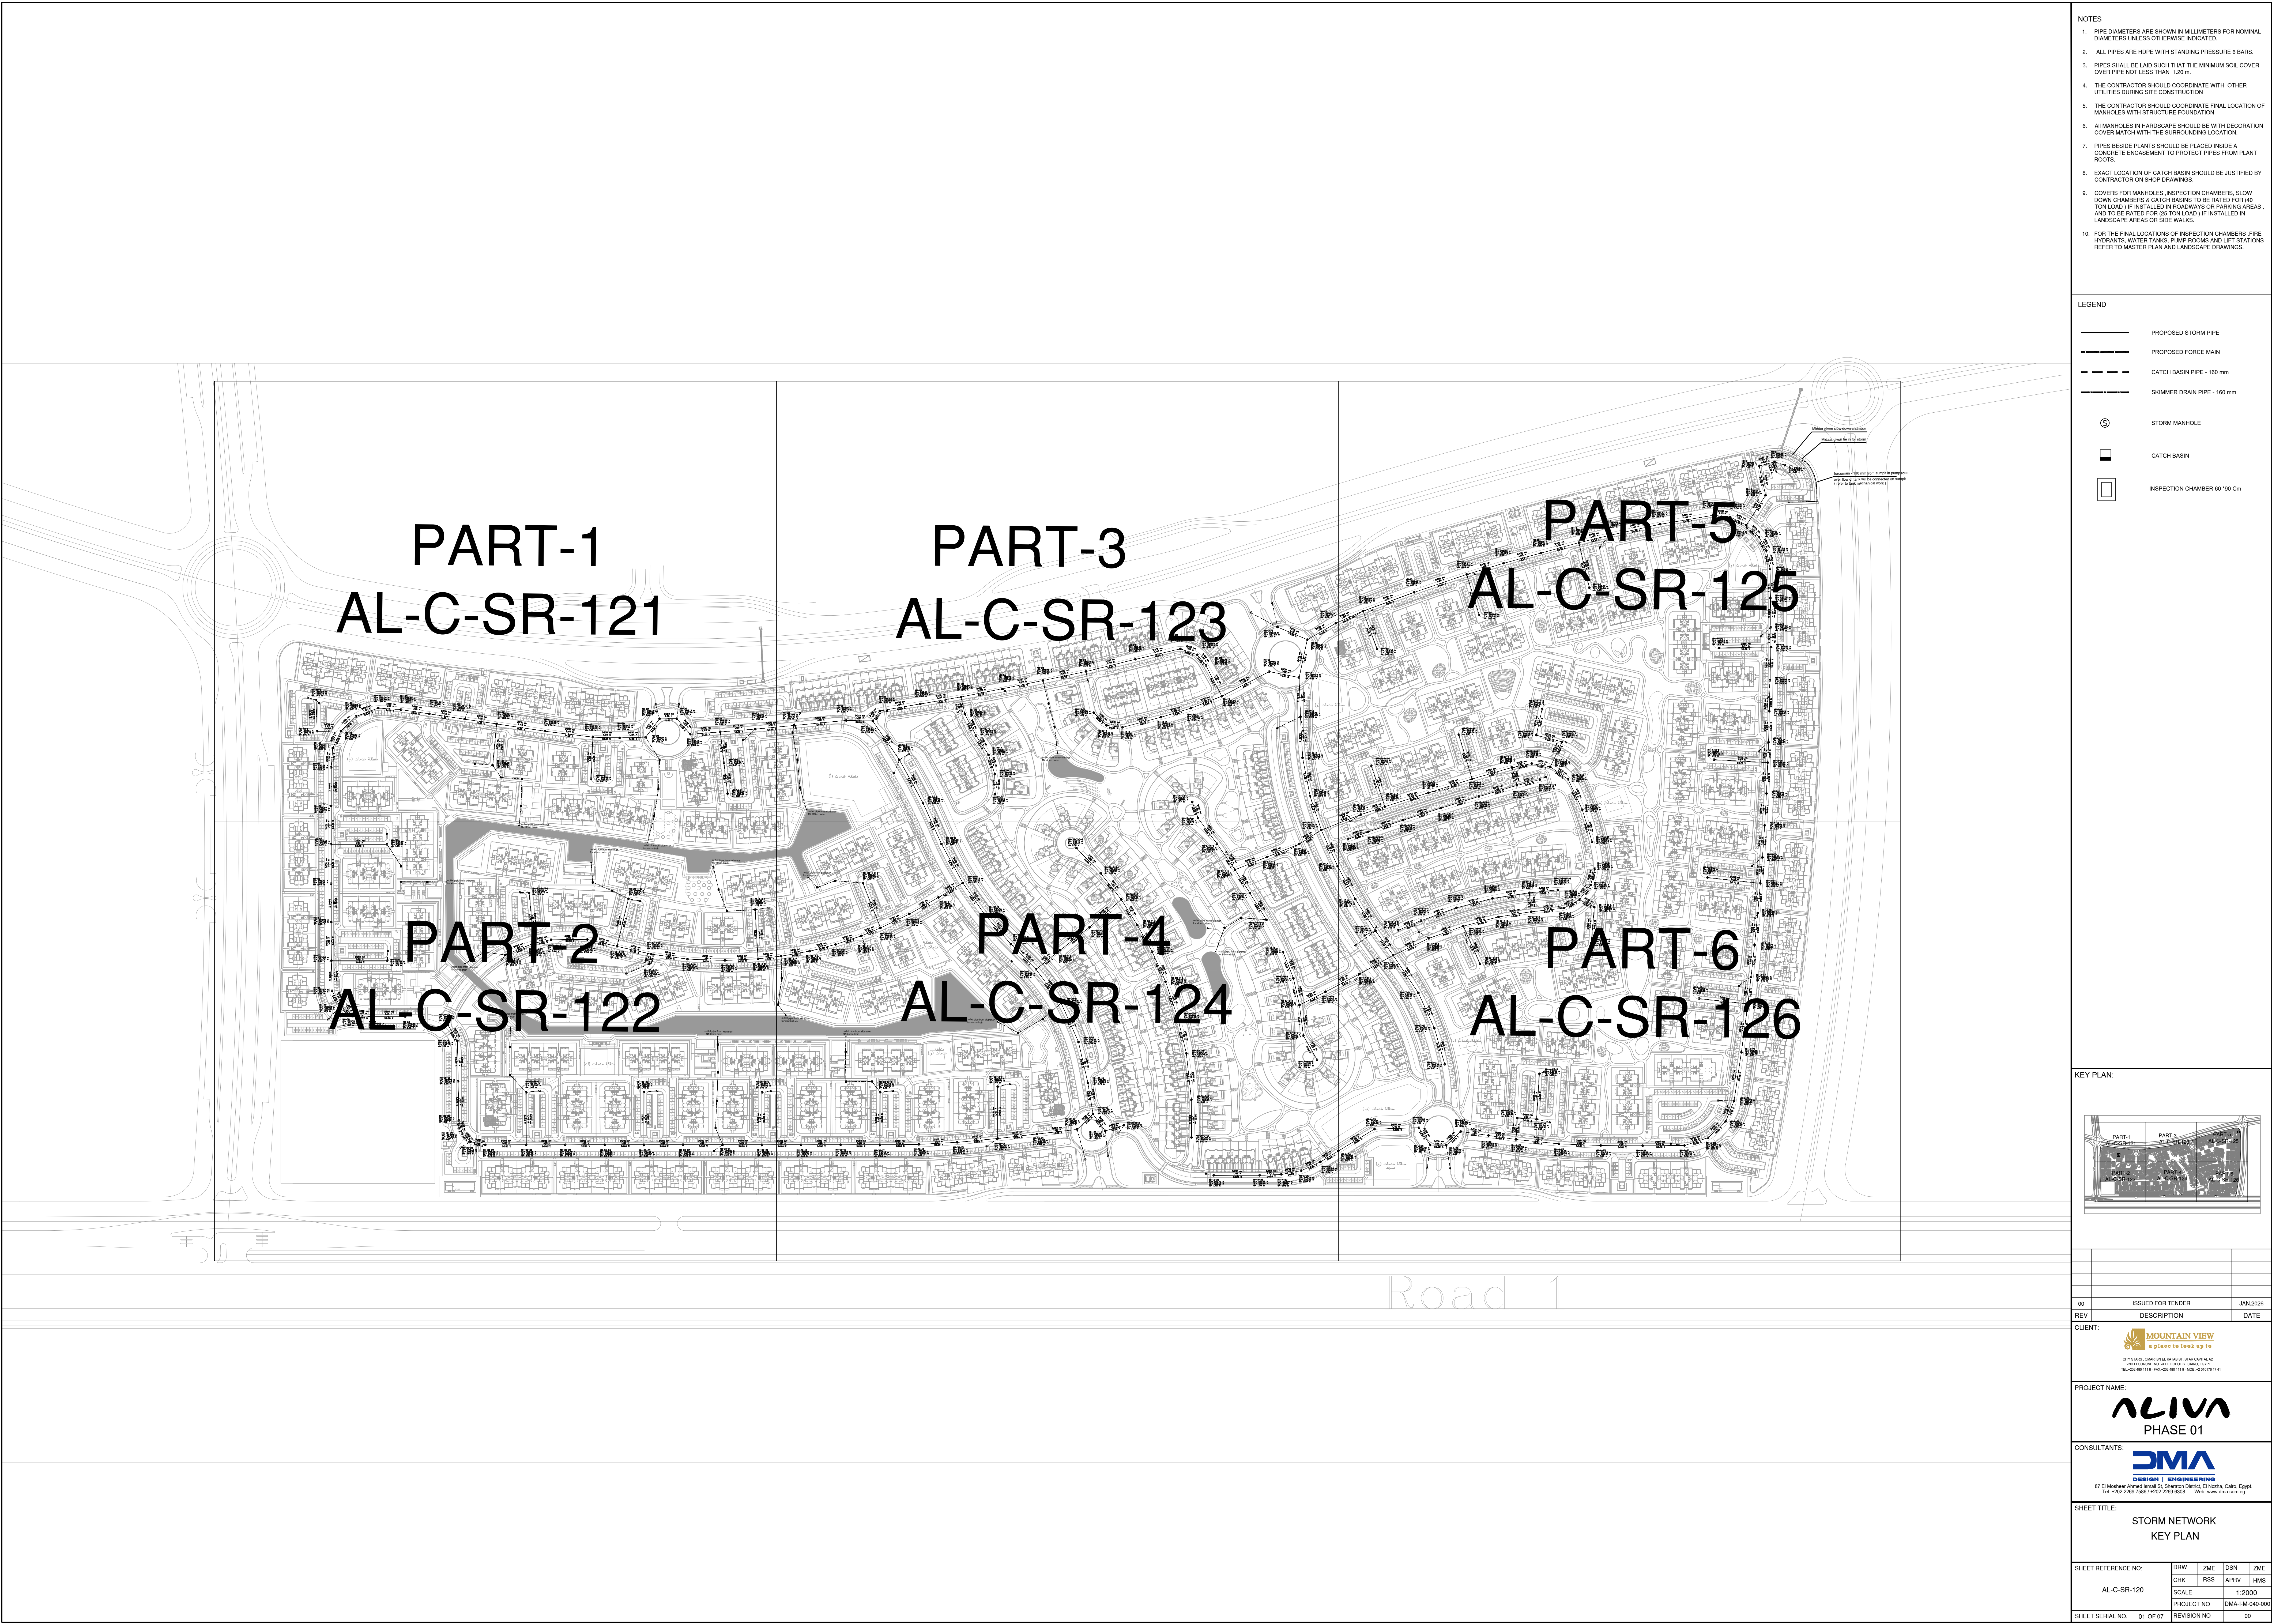

- NOTES
1. PIPE DIAMETERS ARE SHOWN IN MILLIMETERS FOR NOMINAL DIAMETERS UNLESS OTHERWISE INDICATED.
 2. ALL PIPES ARE HOPE WITH STANDING PRESSURE 8 BARS.
 3. PIPES SHALL BE Laid SUCH THAT THE MINIMUM SOIL COVER OVER PIPE NOT LESS THAN 1.20 m.
 4. THE CONTRACTOR SHOULD COORDINATE WITH OTHER UTILITIES DURING SITE CONSTRUCTION.
 5. THE CONTRACTOR SHOULD COORDINATE FINAL LOCATION OF MANHOLES WITH STRUCTURE FOUNDATION.
 6. ALL MANHOLES IN HARDSCAPE SHOULD BE WITH DECORATION COVER MATCH WITH THE SURROUNDING LOCATION.
 7. PIPES BESIDE PLANTS SHOULD BE PLACED INSIDE A CONCRETE ENCASMENT TO PROTECT PIPES FROM PLANT ROOTS.
 8. EXACT LOCATION OF CATCH BASIN SHOULD BE JUSTIFIED BY CONTRACTOR ON SHOP DRAWINGS.
 9. COVERS FOR MANHOLES, INSPECTION CHAMBERS, SLOW DOWN CHAMBERS & CATCH BASINS TO BE RATED FOR (40 TON LOAD) IF INSTALLED IN ROADWAYS OR PARKING AREAS, AND TO BE RATED FOR (25 TON LOAD) IF INSTALLED IN LANDSCAPE AREAS OR SIDE WALKS.
 10. FOR THE FINAL LOCATIONS OF INSPECTION CHAMBERS, FIRE HYDRANTS, WATER TANKS, PUMP ROOMS AND LIFT STATIONS REFER TO MASTER PLAN AND LANDSCAPE DRAWINGS.

- LEGEND
- PROPOSED STORM PIPE
 - PROPOSED FORCE MAIN
 - CATCH BASIN PIPE - 160 mm
 - SKIMMER DRAIN PIPE - 160 mm
 - STORM MANHOLE
 - CATCH BASIN
 - INSPECTION CHAMBER 60"x60" Cn

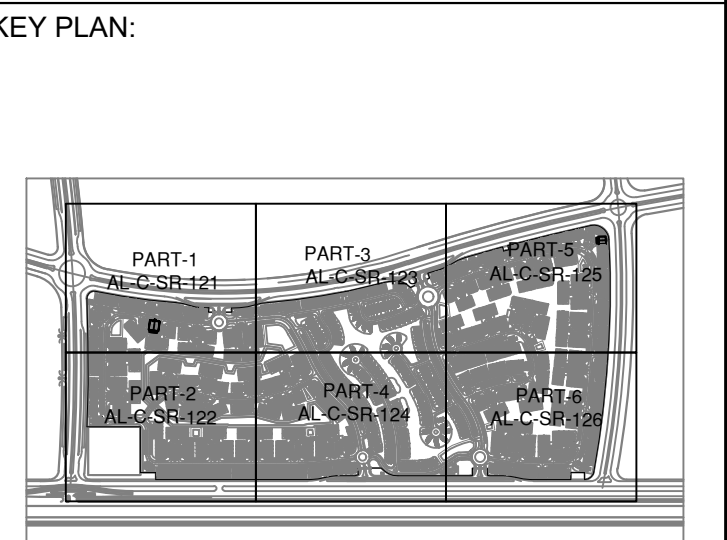

01	ISSUED FOR TENDER	JAN/2026
REV	DESCRIPTION	DATE

CLIENT:

MOUNTAIN VIEW
a place to look up to

CITY OF ALQA, QUAH MOUNTAIN VIEW AT QUAH CAPITAL, ALQA
10000 QUAH MOUNTAIN VIEW AT QUAH CAPITAL, ALQA
TEL: +922 2281 1386 / +922 2281 1388 / FAX: +922 482 1113 / MOB: +922 482 1113

PROJECT NAME:

ALIVA
PHASE 01

CONSULTANTS:

DMA
DESIGN | ENGINEERING

87 E. Moabeh Almad Almad St, Sharmah District, El Noorah, Cairo, Egypt
Tel: +922 2281 1386 / +922 2281 1388 / FAX: +922 482 1113 / MOB: +922 482 1113

SHEET TITLE:

**STORM NETWORK
KEY PLAN**

SHEET REFERENCE NO:	DRW	ZME	DSN	ZME
CHK	RSS	APRV	HMS	
AL-C-SR-120	SCALE	1:2000		
PROJECT NO	DMA-H-M-040-000			
SHEET SERIAL NO	01 OF 07	REVISION NO		00