




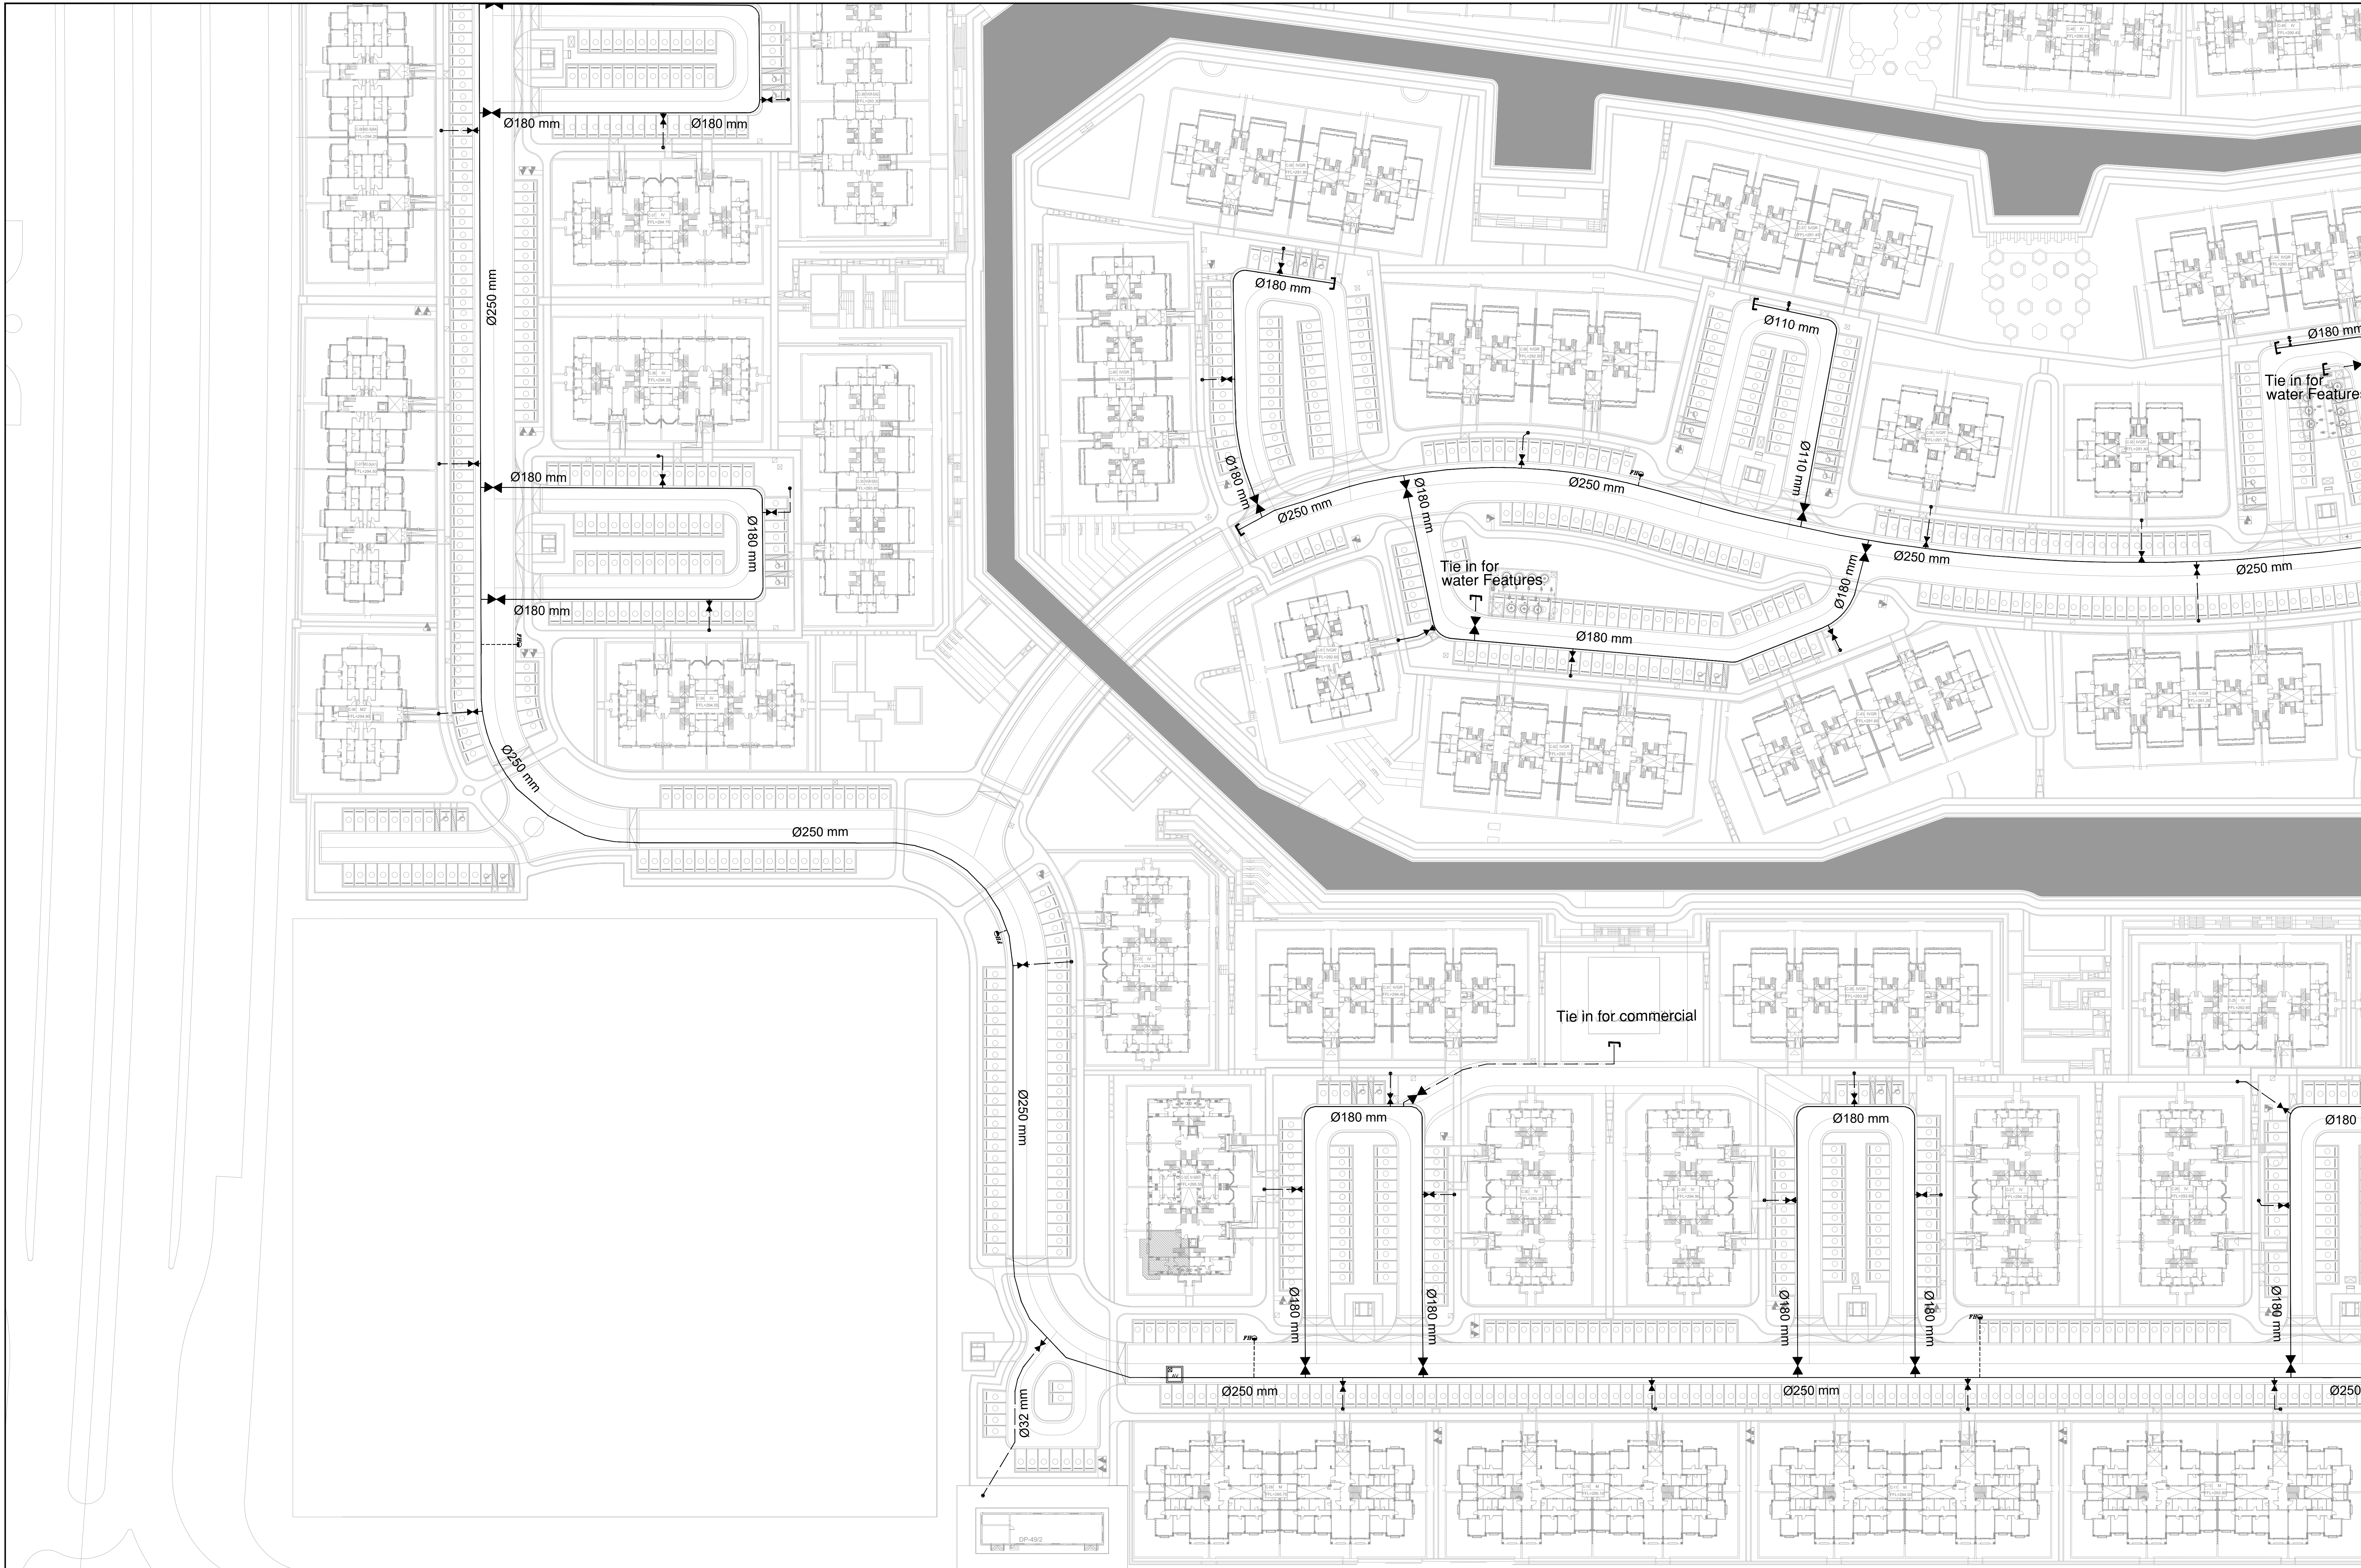

- NOTES
1. PIPE DIAMETERS ARE SHOWN IN MILLIMETERS FOR NOMINAL DIAMETERS UNLESS OTHERWISE INDICATED.
 2. ALL PIPES SHALL BE HDPE WITH STANDING PRESSURE 16 BARS.
 3. PIPES SHALL BE LAID SUCH THAT THE MINIMUM SOIL COVER OVER PIPE CROWN NOT LESS THAN 1.20 m.
 4. PIPES SHALL BE LAID INSIDE A SLEEVE AT ANY CROSSING WITH THE ROAD FOR MAINTENANCE.
 5. PIPES BESIDE PLANTS SHOULD BE PLACED INSIDE A CONCRETE ENCASEMENT TO PROTECT PIPES FROM PLANT ROOTS.
 6. A GATE VALVE SHOULD BE ERRECTED BEFORE EACH BUILDING TIE-IN.
 7. ALL BUILDINGS TIE-IN DIAMETER SHALL BE ACCORDING TO PLUMBING DESIGN.
 8. THE CONTRACTOR SHOULD COORDINATE THE FINAL LOCATION OF THE WATER TIE-INS ACCORDING TO SITE CONDITION.
 9. THE CONTRACTOR SHOULD COORDINATE WITH OTHER UTILITIES DURING SITE CONSTRUCTION.
 10. FOR THE FINAL LOCATIONS OF INSPECTION CHAMBERS, FIRE HYDRANTS, WATER TANKS, PUMP ROOMS AND LIFT STATIONS REFER TO MASTER PLAN AND LANDSCAPE DRAWINGS.

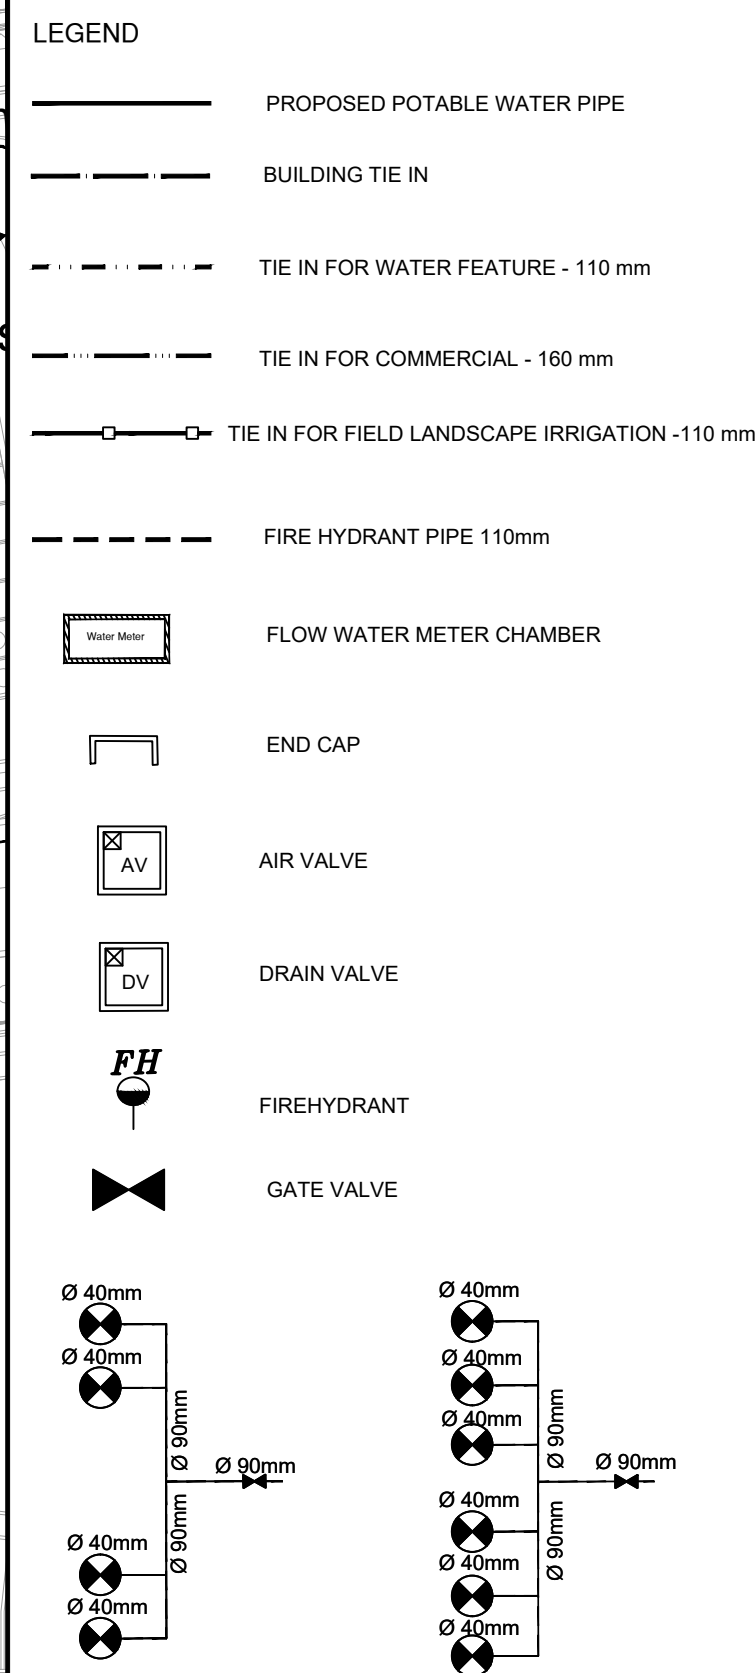

TYPE NAME	BUILDING TIE IN DIAM.
IV	Ø90mm
IV-S	Ø90mm
IV-S(A1)	Ø90mm
IV-S(A2)	Ø90mm
M	Ø110mm
M-S	Ø110mm
M2	Ø90mm
M2-S	Ø90mm
M2-S(A1)	Ø90mm
MNS	Ø50mm
LH	Ø50mm
GH	Ø50mm
TH04	Ø40mm
TH06	Ø40mm
THG-04	Ø40mm
THG-06	Ø40mm
V255	Ø40mm
V285	Ø40mm
IVGR	Ø90mm
IVGR-S	Ø90mm
IVGR-S(A1)	Ø90mm
IVGR-S(A2)	Ø90mm
M'-S(A4)	Ø110mm
M2'	Ø75mm
IVGR'	Ø75mm
IVGR'-S(A2)	Ø75mm
IVGR'-S(A3)	Ø75mm
IVGR'-S(A4)	Ø75mm

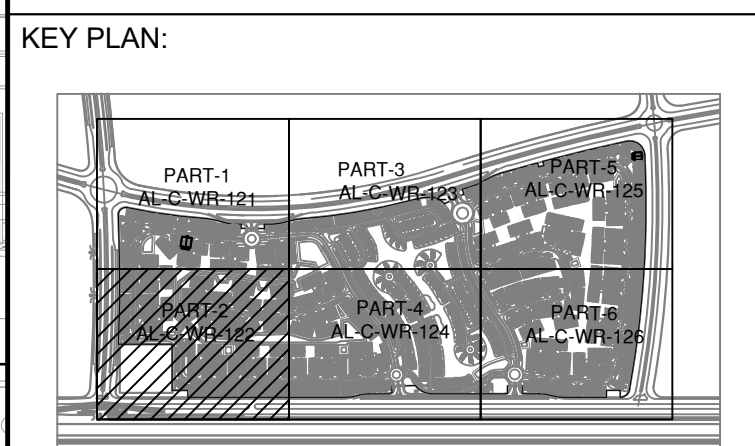

REV	DESCRIPTION	DATE
00	ISSUED FOR TENDER	JAN 2021

CLIENT: **MOUNTAIN VIEW**
a place to look up to
CITY STARS, CHAIRS DEVELOPMENT ST. CITY CAPITAL, AL
PLOT NO. 1111 & 1112, EL HELWAN, EL HELWAN GOV.
TEL: +966 2299 7586 / +966 2299 8336 / FAX: +966 481 1115 / MOB: +966 1115 1114

PROJECT NAME: **ALIVA**
PHASE 01

CONSULTANTS: **DMA**
DESIGN | ENGINEERING
87 El Mostahar Ahmed Street, 5, Sheraton District, El Helwan, Cairo, Egypt
Tel: +966 2299 7586 / +966 2299 8336 / Fax: +966 481 1115 / Mob: +966 1115 1114

SHEET TITLE: **POTABLE WATER & FIRE FIGHTING NETWORK**
LAYOUT PART (2/6)

SHEET REFERENCE NO.	DRW	ZME	DSN	ZME
AL-C-WR-122	CHK	RSS	APRV	INB
SCALE	1:500			
PROJECT NO.	DMA-1-M-040-000			
SHEET SERIAL NO.	03 OF 07	REVISION NO.		00