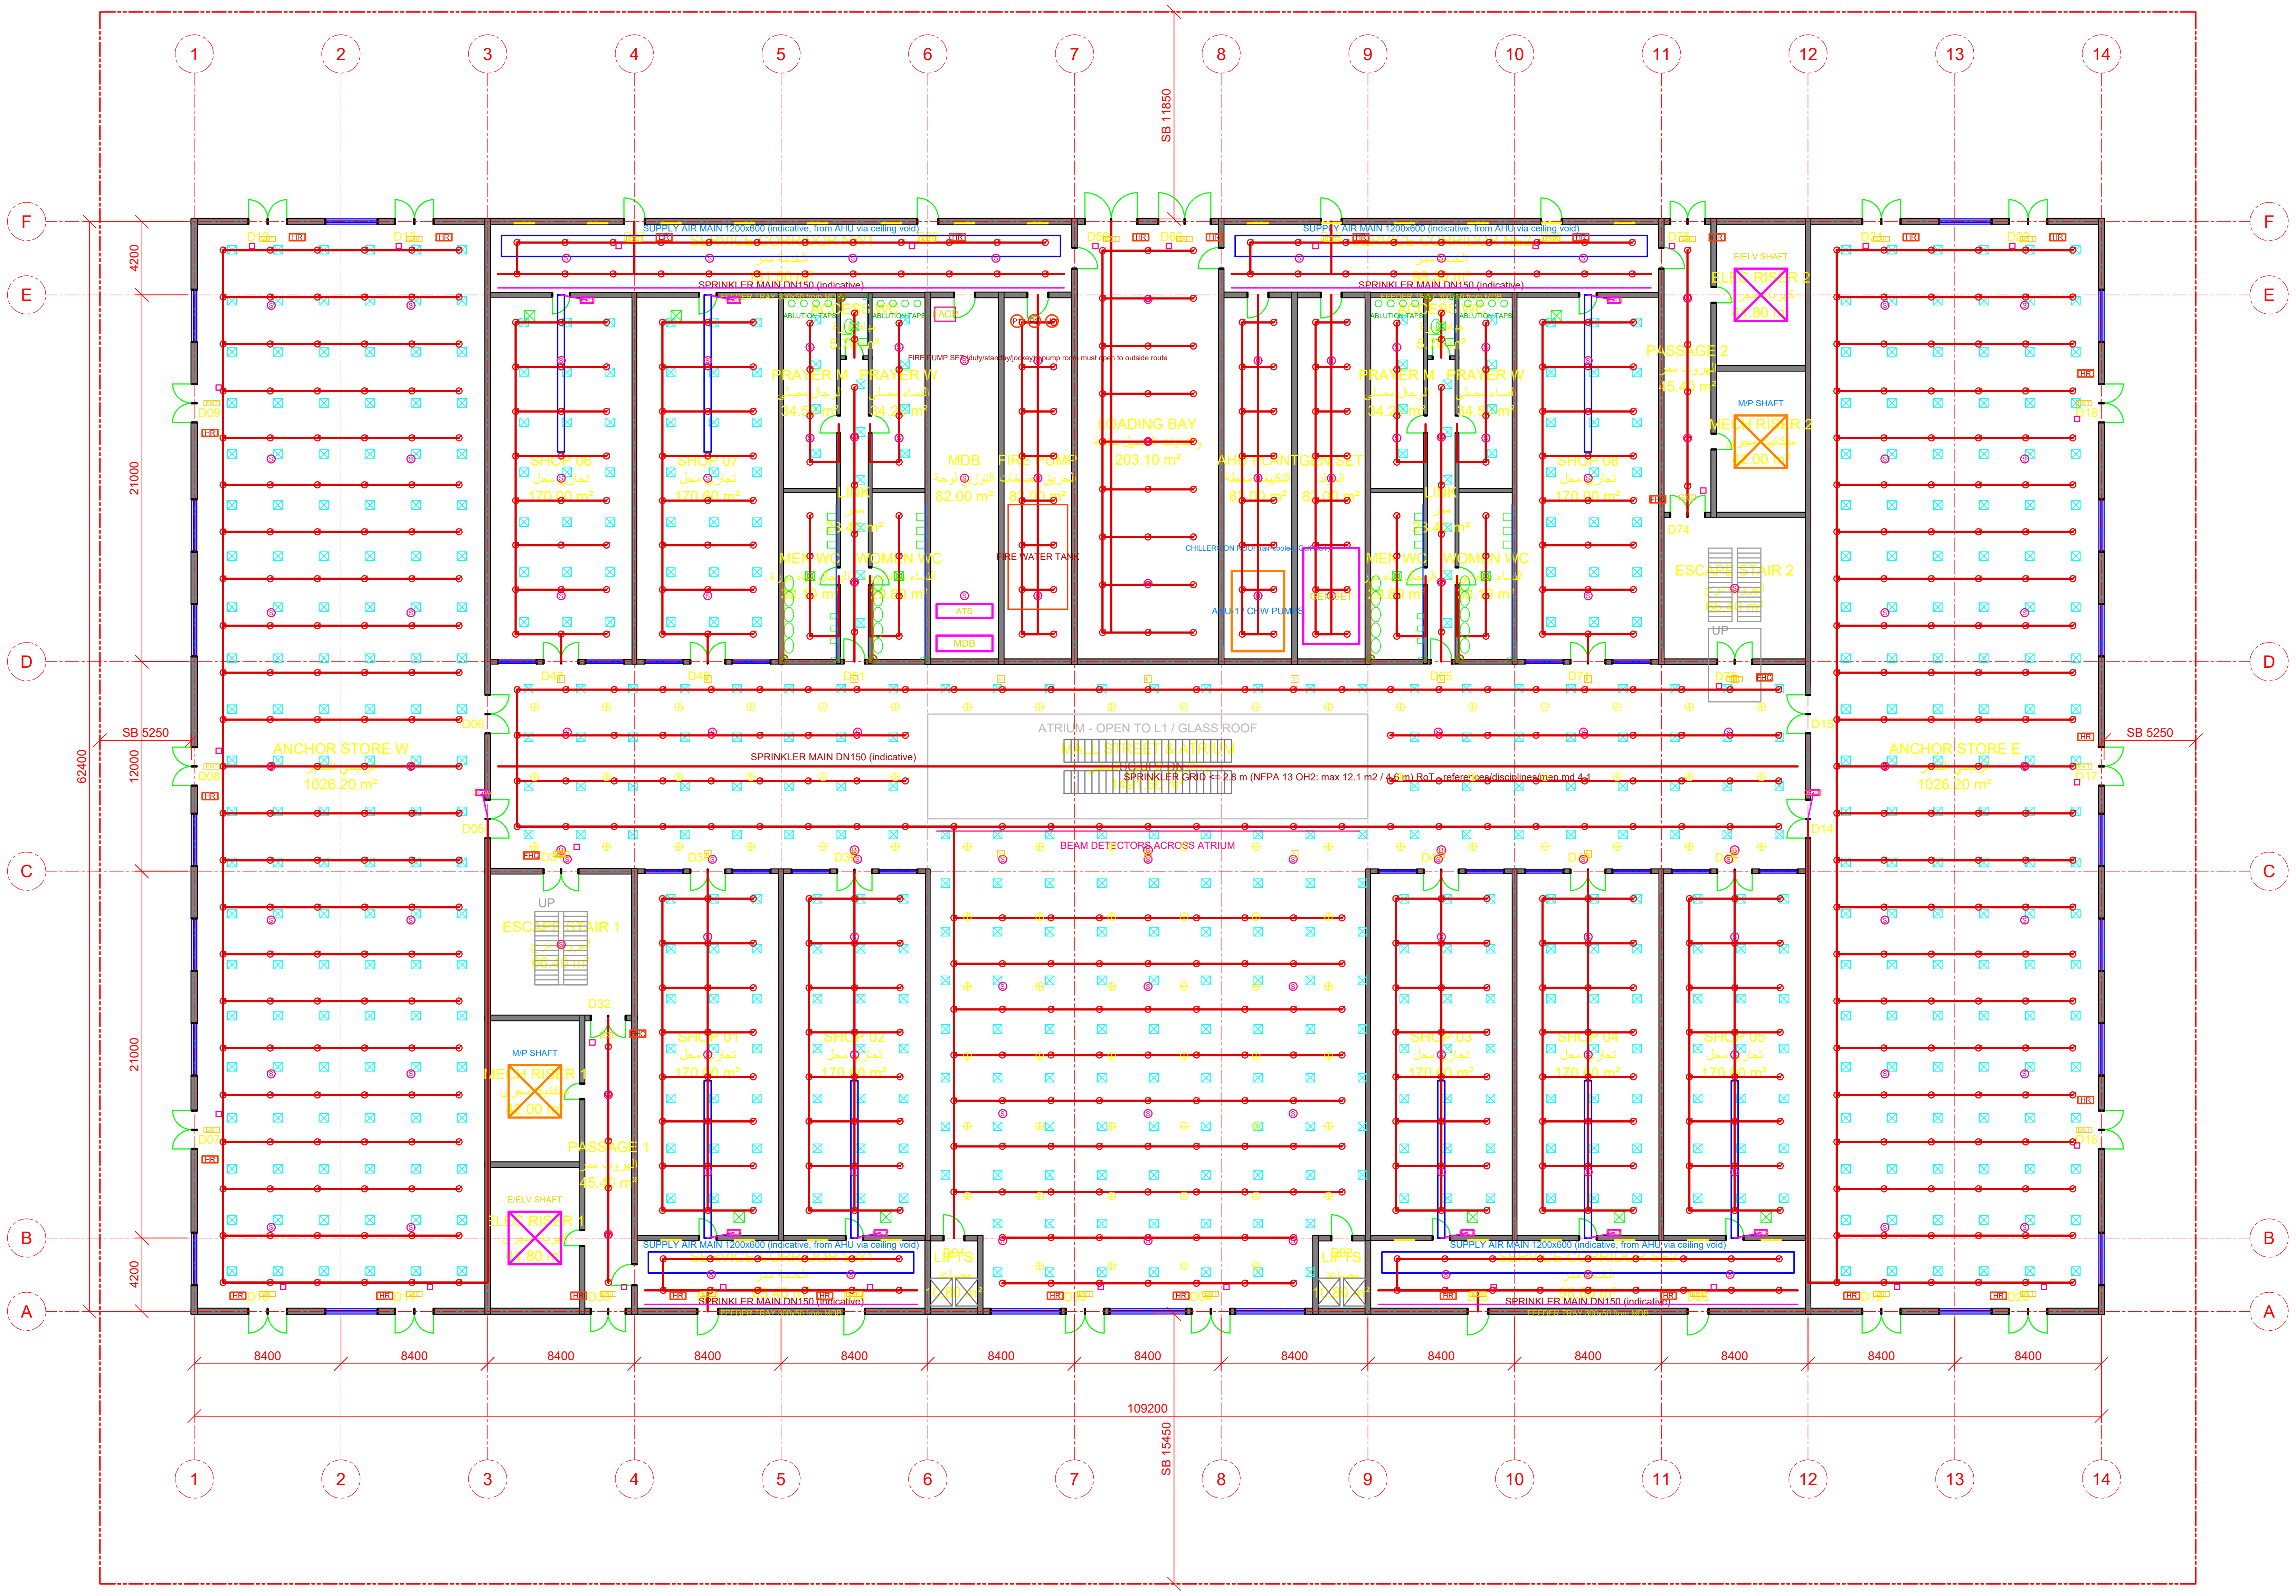
1
2
3
4
5
6
7
8
9
10
11
12
13
14
F
E
D
C
B
A
SB 11850
SB 15450
SB 5250
SB 5250
62400
4200
21000
12000
21000
4200
8400
109200
ANCHOR STORE W
1026.20 m²
ANCHOR STORE E
1026.20 m²
LOADING BAY
MDB
FIRE WATER TANK
ATS
AHU-1 / CHW PUMPS
GENSET
WOMEN WC
MEN WC
ESCAPE STAIR 1
ESCAPE STAIR 2
UP
E/ELV SHAFT
M/P SHAFT
SUPPLY AIR MAIN 1200x600 (indicative, from AHU via ceiling void)
SPRINKLER MAIN DN150 (indicative)
ATRIUM - OPEN TO L1 / GLASS ROOF
MALL STREET & ATRIUM
SPRINKLER GRID <= 2.8 m (NFPA 13 OH2: max 12.1 m2 / 4.6m) RoT - references/disciplines/mep.md 4.1
BEAM DETECTORS ACROSS ATRIUM
FHC
D14
D15

AREA SCHEDULE
PLOT AREA: 10800.00 m²
GROUND FLOOR FOOTPRINT: 6865.65 m²
GROUND COVERAGE: 63.6 %

CODE CHECK (ASSUMED 5/3/3 m - no commercial-zone setbacks in country file [verify])
SOUTH front setback 15450 >= 5000: PASS
NORTH rear setback 11850 >= 3000: PASS
WEST side setback 5250 >= 3000: PASS
EAST side setback 5250 >= 3000: PASS

SAMPLE PROJECT generated by ArchMind gen_mall.py - not for submission.
GRID 8.4 m [RoT retail 7.5-9 m]; street 12 m, shops 8.4 x 21 m, service corridor 4.2 m [RoT].
TRAVEL LIMIT 76 m: qa.md 5.4 'other areas -> exit' 76 m sprinklered (parsed from table layout) (verify).
Computed max this level 42.1 m.
Exit = final exit door or protected-stair door; path around atrium void; open-plan rooms; sprinklered building (assumed).
SETBACKS F/S/R 5/3/3 m: ASSUMED 5/3/3 m - no commercial-zone setbacks in country file (verify)
ASSUMPTIONS: plot 120 x 90 m, frontage south, loading yard north; service corridors fire-rated, 2+ exits each.
WC + prayer rooms separated men/women (design-concepts.md 6.6 RoT).
Stairs, escalators, atrium void: see MEP/ARCH overlay.

N

MEP / ARCH OVERLAY LEGEND - indicative layouts, not hydraulic/aerodynamic designs; spacing per references/disciplines/mep.md

- FP-SPRK-HEAD Sprinkler head
- FP-SPRK-PIPE Sprinkler branch / main
- E-FALM Smoke(S) / heat(H) detector, call point, sounder
- FP-HOSE Hose reel HR / hose cabinet FHC
- M-HVAC-SCD Supply air diffuser 600x600
- M-HVAC-RCG Return air grille
- M-HVAC-SAD Supply duct main / take-off
- M-HVAC-EQPT AHU / riser shaft
- E-LITE Luminaire (mall street)
- E-LITE-EMER Emergency light / EXIT sign
- E-DB DB / MDB / generator
- E-TRAY Feeder cable tray
- P-FIXT WC / basin / urinal / ablution / grease trap
- P-DCW Cold water branch
- P-SANR Soil / waste stack + branch
- A-FLOR-STRS Stair treads / UP arrow
- A-FLOR-OTLN Atrium void edge
- A-FLOR-EVTR Lift car / escalator

PROJECT المشروع
Sample Shopping Mall نموذجي تسوق مركز
CLIENT المالك
Showcase
PLOT / PIN No. القطعة رقم
PIN 00000000 (sample)
DRAWING اللوحة اسم
Ground Floor Plan الأرضي الدور مسقط
DRAWING No. اللوحة رقم
A-101
SCALE المقياس
1:250 @ A1
DATE التاريخ
2026-10-29
REV المراجعة
0
DRAWN BY إعداد
ArchMind gen_mall