




Agnes Xi Yao
Energy Simulation Results

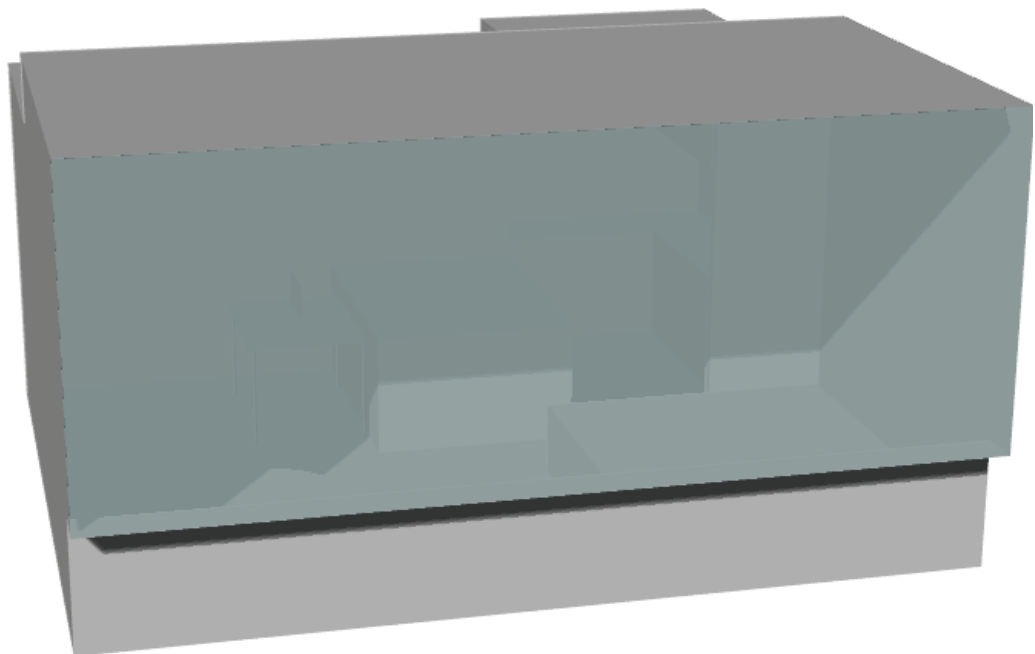

Annual Cooling : 2578.92
Annual Heating : 179.56
Total : 2758.48

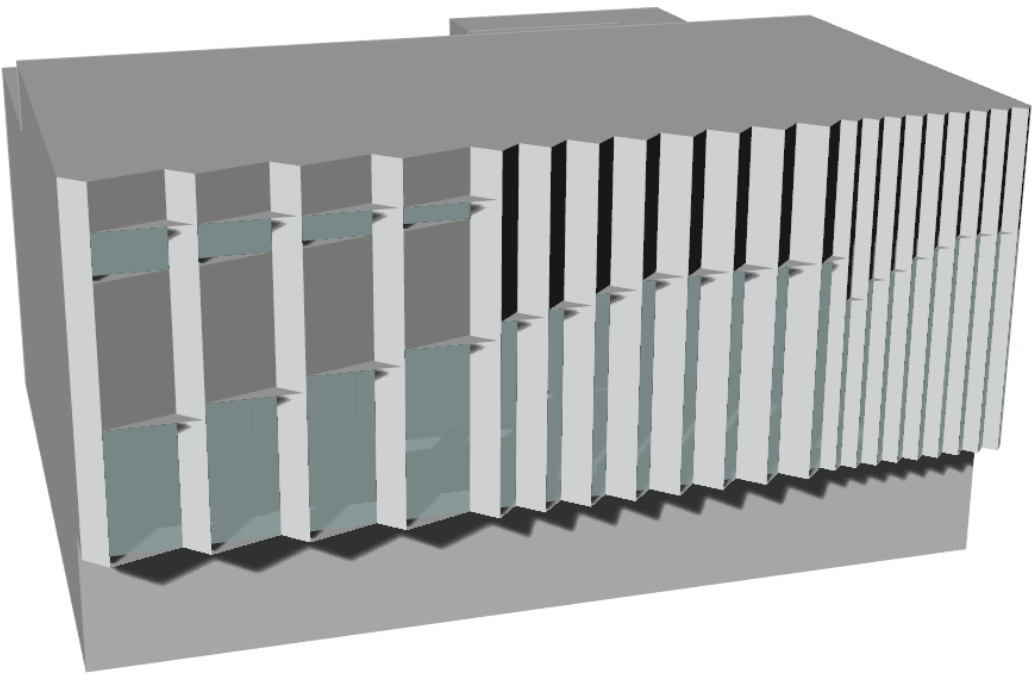


Annual Cooling : 1474.23
Annual Heating : 141.42
Total : 1615.65

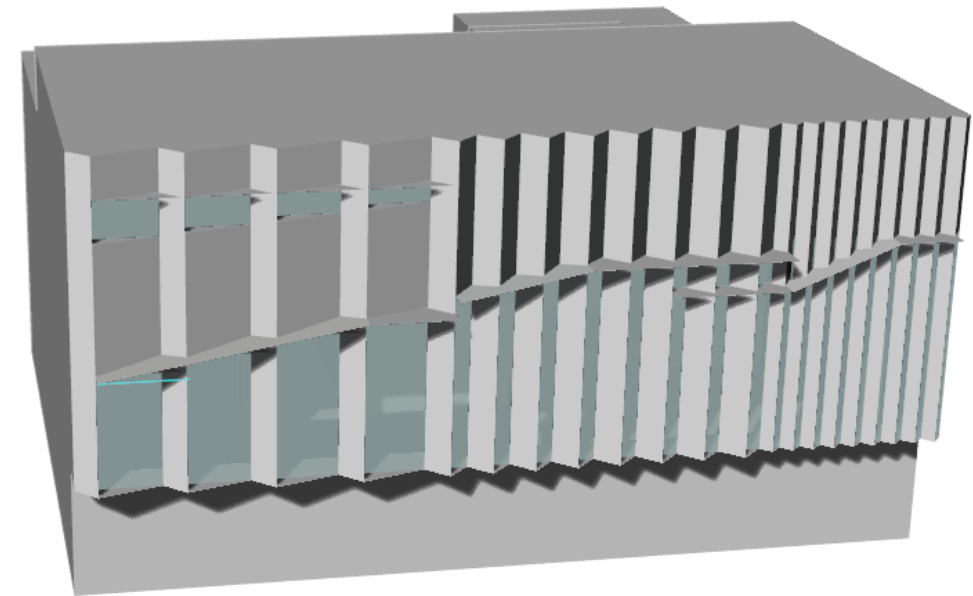


Annual Cooling : 1330.45
Annual Heating : 166.27
Total : 1496.72




Cooling and Heating Loads

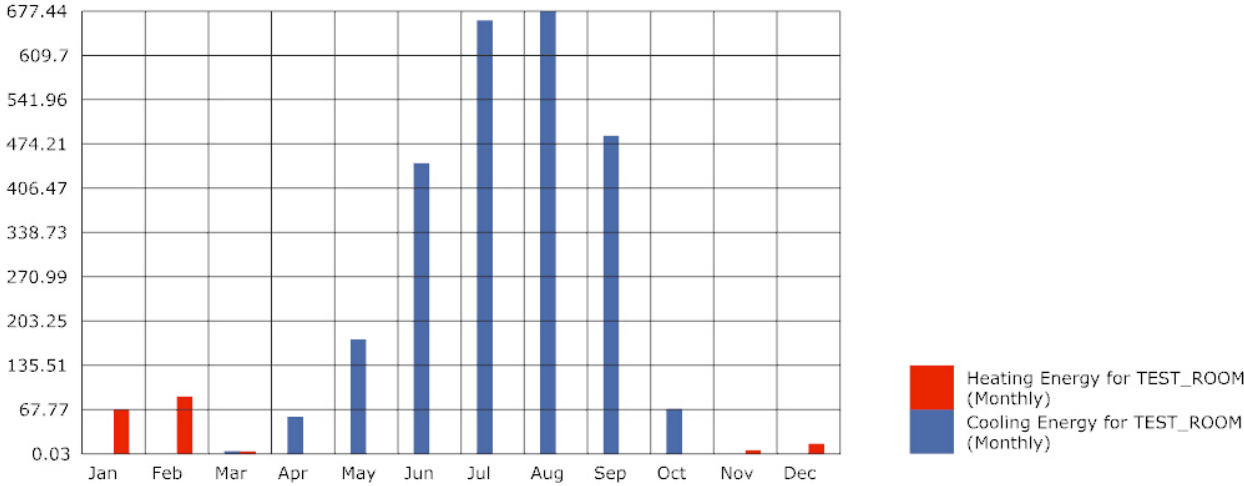

Annual Cooling : 2578.92
Annual Heating : 179.56
Total : 2758.48

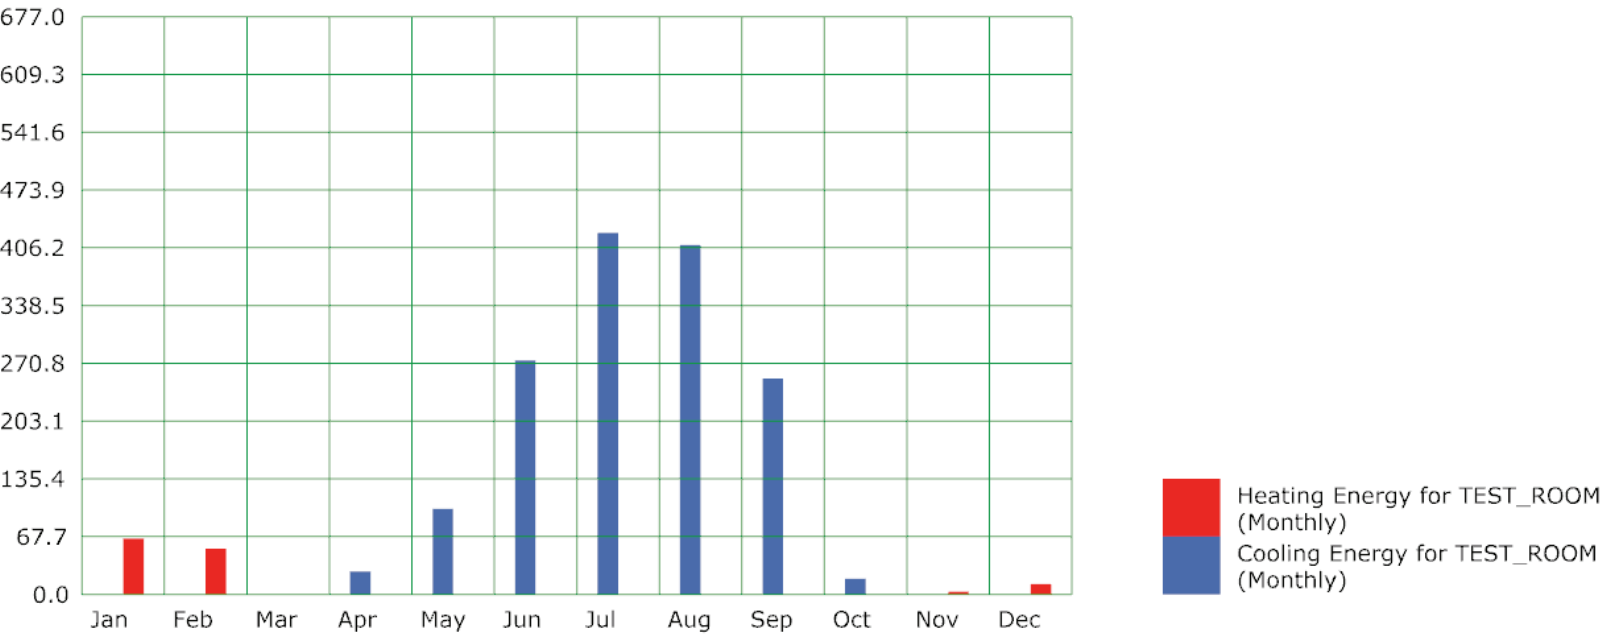

Annual Cooling : 1474.23
Annual Heating : 141.42
Total : 1615.65

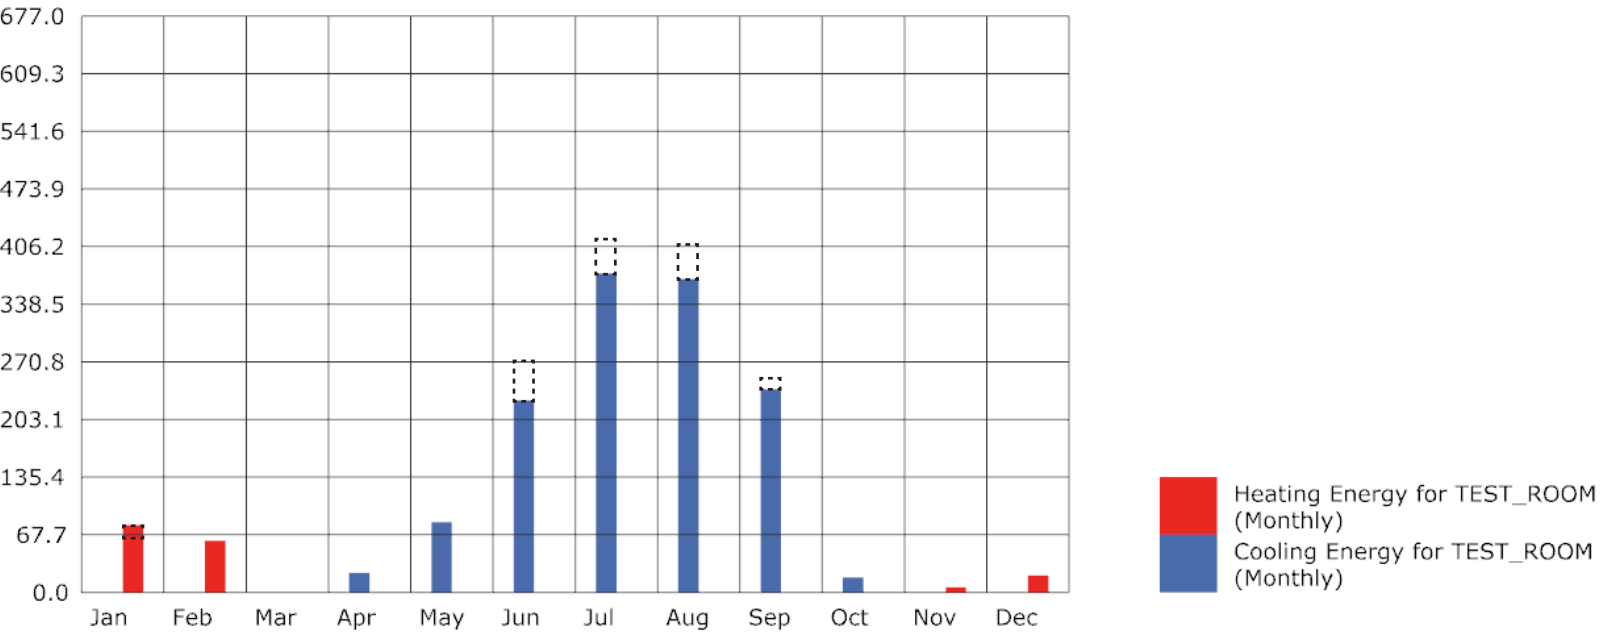

Annual Cooling : 1330.45
Annual Heating : 166.27
Total : 1496.72