
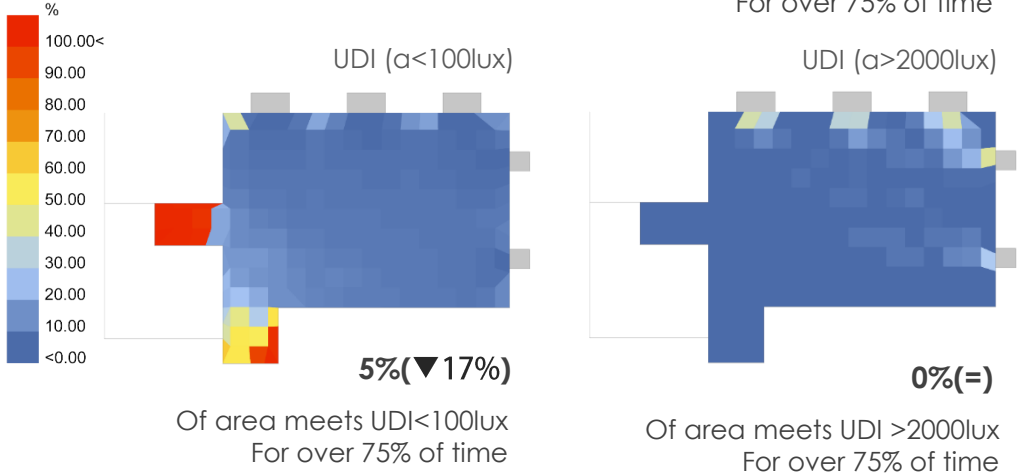
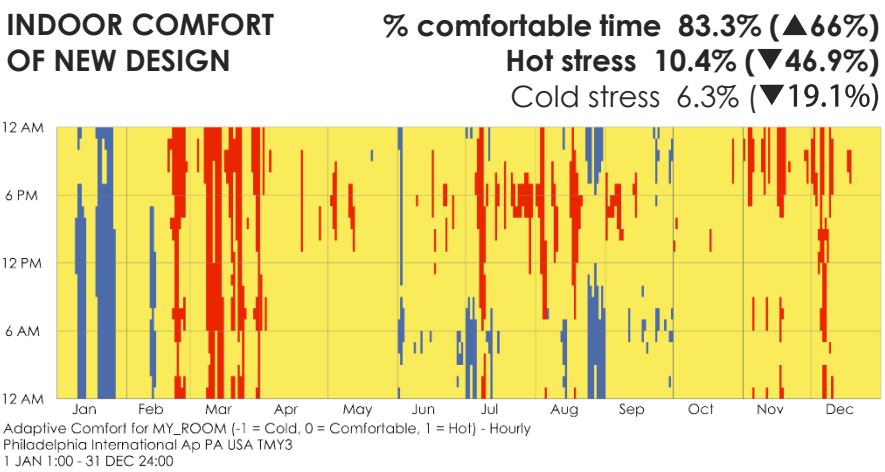
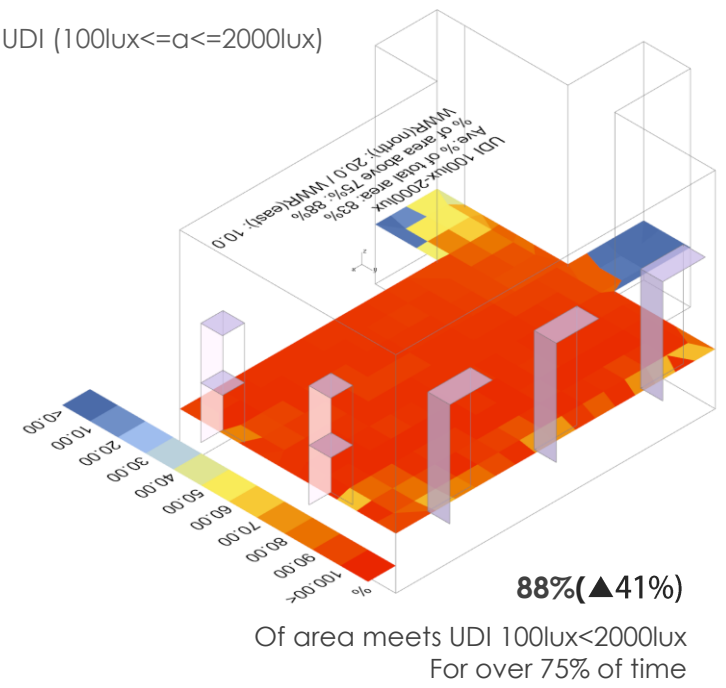
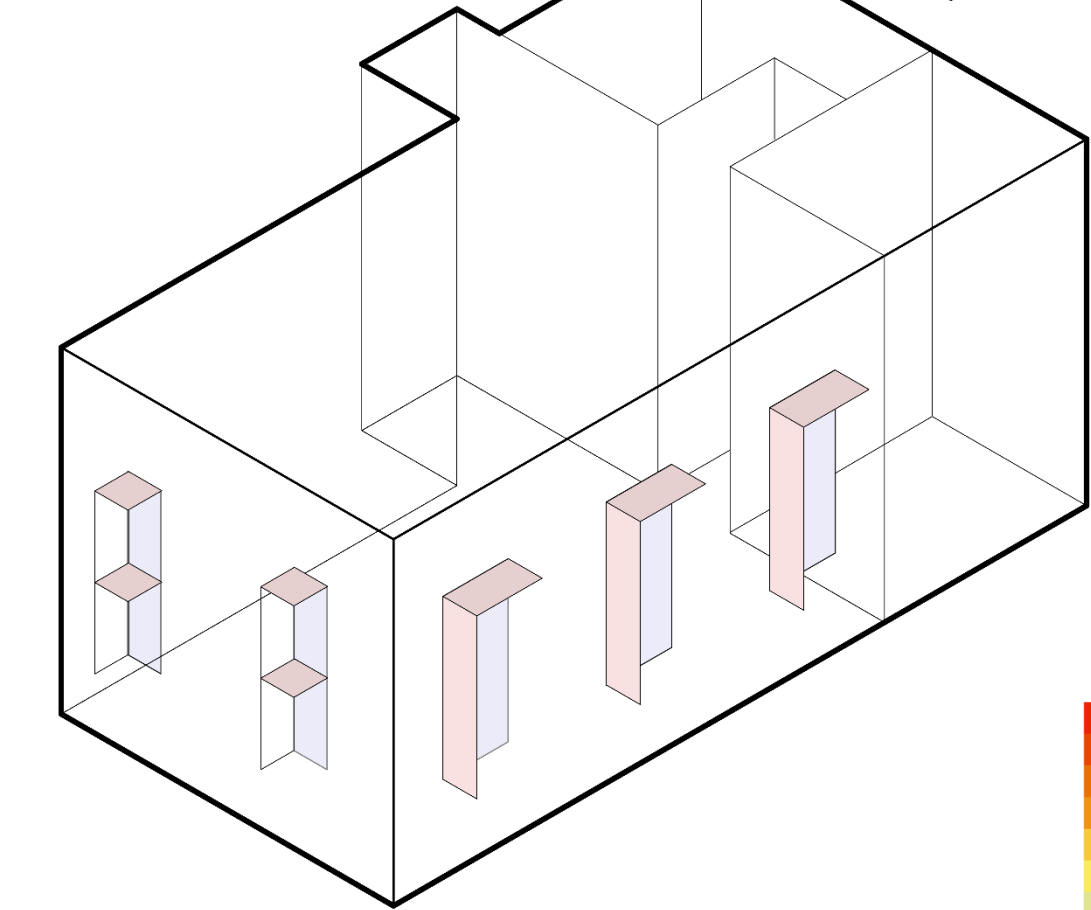
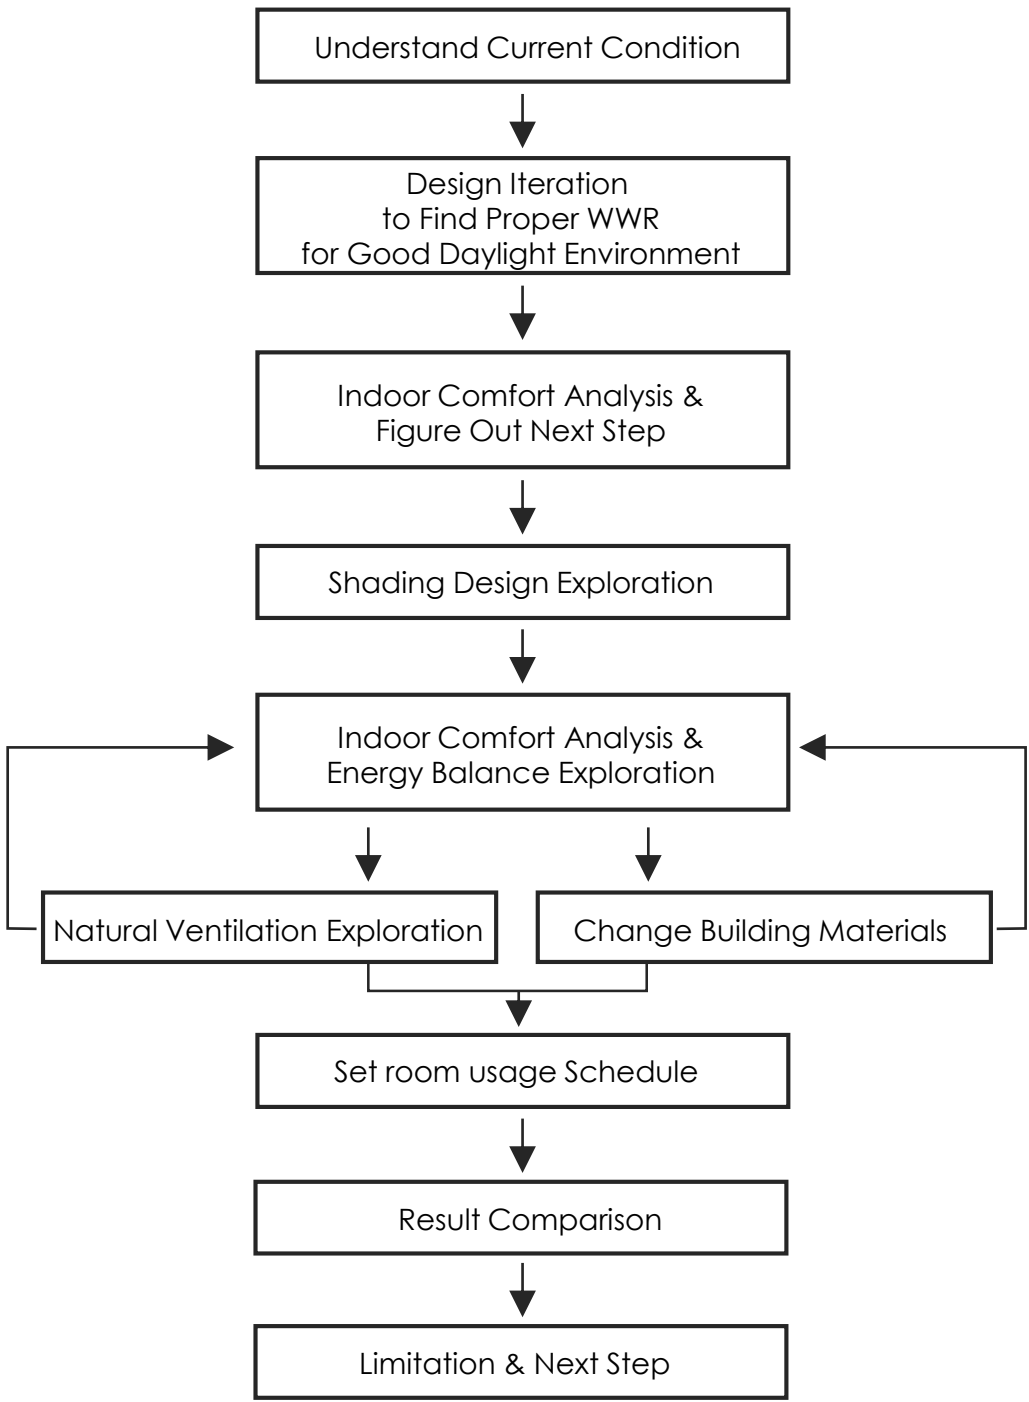
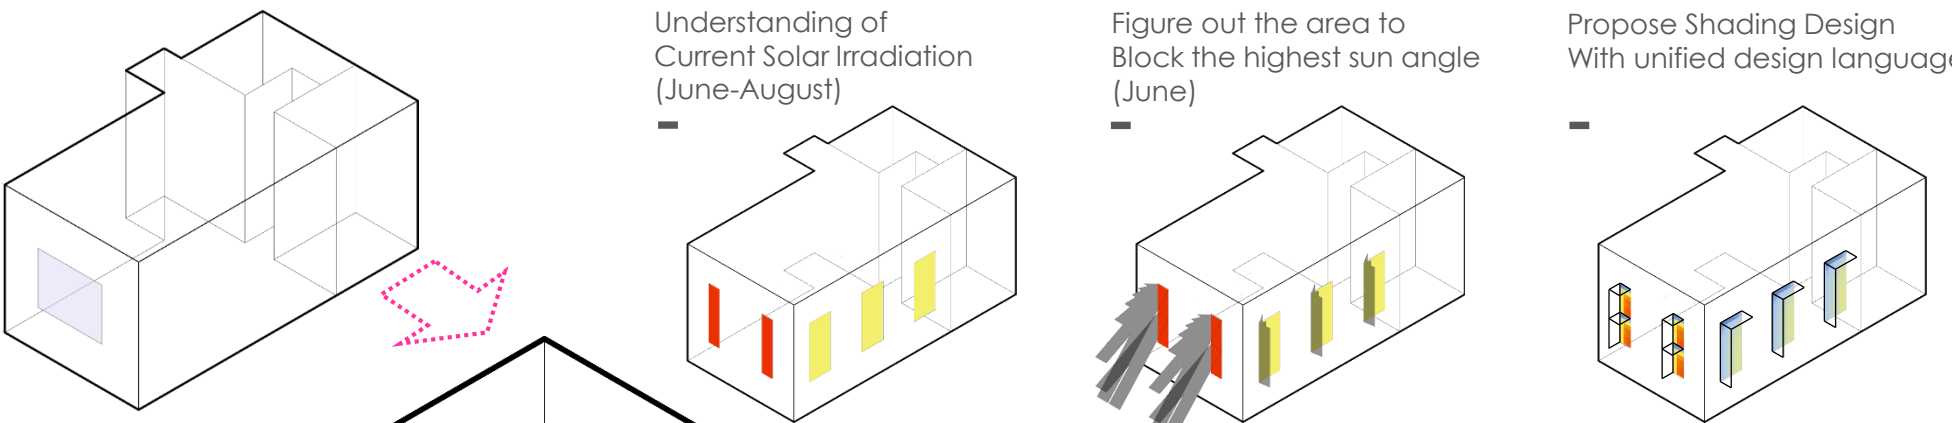


# NO MORE HVAC, BE A DREAM ROOM WITH NATURE!

## BASELINE INDOOR COMFORT & ANNUAL ILLUMINANCE ANALYSIS

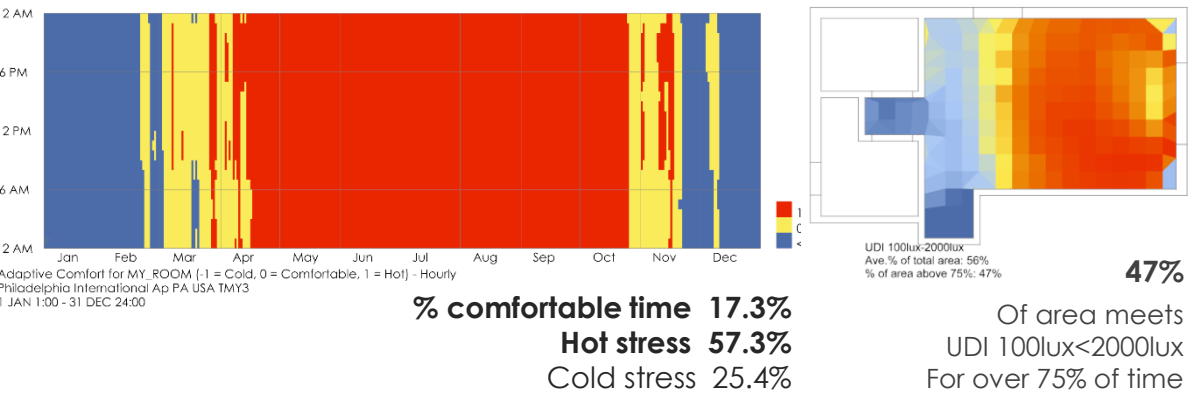

Natural Ventilation & Infiltration Setting	Building Properties
Min Indoor Temp. for Nat.Vent 23 °C Max Indoor Temp. for Nat.Vent 34 °C Min outdoor Temp. for Nat.Vent 10 °C Max outdoor Temp. for Nat.Vent 27 °C Infiltration Rate 0.0001	Exterior wall R-VALUE: 4.74 Window U-VALUE: 0.5 Window SHGC: 0.37 Window VT: 0.56