


Energy Analysis

Room with Shade

Percent of Time Comfortable: 22%
Percent of Time Hot: 67%
Percent of Time Cold: 9%

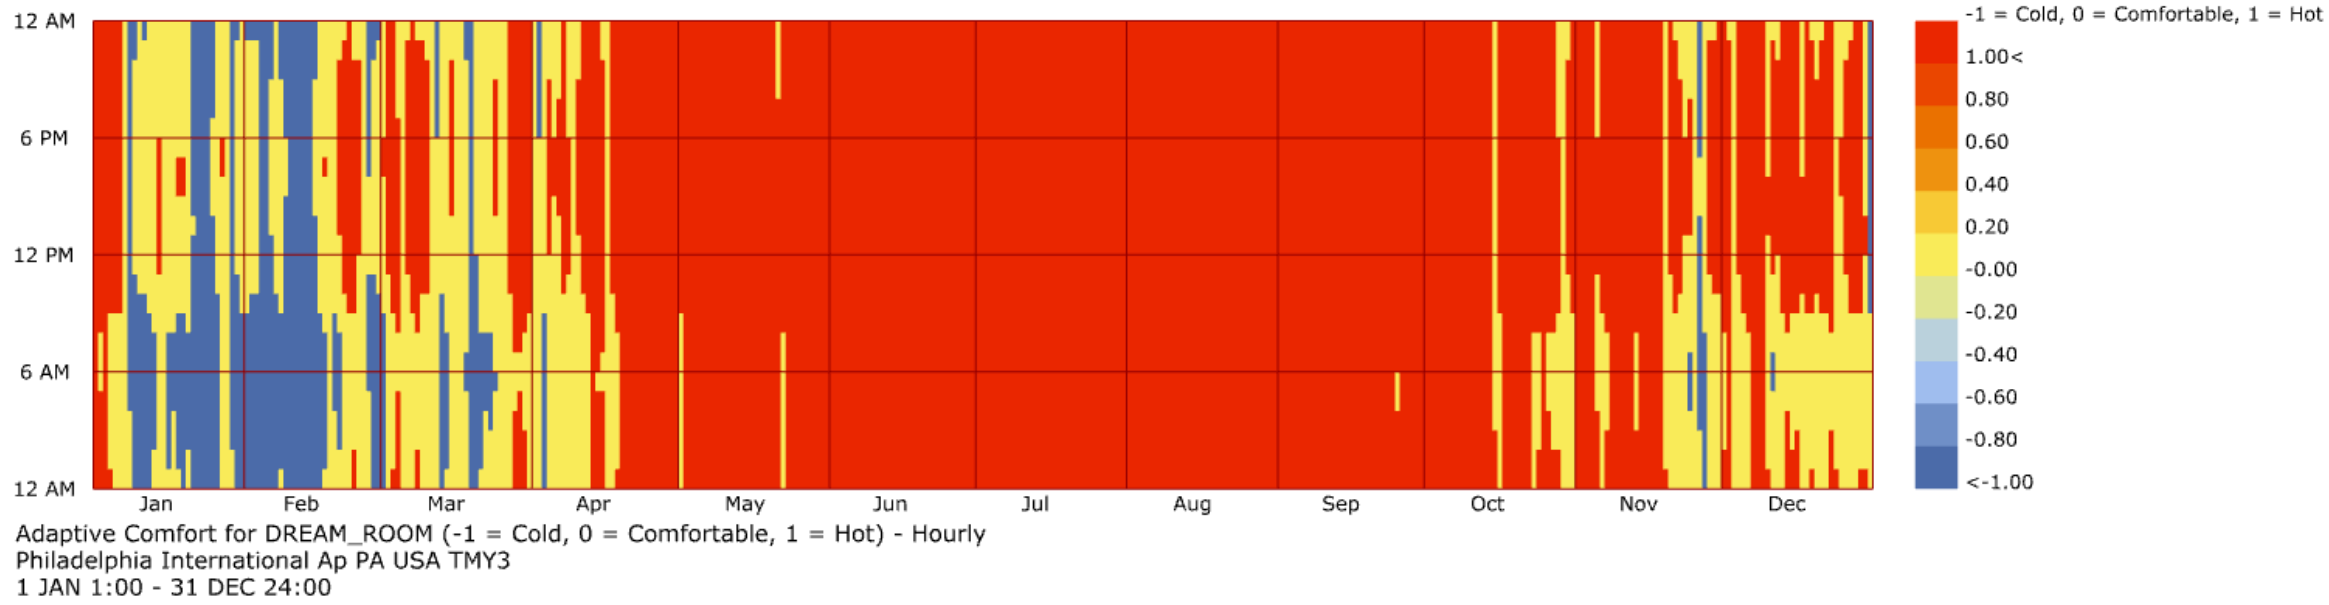


Fan Driven Ventilation

Percent of Time Comfortable: 19%
Percent of Time Hot: 43%
Percent of Time Cold: 36%



Change Wall Materials

Percent of Time Comfortable: 25%
Percent of Time Hot: 23%
Percent of Time Cold: 50%

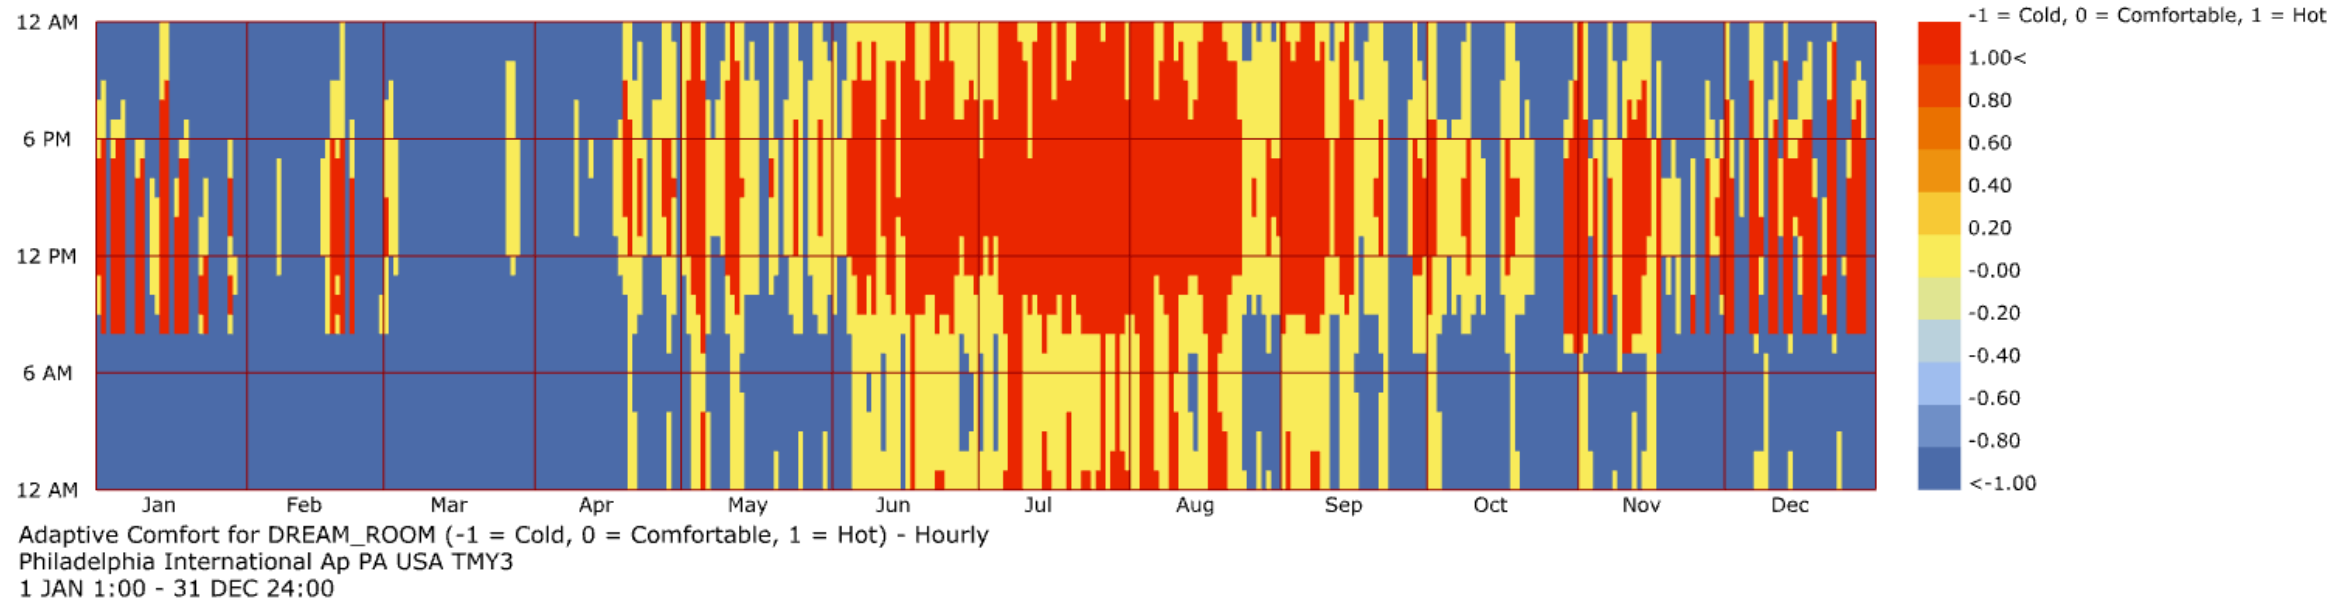

Change to Natural Ventilation

Percent of Time Comfortable: 58%
Percent of Time Hot: 13%
Percent of Time Cold: 27%

