IEC-62208	Standard	Panel Arrangement
IP55-Rated Sheet Metal Electrical Enclosure, Including Rittal Panels		
RAL-7035	Colour	
800/1000/300	Dimensions	
~ 20kg	Maximum Weight	
YES	Doors	
YES	Windows / Viewing Panels	
NO	Cable Passage	
Bottom Cable Entry	Incoming Cables (Main Entrance)	
FORM-2B	Form of Separation	

---	Indoor	Application	Installation
YES	Outdoor		
Wall-Mounted	Installation Method		
Direct / Indirect Contact	Protection Against Electric Shock		
Personnel Only	Skilled		
F	Main Incoming Circuit	Connection Type	
F	Main Outgoing Circuit		
F	Auxiliary Circuits		

0.7	Power Factor (as calculated)	Technical Information
Standard	Environmental Conditions	
35°C	Ambient Temperature	
10KA	Prospective Short-Circuit Current (Icp)	
10KA	Rated Short-Time Withstand Current (Icw)	
In Panel	Short-Circuit Protective Device (SCPD)	
100A	Rated Current (In)	
400V-AC	Rated Operational Voltage (Un = Ue)	
230V-AC	Control Voltage	
50Hz	Frequency	
A (Industrial)	Electromagnetic Environment / EMC	
3	Pollution Degree	
1000V	Rated Insulation Voltage (Ui)	
4KV	Rated Impulse Withstand Voltage (Uimp)	
IK=10	Mechanical Impact Protection	
IP-55	Ingress Protection Rating	

The Electrical Panel has been manufactured in accordance with Israeli Standard SI 61439-2.

WARNING!!! Installation, operation, service, and maintenance of this electrical panel shall be performed by authorized and qualified personnel only.

Date: 02/10/2026	Drawing No.: 26/993	Project Name:	
:1	Designed by: Mahmoud Zoabi	Panel Name: MAIN ELECTRICAL BOARD Customer:	Page No.: 1 OF: 5 Scale: 1:100
:2	Drawn by: Baha Ghamahna		
:3	Approved by: Ofer Alron		

S.S Electrical and control panels
04-8338123: FAX 04-6565394: TEL 276 P.O. Box 3659290200
Email: electrcpss@gmail.com

מערכת ניהול איכות מאושרת
ת"י ISO 9001: 2008
מכון התקנים הישראלי

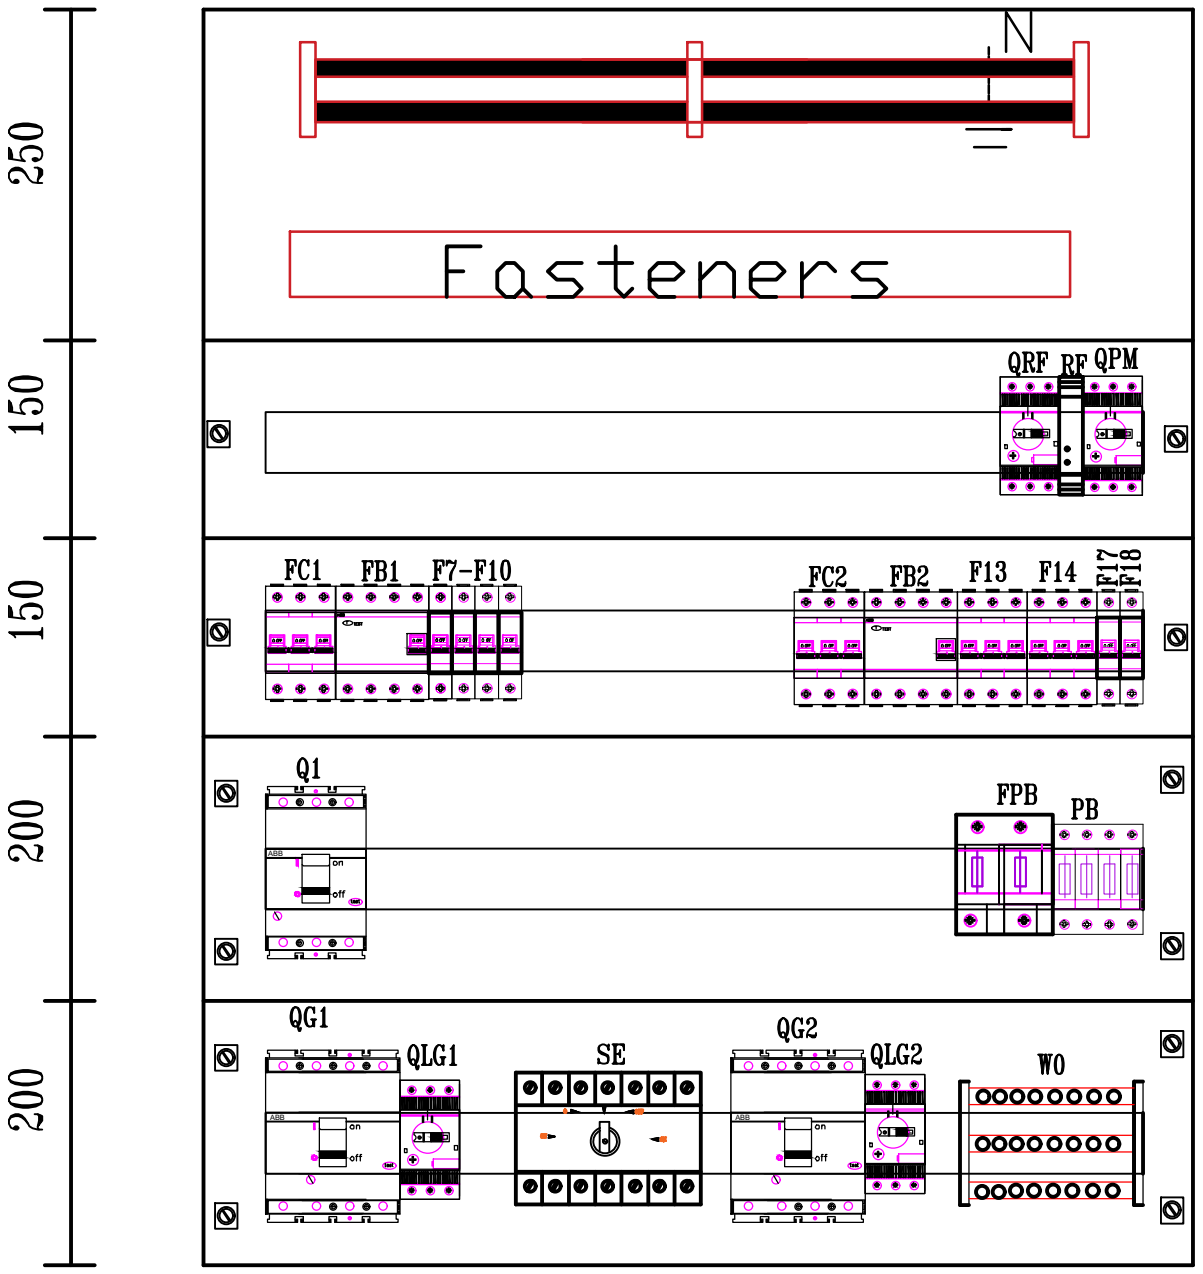
250
150
150
200
200
N
Fasteners
QRF
RF
QPM
FC1
FB1
F7-F10
FC2
FB2
F13
F14
F17
F18
Q1
FPB
PB
QG1
QLG1
SE
QG2
QLG2
W0

S.S Electrical
and control panel
04-6565394 :TL
04-8338123 FAX

MAIN ELECTRICAL BOARD

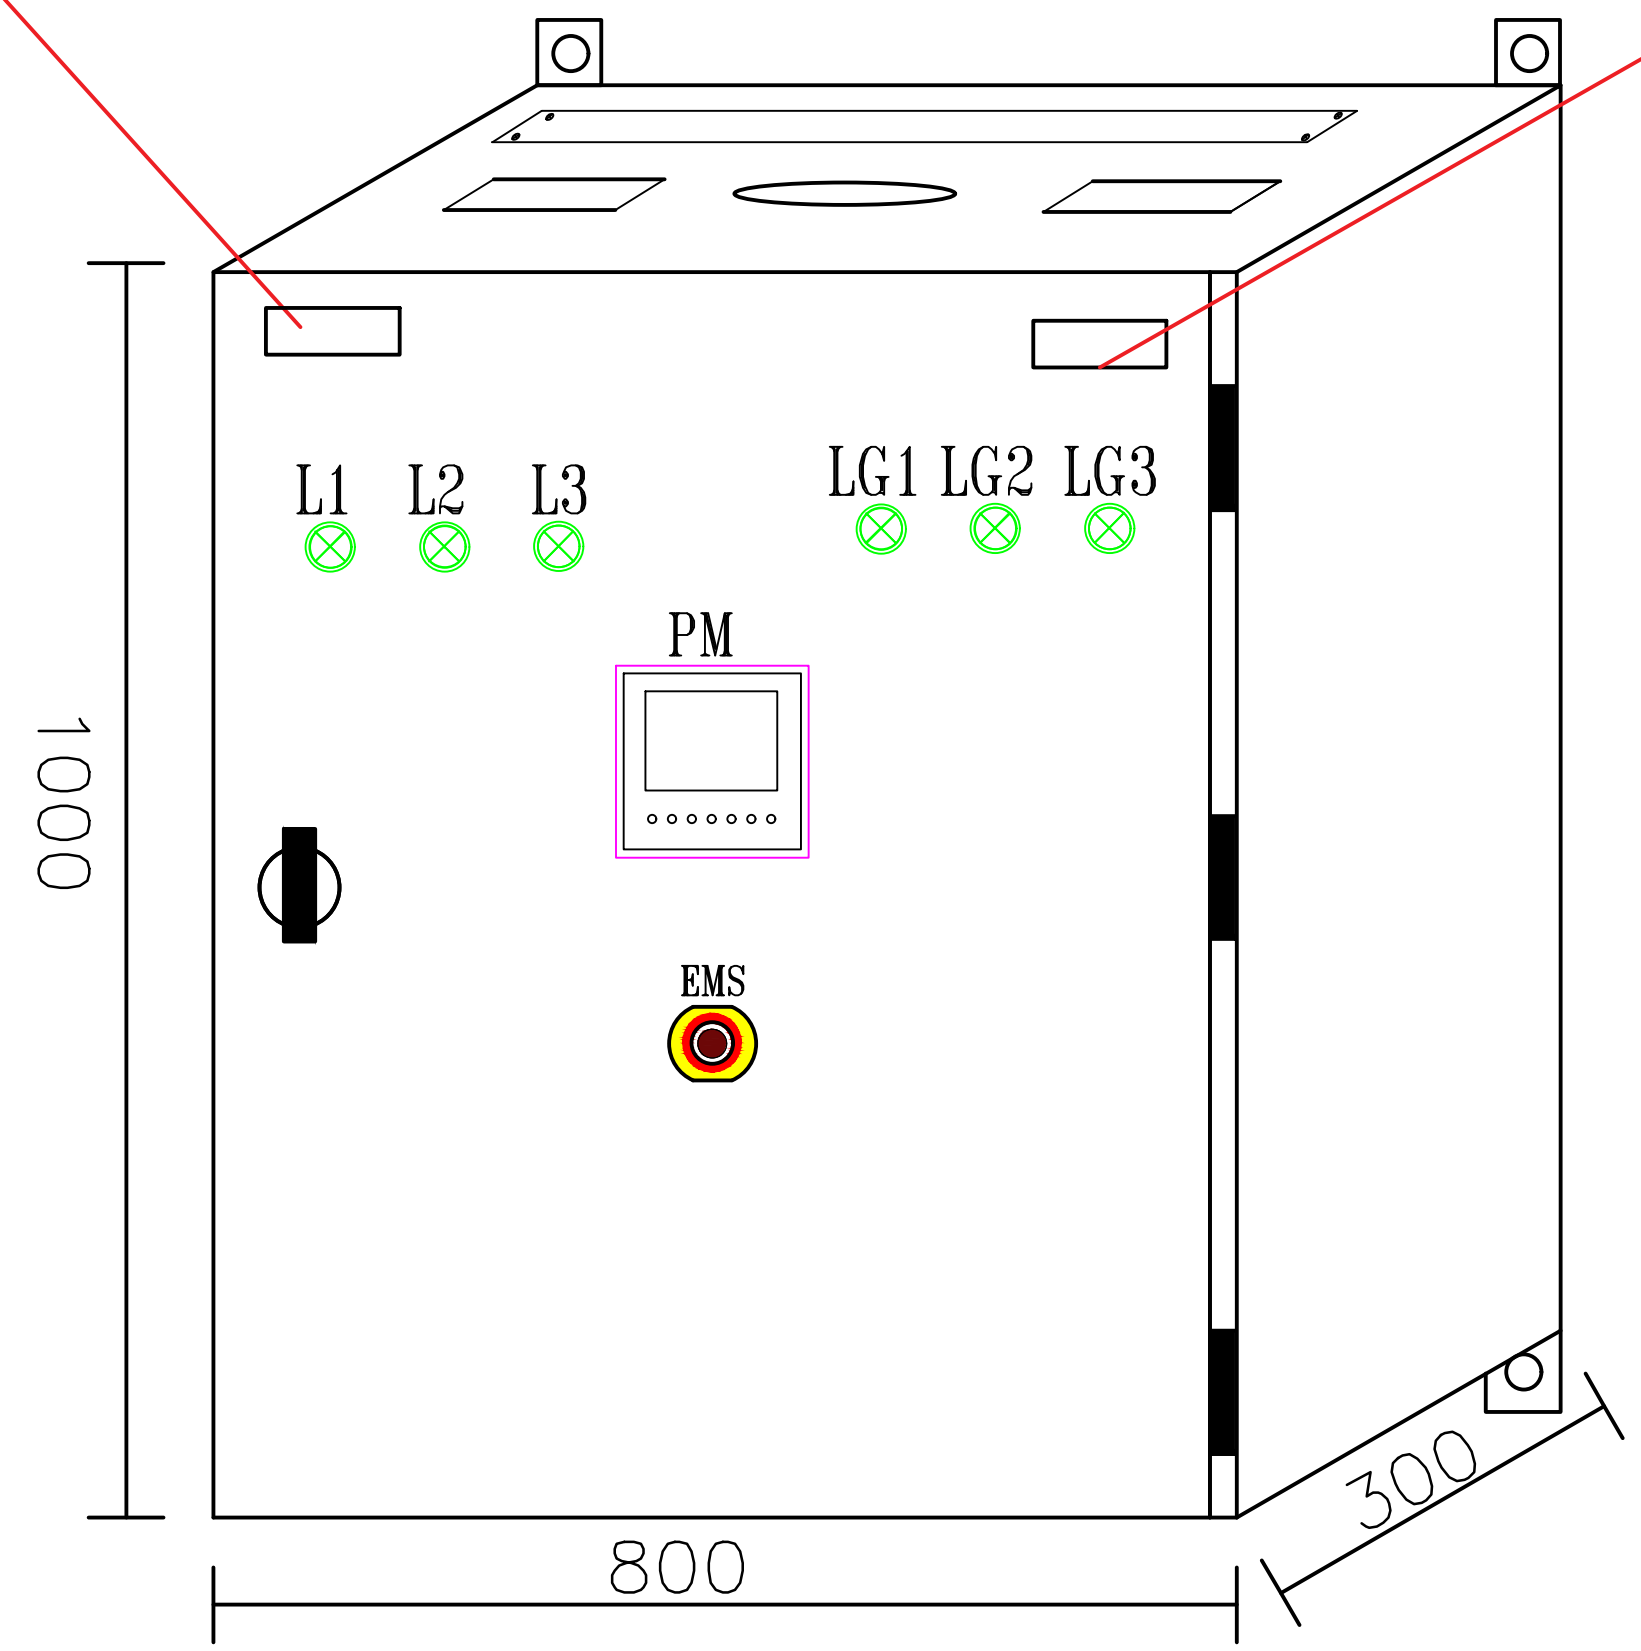
L1
L2
L3
LG1
LG2
LG3
PM
EMS
1000
800
300

Date: 02/10/2026
:1
:2
:3

Drawing No.: 26/993
Designed by: Mahmoud Zoabi
Drawn by: Baha Ghamahna
Approved by: Ofer Alron

Project Name:
Panel Name:
MAIN ELECTRICAL BOARD
Customer:

Page No.: 2
OF: 5
Scale: 1:100

S.S Electrical and control panels
04-8338123:FAX 04-6565394:TEL 276 P.O. B3659290200
Email: electrcpss@gmail.com

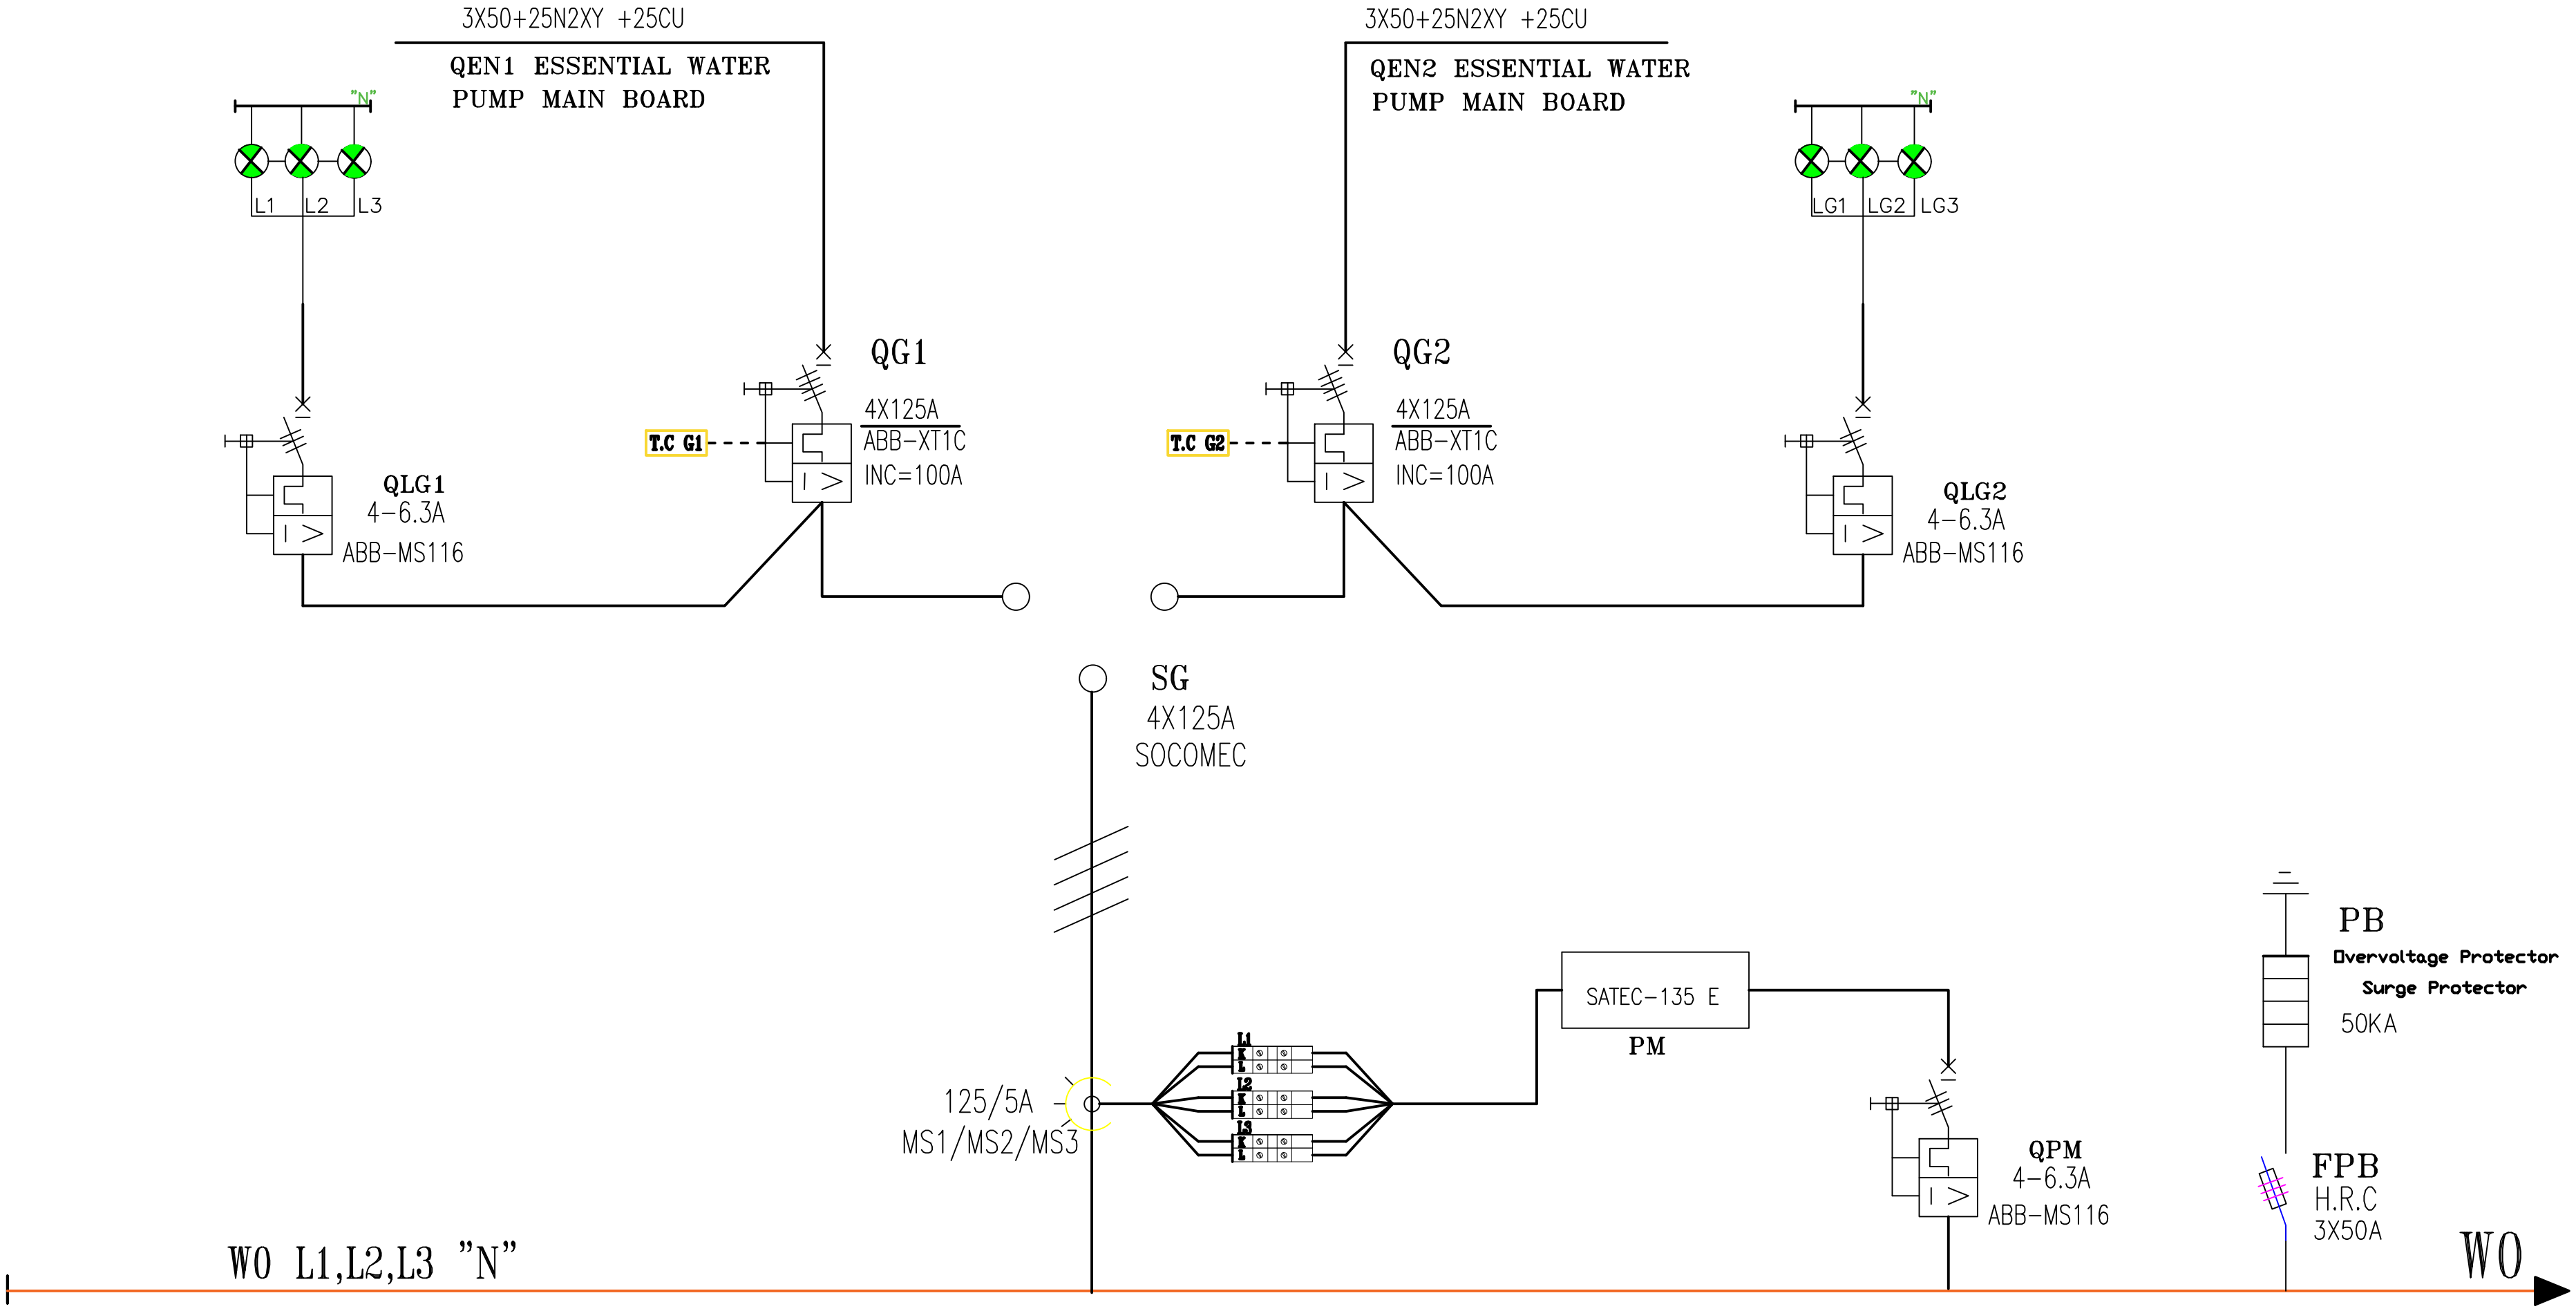
3X50+25N2XY +25CU
QEN1 ESSENTIAL WATER
PUMP MAIN BOARD
3X50+25N2XY +25CU
QEN2 ESSENTIAL WATER
PUMP MAIN BOARD
"N"
L1
L2
L3
"N"
LG1
LG2
LG3
QG1
4X125A
ABB-XT1C
INC=100A
T.C G1
QG2
4X125A
ABB-XT1C
INC=100A
T.C G2
QLG1
4-6.3A
ABB-MS116
QLG2
4-6.3A
ABB-MS116
SG
4X125A
SOCOMEC
125/5A
MS1/MS2/MS3
L1
L2
L3
SATEC-135 E
PM
QPM
4-6.3A
ABB-MS116
PB
Overvoltage Protector
Surge Protector
50KA
FPB
H.R.C
3X50A
W0 L1,L2,L3 "N"
W0

Date: 02/10/2026
:1
:2
:3

Drawing No.: 26/993

Designed by: Mahmoud Zoabi

Drawn by: Baha Ghamahna

Approved by: Ofer Alron

Project Name:

Panel Name:
MAIN ELECTRICAL BOARD
Customer:

Page No.: 3
OF: 5
Scale: 1:100

S.S Electrical and control panels
04-8338123: FAX 04-6565394: TEL 276 P.O. B3659259200
Email: electrcpss@gmail.com

מכון התקנים הישראלי

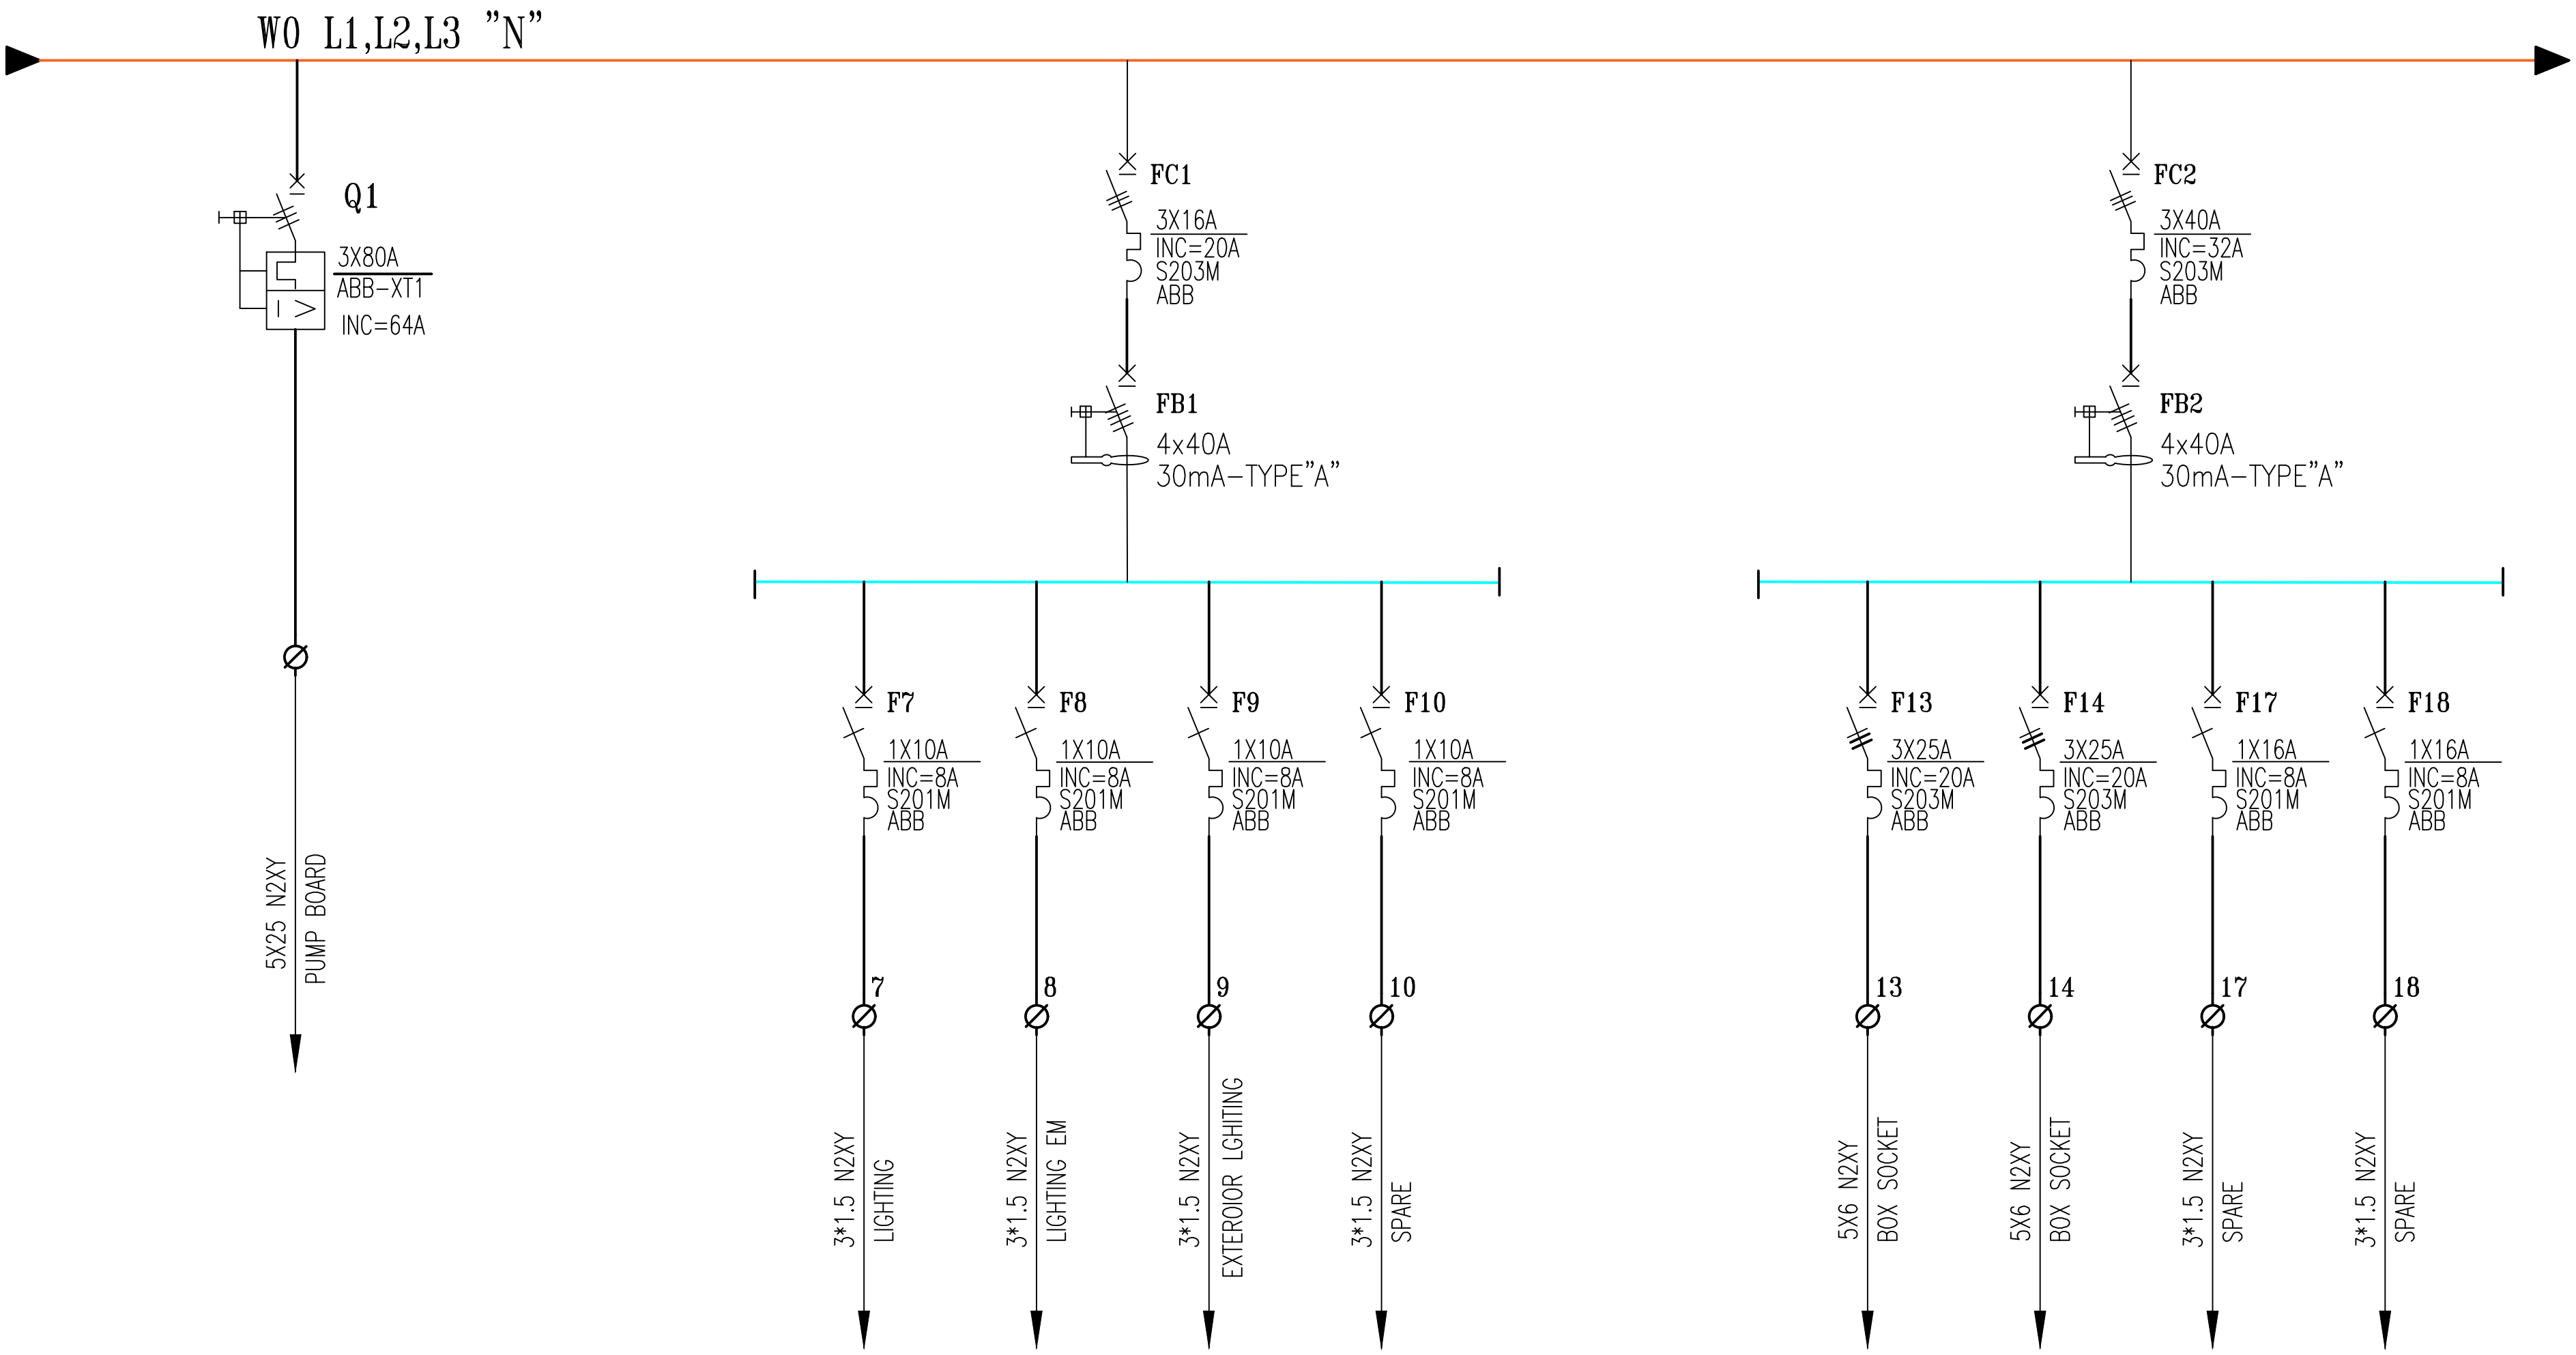
W0 L1,L2,L3 "N"
Q1
3X80A
ABB-XT1
INC=64A
5X25 N2XY
PUMP BOARD
FC1
3X16A
INC=20A
S203M
ABB
FB1
4x40A
30mA-TYPE"A"
FC2
3X40A
INC=32A
S203M
ABB
FB2
4x40A
30mA-TYPE"A"
F7
1X10A
INC=8A
S201M
ABB
7
3*1.5 N2XY
LIGHTING
F8
1X10A
INC=8A
S201M
ABB
8
3*1.5 N2XY
LIGHTING EM
F9
1X10A
INC=8A
S201M
ABB
9
3*1.5 N2XY
EXTEROIOR LGHITING
F10
1X10A
INC=8A
S201M
ABB
10
3*1.5 N2XY
SPARE
F13
3X25A
INC=20A
S203M
ABB
13
5X6 N2XY
BOX SOCKET
F14
3X25A
INC=20A
S203M
ABB
14
5X6 N2XY
BOX SOCKET
F17
1X16A
INC=8A
S201M
ABB
17
3*1.5 N2XY
SPARE
F18
1X16A
INC=8A
S201M
ABB
18
3*1.5 N2XY
SPARE

Date: 02/10/2026
:1
:2
:3

Drawing No.: 26/993
Designed by: Mahmoud Zoabi
Drawn by: Baha Ghamahna
Approved by: Ofer Alron

Project Name:

Panel Name:
MAIN ELECTRICAL BOARD
Customer:

Page No.: 4
OF: 5
Scale: 1:100

S.S Electrical and control panels
04-8338123: FAX 04-6565394: TEL 276 P.O. Box 3659200
Email: electrcpss@gmail.com

מכון התקנים הישראלי

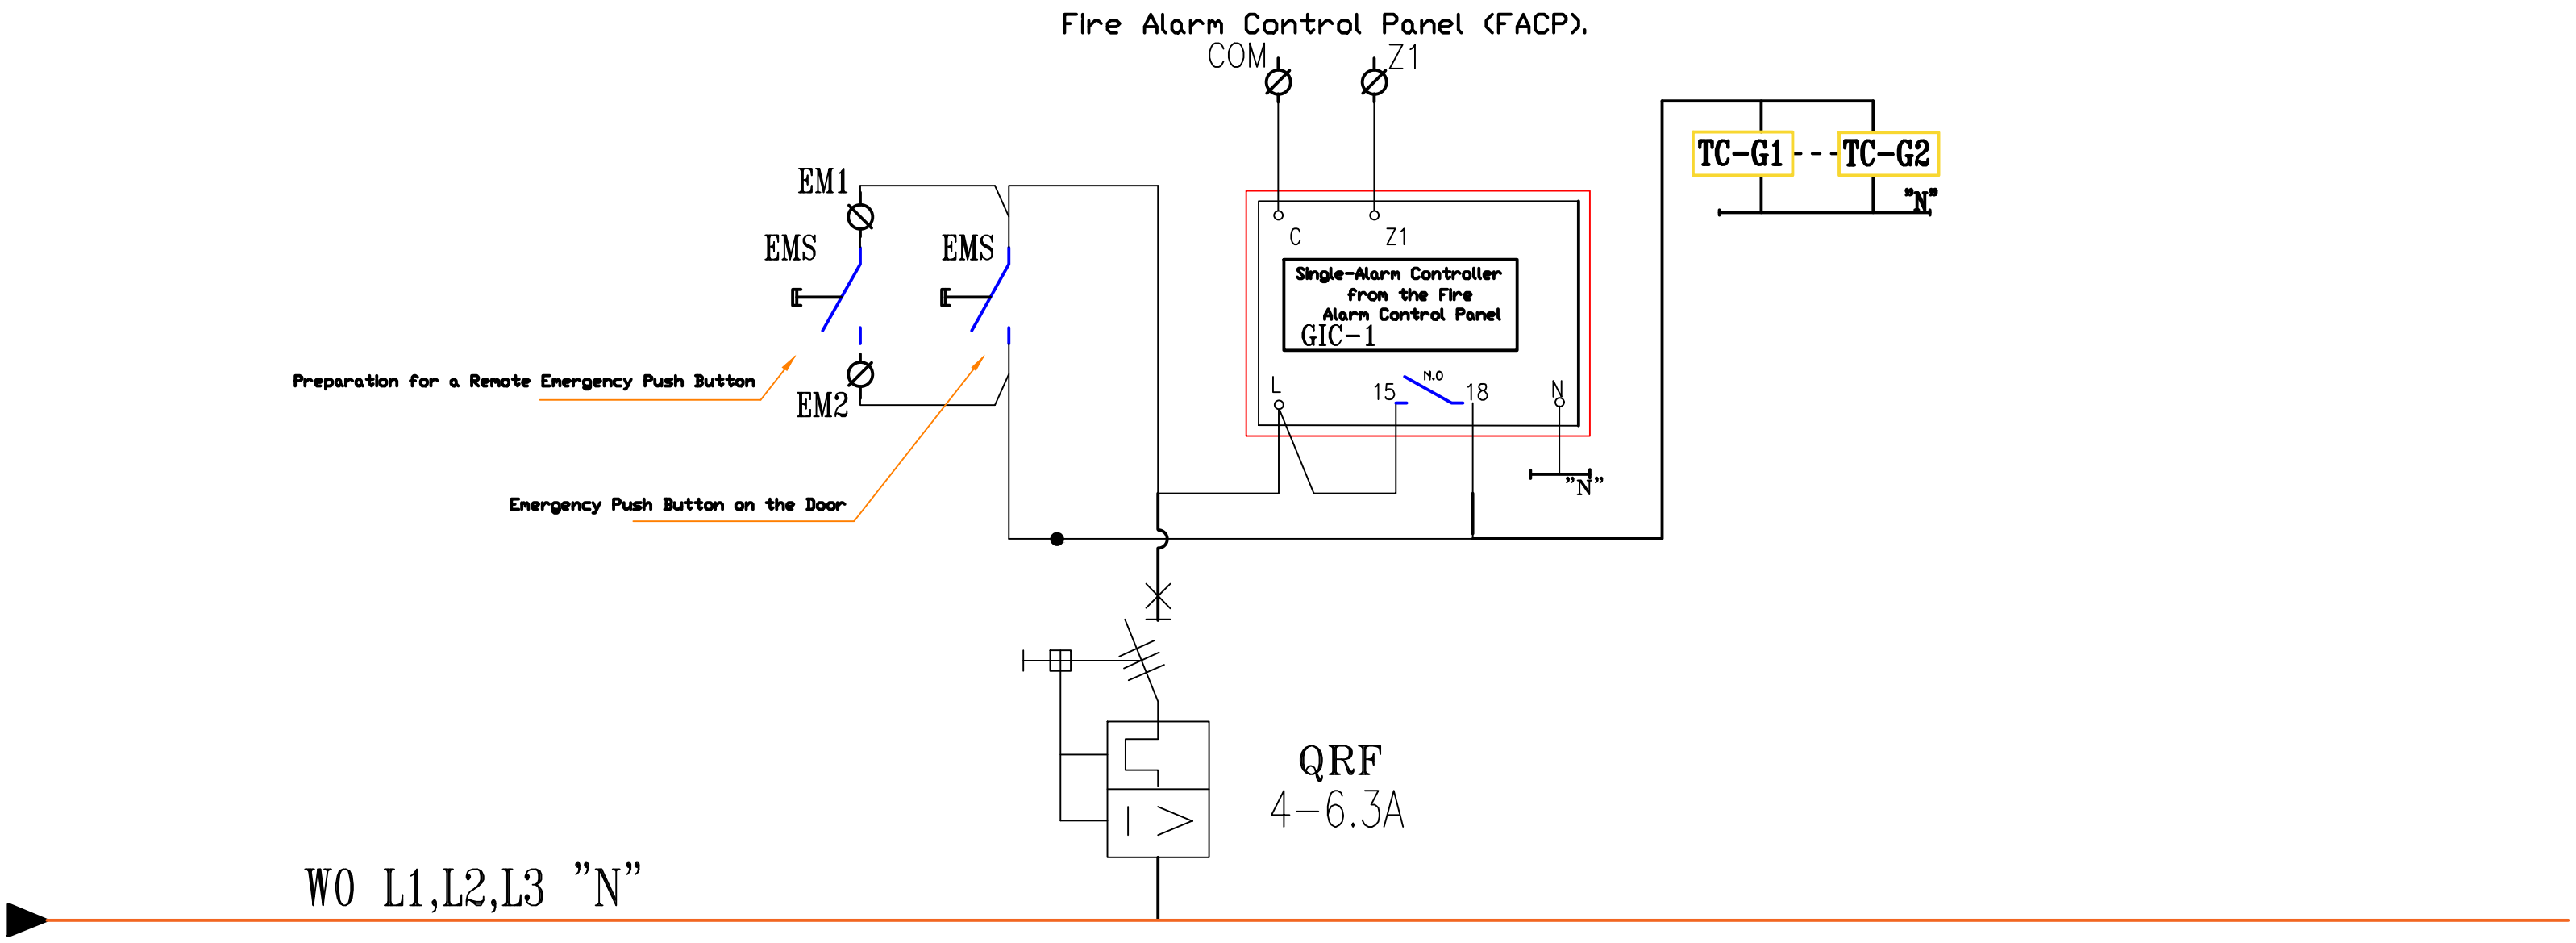
Fire Alarm Control Panel (FACP).
COM
Z1
C
Z1
Single-Alarm Controller from the Fire Alarm Control Panel
GIC-1
L
15
N.O
18
N
"N"
TC-G1
TC-G2
"N"
EM1
EMS
EMS
EM2
Preparation for a Remote Emergency Push Button
Emergency Push Button on the Door
QRF
4-6.3A
W0 L1,L2,L3 "N"

Date: 02/10/2026	Drawing No.: 26/993	Project Name:		S.S Electrical and control panels 04-8338123: FAX 04-6565394: TEL 276 P.O. B36659200 Email: electrcpss@gmail.com
:1	Designed by: Mahmoud Zoabi	Panel Name: MAIN ELECTRICAL BOARD	Page No.: 5	
:2	Drawn by: Baha Ghamahna	Customer:	OF: 5	
:3	Approved by: Ofer Alron		Scale: 1:100	

ISO 9001: 2008
מכון התקנים הישראלי