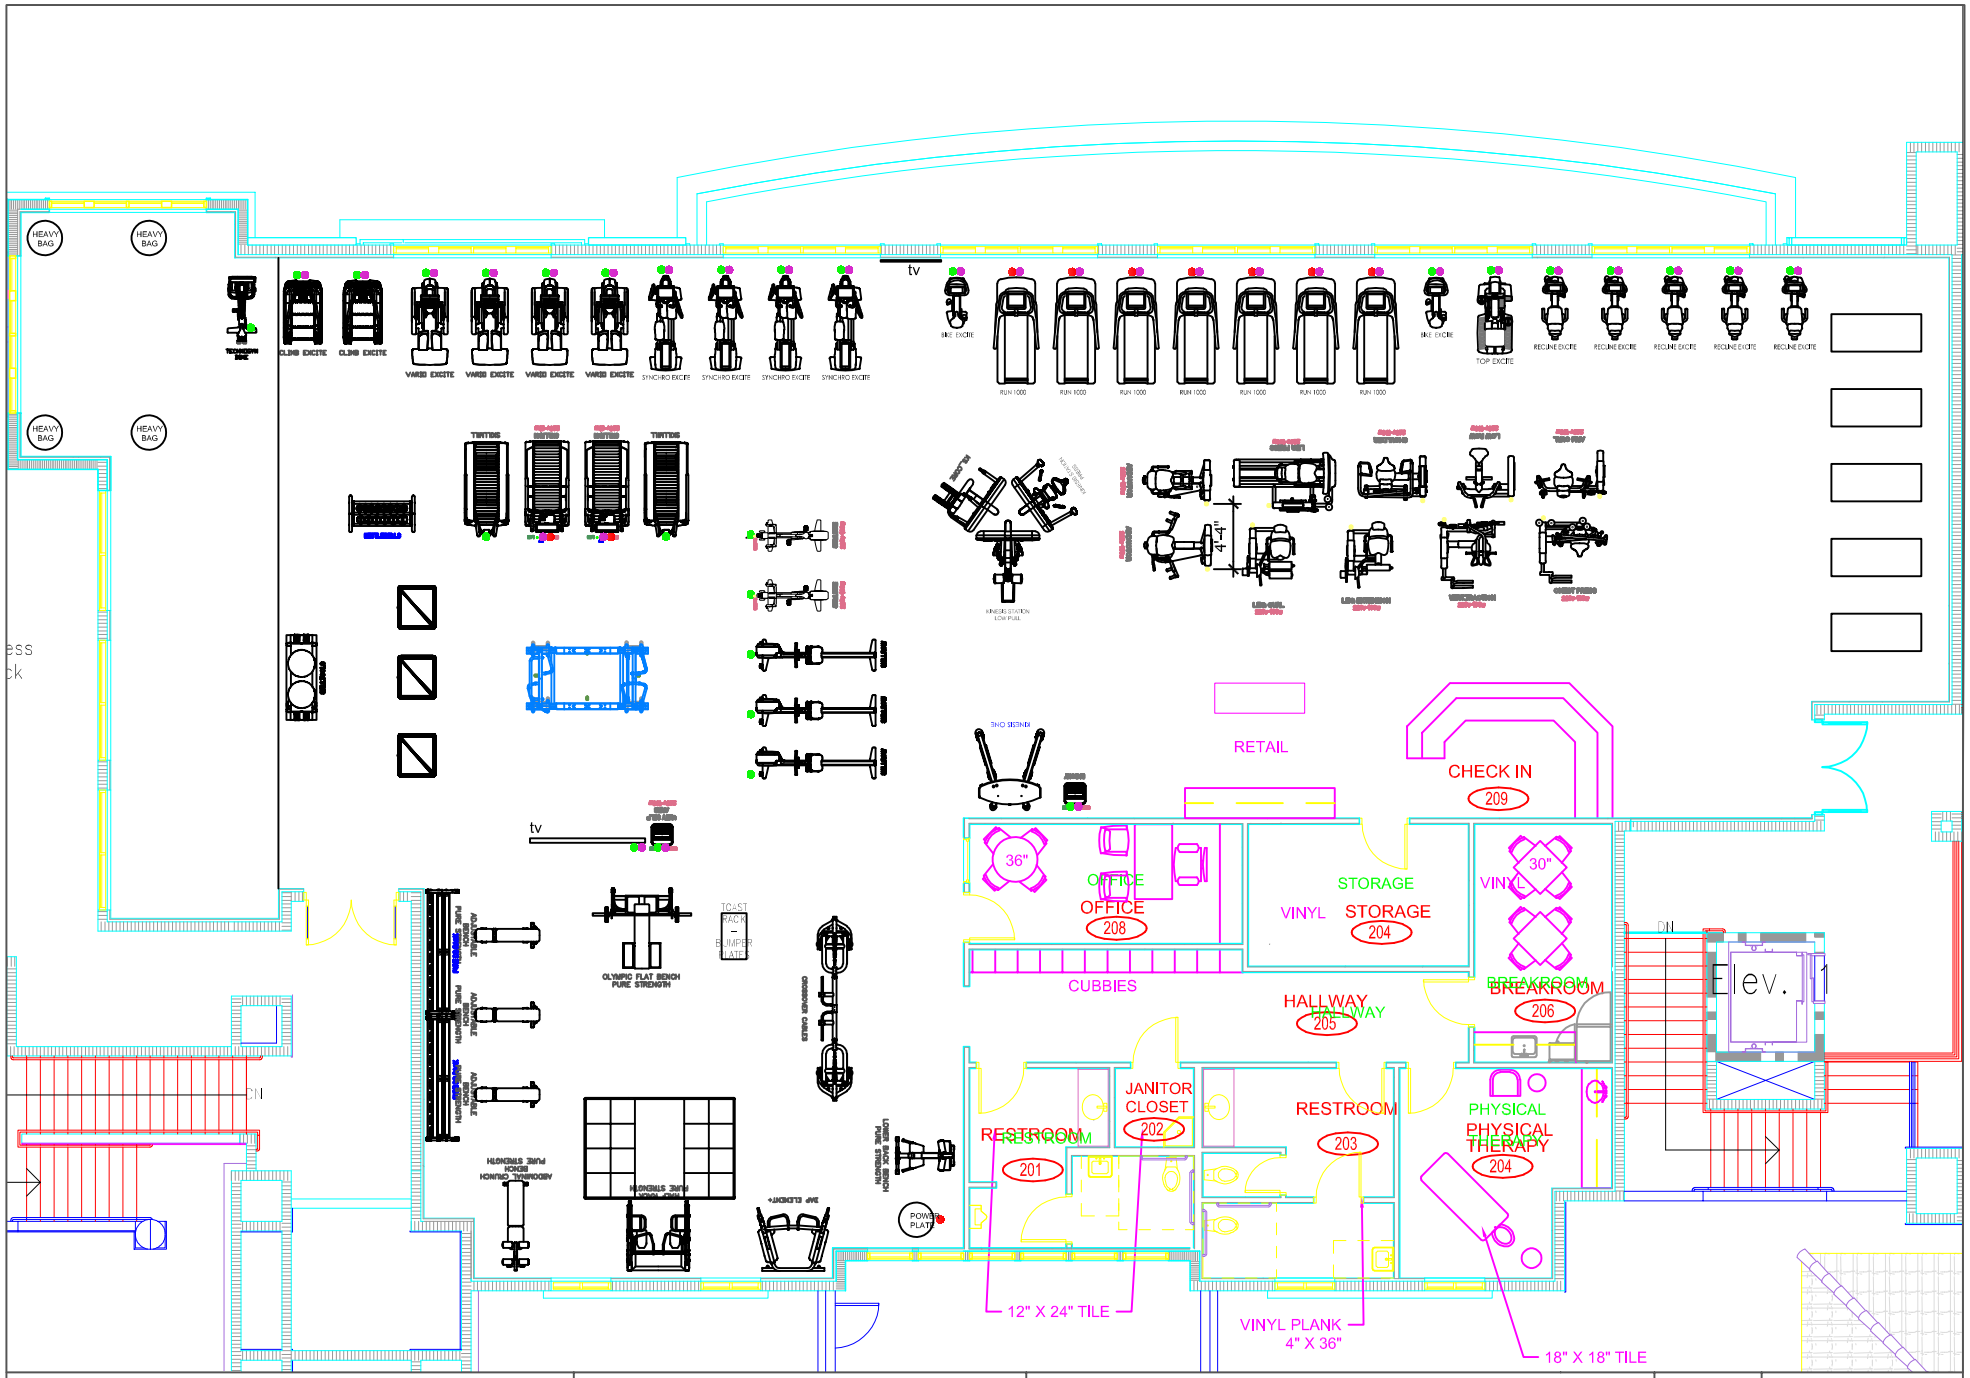

TECHNOGYM
The Wellness Company

Todd Shaw
National Manager
Country Clubs
862.210.5014
tshaw@technogym.com

Mizner Country Club

- 220 VAC 20 AMP 60 HERTZ NEMA 6-20R OR
- 110 VAC 20 AMPS 60 HERTZ NEMA 5-20R

EACH TREADMILL REQUIRES ITS OWN INDIVIDUAL BRANCH CIRCUIT WITH THE HOT, NEUTRAL AND GROUND WIRES RUN TO THE ELECTRICAL PANEL.

- COAXIAL FOR CABLE/SATELLITE AND CAT 6 FOR DATA AND/OR IPTV
- 120 VAC 15 AMP 50-60 HERTZ NEMA 5-15R
- 120 VAC 15 AMP 50-60 HERTZ NEMA 5-15R PLACEMENT OF THESE ARE FOR THE OPTIONAL ISO CONTROLS FOR SELECTION OR ELEMENT

SCALE: To Fit

04.06.20

REV: K1

PROJECT NO.: TGSB17198