



R-Link Chile SPA
RUT: 765652022
Nueva Providencia 1881 - Of. 1515
Providencia - Santiago
Tel: +56 2 24954462

Control de riego RL-IRC-6LP

Hoja de datos
Versión 1.0




Historial de cambios

Versión	Fecha	Autor	Descripción
1.0	2020-09-29	Berardi Ariel	Creación del documento

Descripción

El equipo RL-IRC-6LP permite el riego con un control automático de 6 válvulas, la configuración de un calendario de riego de forma remota y un sensor de flujo de agua. Posee conectividad a la nube por medio de una red **6LoWPAN**.

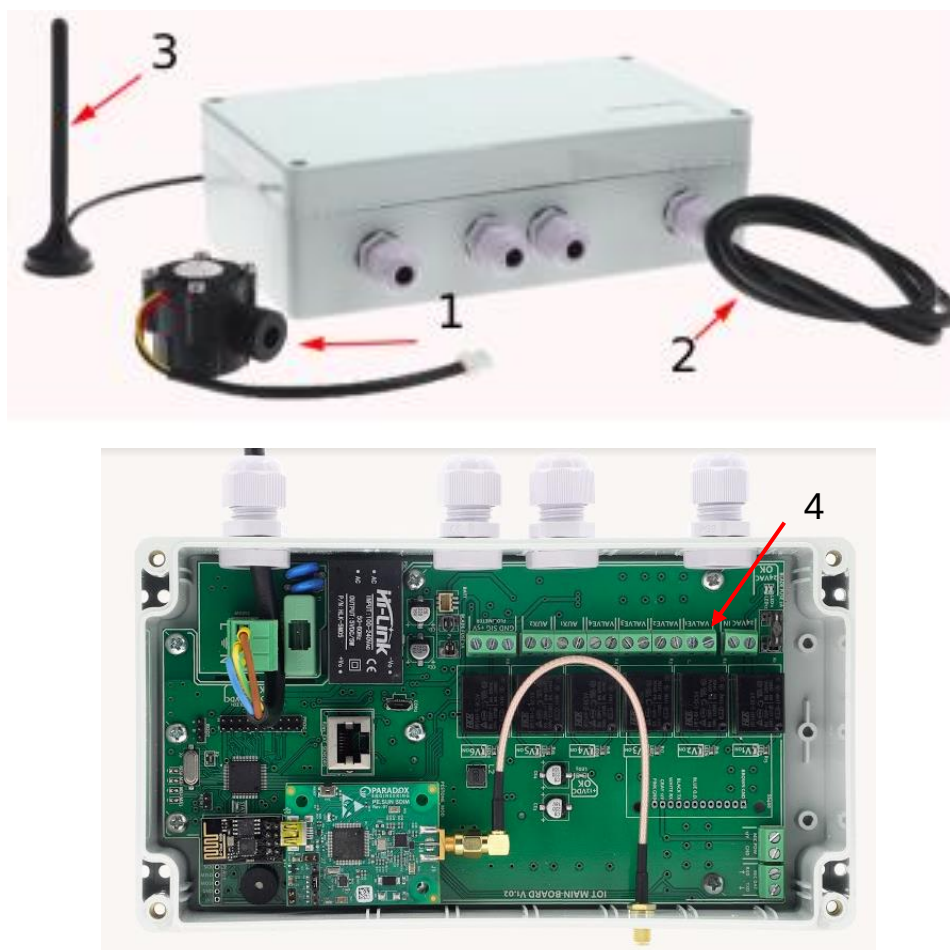

- 1) Sensor caudalímetro
- 2) Cable alimentación
- 3) Antena externa
- 4) Borneras de conexión

Características Técnicas

Parámetros eléctricos

Tensión	100 to 220V AC, 50 to 60Hz
Tensión de válvulas	Típico: 24V corriente alterna
Consumo	Típico: 1W Max:3W
Protecciones	Sobre Corrientes (fusible) y Sobretensiones
Conectividad	6LoWPAN
Dimensiones	30 cm x 21 cm x 8 cm
Peso	0.5 Kg
Gabinete	Plástico Estanco IP65
Configuración	Remota vía WiFi
Batería	Si, último aliento

Rango de medición

	Rango	Unidad	Presición
Litros de agua usados por turno	0 a 9999	Litros (L)	±1 L

Objeto IPSO

Estado de riego

Object Name	Object ID	Instances
IPSO Irrigation meter	27045	1

Resource Name	Resource ID	Type	Value
Current Shift	26293	Integer	Current measured value
Valve status	26294	Bit masked	Current measured value
Water flow average	26295	Float	Current measured value
Total liters of water per shift	26296	Integer	Current measured value

Calendario

Object Name	Object ID	Instances
IPSO Irrigation control	27046	0 Sunday 1 Monday 2 Tuesday 3 Wednesday 4 Thursday 5 Friday 6 Saturday

Resource Name	Resource ID	Type	Value
Shift 1 Start time	26300	Integer	Current measured value
Shift 1 Valve schedules	26301	Bit masked	Current measured value
Shift 2 Start time	26302	Integer	Current measured value
Shift 2 Valve schedules	26303	Bit masked	Current measured value
Shift 3 Start time	26304	Integer	Current measured value
Shift 3 Valve schedules	26305	Bit masked	Current measured value
Shift 4 Start time	26306	Integer	Current measured value

Shift 4 Valve schedules	26307	Bit masked	Current measured value
Shift 5 Start time	26308	Integer	Current measured value
Shift 5 Valve schedules	26309	Bit masked	Current measured value
Shift 6 Start time	26310	Integer	Current measured value
Shift 6 Valve schedules	26311	Bit masked	Current measured value