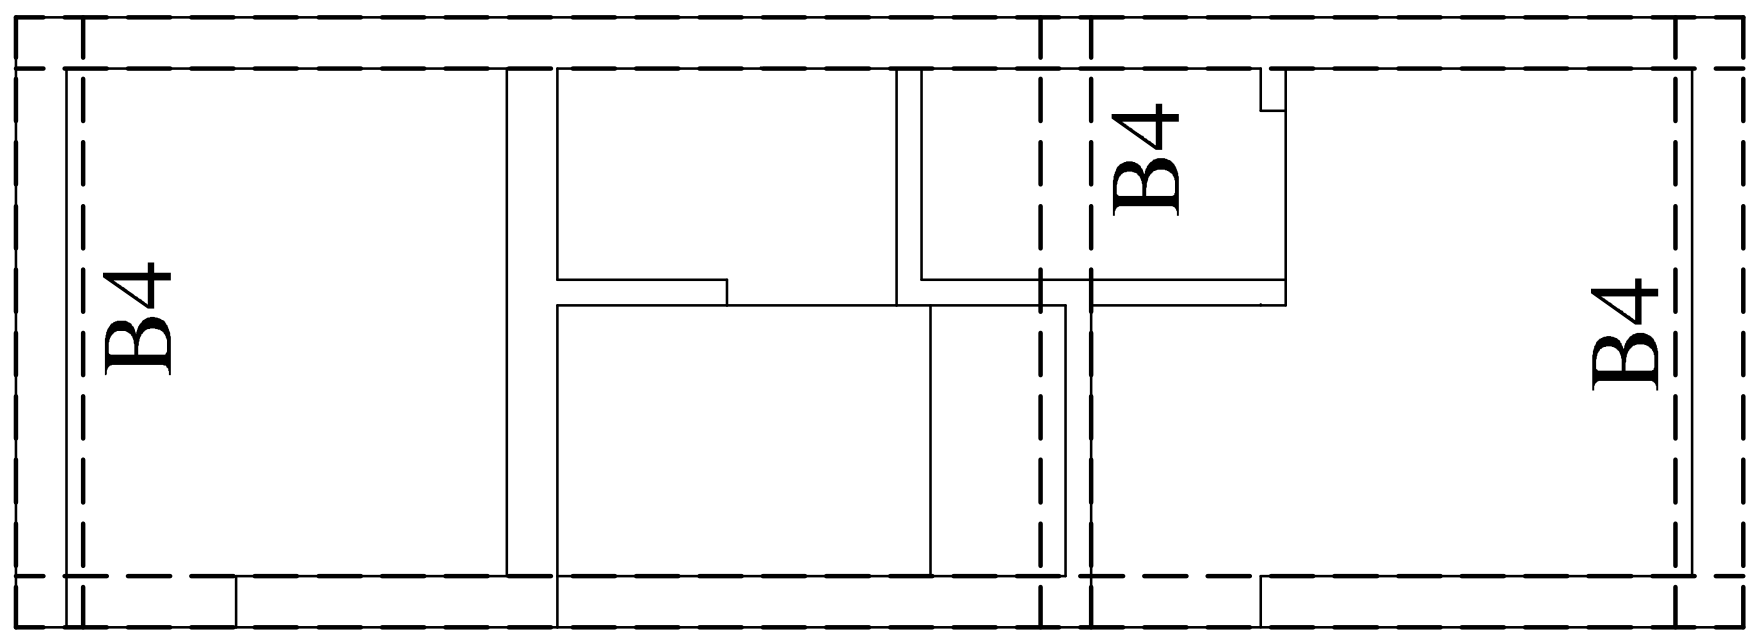

ROOF BEAMS LAYOUT PLAN



BAR NO :- 1 TO 8 -20Ø TOR MAIN STEEL
RINGS :- 8Ø TOR 2 LEGGED@6" C/C THROUGHOUT

ROOF BEAM -B4

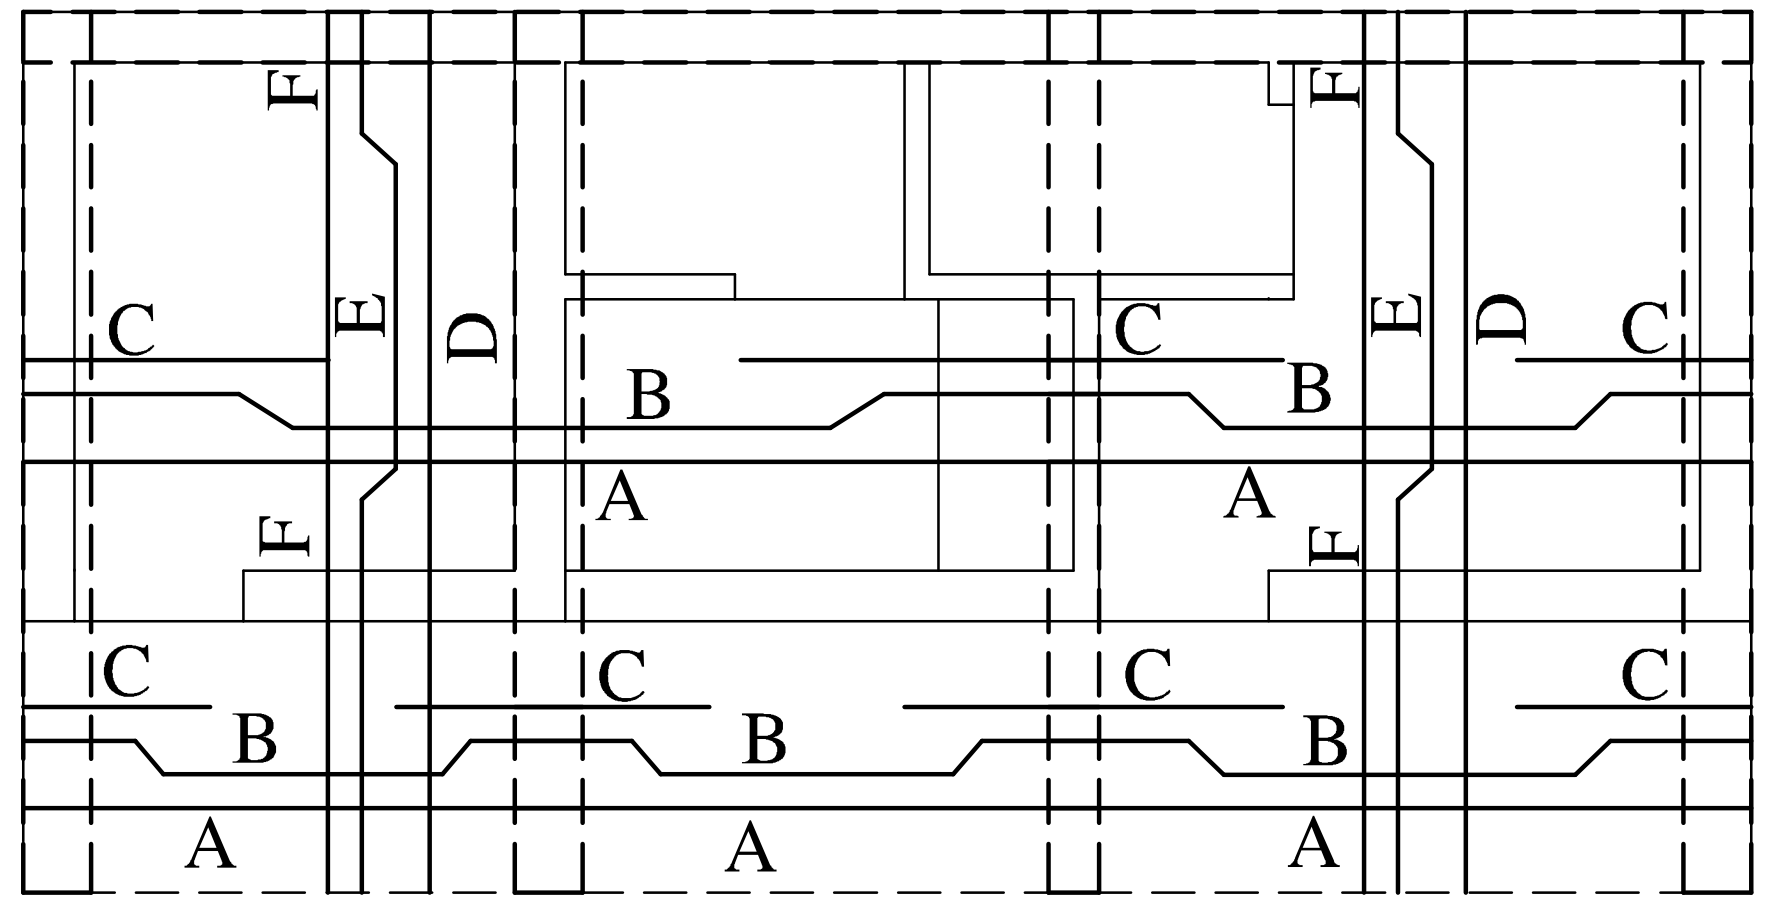

ROOF SLAB LAYOUT PLAN

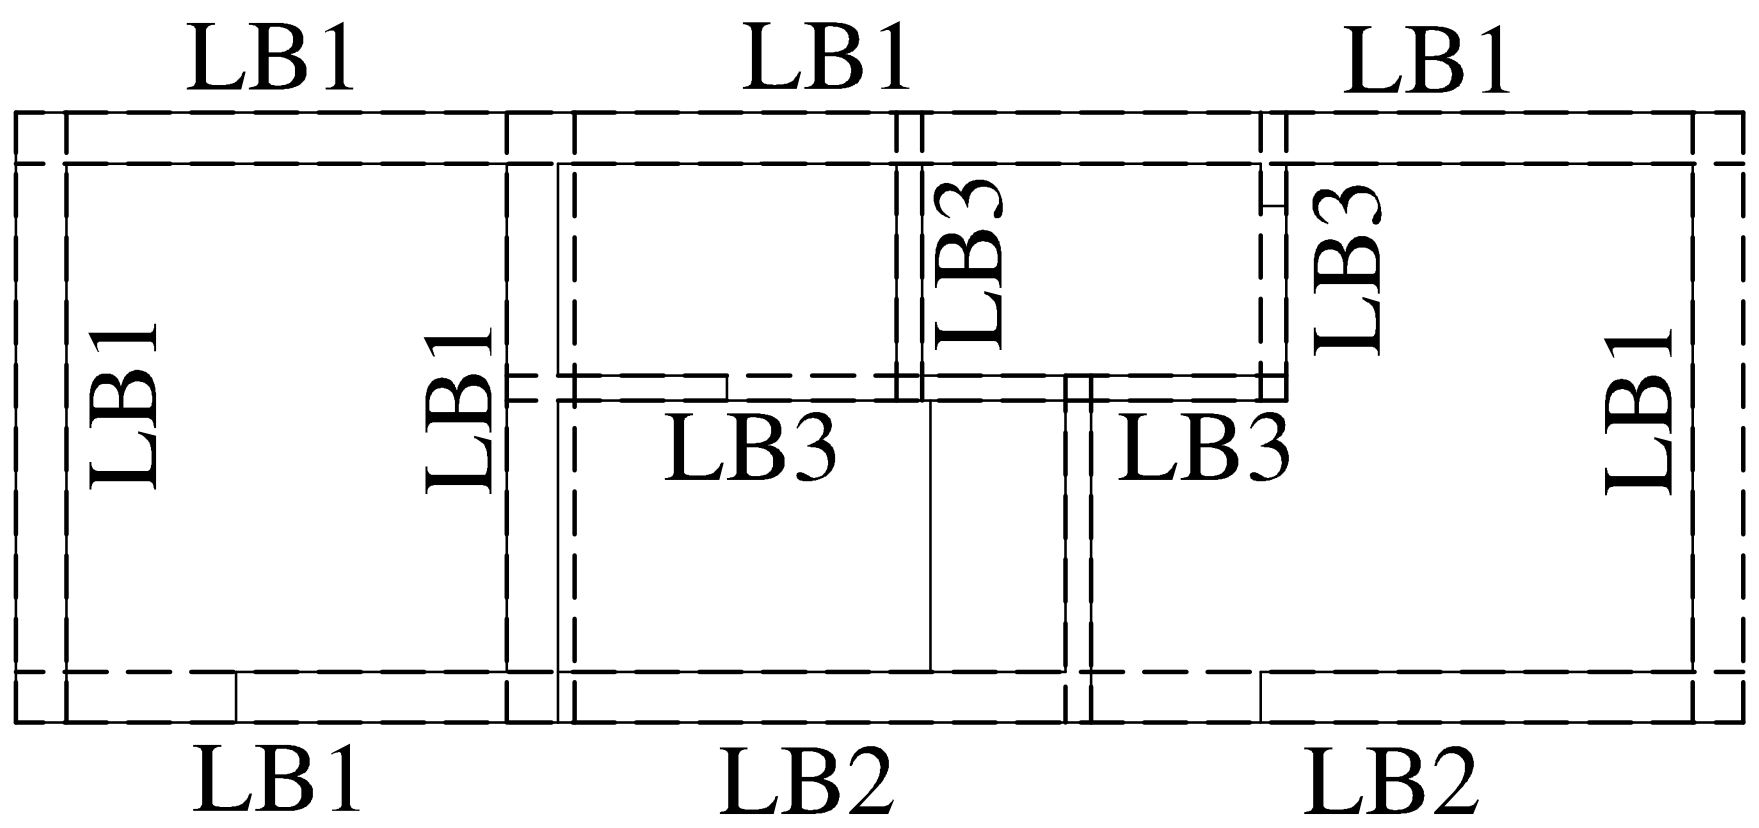

LINTEL BEAMS LAYOUT PLAN AT HEIGHT 8'-6"&DETAIL



BAR NO. :- 1 TO 6 - 12ØTOR MAIN STEEL
RING 8ØTOR 2 LEGGED @6"C/C THROUGHOUT

LINTEL BEAM - LB1 (9"X6")



BAR NO. :- 1 TO 8 - 12ØTOR MAIN STEEL
RING 8ØTOR 2 LEGGED @6"C/C THROUGHOUT

LINTEL BEAM - LB2 (9"X9")



BAR NO. :- 1 TO 4 - 12ØTOR MAIN STEEL
RING 8ØTOR 2 LEGGED @6"C/C THROUGHOUT

LINTEL BEAM - LB3 (9"X9")

SCHEDULE OF BARS

1	A	10Ø TOR STEEL @ 12" C/C STRAIGHT BAR AT BOTTOM FACE
2	B	10Ø TOR STEEL @ 12" C/C CRANKED BAR
3	C	12Ø TOR STEEL @ 12" EXTRA BAR AT TOP FACE
4	D	10Ø TOR STEEL @ 14" STRAIGHT BAR AT BOTTOM FACE
5	E	10Ø TOR STEEL @ 14" CRANKED BAR
6	F	10Ø TOR STEEL @ 14" EXTRA BAR AT TOP FACE

NOTES:-
* IF THERE IS ANY DISCREPANCY REGARDING DIMENSIONS, ARCHITECTURAL DRAWINGS MAY BE CONSULTED.
* WRITTEN DIMENSIONS SHOULD BE FOLLOWED
* MIXER & VIBRATOR ARE TO BE USED FOR ALL CONCRETE WORKS
*M-20 (1:$1\frac{1}{2}$:3)GRADE CONCRETE TO BE USED IN ALL CONCRETE WORKS.
* R.C.C SLAB THICKNESS IS 5".
* STEEL REINFORCEMENT Fe- 500 D IS USED .
* COVER TO REINFORCEMENT IN BEAM WILL BE 25MM ON BOTH SIDES
* COVER TO REINFORCEMENT OF SLAB WILL BE 20MM AT BOTTOM & 12MM AT TOP
* CHAIRS OF 10MM TOR STEEL IS TO BE PROVIDED TO SUPPORT CRANKED/ EXTRA STEEL BARS
* IN CANTILEVER SLAB & BEAM, COUNTER WEIGHT STEEL WILL BE $1\frac{1}{2}$ TIMES THE LENGTH OF CANTILEVER
* LENGTH OF EXTRA BAR AT CONTINOUS SUPPORT OF BEAM WILL BE L/3 ON BOTH SIDES FROM CENTER OF SUPPORT, WHERE L IS SPAN FROM C/C
* LENGTH OF EXTRA BAR AT CONTINOUS SUPPORT OF SLAB WILL BE L/4 ON BOTH SIDES FROM CENTER OF SUPPORT, WHERE L IS SPAN FROM C/C
* OVER LAP LENGTH OF STEEL IS 57 TIMES THE DIAMETER OF THE BAR.
* AT SUPPORT, CRANK WILL START AT L/5 FROM CENTER OF SUPPORT, WHERE L IS SPAN FROM C/C
* MINIMUM SPACING BETWEEN TWO LAYERS OF REINFORCEMENT IN BEAMS WILL BE 25MM
* WHEN TWO BEAMS HAVE DIFFERENT STEEL AT ONE SUPPORT,MAXIMUM OF THE TWO IS TO BE PROVIDED UPTO L/3 OF NEXT SPAN.

ENGINEER :-

CLIENT :- XEN PANCHAYATI RAJ,NUH

PROJECT :-

STRUCTURAL DRAWINGS OF PANCHYAT GHAR AT VILLAGE GHASERA,DISTT.NUH

TITLE :-

TOILET BLOCK

SUB TITLE :-	DRG. NO. :-
ROOF BEAM ,ROOF SLAB LAYOUT PLAN&DETAIL	JC/PR/NUH/2420/7

SCALE :-	DATE :-	DRAWN BY:-	DSN BY:-	CKD. BY:-
1 :100	9 July2022	SIMRAN	JASBIR	K.B. MANOCHA

JC TECHNOCRATS PVT. LTD.
(Formerly known as Jindals Consortium, Since 1990)
ISO 9001-2015 CERTIFIED
STRUCTURAL ENGINEERS, HIGHWAY & BRIDGE DESIGNERS, PROJECT MANAGEMENT CONSULTANTS ROAD SAFETY AUDITORS, PROOF CONSULTANTS, SURVEYORS AND SOIL INVESTIGATORS
REGD.OFF. : S. C. F - 9, VIKAS VIHAR, AMBALA CITY- 134003, HARYANA. PH: 0171- 2550913, MOB:-+91-98966-70914
DELHI : # 678, GREEN VIEW APARTMENTS, SECTOR 19, POCKET-2, DWARKA, NEW DELHI. MOB:-+91-99964-70914
Mob:- 8199907006, 9896550913, e-mail: jindalstructure@gmail.com, jindals13@gmail.com, Web: www.jindalsconsortium.in