

PROPOSED HALL AT
VILLAGE KAIMRI

TITLE:-GROUND FLOOR DOOR BEAM DETAIL

DRG NO.

JOB NO:EB/23/6/HR

GENERAL NOTES:-

1. BEARING CAPACITY OF SOIL HAS BEEN ASSUMED 08.00 T/M²
2. GRADE OF CONCRETE M-20(1:1½:3)
3. GRADE OF STEEL Fe-500
4. NOMINAL COVER FOR FOOTINGS 60 MM
5. NOMINAL COVER FOR COLUMNS 50 MM
6. NOMINAL COVER FOR BEAMS 25 MM
7. NOMINAL COVER FOR SLAB 25 MM
8. LENGTH OF EXTRA BAR TO BE L/3.
9. STRUCTURE DESIGN IS FOR G.F.F.&S.F. ONLY
10. LAP LENGTH OF STEEL REINFORCING BARS SHALL BE:

GRADE OF CONC.	LAP LENGTH
M-20	15 D
M-25	16 D
M-30	18 D

'D' IS THE DIA OF REINF. BARS

11. STANDARD 'L' HOOKS SHALL BE PROVIDED AT THE ENDS OF ALL BARS

12. COL. TIES 8Ø@4"C/C IN END REGION (L/4) & 6"C/C IN MID REGION

TERRAS GEO STRUCTURES

Er. A.R.Saini
Executive Engineer- Structures,CCSHAU
Head Engineering , MHU Karnal
Chartered Engineer,IEI INDIA
CE NO:- F-1190152 DATED.17-07-2018
Fellow Inst.of Valuers, India
IOV NO:- F-28724 DATED.25-06-2019

Er. Sandeep Saini
M.tech Civil(Geo-Tech)
Chartered Engineer
Structural Consultant on Panel (HSVP)

ENGINEERS, BUILDERS,
STRUCTURAL
CONSULTANTS



Institution of Engineers
Regd. No. -AM 162111-7


ENGINEER:-SANDEEP
SAINI

MODELLING:-PARVEEN
SAINI


CHECKED BY: A.R.SAINI

DATE :-
09/02/2024

SCALE :-NTS

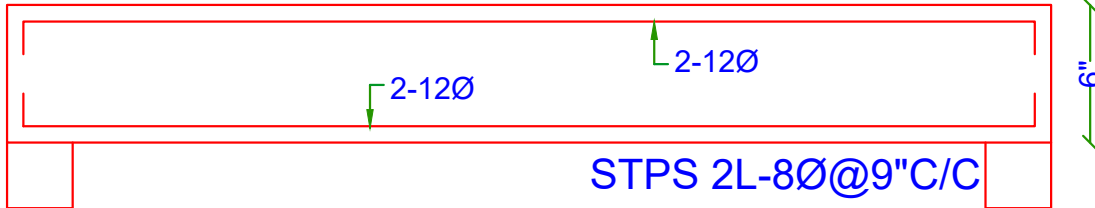


OPENINGS IN 9" WALL 3'-0", 3'-3", 3'-6"

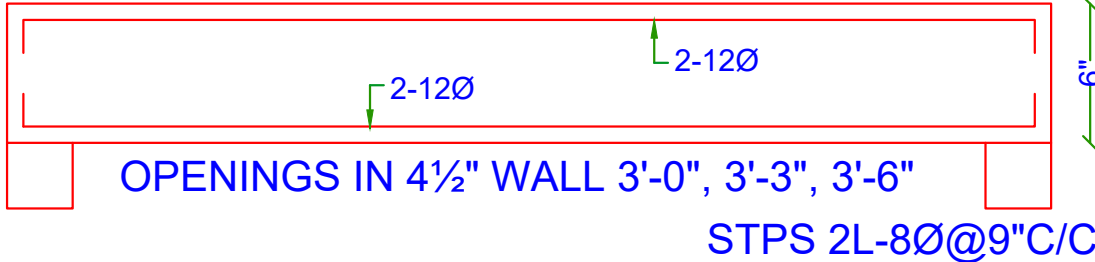

OPENINGS IN 4½" WALL 3'-0", 3'-3", 3'-6"

STPS 2L-8Ø@9"C/C

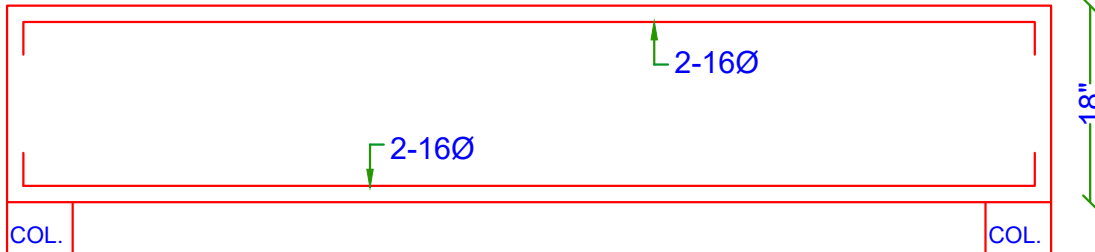


COL.

COL.

D1

9" X 18"
AT DOOR LVL

STPS 2L-8Ø@5"C/C

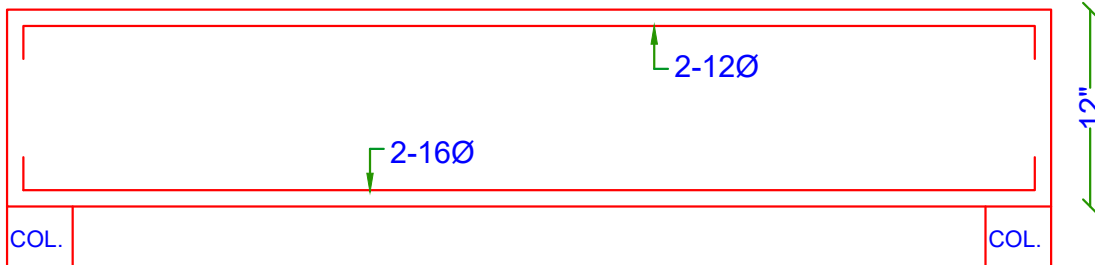


COL.

COL.

D2

9" X 12"
AT DOOR LVL

STPS 2L-8Ø@5"C/C

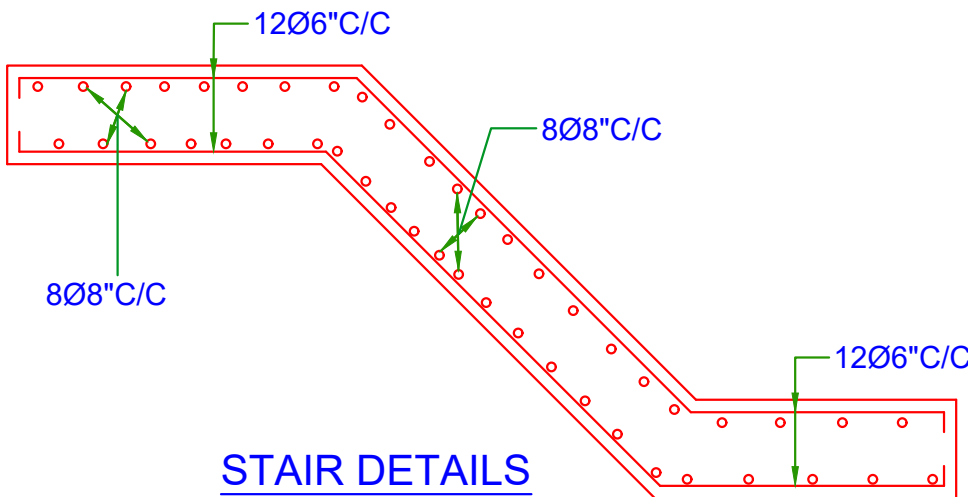

STAIR DETAILS