


COLUMN LAYOUT

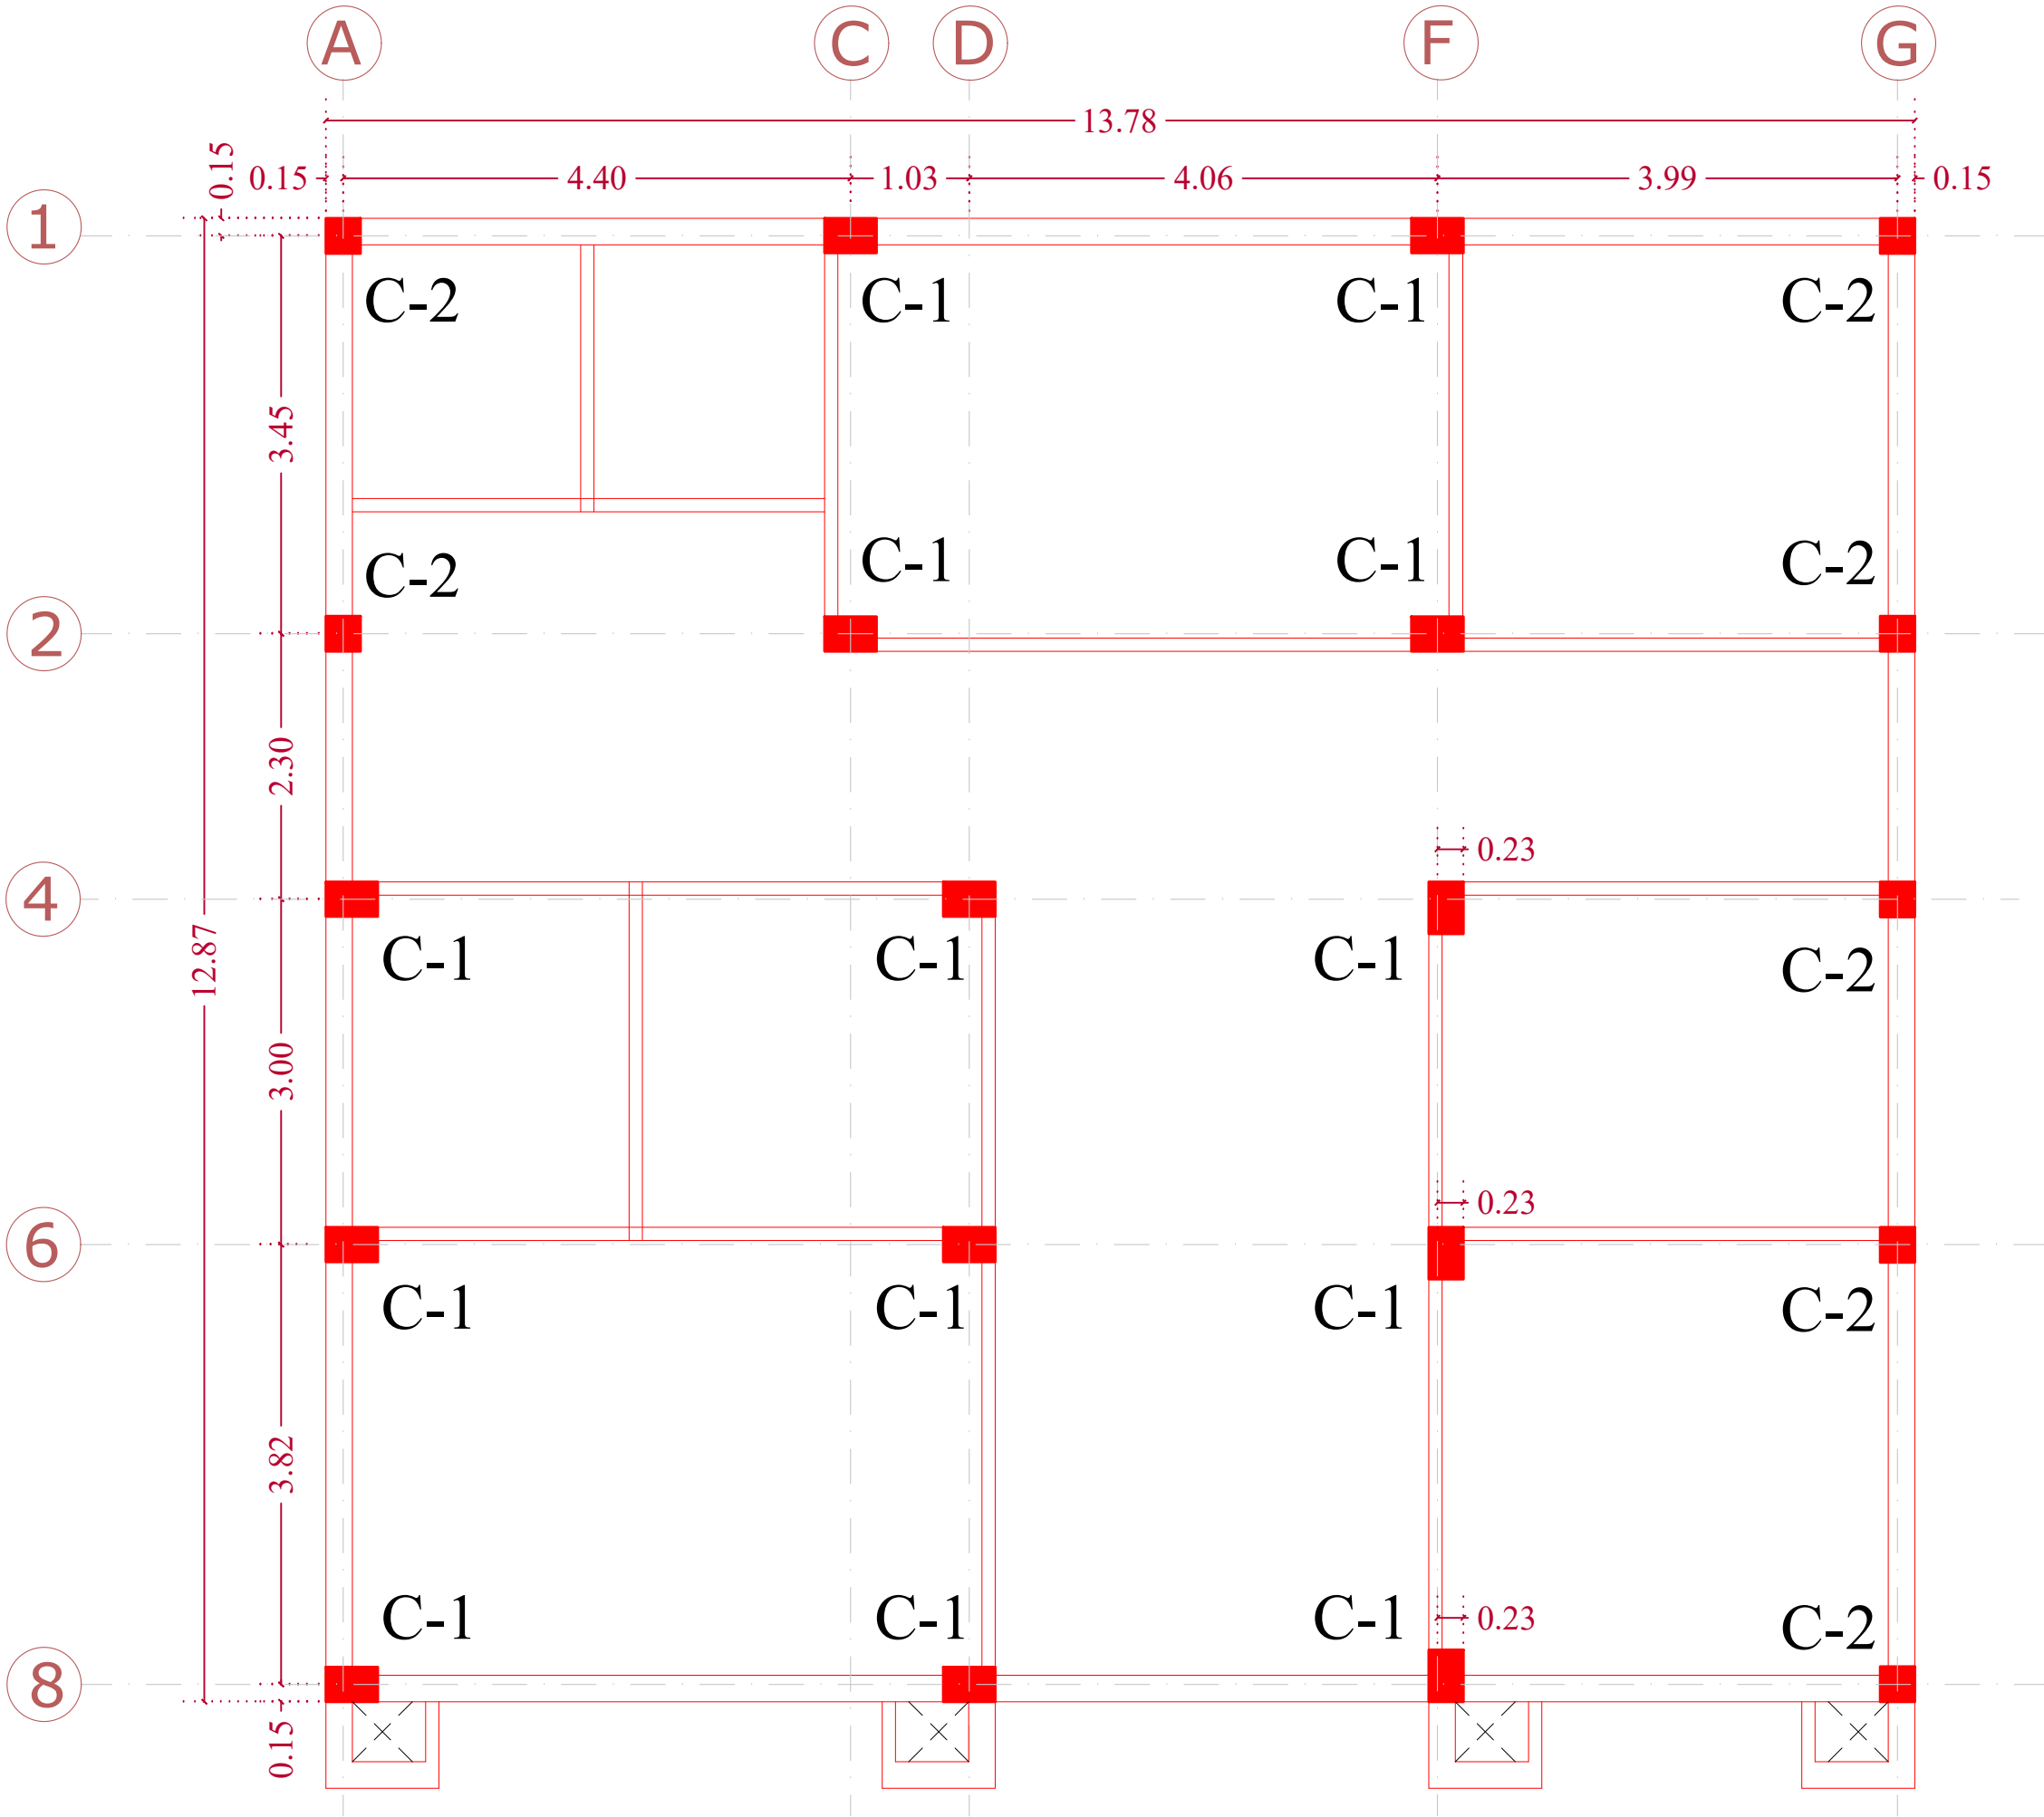

SUBMITTED BY :-

D.B.S.C.R.
GOVT. POLYTECHNIC
SAMPLA

CLIENT : THE EXECUTIVE ENGINEER
PANCHAYATI RAJ DISTRICT JIND
HARYANA

PROJECT:

DRAWING TITLE:
COLUMN LAYOUT

☐ CONCEPTUAL DRG	☐ WORKING DRG
☐ SCHEMATIC DRG	☐ AS BUILT DRG

QUANTITY.- 1

NOTE -


NOTE - DIMENSIONS HAS TO BE
CHECKED FROM SITE.

DISPATCH DATE: 03/09/2025


Scale: NTS	NORTH
Drawn By:	
Checked By:	

ISSUES AND REVISIONS		
NO.	DATE	REMARKS
1		
2		
3		


NOTE:-
*This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission.
*All dimension are as indicated unless otherwise mentioned.
*Drawing not to be scaled, dimensions to be followed.
*All discrepancies to be brought to the notice of the designer before execution and his design to be final.
*This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.

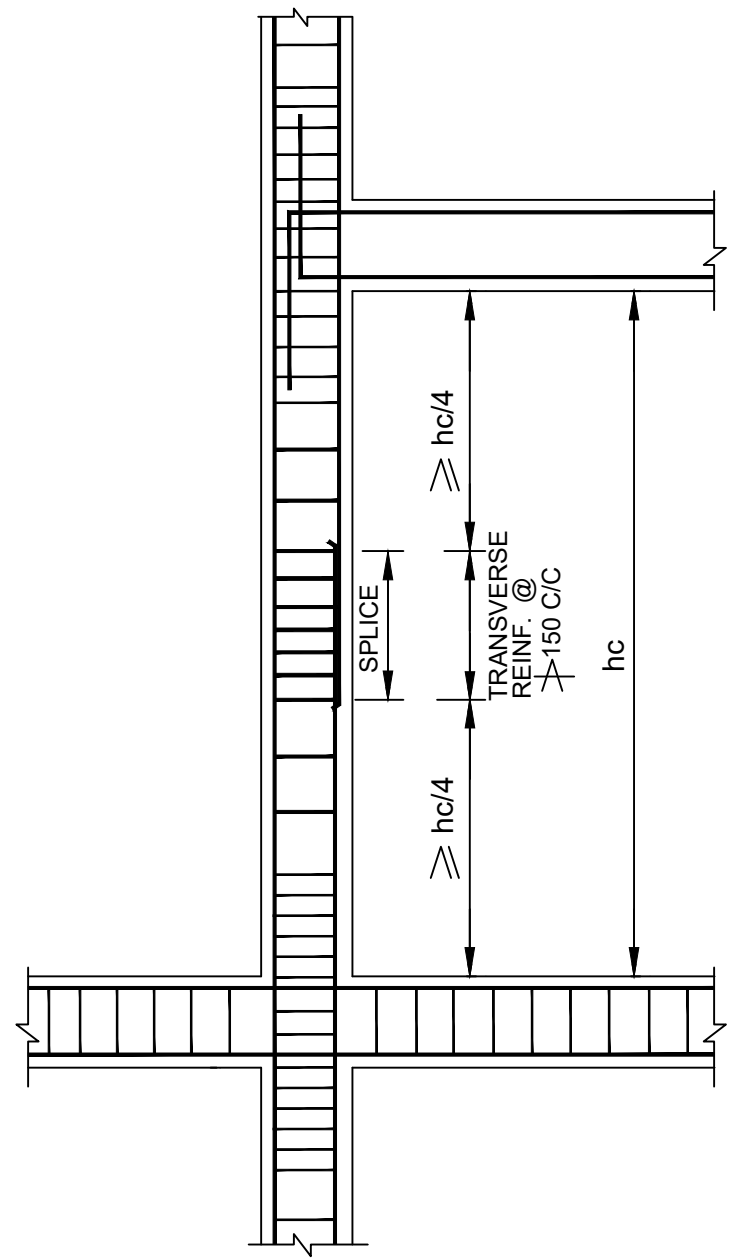

TYP. COLUMN REINF. SPLICING DETAILS

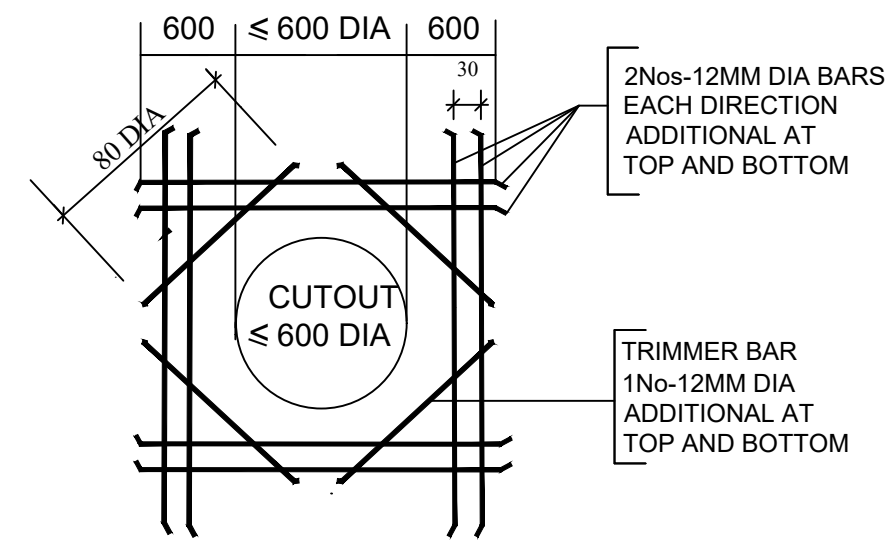


ADDITIONAL REINFORCEMENT AROUND CIRCULAR CUT-OUT (OPENING) IN SLAB

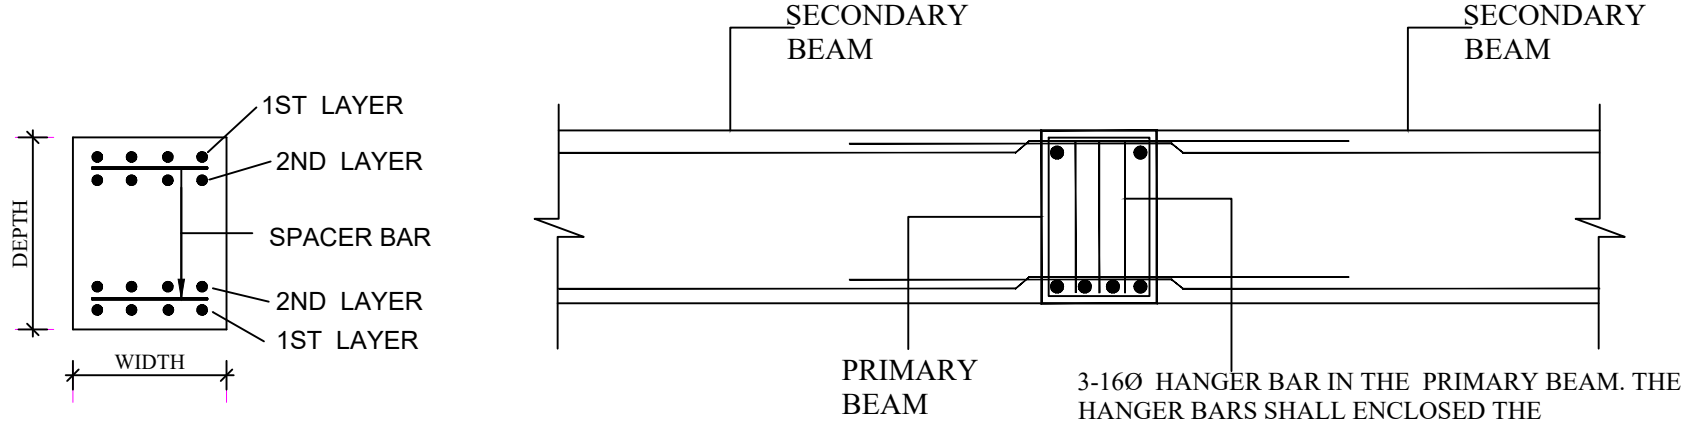


TYP. SEC. OF MAIN BEAM
(STIRRUPS NOT SHOWN)

TYPICAL JUNCTION DETAILS
OF MAIN & SECONDARY BEAMS

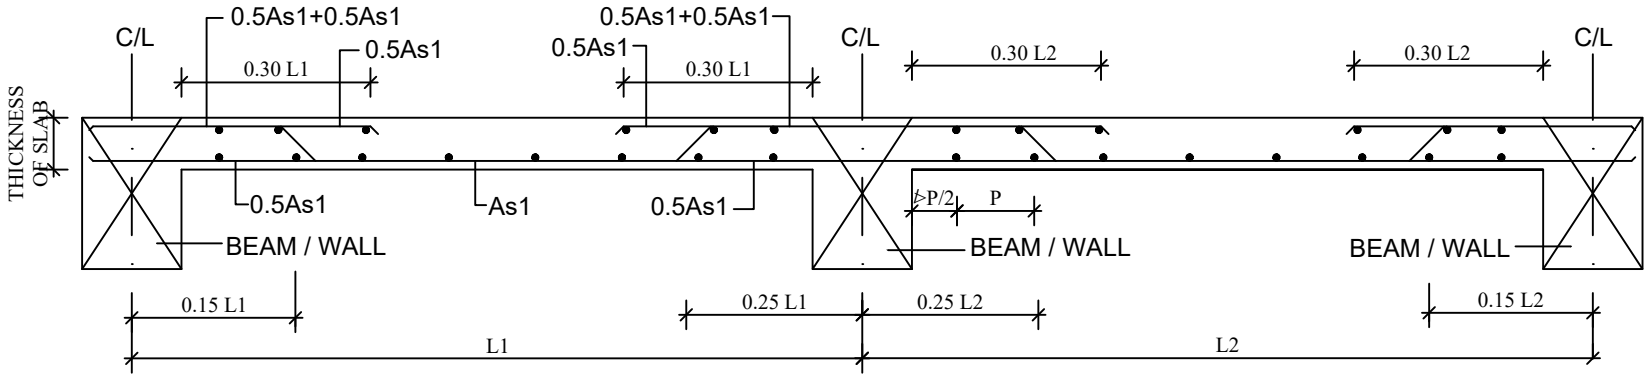

TYPICAL SECTION THROUGH SLAB

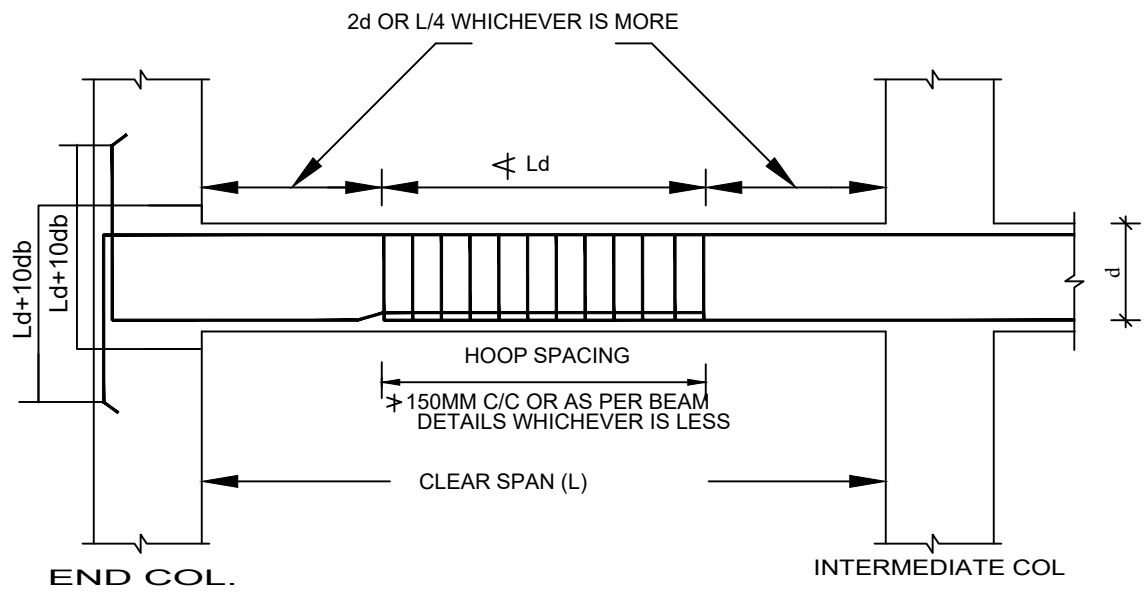

TYPICAL DETAILS OF LAP & SPLICE IN BEAM

Ld = DEVELOPMENT LENGTH
d = EFFECTIVE DEPTH OF BEAM

SUBMITTED BY:-

D.B.S.C.R
GOVT POLYTECHNIC
SAMPLA

CLIENT : THE EXECUTIVE ENGINEER
PANCHAYATI RAJ DISTRICT JIND
HARYANA

PROJECT:

DRAWING TITLE: TYPICAL DETAIL_II

☐ CONCEPTUAL DRG	☒ WORKING DRG
☐ SCHEMATIC DRG	☐ AS BUILT DRG

QUANTITY.- 1

NOTE -

DESIGN NO.-1

NOTE - DIMENSIONS HAS TO BE
CHECKED FROM SITE.

DISPATCH DATE: 17/07/2025


Scale: NTS	NORTH
Drawn By:	
Checked By:	

ISSUES AND REVISIONS		
NO.	DATE	REMARKS
1		
2		
3		

NOTE:-
*This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission.
*All dimension are as indicated unless otherwise mentioned.
*Drawing not to be scaled, dimensions to be followed.
*All discrepancies to be brought to the notice of the designer before execution and his design to be final.
*This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.

TYPICAL DETAIL_II

PRINT THIS TYPE OF DRAWING ON A3 PAGE SIZE

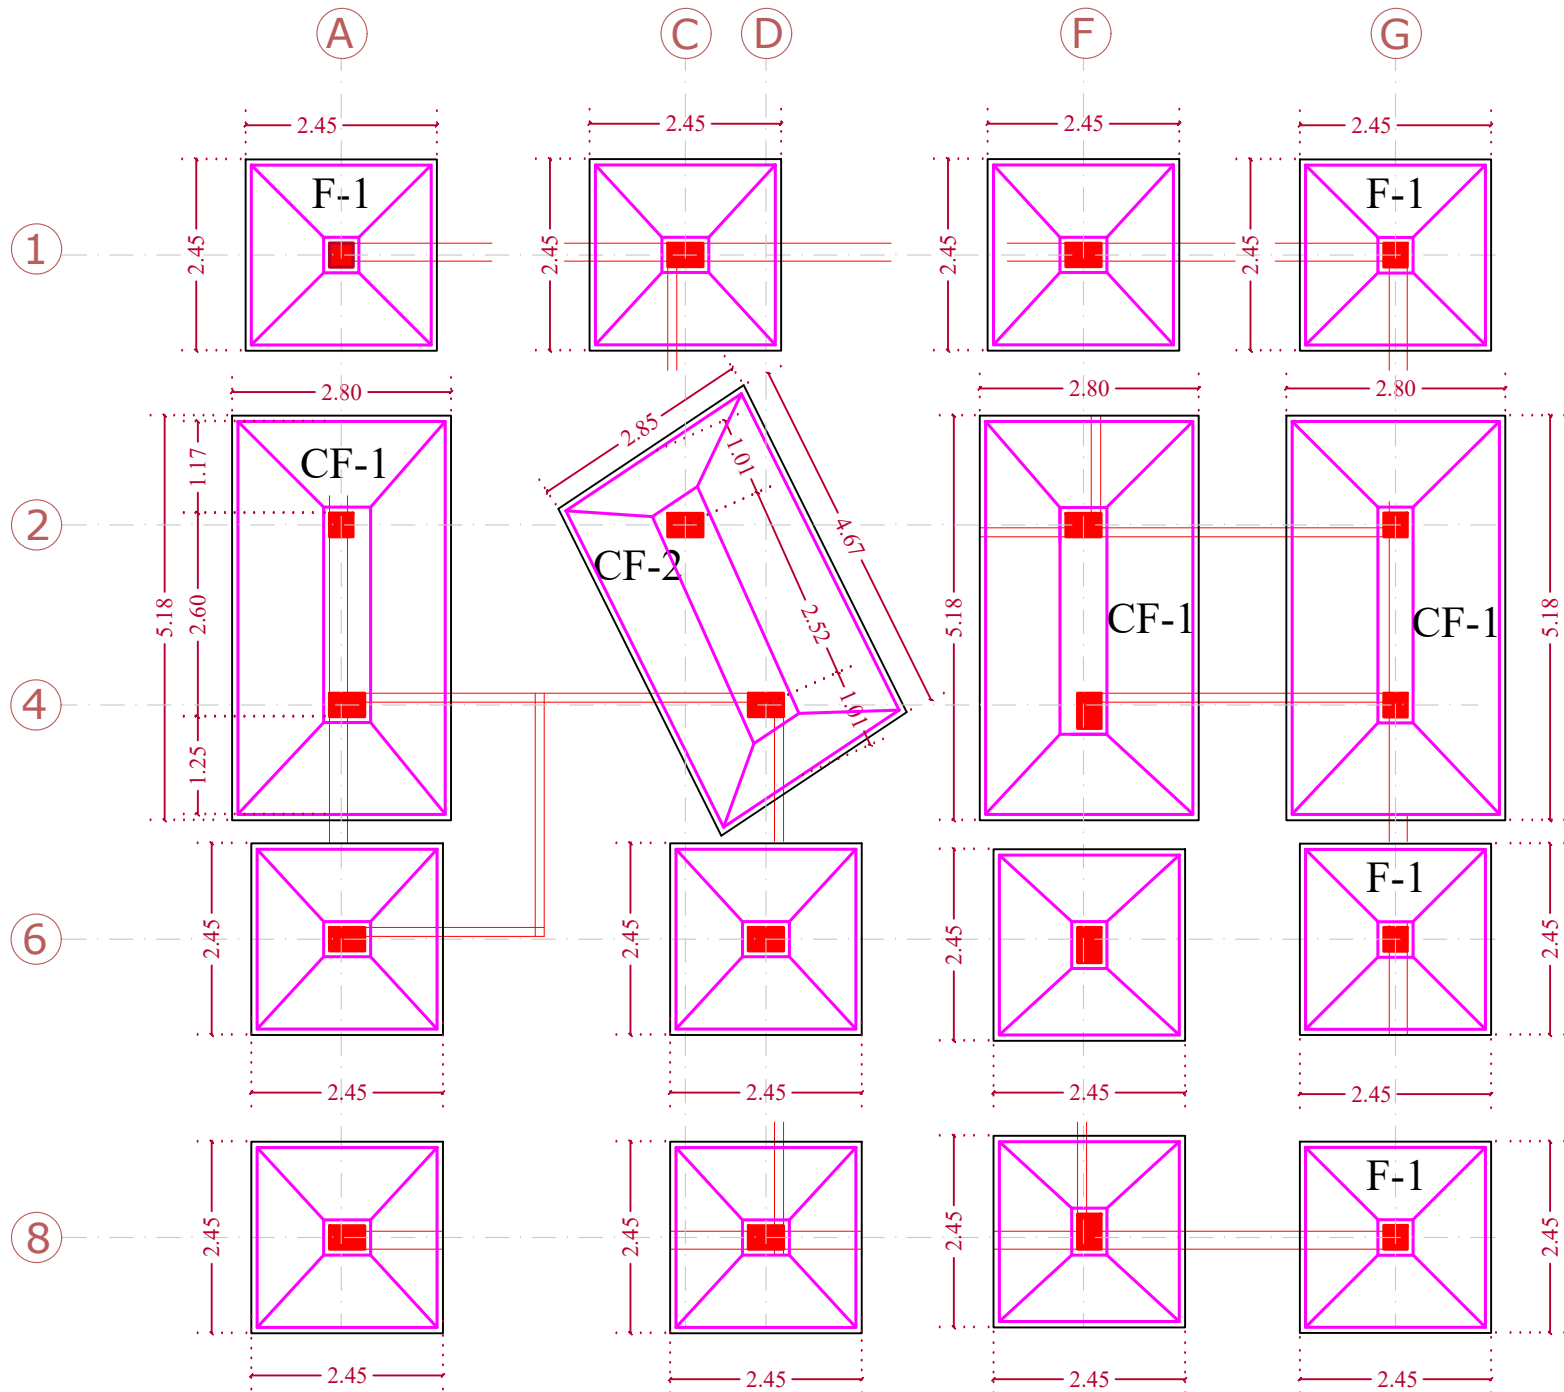

FOOTING LAYOUT

SUBMITTED BY :-

D.B.S.C.R.
GOVT. POLYTECHNIC
SAMPLA

CLIENT : THE EXECUTIVE ENGINEER
PANCHAYATI RAJ DISTRICT JIND
HARYANA

PROJECT:

DRAWING TITLE:
FOOTING LAYOUT

☐ CONCEPTUAL DRG ☐ WORKING DRG
☐ SCHEMATIC DRG ☐ AS BUILT DRG

QUANTITY.- 1

NOTE -

NOTE - DIMENSIONS HAS TO BE
CHECKED FROM SITE.

DISPATCH DATE: 03/09/2025

Scale: NTS NORTH
Drawn By:
Checked By:

ISSUES AND REVISIONS		
NO.	DATE	REMARKS
1		
2		
3		

NOTE:-
*This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission.
*All dimension are as indicated unless otherwise mentioned.
*Drawing not to be scaled, dimensions to be followed.
*All discrepancies to be brought to the notice of the designer before execution and his design to be final.
*This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.

NOTE:-
1. CHECK ALL DIMENSIONS AND LEVELS WITH ARCHITECTURAL DRAWING.
2. THERE WILL BE NO FUTURE EXPANSION ABOVE GROUND FLOOR.

1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE SPECIFIED.

2. ONLY WRITTEN DIMENSIONS SHOULD BE FOLLOWED NEITHER THE BARS SHALL BE COUNTED NOR THE DIMENSIONS BE SCALED FROM THE DRAWING.

3. ANY DISCREPANCY IN ARCH. DRG, STRUCTURAL DRG SHALL BE BROUGHT TO THE NOTICE OF THIS OFFICE & GOT RECONCILED BEFORE EXECUTION.

4. WORK SHALL BE CARRIED OUT AS PER STRUCTURAL SPECIFICATIONS.

5. NET SAFE BEARING CAPACITY OF SOIL HAS BEEN TAKEN AS 9 T/SQM. AT A DEPTH OF 1.52M FROM N.G.L. BUILDING IS DESIGNED FOR GROUND FLOOR

A) LIVE LOAD FOR SLAB IS TAKEN 4KN/SQM.

6. ALL R.C.C. WORK SHALL BE IN FOLLOWING GARDE OF CEMENT CONCRETE

* RAFT FOUNDATION, RCC COLUMN, SHEAR WALL = M20 (1:1.5:3)

* RCC ROOF SLAB & BEAMS, STAIRS, LINTEL BEAMS=M20 (1:1.5:3) DESIGN MIX CONCRETE

7. WATER TO BE USED SHALL CONFORM TO I.S. 456-2000.

8. MINIMUM NOMINAL COVER TO ALL REINFORCEMENT AS PER I.S. 456-2000 INCLUDING LINKS SHALL BE AS BELOW

a) FOUNDATION = 50 MM b) COLUMNS = 40 MM

c) BEAMS = 30 MM

d) PLINTH BEAM = 40 MM e) SLABS = 20 MM

f) RETAINING WALLS = 40MM ON EARTH SIDE

9. REINFORCEMENT BARS TO BE USED SHALL BE TMT BARS (THERMO MECHANICALLY TREATED BARS) OF GRADE 500 D CONFORMING TO I.S. 1786.

10. I.S. 456-2000. I.S. 4326, I.S. 13920 SHALL BE REFFERED FOR DETAILING OF REINFORCEMENT AND TO MEET DUCTILITY REQUIREMENTS SOME OF SALIENT FEATURES OF WHICH ARE REITERATED AS UNDER :

a) REINFORCEMENT OF COLUMN TO BE TERMINATED SHALL BE TAKEN INTO THEIR RESPECTIVE BEAMS AT TERMINATION LEVEL UPTO DEVELOPMENT LENGTH (Ld).

b) NOT MORE THAN HALF OF THE TOTAL NOS. OF BARS SHALL BE OVERLAPPED AT ANY SECTION. OVERLAPPING SHALL BE STAGGERED & AVOIDED AT THE POINT OF THE MAXIMUM BENDING MOMENT IN THE BEAM.

c) IN 'K' , DISTANCE OF COLUMN FROM TOP AND BOTTOM OF INTERSECTING BEAM THE TIES BE KEPT AS PER I.S. 13920 REFER DETAIL.

d) CONFINING STIRRUPS IN BEAM COLUMN JUNCTION SHALL BE PROVIDED IN 'Z' PORTION (REFER SECTION A-A TYPICAL DETAIL OF COLUMN). HOWEVER IF COLUMN IS CONNECTED FROM FOUR DIRECTIONS, THE SPACING SHOULD BE DOUBLED. IN CASE OF DIFFICULTY IN PROVIDING CLOSED STIRRUPS, 'U' TYPE STIRRUPS FROM TWO OPPOSITE DIRECTIONS PROJECTING UPTO DEVELOPMENT LENGTH Ld IN BEAM FROM COLUMN FACE CAN BE PROVIDED.

e) WHERE A BEAM TERMINATES INTO ANOTHER BEAM OR ON WALL, THE BOTTOM BARS OF TERMINATING BEAM SHALL BE BENT UP AT ENDS BY Lo. WHERE Lo = 12 TIMES THE DIA OF BAR OR EFFECTIVE DEPTH OF TERMINATING BEAM WHICHEVER IS MORE (REFER SKETCH).

f) CLOSED STIRRUPS SHALL BE PROVIDED i.e. THE HOOKS SHALL BE BENT BY 135° (REFER SKETCH) INTO THE CORE.

g) LAP LENGTH , DEVELOPMENT LENGTH FOR ALL STRAIGHT REINFORCEMENT BARS SHALL BE AS UNDER :
REFER CLAUSE : 26.2.5.1 OF IS 456-2000.

i) M:25 = 48 d

WHERE d IS THE DIA OF BAR. Ld AS CALCULATED ABOVE SHALL BE CORRECTED FOR ANCHORAGE VALUE OF EVERY 45° BEND @ 4xDIA OF BAR. SUBJECT TO MAX. 16xDIA OF BAR.
- ii) LAP LENGTH INCLUDING ANCHORAGE VALUE OF HOOKS FOR BARS IN FLEXURAL SHALL BE Ld (SEE 26.2.1) OR 30Ø WHICHEVER IS GREATER AND FOR DIRECT TENSION SHALL BE 2Ld OR 30Ø WHICHEVER IS GREATER. THE STRAIGHT LENGTH OF THE LAPSHALL NOT BE LESS THAN 15Ø OR 20MM.THE FOLLOWING PROVISIONS SHALL ALSO APPLY:- WHERE LAP OCCURS FOR A TENSION BAR LOCATED AT:

a) TOP OF A SECTION AS CAST AND THE MINIMUM COVER IS LESS THAN TWICE THE DIAMETER OF THE LAPPED BAR, THE LAP LENGTH SHALL BE INCREASED BY A FACTOR OF 1.4.

b) CORNER OF A SECTION AND THE MINIMUM COVER TO EITHER FACE IS LESS THAN TWICE THE DIAMETER OF LAPPED BAR OR WHERE THE CLEAR DISTANCE BETWEEN ADJACENT LAPS IS LESS THAN 75MM OR 6 TIMES THE DIAMETER OF LAPPED BAR,WHICHEVER IS GREATER, THE LAP LENGTH SHALL BE INCREASED BY A FACTOR OF 1.4. WHERE BOTH CONDITION(a) &(b) APPLY, THE LAP LENGTH SHALL BE INCREASED BY A FACTOR OF 2.0.

NOTE:- SPLICES IN TENSION MEMBERS SHALL BE ENCLOSED IN SPIRALS MADE OF BARS NOT LESS THAN 6MM DIAMETER WITH PITCH NOT MORE THAN 100MM.

iii) LAP SPLICES SHALL BE CONSIDERED AS STAGGERED IF THE CENTRE TO CENTRE DISTANCE OF THE SPLICES IS NOT LESS THAN 1.3 TIMES THE LAP LENGTH CALCULATED AS DESCRIBED IN NOTE NO. -10g(ii).

11. CENTRING & SHUTTERING FOR THE CANTILEVER SHALL NOT BE REMOVED UNLESS FLOOR SLAB BEHIND IT HAS BEEN CAST & ATTAINED SUFFICIENT STRENGTH & WALL RAISED ABOVE THAT FLOOR LEVEL TO FULL HEIGHT.

12. TOP LEVEL OF INTERNAL PLINTH BEAMS SHALL BE 40 MM BELOW FLOOR LEVEL OR THICKNESS OF FLOOR WHICHEVER IS MORE & BOTTOM LEVEL OF EXTERNAL PLITH BEAM SHALL BE 150 MM BELOW FORMATION LEVEL. HOWEVER,THE SAME MAY BE MODIFIED AS PER SITE REQUIREMENTS/ ARCHTECTURAL DRAWINGS.

13. WHERE THERE ARE TWO OR MORE ROWS OF REINFORCEMENT BAR THE REINFORCEMENT BARS SHALL BE VERTICALLY IN LINE AND MINIMUM VERTICAL DISTANCE BETWEEN THE REINFORCEMENT BARS SHALL BE 15 mm OR 2/3 OF THE NOMINAL SIZE OF THE AGGREGATE OR THE MAX. SIZE OF BAR WHICHEVER IS THE MORE.

14. SMALL SQUARE OR CIRCULAR OPENING(AREA < 1000SQMM) MAY BE PLACED IN BEAMS WHEREVER REQUIRED PROVIDED:-

a) THE CLEAR DISTANCE BETWEEN SUCH OPENINGS,MEASURED ALONG THE BEAM, IS NOT LESS THAN 150MM.

b) THE EDGE OF THE SMALL OPENINGS SHOULD BE NOT CLOSER THAN 0.46d, TO THE COMPRESSION FACE OF THE MEMBER, WHERE 'd' IS THE EFFECTIVE DEPTH OF THE BEAM.

18. NECESSARY ARCH FEATURES SHALL BE INCORPORATED AS PER RELEVANT ARCH DRGS ISSUED BY SA(CHD) OFFICE TIME TO TIME.
- NOTES FOR CONSTRUCTION JOINTS

1) DURING CASTING OF BEAM, IF THE WORK IS STOPPED FOR A DURATION LONGER THAN INITIAL SETTING TIME OF CEMENT, THEN SUCH DISCONTINUITY SHALL BE TREATED AS CONSRUCTION JOINTS.

2) CONSTRUCTION JOINTS SHALL BE MADE VERTICAL BY PROPER TEMPLATE WITH SLOTS FOR ACCOMMODATING REINFORCEMENT BARS. THE JOINT SHALL BE TREATED IN ACCORDANCE WITH C.P.W.D. SPECIFICATIONS.

- 3) CONSTRUCTION JOINTS SHALL BE PLANNED AT OR NEAR MID SPAN BUT NOT OUT SIDE THE MIDDLE THIRD OF THE SPAN PROVIDED THE BEAM DOES NOT CARRY ANY CONCENTRATED LOAD. IN CASE BEAM CARRIES CONCENTRATED LOAD DUE TO REACTION OF THE SECONDARY BEAM, THE CONSTRUCTION JOINT IN THE MAIN BEAM SHALL BE OFFSET BY A DISTANCE EQUAL TO TWICE THE WIDTH OF THE SECONDARY BEAM.
- 4) CONSTRUCTION JOINTS SHALL NOT BE PROVIDED IN CANTILEVER SLAB & BEAMS. THE CANTILEVER BEAMS SHALL BE CAST MONOLITHICALLY WITH INTERIOR BEAM.

SUBMITTED BY:-

D.B.S.C.R
GOVT. POLYTECHNIC
SAMPLA

CLIENT : THE EXECUTIVE ENGINEER
PANCHAYATI RAJ DISTRICT - JIND
HARYANA

DRAWING TITLE: TYPICAL DETAIL_III

PROJECT :

☐ CONCEPTUAL DRG

☐ WORKING DRG

☐ SCHEMATIC DRG

☐ AS BUILT DRG

QUANTITY.- 1

NOTE -

NOTE - DIMENSIONS HAS TO BE
CHECKED FROM SITE.

DISPATCH DATE: 17/07/2025

Scale: NTS

Drawn By:

Checked By:

NORTH

ISSUES AND REVISIONS


NO.	DATE	REMARKS
1		
2		
3		

NOTE:-
*This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission.
*All dimension are as indicated unless otherwise mentioned.
*Drawing not to be scaled, dimensions to be followed.
*All discrepancies to be brought to the notice of the designer before execution and his design to be final.
*This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.


TYPICAL DETAIL_III

SCHEDULE FOR DETAIL OF COLUMN FOOTING

COLUMN FOOTING P.C.C SIZE			COLUMN FOOTING R.C.C SIZE		THIKNESS OF FOOTING			REINFORCEMENT FOR FOOTING		PEDESTAL DIMENSION		
L1		B1	L	B	H1	H2		R	S	P1	P2	P
F1	2.45	2.45	2.30	2.30	300	600		12MMØ @150mmC/C	12MMØ @150mmC/C	600	450	300
CF-1	5.18	2.80	5.02	2.65	300	600		12MMØ @150mmC/C	12MMØ @150mmC/C	450	450	300
CF-2	4.67	2.85	4.52	2.70	300	600		12MMØ @150mmC/C	12MMØ @150mmC/C	450	450	300

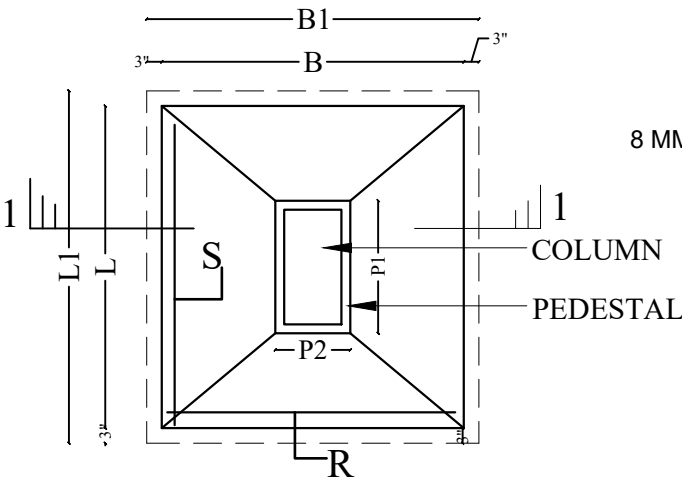

TYPICAL PLAN OF COLUMN FOOTING

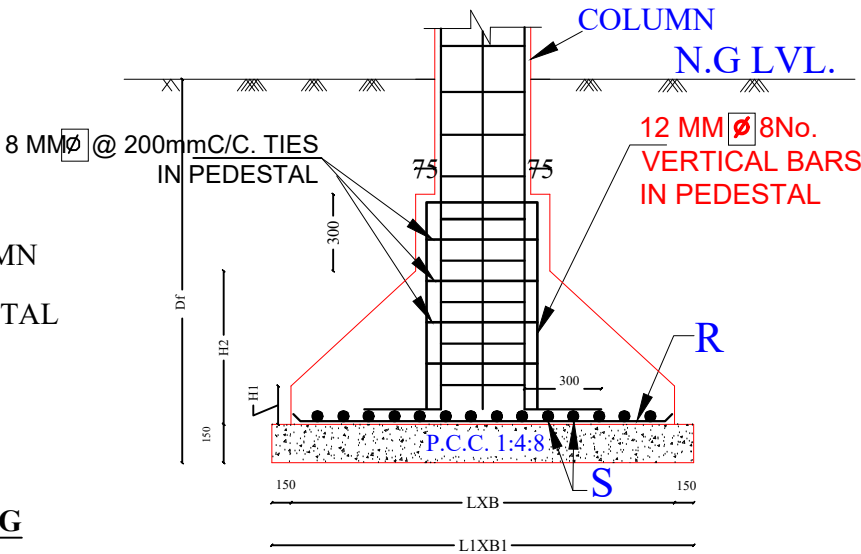


FOOTING DETAIL

SECTION AT 1-1

PRINT THIS TYPE OF DRAWING ON A3 PAGE SIZE

NOTE:- *This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission. *All dimension are as indicated unless otherwise mentioned. *Drawing not to be scaled, dimensions to be followed. *All discrepancies to be brought to the notice of the designer before execution and his design to be final. *This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.	NOTE - DIMENSIONS HAS TO BE CHECKED FROM SITE.		NOTE :-	CLIENT : THE EXECUTIVE ENGINEER PANCHAYATI RAJ DISTRICT JIND HARYANA		SUBMITTED BY :- D.B.S.C.R. GOVT. POLYTECHNIC SAMPLA		
	DISPATCH DATE: 03/09/2025			PROJECT:				
	Scale: NTS			DRAWING TITLE:				
	Drawn By:			FOOTING DETAIL				
	Checked By:			QUANTITY.- 1				
ISSUES AND REVISIONS		NO. DATE REMARKS		☐ CONCEPTUAL DRG ☐ WORKING DRG				
1		2		☐ SCHEMATIC DRG ☐ AS BUILT DRG				
2		3						

PLINTH BEAM LAYOUT

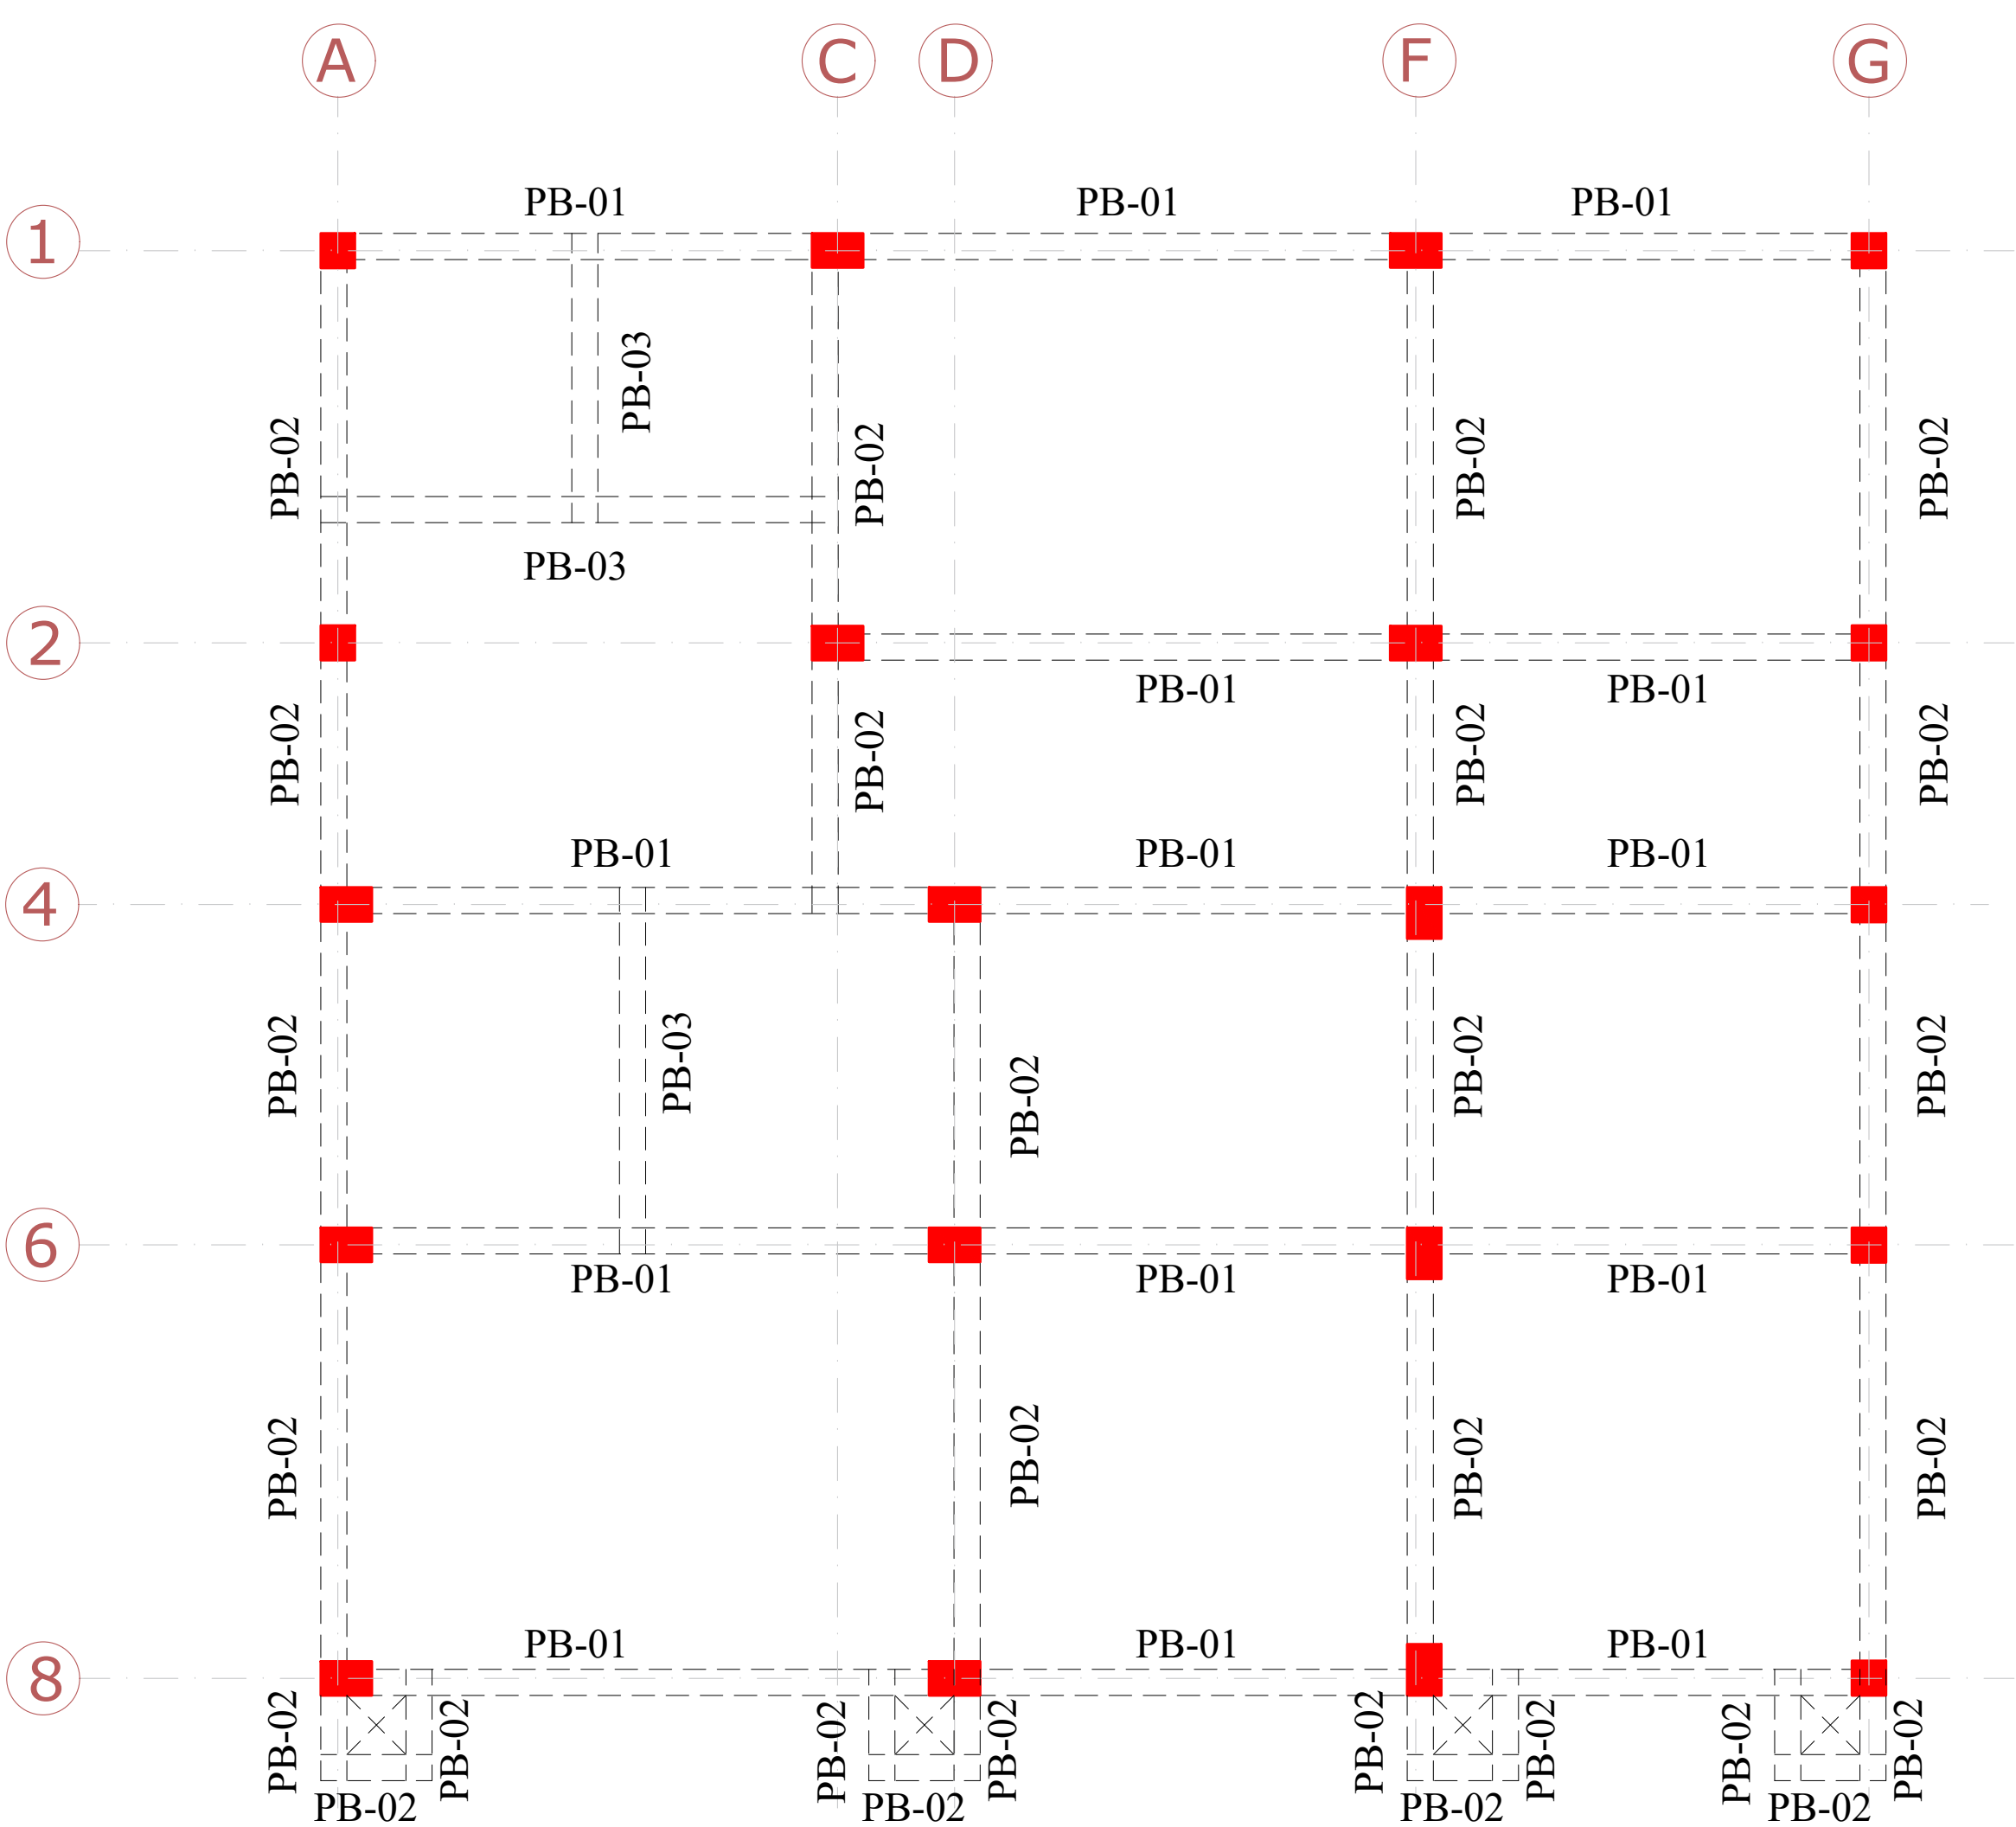

NOTE:-
1. CHECK ALL DIMENSIONS AND LEVELS WITH ARCHITECTURAL DRAWING.
2. THERE WILL BE NO FUTURE EXPANSION ABOVE GROUND FLOOR.

SUBMITTED BY :-

D.B.S.C.R.
GOVT. POLYTECHNIC
SAMPLA

CLIENT : THE EXECUTIVE ENGINEER
PANCHAYATI RAJ DISTRICT JIND
HARYANA

PROJECT:

DRAWING TITLE:
PLINTH BEAM LAYOUT

☐ CONCEPTUAL DRG	☐ WORKING DRG
☐ SCHEMATIC DRG	☐ AS BUILT DRG

QUANTITY.- 1

NOTE -



NOTE - DIMENSIONS HAS TO BE
CHECKED FROM SITE.

DISPATCH DATE: 03/09/2025




Scale: NTS	NORTH
Drawn By:	
Checked By:	

ISSUES AND REVISIONS		
NO.	DATE	REMARKS
1		
2		
3		

NOTE:-
*This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission.
*All dimension are as indicated unless otherwise mentioned.
*Drawing not to be scaled, dimensions to be followed.
*All discrepancies to be brought to the notice of the designer before execution and his design to be final.
*This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.

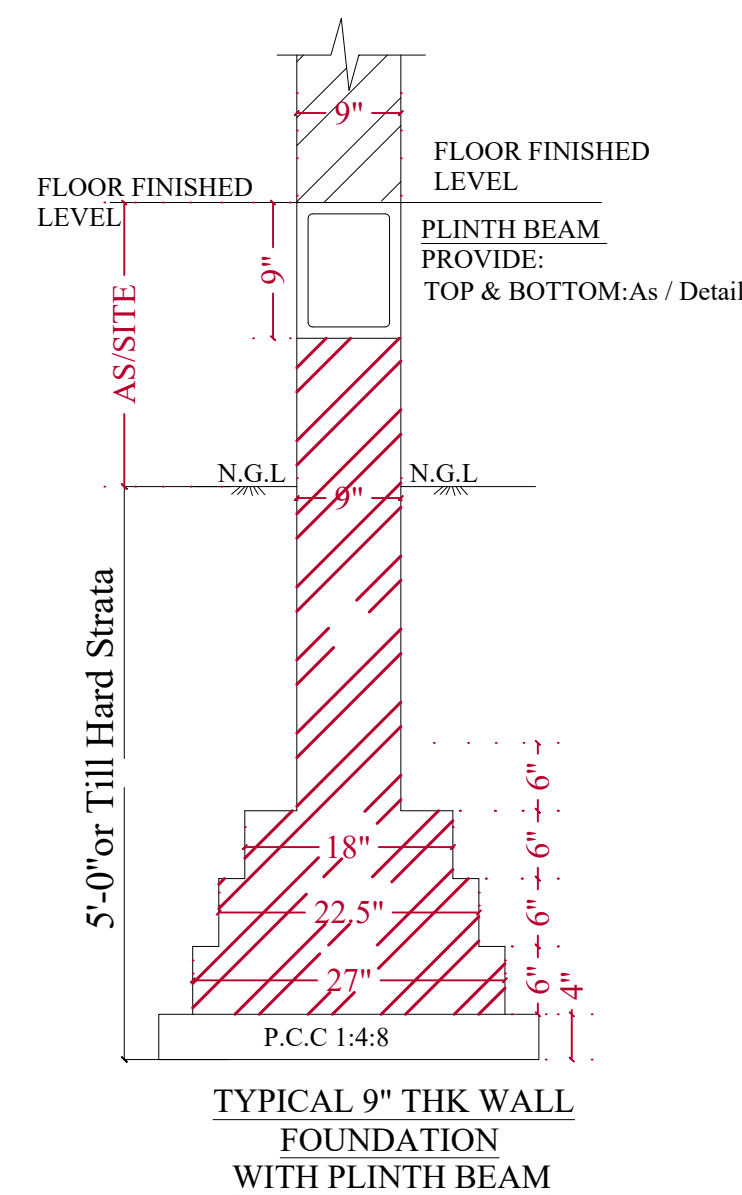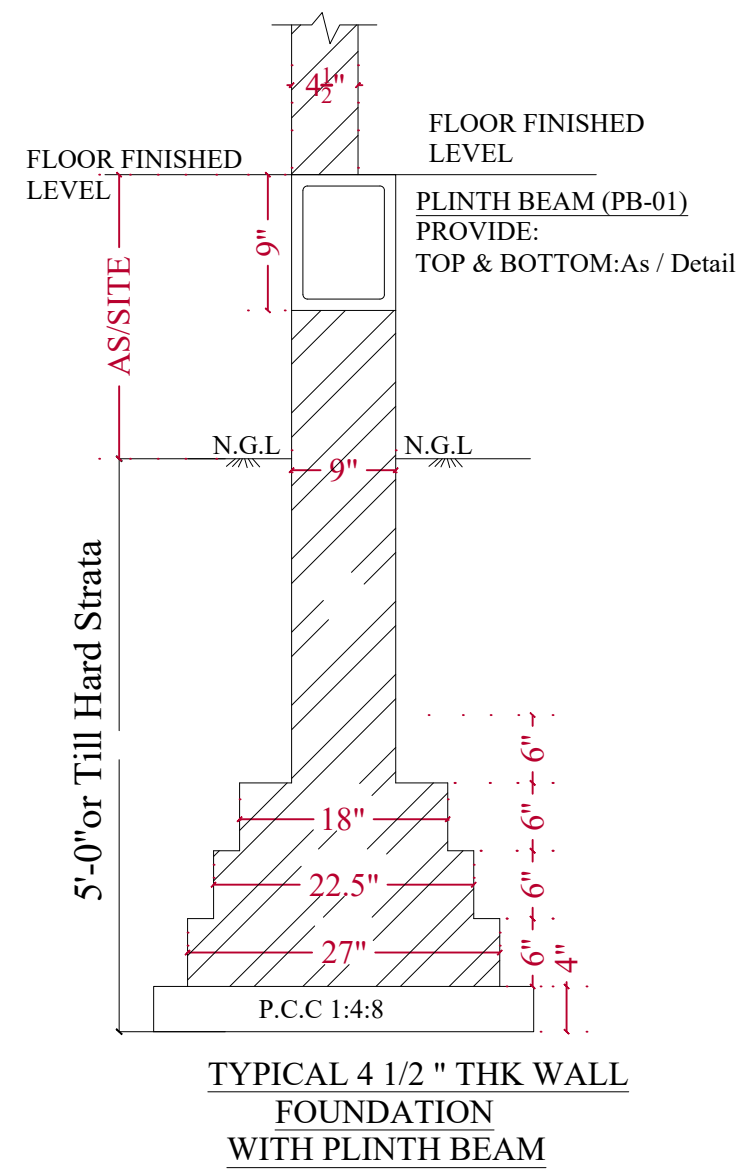

PLINTH BEAM DETAIL

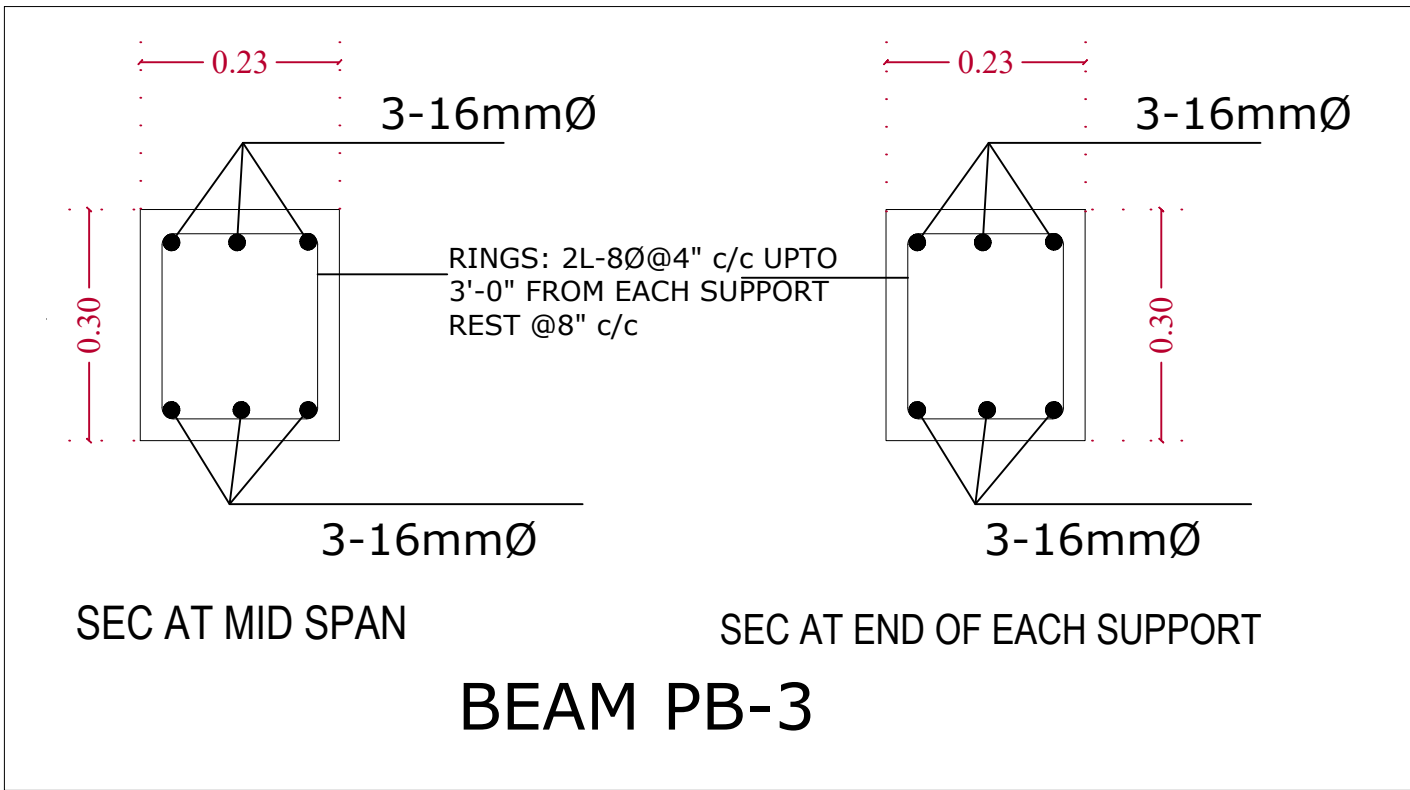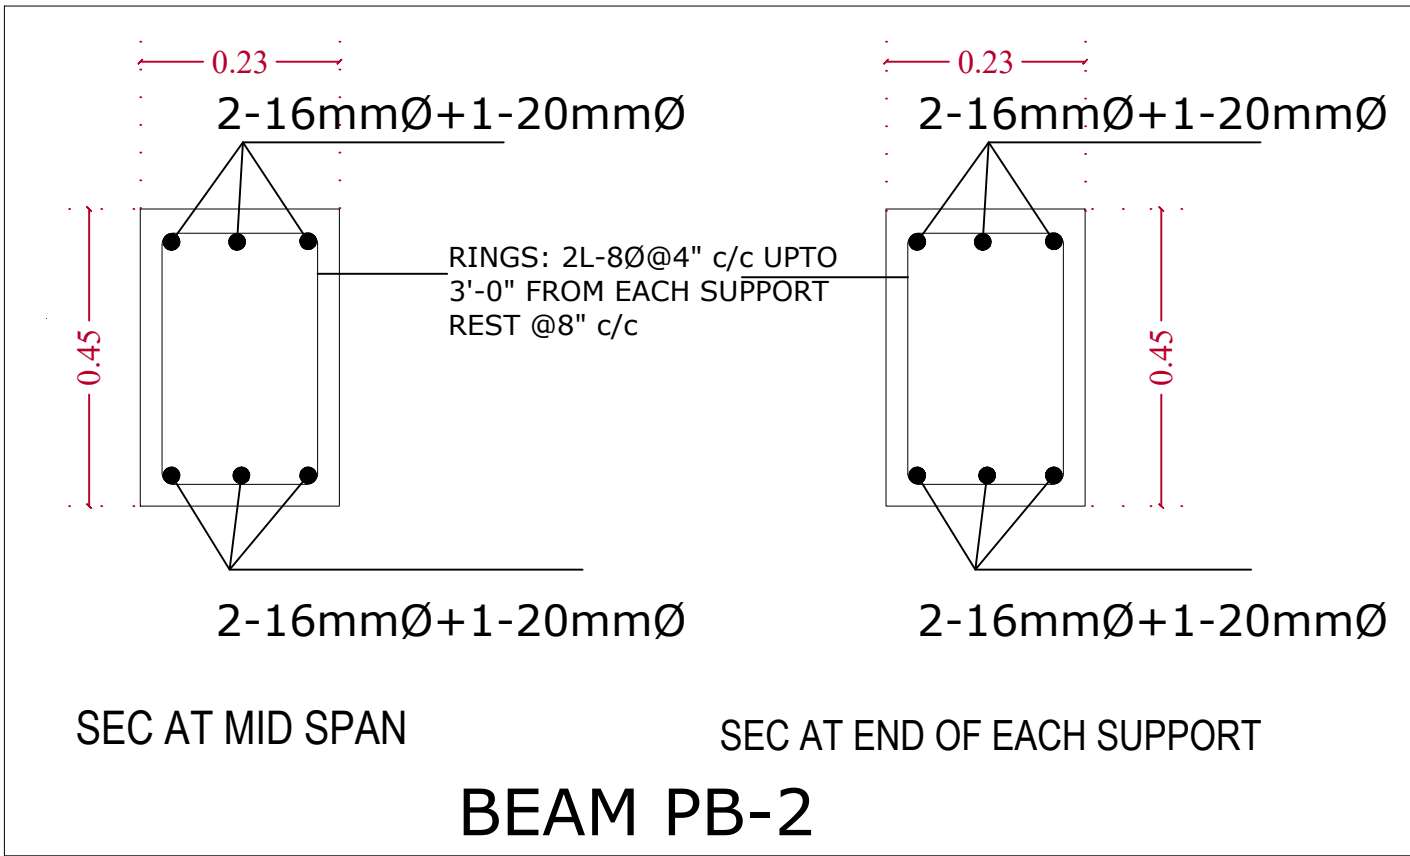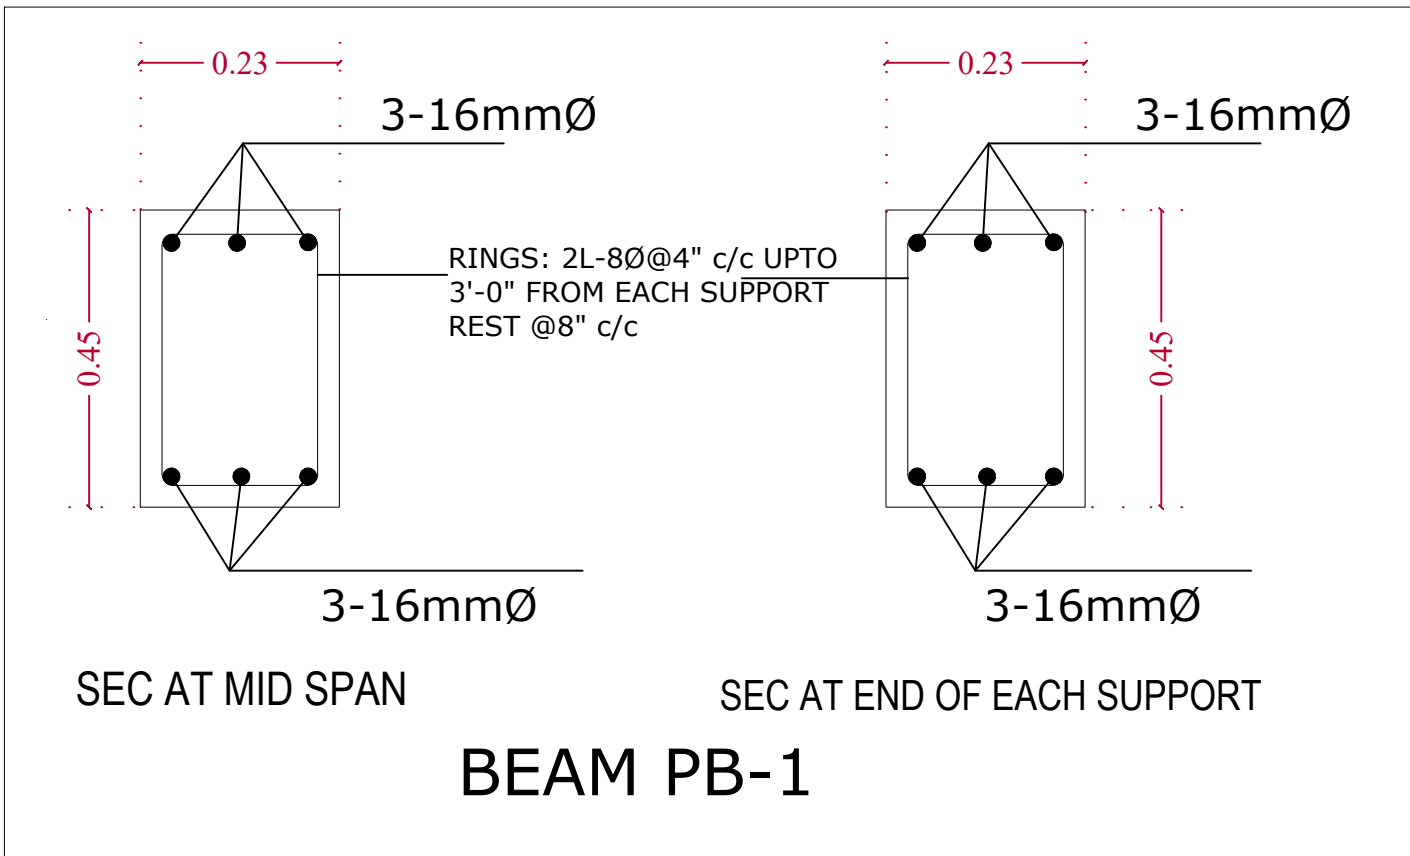

PLINTH BEAM DETAIL

NOTE:-
*This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission.
*All dimension are as indicated unless otherwise mentioned.
*Drawing not to be scaled, dimensions to be followed.
*All discrepancies to be brought to the notice of the designer before execution and his design to be final.
*This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.

NOTE - DIMENSIONS HAS TO BE CHECKED FROM SITE.		
DISPATCH DATE: 17/07/2025		
Scale: NTS		NORTH
Drawn By:		
Checked By:		
ISSUES AND REVISIONS		
NO.	DATE	REMARKS
1		
2		
3		

NOTE :-

CLIENT : THE EXECUTIVE ENGINEER
PANCHAYATI RAJ DISTRICT JIND HARYANA

PROJECT:

DRAWING TITLE:
PLINTH BEAM DETAIL

☐ CONCEPTUAL DRG ☐ WORKING DRG
☐ SCHEMATIC DRG ☐ AS BUILT DRG


QUANTITY.- 1

PRINT THIS TYPE OF DRAWING ON A3 PAGE SIZE

SUBMITTED BY :-

D.B.S.C.R.
GOVT. POLYTECHNIC
SAMPLA

G.F ROOF BEAM LAYOUT

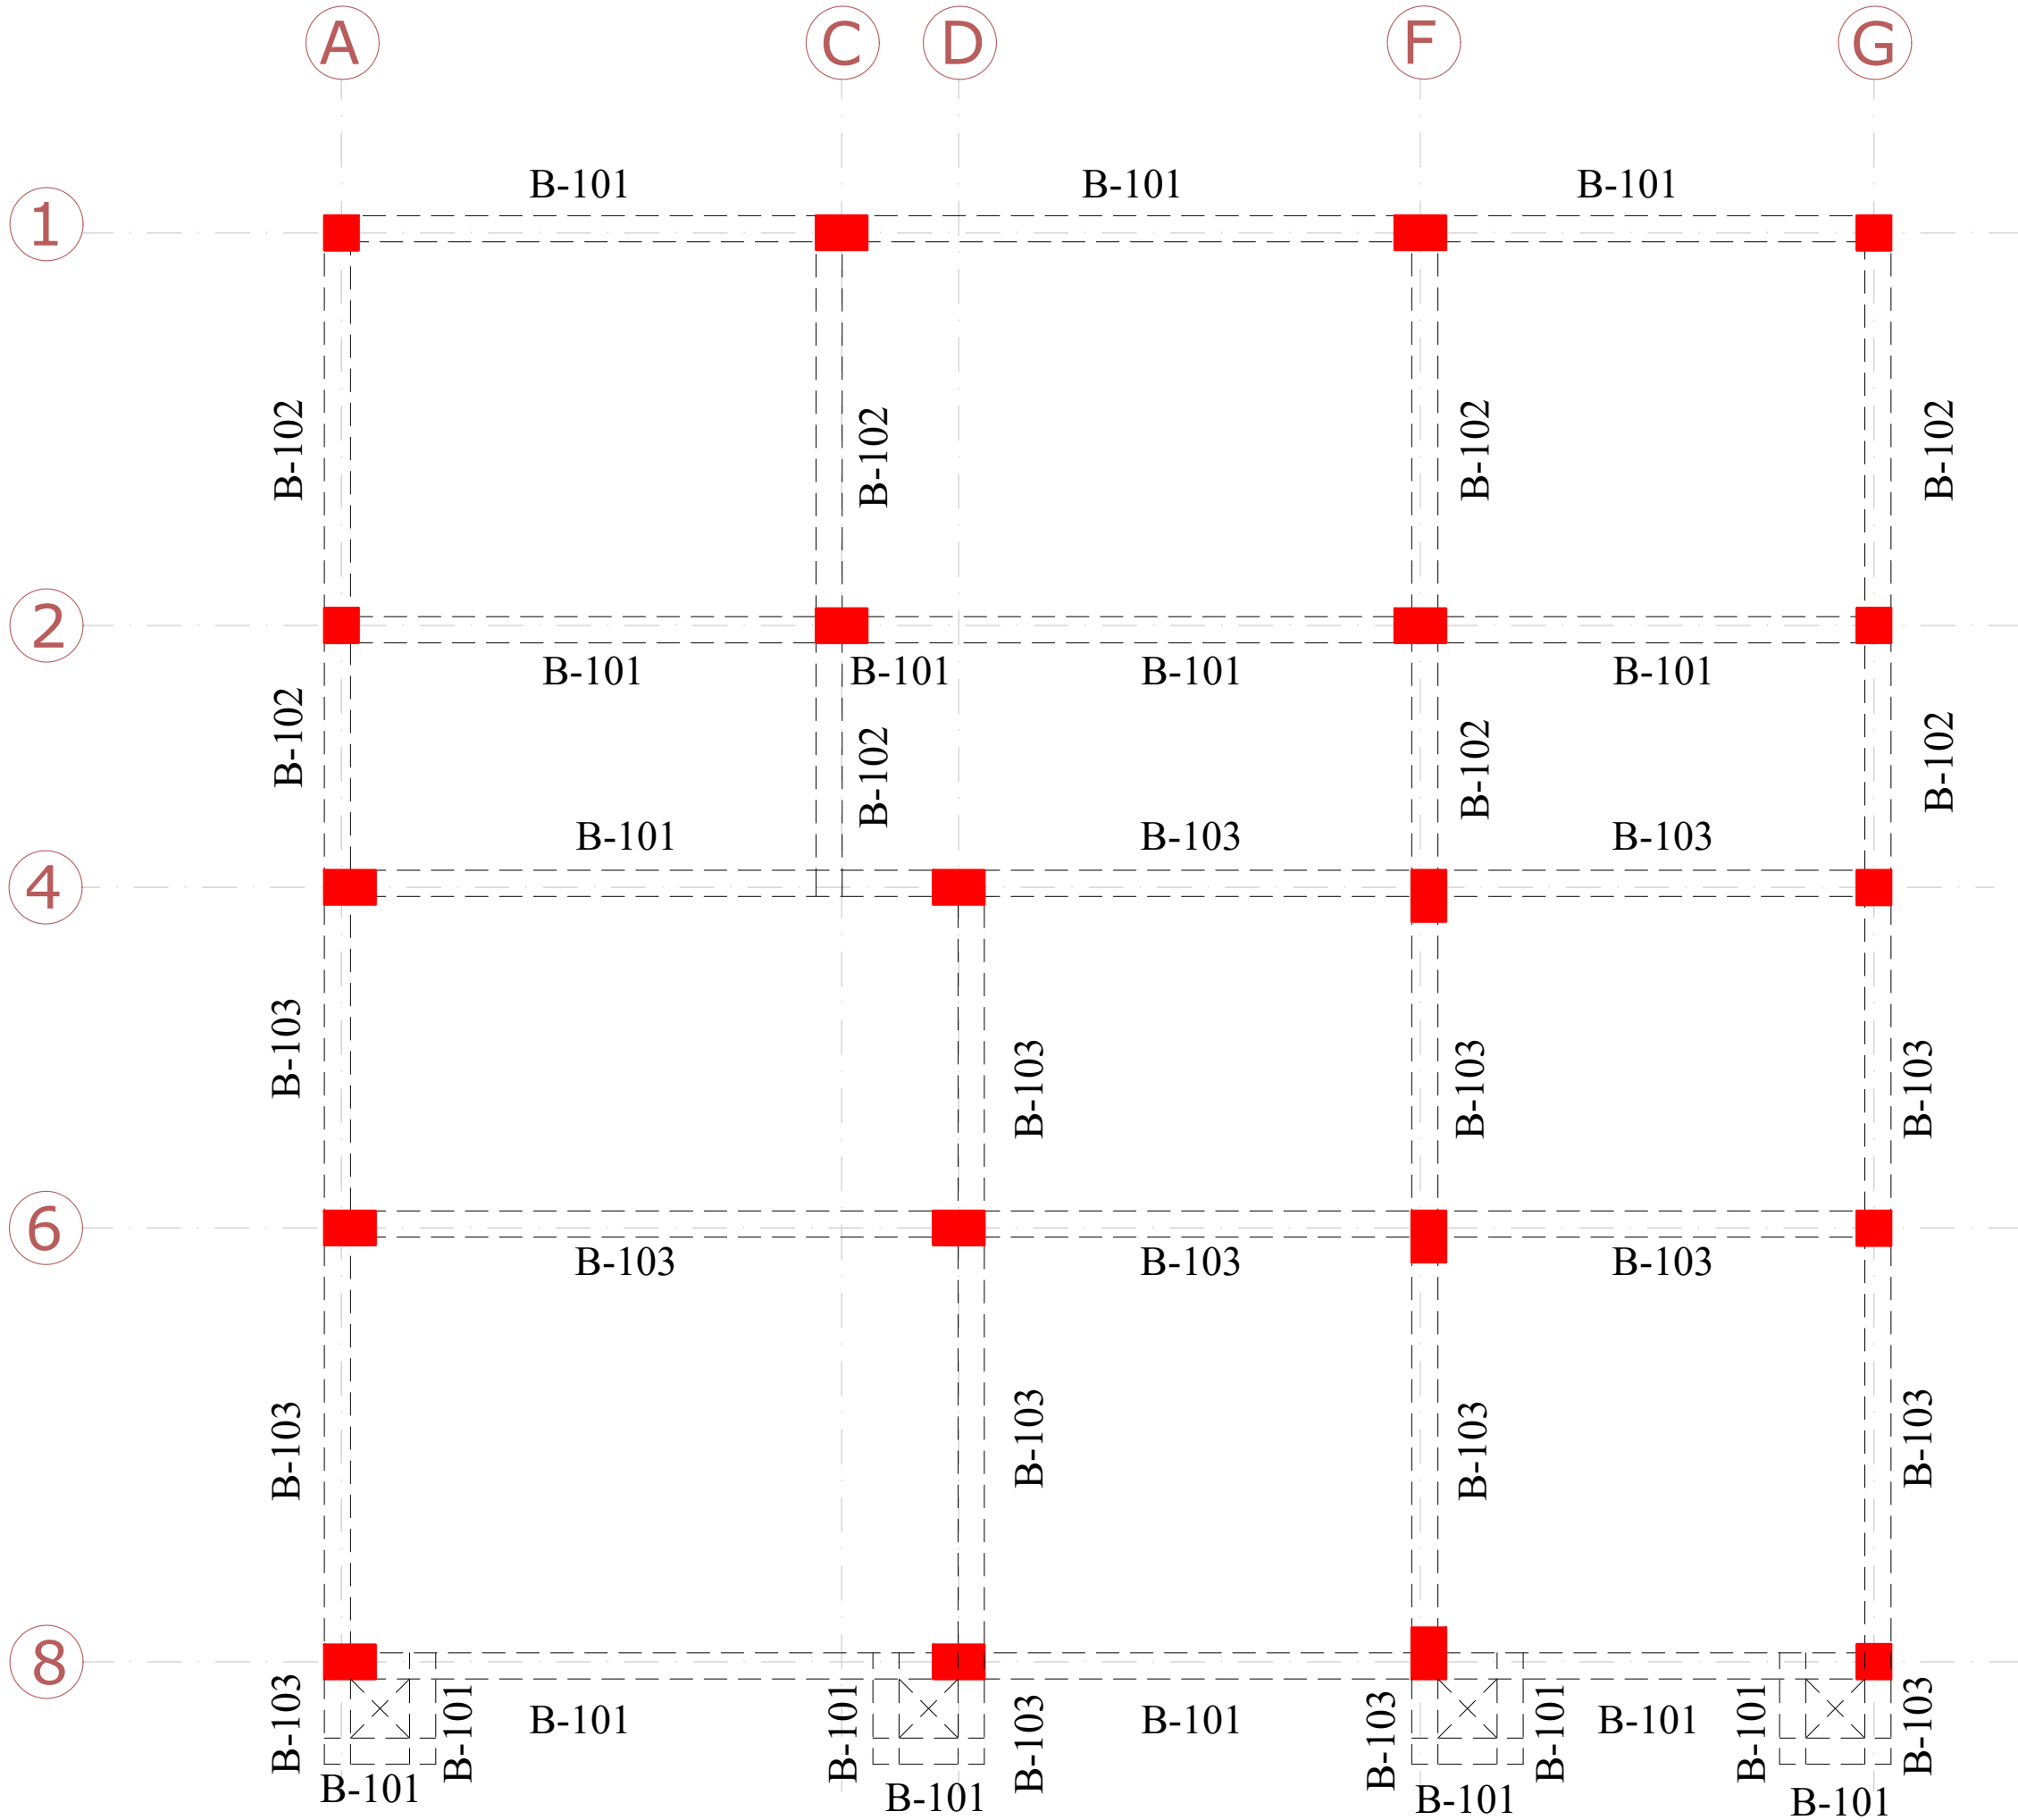

- NOTE:-
- CHECK ALL DIMENSIONS AND LEVELS WITH ARCHITECTURAL DRAWING.
 - THERE WILL BE NO FUTURE EXPANSION ABOVE GROUND FLOOR.

SUBMITTED BY :-

D.B.S.C.R.
GOVT. POLYTECHNIC
SAMPLA

CLIENT : THE EXECUTIVE ENGINEER
PANCHAYATI RAJ DISTRICT JIND
HARYANA

PROJECT:

DRAWING TITLE:
G.F ROOF BEAM LAYOUT

☐ CONCEPTUAL DRG ☐ WORKING DRG

☐ SCHEMATIC DRG ☐ AS BUILT DRG

QUANTITY.- 1

NOTE -

NOTE - DIMENSIONS HAS TO BE
CHECKED FROM SITE.




DISPATCH DATE: 03/09/2025

Scale: NTS NORTH
Drawn By:
Checked By:

ISSUES AND REVISIONS

NO.	DATE	REMARKS
1		
2		
3		

NOTE:-
*This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission.
*All dimension are as indicated unless otherwise mentioned.
*Drawing not to be scaled, dimensions to be followed.
*All discrepancies to be brought to the notice of the designer before execution and his design to be final.
*This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.

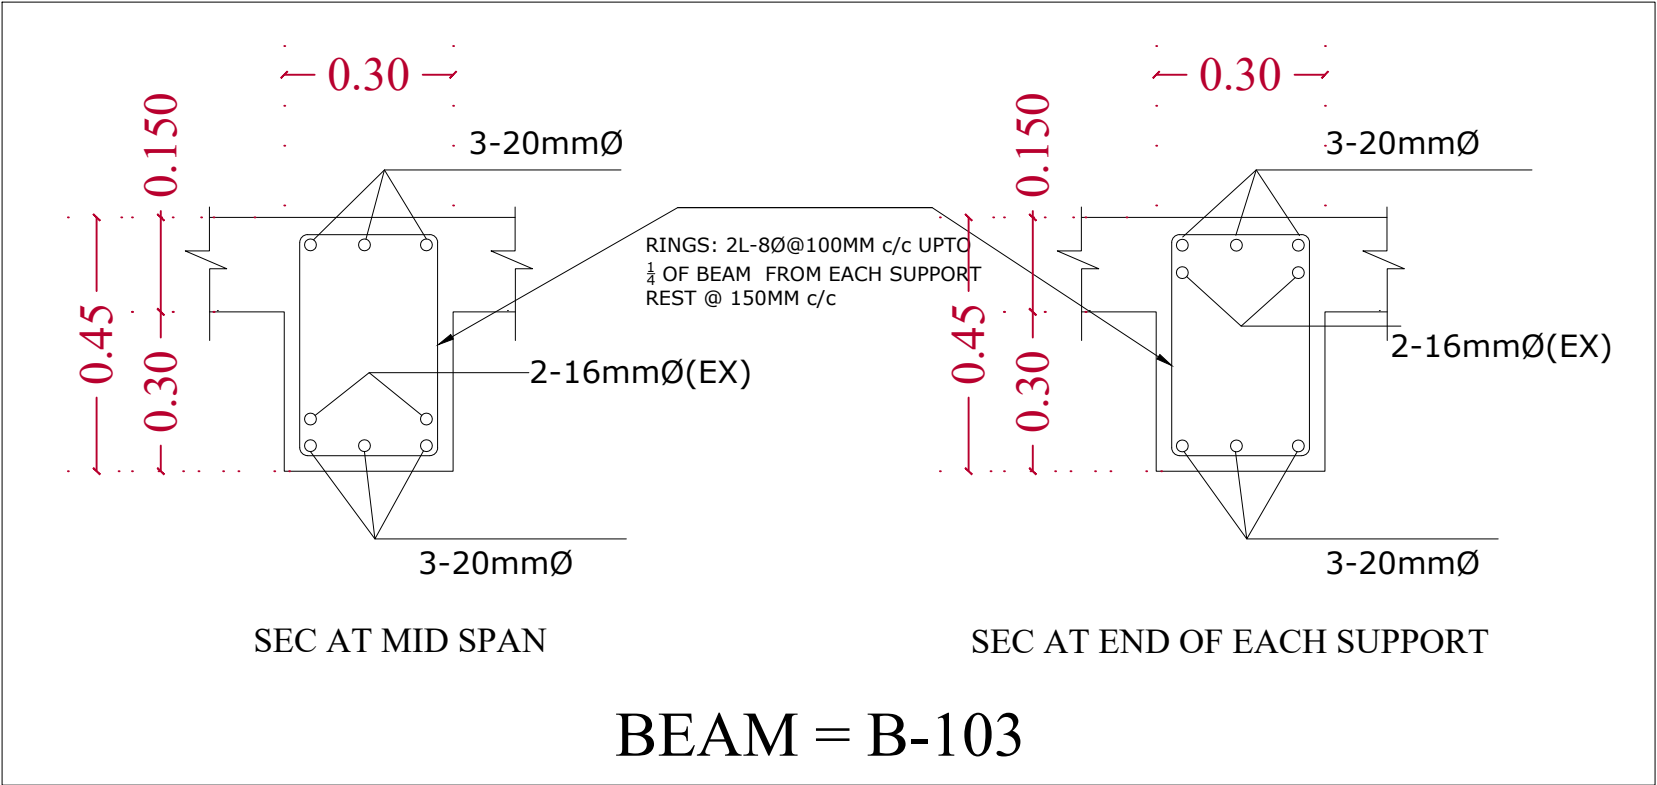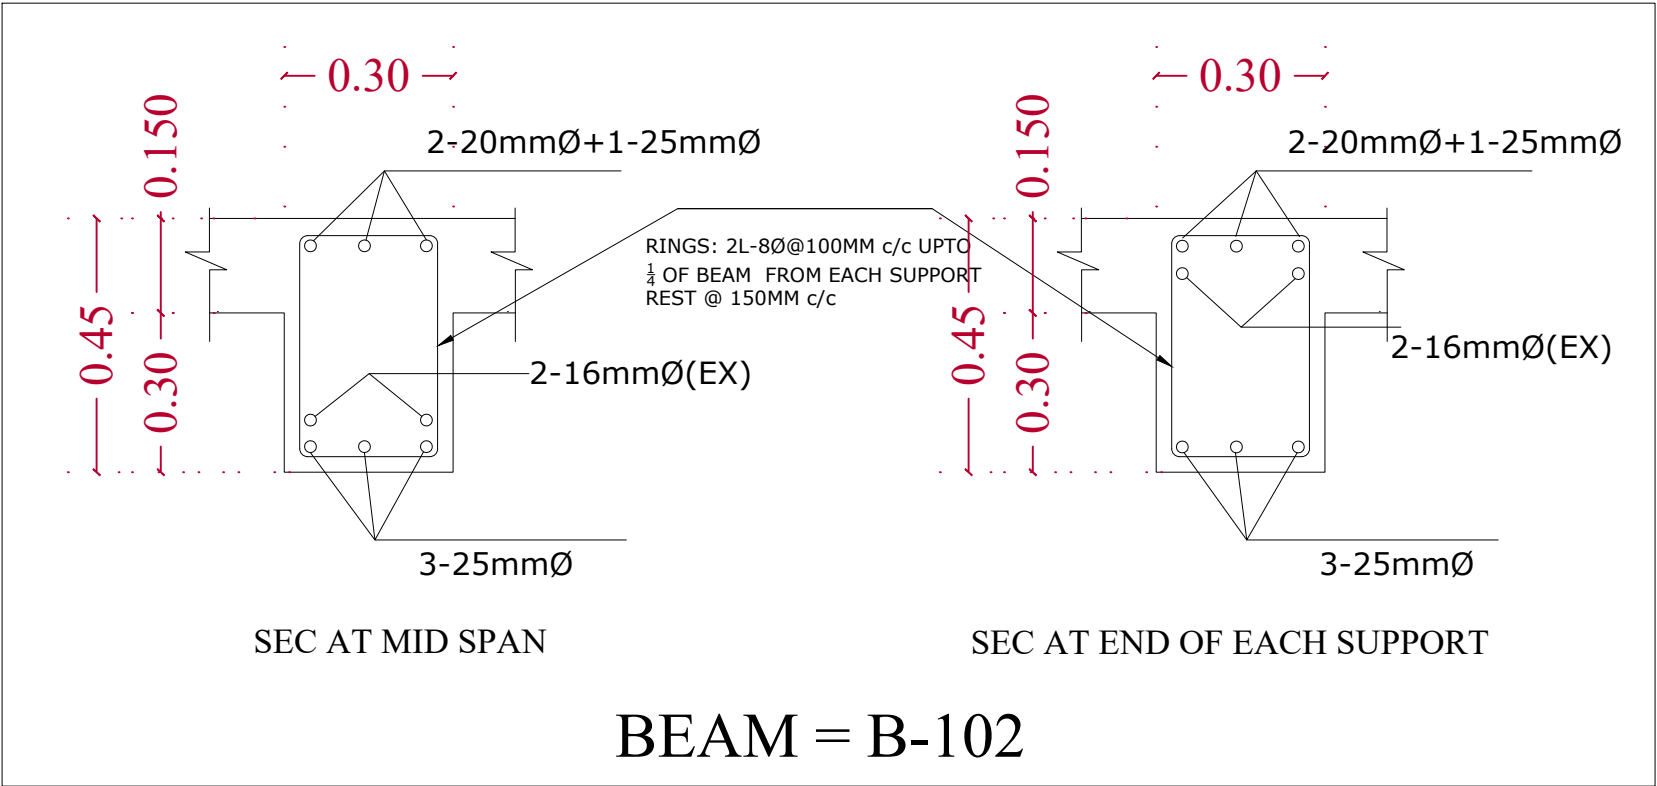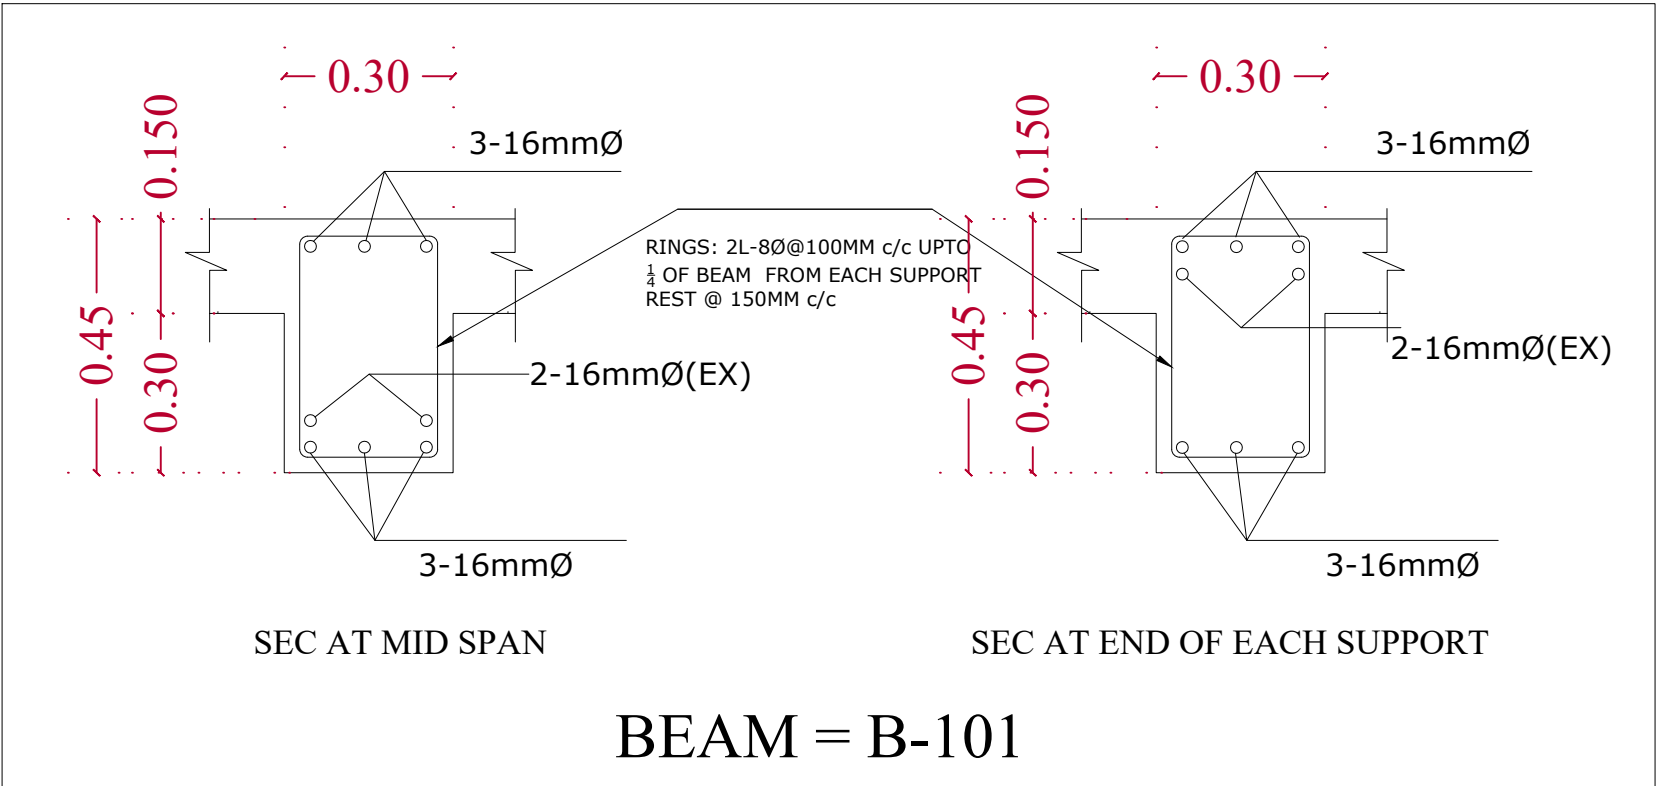

G.F ROOF BEAM DETAIL

PRINT THIS TYPE OF DRAWING ON A3 PAGE SIZE

NOTE:-

*This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission.

*All dimension are as indicated unless otherwise mentioned.

*Drawing not to be scaled, dimensions to be followed.

*All discrepancies to be brought to the notice of the designer before execution and his design to be final.

*This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.

NOTE - DIMENSIONS HAS TO BE CHECKED FROM SITE.

DISPATCH DATE: 17/07/2025

Scale: NTS

NORTH

Drawn By:

Checked By:

ISSUES AND REVISIONS

NO.	DATE	REMARKS
1		
2		
3		

NOTE :-

CLIENT : THE EXECUTIVE ENGINEER
PANCHAYATI RAJ DISTRICT JIND HARYANA

PROJECT:

DRAWING TITLE:

G.F ROOF BEAM DETAIL

☐ CONCEPTUAL DRG

☐ WORKING DRG


☐ SCHEMATIC DRG

☐ AS BUILT DRG

QUANTITY.- 1

SUBMITTED BY :-

D.B.S.C.R.
GOVT. POLYTECHNIC
SAMPLA

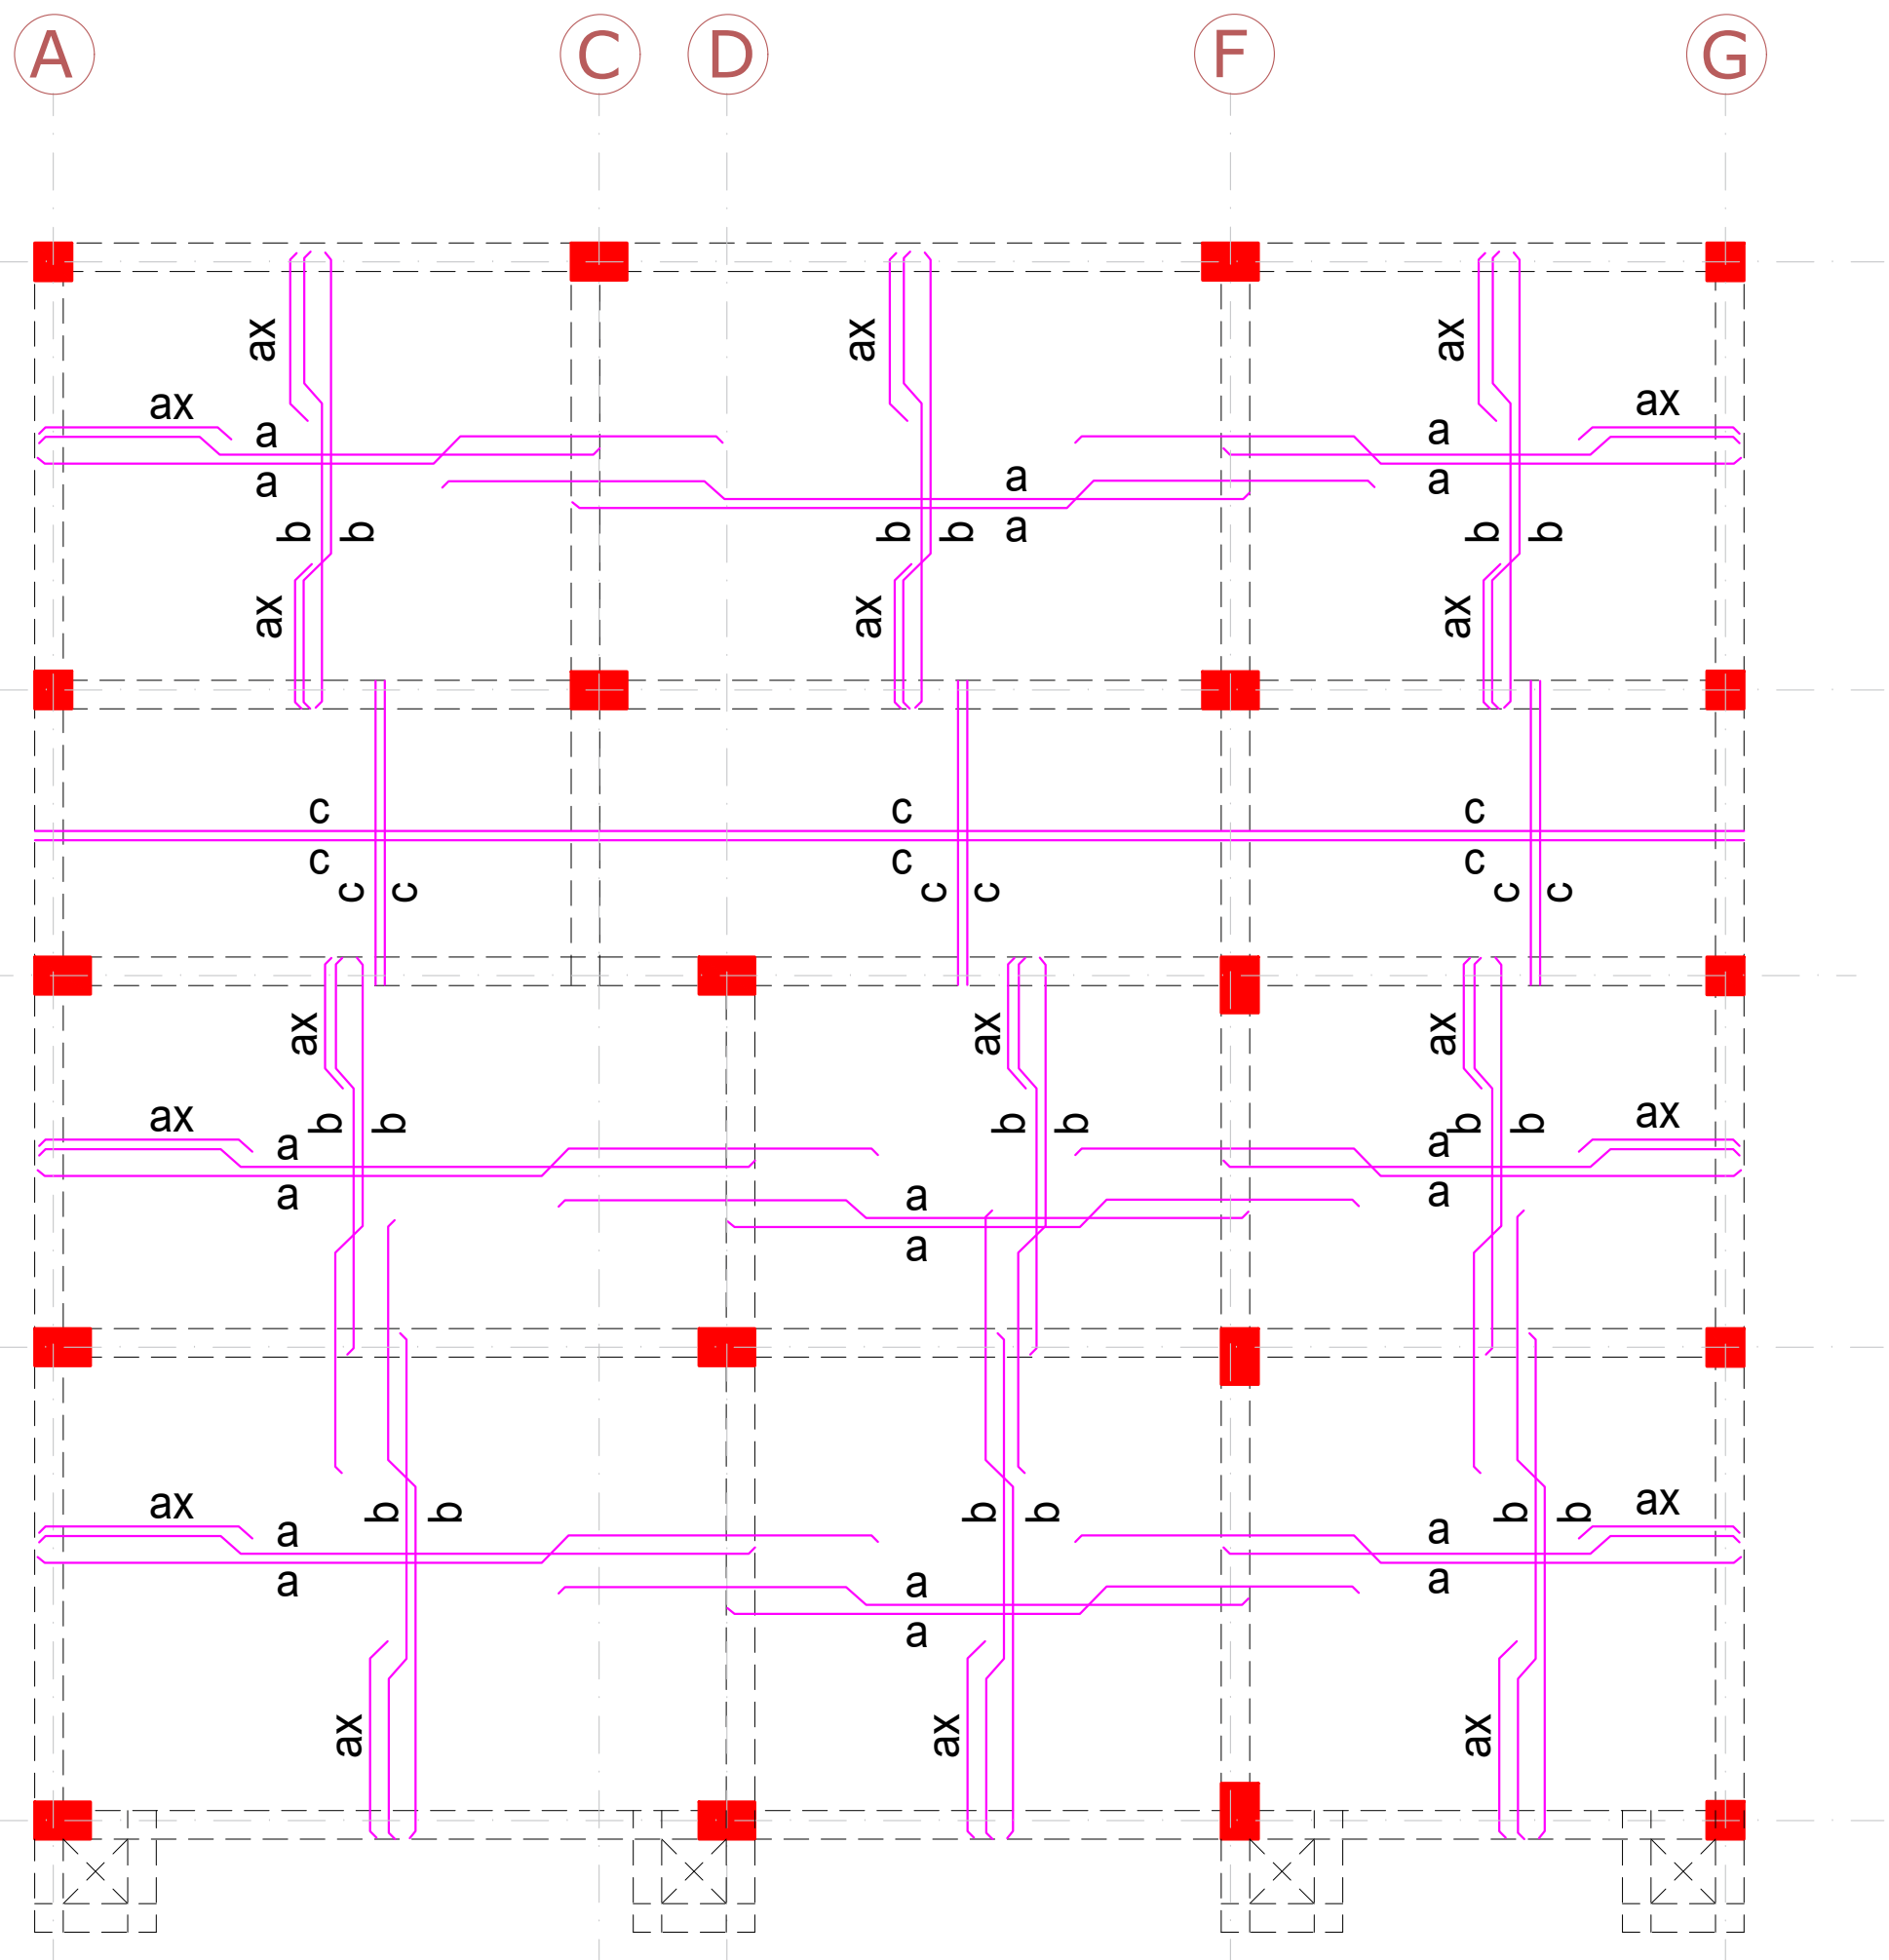

SUBMITTED BY :-

D.B.S.C.R.

GOVT. POLYTECHNIC

SAMPLA

CLIENT : THE EXECUTIVE ENGINEER

PANCHAYATI RAJ DISTRICT JIND

HARYANA

PROJECT:

DRAWING TITLE:

G.F ROOF SLAB REINF. DETAIL

☐ CONCEPTUAL DRG	☐ WORKING DRG
☐ SCHEMATIC DRG	☐ AS BUILT DRG

QUANTITY.- 1

STEEL LEGEND

a = 12mmØ@150mmc/c

ax = 12mmØ@150mmc/c(extra at top)

b = 10mmØ@150mmc/c

bx = 12mmØ@150mmc/c(extra at top)

c = 12mmØ@150mmc/c(top & bottom)

d.s= 10mmØ@150mmc/c(bottom)

e = 10mmØ@150mmc/c(bottom)

SLAB=150mm UNLESS OTHERWISE SPECIFIED.

NOTE - DIMENSIONS HAS TO BE CHECKED FROM SITE.

DISPATCH DATE: 03/09/2025

Scale: NTS	NORTH
Drawn By:	
Checked By:	

ISSUES AND REVISIONS		
NO.	DATE	REMARKS
1		
2		
3		

NOTE:-

*This drawing is the property of 7 Frames Designs and shall not be copied or used in any way without their prior permission.

*All dimension are as indicated unless otherwise mentioned.

*Drawing not to be scaled, dimensions to be followed.

*All discrepancies to be brought to the notice of the designer before execution and his design to be final.

*This drawing is to be read in conjunction with detail scale drawings and other relevant drawing.

G.F ROOF SLAB REINF. DETAIL

NOTE:-

1. CHECK ALL DIMENSIONS AND LEVELS WITH ARCHITECTURAL DRAWING.

2. THERE WILL BE NO FUTURE EXPANSION ABOVE GROUND FLOOR.