



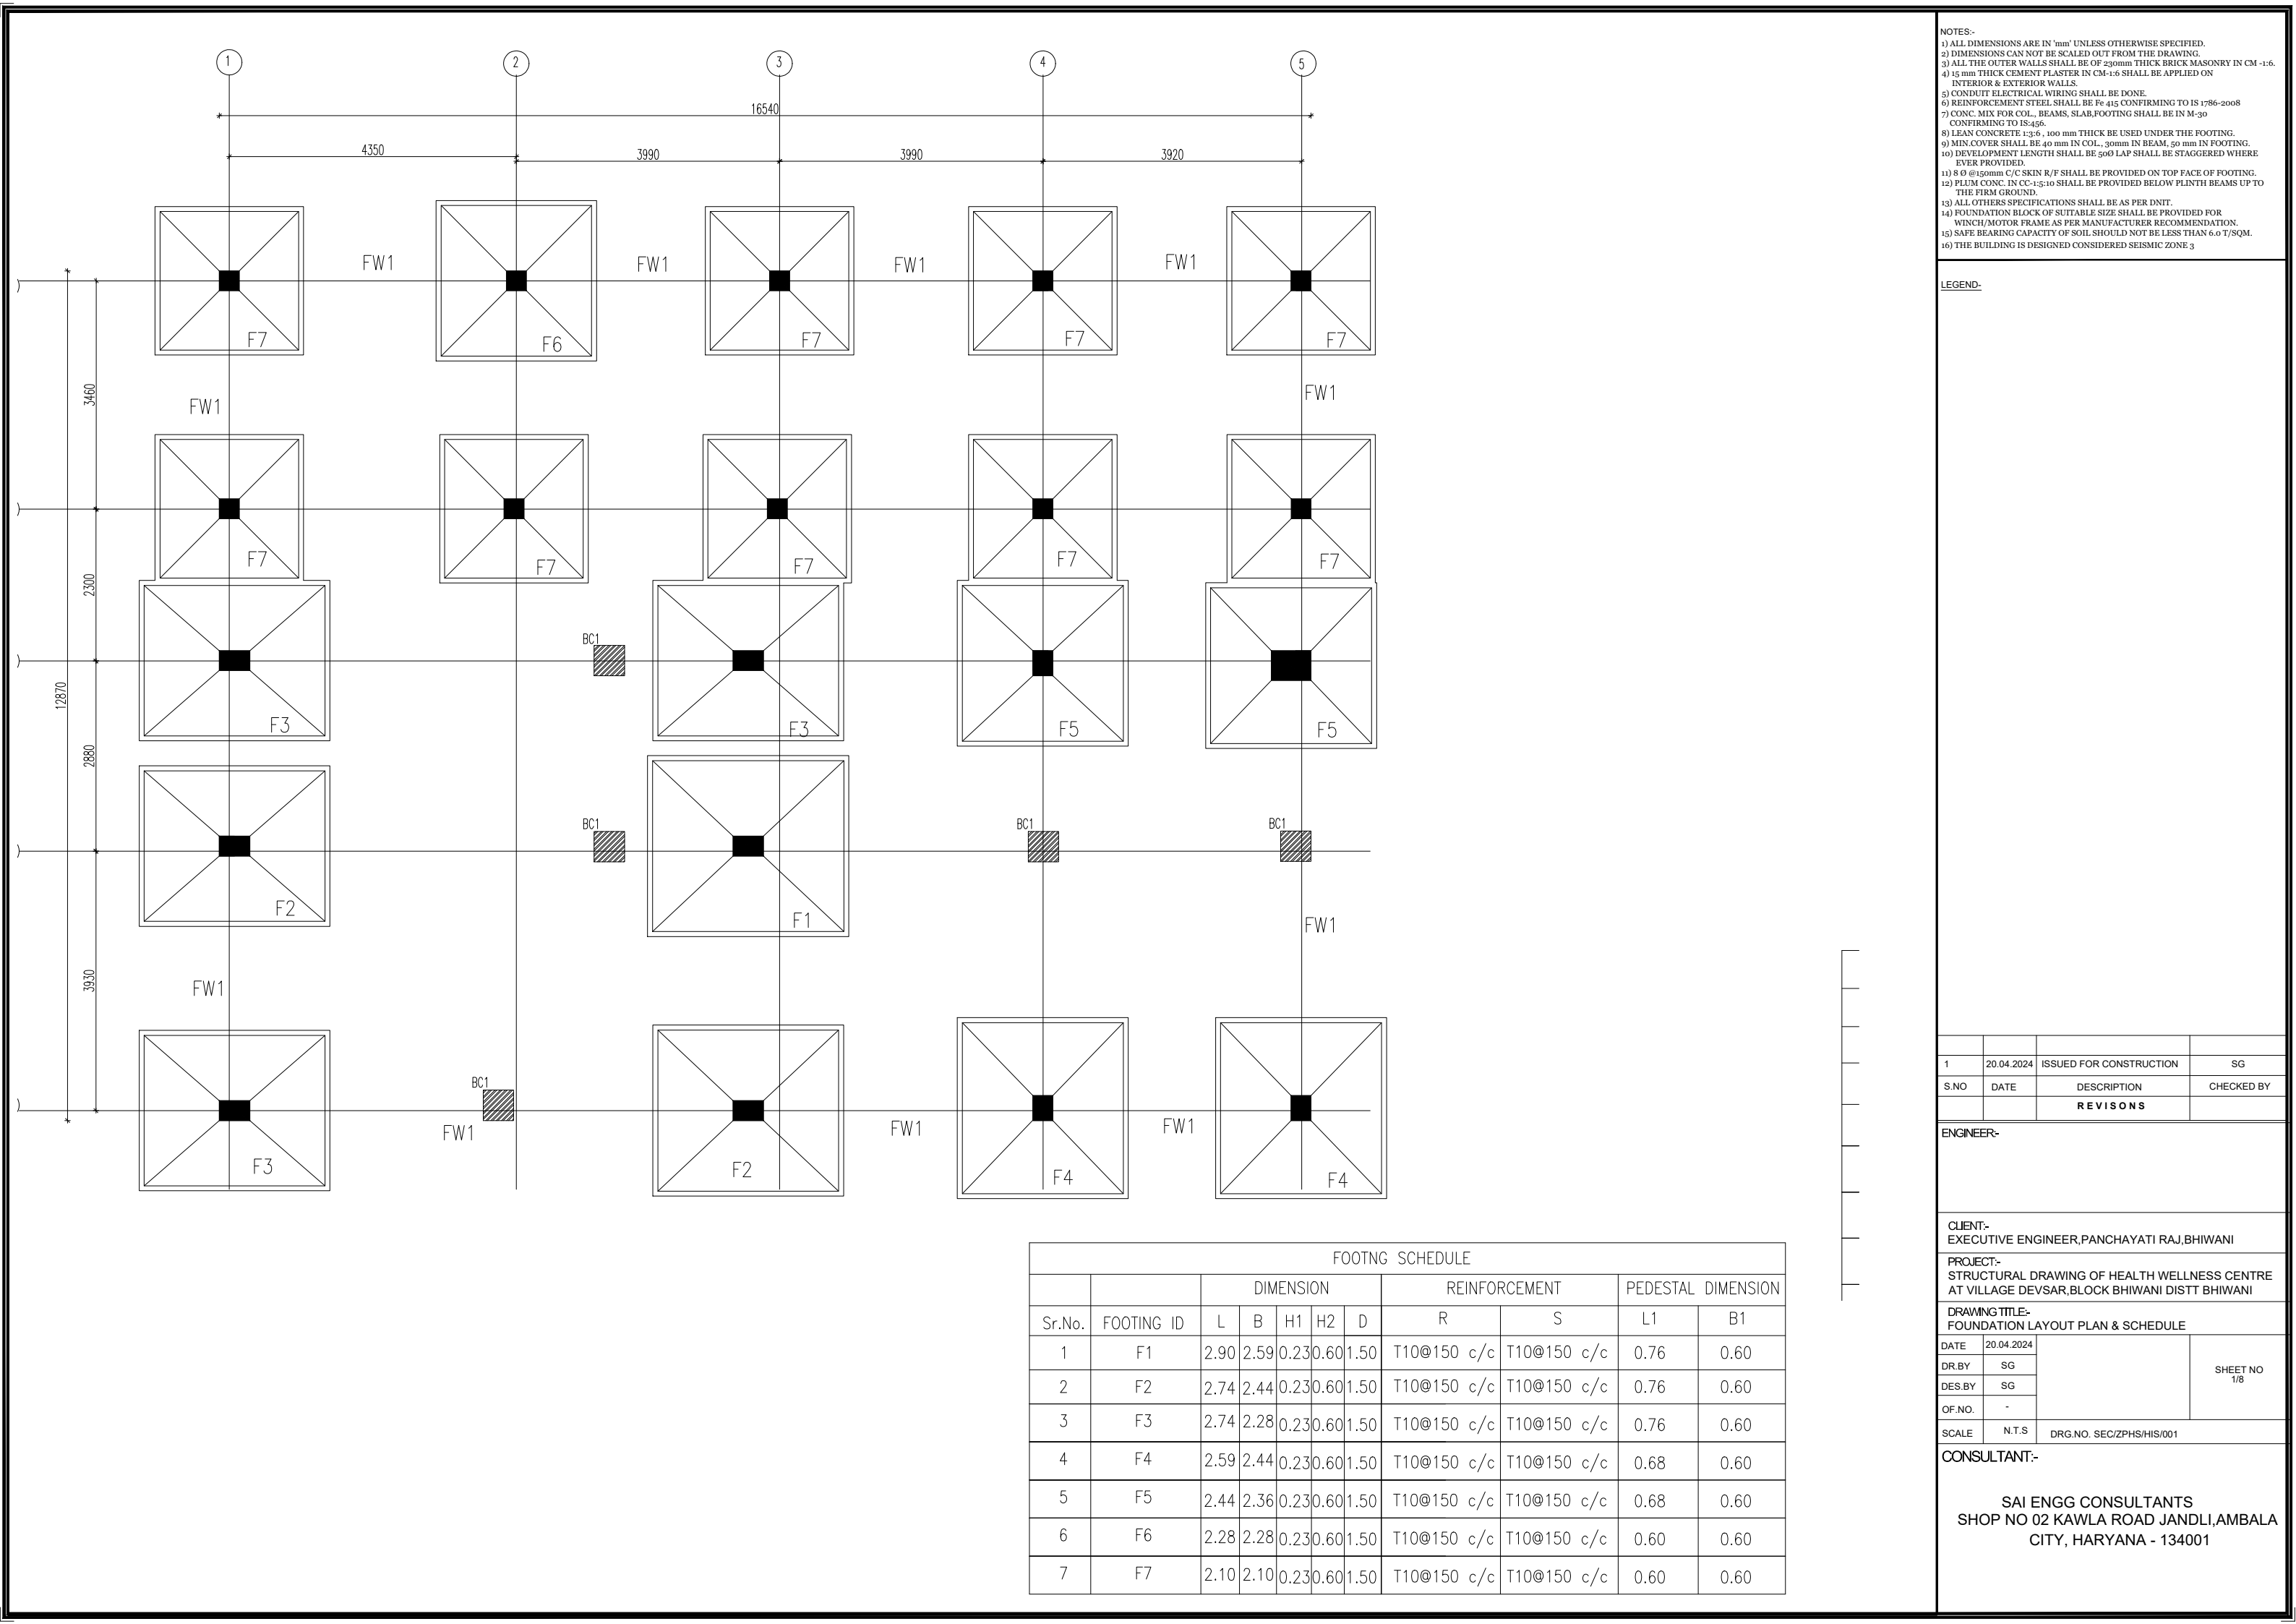

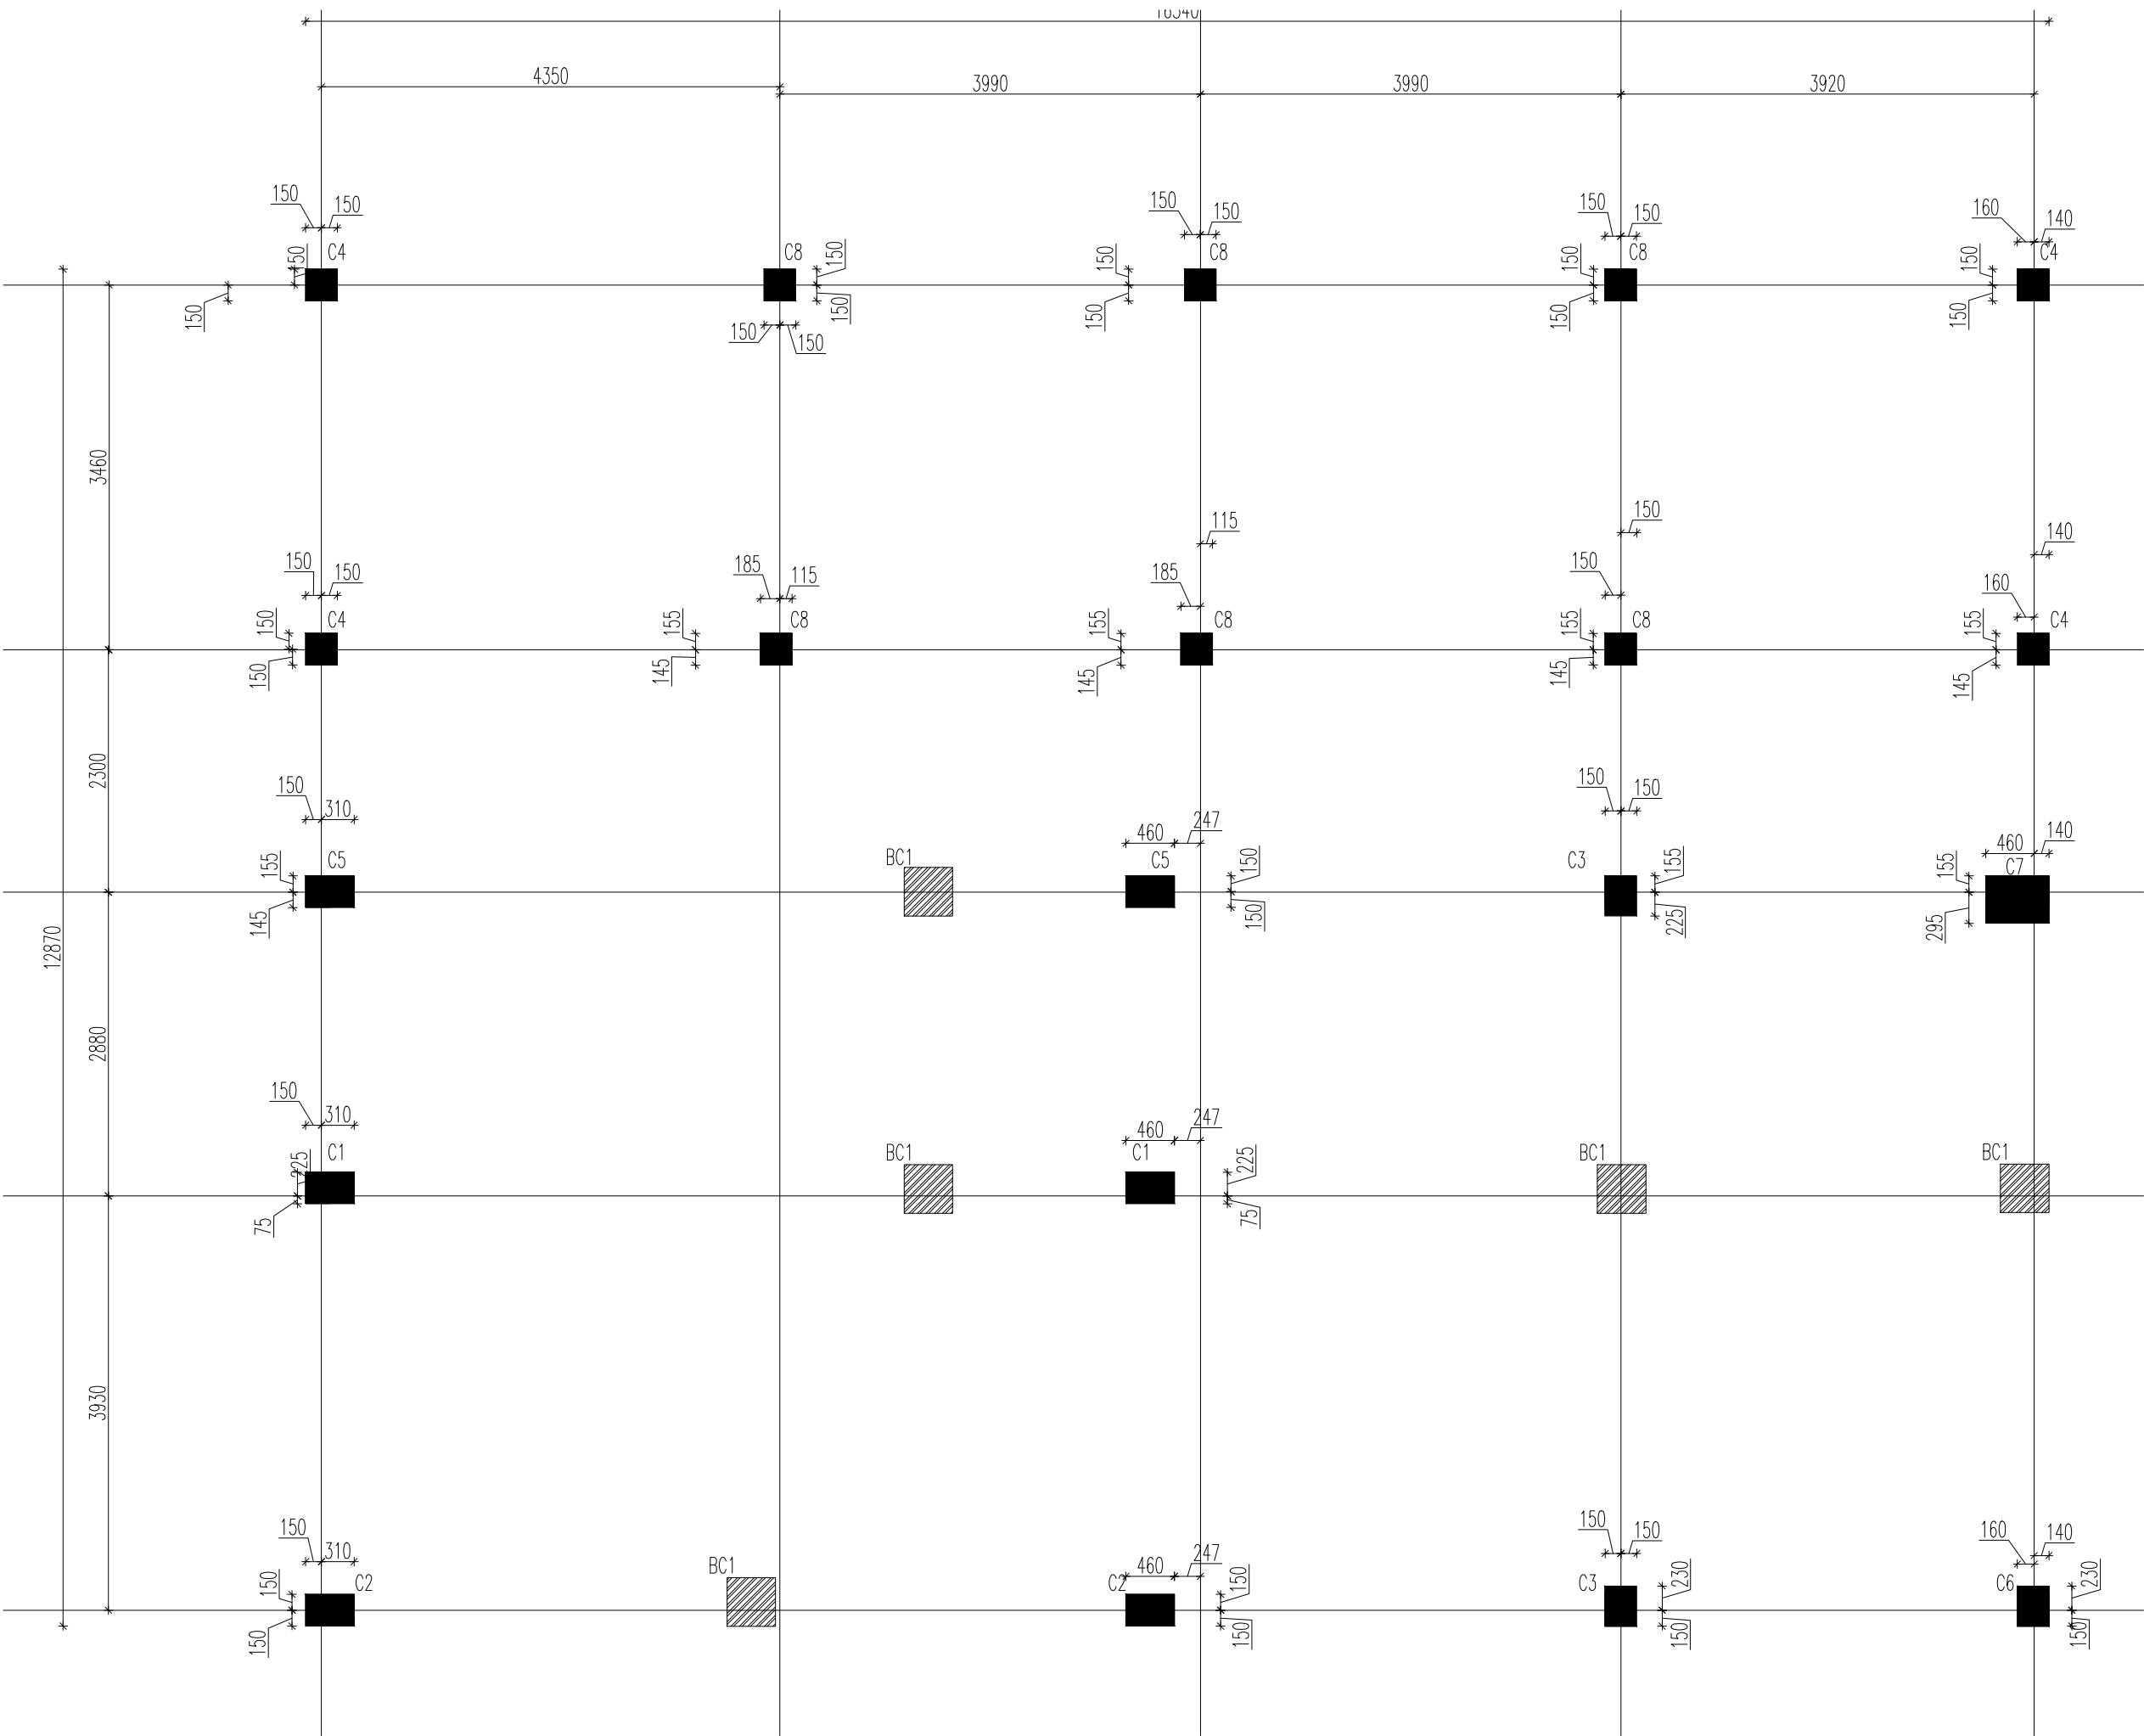

- NOTES:-
- 1) ALL DIMENSIONS ARE IN 'mm' UNLESS OTHERWISE SPECIFIED.
 - 2) DIMENSIONS CAN NOT BE SCALED OUT FROM THE DRAWING.
 - 3) ALL THE OUTER WALLS SHALL BE OF 230mm THICK BRICK MASONRY IN CM -1:6.
 - 4) 15 mm THICK CEMENT PLASTER IN CM-1:6 SHALL BE APPLIED ON INTERIOR & EXTERIOR WALLS.
 - 5) CONDUIT ELECTRICAL WIRING SHALL BE DONE.
 - 6) REINFORCEMENT STEEL SHALL BE Fe 415 CONFIRMING TO IS 1786-2008
 - 7) CONC. MIX FOR COL., BEAMS, SLAB, FOOTING SHALL BE IN M-30 CONFIRMING TO IS-456.
 - 8) LEAN CONCRETE 1:3:6, 100 mm THICK BE USED UNDER THE FOOTING.
 - 9) MIN. COVER SHALL BE 40 mm IN COL., 30mm IN BEAM, 50 mm IN FOOTING.
 - 10) DEVELOPMENT LENGTH SHALL BE 500 LAP SHALL BE STAGGERED WHERE EVER PROVIDED.
 - 11) 8 Ø @150mm C/C SKIN R/F SHALL BE PROVIDED ON TOP FACE OF FOOTING.
 - 12) PLUM CONC. IN CC-1:5:10 SHALL BE PROVIDED BELOW PLINTH BEAMS UP TO THE FIRM GROUND.
 - 13) ALL OTHERS SPECIFICATIONS SHALL BE AS PER DNIT.
 - 14) FOUNDATION BLOCK OF SUITABLE SIZE SHALL BE PROVIDED FOR WINCH/MOTOR FRAME AS PER MANUFACTURER RECOMMENDATION.
 - 15) SAFE BEARING CAPACITY OF SOIL SHOULD NOT BE LESS THAN 6.0 T/SQM.
 - 16) THE BUILDING IS DESIGNED CONSIDERED SEISMIC ZONE 3

LEGEND:-

1	20.04.2024	ISSUED FOR CONSTRUCTION	SG
S.NO	DATE	DESCRIPTION	CHECKED BY
REVISONS			

ENGINEER:-

CLIENT:-
EXECUTIVE ENGINEER, PANCHAYATI RAJ, BHIWANI



PROJECT:-
STRUCTURAL DRAWING OF HEALTH WELLNESS CENTRE
AT VILLAGE DEVSAR, BLOCK BHIWANI, DISTT BHIWANI

DRAWING TITLE:-
COLUMN AXIS LAYOUT PLAN


DATE	20.04.2024	SHEET NO 2/8	
DR.BY	SG		
DES.BY	SG		
OF.NO.	-		
SCALE	N.T.S	DRG.NO. SEC/ZPHS/HIS/002	

CONSULTANT:-


SAI ENGG CONSULTANTS
SHOP NO 02 KAWLA ROAD JANDLI, AMBALA
CITY, HARYANA - 134001

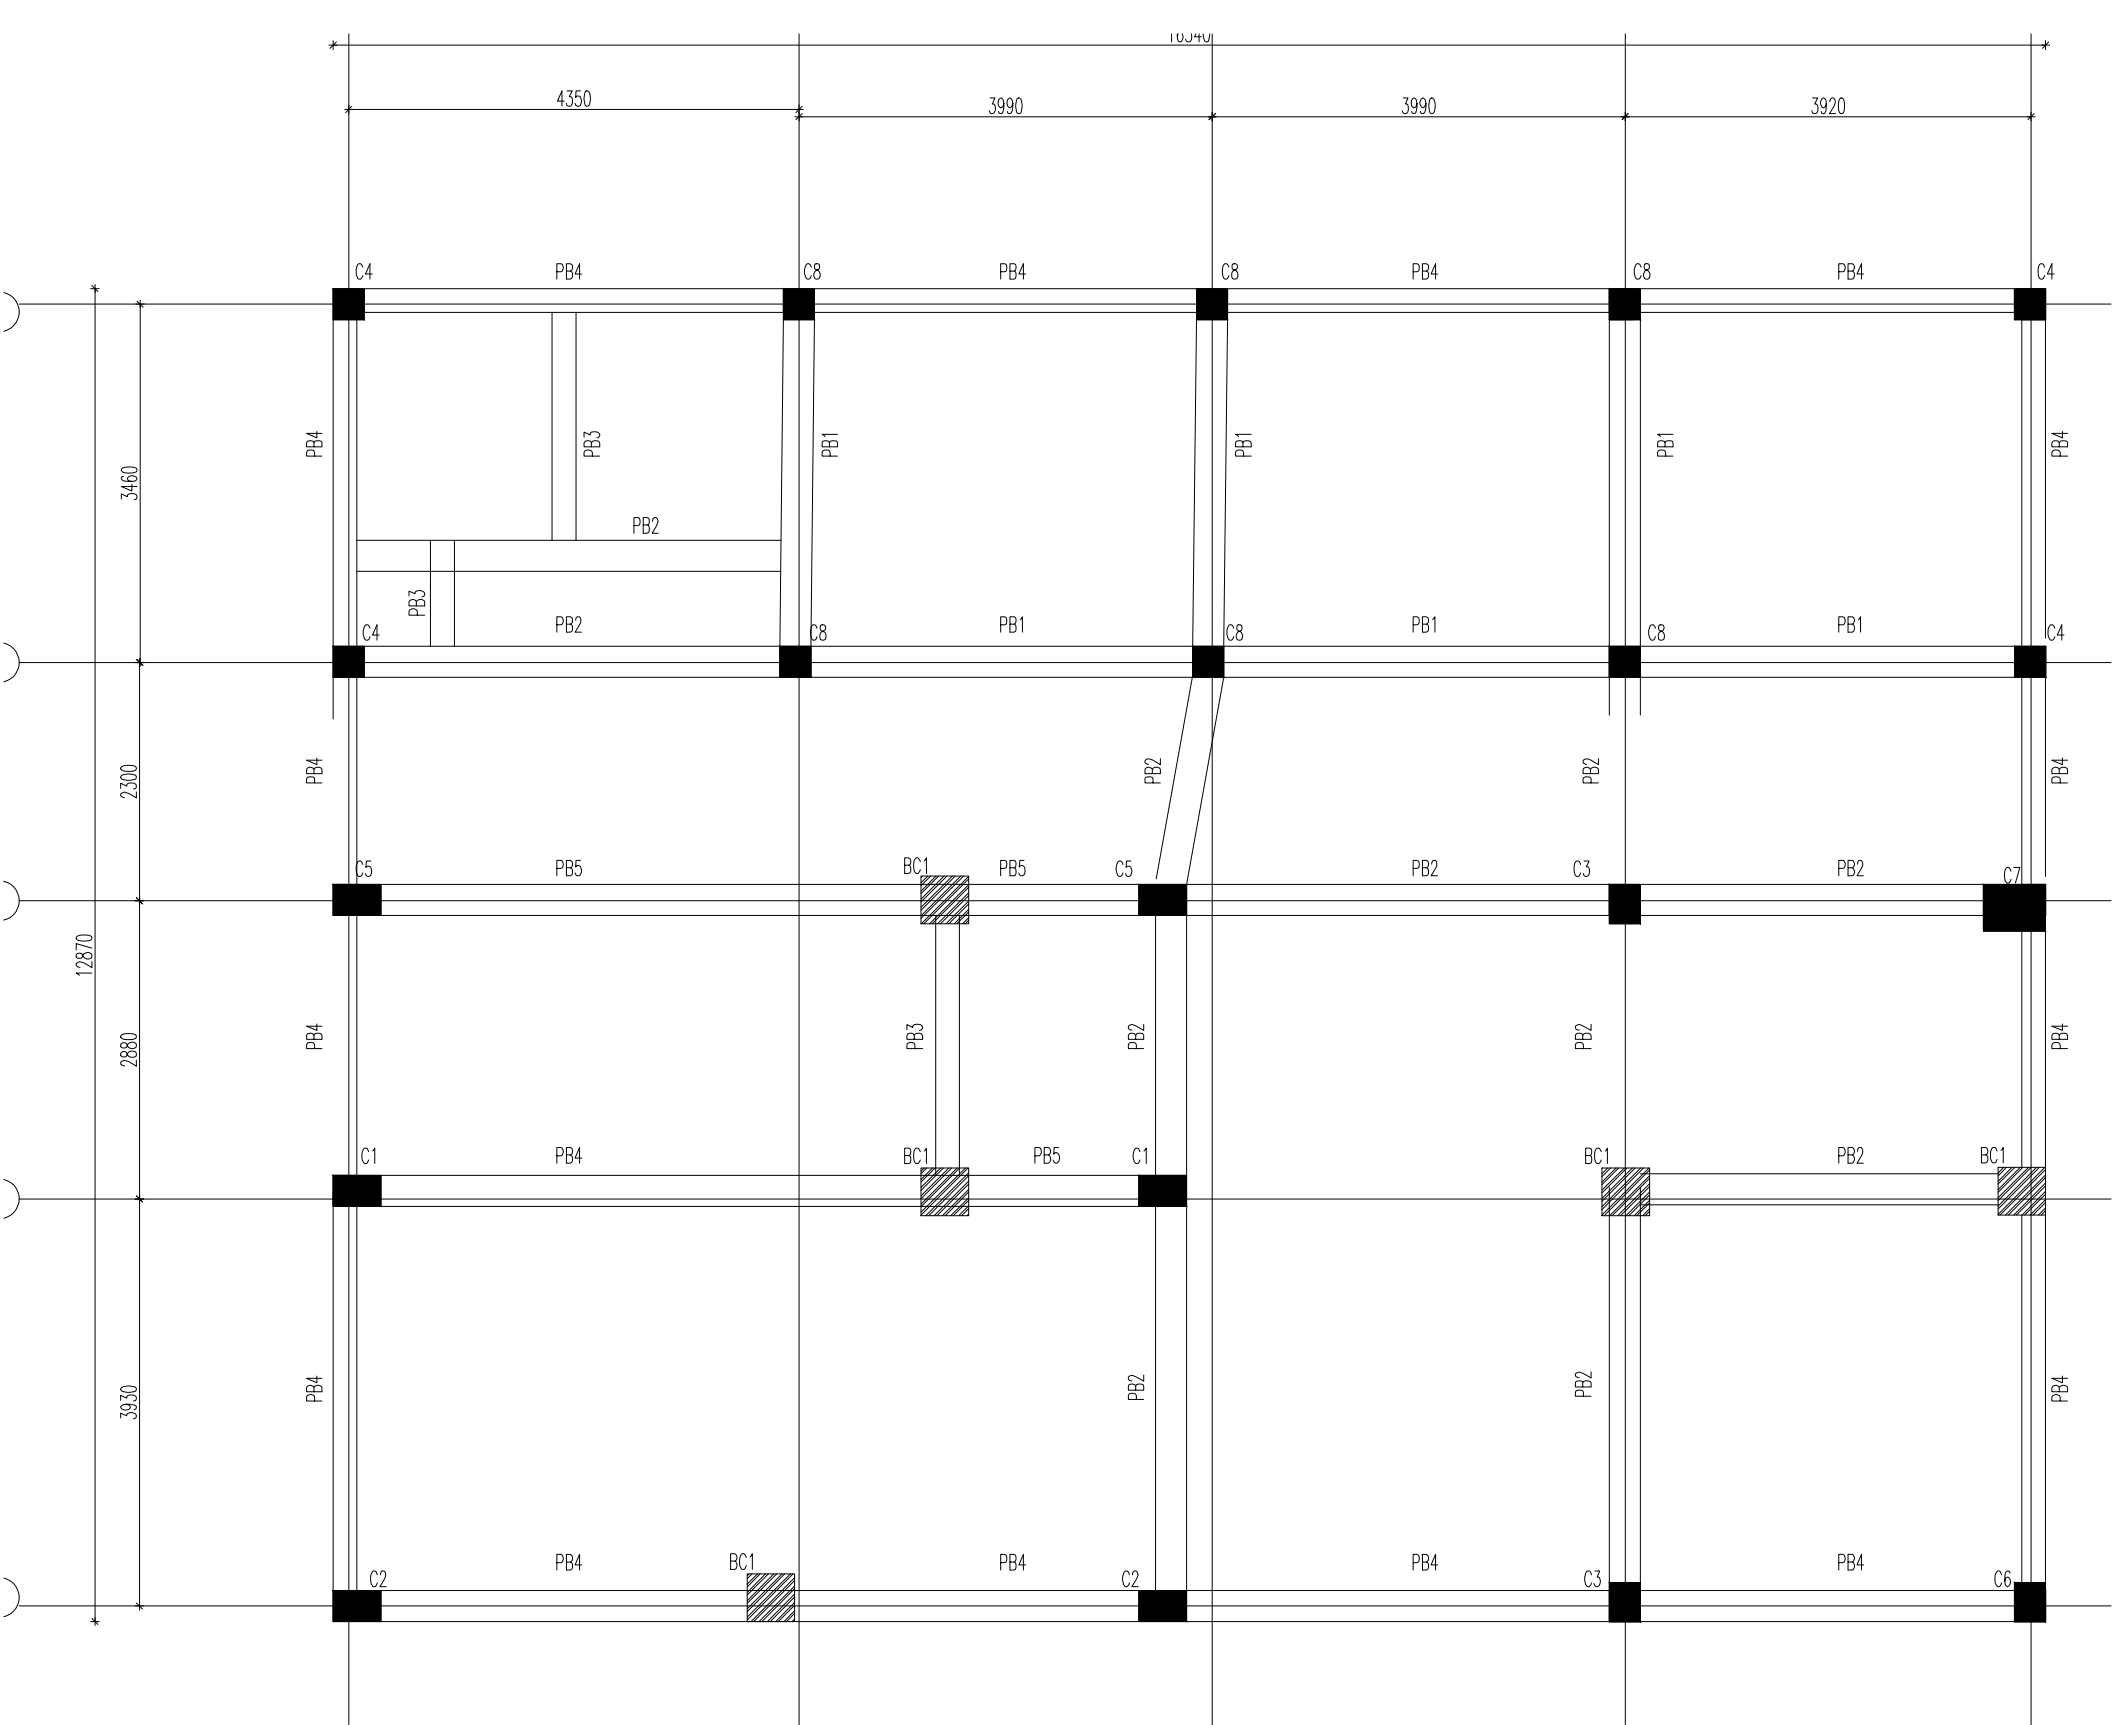


BAR NO:-1to6: 16# FOR MAIN STEEL
Rings:-8# for 2 legged @100c/c 8 nos from suport
@150 c/c in the middle

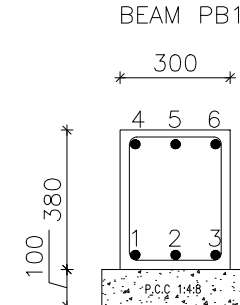


BAR NO:-1,3,4,6: 16# FOR MAIN STEEL
BAR NO:-2,5: 12# FOR MAIN STEEL
Rings:-8# for 2 legged @100c/c 8 nos from suport
@150 c/c in the middle

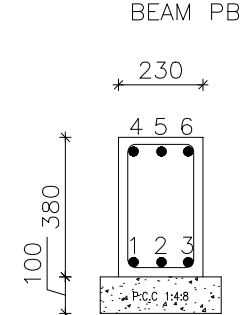

BAR NO:-1to6: 12# FOR MAIN STEEL
Rings:-8# for 2 legged @100c/c 8 nos from suport
@150 c/c in the middle

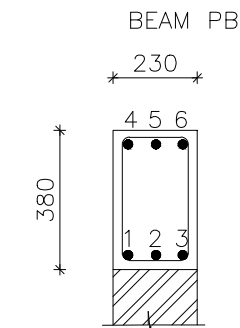

BAR NO:-1to6: 12# FOR MAIN STEEL
Rings:-8# for 2 legged @100c/c 8 nos from suport
@150 c/c in the middle

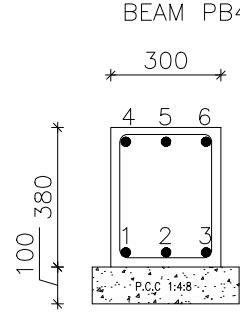

BAR NO:-1to6: 20# FOR MAIN STEEL
Rings:-8# for 2 legged @100c/c 8 nos from suport
@150 c/c in the middle

- NOTES:-
- 1) ALL DIMENSIONS ARE IN 'mm' UNLESS OTHERWISE SPECIFIED.
 - 2) DIMENSIONS CAN NOT BE SCALED OUT FROM THE DRAWING.
 - 3) ALL THE OUTER WALLS SHALL BE OF 230mm THICK BRICK MASONRY IN CM -1:6.
 - 4) 15 mm THICK CEMENT PLASTER IN CM-1:6 SHALL BE APPLIED ON INTERIOR & EXTERIOR WALLS.
 - 5) CONDUIT ELECTRICAL WIRING SHALL BE DONE.
 - 6) REINFORCEMENT STEEL SHALL BE Fe 415 CONFIRMING TO IS 1786-2008
 - 7) CONC. MIX FOR COL., BEAMS, SLAB, FOOTING SHALL BE IN M-30 CONFIRMING TO IS:456.
 - 8) LEAN CONCRETE 1:3:6, 100 mm THICK BE USED UNDER THE FOOTING.
 - 9) MIN. COVER SHALL BE 40 mm IN COL., 30mm IN BEAM, 50 mm IN FOOTING.
 - 10) DEVELOPMENT LENGTH SHALL BE 50# LAP SHALL BE STAGGERED WHERE EVER PROVIDED.
 - 11) 8 @ 150mm C/C SKIN R/F SHALL BE PROVIDED ON TOP FACE OF FOOTING.
 - 12) PLUM CONC. IN CC-1:5:10 SHALL BE PROVIDED BELOW PLINTH BEAMS UP TO THE FIRM GROUND.
 - 13) ALL OTHERS SPECIFICATIONS SHALL BE AS PER DNIT.
 - 14) FOUNDATION BLOCK OF SUITABLE SIZE SHALL BE PROVIDED FOR WINCH/MOTOR FRAME AS PER MANUFACTURER RECOMMENDATION.
 - 15) SAFE BEARING CAPACITY OF SOIL SHOULD NOT BE LESS THAN 6.0 T/SQM.
 - 16) THE BUILDING IS DESIGNED CONSIDERED SEISMIC ZONE 3

LEGEND:-

1	20.04.2024	ISSUED FOR CONSTRUCTION	SG
S.NO	DATE	DESCRIPTION	CHECKED BY
REVISONS			

ENGINEER:-

CLIENT:-
EXECUTIVE ENGINEER, PANCHAYATI RAJ, BHIWANI



PROJECT:-
STRUCTURAL DRAWING OF HEALTH WELLNESS CENTRE
AT VILLAGE DEVSAR, BLOCK BHIWANI, DISTT BHIWANI

DRAWING TITLE:-
PLINTH BEAM LAYOUT PLAN & DETAIL


DATE	20.04.2024	SHEET NO 3/8
DR. BY	SG	
DES. BY	SG	
OF. NO.	-	
SCALE	N.T.S	DRG. NO. SEC/ZPHS/HIS/003

CONSULTANT:-


SAI ENGG CONSULTANTS
SHOP NO 02 KAWLA ROAD JANDLI, AMBALA
CITY, HARYANA - 134001

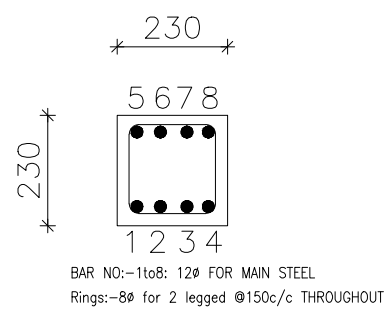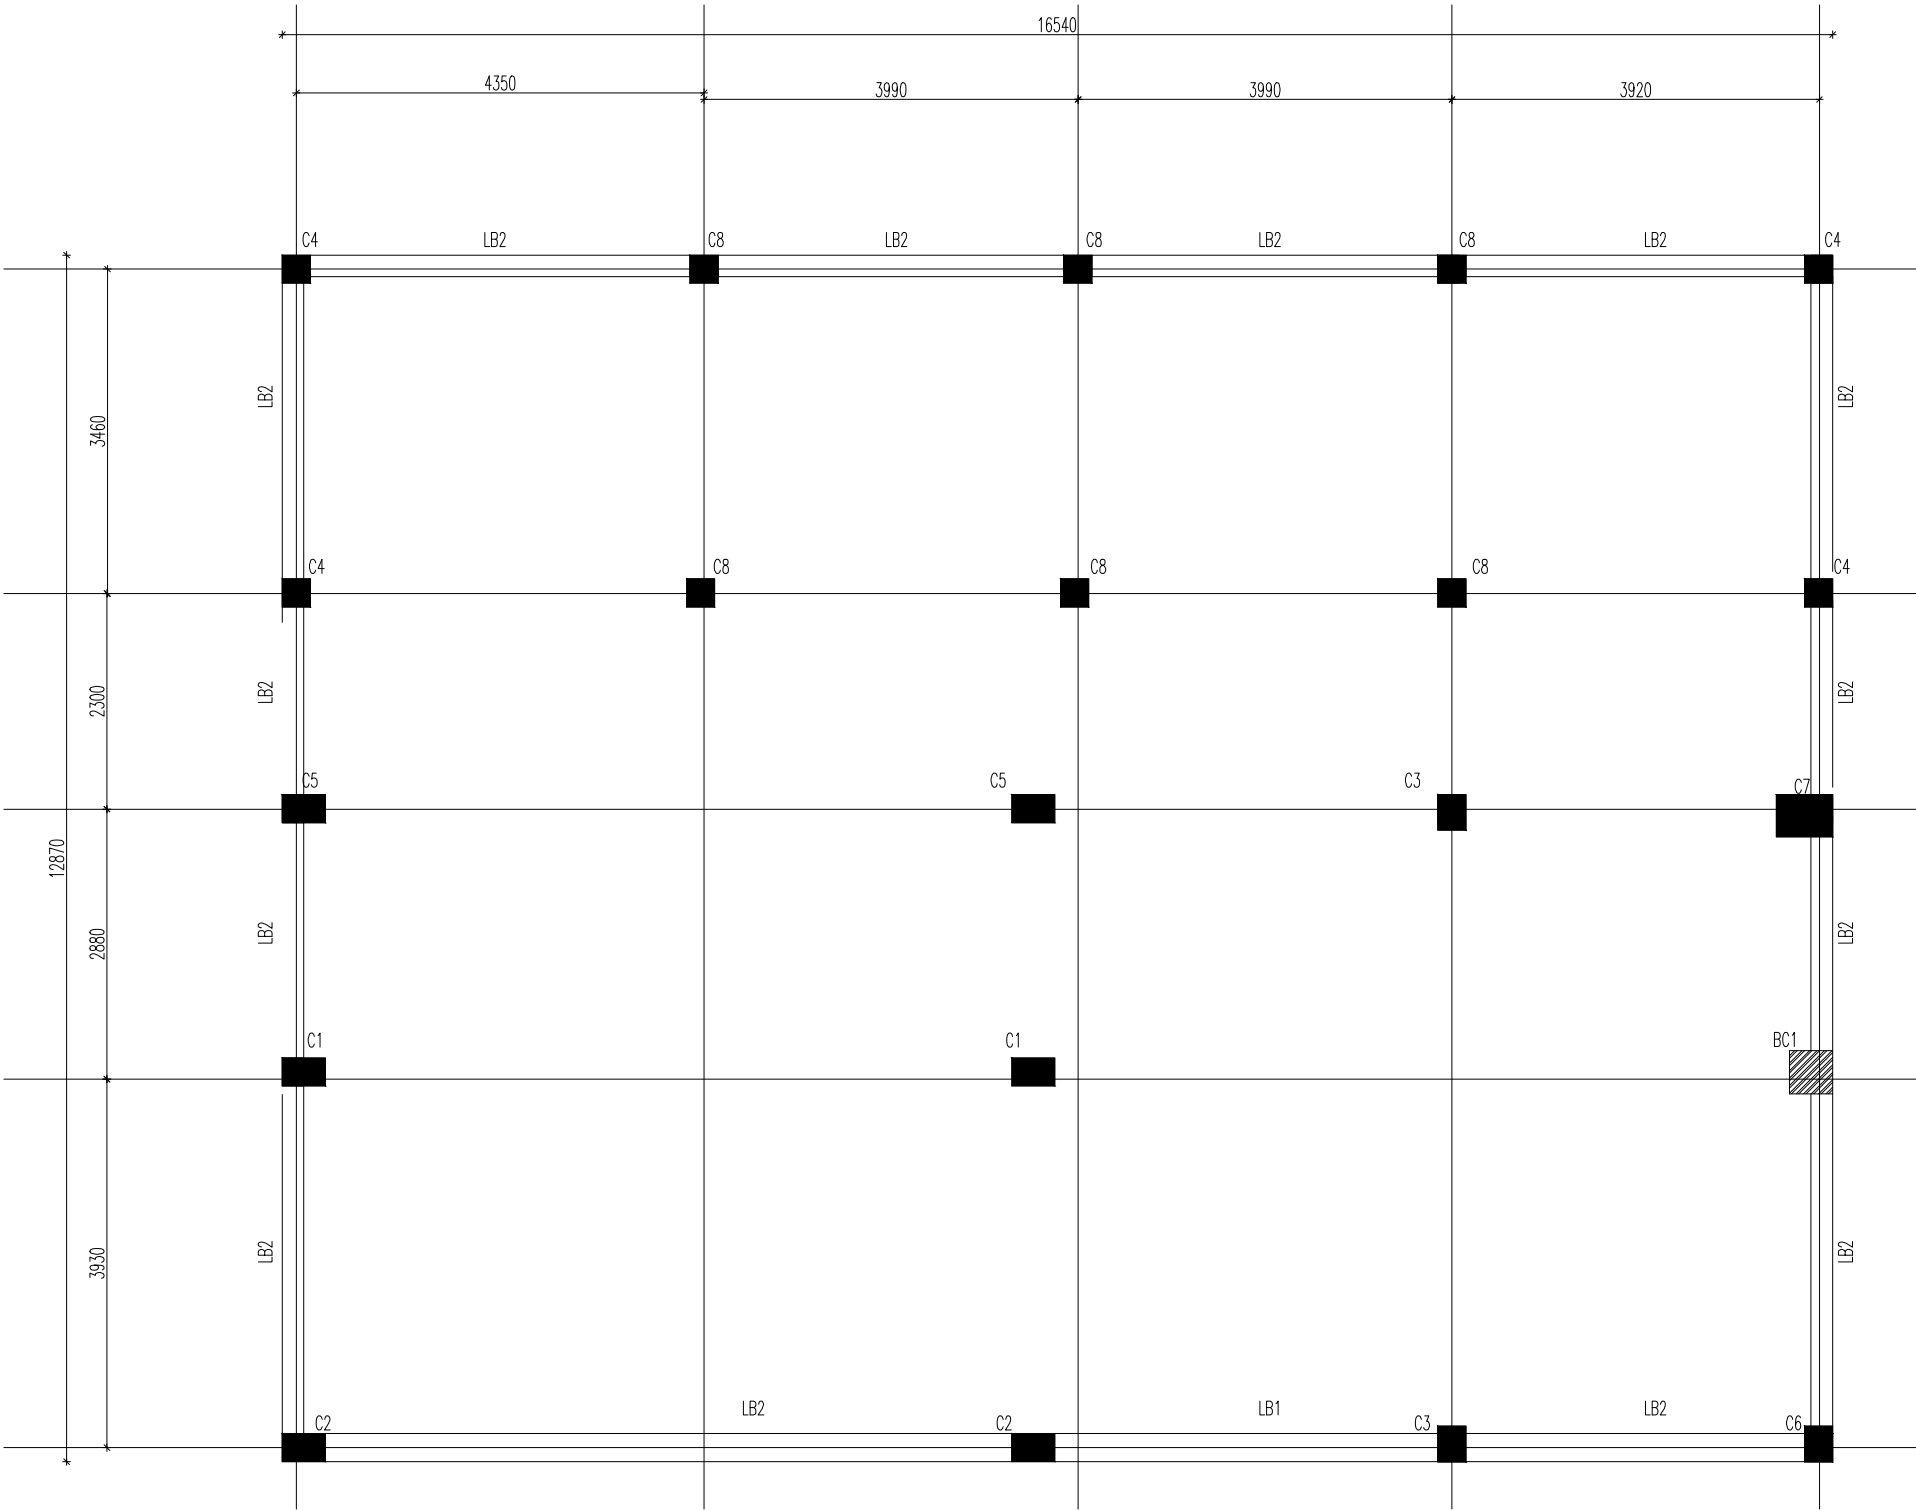

LINTEL BEAM LB1

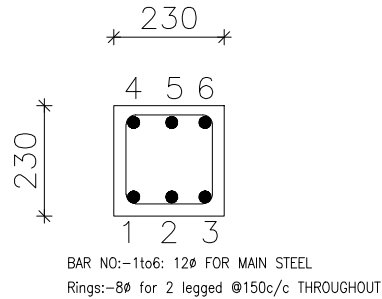

LINTEL BEAM LB2

SCHEDULE OF LINTELS				
S.No	CLEAR SPAN	SIZE	DETAILS	RINGS
1.	600 TO BELOW 900	230x150	 2 -T12 TOP 2 -T12 BOTTOM	2L-T8@150c/c
2.	300 TO BELOW 900	115x150	 2 -T10 TOP 2 -T10 BOTTOM	2L-T8@150c/c
3.	900 TO BELOW 1200	230x150	 2 -T12 TOP 2 -T12 BOTTOM	2L-T8@150c/c
4.	900 TO BELOW 1200	115x150	 2 -T10 TOP 2 -T10 BOTTOM	2L-T8@150c/c
5.	1200 TO BELOW 1800	230x150	 3 -T12 TOP 3 -T12 BOTTOM	2L-T8@150c/c
6.	1800 TO BELOW 2700	230x230	 4 -T12 TOP 4 -T12 BOTTOM	2L-T8@150c/c
7.	2700 TO BELOW 3600	230x230	 4 -T16 TOP 4 -T16 BOTTOM	2L-T8@150c/c
8.	TYP. SUNSHADE DETAIL		 4 -T16 TOP 4 -T16 BOTTOM T8@150c/c	2L-T8@150c/c

- NOTES:-
- 1) ALL DIMENSIONS ARE IN 'mm' UNLESS OTHERWISE SPECIFIED.
 - 2) DIMENSIONS CAN NOT BE SCALED OUT FROM THE DRAWING.
 - 3) ALL THE OUTER WALLS SHALL BE OF 230mm THICK BRICK MASONRY IN CM -1:6.
 - 4) 15 mm THICK CEMENT PLASTER IN CM-1:6 SHALL BE APPLIED ON INTERIOR & EXTERIOR WALLS.
 - 5) CONDUIT ELECTRICAL WIRING SHALL BE DONE.
 - 6) REINFORCEMENT STEEL SHALL BE Fe 415 CONFIRMING TO IS 1786-2008
 - 7) CONC. MIX FOR COL., BEAMS, SLAB, FOOTING SHALL BE IN M-30 CONFIRMING TO IS:456.
 - 8) LEAN CONCRETE 1:3:6, 100 mm THICK BE USED UNDER THE FOOTING.
 - 9) MIN. COVER SHALL BE 40 mm IN COL., 30mm IN BEAM, 50 mm IN FOOTING.
 - 10) DEVELOPMENT LENGTH SHALL BE 50Ø LAP SHALL BE STAGGERED WHERE EVER PROVIDED.
 - 11) 8 Ø @150mm C/C SKIN R/F SHALL BE PROVIDED ON TOP FACE OF FOOTING.
 - 12) PLUM CONC. IN CC-1:5:10 SHALL BE PROVIDED BELOW PLINTH BEAMS UP TO THE FIRM GROUND.
 - 13) ALL OTHERS SPECIFICATIONS SHALL BE AS PER DNIT.
 - 14) FOUNDATION BLOCK OF SUITABLE SIZE SHALL BE PROVIDED FOR WINCH/MOTOR FRAME AS PER MANUFACTURER RECOMMENDATION.
 - 15) SAFE BEARING CAPACITY OF SOIL SHOULD NOT BE LESS THAN 6.0 T/SQM.
 - 16) THE BUILDING IS DESIGNED CONSIDERED SEISMIC ZONE 3

LEGEND:-

1	20.04.2024	ISSUED FOR CONSTRUCTION	SG
S.NO	DATE	DESCRIPTION	CHECKED BY
REVISONS			

ENGINEER:-

CLIENT:-
EXECUTIVE ENGINEER,PANCHAYATI RAJ,BHIWANI


PROJECT:-
STRUCTURAL DRAWING OF HEALTH WELLNESS CENTRE
AT VILLAGE DEVSAR,BLOCK BHIWANI DISTT BHIWANI

DRAWING TITLE:-
LINTEL BEAM LAYOUT PLAN & DETAIL

DATE	20.04.2024	SHEET NO 4/8
DR.BY	SG	
DES.BY	SG	
OF.NO.	-	
SCALE	N.T.S	DRG.NO. SEC/ZPHS/HIS/004

CONSULTANT:-

SAI ENGG CONSULTANTS
SHOP NO 02 KAWLA ROAD JANDLI,AMBALA
CITY, HARYANA - 134001

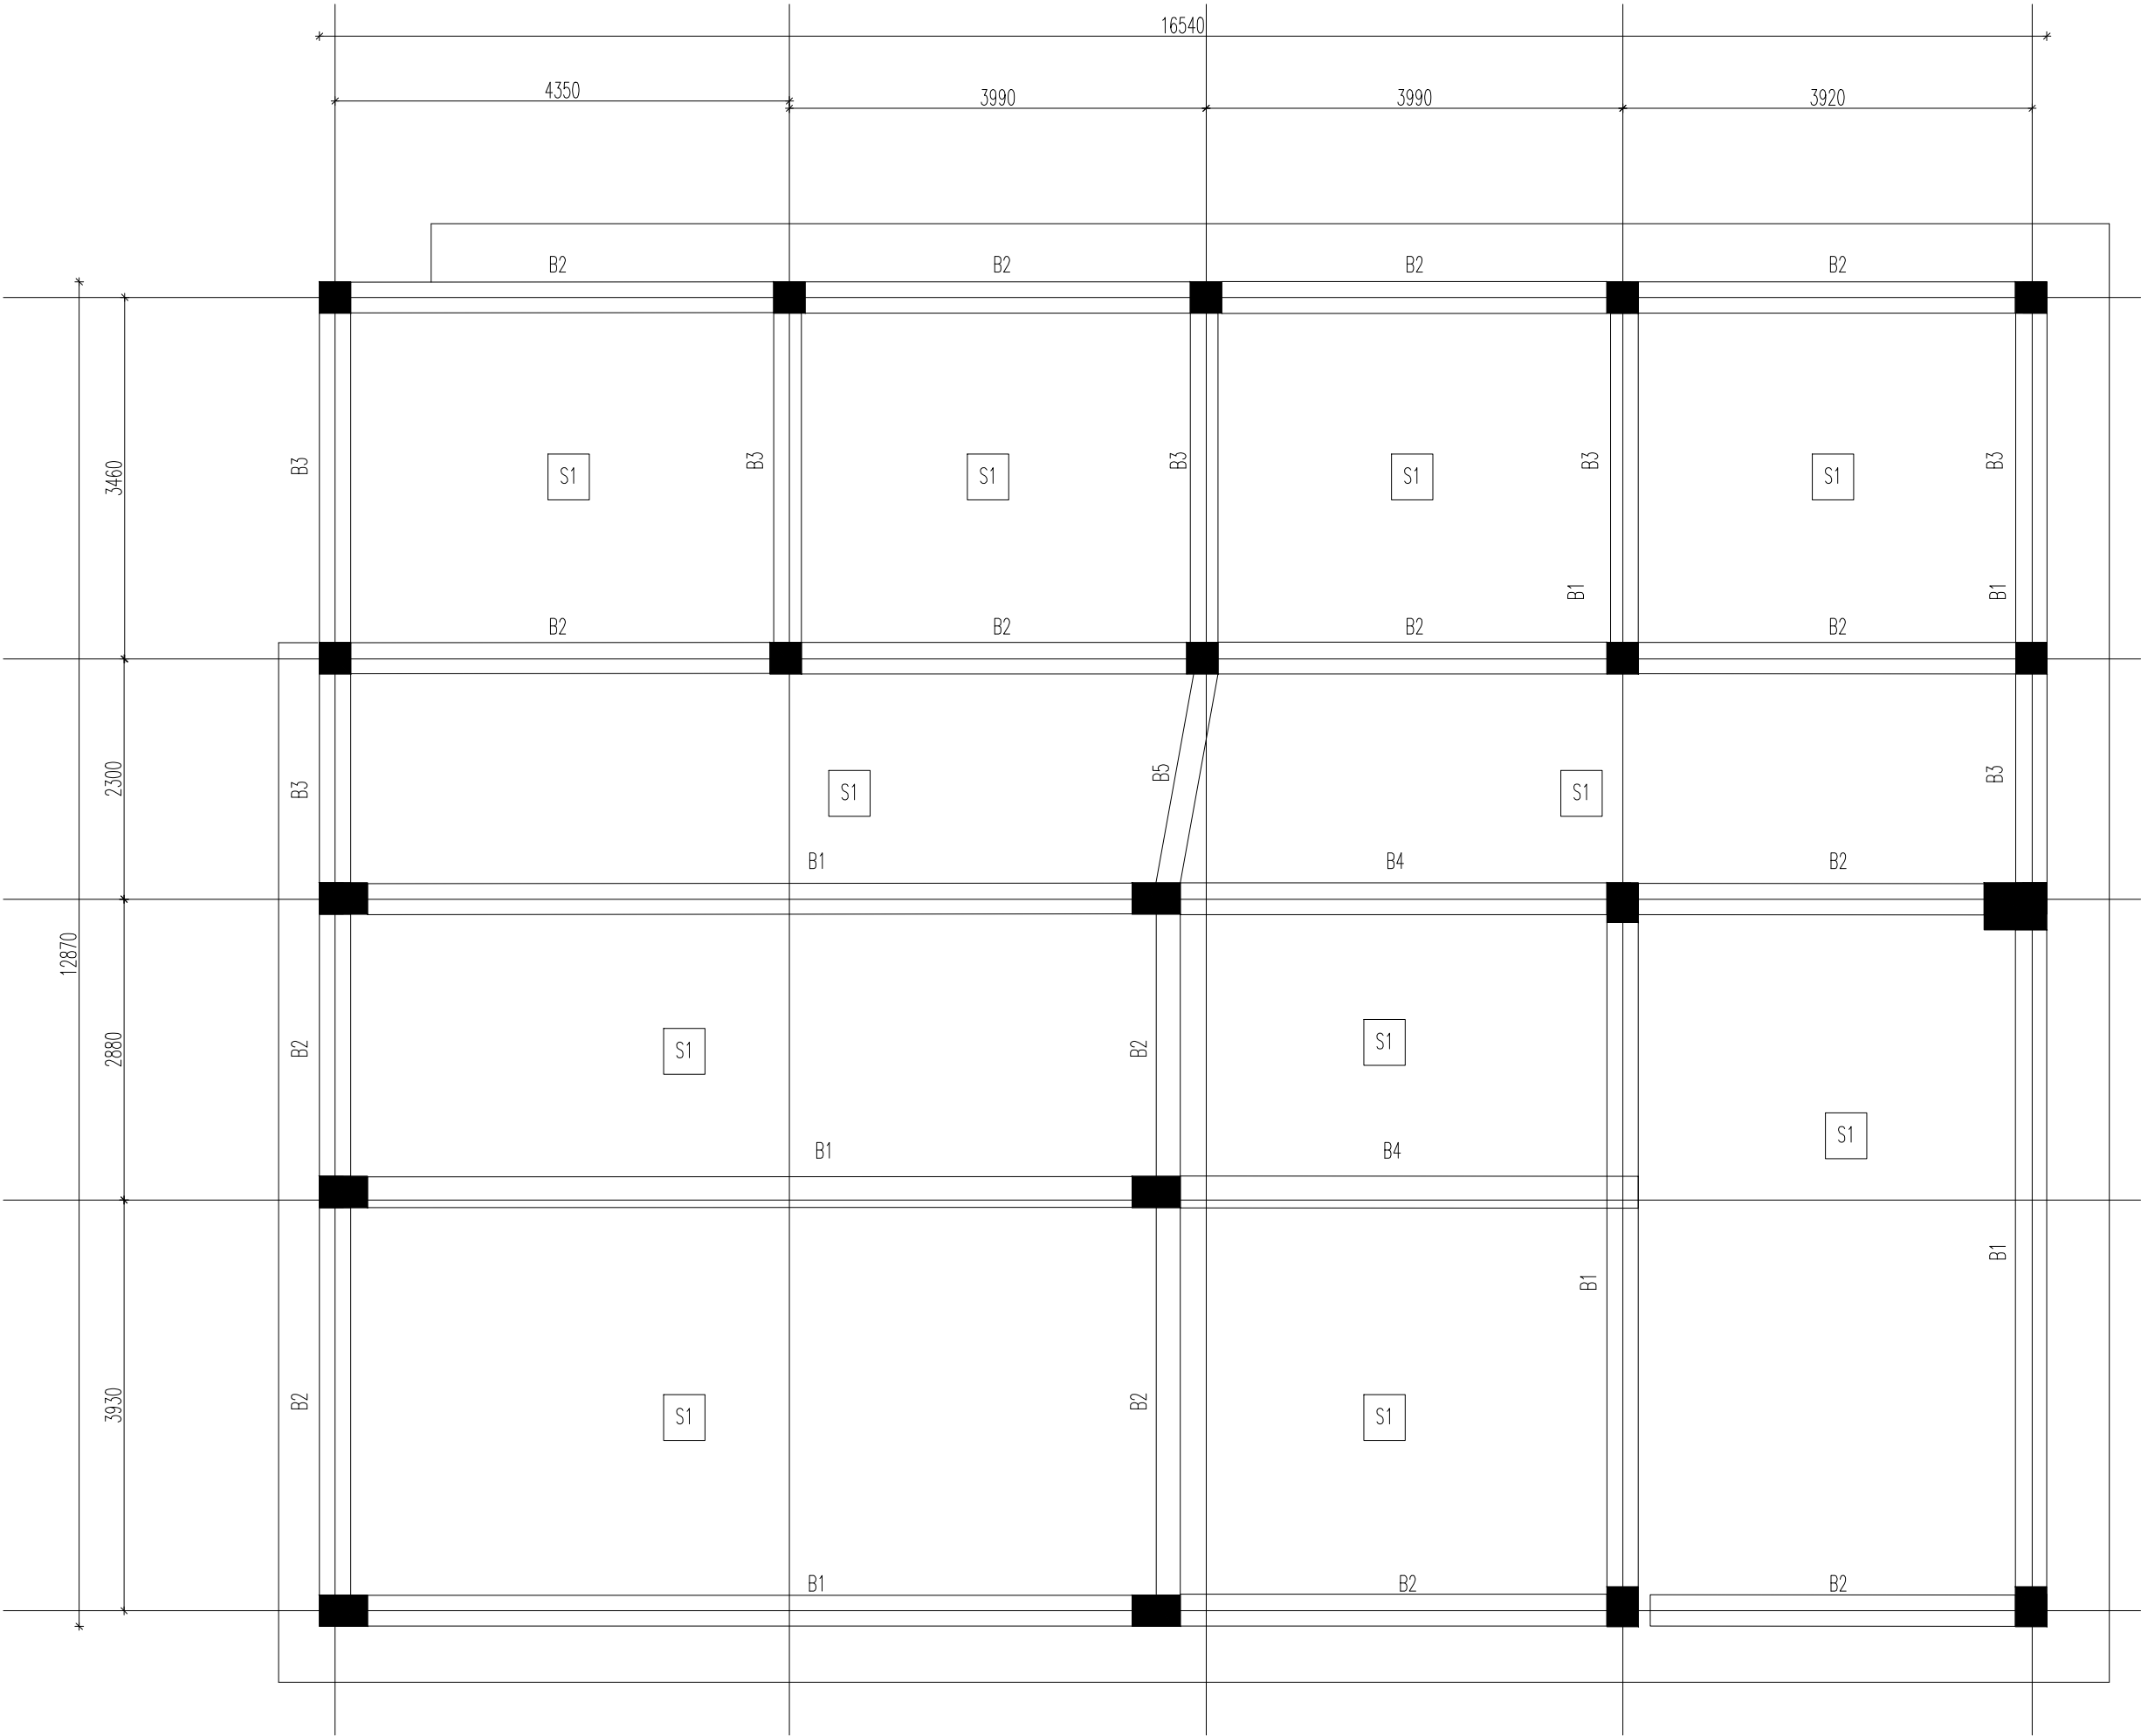

- NOTES:-
- 1) ALL DIMENSIONS ARE IN 'mm' UNLESS OTHERWISE SPECIFIED.
 - 2) DIMENSIONS CAN NOT BE SCALED OUT FROM THE DRAWING.
 - 3) ALL THE OUTER WALLS SHALL BE OF 230mm THICK BRICK MASONRY IN CM -1:6.
 - 4) 15 mm THICK CEMENT PLASTER IN CM-1:6 SHALL BE APPLIED ON INTERIOR & EXTERIOR WALLS.
 - 5) CONDUIT ELECTRICAL WIRING SHALL BE DONE.
 - 6) REINFORCEMENT STEEL SHALL BE Fe 415 CONFIRMING TO IS 1786-2008
 - 7) CONC. MIX FOR COL., BEAMS, SLAB, FOOTING SHALL BE IN M-30 CONFIRMING TO IS-456.
 - 8) LEAN CONCRETE 1:3:6, 100 mm THICK BE USED UNDER THE FOOTING.
 - 9) MIN. COVER SHALL BE 40 mm IN COL., 30mm IN BEAM, 50 mm IN FOOTING.
 - 10) DEVELOPMENT LENGTH SHALL BE 500 LAP SHALL BE STAGGERED WHERE EVER PROVIDED.
 - 11) 8 Ø @150mm C/C SKIN R/F SHALL BE PROVIDED ON TOP FACE OF FOOTING.
 - 12) PLUM CONC. IN CC-1:5:10 SHALL BE PROVIDED BELOW PLINTH BEAMS UP TO THE FIRM GROUND.
 - 13) ALL OTHERS SPECIFICATIONS SHALL BE AS PER DNIT.
 - 14) FOUNDATION BLOCK OF SUITABLE SIZE SHALL BE PROVIDED FOR WINCH/MOTOR FRAME AS PER MANUFACTURER RECOMMENDATION.
 - 15) SAFE BEARING CAPACITY OF SOIL SHOULD NOT BE LESS THAN 6.0 T/SQM.
 - 16) THE BUILDING IS DESIGNED CONSIDERED SEISMIC ZONE 3

LEGEND:-

1	20.04.2024	ISSUED FOR CONSTRUCTION	SG
S.NO	DATE	DESCRIPTION	CHECKED BY
		REVISIONS	

ENGINEER:-

CLIENT:-
EXECUTIVE ENGINEER, PANCHAYATI RAJ, BHIWANI


PROJECT:-
STRUCTURAL DRAWING OF HEALTH WELLNESS CENTRE
AT VILLAGE DEVSAR, BLOCK BHIWANI, DISTT BHIWANI

DRAWING TITLE:-
ROOF BEAM LAYOUT PLAN


DATE	20.04.2024	SHEET NO 5/8
DR. BY	SG	
DES. BY	SG	
OF. NO.	-	
SCALE	N.T.S	DRG. NO. SEC/ZPHS/HIS/005

CONSULTANT:-

SAI ENGG CONSULTANTS
SHOP NO 02 KAWLA ROAD JANDLI, AMBALA
CITY, HARYANA - 134001

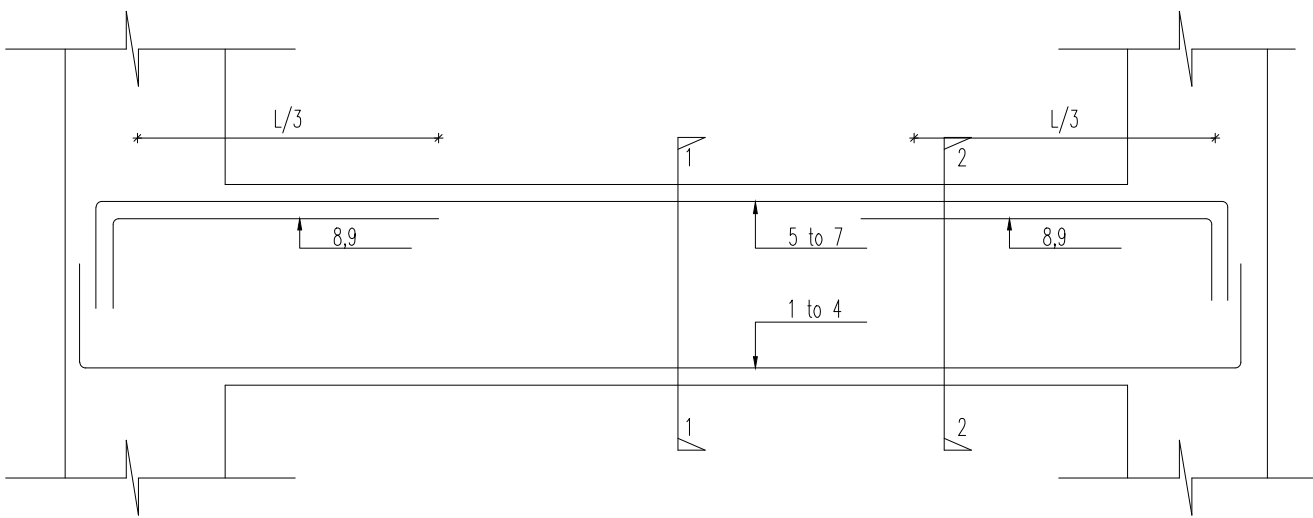


L-SEC OF BEAM B-1

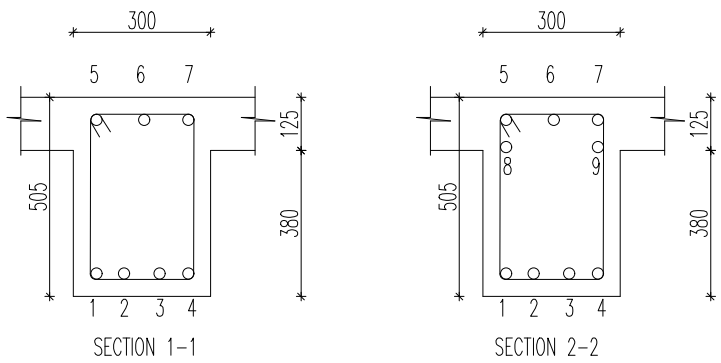


BAR NO:-1to7: 20Ø FOR MAIN STEEL
BAR NO:-8,9: 20ØEXTRA BAR AT TOP FACE ON SUPPORT
Rings:-8Ø for 2 legged @100c/c 8 nos from suport
@150 c/c in the middle

ROOF BEAM B-1

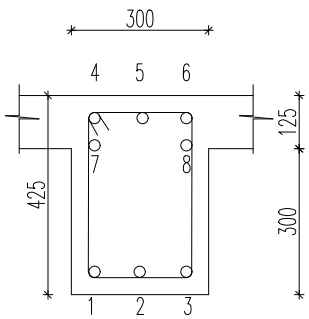

BAR NO:-1to6: 16Ø FOR MAIN STEEL
BAR NO:-7,8: 16ØEXTRA BAR AT TOP FACE ON SUPPORT
Rings:-8Ø for 2 legged @100c/c 9 nos from suport
@150 c/c in the middle


ROOF BEAM B-2

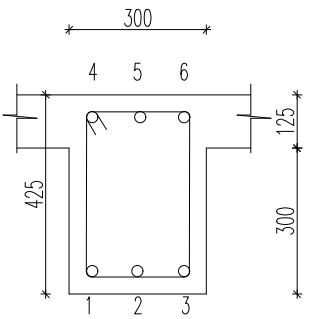

BAR NO:-1to6: 16Ø FOR MAIN STEEL
Rings:-8Ø for 2 legged @100c/c 9 nos from suport
@150 c/c in the middle


ROOF BEAM B-3

SLAB SCHEDULE		
S.No.	SLAB ID	THICKNESS
1	S1	125 mm

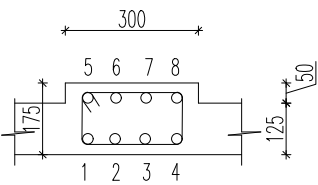

BAR NO:-1to8: 20Ø FOR MAIN STEEL
Rings:-8Ø for 2 legged @150c/c THROUGHOUT

ROOF BEAM B-4

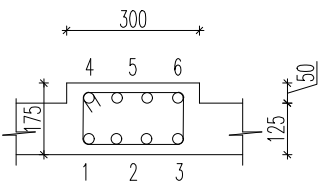

BAR NO:-1to8: 16Ø FOR MAIN STEEL
Rings:-8Ø for 2 legged @150c/c THROUGHOUT

ROOF BEAM B-5

- NOTES:-
- 1) ALL DIMENSIONS ARE IN 'mm' UNLESS OTHERWISE SPECIFIED.
 - 2) DIMENSIONS CAN NOT BE SCALED OUT FROM THE DRAWING.
 - 3) ALL THE OUTER WALLS SHALL BE OF 230mm THICK BRICK MASONRY IN CM -1:6.
 - 4) 15 mm THICK CEMENT PLASTER IN CM-1:6 SHALL BE APPLIED ON INTERIOR & EXTERIOR WALLS.
 - 5) CONDUIT ELECTRICAL WIRING SHALL BE DONE.
 - 6) REINFORCEMENT STEEL SHALL BE Fe 415 CONFIRMING TO IS 1786-2008
 - 7) CONC. MIX FOR COL., BEAMS, SLAB, FOOTING SHALL BE IN M-30 CONFIRMING TO IS-456.
 - 8) LEAN CONCRETE 1:3:6, 100 mm THICK BE USED UNDER THE FOOTING.
 - 9) MIN. COVER SHALL BE 40 mm IN COL., 30mm IN BEAM, 50 mm IN FOOTING.
 - 10) DEVELOPMENT LENGTH SHALL BE 50Ø LAP SHALL BE STAGGERED WHERE EVER PROVIDED.
 - 11) 8 Ø @150mm C/C SKIN R/F SHALL BE PROVIDED ON TOP FACE OF FOOTING.
 - 12) PLUM CONC. IN CC-1:5:10 SHALL BE PROVIDED BELOW PLINTH BEAMS UP TO THE FIRM GROUND.
 - 13) ALL OTHERS SPECIFICATIONS SHALL BE AS PER DNIT.
 - 14) FOUNDATION BLOCK OF SUITABLE SIZE SHALL BE PROVIDED FOR WINCH/MOTOR FRAME AS PER MANUFACTURER RECOMMENDATION.
 - 15) SAFE BEARING CAPACITY OF SOIL SHOULD NOT BE LESS THAN 6.0 T/SQM.
 - 16) THE BUILDING IS DESIGNED CONSIDERED SEISMIC ZONE 3

LEGEND:-

1	20.04.2024	ISSUED FOR CONSTRUCTION	SG
S.NO	DATE	DESCRIPTION	CHECKED BY
		REVISIONS	

ENGINEER:-

CLIENT:-
EXECUTIVE ENGINEER, PANCHAYATI RAJ, BHIWANI


PROJECT:-
STRUCTURAL DRAWING OF HEALTH WELLNESS CENTRE
AT VILLAGE DEVSAR, BLOCK BHIWANI, DISTT BHIWANI

DRAWING TITLE:-
GROUND ROOF BEAM DETAIL

DATE	20.04.2024	SHEET NO 6/8
DR.BY	SG	
DES.BY	SG	
OF.NO.	-	
SCALE	N.T.S	DRG.NO. SEC/ZPHS/HIS/006

CONSULTANT:-

SAI ENGG CONSULTANTS
SHOP NO 02 KAWLA ROAD JANDLI, AMBALA
CITY, HARYANA - 134001

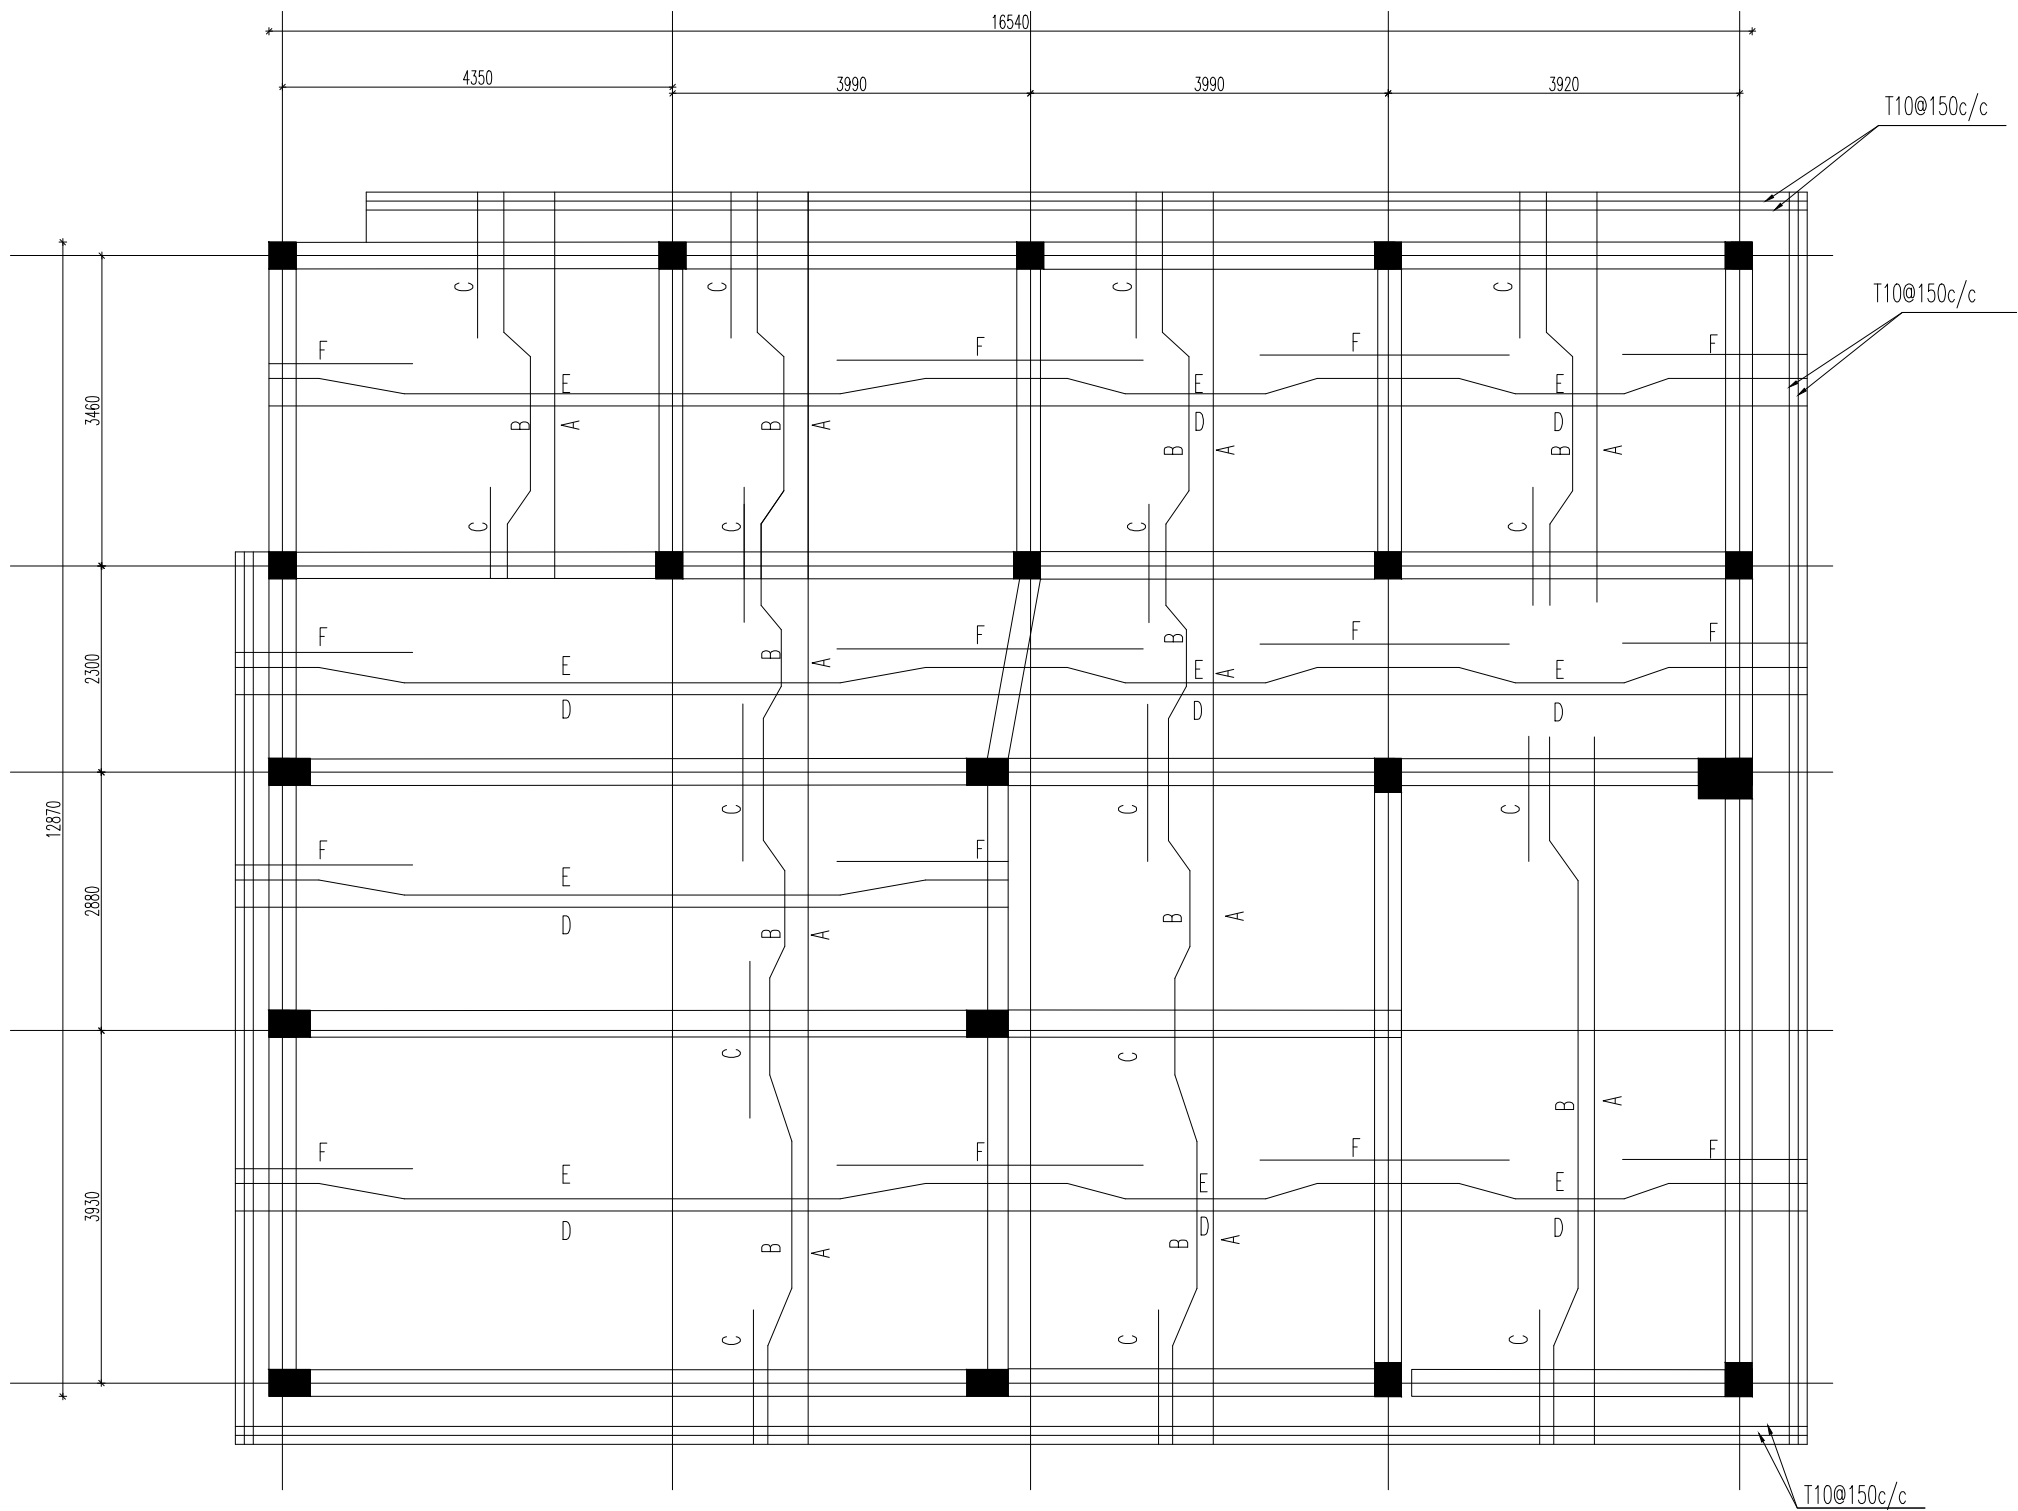

SCHEDULE OF BARS		
1	A	10ø@300 mm c/c Straight bar at bottom face
2	B	10ø@300 mm c/c Cranked bar
3	C	12ø@300 mm c/c extra bar at top face
4	D	10ø@380 mm c/c Straight bar at bottom face
5	E	10ø@380 mm c/c Cranked bar
6	F	10ø@380 mm c/c extra bar at top face
7	G	10ø@250 mm c/c distribution Steel(Binder Bar)

- NOTES:-
- 1) ALL DIMENSIONS ARE IN 'mm' UNLESS OTHERWISE SPECIFIED.
 - 2) DIMENSIONS CAN NOT BE SCALED OUT FROM THE DRAWING.
 - 3) ALL THE OUTER WALLS SHALL BE OF 230mm THICK BRICK MASONRY IN CM -1:6.
 - 4) 15 mm THICK CEMENT PLASTER IN CM-1:6 SHALL BE APPLIED ON INTERIOR & EXTERIOR WALLS.
 - 5) CONDUIT ELECTRICAL WIRING SHALL BE DONE.
 - 6) REINFORCEMENT STEEL SHALL BE Fe 415 CONFIRMING TO IS 1786-2008
 - 7) CONC. MIX FOR COL., BEAMS, SLAB, FOOTING SHALL BE IN M-30 CONFIRMING TO IS:456.
 - 8) LEAN CONCRETE 1:3:6, 100 mm THICK BE USED UNDER THE FOOTING.
 - 9) MIN. COVER SHALL BE 40 mm IN COL., 30mm IN BEAM, 50 mm IN FOOTING.
 - 10) DEVELOPMENT LENGTH SHALL BE 50ø LAP SHALL BE STAGGERED WHERE EVER PROVIDED.
 - 11) 8 Ø @150mm C/C SKIN R/F SHALL BE PROVIDED ON TOP FACE OF FOOTING.
 - 12) PLUM CONC. IN CC-1:5:10 SHALL BE PROVIDED BELOW PLINTH BEAMS UP TO THE FIRM GROUND.
 - 13) ALL OTHERS SPECIFICATIONS SHALL BE AS PER DNIT.
 - 14) FOUNDATION BLOCK OF SUITABLE SIZE SHALL BE PROVIDED FOR WINCH/MOTOR FRAME AS PER MANUFACTURER RECOMMENDATION.
 - 15) SAFE BEARING CAPACITY OF SOIL SHOULD NOT BE LESS THAN 6.0 T/SQM.
 - 16) THE BUILDING IS DESIGNED CONSIDERED SEISMIC ZONE 3

LEGEND:-

1	20.04.2024	ISSUED FOR CONSTRUCTION	SG
S.NO	DATE	DESCRIPTION	CHECKED BY
REVISIONS			

ENGINEER:-

CLIENT:-
EXECUTIVE ENGINEER, PANCHAYATI RAJ, BHIWANI













PROJECT:-
STRUCTURAL DRAWING OF HEALTH WELLNESS CENTRE
AT VILLAGE DEVSAR, BLOCK BHIWANI, DISTT BHIWANI





DRAWING TITLE:-
ROOF SLAB REINF DETAILS & SCHEDULE


DATE	20.04.2024	SHEET NO 7/8
DR. BY	SG	
DES. BY	SG	
OF. NO.	-	
SCALE	N.T.S	DRG. NO. SEC/ZPHS/HIS/007

CONSULTANT:-


SAI ENGG CONSULTANTS
SHOP NO 02 KAWLA ROAD JANDLI, AMBALA
CITY, HARYANA - 134001

COLUMN No	SIZE	REINF. DETAIL	RING DETAIL
C1	300x460	 Bar No:1to12-T20 RINGS:- 8@100 c/c Top & Bottom @150 c/c Middle (as per ductility diagram)	
C2	300x460	 Bar No:1to6-T20,7to10-T16 RINGS:- 8@100 c/c Top & Bottom @150 c/c Middle (as per ductility diagram)	
C3	300x380	 Bar No:1to6-T20,7to10-T16 RINGS:- 8@100 c/c Top & Bottom @150 c/c Middle (as per ductility diagram)	
C4	300x300	 Bar No:1,3,4,6-T16 Bar No:2,5,7,8-T12 RINGS:- 8@100 c/c Top & Bottom @150 c/c Middle (as per ductility diagram)	
C5	300x460	 Bar No:1to8-T20 RINGS:- 8@100 c/c Top & Bottom @150 c/c Middle (as per ductility diagram)	
C6	300x380	 Bar No:1to8-T20 RINGS:- 8@100 c/c Top & Bottom @150 c/c Middle (as per ductility diagram)	


C7	300x380	 Bar No:1,3,4,6-T20 Bar No:2,5,7,8-T16 RINGS:- 8@100 c/c Top & Bottom @150 c/c Middle (as per ductility diagram)	
C8	300x300	 Bar No:1to8-T20 RINGS:- 8@100 c/c Top & Bottom @150 c/c Middle (as per ductility diagram)	

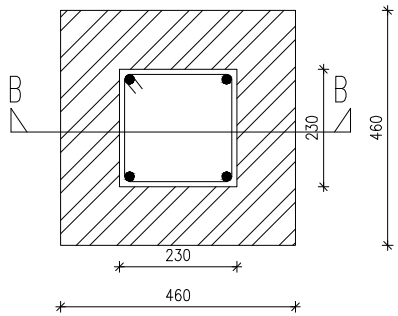



PLAN OF COLUMN BC-1(460x460)
BAR NO:- 1T04-16Ø
RINGS:-8@150c/c THROUGHOUT

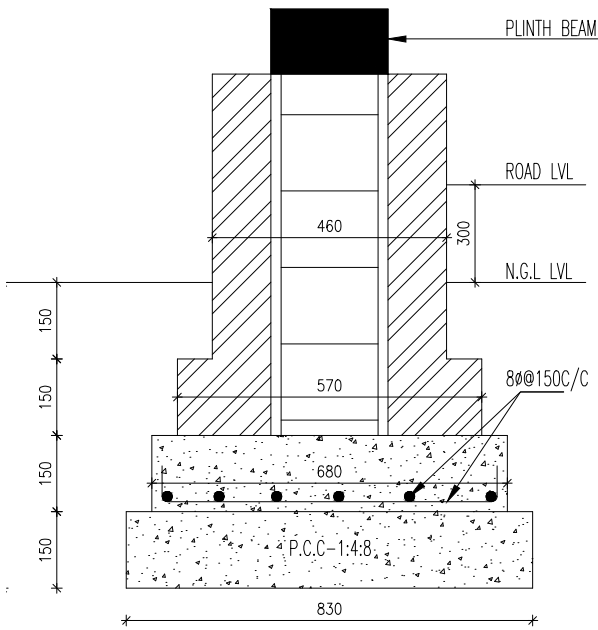

SECTION AT B-B

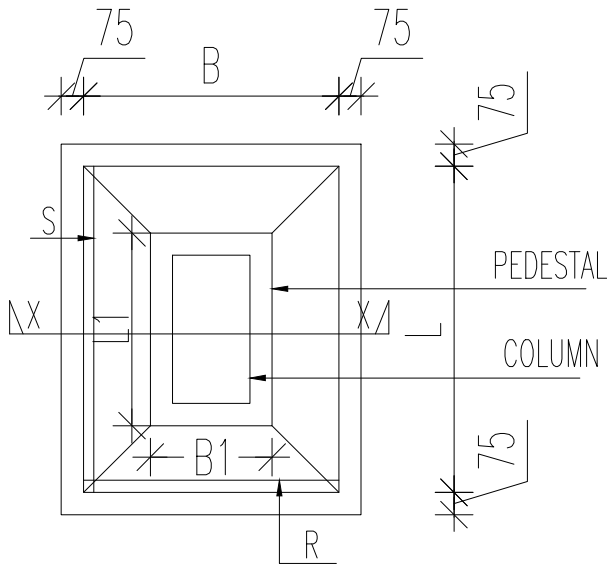

TYPICAL PLAN OF COLUMN FOOTING

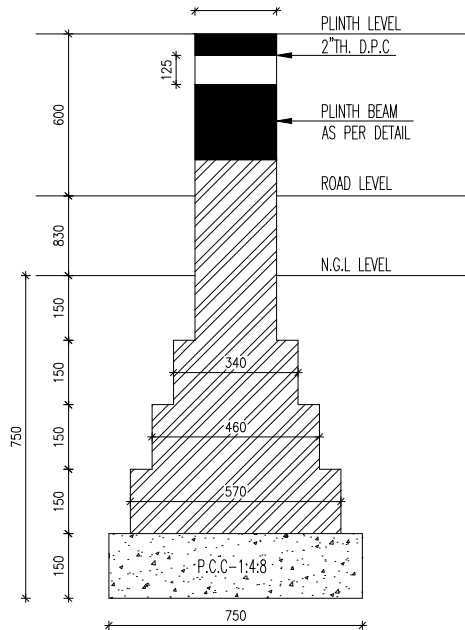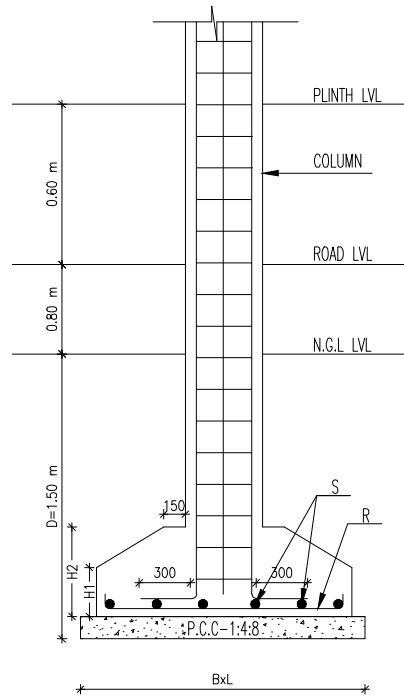

FOUNDATION OF 230 TH.
BRICK WALL(FW1)

- NOTES:-
- 1) ALL DIMENSIONS ARE IN 'mm' UNLESS OTHERWISE SPECIFIED.
 - 2) DIMENSIONS CAN NOT BE SCALED OUT FROM THE DRAWING.
 - 3) ALL THE OUTER WALLS SHALL BE OF 230mm THICK BRICK MASONRY IN CM -1:6.
 - 4) 15 mm THICK CEMENT PLASTER IN CM-1:6 SHALL BE APPLIED ON INTERIOR & EXTERIOR WALLS.
 - 5) CONDUIT ELECTRICAL WIRING SHALL BE DONE.
 - 6) REINFORCEMENT STEEL SHALL BE Fe 415 CONFIRMING TO IS 1786-2008
 - 7) CONC. MIX FOR COL., BEAMS, SLAB, FOOTING SHALL BE IN M-30 CONFIRMING TO IS-456.
 - 8) LEAN CONCRETE 1:3:6, 100 mm THICK BE USED UNDER THE FOOTING.
 - 9) MIN. COVER SHALL BE 40 mm IN COL., 30mm IN BEAM, 50 mm IN FOOTING.
 - 10) DEVELOPMENT LENGTH SHALL BE 50Ø LAP SHALL BE STAGGERED WHERE EVER PROVIDED.
 - 11) 8 Ø @150mm C/C SKIN R/F SHALL BE PROVIDED ON TOP FACE OF FOOTING.
 - 12) PLUM CONC. IN CC-1:5:10 SHALL BE PROVIDED BELOW PLINTH BEAMS UP TO THE FIRM GROUND.
 - 13) ALL OTHERS SPECIFICATIONS SHALL BE AS PER DNIT.
 - 14) FOUNDATION BLOCK OF SUITABLE SIZE SHALL BE PROVIDED FOR WINCH/MOTOR FRAME, AS PER MANUFACTURER RECOMMENDATION.
 - 15) SAFE BEARING CAPACITY OF SOIL SHOULD NOT BE LESS THAN 6.0 T/SQM.
 - 16) THE BUILDING IS DESIGNED CONSIDERED SEISMIC ZONE 3

LEGEND:-

1	20.04.2024	ISSUED FOR CONSTRUCTION	SG
S.NO	DATE	DESCRIPTION	CHECKED BY
REVISIONS			

ENGINEER:-

CLIENT:-
EXECUTIVE ENGINEER, PANCHAYATI RAJ, BHIWANI

PROJECT:-
STRUCTURAL DRAWING OF HEALTH WELLNESS CENTRE
AT VILLAGE DEVSAR, BLOCK BHIWANI, DISTT BHIWANI

DRAWING TITLE:-
COLUMN SCHEDULE & DETAILS

DATE	20.04.2024	SHEET NO 8/8
DR. BY	SG	
DES. BY	SG	
OF. NO.	-	
SCALE	N.T.S	DRG. NO. SEC/ZPHS/HIS/008

CONSULTANT:-

SAI ENGG CONSULTANTS
SHOP NO 02 KAWLA ROAD JANDLI, AMBALA
CITY, HARYANA - 134001