

A Power supply




B Controller



C 1-Wire temperatures / E Expansion




D Mode inputs

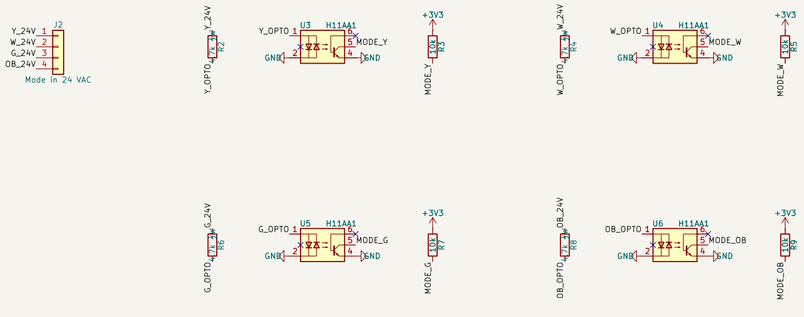


Mounting



F I2C mux: SHT45 ch 0-1, SDP810 ch 2-4

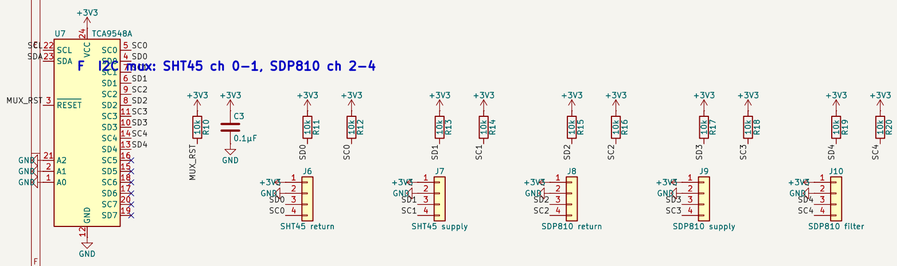

G LoRa radio and SETUP button

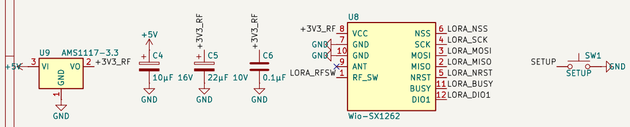

Labels with the same name are connected
Rev A from docs/hvac-schematics.html; rev B additions in design.py

HVAC Monitor

Sheet: /
File: indoor-carrier.kicad_sch

Title: HVAC Monitor indoor carrier

Size: A2	Date: 2026-10-18	**Rev: B**
KiCad E.D.A. 10.0.6		Id: 1/1