


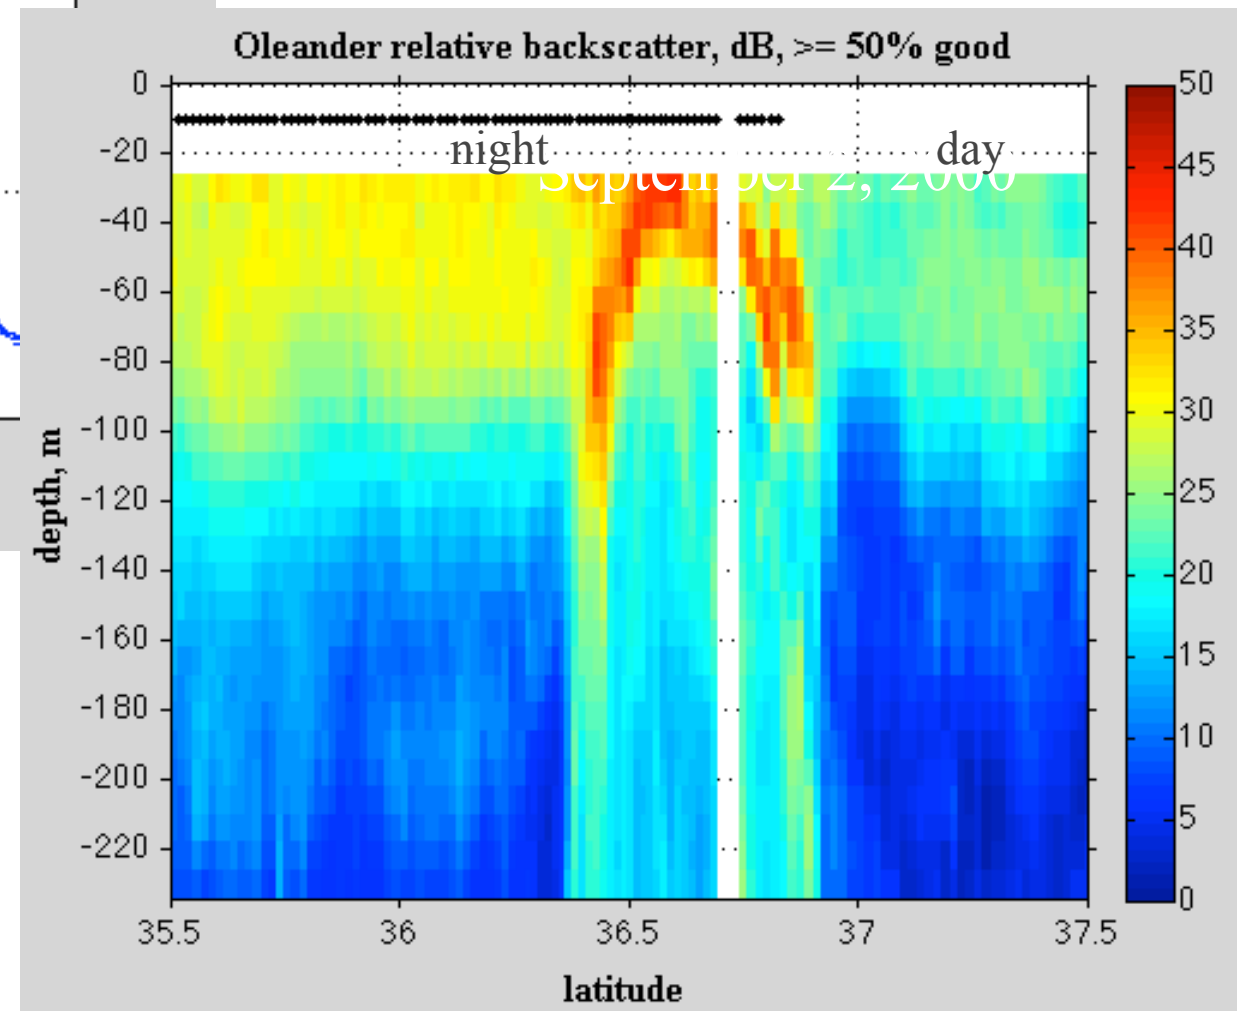
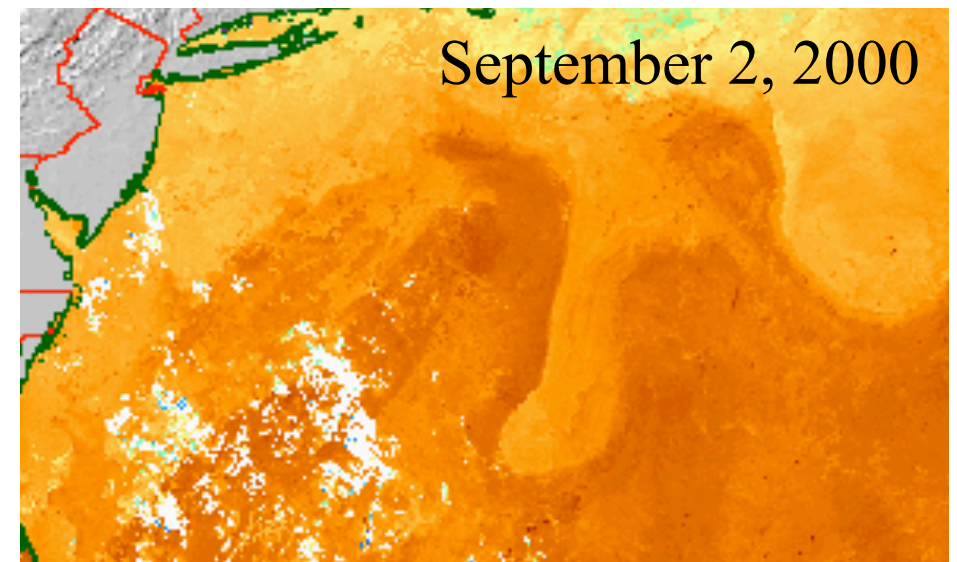
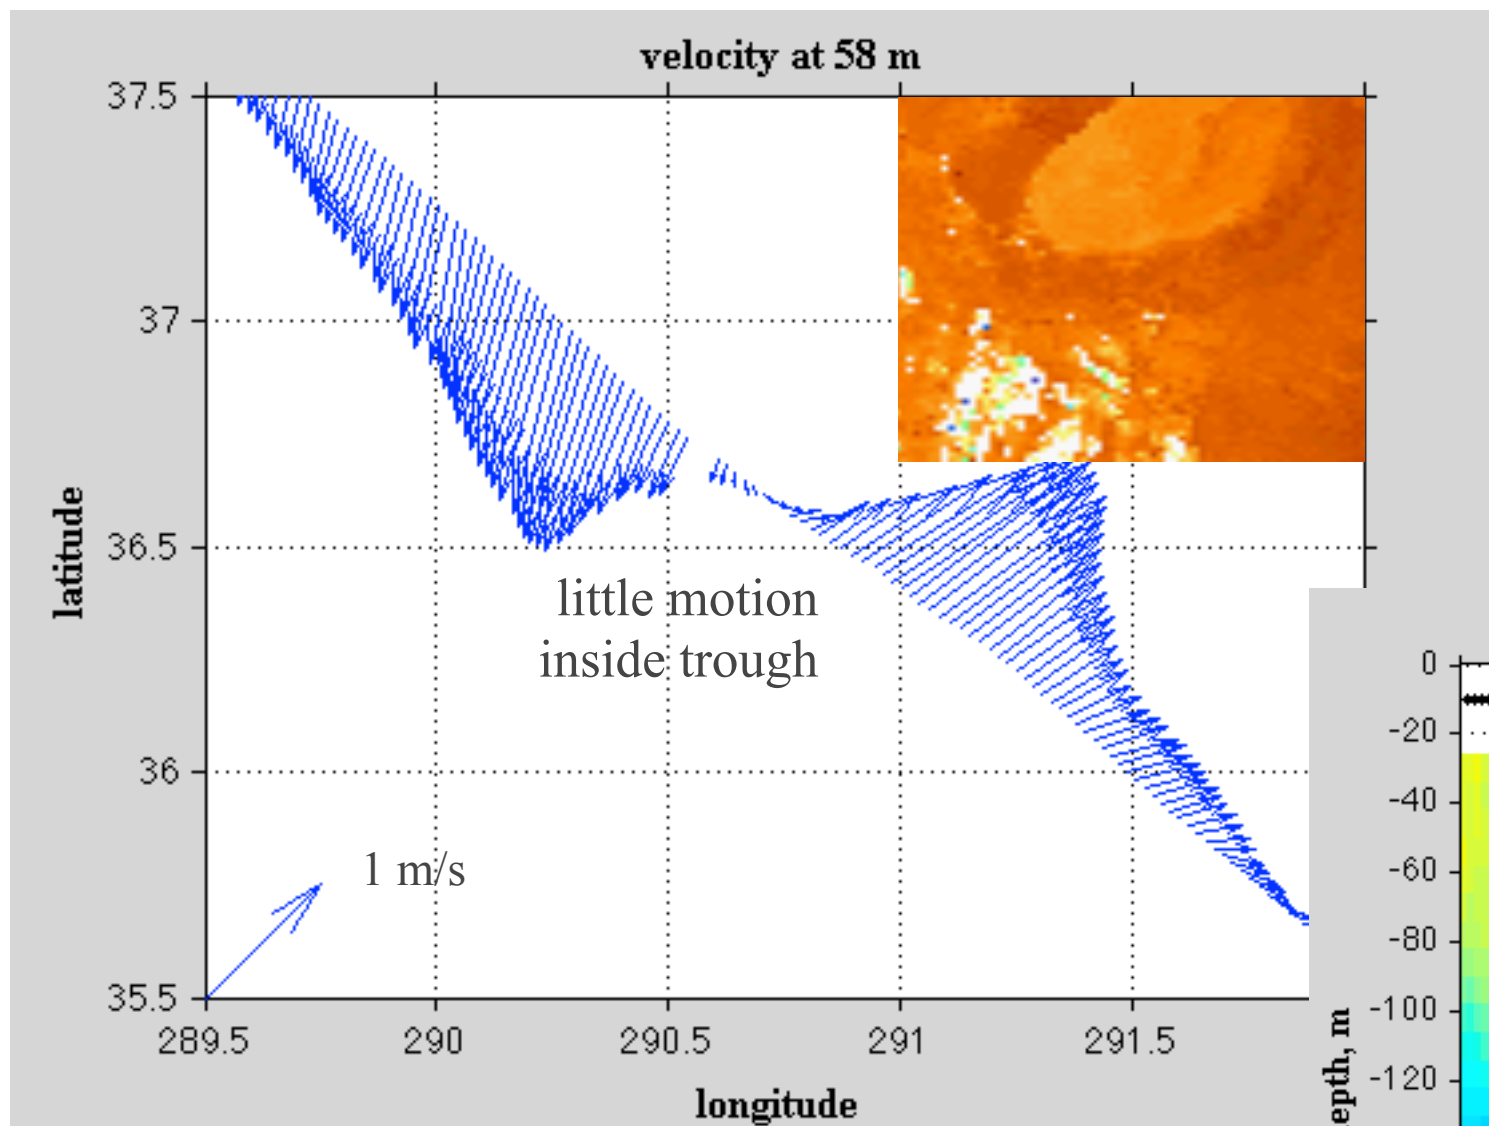
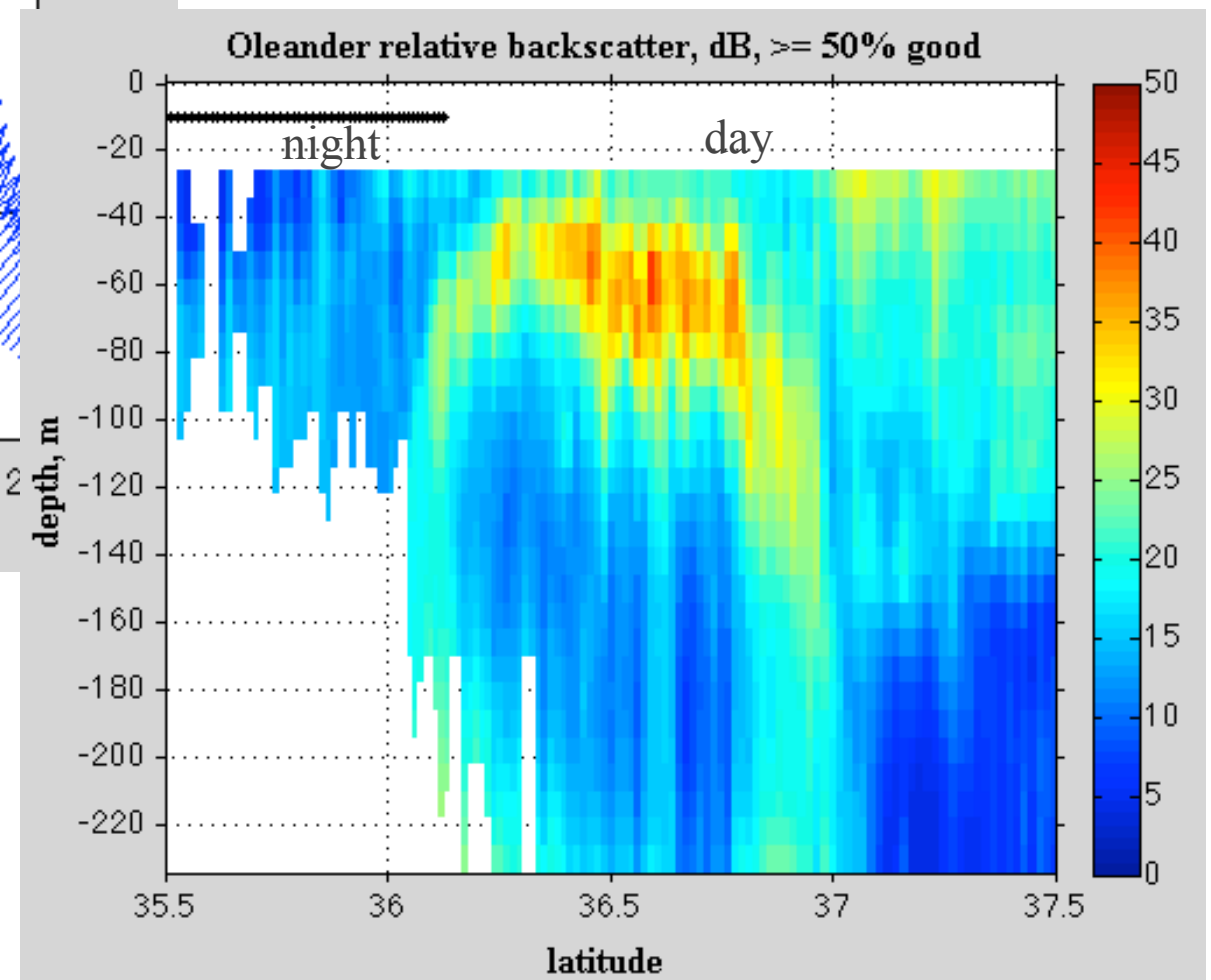
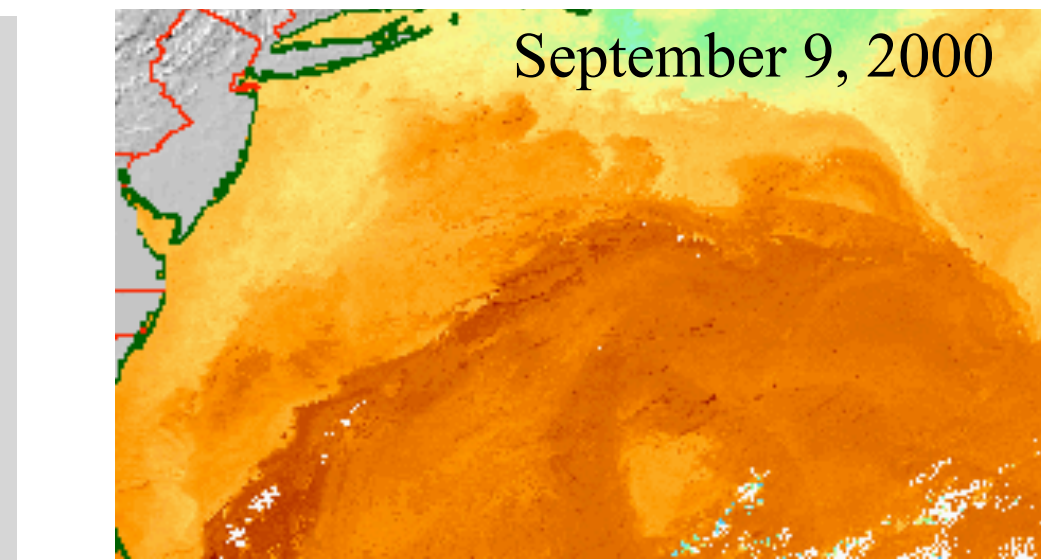
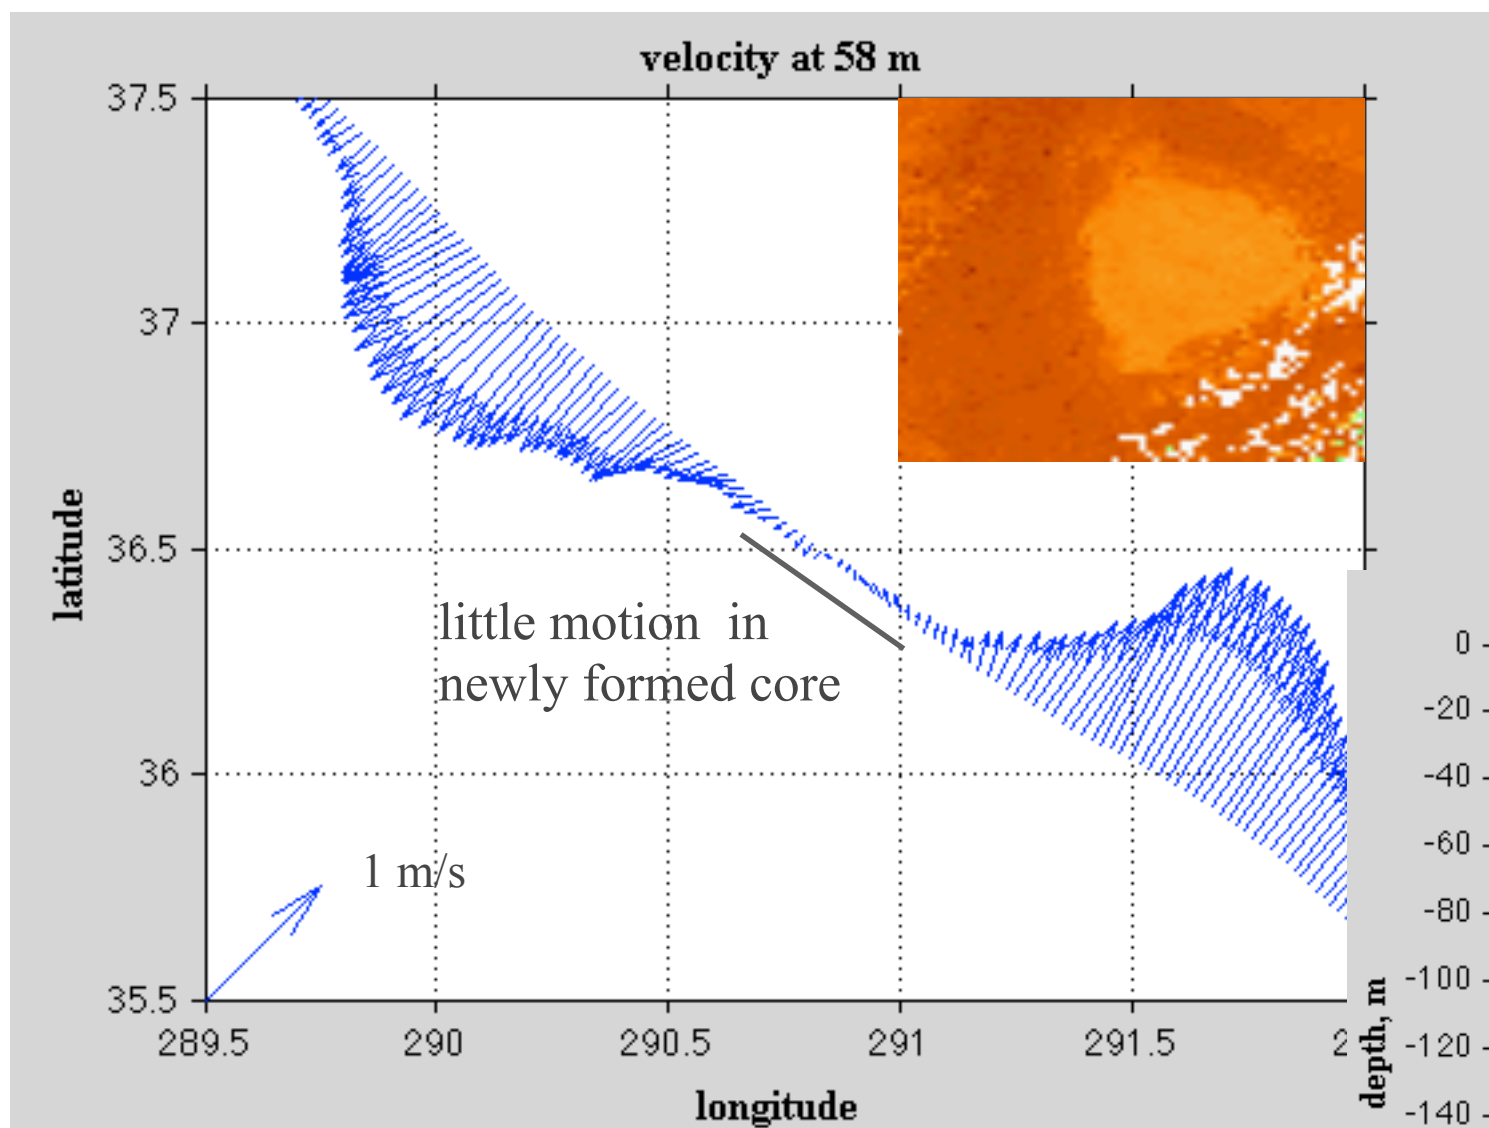


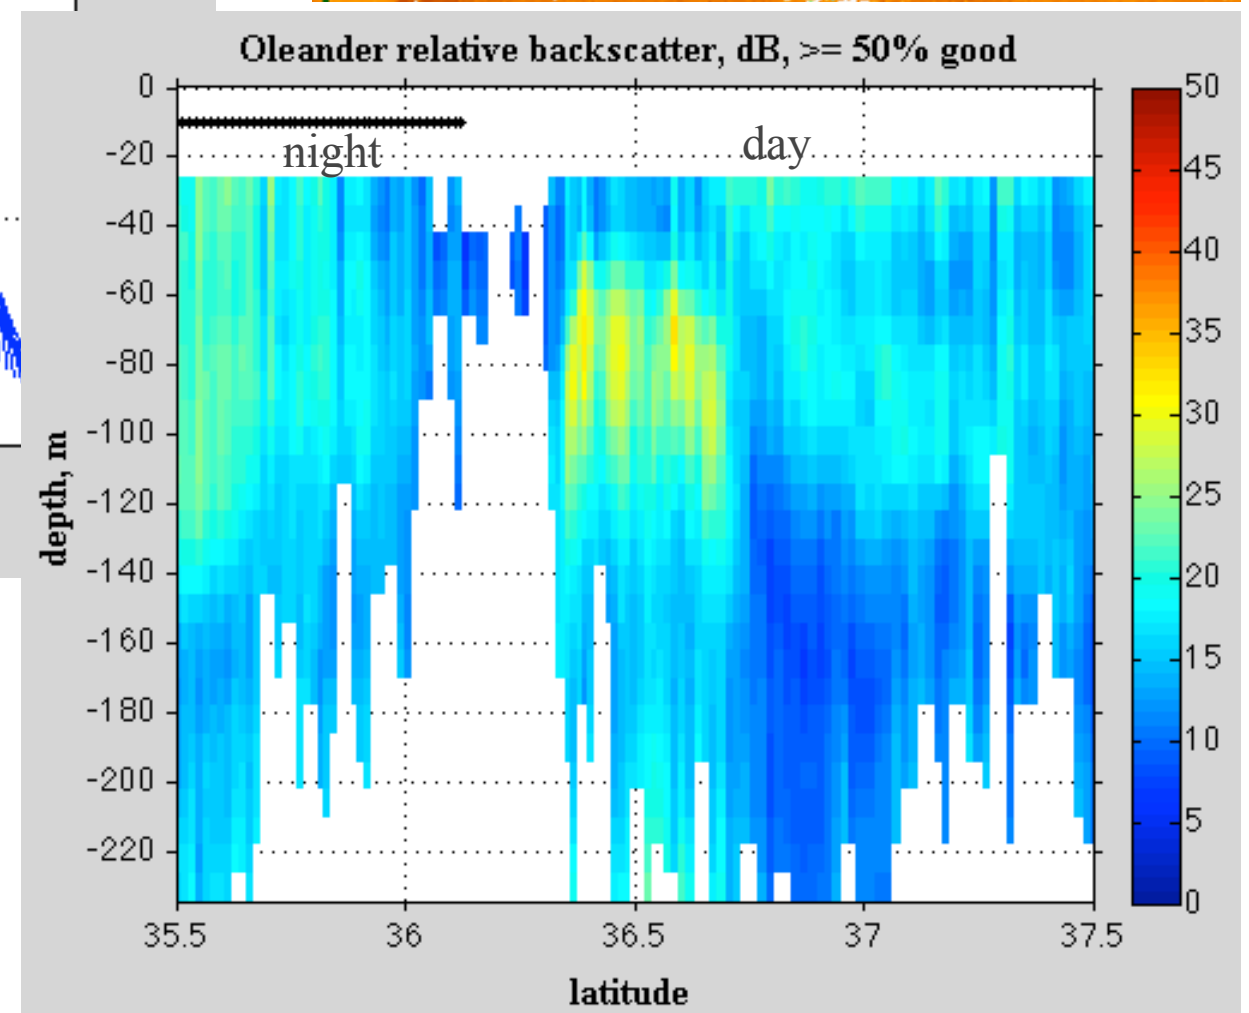


Slice through GS trough shows high biomass
in trough water and front down to ~ 100 m.
150 kHz ADCP

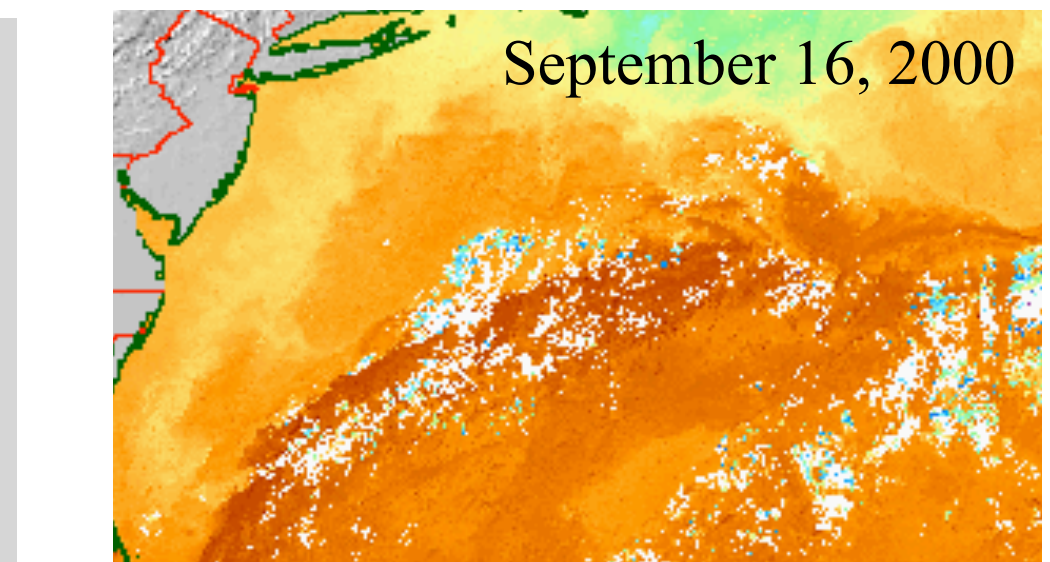

One week later nascent CCR shows remnants of GS structure. Backscatter weakening along edges. Core waters not yet spun up.

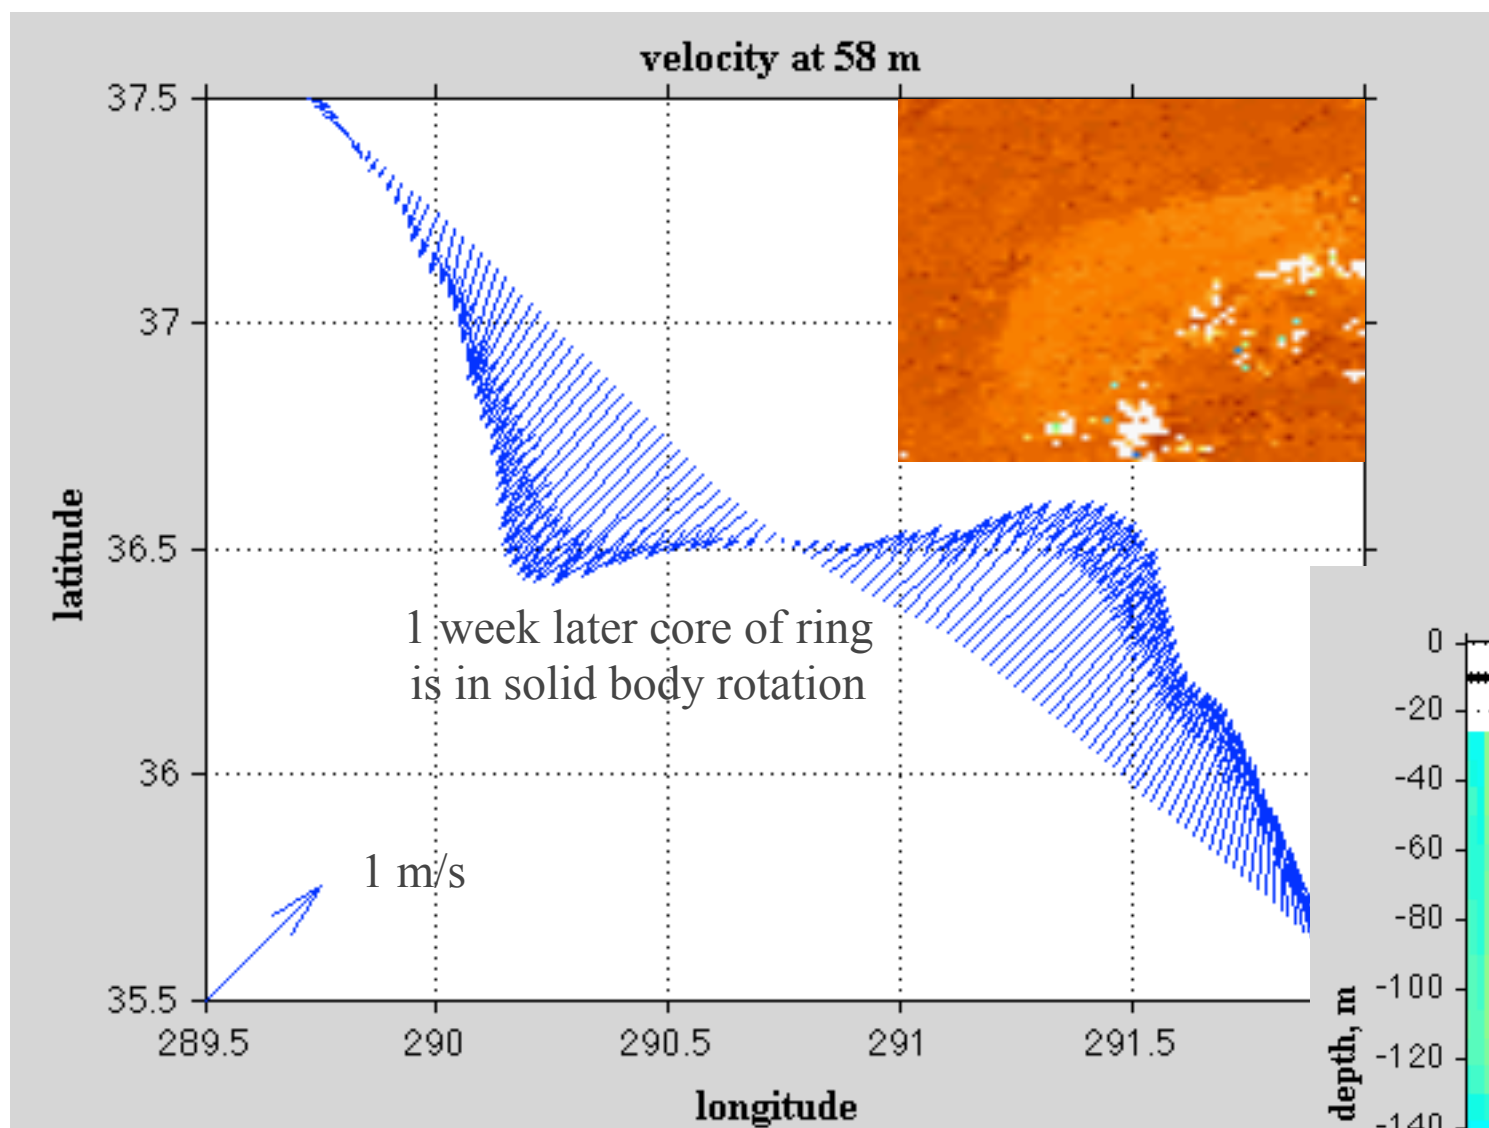

The following week a beautiful slice right through the center of the CCR now in solid body rotation. Backscatter maximum substantially weakened and limited to core.

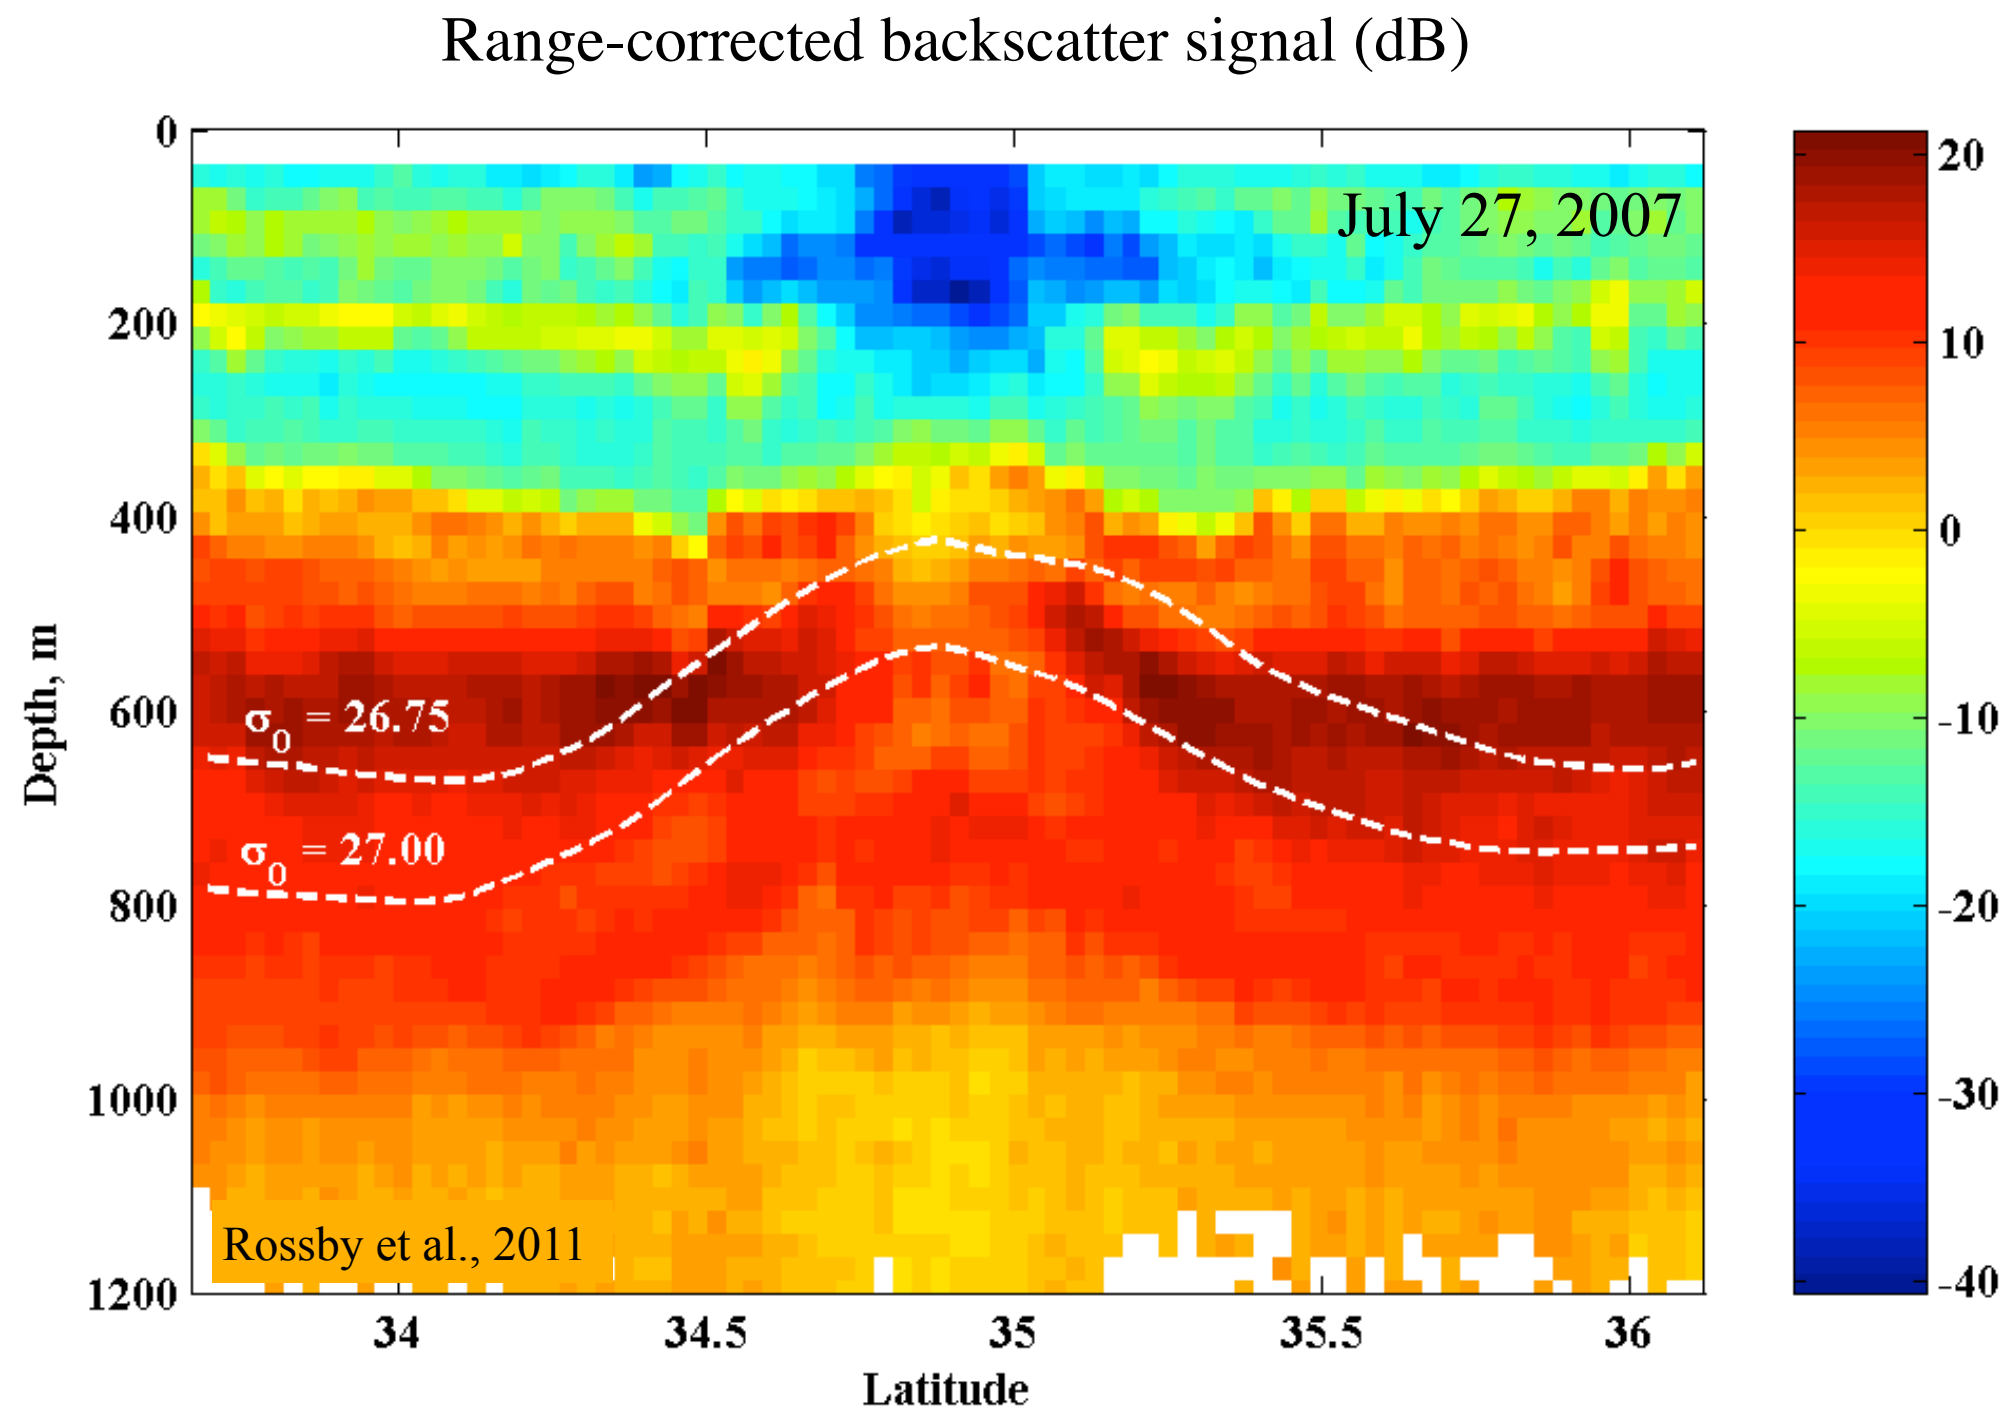

This CCR is 4 months old. Daytime transect.
38 kHz ADCP