

RSLogix Micro Project Report



Processor Information

Processor Type: Bul.1763 MicroLogix 1100 Series B

Processor Name: PROJECT1

Total Memory Used: *

Total Memory Left: *

Program Files: 6

Data Files: 9

Program ID: 0

I/O Configuration

0	Bul.1763	MicroLogix 1100 Series B
1	1762-IQ16	16-Input 10/30 VDC
2	1762-OB16	16-Output (TRANS-SRC) 10/50 VDC
3		
4		

Channel Configuration

CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex

CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Edit Resource/Owner Timeout: 60
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Passthru Link ID: 1
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Write Protected: No
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Comms Servicing Selection: Yes
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Message Servicing Selection: Yes
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex 1st AWA Append Character: \d
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex 2nd AWA Append Character: \a

Source ID: 1 (decimal)
Baud: 19200
Parity: NONE
Control Line : No Handshaking
Error Detection: CRC
Embedded Responses: Auto Detect
Duplicate Packet Detect: Yes
ACK Timeout(x20 ms): 50
NAK Retries: 3
ENQ Retries: 3

CHANNEL 1 (SYSTEM) - Driver: Ethernet

CHANNEL 1 (SYSTEM) - Driver: Ethernet Edit Resource/Owner Timeout: 60
CHANNEL 1 (SYSTEM) - Driver: Ethernet Passthru Link ID: 1
CHANNEL 1 (SYSTEM) - Driver: Ethernet Write Protected: No
CHANNEL 1 (SYSTEM) - Driver: Ethernet Comms Servicing Selection: Yes
CHANNEL 1 (SYSTEM) - Driver: Ethernet Message Servicing Selection: Yes


Hardware Address: 00:00:00:00:00:00
IP Address: 0.0.0.0
Subnet Mask: 0.0.0.0
Gateway Address: 0.0.0.0
Msg Connection Timeout (x 1mS): 15000
Msg Reply Timeout (x mS): 3000
Inactivity Timeout (x Min): 30
Bootp Enable: Yes
Dhcp Enable No
SNMP Enable: No
HTTP Enable: Yes
Auto Negotiate Enable: Yes
Port Speed Enable: 10/100 Mbps Full Duplex/Half Duplex
Contact:
Location:


Program File List


Name	Number	Type	Rungs	Debug	Bytes
[SYSTEM]	0	SYS	0	No	0
	1	SYS	0	No	0
MAIN	2	LADDER	5	No	39
INPUTS	3	LADDER	3	No	35
OUTPUTS	4	LADDER	3	No	35
CONTROLS	6	LADDER	11	No	231


TANK LEVEL CONTROL							
Data File List							
Name	Number	Type	Scope	Debug	Words	Elements	Last
OUTPUT	0	O	Global	No	15	5	O:4
INPUT	1	I	Global	No	21	7	I:6
STATUS	2	S	Global	No	0	66	S:65
BINARY	3	B	Global	No	1	1	B3:0
TIMER	4	T	Global	No	12	4	T4:3
COUNTER	5	C	Global	No	3	1	C5:0
CONTROL	6	R	Global	No	3	1	R6:0
INTEGER	7	N	Global	No	1	1	N7:0
FLOAT	8	F	Global	No	2	1	F8:0



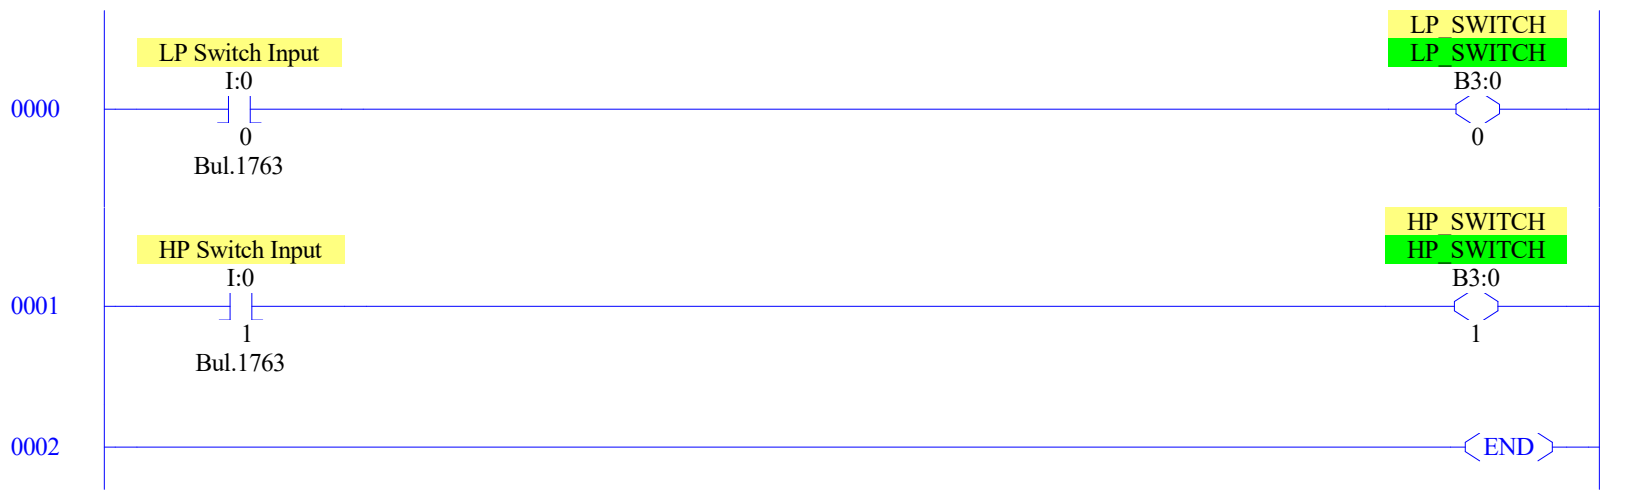

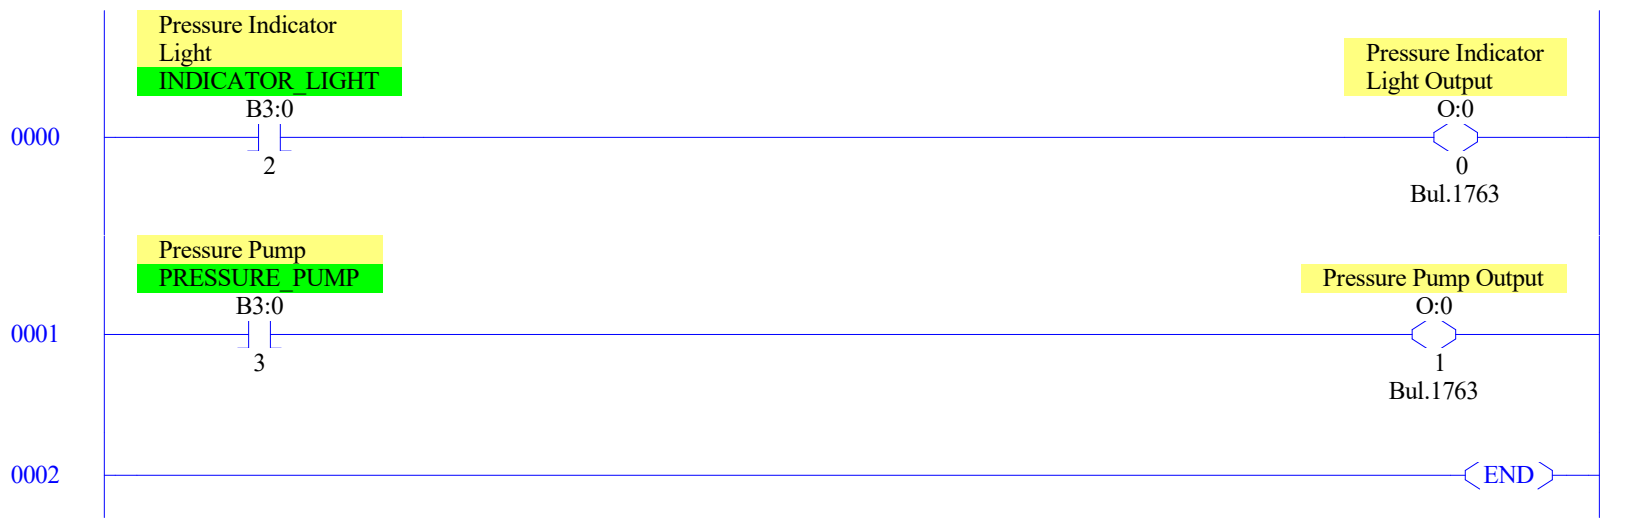

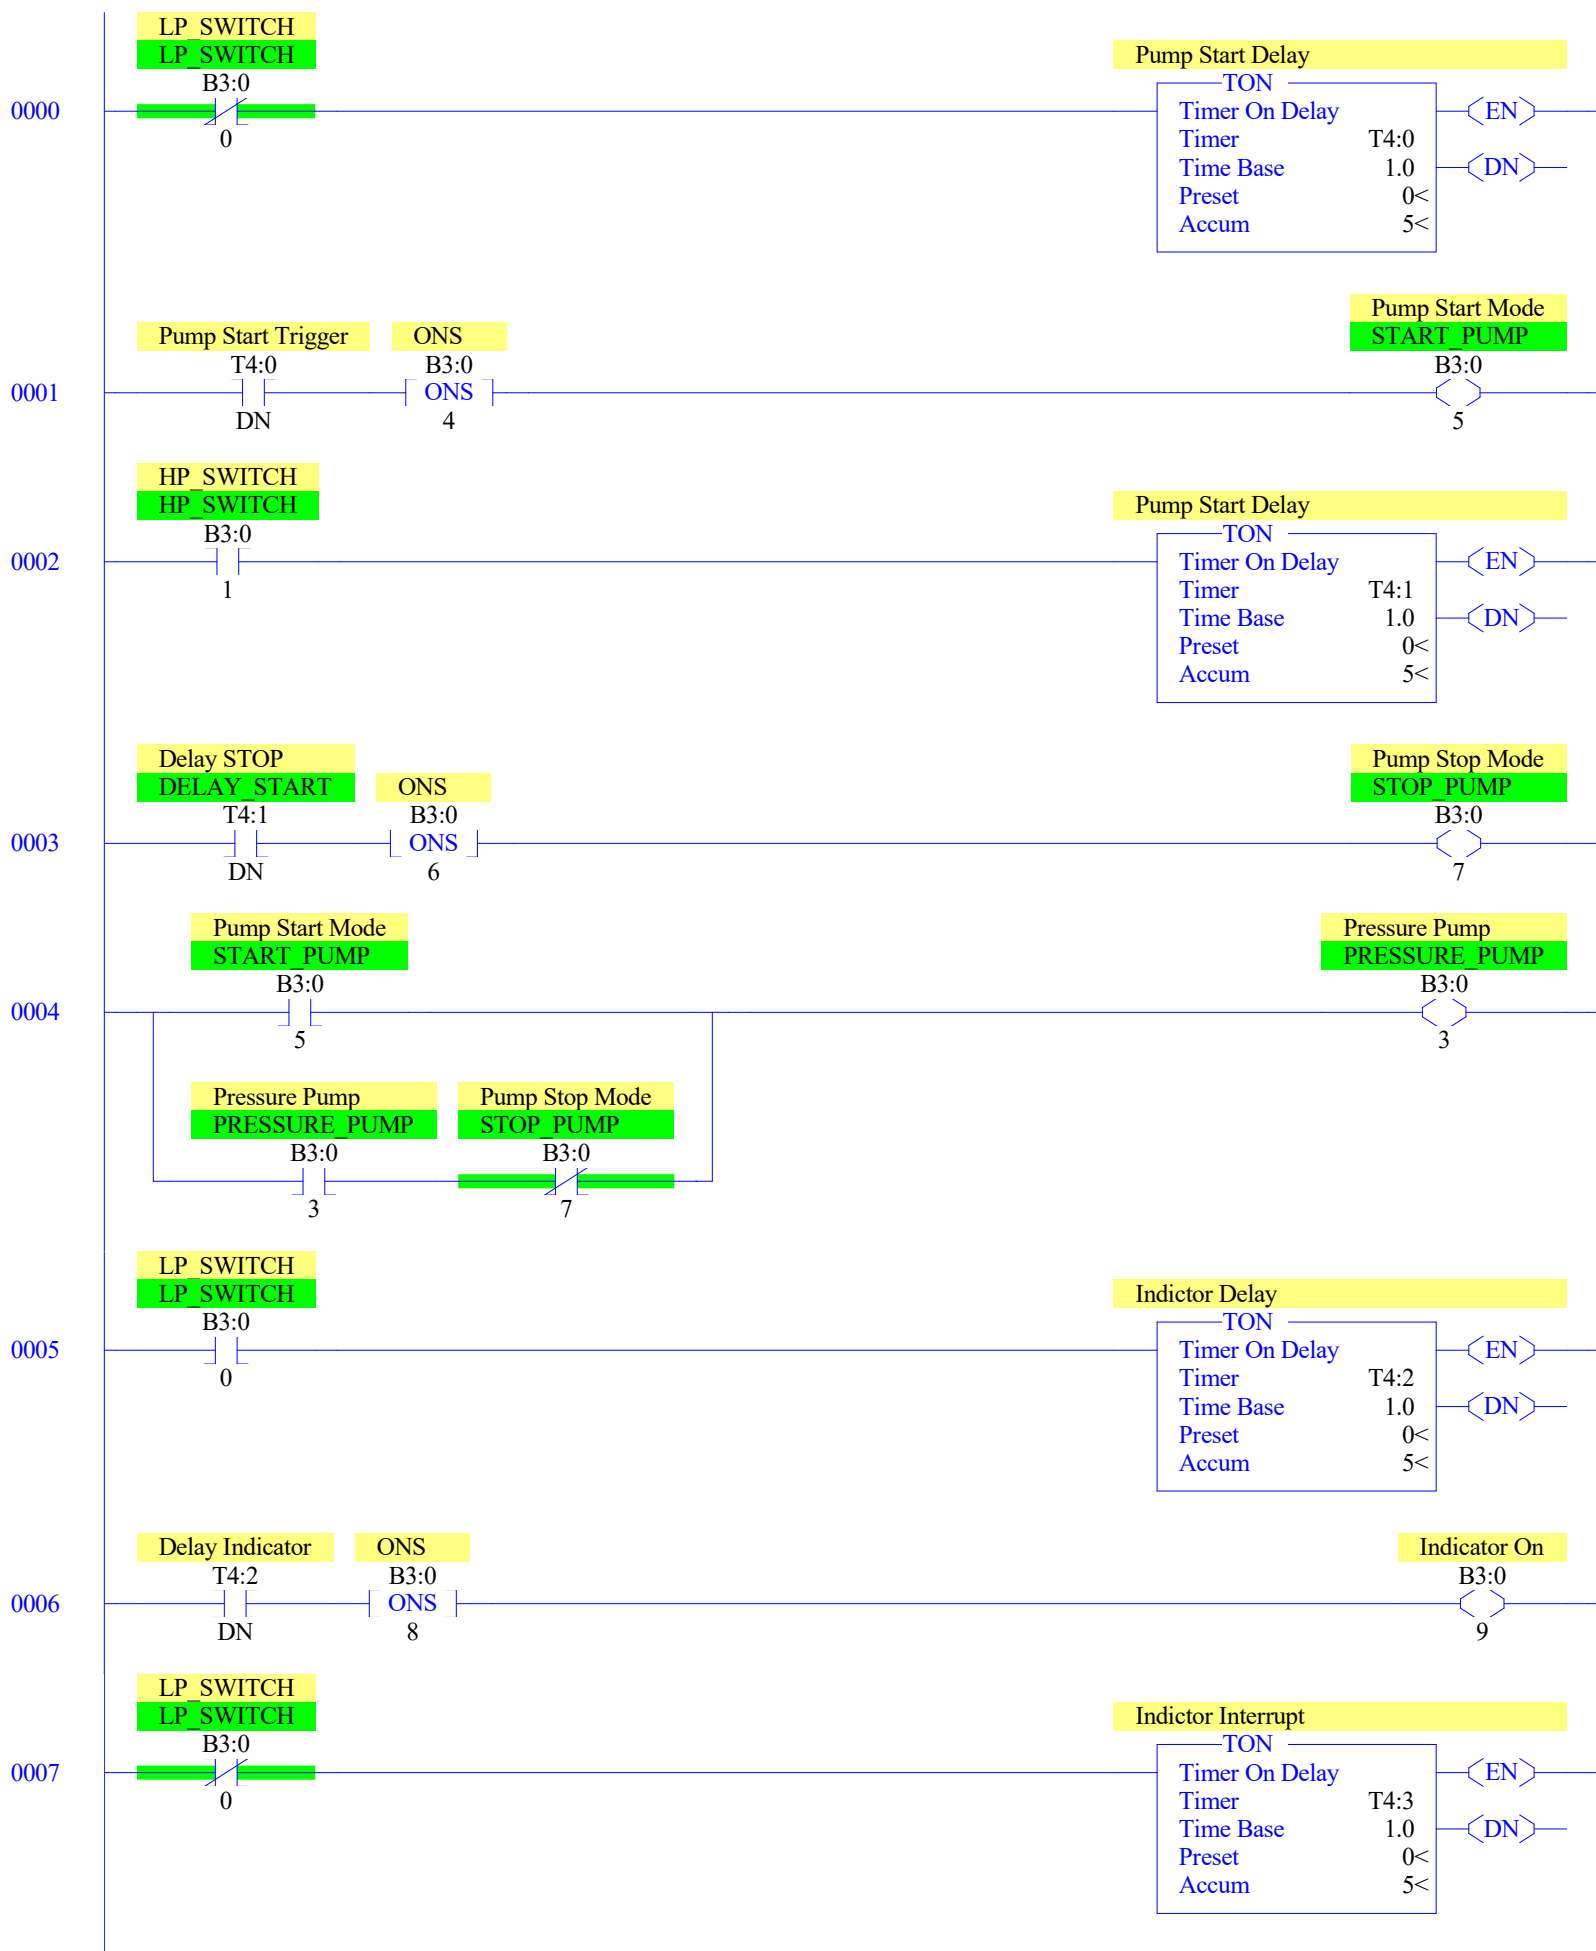

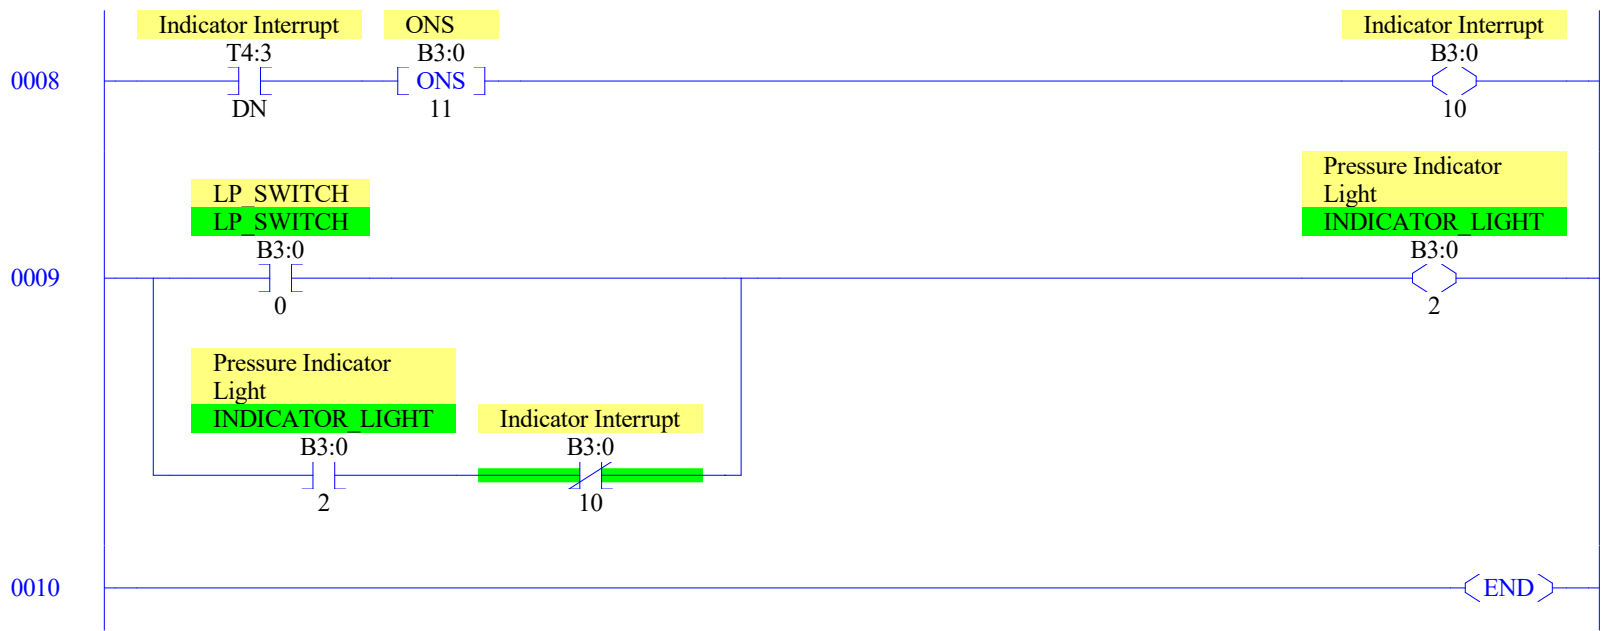

Offset	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0		
O:0.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
O:0.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
O:0.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
O:0.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763	MicroLogix 1100 Series B
O:2.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1762-OB16 - 16-Output (TRANS-SRC) 10/50 VDC	

TANK LEVEL CONTROL																
Data File I1 (bin) -- INPUT																
Offset	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
I:0.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763 MicroLogix 1100 Series B
I:0.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763 MicroLogix 1100 Series B
I:0.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763 MicroLogix 1100 Series B
I:0.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763 MicroLogix 1100 Series B
I:0.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763 MicroLogix 1100 Series B-Analog
I:0.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763 MicroLogix 1100 Series B-Analog
I:1.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1762-IQ16 - 16-Input 10/30 VDC

Main

Processor Mode S:1/0 - S:1/4 = Remote Program Mode
On Power up Go To Run (Mode Behavior) S:1/12 = 0
First Pass S:1/15 = No
Free Running Clock S:4 = 0000-0000-0000-0000

Proc

OS Catalog Number S:57 = 1100 User Program Type S:63 = 8001h
OS Series S:58 = A Compiler Revision Number S:64 =
OS FRS S:59 =
Processor Catalog Number S:60 =
Processor Series S:61 = A
Processor FRN S:62 =

Scan Times

Maximum (x10 ms) S:22 = 0
Watchdog (x10 ms) S:3 (high byte) = 10
Last 100 uSec Scan Time S:35 = 0
Scan Toggle Bit S:33/9 = 0

Math

Math Overflow Selected S:2/14 = 0 Math Register (lo word) S:13 = 0
Overflow Trap S:5/0 = 0 Math Register (high word) S:14-S:13 = 0
Carry S:0/0 = 0 Math Register (32 Bit) S:14-S:13 = 0
Overflow S:0/1 = 0
Zero Bit S:0/2 = 0
Sign Bit S:0/3 = 0

Chan 0

Processor Mode S:1/0- S:1/4 = Remote Program Mode
Node Address S:15 (low byte) = 0 Outgoing Msg Cmd Pending S:33/2 = 0
Baud Rate S:15 (high byte) = ?
Channel Mode S:33/3 = 0
Comms Active S:33/4 = 0
Incoming Cmd Pending S:33/0 = 0
Msg Reply Pending S:33/1 = 0

Debug

Suspend Code S:7 = 0
Suspend File S:8 = 0

Errors

Fault Override At Power Up S:1/8 = 0 Fault Routine S:29 = 0
Startup Protection Fault S:1/9 = 0 Major Error S:6 = 0h
Major Error Halt S:1/13 = 0
Overflow Trap S:5/0 = 0 Error Description:
Control Register Error S:5/2 = 0
Major Error Executing User Fault Rtn. S:5/3 = 0
Battery Low S:5/11 = 0
Input Filter Selection Modified S:5/13 = 0
ASCII String Manipulation error S:5/15 = 0

Protection

Deny Future Access S:1/14 = No
Data File Overwrite Protection Lost S:36/10 = False

Mem Module

Memory Module Loaded On Boot S:5/8 = 0
Password Mismatch S:5/9 = 0
Load Memory Module On Memory Error S:1/10 = 0
Load Memory Module Always S:1/11 = 0
On Power up Go To Run (Mode Behavior) S:1/12 = 0
Program Compare S:2/9 = 0
Data File Overwrite Protection Lost S:36/10 = 0

Forces

Forces Enabled S:1/5 = Yes
Forces Installed S:1/6 = No

Offset	EN	TT	DN	BASE	PRE	ACC	(Symbol)	Description
T4:0	0	0	0	1.0 sec	0	5	Pump Start Delay	
T4:1	0	0	0	1.0 sec	0	5	Pump Start Delay	
T4:2	0	0	0	1.0 sec	0	5	Indictor Delay	
T4:3	0	0	0	1.0 sec	0	5	Indictor Interrupt	

Offset	CU	CD	DN	OV	UN	UA	PRE	ACC	(Symbol)	Description
C5:0	0	0	0	0	0	0	0	0		

Offset	EN	EU	DN	EM	ER	UL	IN	FD	LEN	POS	(Symbol)	Description
R6:0	0	0	0	0	0	0	0	0	0	0		

TANK LEVEL CONTROL

```
Data File N7 (dec)  --  INTEGER
```

Offset	0	1	2	3	4	5	6	7	8	9
N7:0	0									

Offset	0	1	2	3	4
F8:0	0				

Address/Symbol Database

Address	Symbol	Scope	Description	Sym Group	Dev. Code	ABV	BLW
B3:0/0	LP_SWITCH	Global	LP_SWITCH				
B3:0/1	HP_SWITCH	Global	HP_SWITCH				
B3:0/2	INDICATOR_LIGHT	Global	Pressure Indicator Light				
B3:0/3	PRESSURE_PUMP	Global	Pressure Pump				
B3:0/4			ONS				
B3:0/5	START_PUMP	Global	Pump Start Mode				
B3:0/6			ONS				
B3:0/7	STOP_PUMP	Global	Pump Stop Mode				
B3:0/8			ONS				
B3:0/9			Indicator On				
B3:0/10			Indicator Interrupt				
B3:0/11			ONS				
I:0/0			LP Switch Input				
I:0/1			HP Switch Input				
O:0/0			Pressure Indicator Light Output				
O:0/1			Pressure Pump Output				
T4:0			Pump Start Delay				
T4:0/0	DELYA_FOR_START	Global	Delay for Start				
T4:0/1	DELAY_FOR_STOP	Global	Delay for Stop				
T4:0/2	DELAY_INDICATOR	Global	Delay Indicator				
T4:0/DN			Pump Start Trigger				
T4:1			Pump Start Delay				
T4:1/0	DELAY_STOP	Global	Delay for Stop				
T4:1/DN	DELAY_START	Global	Delay STOP				
T4:2			Indictor Delay				
T4:2/DN			Delay Indicator				
T4:3			Indictor Interrupt				
T4:3/0			Indicator Interrupt Delay				
T4:3/DN			Indicator Interrupt				
U:3	INPUTS	Global	LAD 3 Inputs				
U:4	OUTPUTS	Global	LAD 4 Outputs				
U:5	ALARMS	Global	LAD 5 Alarms				
U:6	CONTROLS	Global	LAD 6 Controls				

Address	Instruction	Description
---------	-------------	-------------

Group_Name	Description
------------	-------------