

RSLogix Micro Project Report



Processor Type: Bul.1763 MicroLogix 1100 Series B

Processor Name: UNTITLED

Total Memory Used: 224 Instruction Words Used - 63 Data Table Words Used

Total Memory Left: 6432 Instruction Words Left

Program Files: 6

Data Files: 9

Program ID: 9286

I/O Configuration

0	Bul.1763	MicroLogix 1100 Series B
1		
2		
3		
4		

Channel Configuration

CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex

CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Edit Resource/Owner Timeout: 60
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Passthru Link ID: 1
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Write Protected: No
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Comms Servicing Selection: Yes
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex Message Servicing Selection: Yes
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex 1st AWA Append Character: \d
CHANNEL 0 (SYSTEM) - Driver: DF1 Full Duplex 2nd AWA Append Character: \a

Source ID: 1 (decimal)
Baud: 19200
Parity: NONE
Control Line : No Handshaking
Error Detection: CRC
Embedded Responses: Auto Detect
Duplicate Packet Detect: Yes
ACK Timeout(x20 ms): 50
NAK Retries: 3
ENQ Retries: 3

CHANNEL 1 (SYSTEM) - Driver: Ethernet


CHANNEL 1 (SYSTEM) - Driver: Ethernet Edit Resource/Owner Timeout: 60
CHANNEL 1 (SYSTEM) - Driver: Ethernet Passthru Link ID: 1
CHANNEL 1 (SYSTEM) - Driver: Ethernet Write Protected: No
CHANNEL 1 (SYSTEM) - Driver: Ethernet Comms Servicing Selection: Yes
CHANNEL 1 (SYSTEM) - Driver: Ethernet Message Servicing Selection: Yes


Hardware Address: 00:00:00:00:00:00
IP Address: 0.0.0.0
Subnet Mask: 0.0.0.0
Gateway Address: 0.0.0.0
Msg Connection Timeout (x 1mS): 15000
Msg Reply Timeout (x mS): 3000
Inactivity Timeout (x Min): 30
Bootp Enable: Yes
Dhcp Enable No
SNMP Enable: No
HTTP Enable: Yes
Auto Negotiate Enable: Yes
Port Speed Enable: 10/100 Mbps Full Duplex/Half Duplex
Contact:
Location:


Program File List


Name	Number	Type	Rungs	Debug	Bytes
[SYSTEM]	0	SYS	0	No	0
	1	SYS	0	No	0
MAIN	2	LADDER	4	No	30
I/OS	3	LADDER	8	No	115
CONTROLS	4	LADDER	11	No	346
VLV STATUS	5	LADDER	6	No	223


SERVO MOTOR POSITION							
Data File List							
Name	Number	Type	Scope	Debug	Words	Elements	Last
OUTPUT	0	O	Global	No	12	4	O:3
INPUT	1	I	Global	No	18	6	I:5
STATUS	2	S	Global	No	0	66	S:65
BINARY	3	B	Global	No	8	8	B3:7
TIMER	4	T	Global	No	15	5	T4:4
COUNTER	5	C	Global	No	3	1	C5:0
CONTROL	6	R	Global	No	3	1	R6:0
INTEGER	7	N	Global	No	2	2	N7:1
FLOAT	8	F	Global	No	2	1	F8:0

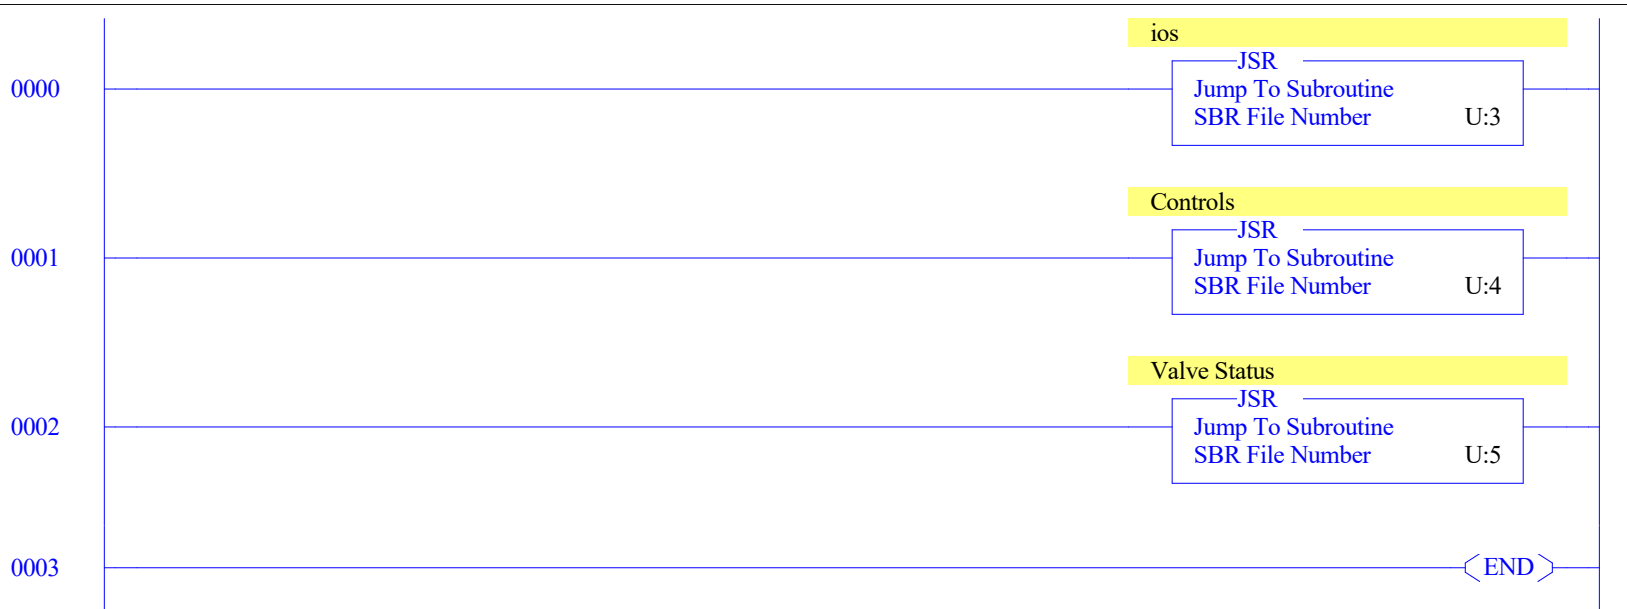


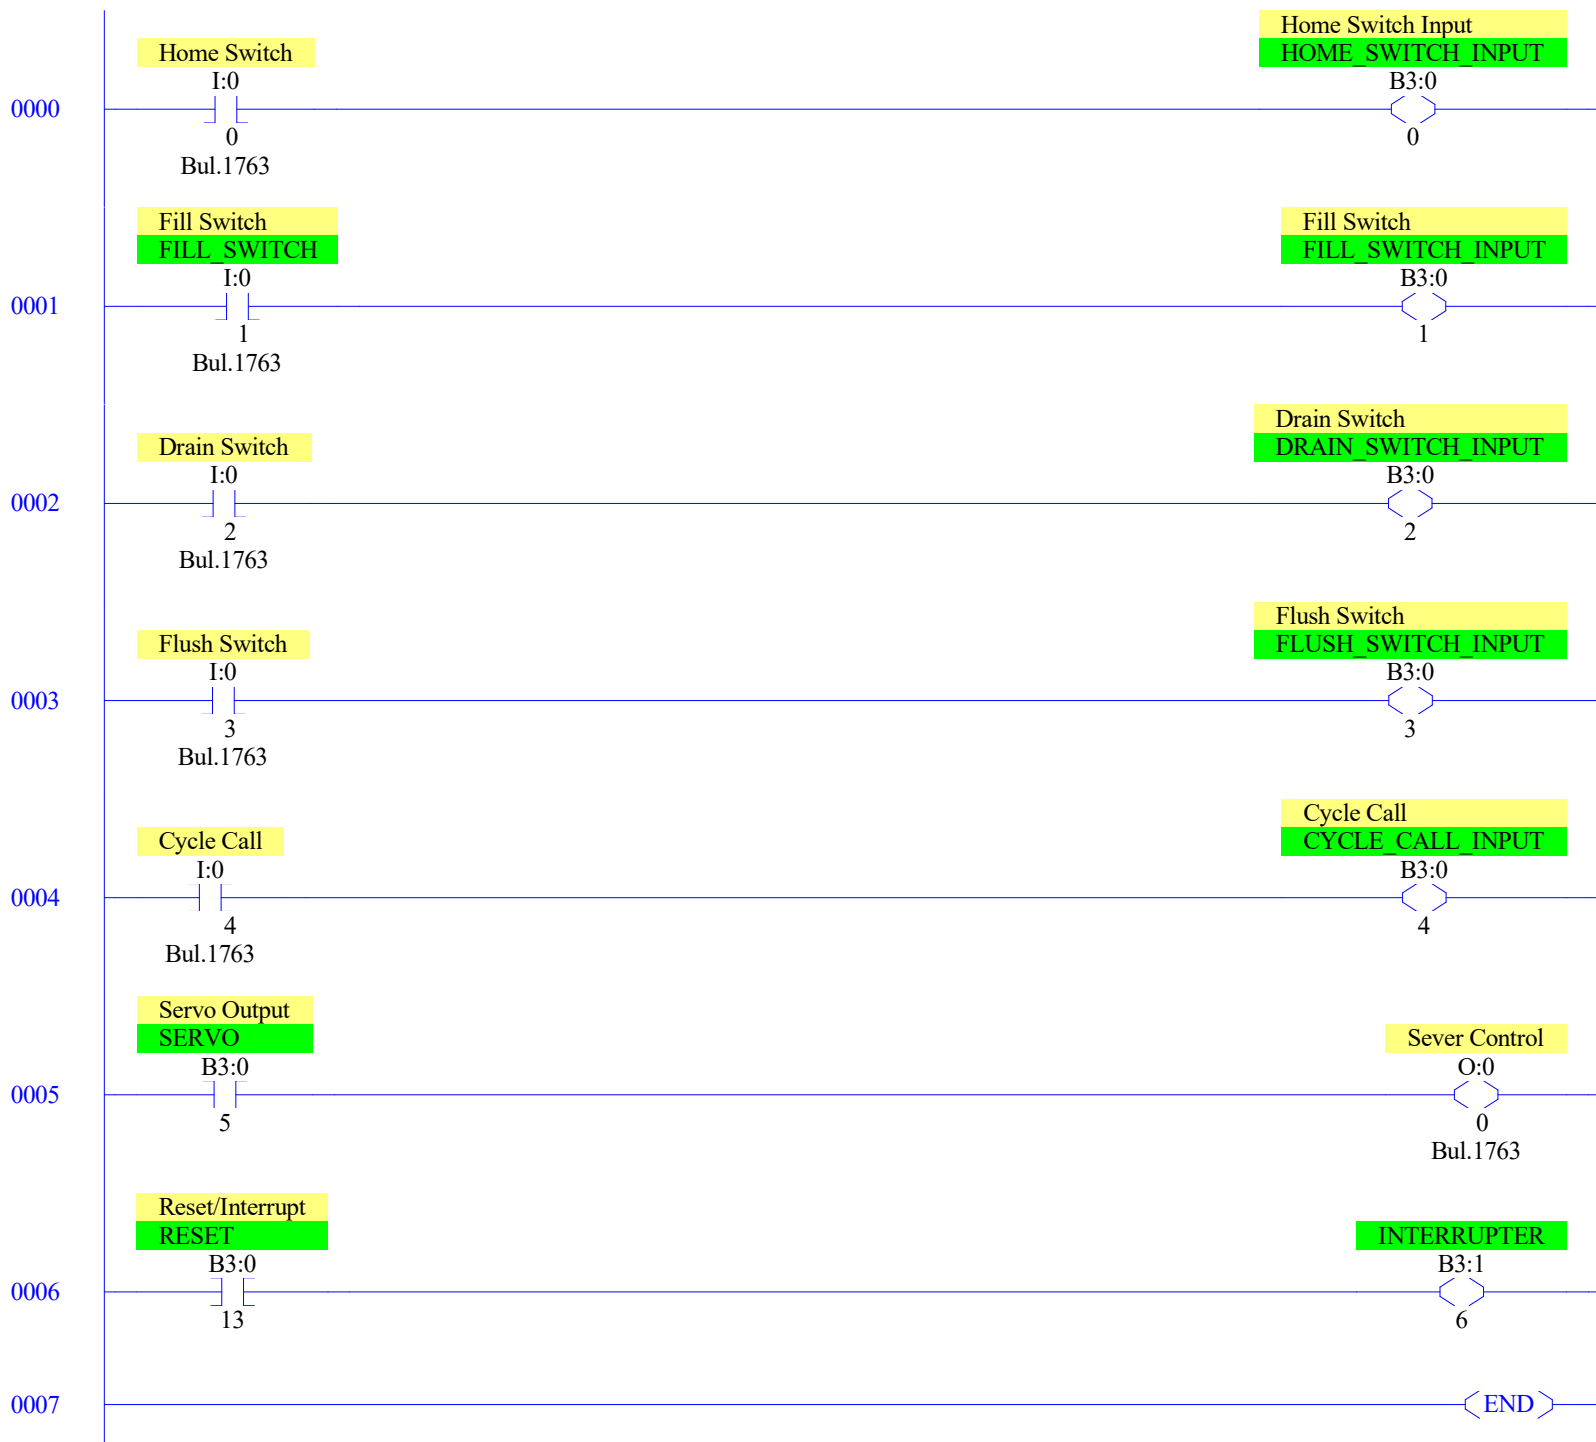


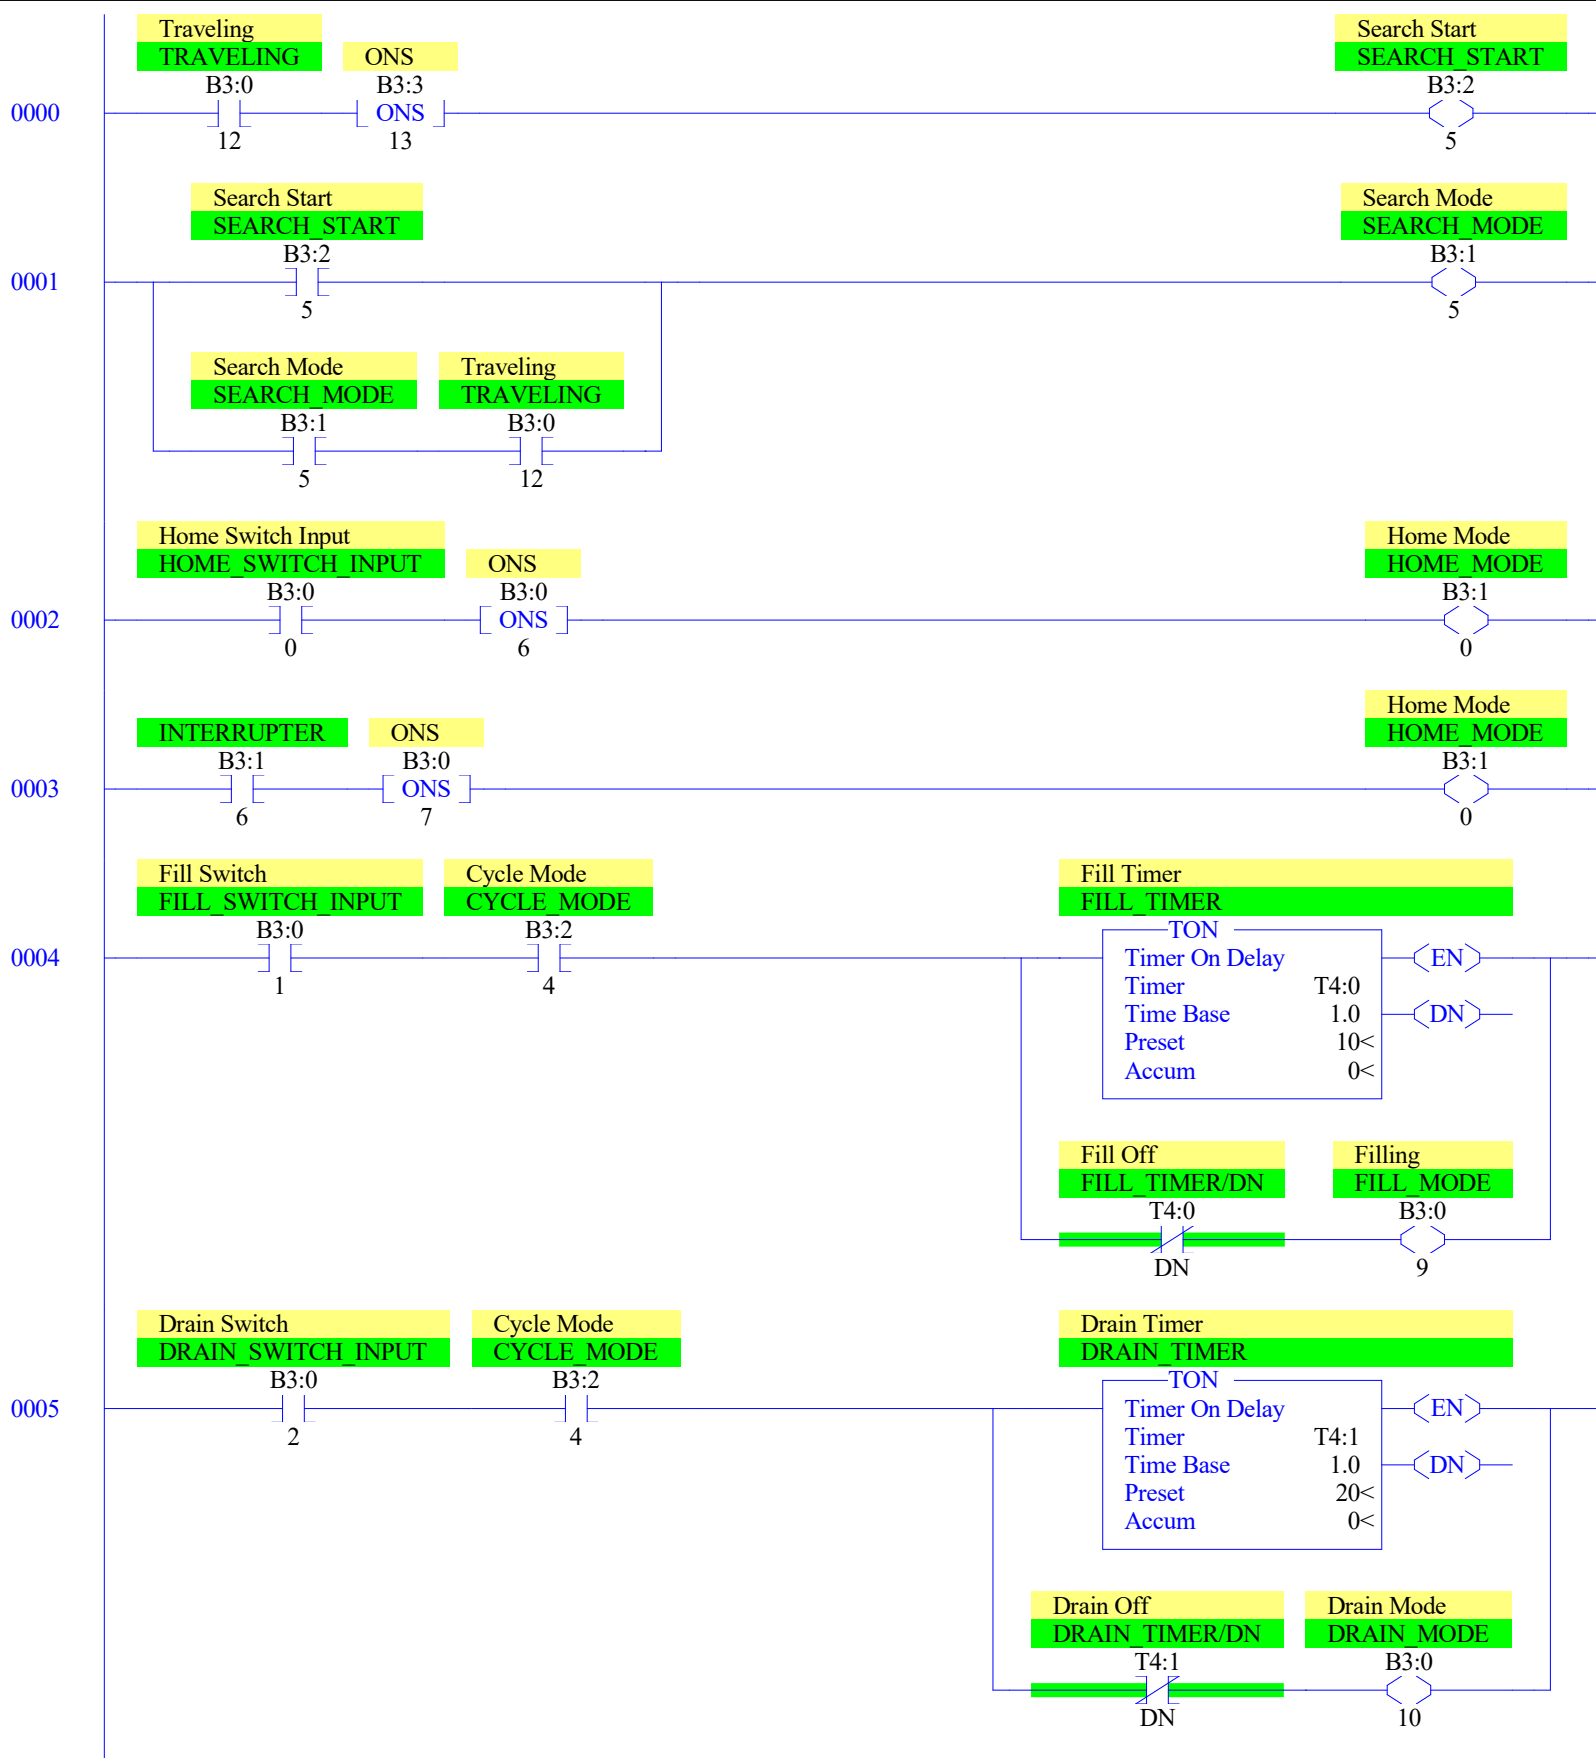

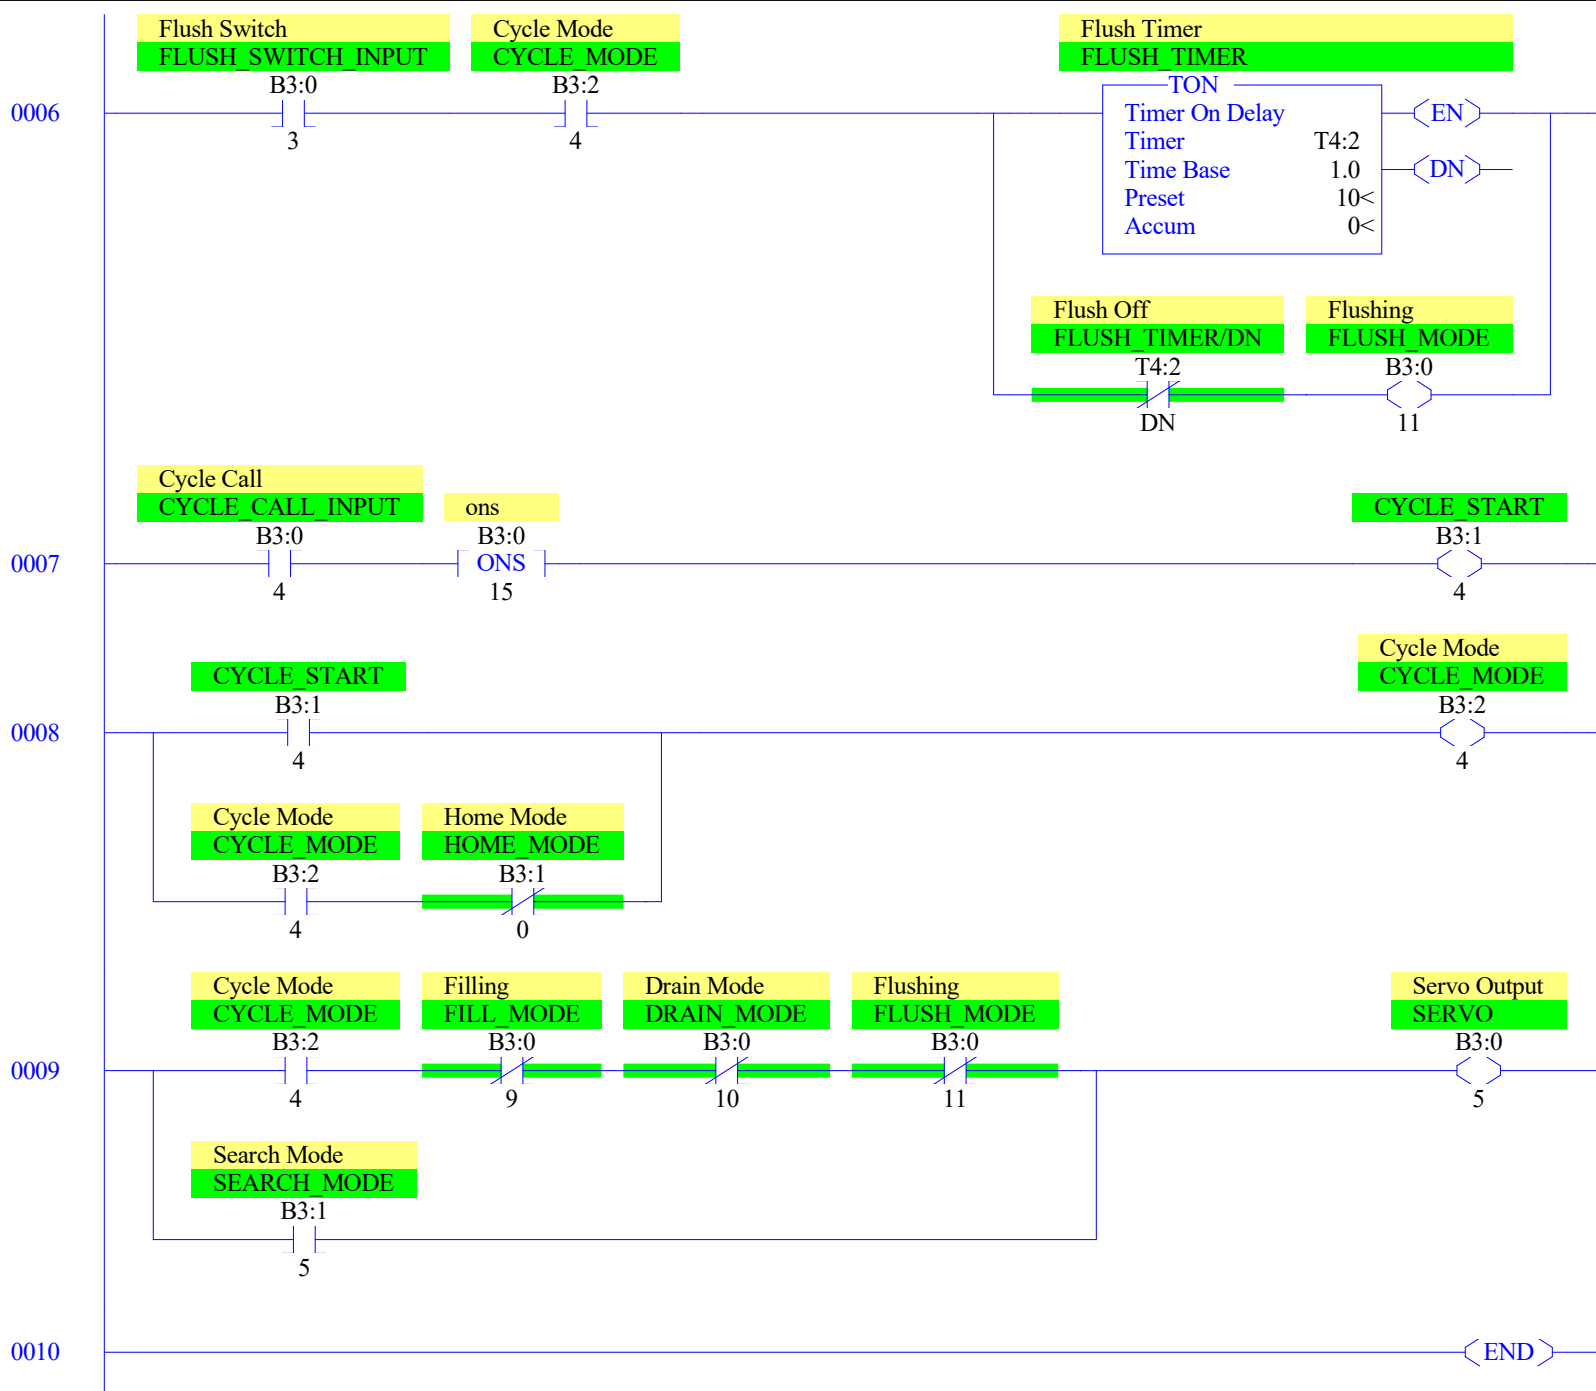

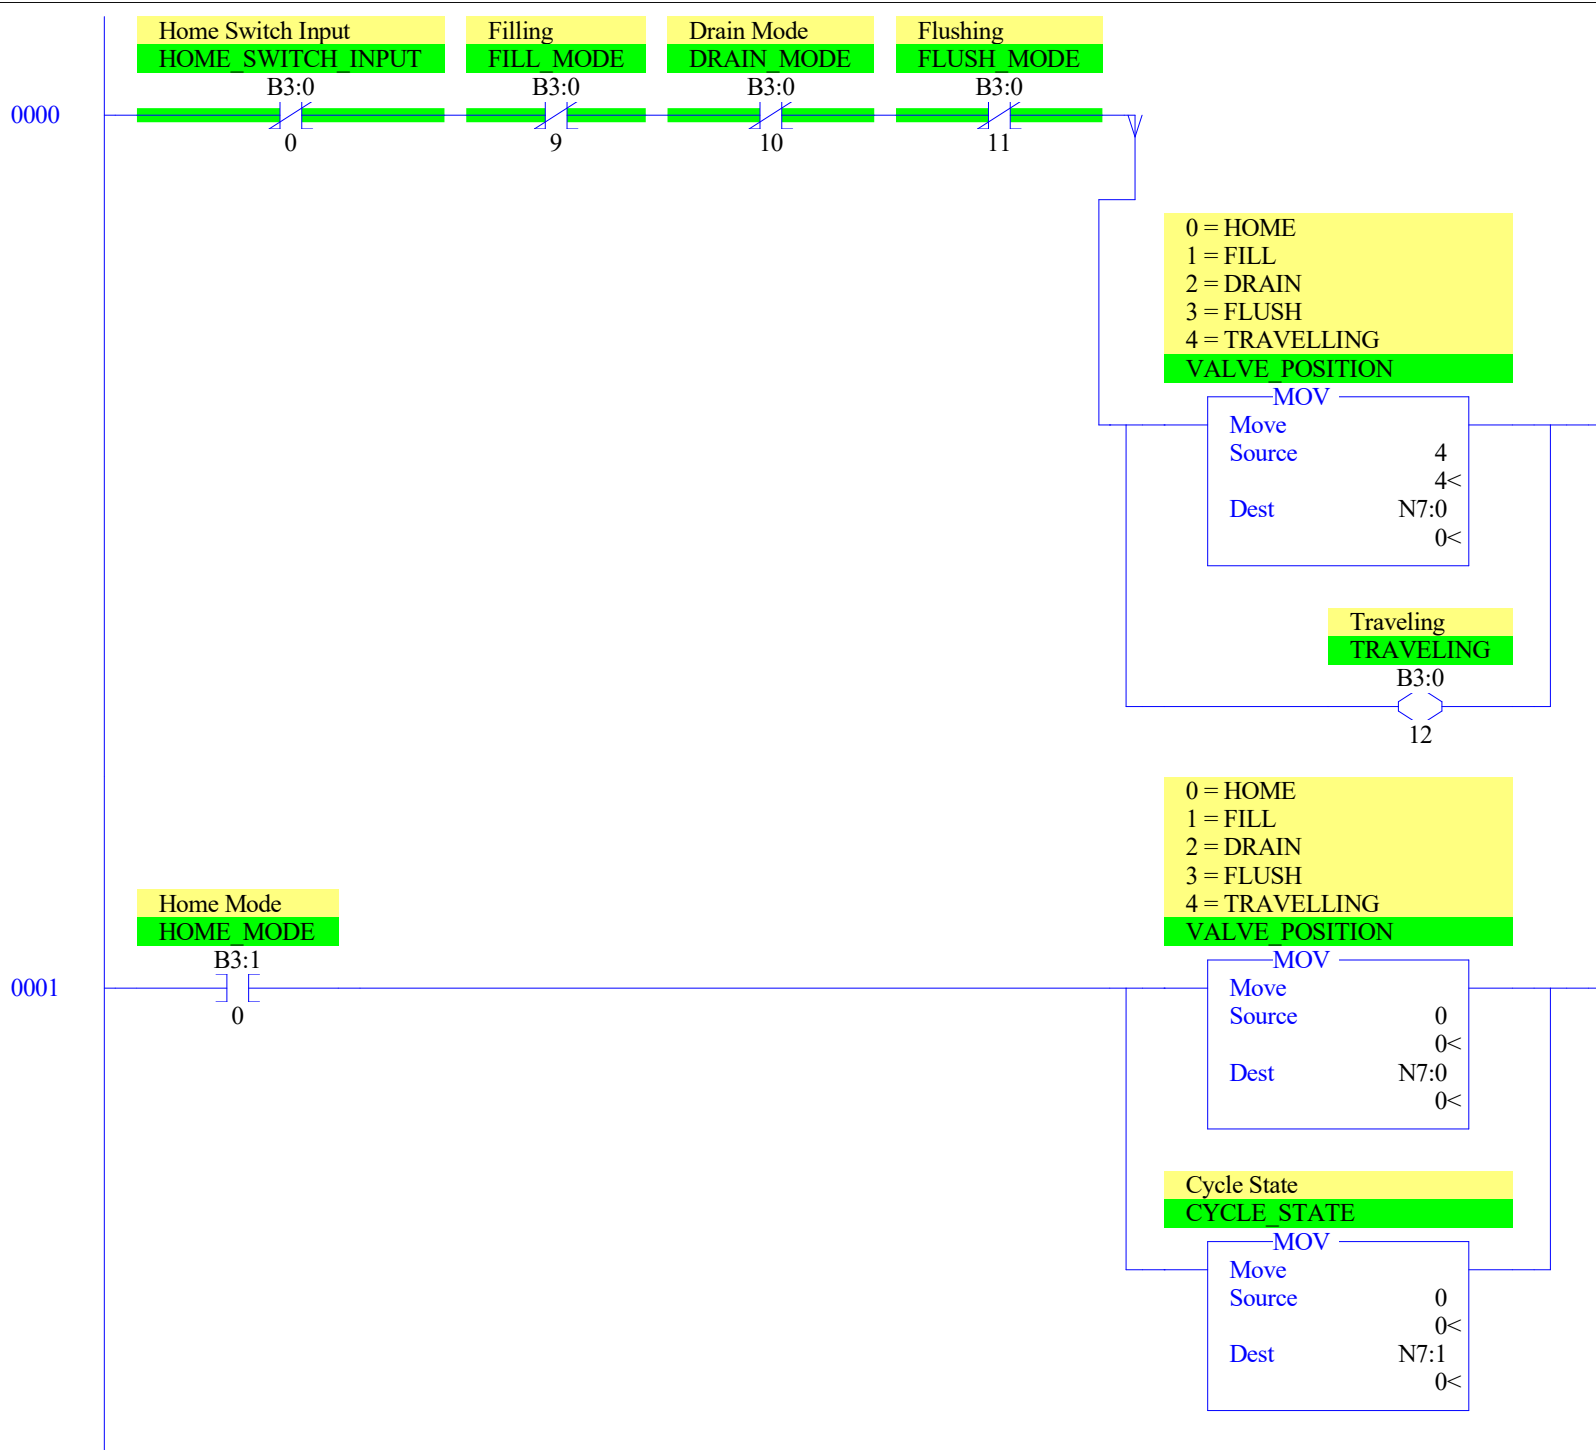

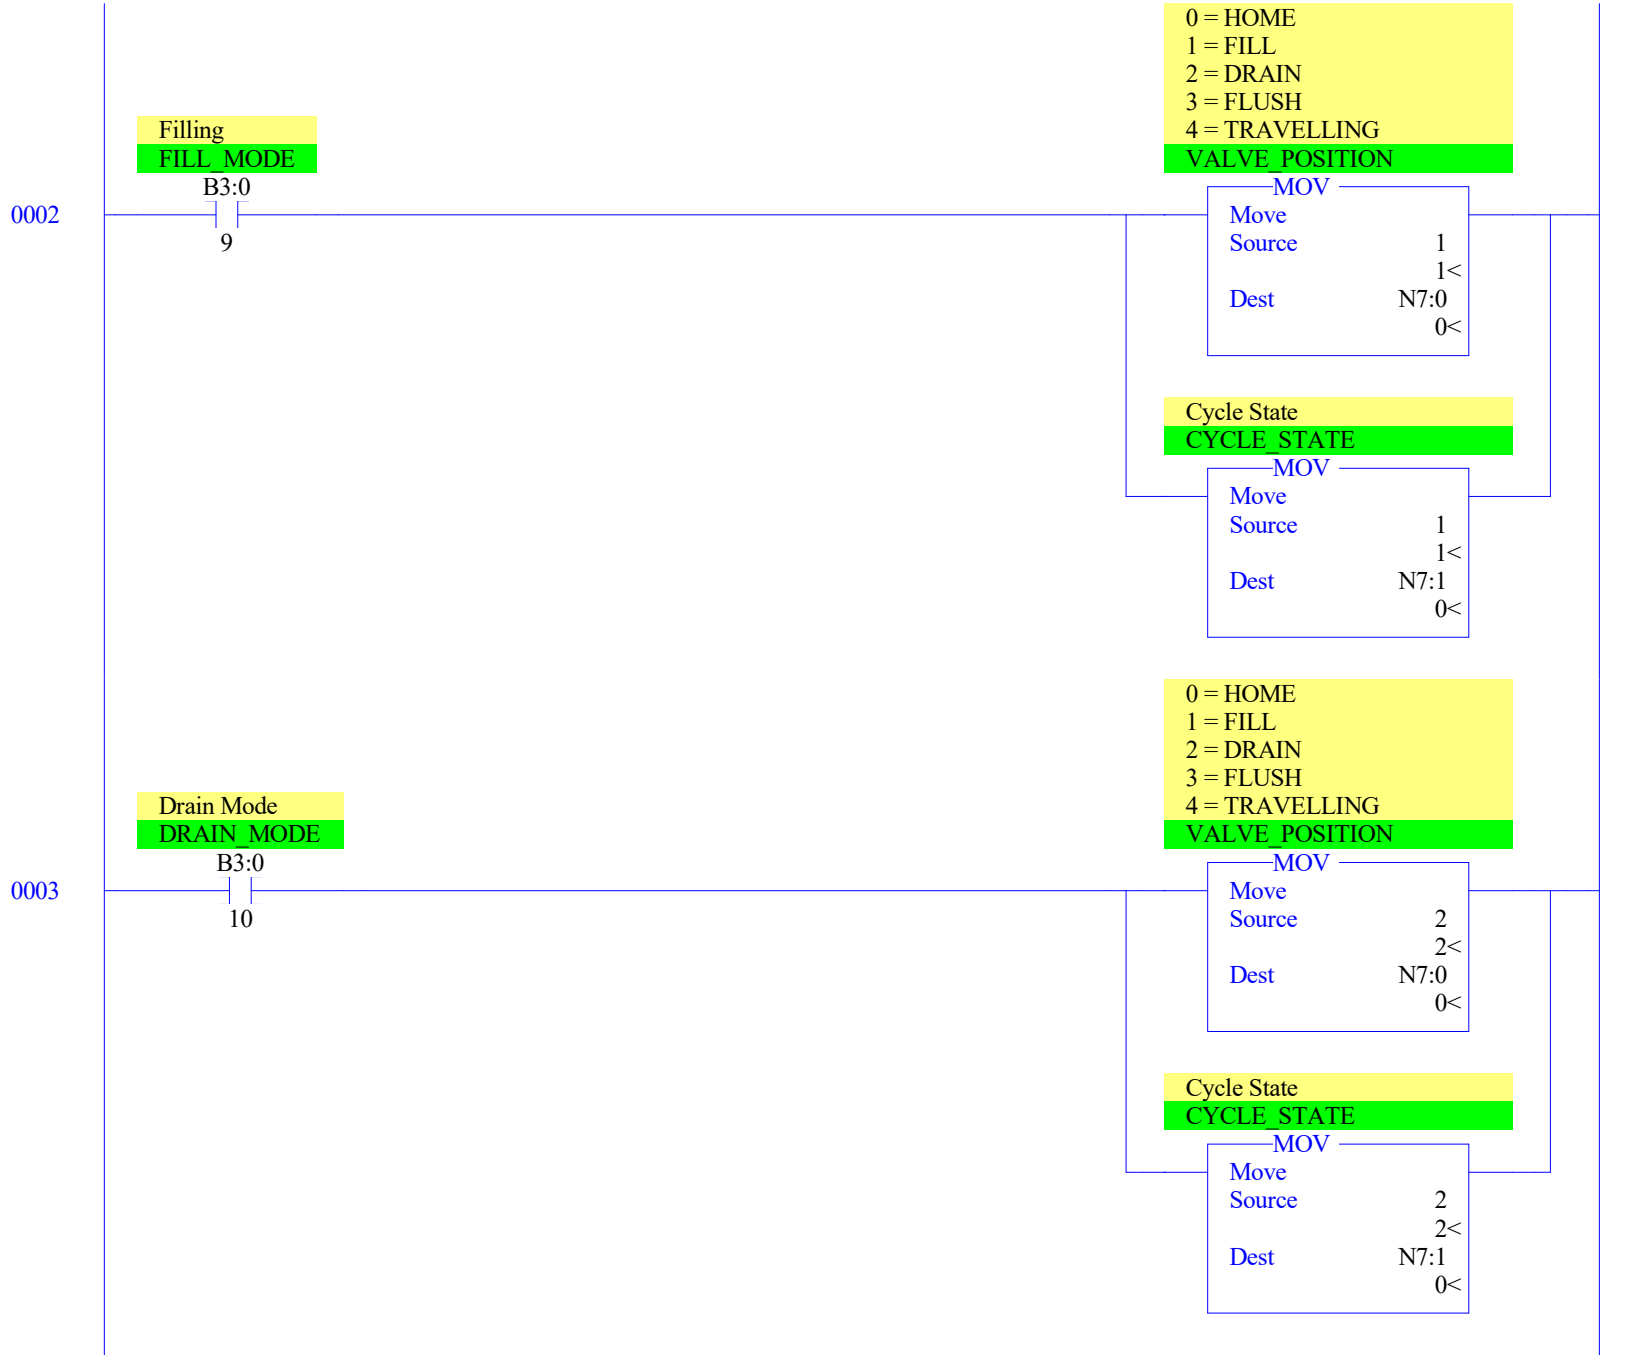

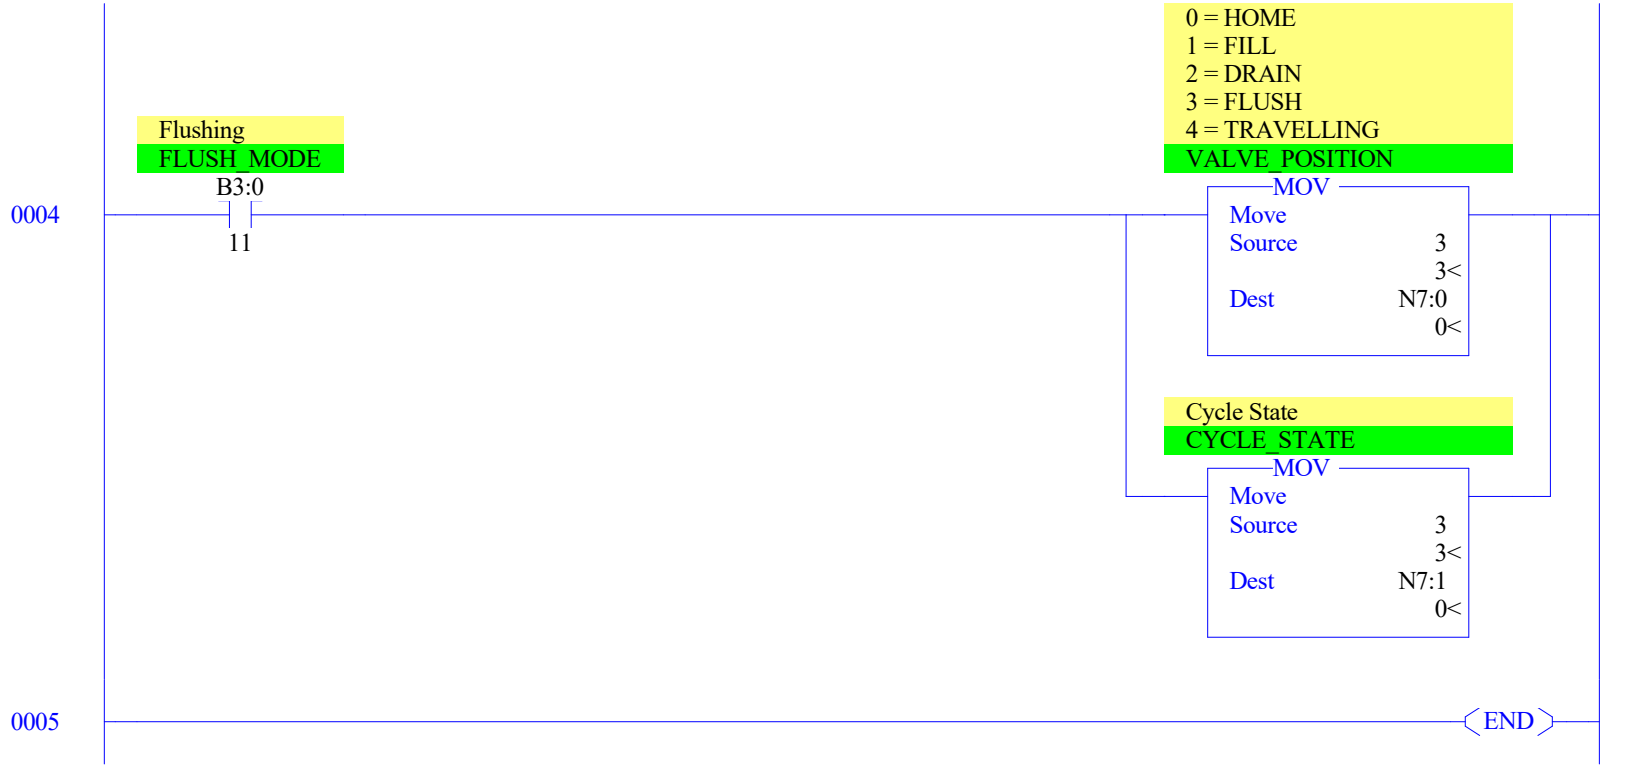

SERVO MOTOR POSITION																	Data File 00 (bin)	--	OUTPUT
Offset	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0			
O:0.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763		MicroLogix 1100 Series B
O:0.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763		MicroLogix 1100 Series B
O:0.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763		MicroLogix 1100 Series B
O:0.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763		MicroLogix 1100 Series B

SERVO MOTOR POSITION																
Data File I1 (bin) -- INPUT																
Offset	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
I:0.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763
I:0.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763
I:0.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763
I:0.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763
I:0.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763
I:0.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	Bul.1763
																MicroLogix 1100 Series B
																MicroLogix 1100 Series B
																MicroLogix 1100 Series B
																MicroLogix 1100 Series B
																MicroLogix 1100 Series B-Analog
																MicroLogix 1100 Series B-Analog

Main

Processor Mode S:1/0 - S:1/4 = Remote Program Mode
On Power up Go To Run (Mode Behavior) S:1/12 = 0
First Pass S:1/15 = No
Free Running Clock S:4 = 0000-0000-0000-0000

Proc

OS Catalog Number S:57 = 1100 User Program Type S:63 = 8001h
OS Series S:58 = A Compiler Revision Number S:64 =
OS FRS S:59 =
Processor Catalog Number S:60 =
Processor Series S:61 = A
Processor FRN S:62 =

Scan Times

Maximum (x10 ms) S:22 = 0
Watchdog (x10 ms) S:3 (high byte) = 10
Last 100 uSec Scan Time S:35 = 0
Scan Toggle Bit S:33/9 = 0

Math

Math Overflow Selected S:2/14 = 0 Math Register (lo word) S:13 = 0
Overflow Trap S:5/0 = 0 Math Register (high word) S:14-S:13 = 0
Carry S:0/0 = 0 Math Register (32 Bit) S:14-S:13 = 0
Overflow S:0/1 = 0
Zero Bit S:0/2 = 0
Sign Bit S:0/3 = 0

Chan 0

Processor Mode S:1/0- S:1/4 = Remote Program Mode
Node Address S:15 (low byte) = 0 Outgoing Msg Cmd Pending S:33/2 = 0
Baud Rate S:15 (high byte) = ?
Channel Mode S:33/3 = 0
Comms Active S:33/4 = 0
Incoming Cmd Pending S:33/0 = 0
Msg Reply Pending S:33/1 = 0

Debug

Suspend Code S:7 = 0
Suspend File S:8 = 0

Errors

Fault Override At Power Up S:1/8 = 0 Fault Routine S:29 = 0
Startup Protection Fault S:1/9 = 0 Major Error S:6 = 0h
Major Error Halt S:1/13 = 0
Overflow Trap S:5/0 = 0 Error Description:
Control Register Error S:5/2 = 0
Major Error Executing User Fault Rtn. S:5/3 = 0
Battery Low S:5/11 = 0
Input Filter Selection Modified S:5/13 = 0
ASCII String Manipulation error S:5/15 = 0

Protection

Deny Future Access S:1/14 = No
Data File Overwrite Protection Lost S:36/10 = False

Mem Module

Memory Module Loaded On Boot S:5/8 = 0
Password Mismatch S:5/9 = 0
Load Memory Module On Memory Error S:1/10 = 0
Load Memory Module Always S:1/11 = 0
On Power up Go To Run (Mode Behavior) S:1/12 = 0
Program Compare S:2/9 = 0
Data File Overwrite Protection Lost S:36/10 = 0

Forces

Forces Enabled S:1/5 = Yes
Forces Installed S:1/6 = No

SERVO MOTOR POSITION																	
Data File B3 (bin) -- BINARY																	
Offset	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	(Symbol) Description
B3:0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
B3:1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
B3:2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
B3:3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
B3:4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
B3:5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
B3:6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
B3:7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Offset	EN	TT	DN	BASE	PRE	ACC	(Symbol)	Description
T4:0	0	0	0	1.0 sec	10	0	(FILL_TIMER)	Fill Timer
T4:1	0	0	0	1.0 sec	20	0	(DRAIN_TIMER)	Drain Timer
T4:2	0	0	0	1.0 sec	10	0	(FLUSH_TIMER)	Flush Timer
T4:3	0	0	0	.01 sec	0	0		
T4:4	0	0	0	.01 sec	0	0		

Offset	CU	CD	DN	OV	UN	UA	PRE	ACC	(Symbol)	Description
C5:0	0	0	0	0	0	0	0	0		

Offset	EN	EU	DN	EM	ER	UL	IN	FD	LEN	POS	(Symbol)	Description
R6:0	0	0	0	0	0	0	0	0	0	0		

Offset	0	1	2	3	4
F8:0	0				

Address/Symbol Database

Address	Symbol	Scope	Description	Sym Group	Dev. Code
B3:0/0	HOME_SWITCH_INPUT	Global	Home Switch Input		
B3:0/1	FILL_SWITCH_INPUT	Global	Fill Switch		
B3:0/2	DRAIN_SWITCH_INPUT	Global	Drain Switch		
B3:0/3	FLUSH_SWITCH_INPUT	Global	Flush Switch		
B3:0/4	CYCLE_CALL_INPUT	Global	Cycle Call		
B3:0/5	SERVO	Global	Servo Output		
B3:0/6			ONS		
B3:0/7			ONS		
B3:0/8			ONS		
B3:0/9	FILL_MODE	Global	Filling		
B3:0/10	DRAIN_MODE	Global	Drain Mode		
B3:0/11	FLUSH_MODE	Global	Flushing		
B3:0/12	TRAVELING	Global	Traveling		
B3:0/13	RESET	Global	Reset/Interrupt		
B3:0/14			ons		
B3:0/15			ons		
B3:1/0	HOME_MODE	Global	Home Mode		
B3:1/1	START_FILL	Global	START FILL		
B3:1/2	START_DRAIN	Global	START DRAINING		
B3:1/3	START_FLUSH	Global	Start Flush		
B3:1/4	CYCLE_START	Global			
B3:1/5	SEARCH_MODE	Global	Search Mode		
B3:1/6	INTERRUPTER	Global			
B3:2/1			ONS		
B3:2/2			ons draining		
B3:2/4	CYCLE_MODE	Global	Cycle Mode		
B3:2/5	SEARCH_START	Global	Search Start		
B3:3/13			ONS		
I:0/0			Home Switch		
I:0/1	FILL_SWITCH	Global	Fill Switch		
I:0/2			Drain Switch		
I:0/3			Flush Switch		
I:0/4			Cycle Call		
N7:0	VALVE_POSITION	Global	0 = HOME 1 = FILL 2 = DRAIN 3 = FLUSH 4 = TRAVELLING		
N7:1	CYCLE_STATE	Global	Cycle State		
O:0/0			Sever Control		
T4:0	FILL_TIMER	Global	Fill Timer		
T4:0/DN			Fill Off		
T4:1	DRAIN_TIMER	Global	Drain Timer		
T4:1/DN			Drain Off		
T4:2	FLUSH_TIMER	Global	Flush Timer		
T4:2/DN			Flush Off		
U:3			I/OS		
U:4			Controls		
U:5			Valve Status		
U:3	U3	Global	I/Os		
U:3			ios		
U:4			Controls		
U:5			Valve Status		

Address	Instruction	Description
---------	-------------	-------------

Group_Name	Description
------------	-------------