


UPPER LEVEL PLAN
SCALE: 1/4"=1'-0"

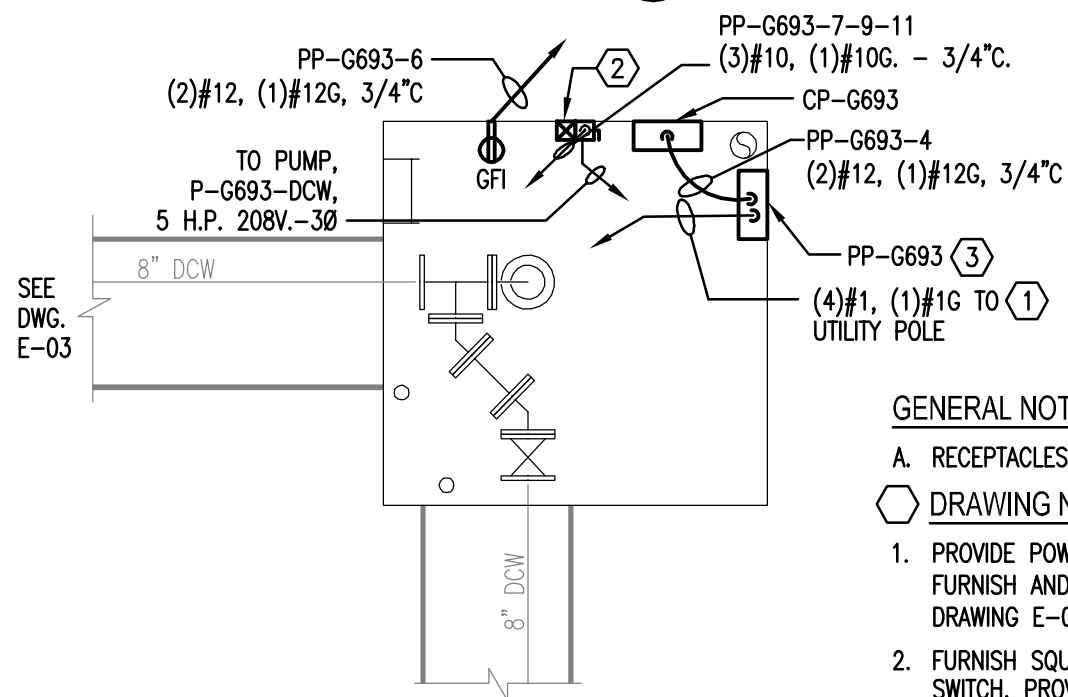


MID LEVEL PLAN
SCALE: 1/4"=1'-0"

GENERAL NOTES:

A. RECEPTACLES SHALL BE MOUNTED 48" MINIMUM ABOVE UTILIDOR (OR VAULT) FLOOR.

DRAWING NOTES:

1. PROVIDE POWER TO PANELBOARD FROM UTILITY POLE (TO BE DETERMINED, SEE DRAWING G-01). FURNISH AND INSTALL ELECTRICAL SERVICE PER UTILIDOR SERVICE CONNECTION DETAIL (REFERENCE DRAWING E-07).
2. FURNISH SQUARE D MODEL 8538SCW12V02CS COMBINATION STARTER WITH FUSIBLE-TYPE DISCONNECT SWITCH. PROVIDE 5 HP RECIRCULATION PUMP CONNECTED TO PANEL PP-G693 AS SHOWN ON DRAWINGS.
3. FURNISH PANELBOARD PP-G693 WITH NEMA 4X ENCLOSURE AND CIRCUIT BREAKERS AS INDICATED ON PANELBOARD SCHEDULE (SEE DRAWING E-06).

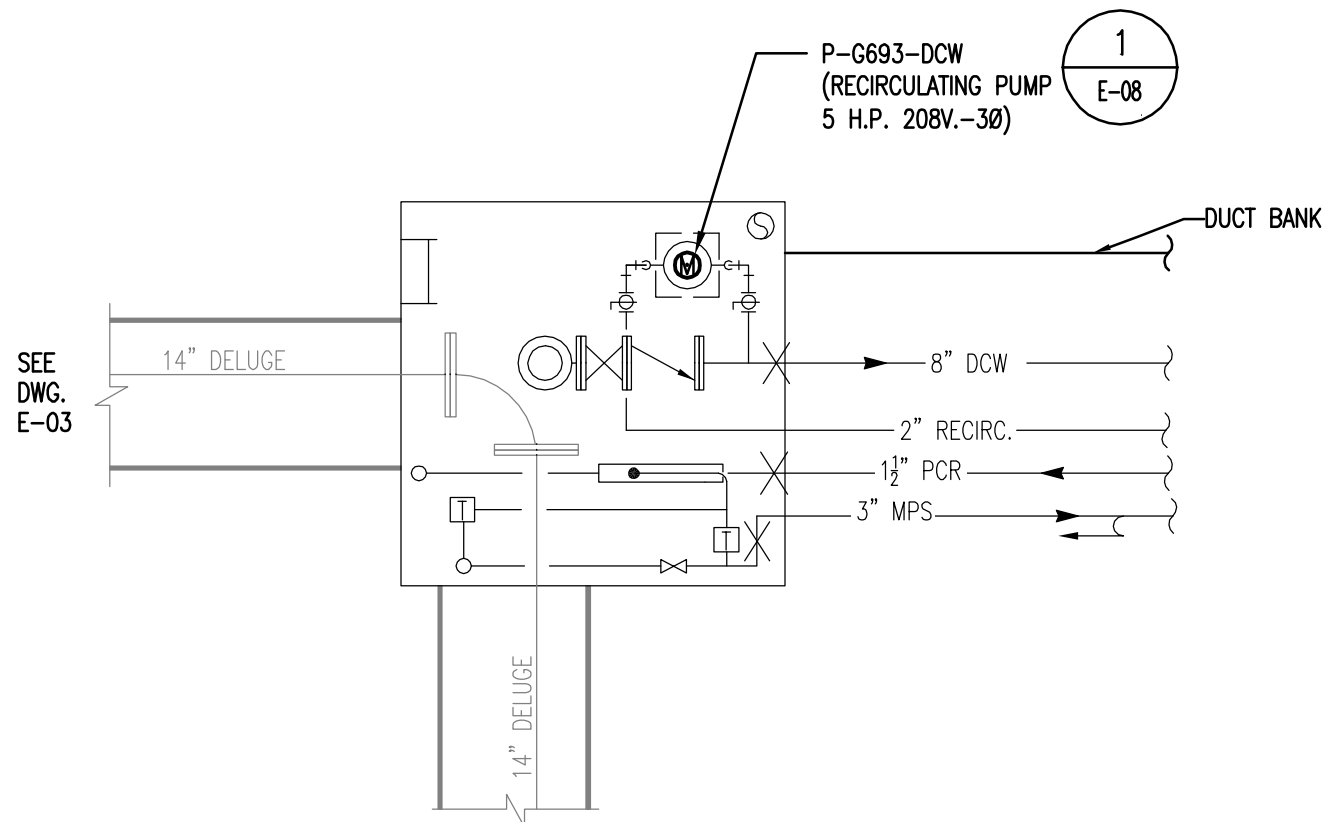

LOWER LEVEL PLAN
SCALE: 1/4"=1'-0"

REV. NO.	DATE	DESCRIPTION
	04/09/10	ISSUED FOR CONSTRUCTION

FOSDICK & HILMER CONSULTING ENGINEERS
309 VINE STREET, SUITE 50
TELEPHONE (513)241-5640



Jimmy Huntington Building
714 Fourth Avenue, Suite 20
Fairbanks, Alaska 99701
Telephone (907) 455-1500
Fax (907) 455-6788

Date: 19 FEB 2010
Scale: 1/4"=1'-0"
Designed By: JRS
Drawn By: RHW
Checked By: EAE

UTILITY SERVICE EXTENSION TO AIRCRAFT PARTS STORAGE
NEW VAULT G6-9-3
FORT WAINWRIGHT, AK.
DU PROJECT NO. J101395, J101396, J101397

Drawing No.

E-04