


HYDRANT LATERAL CONCRETE BLOCK PIPE SUPPORT DETAIL

SCALE: 3/4"=1'-0"

NOTE: PROVIDE A MINIMUM OF TWO
SUPPORTS PER PIPE LENGTH.


1
W004

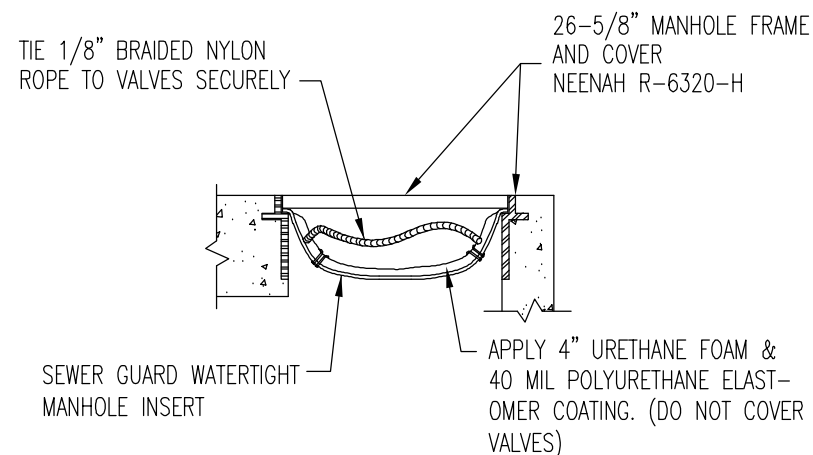

WATERTIGHT MANHOLE FRAME & COVER DETAIL

SCALE: 1/2"=1'-0"

2
W004

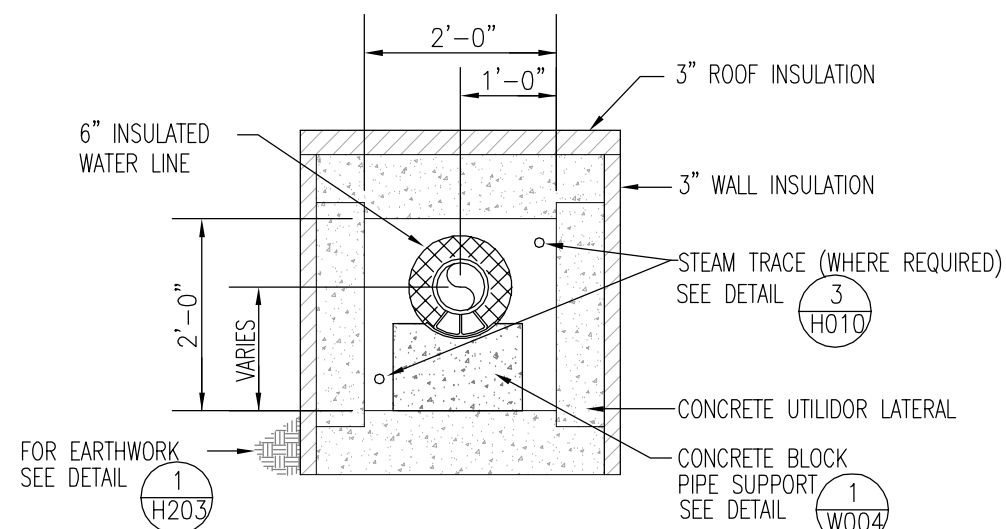

HYDRANT LATERAL SECTION

SCALE: 1/2"=1'-0"

B
W004

NOTE: COORDINATE CUT GROOVE COUPLINGS
WITH STEAM PIPING CLEARANCES.



Jimmy Huntington Building
714 Fourth Avenue, Suite 201
Fairbanks, Alaska 99701
Telephone (907) 455-1500
Fax (907) 455-6788

Date: 14 FEB 2010
Scale: NOTED
Designed By: CDH
Drawn By: MMC
Checked By: NEM

UTILIDOR WATER DISTRIBUTION SYSTEM
LATERAL OFF UTILIDOR
DESIGN & CONSTRUCTION STANDARDS

Drawing No.
UES-DD-W004