


DETAIL 2 OUTDOOR AIR TEMPERATURE TRANSMITTER
N.T.S. PC-04

DETAIL GENERAL NOTE:

A. SEE DOYON UTILITIES STANDARD DRAWING UES-DD-H206 FOR VENT INSTALLATION DETAILS.

DETAIL NOTES:

1. DRILL AND TAP INTAKE VENT PIPE FOR CONNECTION OF DEVICE.

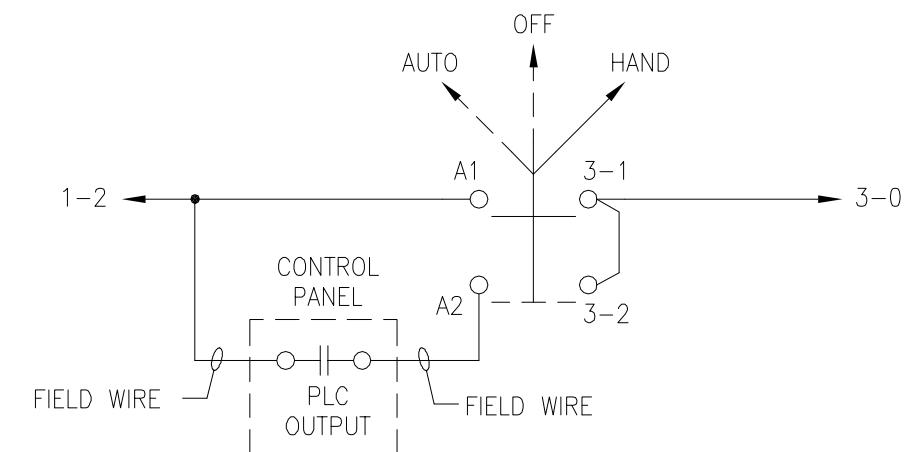

**DETAIL 3 HYDRANT WATER RECIRCULATING PUMP
H-O-A CONTROL**
N.T.S. PC-04

| REV. NO. | DATE | DESCRIPTION |
|----------|----------|-------------------------|
| | 04/09/10 | ISSUED FOR CONSTRUCTION |

FOSDICK & HILMER CONSULTING ENGINEERS
309 VINE STREET, SUITE 50 CINCINNATI, OHIO 45202
TELEPHONE (513)241-5640 WWW.FHENG.COM



Jimmy Huntington Building
714 Fourth Avenue, Suite 20
Fairbanks, Alaska 99701
Telephone (907) 455-1500
Fax (907) 455-6788

Date: 04/09/10
Scale: NTS
Designed By: J.T.
Drawn By: G.N.
Checked By: J.T.

UTILITY SERVICE EXTENSION TO AIRCRAFT PARTS STORAGE
MISCELLANEOUS UTILITY MONITORING DETAILS
FORT WAINWRIGHT, AK.
DU PROJECT NO. J101395, 101396, 101397

Drawing No.
PC-07