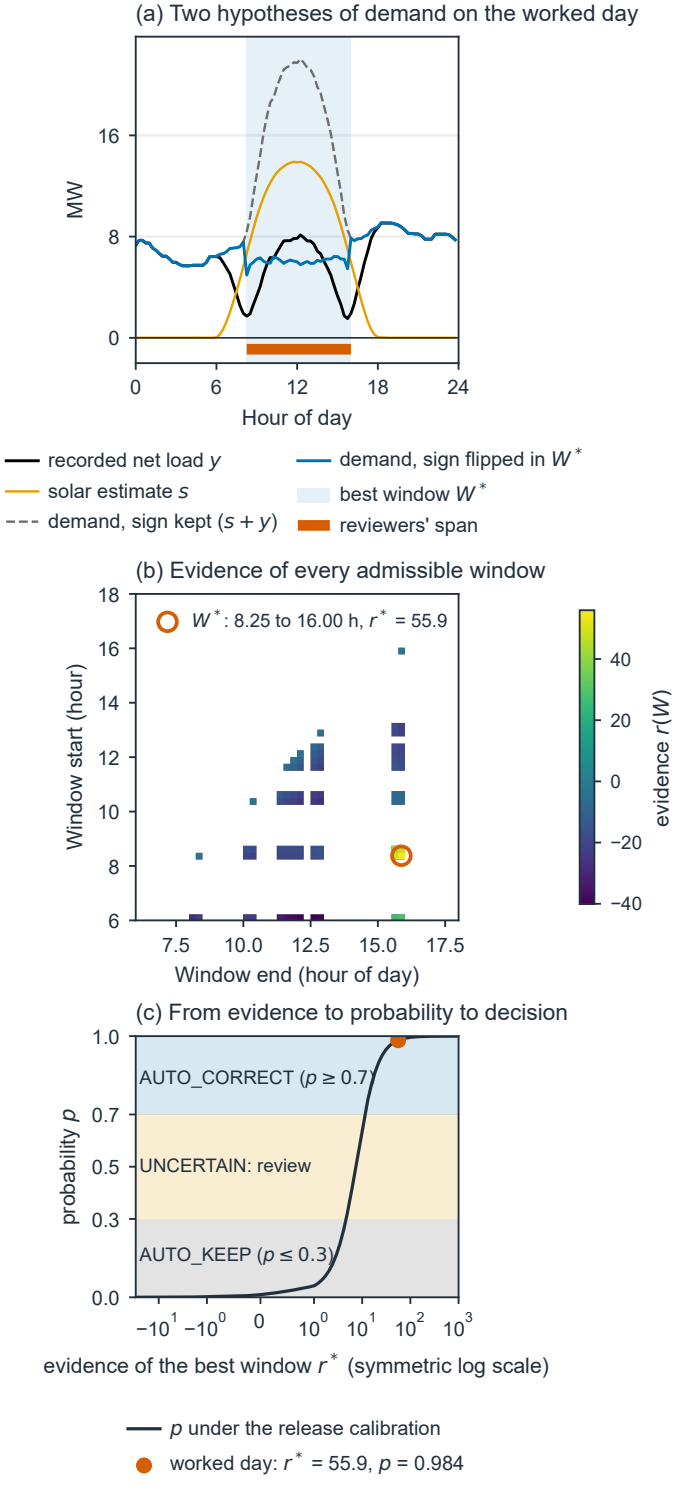

(a) Two hypotheses of demand on the worked day
MW
16
8
0
0
6
12
18
24
Hour of day
recorded net load y
solar estimate s
demand, sign kept (s + y)
demand, sign flipped in W*
best window W*
reviewers' span
(b) Evidence of every admissible window
W*: 8.25 to 16.00 h, r* = 55.9
Window start (hour)
18
16
14
12
10
8
6
7.5
10.0
12.5
15.0
17.5
Window end (hour of day)
evidence r(W)
40
20
0
−20
−40
(c) From evidence to probability to decision
probability p
1.0
0.7
0.5
0.3
0.0
AUTO_CORRECT (p ≥ 0.7)
UNCERTAIN: review
AUTO_KEEP (p ≤ 0.3)
−10^1
−10^0
0
10^0
10^1
10^2
10^3
evidence of the best window r* (symmetric log scale)
p under the release calibration
worked day: r* = 55.9, p = 0.984