


A. Internal hold out test set

Accuracy: 97.75% | Macro F1: 97.35%

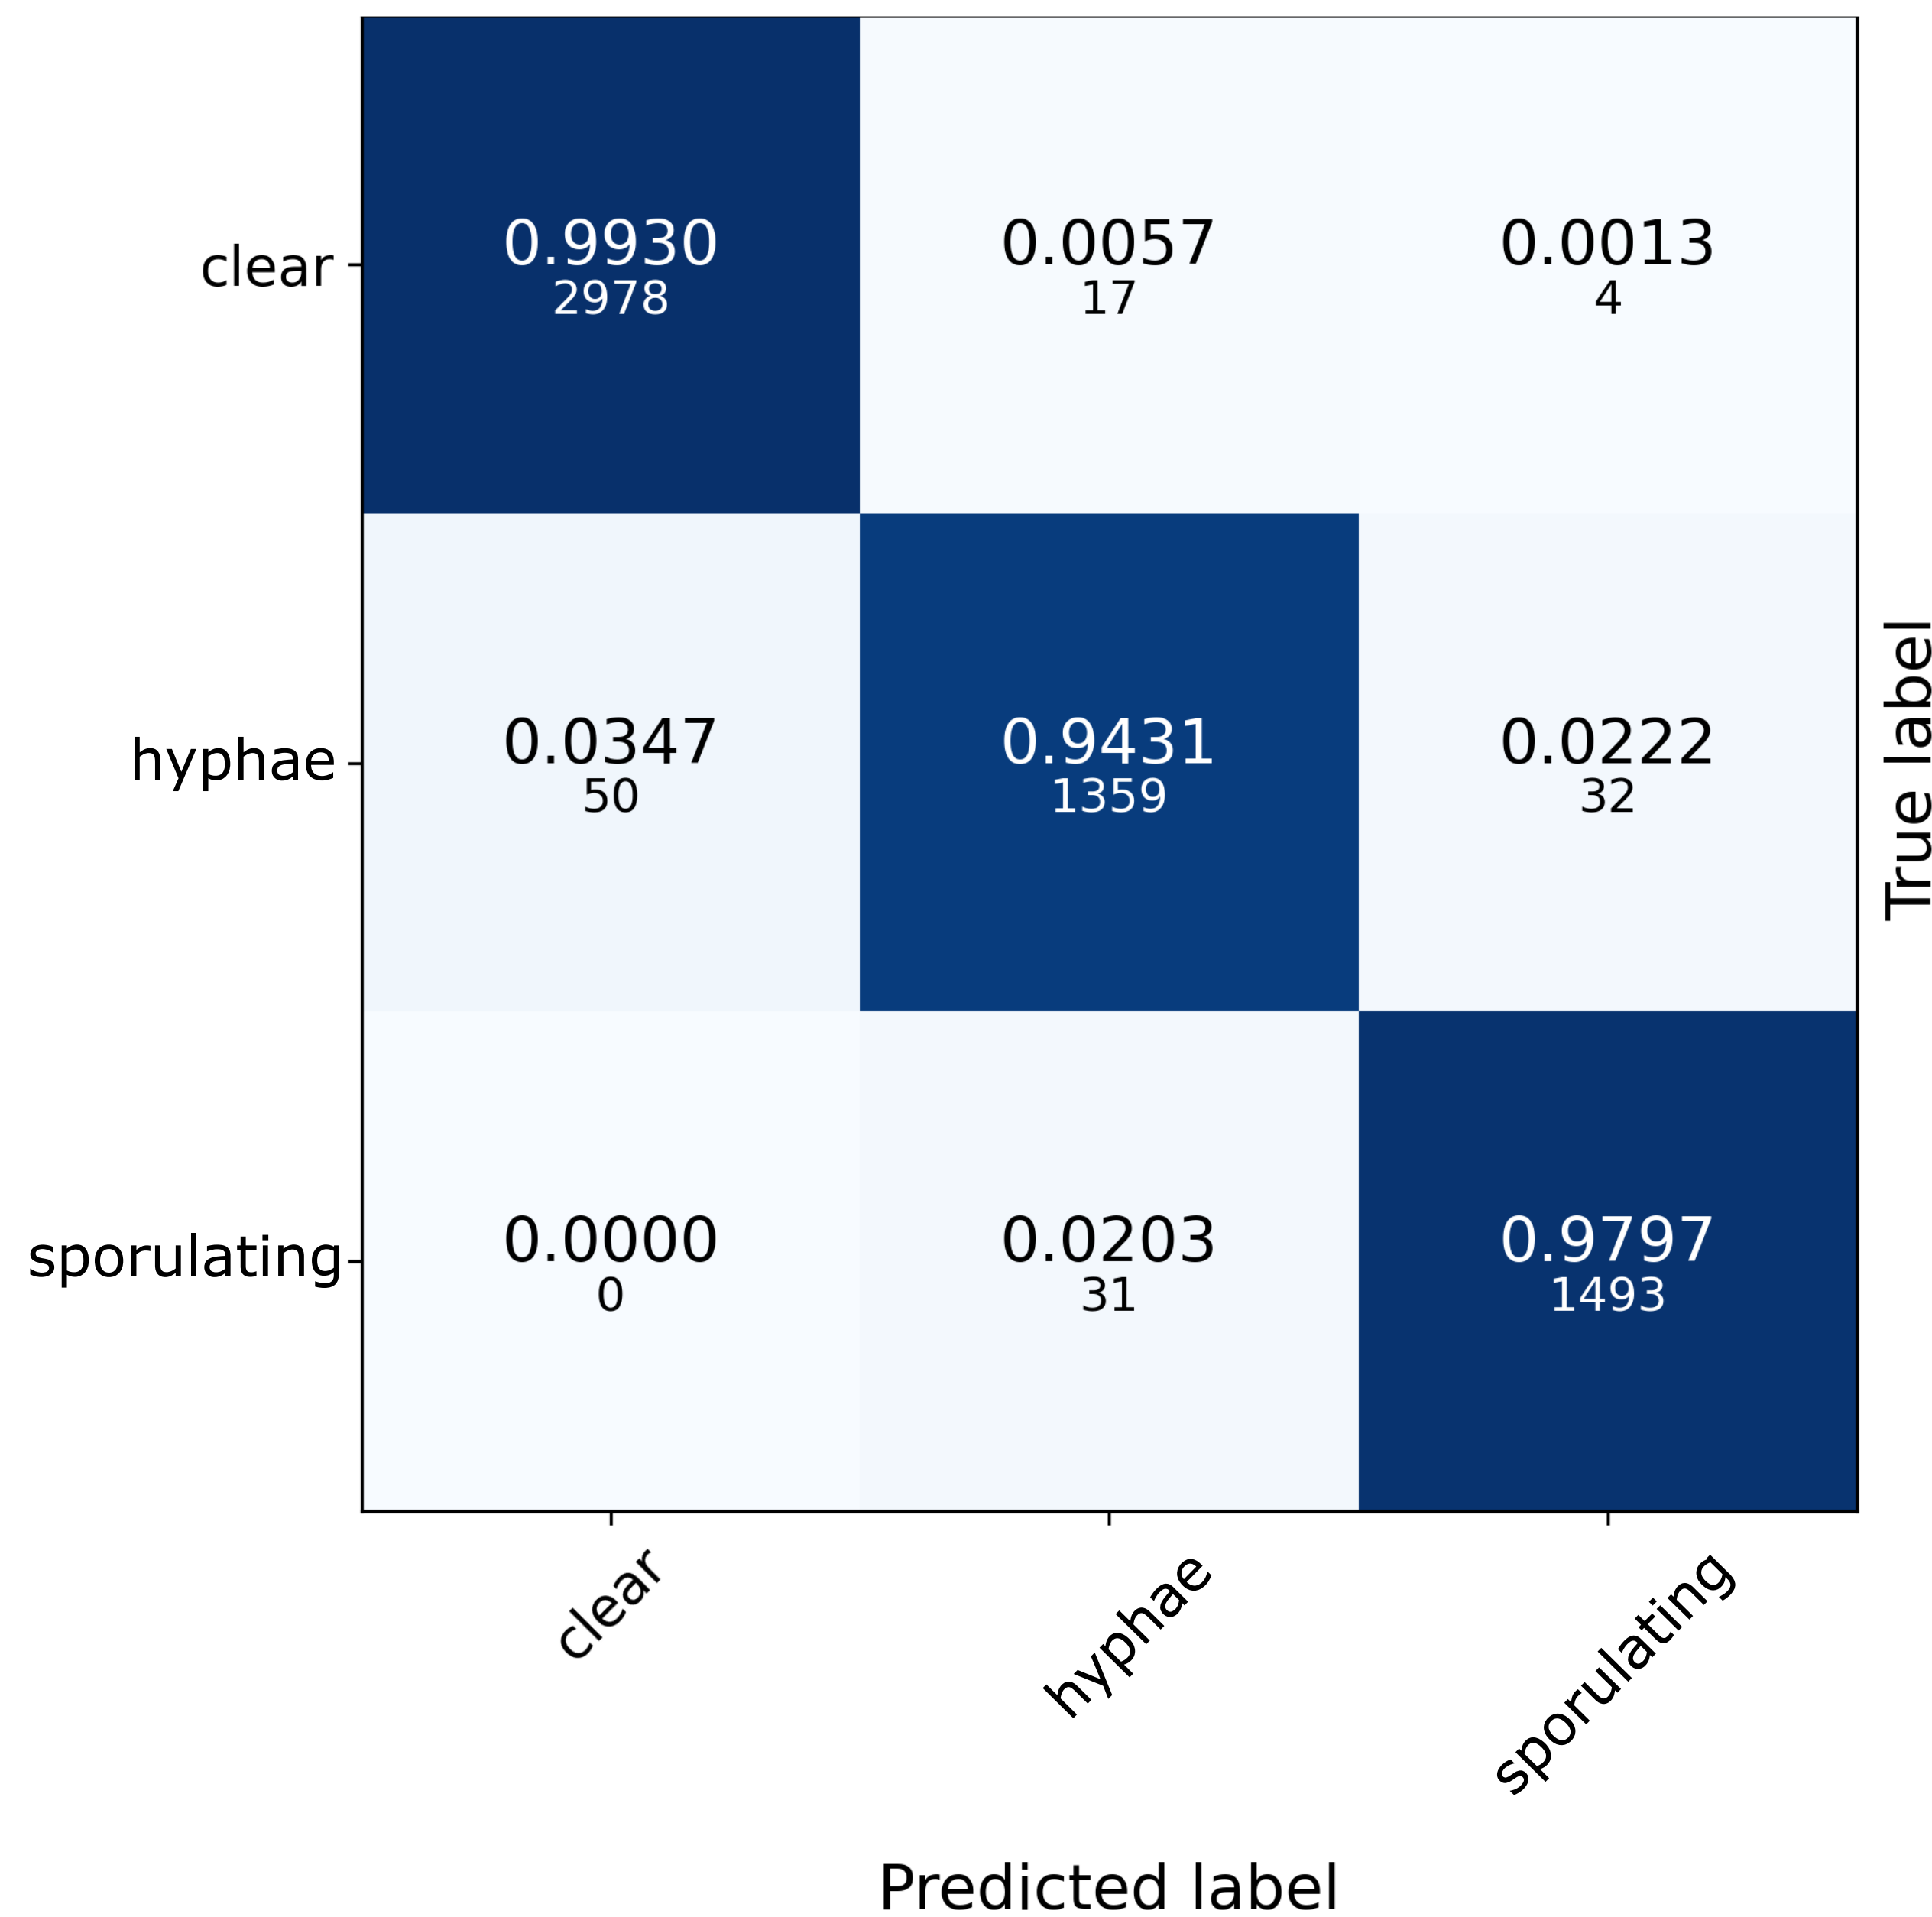

B. External independent hold out test set

Accuracy: 95.27% | Macro F1: 95.39%

