


PROGRESS SET - NOT FOR CONSTRUCTION



Scale: 1/8" = 1'-0"

1. TOP OF CONC. SLAB ELEVATION (T/S) IS SHOWN THUS (+/-) ON PLAN.
2. SLAB TO BE A 6" THICK SLAB ON GRADE, REINFORCED W/6x6 - W/2.9W/2.9 WWF ON VAPOR BARRIER.
3. EL. TO B.O. FOOTINGS ARE DENOTED THUS (+/-) ON PLAN RELATIVE TO BASEPLANE
4. ALL FOOTINGS SHALL BEAR ON SOIL WITH A MINIMUM 2.5 TONS/SQ. FT. CAPACITY
5. WALL BUTTRESSES ARE TYPE WB1 UNLESS OTHERWISE NOTED
6. BOTTOM ELEVATION OF SPREAD FOOTING TO BE (-2'-2") FROM TOP OF SLAB, UNLESS OTHERWISE NOTED
7. EXISTING TIE (OR STRAP) BEAMS DENOTED AS GB-1 ARE 24" D X 16" W - WITH ASSUMED TOP AND BOTTOM REINFORCEMENT 3 - (#6) EXTENDED A MINIMUM OF 3'-0" INTO THE FOOTINGS. STIRRUPS ARE TO BE #3 BARS @ 10" O.C.
8. PROPOSED TIE BEAMS ARE ALSO THUS DENOTED ON PLANS AS (GB-1)
9. FOR FOOTING, BUTTRESS, AND WALL REINFORCEMENT SEE SCHEDULES AND DETAILS SHOWN ON THIS DRAWING AND SECTION DETAILS.
10. SEE DRAWINGS 5-001 FOR GENERAL NOTES, LIST OF ABBREVIATIONS AND LEGEND
11. CONTRACTOR SHALL CONDUCT PRECONSTRUCTION SURVEY OF ADJACENT EXISTING BUILDINGS BEFORE EXCAVATION, UNDERPINNING OR STIFF SHEETING AS REQUIRED.

Grand total: 69

Email:---

Email: info@crisomconstruction.com



Tel: (212) 377-2456

Email: info@salamcons.com

3/22/2017 3:36:40 PM

PLOT TIME/DATE

SCOPE OF WORK

ADDRESS

BLOCK: 2988

MAP #: 13b

LOT: 01, 49, 14

ZONING:M3.

SHEET TITLE

SEAL & SIGNATURE

DATE: 7/28/2016

PROJECT NO.: 170102

DRAWING BY: HSK

CHK BY: RAS


DWG NO.

S-005.00

File Directory:

8 OF

 Orient and affix BIS job number label here 

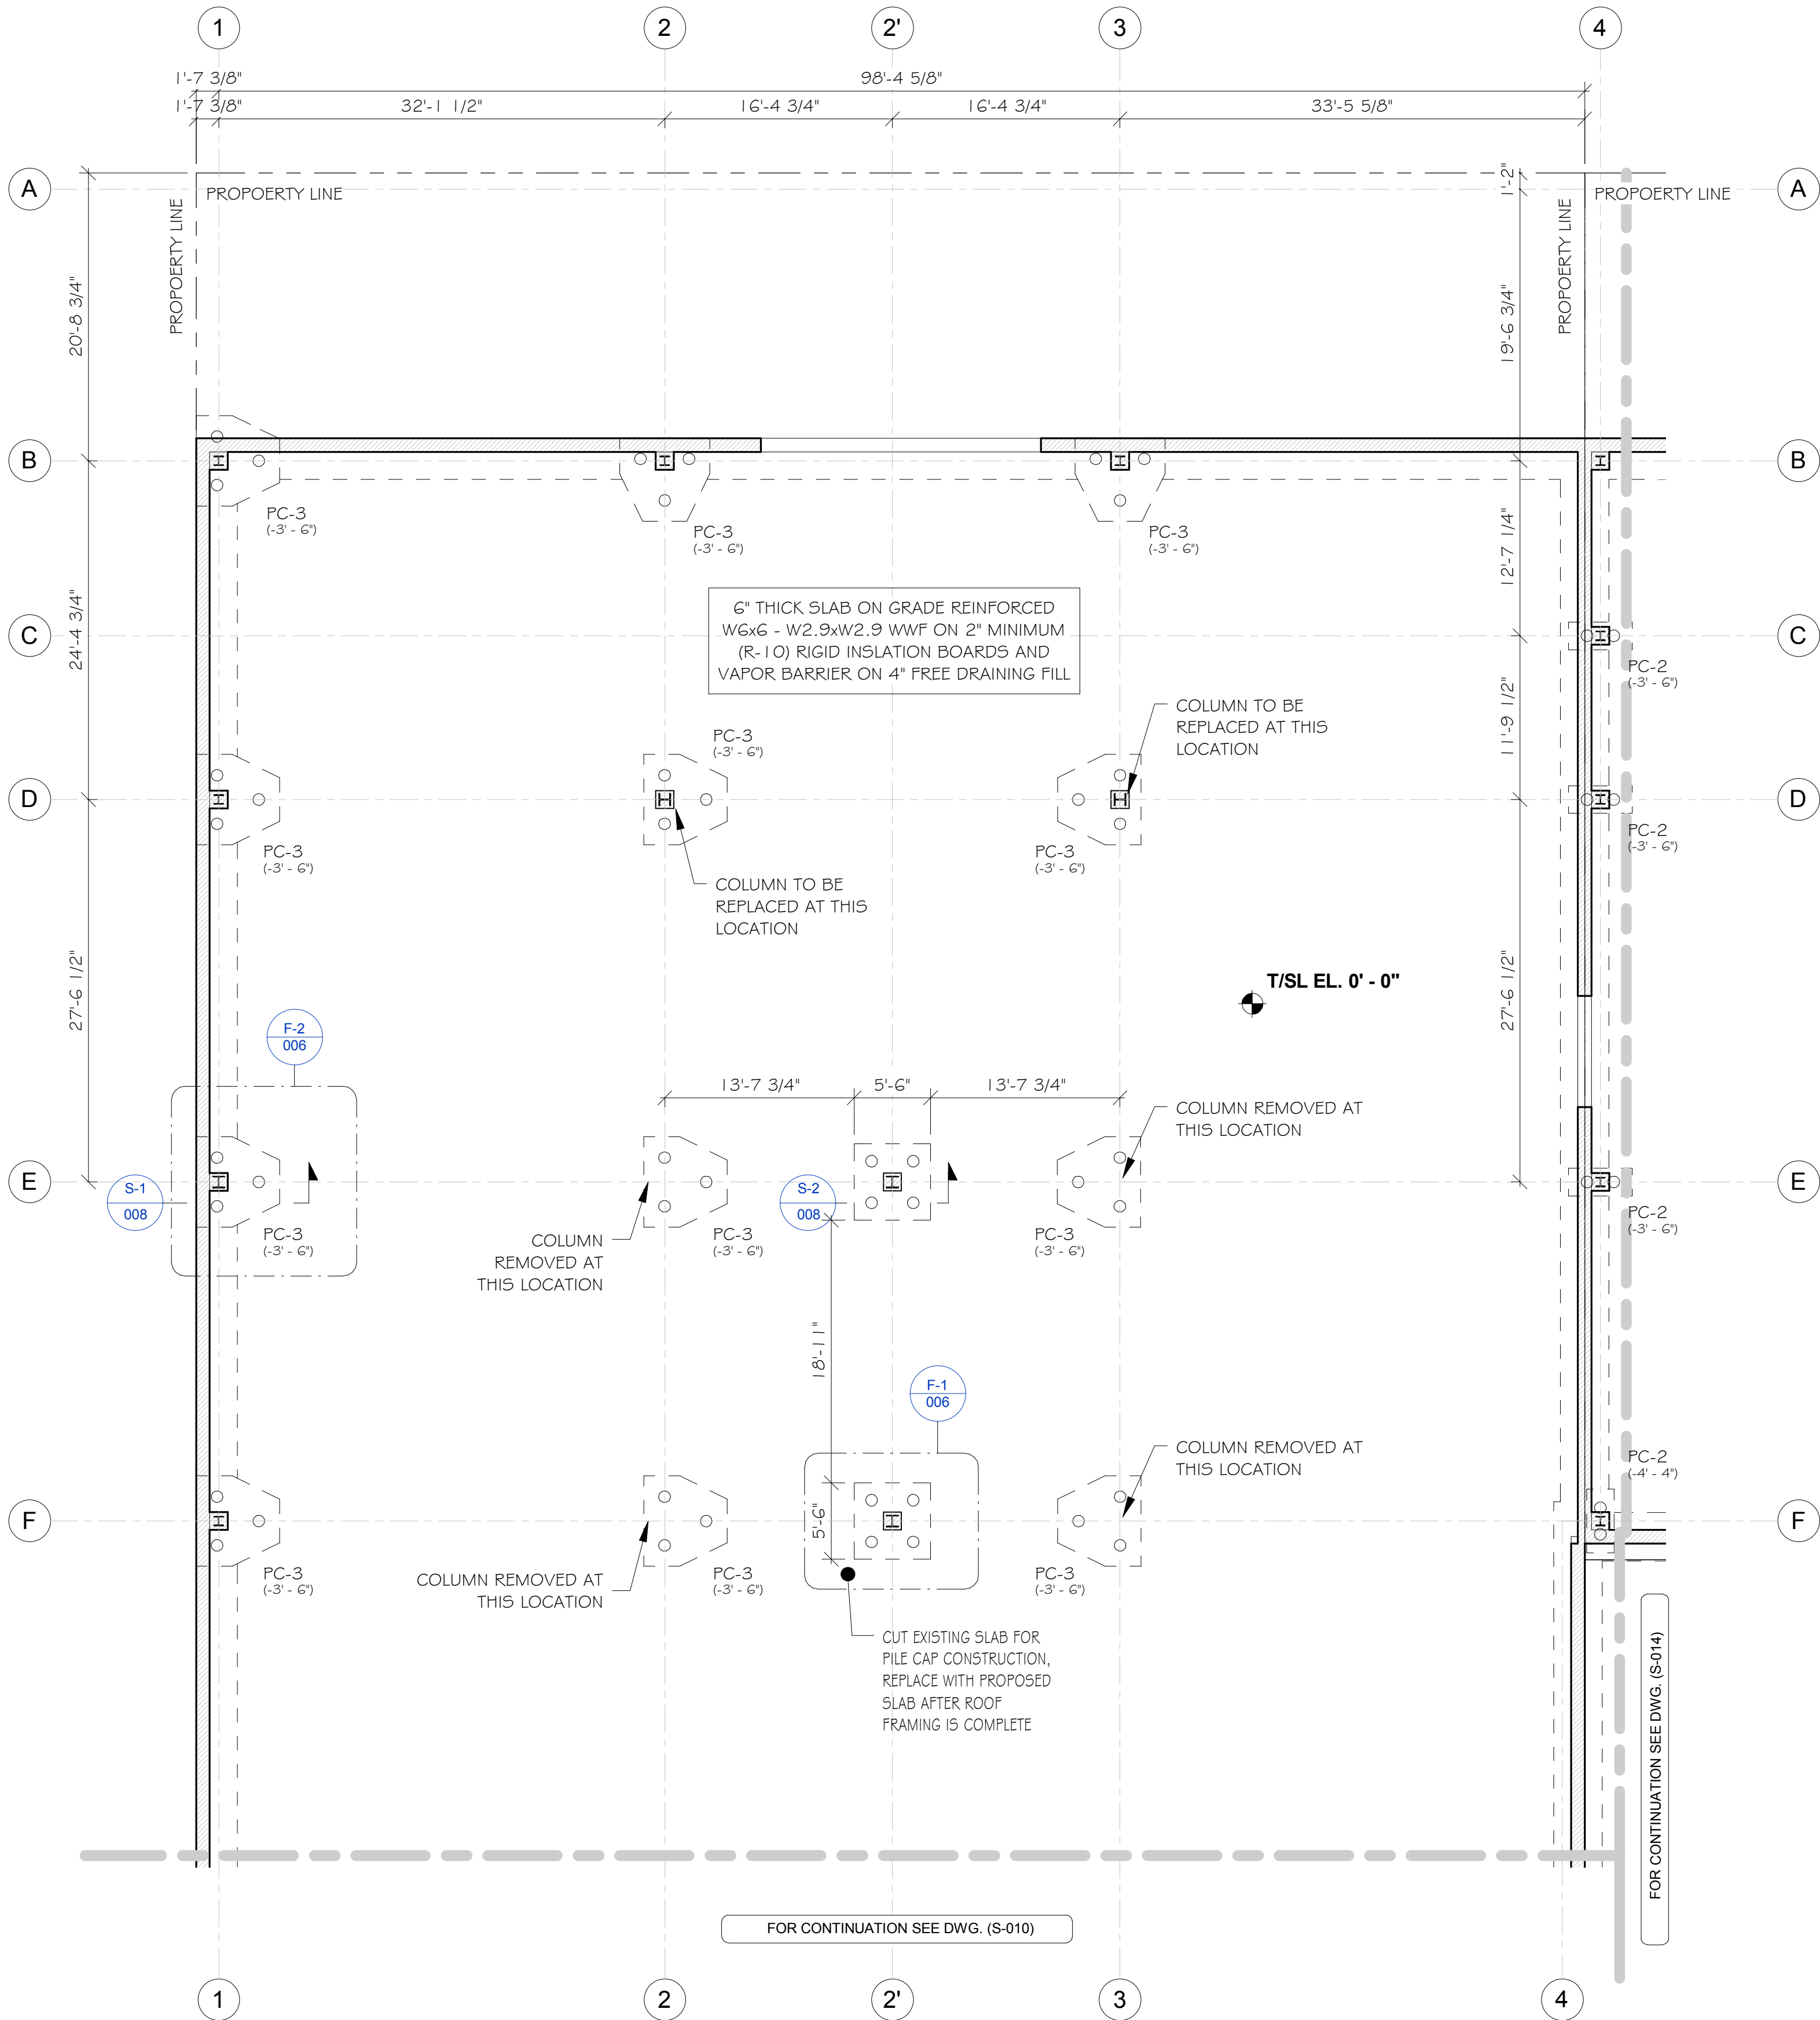


Existing Pile Cap Schedule						
Type	Dimensions			Reinforcement		Comments
	Width	Length	Thick.	Bottom	Top	
PC-2	4' - 7"	2' - 0"	3' - 0"	4-#5 BOTT. L-WAY, 8-#5 BOTT. S-WAY		
PC-3	6' - 6"	6' - 0"	3' - 0"			
PC-4	5' - 6"	5' - 6"	3' - 8"			

Grand total: 69


Proposed Pile Cap Schedule							
Type	Dimensions			Reinforcement		Qty	Volume (CY)
	Width	Length	Thick.	Bottom	Top		
PC-4	5' - 6"	5' - 6"	3' - 8"	11-#9 EACH WAY		4	14.19

Grand total: 4

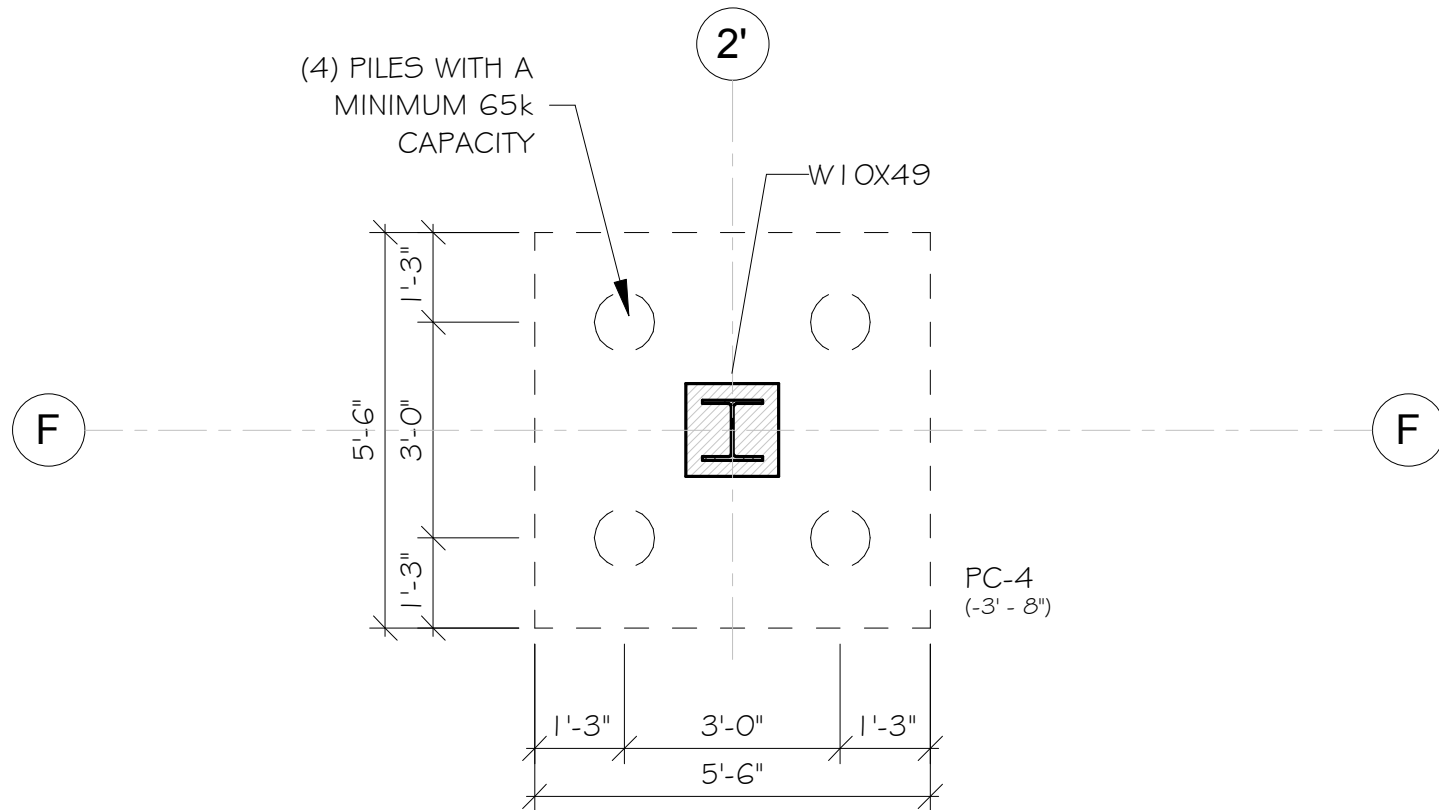

Detail (F-1) Proposed Typical Pile Cap Detail:

Scale: 3/8" = 1'-0"

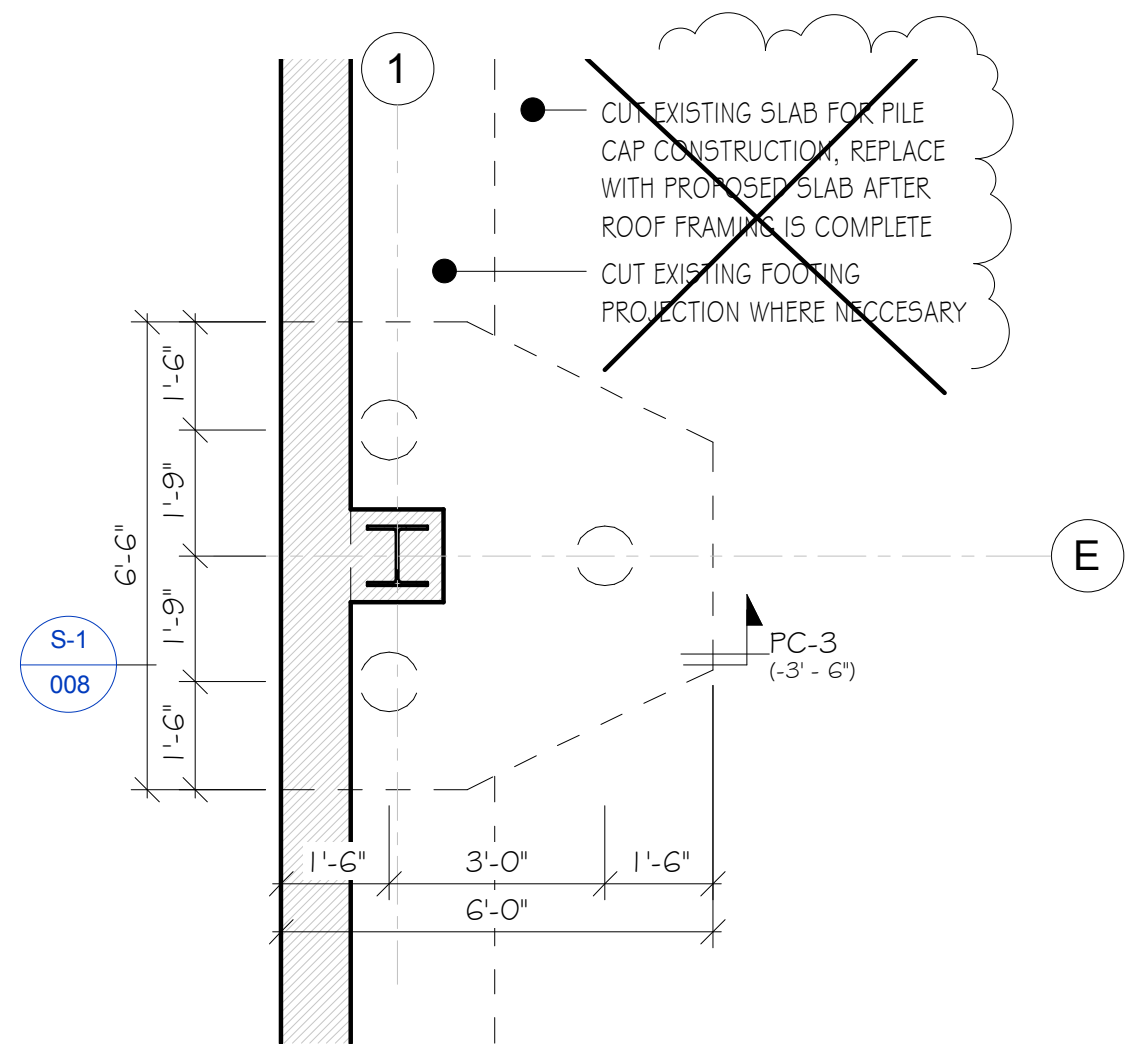

Detail (F-2) Retrofit of Ex. Perimeter Pile Cap:

Scale: 3/8" = 1'-0"

Partial - Proposed Slab on Grade and Pilecap Layout @ 537 Jonhson Ave (1 of 2):

Scale: 1/8" = 1'-0"

NOTES:

1. TOP OF CONC. SLAB ELEVATION (T/S) IS SHOWN THUS [+/-] ON PLAN.
2. SLAB TO BE A 6" THICK SLAB ON GRADE, REINFORCED W6x6 - W2.9xW2.9 WWF ON VAPOR BARRIER
3. EL. TO B.O. FOOTINGS ARE DENOTED THUS (+/-) ON PLAN RELATIVE TO BASEPLANE
4. ALL FOOTINGS SHALL BEAR ON SOIL WITH A MINIMUM 2.5 TON/SQ. FT. CAPACITY
5. WALL BUTTRESSES ARE TYPE WB1 UNLESS OTHERWISE NOTED
6. BOTTOM ELEVATION OF SPREAD FOOTING TO BE (-2'-2") FROM TOP OF SLAB, UNLESS OTHERWISE NOTED
7. EXISTING TIE (OR STRAP) BEAMS DENOTED AS GB-1 ARE 24" D X 16" W - WITH ASSUMED TOP AND BOTTOM REINFORCEMENT 3 - (#6) EXTENDED A MINIMUM OF 3'-0" INTO THE FOOTINGS. STIRRUPS ARE TO BE #3 BARS @ 10" O.C.
8. PROPOSED TIE BEAMS ARE ALSO THUS DENOTED ON PLANS AS (GB-1)
9. FOR FOOTING, BUTTRESS, AND WALL REINFORCEMENT SEE SCHEDULES AND DETAILS SHOWN ON THIS DRAWING AND SECTION DETAILS.
10. SEE DRAWINGS S-001 FOR GENERAL NOTES, LIST OF ABBREVIATIONS AND LEGEND
11. CONTRACTOR SHALL CONDUCT PRECONSTRUCTION SURVEY OF ADJACENT EXISTING BUILDINGS BEFORE CONSTRUCTION UNDERPINNING OR SHORING WHICH IS REQUIRED.

Copyright © 2015 Rizwan A. Salam PE Consulting Engineers (RAS) - This drawing is an instrument of service and the sole property of the RAS or the Applicant of Record (AoR). Any use of this drawing without the consent of RAS is prohibited.
Drawing scales as indicated are for reference only and are not intended to accurately depict actual or designed conditions. Written dimensions shall govern.

CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS AND BE RESPONSIBLE FOR FIELD FIT AND QUALITY OF WORK. NO ALLOWANCES SHALL BE MADE IN BEHALF OF THE CONTRACTOR FOR ANY ERROR OR NEGLIGENCE ON HIS PART.

Client:

Tel: ---


Email:---

Contractor:

Cristom Construction Services
151-01 14th Avenue
Whitestone NY 11357

Tel: (718) 747-4747

Email: info@cristomconstruction.com

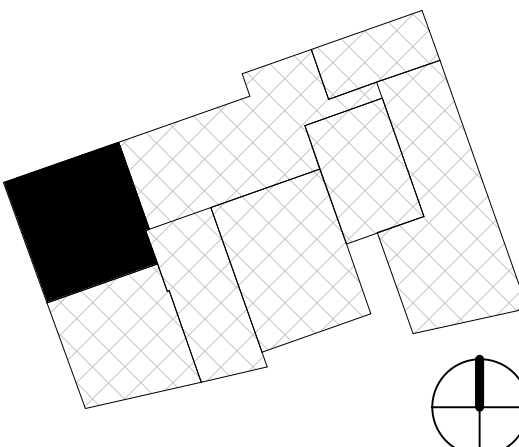

APPLICANT OF RECORD:



20 E 49TH ST. SUITE-3A
NEW YORK NY 10017

Tel: (212) 377-2456

Email: info@salamcons.com

3/22/2017 3:36:41 PM

PLOT TIME/DATE

Date 1	1	Revision 1
Date	Issue No.	Rev. Description

SCOPE OF WORK

ALT II STRUCTURAL RENOVATION
OF EXISTING ONE STORY
WAREHOUSE STRUCTURE

ADDRESS

537-561 Johnson Avenue
Brooklyn NY 11237

BLOCK: 2988

MAP #: 13b


LOT: 01, 49, 14

ZONING:M3-1

SHEET TITLE

Proposed Foundation Plan and
Slab Layout @ 537 Johnson
Avenue (1 of 2)

SEAL & SIGNATURE

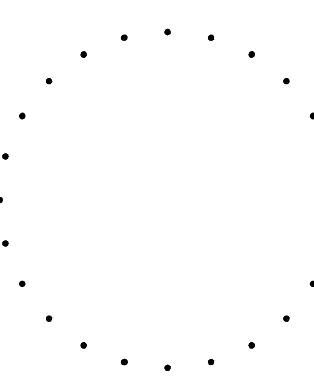

DATE: 7/28/2016

PROJECT NO.: 170102

DRAWING BY: HSK

CHK BY: RAS

DWG NO.:


S-006.00

File Directory:
Rizwan A. Salam, P.E.
151-01 14th Avenue
Whitestone, NY 11357

10 OF 5

Orient and affix BIS
job number label here


PROGRESS SET - NOT FOR CONSTRUCTION

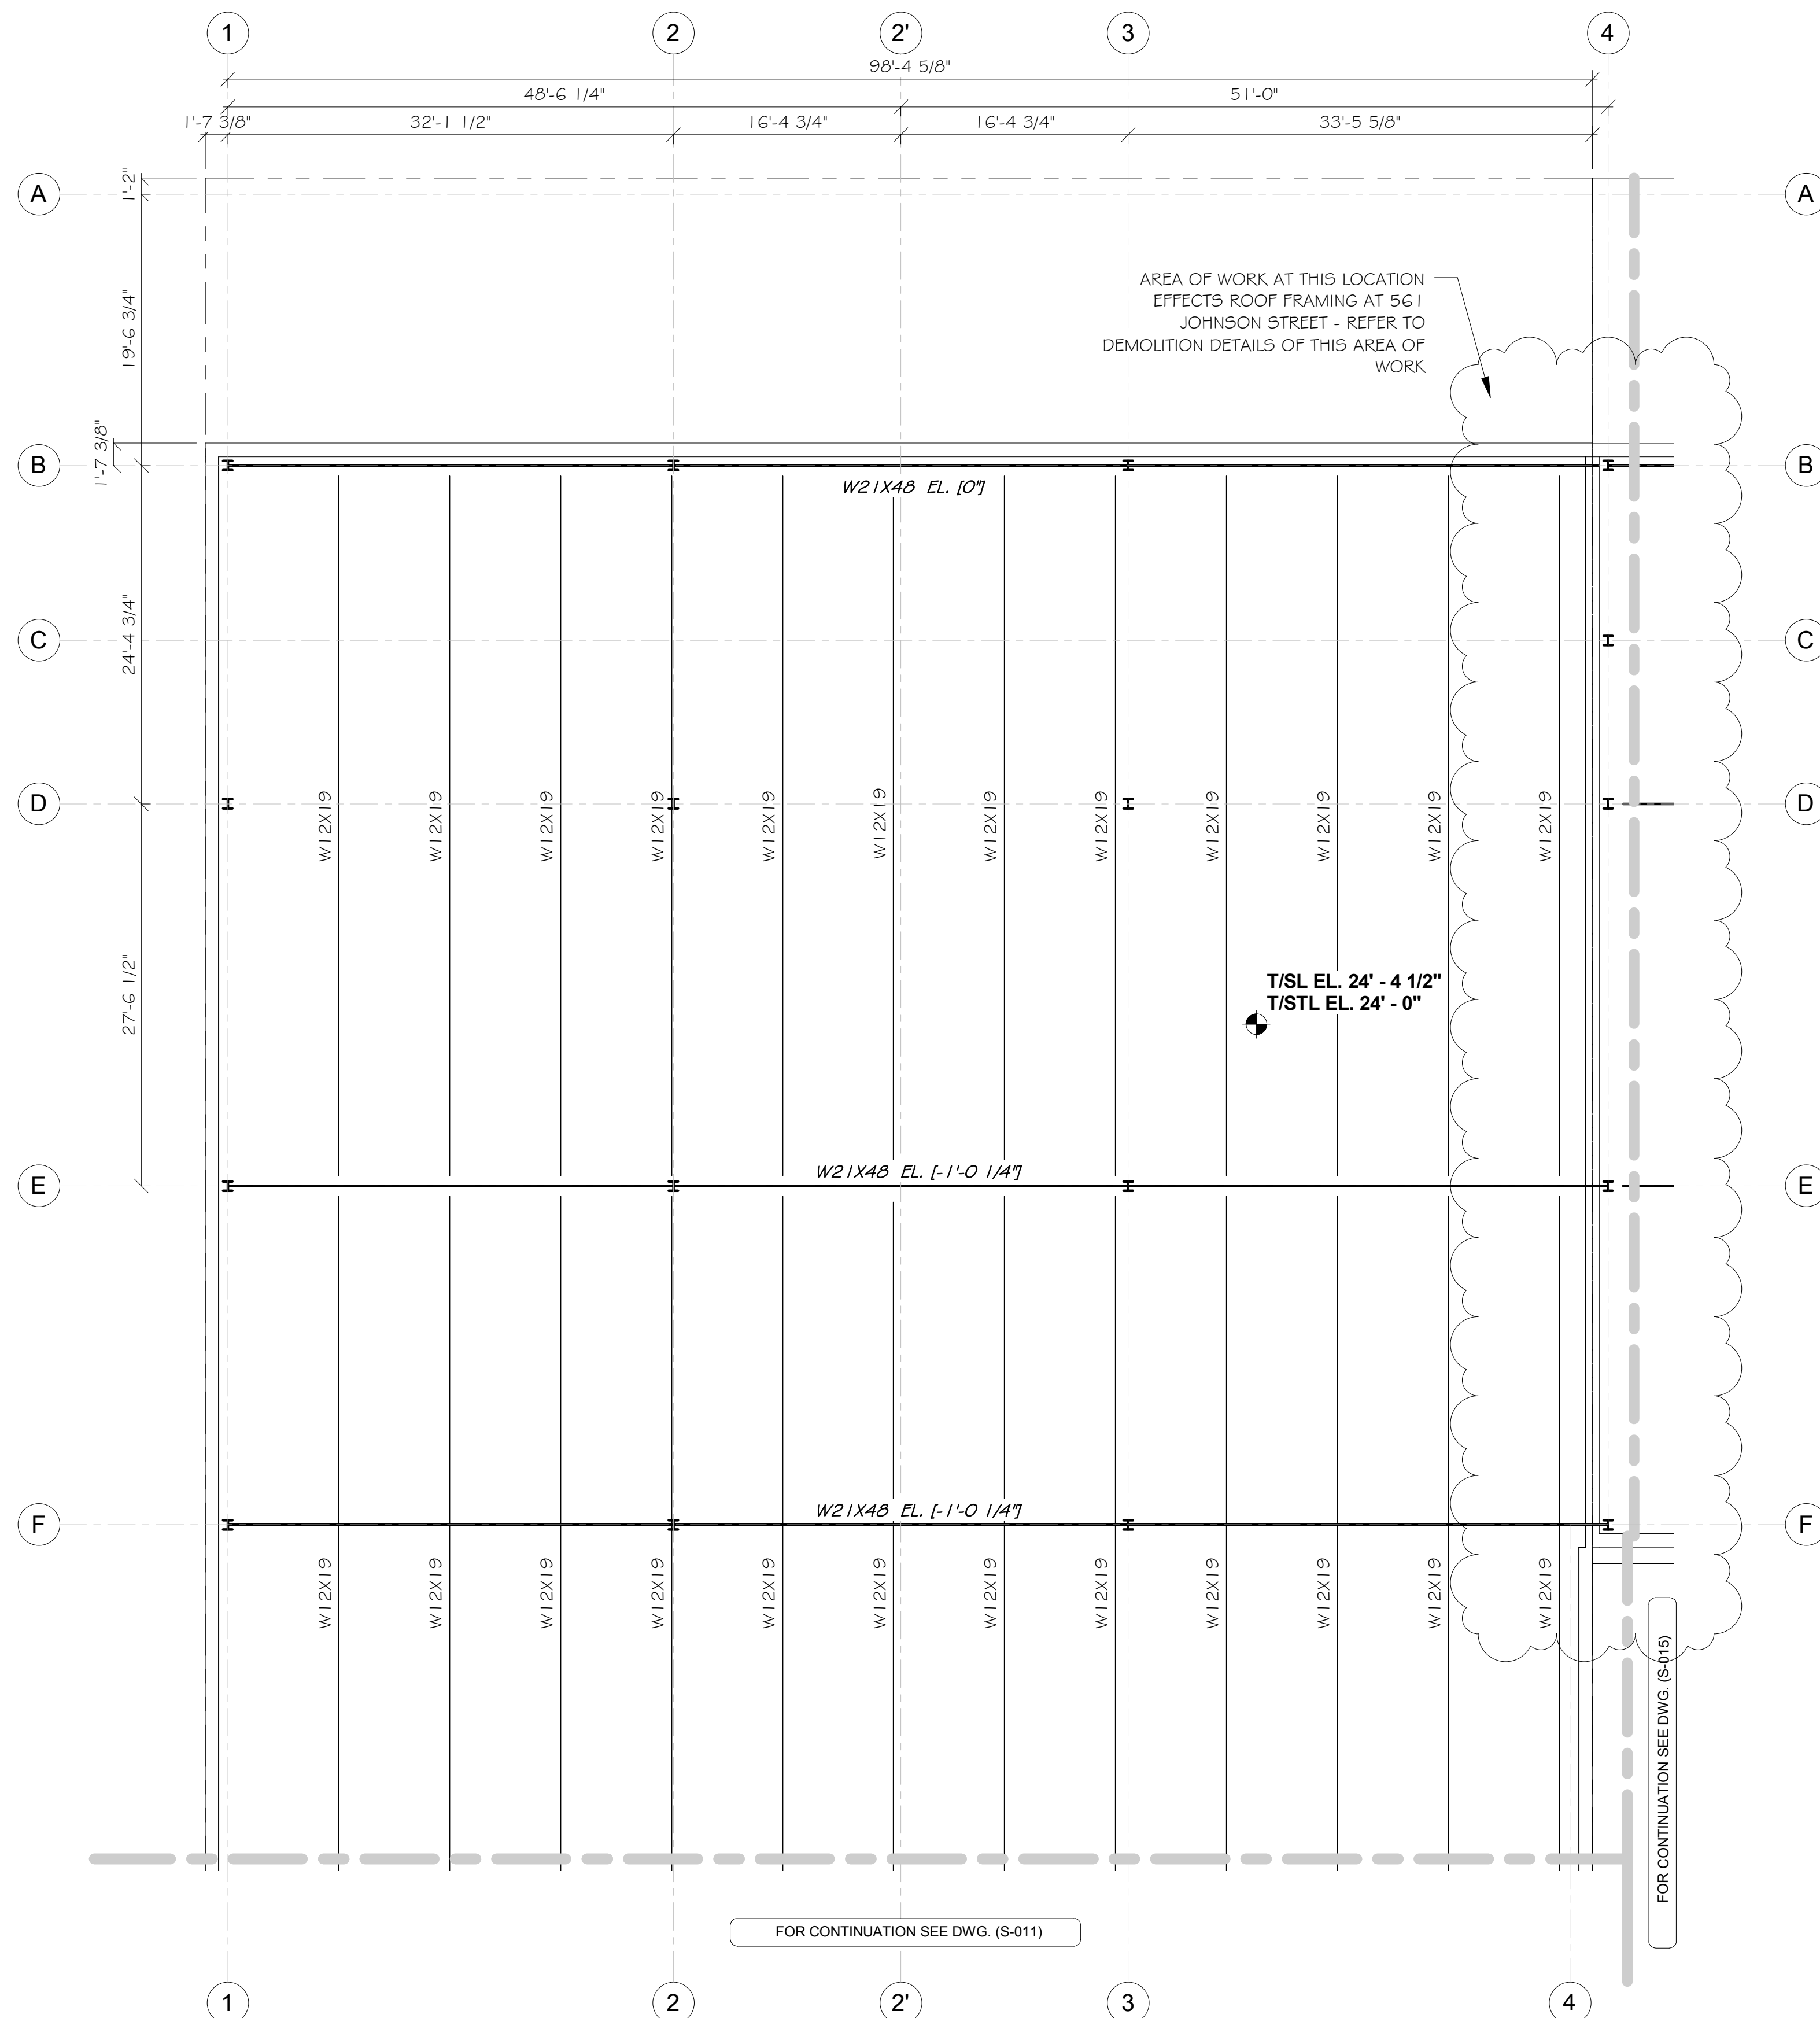

Procedure of Work

- | | |
|-----------|---|
| PH1-SSP.1 | PROTECT PUBLIC AND ADJACENT PRIVATE PROPERTIES - AS SHOWN ON THE SITE SAFETY PLAN. ENCLOSE THE PROPERTY WITH A CONSTRUCTION FENCE, AND: |
| PH1-SSP.2 | ERECT A COVERED SIDEWALK SHED AND A PIPE SCAFFOLDING SYSTEM SECURED TO THE FACADE UP TO 42' ABOVE THE HIGHEST ROOF LEVEL AS PER 2014 NYC B.C. (FILED BY OTHERS) |
| PH1-SSP.3 | ERECT SHORING STEEL JACK POSTS TO TEMPORARILY SUPPORT AREAS OF WORK AS REQUIRED |
| PH1-SSP.4 | PROVIDE GUARDRAILS ALONG THE OPEN SIDES OF THE HIGHEST PIPE SCAFFOLD AT ALL TIMES. SECURE PERSONNEL WITH A FALL ARREST SYSTEM AS NECESSARY. |

REFER TO THE
ACCOMPANYING
DRAFT MEANS AND
METHODS

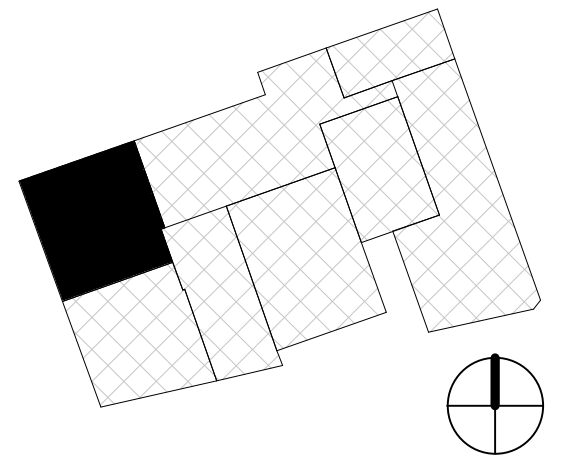

APPLICANT OF RECORD:



RAS P.E.
CONSULTING ENGINEERS
RIZWAN A. SALAM, P.E.

20 E 49TH ST. SUITE-3A
NEW YORK NY 10017

Tel: (212) 377-2456 Email: info@salamcons.com

3/22/2017 3:36:42 PM		PLOT TIME/DATE	
Date 1	1	Revision 1	
Date	Issue No.	Rev. Description	

SCOPE OF WORK

ALT II STRUCTURAL RENOVATION OF EXISTING ONE STORY WAREHOUSE STRUCTURE

ADDRESS


537-561 Johnson Avenue
Brooklyn NY 11237

BLOCK: 2988 MAP #: 13b
LOT: 01, 49, 14 ZONING:M3-1

SHEET TITLE

**Existing Roof Framing Plan @
537 Johnson Avenue (1 of 2)**

SEAL & SIGNATURE

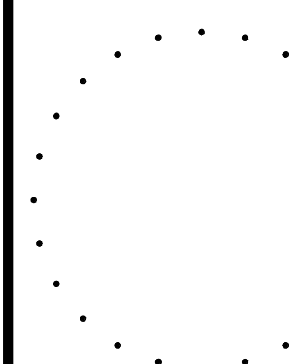

DATE:	7/28/2016
PROJECT NO.:	170102
DRAWING BY:	HSK
CHK BY:	RAS
DWG NO.:	


S-007.00

File Directory:
IBM 360/517-561 Johnson & Jones 517

7 OF 5

 Orient and affix BIS
job number label here


PROGRESS SET - NOT FOR CONSTRUCTION

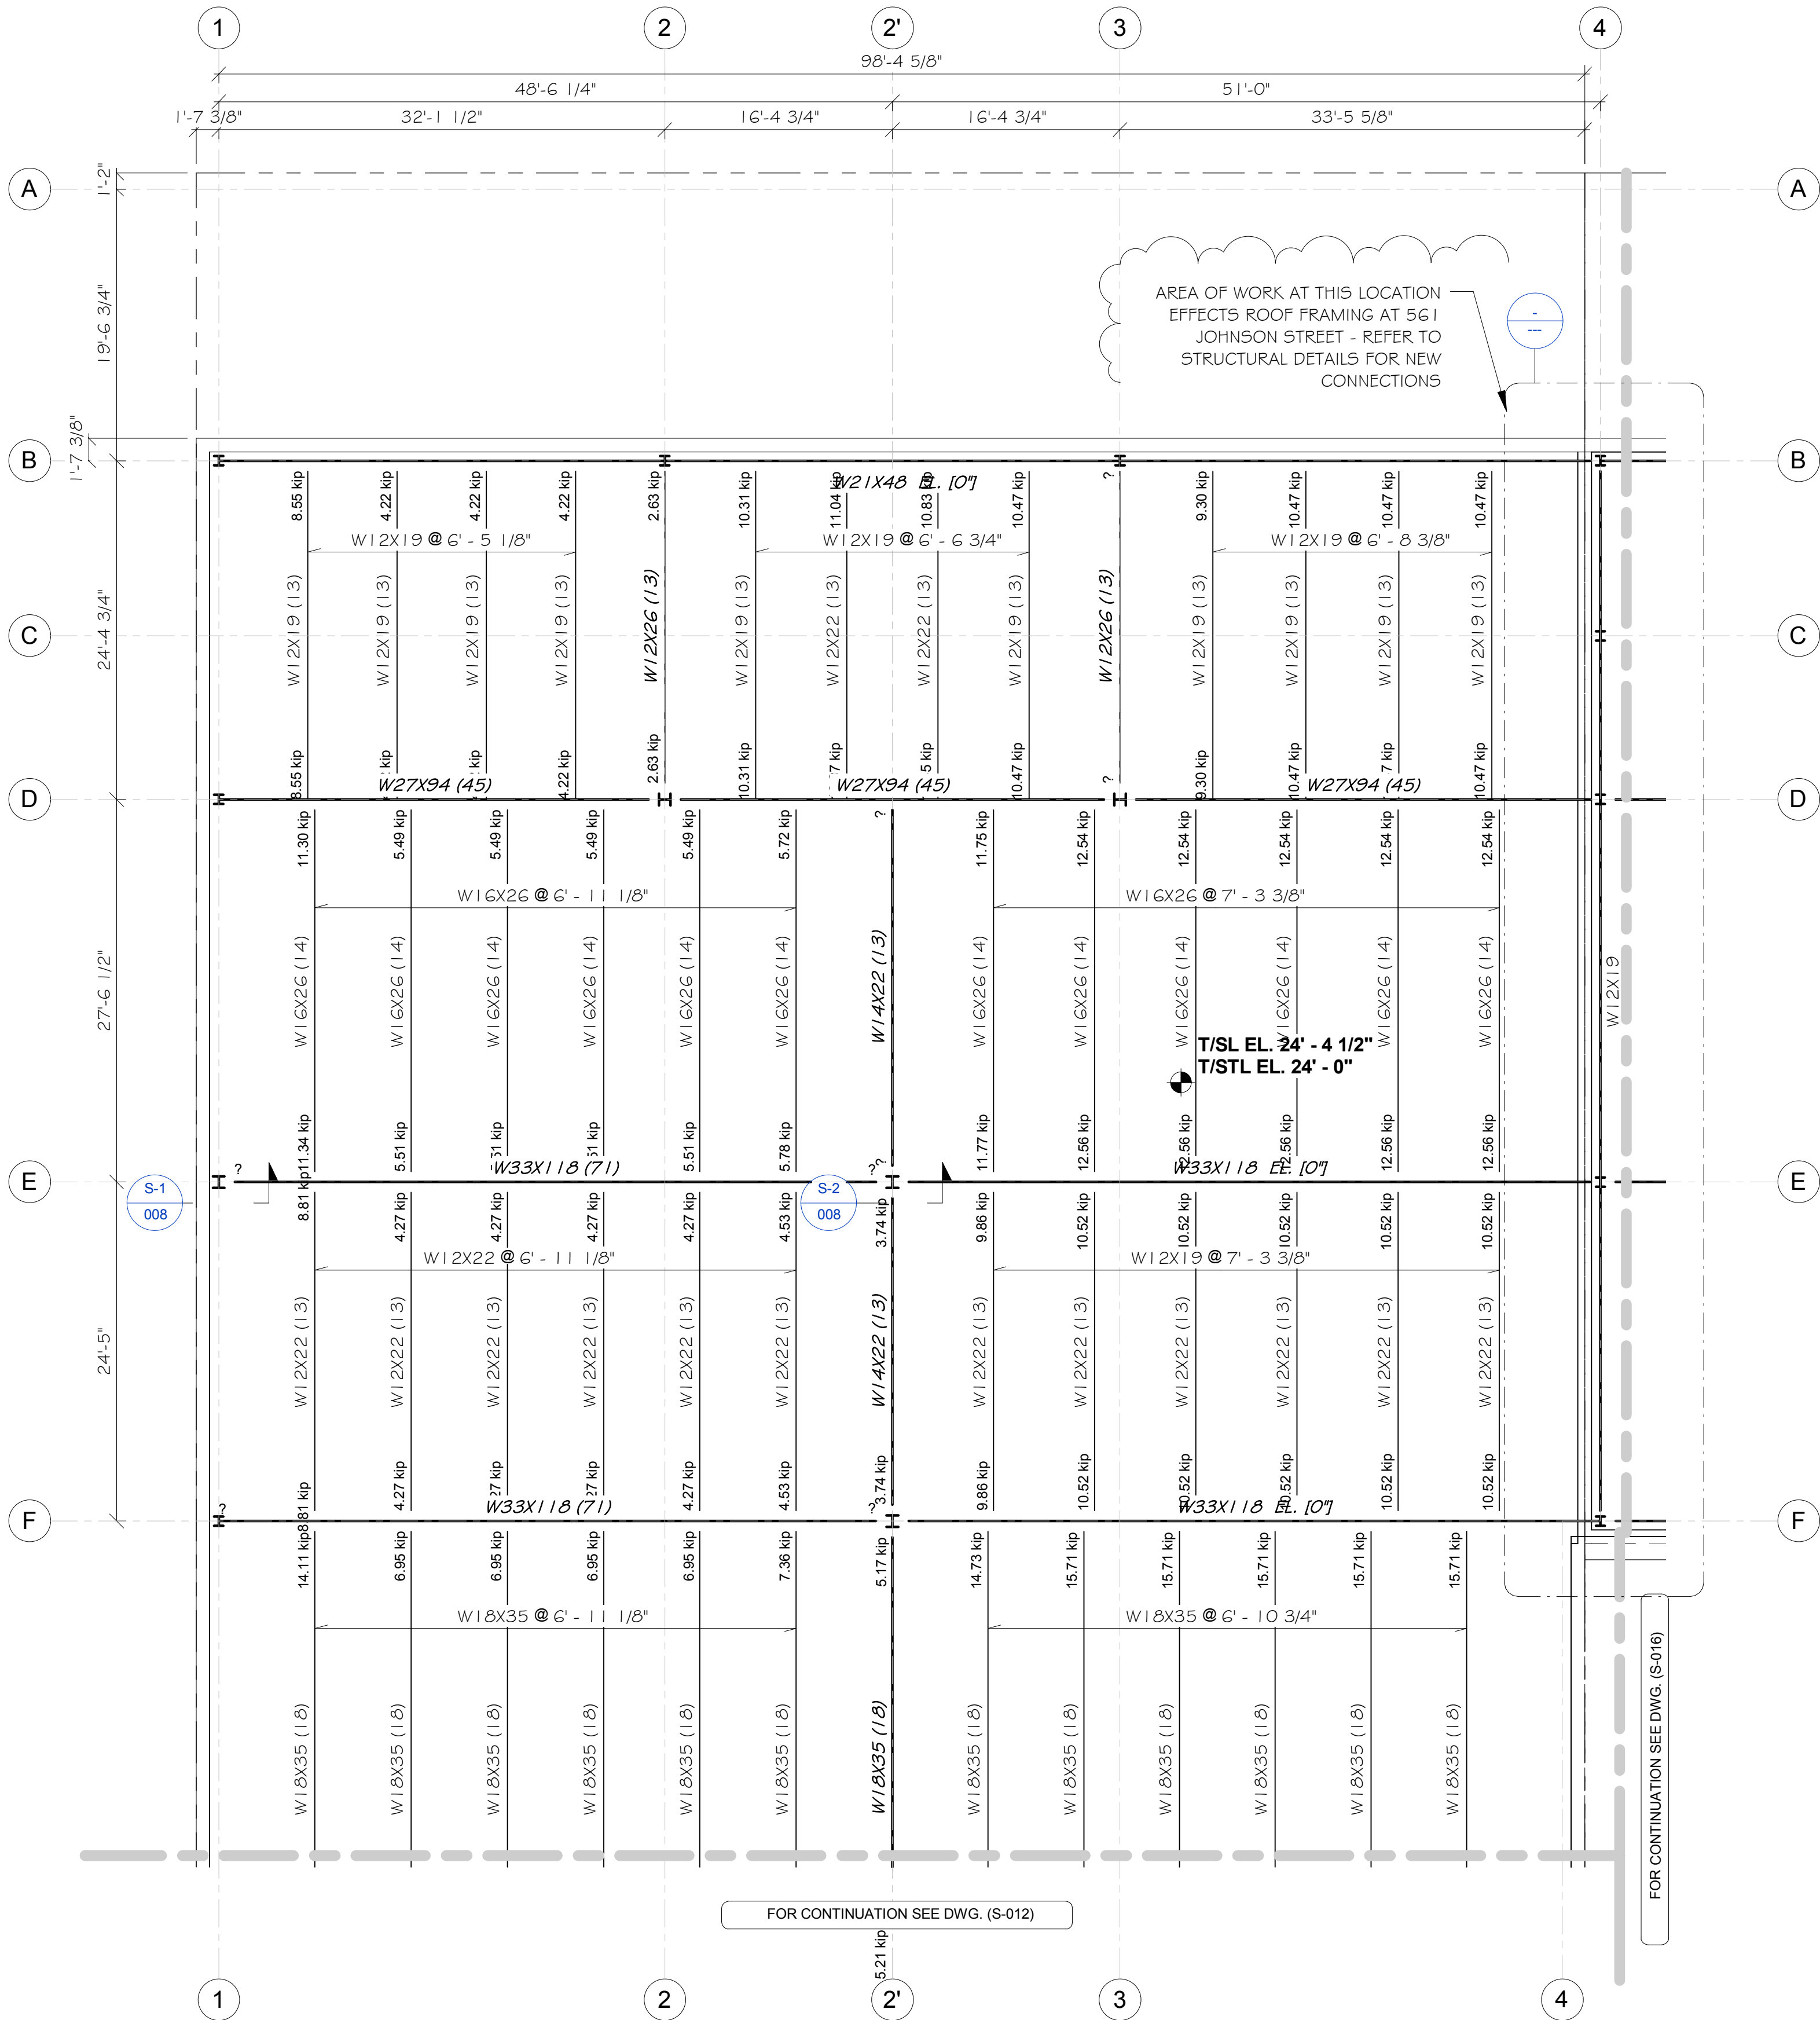

T.O. Roof	24' - 0"								T.O. Roof	24' - 0"
T.O. Mezzanine	13' - 6"	W10X49	W10X49	W10X49	W10X49	W10X49	W10X49	W10X49	T.O. Mezzanine	13' - 6"
T.O. Slab	0' - 0"								T.O. Slab	0' - 0"
Column Locations	D-2	D-3	E-2	F-2	G-2	H-2				


Proposed Column Schedule:

Scale: 3/32" = 1'-0"

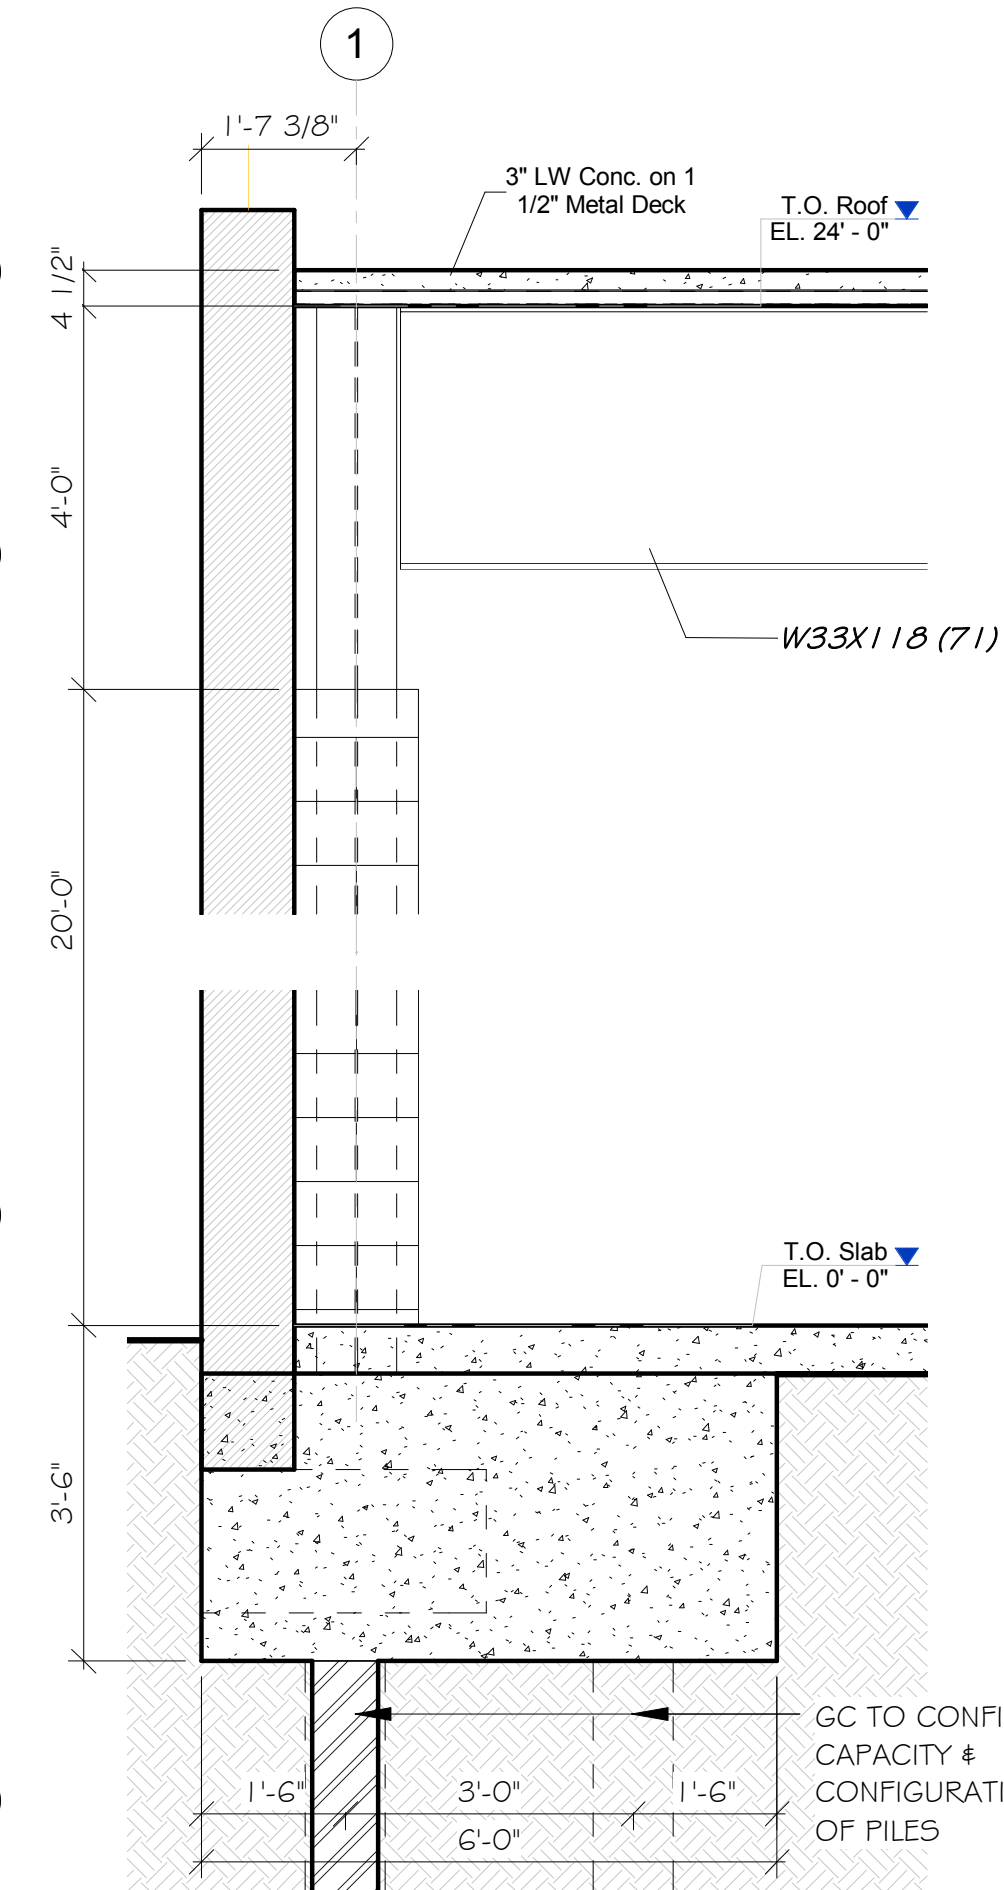

Section S-1:

Scale: 1/2" = 1'-0"

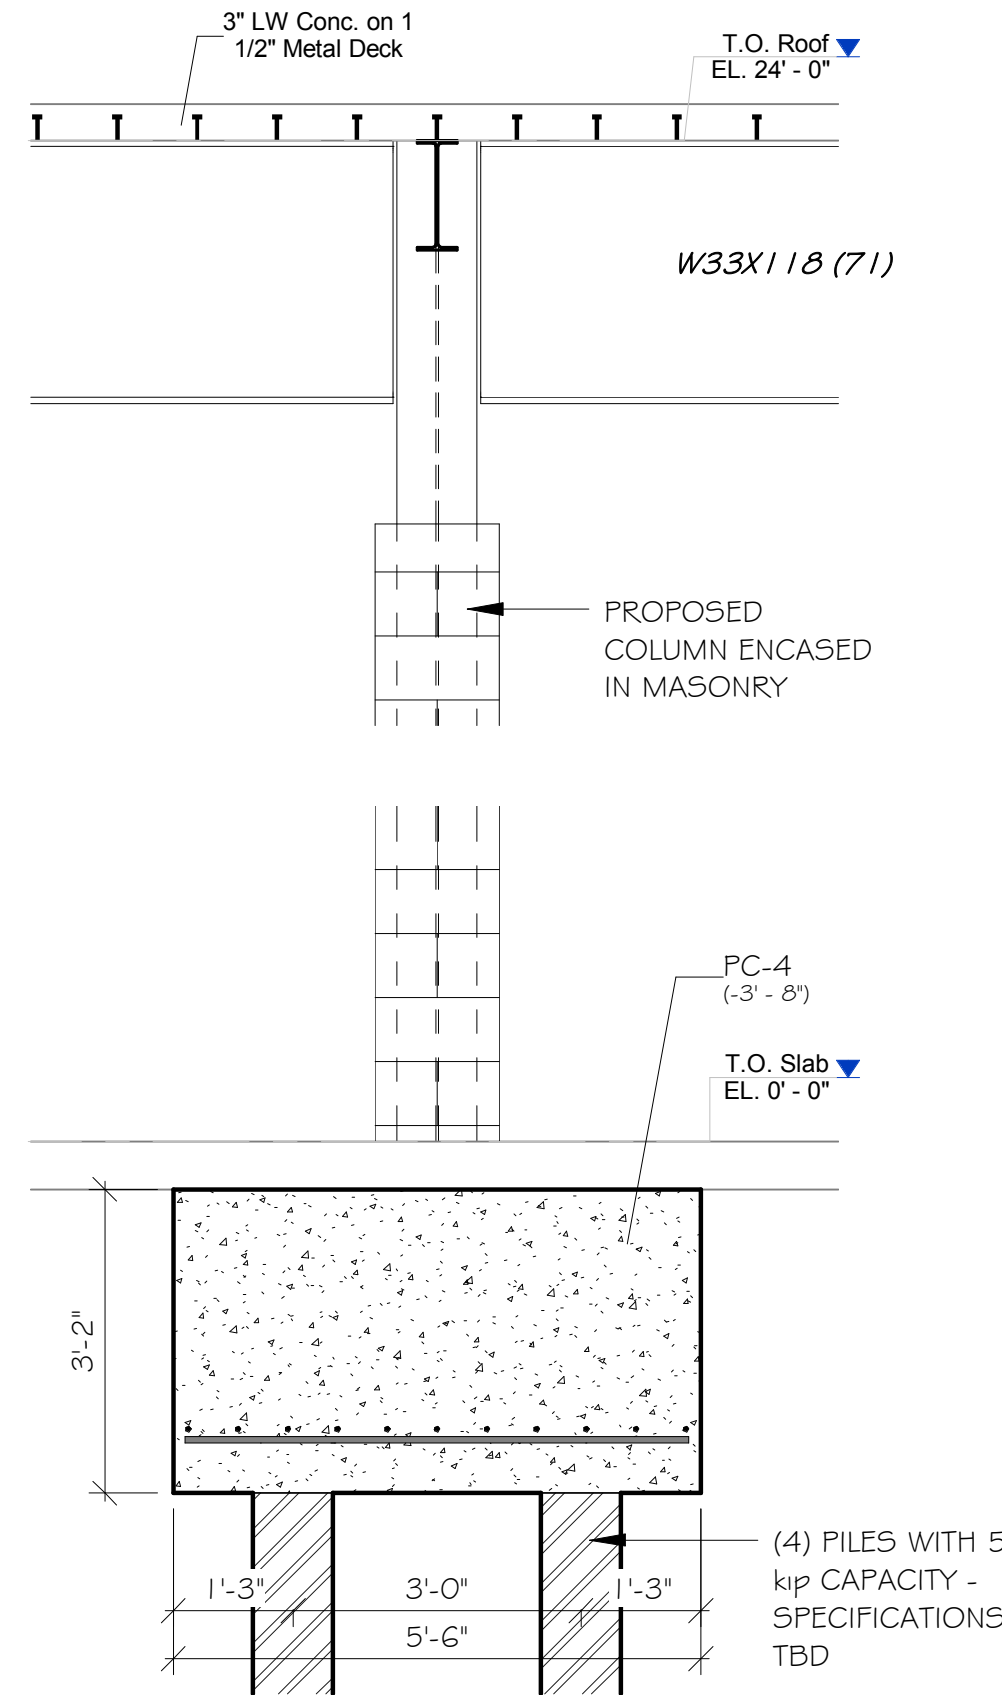

Section S-2:

Scale: 1/2" = 1'-0"

Partial - Proposed Roof Framing Plan @ 537 Johnson Ave (1 of 2):

Scale: 1/8" = 1'-0"

NOTES:

- TOP OF SLAB ELEVATION (T/S/L) IS NOTED THUS [+/-] ON PLAN
- PROPOSED ROOF SLAB IS 3" N. WT. CONCRETE ON 1-1/2x20 NON-COMPOSITE GA. MTL DECK, REINFORCED WITH WWM 6x6 - W1.4xW1.4.
- ARROW DENOTES THE DIRECTION OF THE METAL DECK
- TOP OF STRUCTURAL STEEL (T/S/T) IS 4 1/2" BELOW TOP OF SLAB (T/S/L) UNLESS NOTED OTHERWISE
- NUMBER OF SHEAR STUDS SHOWN AFTER THE BEAM SIZE (##)
- THE END REACTIONS OF THE BEAMS ARE SHOWN THUS (KIP) AT BEAM ENDS
- STEEL BEAMS SHALL BE EQUALLY SPACED WITHIN BAYS UNLESS OTHERWISE NOTED.
- BEAM SIZES NOT SHOWN SHALL BE A MINIMUM OF W12x19
- SEE DRAWINGS S-001 FOR GENERAL NOTES, LIST OF ABBREVIATIONS AND LEGEND
- FOR BRACING, SEE ELEVATIONS.
- FOR COLUMN SCHEDULE SEE S-008
- CONTRACTOR TO VERIFY ALL DIMENSIONS ON FIELD AND REPORT ANY DISCREPANCIES TO ENGINEER OF RECORD

Copyright © 2015 Rizwan A. Salam PE Consulting Engineers (RAS) - This drawing is an instrument of service and the sole property of the RAS or the Applicant of Record (AoR). Any use of this drawing without the consent of RAS is prohibited.
Drawing scales as indicated are for reference only and are not intended to accurately depict actual or designed conditions. Written dimensions shall govern.

CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS AND BE RESPONSIBLE FOR FIELD FIT AND QUALITY OF WORK. NO ALLOWANCES SHALL BE MADE IN BEHALF OF THE CONTRACTOR FOR ANY ERROR OR NEGLIGENCE ON HIS PART.

Client:

Tel: ---


Email:---

Contractor:

Cristom Construction Services
151-01 14th Avenue
Whitestone NY 11357

Tel: (718) 747-4747

Email: info@cristomconstruction.com

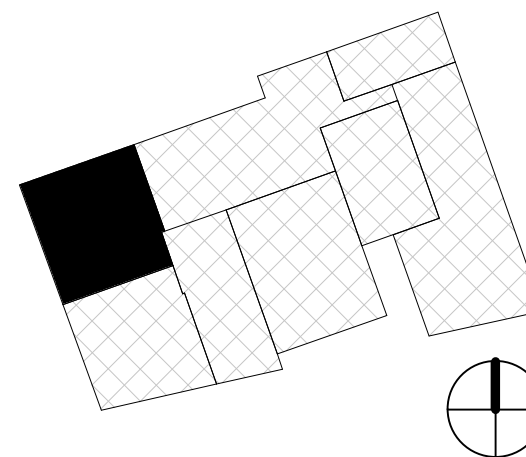

APPLICANT OF RECORD:



20 E 49TH ST. SUITE-3A
NEW YORK NY 10017

Tel: (212) 377-2456

Email: info@salamcons.com

3/22/2017 3:36:43 PM PLOT TIME/DATE

Date	Issue No.	Revision	Rev. Description

SCOPE OF WORK

ALT II STRUCTURAL RENOVATION
OF EXISTING ONE STORY
WAREHOUSE STRUCTURE

ADDRESS

537-561 Johnson Avenue
Brooklyn NY 11237

BLOCK: 2988

MAP #: 13b

LOT: 01, 49, 14

ZONING: M3-1

SHEET TITLE

Proposed Roof Framing Plan @
537 Johnson Avenue (1 of 2)

SEAL & SIGNATURE



DATE: 7/28/2016

PROJECT NO.: 170102

DRAWING BY: HSK

CHK BY: RAS

DWG NO.: S-008.00


File Directory:

2017-07-28 15:00 537 Johnson Avenue

OF 5

Orient and affix BIS
job number label here

PROGRESS SET - NOT FOR CONSTRUCTION



Scale: $1/8" = 1'-0"$

1. TOP OF CONC. SLAB ELEVATION (7/51) IS SHOWN THUS (+/-) ON PLAN.
2. SLAB TO BE A 6" THICK SLAB ON GRADE, REINFORCED W/6# - W2.9XW2.9 WWF ON VAPOR BARRIER
3. EL. TO B.O. FOOTINGS ARE DENOTED THUS (+/-) ON PLAN RELATIVE TO BASEPLANE
4. ALL FOOTINGS SHALL BEAR ON SOIL WITH A MINIMUM 2.5 TON/SQ. FT. CAPACITY
5. WALL BUTTRESSES ARE TYPE WB1 UNLESS OTHERWISE NOTED
6. BOTTOM ELEVATION OF SPREAD FOOTING TO BE (-2'-2") FROM TOP OF SLAB, UNLESS OTHERWISE NOTED
7. EXISTING TIE (OR STRAP) BEAMS DENOTED AS GB-1 ARE 24" D X 16" W - WITH ASSUMED TOP AND BOTTOM REINFORCEMENT 3" - (#6) EXTENDED A MINIMUM OF 3'-0" INTO THE FOOTINGS. STIRRUPS ARE TO BE #3 BARS @ 10" O.C.
8. PROPOSED TIE BEAMS ARE ALSO THUS DENOTED ON PLANS AS (GB-1)
9. FOR FOOTING, BUTTRESS, AND WALL REINFORCEMENT SEE SCHEDULES AND DETAILS SHOWN ON THIS DRAWING AND SECTION DETAILS.
10. SEE DRAWINGS 5-001 FOR GENERAL NOTES, LIST OF ABBREVIATIONS AND LEGEND
11. CONTRACTOR SHALL CONDUCT PRECONSTRUCTION SURVEY OF ADJACENT EXISTING BUILDINGS BEFORE EXCAVATION. UNDERPINNING OR STIFF SHEETING AS REQUIRED.

Grand total: 69


CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS AND BE RESPONSIBLE FOR FIELD FIT AND QUALITY OF WORK. NO ALLOWANCES SHALL BE MADE IN BEHALF OF THE CONTRACTOR FOR ANY ERROR OR NEGLIGENCE ON HIS PART.

■■■■■

Email:---

Contractor:
Cristom Construction Services
151-01 14th Avenue
Whitestone NY 11357

Tel: (718) 747-4747 Email: info@crustomconstruction.com

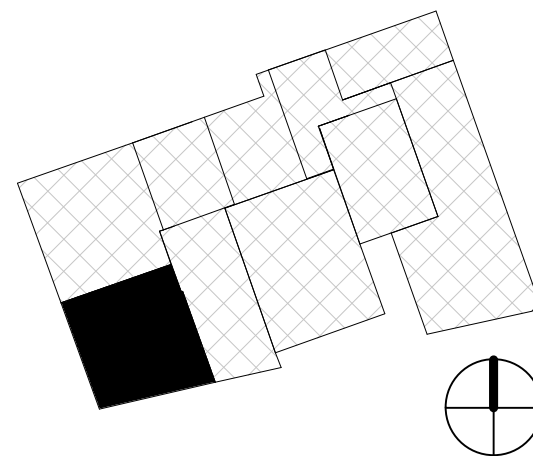

20 E 49TH ST. SUITE-3A
NEW YORK NY 10017

Tel: (212) 377-2456

Email: info@salamcons.com

3/22/2017 3:36:44 PM

PLOT TIME/DATE

Date	Issue No.	Rev. Description

ALT II STRUCTURAL RENOVATION OF EXISTING ONE STORY WAREHOUSE STRUCTURE

**537-561 Johnson Avenue
Brooklyn NY 11237**

BLOCK: 2988

MAP #: 13b

LOT: 01, 49, 14

ZONING:M3-1

SHEET TITLE

Existing Foundation Plan and Slab Layout @ 537 Johnson Avenue (2 of 2)

SEAL & SIGNATURE

DATE: 7/28/2016

PROJECT NO.: 170102

DRAWING BY: HSK

CHK BY: RAS


DWG NO.:

S-009.00

File Directory:
IBM 360/537-561 Johnson Av
Johnson, Arizona, AZ

OF 5

 Orient and affix BIS
job number label here

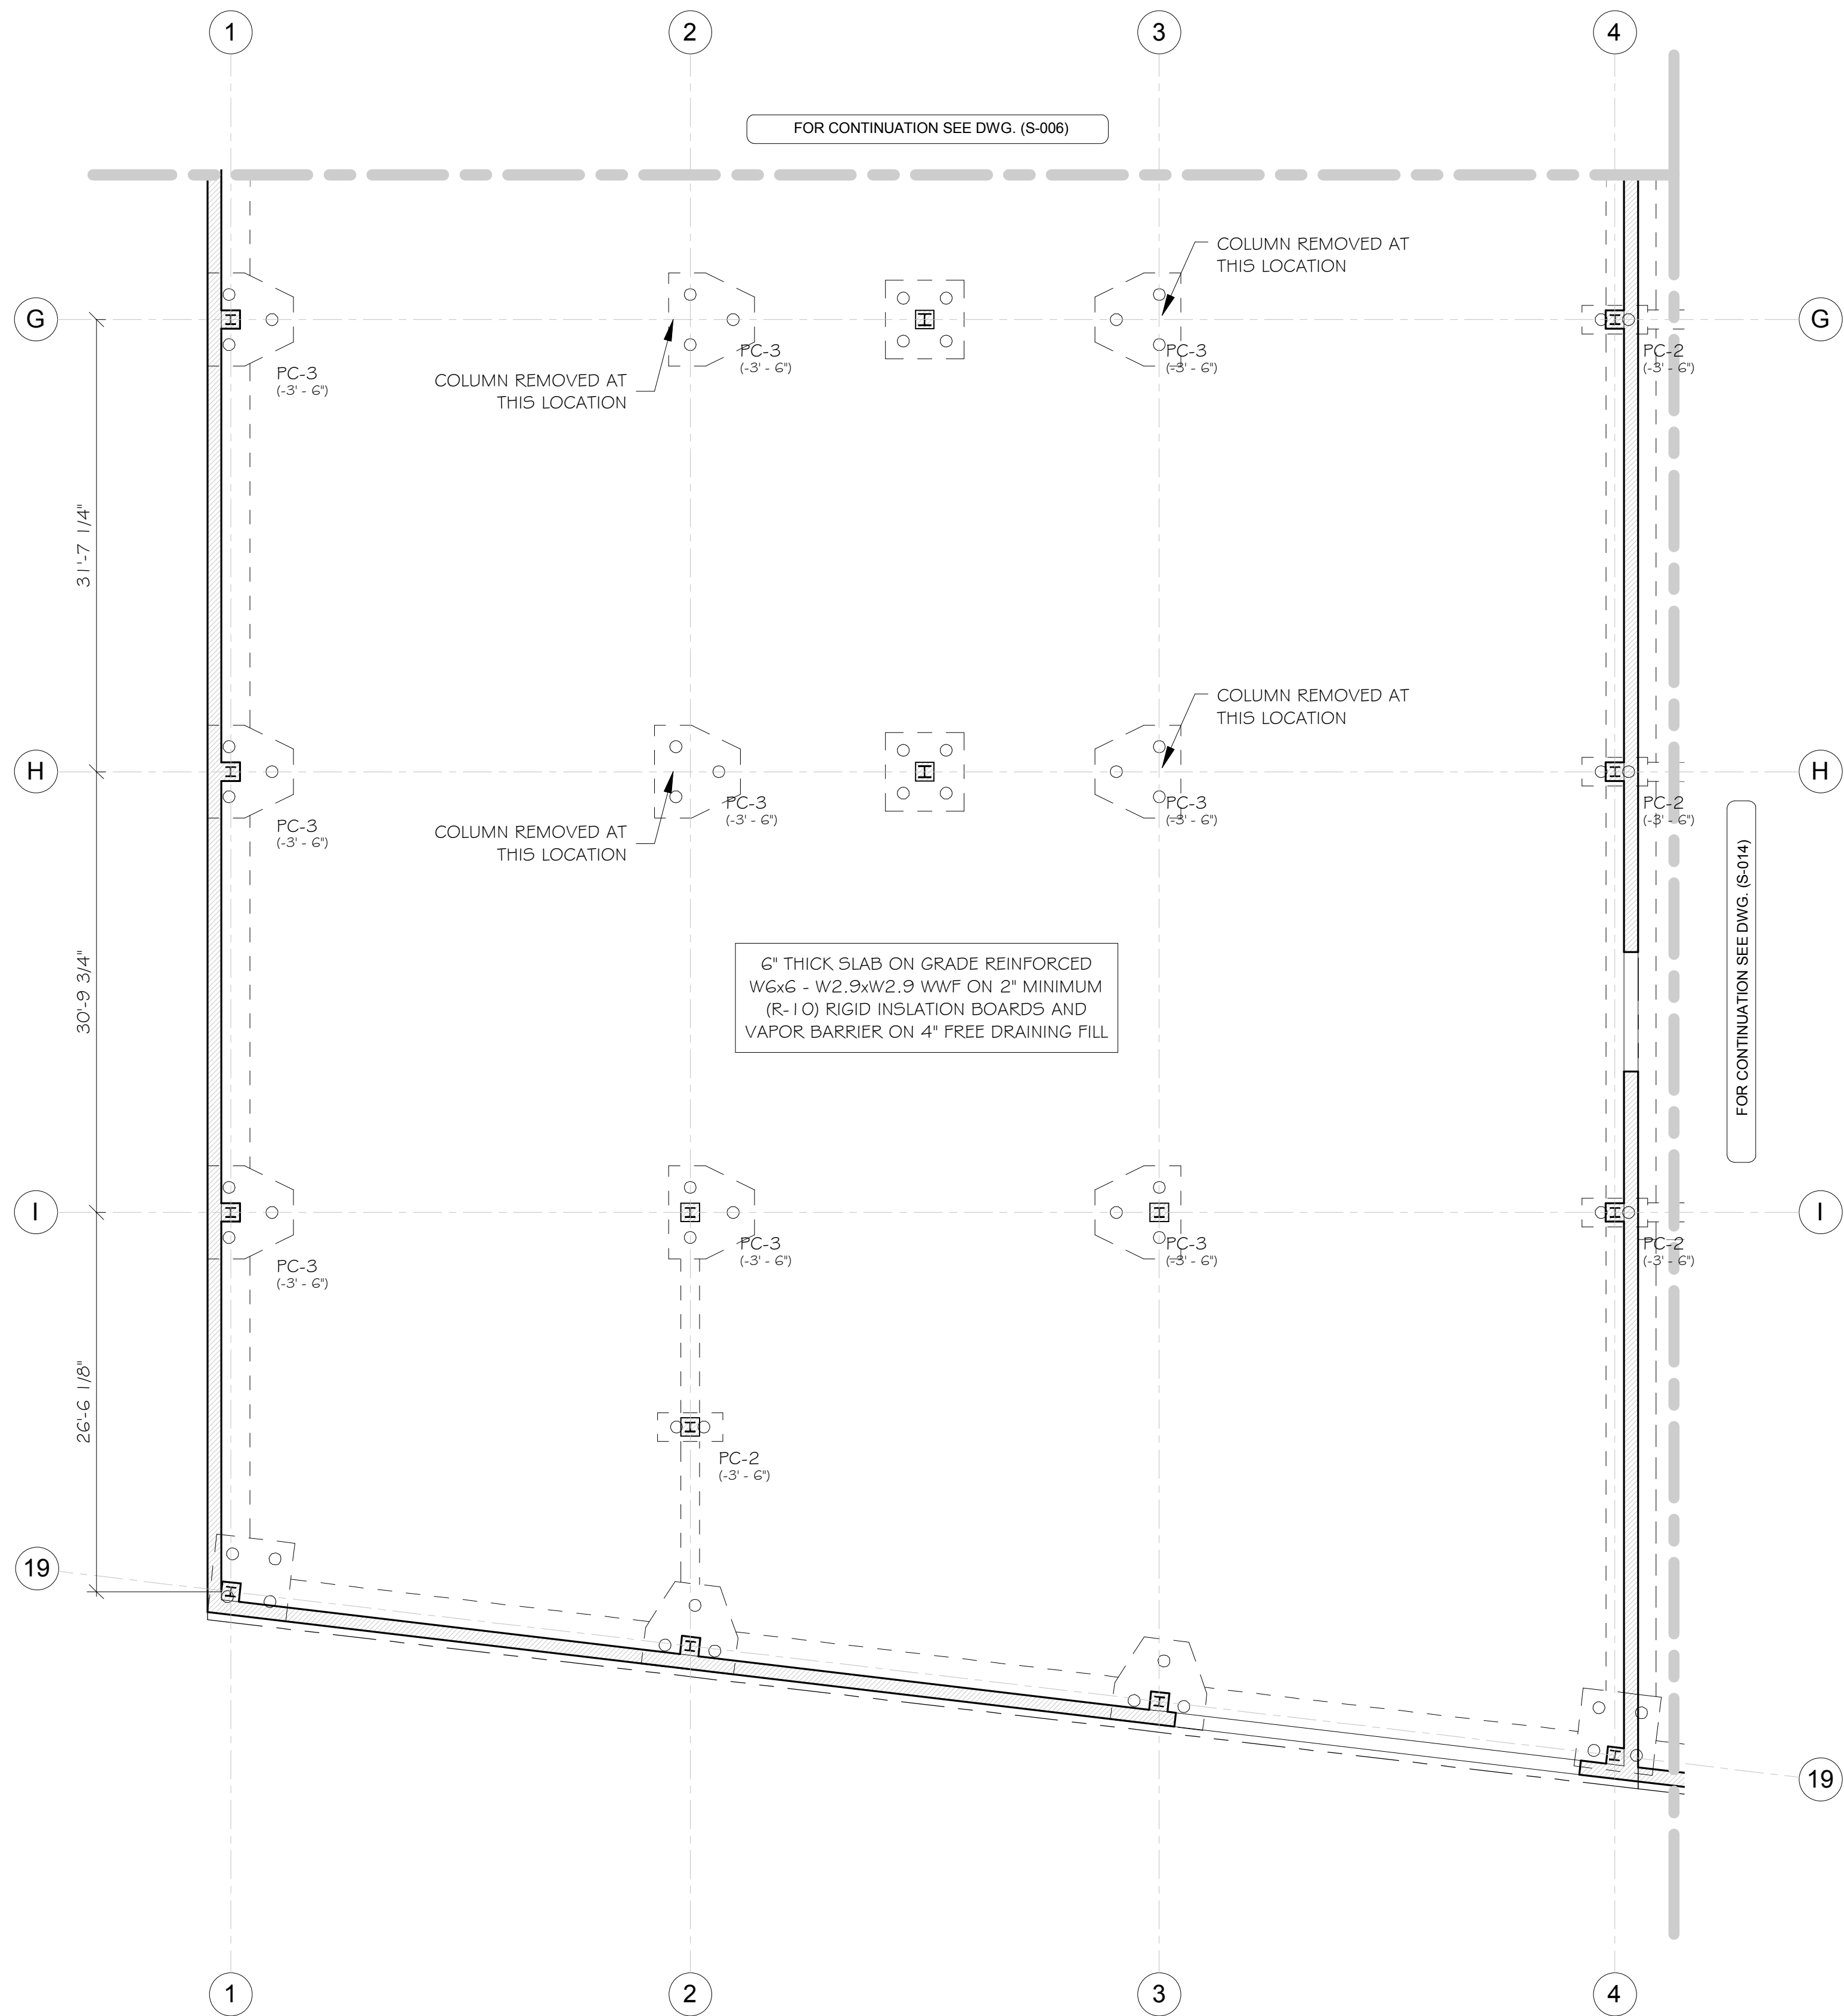

Partial - Proposed Slab on Grade and Pilecap Layout @ 537 Jonhson Ave (2 of 2):

Scale: 1/8" = 1'-0"

NOTES:

1. TOP OF CONC. SLAB ELEVATION (T/S) IS SHOWN THUS [+/-] ON PLAN.
2. SLAB TO BE A 6" THICK SLAB ON GRADE, REINFORCED W6x6 - W2.9xW2.9 WWF ON VAPOR BARRIER.
3. EL. TO B.O. FOOTINGS ARE DENOTED THUS [+/-] ON PLAN RELATIVE TO BASEPLANE
4. ALL FOOTINGS SHALL BEAR ON SOIL WITH A MINIMUM 2.5 TON/SQ. FT. CAPACITY
5. WALL BUTTRESSES ARE TYPE WB1 UNLESS OTHERWISE NOTED
6. BOTTOM ELEVATION OF SPREAD FOOTING TO BE (-2'-2") FROM TOP OF SLAB, UNLESS OTHERWISE NOTED
7. EXISTING TIE (OR STRAP) BEAMS DENOTED AS GB-1 ARE 24" D X 16" W - WITH ASSUMED TOP AND BOTTOM REINFORCEMENT 3 - (#6) EXTENDED A MINIMUM OF 3'-0" INTO THE FOOTINGS. STIRRUPS ARE TO BE #3 BARS @ 10" O.C.
8. PROPOSED TIE BEAMS ARE ALSO THUS DENOTED ON PLANS AS (GB-1)
9. FOR FOOTING, BUTTRESS, AND WALL REINFORCEMENT SEE SCHEDULES AND DETAILS SHOWN ON THIS DRAWING AND SECTION DETAILS.
10. SEE DRAWINGS 5-001 FOR GENERAL NOTES, LIST OF ABBREVIATIONS AND LEGEND
11. CONTRACTOR SHALL CONDUCT PRECONSTRUCTION SURVEY OF ADJACENT EXISTING BUILDINGS BEFORE EXCAVATION. UNDERPINNING OR STIFF SHEETING AS REQUIRED.

Copyright © 2015 Rizwan A. Salam PE Consulting Engineers (RAS) - This drawing is an instrument of service and the sole property of the RAS or the Applicant of Record (AoR). Any use of this drawing without the consent of RAS is prohibited.
Drawing scales as indicated are for reference only and are not intended to accurately depict actual or designed conditions. Written dimensions shall govern.

CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS AND BE RESPONSIBLE FOR FIELD FIT AND QUALITY OF WORK. NO ALLOWANCES SHALL BE MADE IN BEHALF OF THE CONTRACTOR FOR ANY ERROR OR NEGLIGENCE ON HIS PART.

Client:

Tel: ---

Email:---


Contractor:

Cristom Construction Services

151-01 14th Avenue
Whitestone NY 11357

Tel: (718) 747-4747

Email: info@cristomconstruction.com

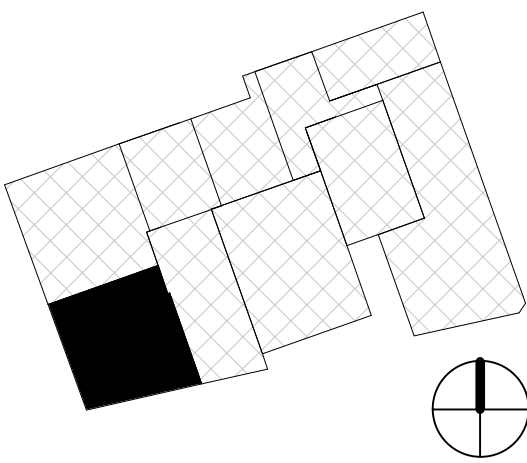

APPLICANT OF RECORD:



20 E 49TH ST. SUITE-3A
NEW YORK NY 10017

Tel: (212) 377-2456

Email: info@salamcons.com

3/22/2017 3:36:44 PM

PLOT TIME/DATE

Date	Issue No.	Rev.	Description

SCOPE OF WORK

ALT II STRUCTURAL RENOVATION OF EXISTING ONE STORY WAREHOUSE STRUCTURE

ADDRESS

537-561 Johnson Avenue
Brooklyn NY 11237

BLOCK: 2988

MAP #: 13b


LOT: 01, 49, 14

ZONING:M3-1

SHEET TITLE

Proposed Foundation Plan and Slab Layout @ 537 Johnson Avenue (2 of 2)

SEAL & SIGNATURE

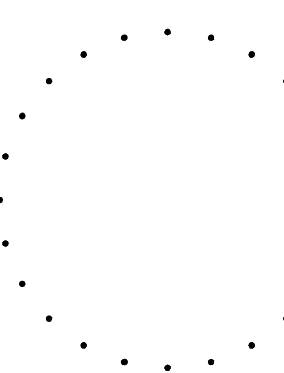

DATE: 7/28/2016

PROJECT NO.: 170102

DRAWING BY: HSK

CHK BY: RAS

DWG NO.:

S-010.00

File Directory:


884 480-111-101 Johnson Avenue 157

Whitestone Avenue 11357

11 OF 5

Orient and affix BIS
job number label here

PROGRESS SET - NOT FOR CONSTRUCTION



Scale: $1/8" = 1'-0"$

1. TOP OF SLAB ELEVATION (T/S/L) IS NOTED THUS [+/-] ON PLAN
2. PROPOSED ROOF SLAB IS 3' N. WT. CONCRETE ON 1-1/2x20 NON-COMPOSITE GA. MTL DECK, REINFORCED WITH WWM G&G - W1.4xW1.4.
3. — DENOTES THE DIRECTION OF THE METAL DECK
4. TOP OF STRUCTURAL STEEL (T/S/L) IS 4 1/2" BELOW TOP OF SLAB (T/S/L) UON THUS [+/-] ON PLAN, INDICATING DISTANCE ABOVE OR BELOW TOP OF SLAB.
5. NUMBER OF SHEAR STUDS SHOWN THUS AFTER THE BEAM SIZE (##)
6. THE END REACTIONS OF THE BEAMS ARE SHOWN THUS (_ KIP) AT BEAM ENDS
7. STEEL BEAMS SHALL BE EQUALLY SPACED WITHIN BAYS UNLESS OTHERWISE NOTED.
8. BEAM SIZES NOT SHOWN SHALL BE A MINIMUM OF W12x19
9. SEE DRAWINGS 5-001 FOR GENERAL NOTES, LIST OF ABBREVIATIONS AND LEGEND
10. FOR BRACING, SEE ELEVATIONS.
11. FOR COLUMN SCHEDULE SEE 5-008
12. CONTRACTOR TO VERIFY ALL DIMENSIONS ON FIELD AND REPORT ANY DISCREPANCIES TO ENGINEER OF RECORD

Copyright © 2015 Rizwan A. Salam PE Consulting Engineers (RAS) - This drawing is an instrument of service and the sole property of the RAS or the Applicant of Record (AOR). Any use of this drawing without the consent of RAS is prohibited.

Drawing scales as indicated are for reference only and are not intended to accurately depict actual or designed conditions. Written dimensions shall govern.

CONTRACTOR SHALL VERIFY ALL FIELD CONDITIONS AND DIMENSIONS AND BE RESPONSIBLE FOR FIELD FIT AND QUALITY OF WORK. NO ALLOWANCES SHALL BE MADE IN BEHALF OF THE CONTRACTOR FOR ANY ERROR OR NEGLIGENCE ON HIS PART.

Tel: ---


Contractor:

C

151-01 14th Avenue
Whitestone NY 11357

Tel: (718) 747-4747

Email: info@crisomconstruction.com

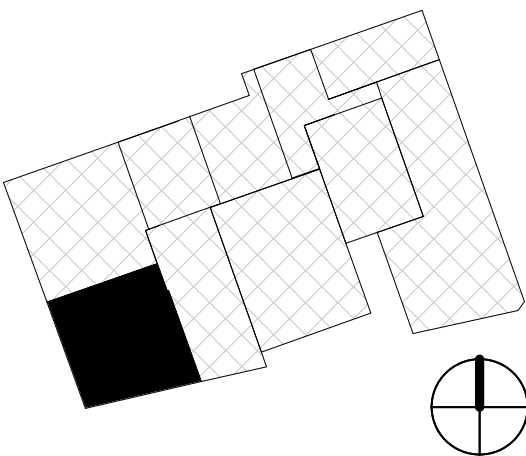

APPLICANT OF RECORD:



RAS P.E.
CONSULTING ENGINEERS
RIZWAN A. SALAM, P.E.

20 E 49TH ST. SUITE-3A
NEW YORK NY 10017

Tel: (212) 377-2456

Email: info@salamcons.com

[illegible]

SCOPE OF WORK

ALT II STRUCTURAL RENOVATION OF EXISTING ONE STORY WAREHOUSE STRUCTURE

ADDRESS

**537-561 Johnson Avenue
Brooklyn NY 11237**

BLOCK: 2988

MAP #: 13b

LOT: 01, 49, 14

ZONING:M3.

SHEET TITLE

Proposed Roof Framing Plan @ 537 Johnson Avenue (2 of 2)

SEAL & SIGNATURE

DATE: 7/28/2016

PROJECT NO.: 170102

DRAWING BY: HSK

CHK BY: RAS

DWG NO.

S-012.00

File Directory:

OF

 Orient and affix BIS
job number label here 