

JOB No./ No ЗАДАНИЯ GKT-26.08	DOC.No/ДОК. No 017RET-G4-49ES-0002	K	PAGE 1 OF 3 СТР. 1 ИЗ 3
	Technical Specification Eye Washer & Safety Shower		DATE : 24/11/2015 ДАТА :

	Owner Заказчик	State Concern "Turkmengas" Государственный Концерн «Туркменгаз»	
	Owner Job No. Задания	-	
	Project Проект	Gas to Gasoline Project Проект по переработке газа в бензин	
	Location Расположение	Akhal velayat, Turkmenistan Ахалский велаят, Туркменистан	
		OWNER Category No.	TK

TECHNICAL SPECIFICATION - EYE WASHER & SAFETY SHOWER

AA	24/11/2015	Issue For Comment	LB	OB	HE	GS
Rev. Ред.	Date Дата	Reason for Issue Причина выпуска	By Составлено	Checked Проверено	Chief Руководит	Approved Одобрено
This document and the information/data contained therein is confidential, remains RONESANS ENDÜSTRİ TESİSLERİ İNŞAAT SANAYİ VE TİCARET ANONİM ŞİRKETİ (RET), and has been provided for use on the Gas to Gasoline Project only. The use of this document and the information/data contained therein is governed by the confidentiality and intellectual property provisions of the relevant Agreement(s) between the party whom this document is delivered to and KHI and RET. It must not be otherwise copied, loaned or transferred, used for any other purpose, nor must the information it contains be disclosed to any other party, other than as required for the execution of the Gas to Gasoline Project, without the written consent of KHI and RET. Этот документ и информация (данные), содержащиеся в нем далее, являются конфиденциальными и остаются собственностью Kawasaki Heavy Industries, Ltd (KHI) , предоставляются только для использования в рамках Проекта по переработке газа в бензин. Использование данного документа и информации/данных, содержащейся в нем, охраняется статьями о конфиденциальности и интеллектуальной собственности соответствующим Соглашением(и) между сторонами, которым этот документ адресован, и KHI. Другими словами, он не должен быть копирован, отдан в займы или передан, использован для любых других целей без письменного согласия KHI, также как информация, содержащаяся в нем, не должна быть открыта никакой другой стороне , кроме случая, когда информация запрошена для выполнения Проекта по переработке газа в бензин.						

**RÖNESANS**
ENDÜSTRİ TESİSLERİ

CUSTOMER'S NAME:		State Concern "Turkmengas		UNIT N°:	G4-1 , G4-2
LOCATION:		Akhal velayat, Turkmenistan		SERVICE:	-
PROJECT N°:		017-Gas to Gasoline Project		ITEM N°:	No. REQD: 9
				P&ID N°:	31-25PID038
CHANGE	REV. AA	REV.	REV.		
DATE	24/11/2015				
ORIG. BY	LB				
APPROVED BY	GS				
General					
Type		Standard Type			
		Eye Washer & Safety Shower			
Quantity		9			
Code/Standard		ANSI Z358.1			
Location		Outdoor			
Design Condition					
Fluid		Potable Water			
Operating Press. Barg		3.5		(Max.)	
		2.0		(Nor.)	
		1.5		(Min.)	
Operating Temp. °C		0-35			
Design Press. Barg		7.0			
Design Temp. °C		65.0			
Min. Capacity, Performance Criteria		As per ANSI Z358.1			
Ambiant Temperature (min/avarage/max.) °C		-29 / 38.5 / 47		(Note 1)	
Connection					
Inlet Size		By Vendor			
Outlet Size		By Vendor			
Type		Flange(150-RF)			
Material					
Body		By Vendor			
Valve		By Vendor			
Accessory		By Vendor			
Accessory		Anchor Bolt		Supplied by Vendor	
Hazardous Area		Refer to 9-80DWG121D, 9-80DWG121E			
Test & Inspection					
Hyd. Test. Barg		10.5			
Others					
Scald protection bleed valve		Yes		38 °C Open, 28 °C Close , Verify by Vendor (Note 2)	
Flow Switch		—			
Alarm Bell		—			
Alarm Light		—			
Interior Light		—			
Space Heater		—			
Note:					
1) The electrical tracing shall be applied to the safety showers and eyewashers					
2) Vendor shall supply the Scald protection bleed valves if neccessary (9 sets) .					
3) Vendor shall consider the pressure and flow control system for personal safety.					
4) Refer to Utility Station Map for the safety shower locations.					

CUSTOMER'S NAME: State Concern "Turkmengas"
LOCATION: Akhal velayat, Turkmenistan
PROJECT N°: 017-Gas to Gasoline Project

UNIT N°: G4-1, G4-2
SERVICE: -
ITEM N°: No. REQD: 9
P&ID N°: 31-25PID038

CHANG	REV.	REV.	REV.
AA			
DATE	24/11/2015		
ORIG. E	LB		
APPRO	GS		

No.	Safety Shower No.			BUILDING No.	BUILDING NAME (Note 4)	ELEVATION	Line No.	P&I No.
1	21-	SP	800	G4-2	Product Storage Area	HOLD	DW31508-1.5"(12AG0T01)-J	31-25PID038
2	21-	SP	801	G4-1	Product Loading Area	HOLD	DW31509-1.5"(12AG0T01)-J	31-25PID038
3	21-	SP	802	G4-1	Product Loading Area	HOLD	DW31509-1.5"(12AG0T01)-J	31-25PID038
4	21-	SP	803	G4-2	Product Storage Area	HOLD	DW31508-1.5"(12AG0T01)-J	31-25PID038
5	21-	SP	804	G4-2	Product Storage Area	HOLD	DW31508-1.5"(12AG0T01)-J	31-25PID038
6	21-	SP	805	G4-1	Product Loading Area	HOLD	DW31509-1.5"(12AG0T01)-J	31-25PID038
7	21-	SP	806	G4-2	Product Storage Area	HOLD	DW31508-1.5"(12AG0T01)-J	31-25PID038
8	75-	SP	800	G4-1	Acid Storage Area	HOLD	DW31511-1.5"(12AG0T01)-J	31-25PID038
9	75-	SP	801	G4-1	Acid Storage Area	HOLD	DW31511-1.5"(12AG0T01)-J	31-25PID038

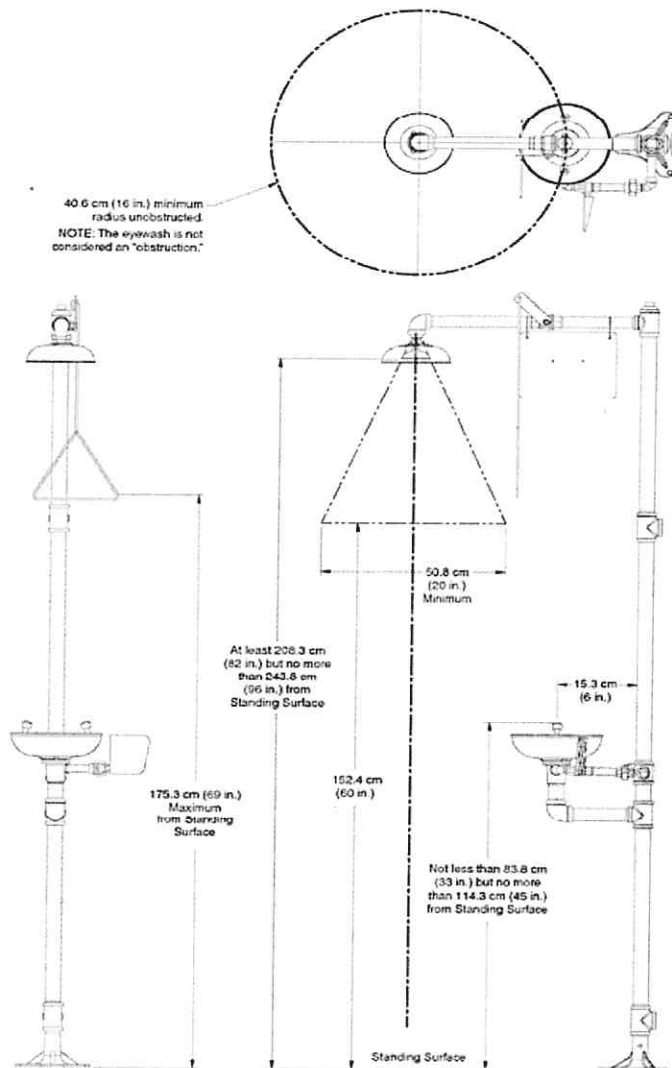


Figure 1: Illustration of Combination Unit