Mobil™

Alert

Unit ID: **4RK1** Asset ID: **51081631**

Description: **Kiln 2 Drive pinion gear**

Account Information

ID: **402009**

Name: **Greer Lime**

Address: **1088 Germany Valley Limestone Road, Riverton, WV 26814-0000 US**

Parent Account: **MATTHEWS LUBRICANTS, INC.**

Sample Information

Sample ID: **25308622010**

Service Level: **Essential**

Bottle ID: **a003620679**

Tested Lubricant: **MOBIL SHC GEAR 6800**

Equipment Information

Asset Class: **Gear Drive**

Manufacturer:

Model:

Lubricant: **MOBIL SHC GEAR 6800**

Sample Data & Trends

Sample Info	Report Status	Normal	Caution	Caution	Alert	Alert
	Sample ID	24163536007	24257608002	24312657001	24330642003	25308622010
	Service Level	Enhanced	Enhanced	Enhanced	Enhanced	Essential
	Bottle ID	b051031318	b051053847	b051055913	b051035694	a003620679
	Tested Lubricant	MOBIL SHC GEAR 6800	MOBIL SHC GEAR 6800	MOBIL SHC GEAR 6800	MOBIL SHC GEAR 6800	MOBIL SHC GEAR 6800
	Sampled	03 Jun 2024	29 Aug 2024	15 Oct 2024	13 Nov 2024	21 Jul 2025
	Reported	19 Jun 2024	18 Sep 2024	09 Nov 2024	27 Nov 2024	06 Nov 2025
	Equipment Age					
	Oil Age					
	Make-up Volume					
	Oil Changed					
	Filter Changed					
Lubricant	Contamination Rating	Normal	Caution	Caution	Caution	Alert
	Equipment Rating	Normal	Normal	Normal	Alert	Normal
	Lubricant Rating	Normal	Normal	Normal	Normal	Caution
	PQ Index				6423	
	Visc@100C (cSt)					
	TAN (mg KOH/g)				0.03	0.04
	Water (Hot Plate)					Detected
	Water (Vol%)				0.017	

Viscosity

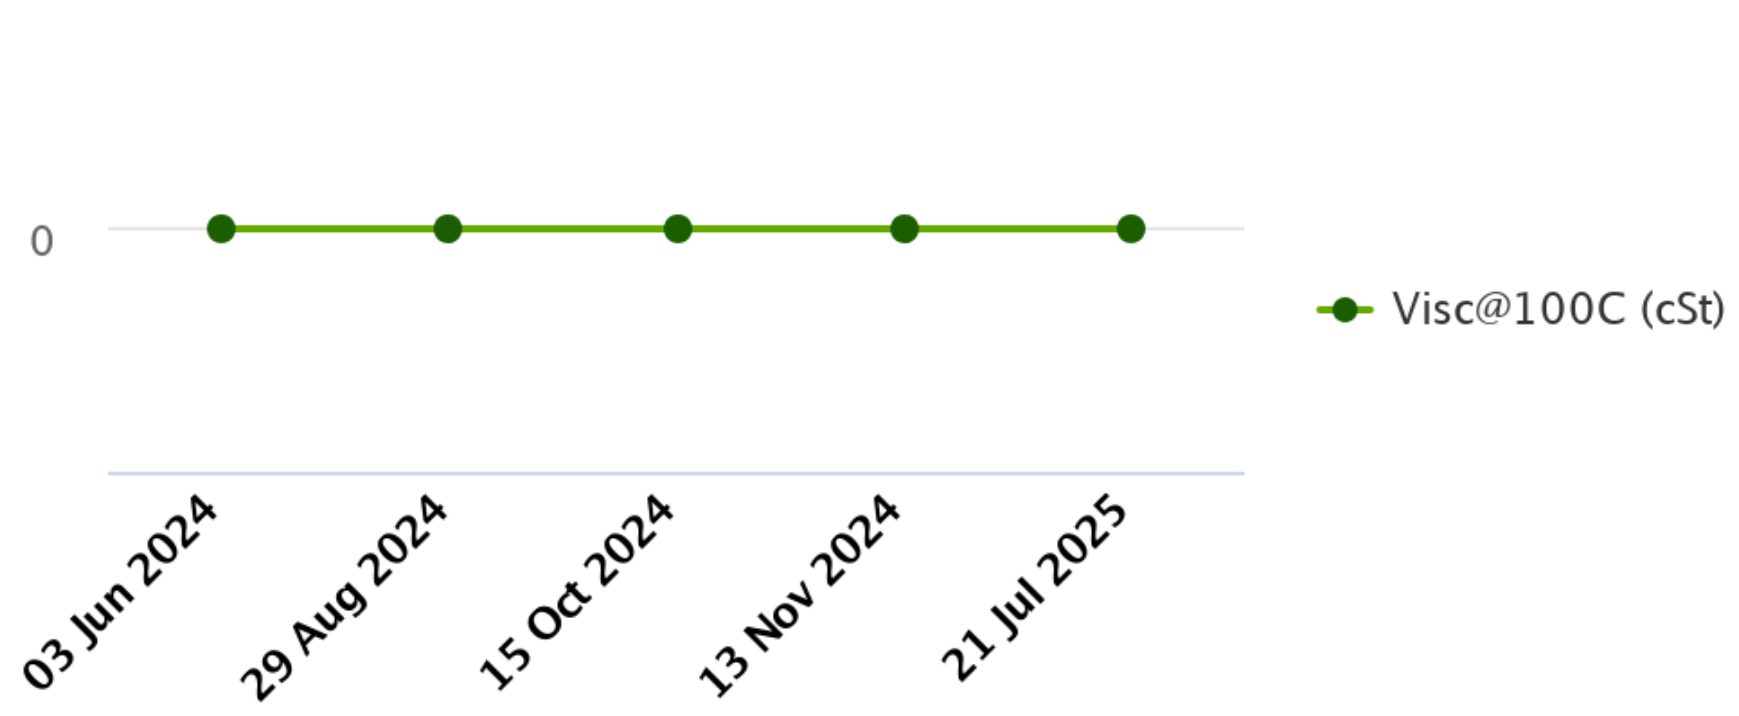

Physical Properties

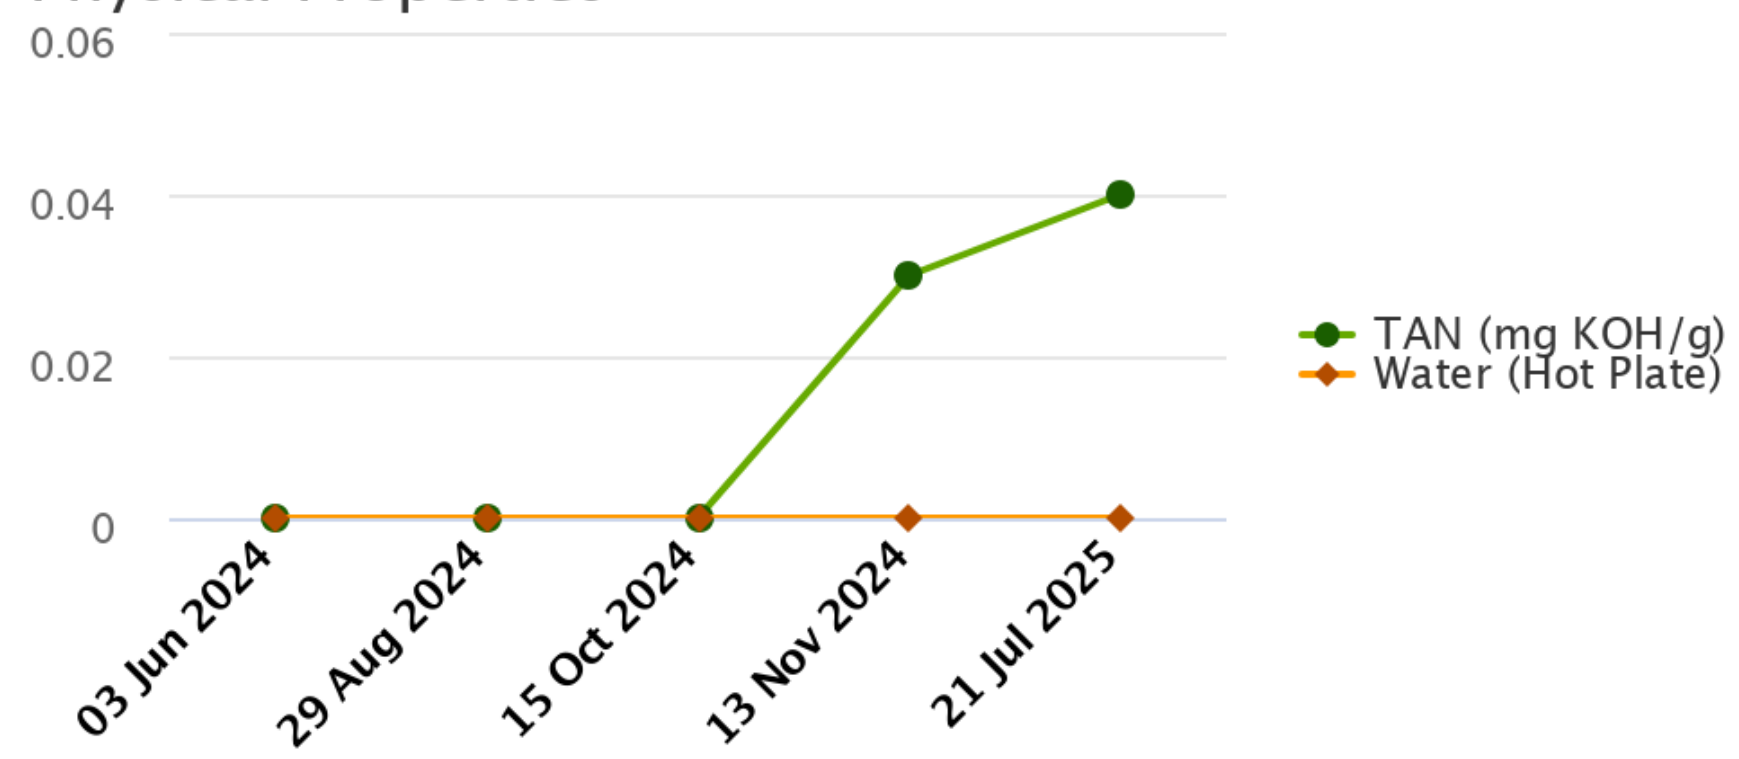

Recommendation/Comments

ACTION REQUIRED - EXCESSIVE WATER CONTAMINATION. Determine source of water and take corrective action. Analyze the oil with an on-site water test if accessible. Possible sources of water include: a. Leaking seals; b. Condensation resulting from low operating temperatures or prolonged shutdowns; c. Compromised oil cooler; d. Direct exposure to atmosphere as a result of compromises to system components (i.e. improperly sealed tank fill access point). Remove water from oil using centrifuges or dehydration units, or drain the oil and recharge the system with new oil. Resample the system after corrective measures have been implemented. Contact your ExxonMobil representative for further

Alert	
Unit ID: **4RK1**	Asset ID: **51081631**
Description: **Kiln 2 Drive pinion gear**	

Account Information	Sample Information	Equipment Information
ID: **402009**	Sample ID: **25308622010**	Asset Class: **Gear Drive**
Name: **Greer Lime**	Service Level: **Essential**	Manufacturer:
Address: **1088 Germany Valley Limestone Road, Riverton, WV 26814-0000 US**	Bottle ID: **a003620679**	Model:
Parent Account: **MATTHEWS LUBRICANTS, INC.**	Tested Lubricant: **MOBIL SHC GEAR 6800**	Lubricant: **MOBIL SHC GEAR 6800**

Continued

assistance if necessary.

ADMINISTRATION - UNTESTABLE SAMPLE. Tests were not able to be performed due to unusual properties of the oil and / or contamination with a non-oil substance. Oil samples that contain significant levels of coolant, ammonia, grease, or other non-oil substances can damage the laboratory's precision equipment. As a result, tests were not completed, and analysis was not provided. Before sending future ensure that no outside contamination was introduced into the original sample. Contact your ExxonMobil representative for assistance if necessary.

ACTION REQUIRED – EXCESSIVE CONTAMINATION. Due to the nature or condition of the sample, viscosity could not be performed. Oil samples that contain significant amounts of contaminants (i.e. water, fuel, coolant) and/or insolubles (i.e. soot, glycol) do not comply with the operating limitations of the laboratory equipment responsible for conducting viscosity tests. Before sending future samples to the laboratory, please ensure that no signs of excessive visible contamination are present. Oil samples should not be collected from the bottoms of a filter unit, tank, or crankcase due to the heavy concentrations of sediment that can deposit in these areas (resulting in a sample that is not representative of the system). Contact your ExxonMobil representative for further assistance.

Sample Timeline

- 21 Jul 2025 9:24 PM UTC - Brad Roy - In Service Oil Sample Comments: Photo: