Mobil™

Alert

Unit ID: **5-BM-1**

Asset ID: **50074772**

Description: **Kiln 2 Ball Mill Feed End Bearing**

Account Information

ID: **402009**

Name: **Greer Lime**

Address: **1088 Germany Valley Limestone Road, Riverton, WV 26814-0000 US**

Parent Account: **MATTHEWS LUBRICANTS, INC.**

Sample Information

Sample ID: **25342227014**

Service Level: **Essential**

Bottle ID: **a003620210**

Tested Lubricant: **MOBIL VACUOLINE 537**

Equipment Information

Asset Class: **Circulating System**

Manufacturer:

Model:

Lubricant: **MOBIL VACUOLINE 537**

Sample Data & Trends

Sample Info	Report Status	Normal	Alert	Alert	Alert	Alert
	Sample ID	**19352475036**	**25044280017**	**25147132044**	**25308280026**	**25342227014**
	Service Level	Essential	Essential	Essential	Essential	Essential
	Bottle ID	a005311802	a033581370	a033684445	a037321143	a003620210
	Tested Lubricant	MOBIL VACUOLINE 537	MOBIL VACUOLINE 537	MOBIL VACUOLINE 537	MOBIL VACUOLINE 537	MOBIL VACUOLINE 537
	Sampled	**12 Dec 2019**	**03 Feb 2025**	**18 May 2025**	**22 Oct 2025**	**03 Dec 2025**
	Reported	20 Dec 2019	18 Feb 2025	29 May 2025	06 Nov 2025	10 Dec 2025
	Equipment Age					
	Oil Age					
	Make-up Volume					
	Oil Changed					
	Filter Changed					
Lubricant	Contamination Rating	Normal	Alert	Alert	Alert	Alert
	Equipment Rating	Normal	Alert	Alert	Alert	Alert
	Lubricant Rating	Normal	Normal	Normal	Normal	Alert
	Visc@40C (cSt)	337.2	350.9	319.8	315.6	219.2
	Oxidation (Ab/cm)	0				
	Oxidation (Abs/cm) D7414		3	3	3	8
	Water (Hot Plate)	NotDetected	NotDetected	NotDetected	NotDetected	Detected
Wear (ppm)	Ag (Silver)		0	0	0	0
	Al (Aluminum)	6	202	12	18	0
	Cr (Chromium)	0	0	0	0	0
	Cu (Copper)	5	50	4	5	1
	Fe (Iron)	5	128	10	17	164
	Mo (Molybdenum)	0	0	0	0	0
	Ni (Nickel)	0	0	0	0	0
	Pb (Lead)	1	5	1	2	0
	Sn (Tin)	45	891	55	71	1
Contaminant (ppm)	K (Potassium)	0	33	2	2	1
	Na (Sodium)	1	11	1	3	0
	Si (Silicon)	9	268	22	31	8
Additive (ppm)	B (Boron)	0	11	0	3	0
	Ba (Barium)	0	2	0	0	0
	Ca (Calcium)	218	595	193	249	11
	Mg (Magnesium)	1	17	2	3	2
	P (Phosphorus)	377	254	442	421	223
	Zn (Zinc)	441	3	502	523	2

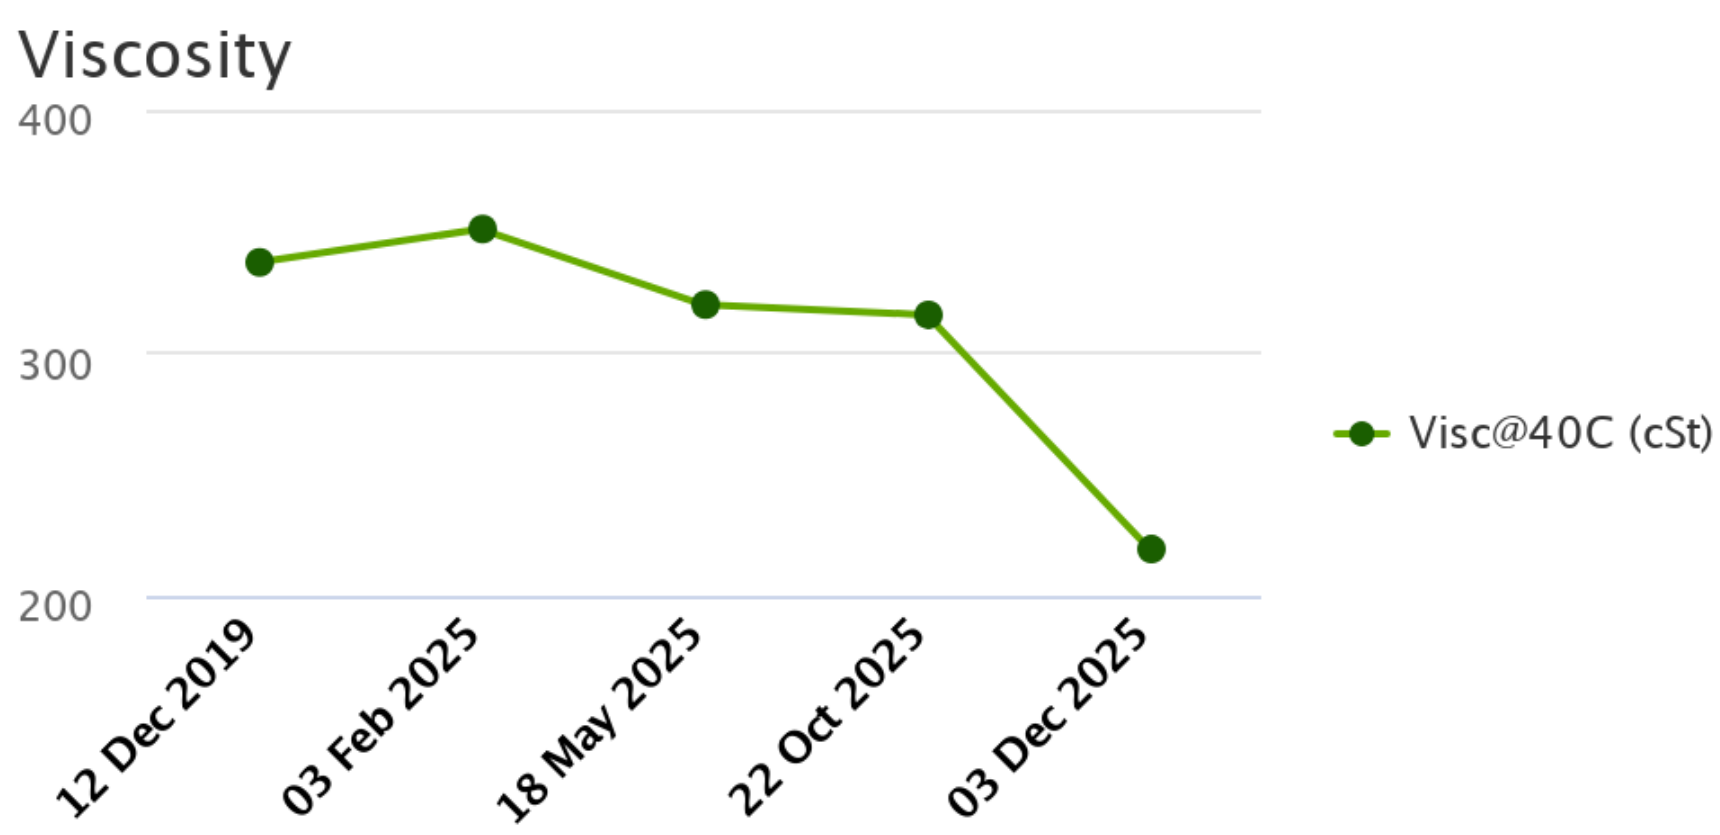

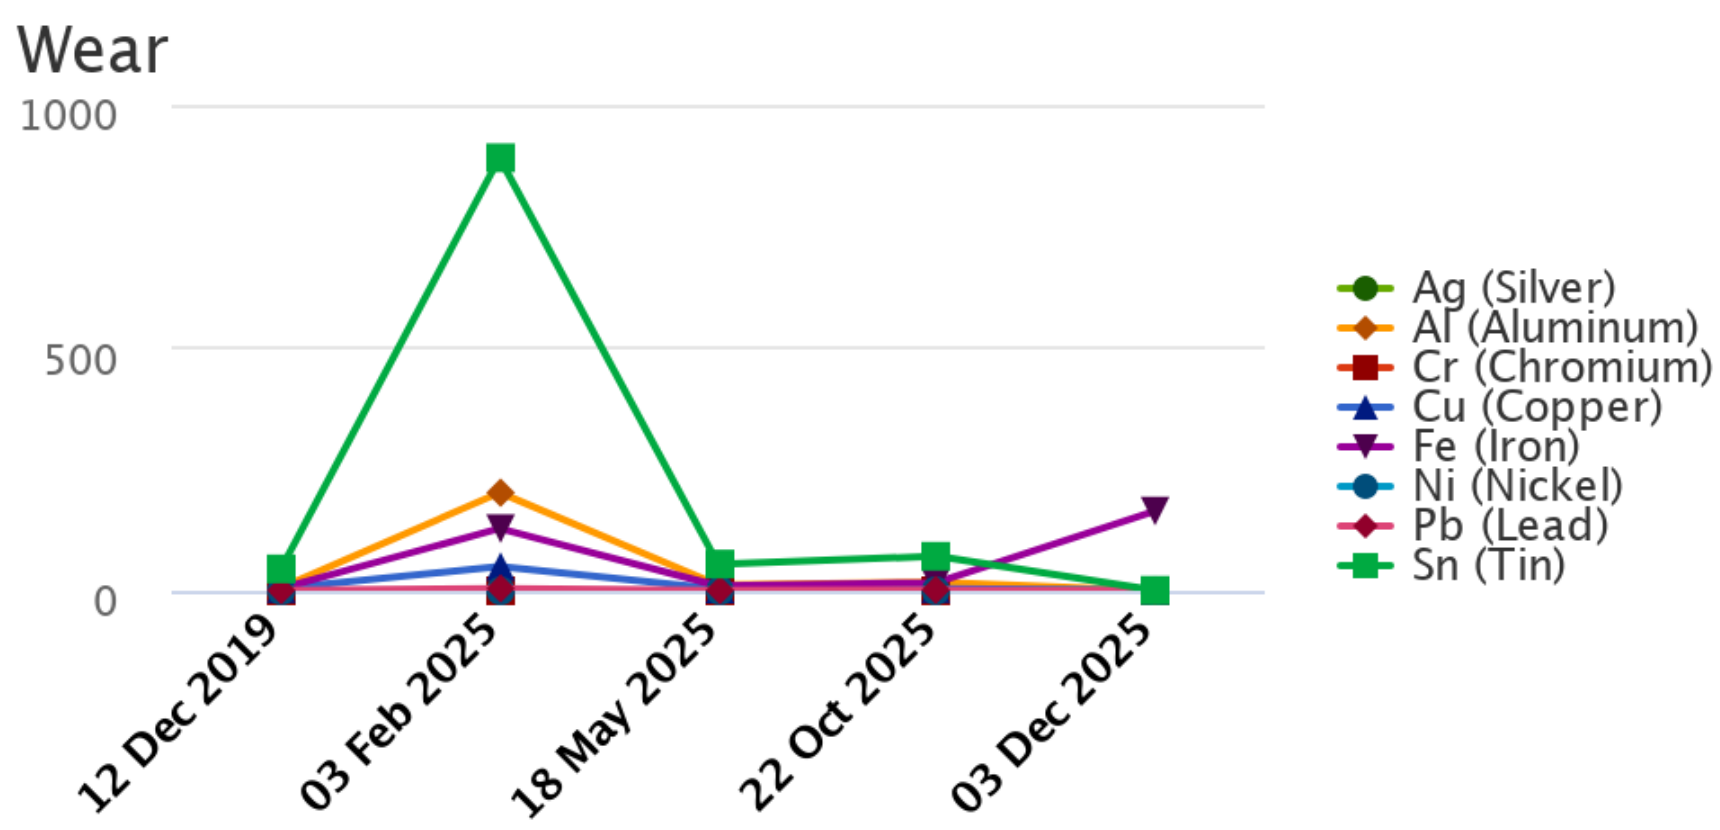

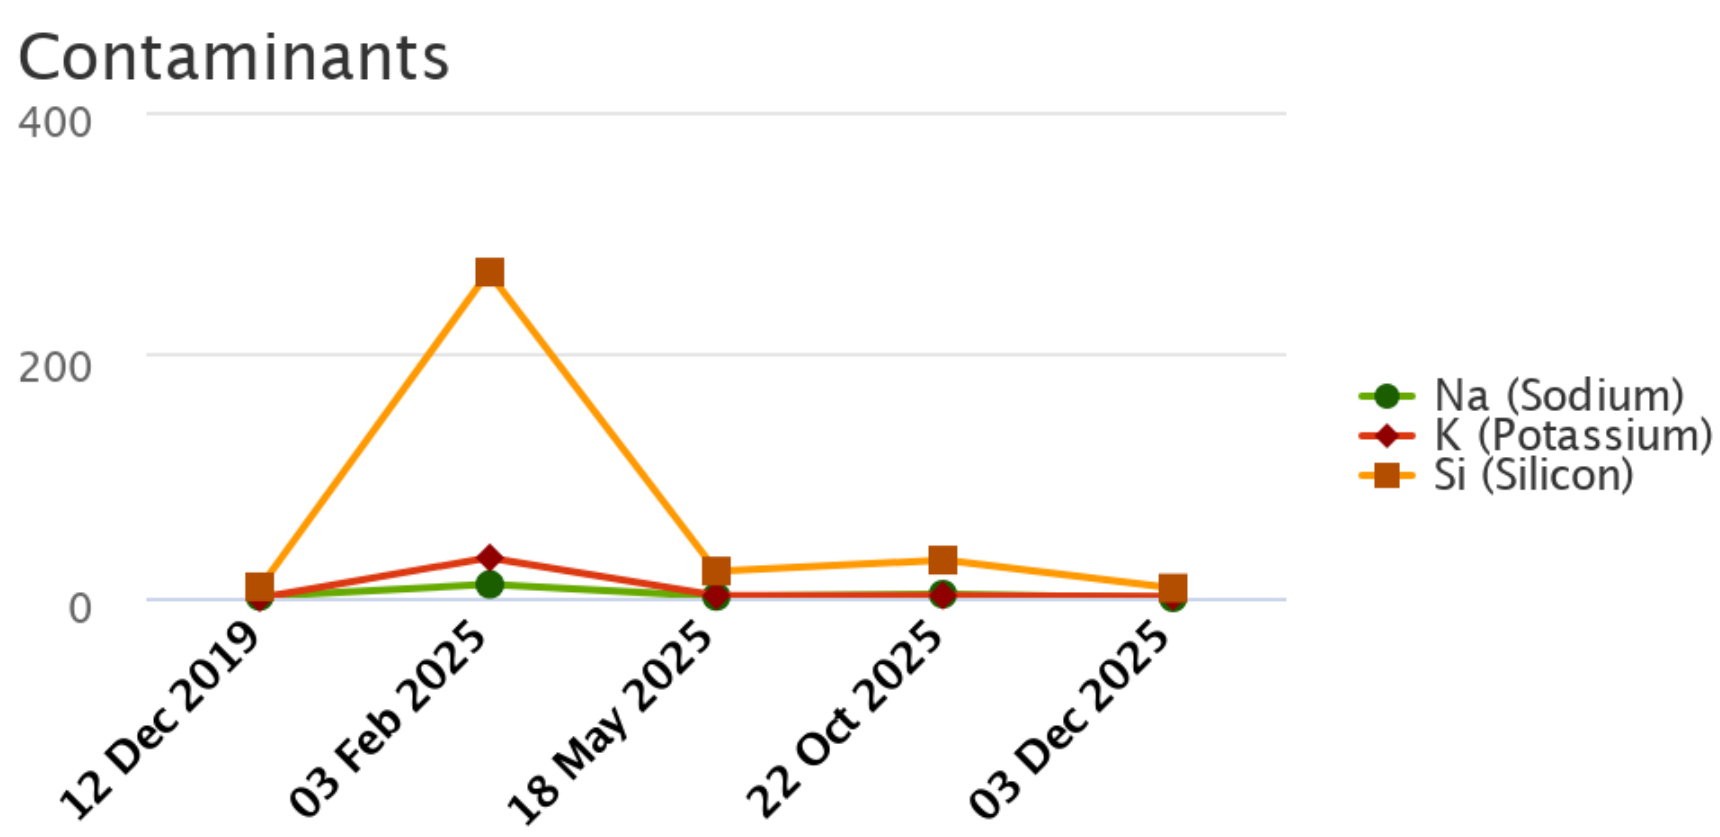

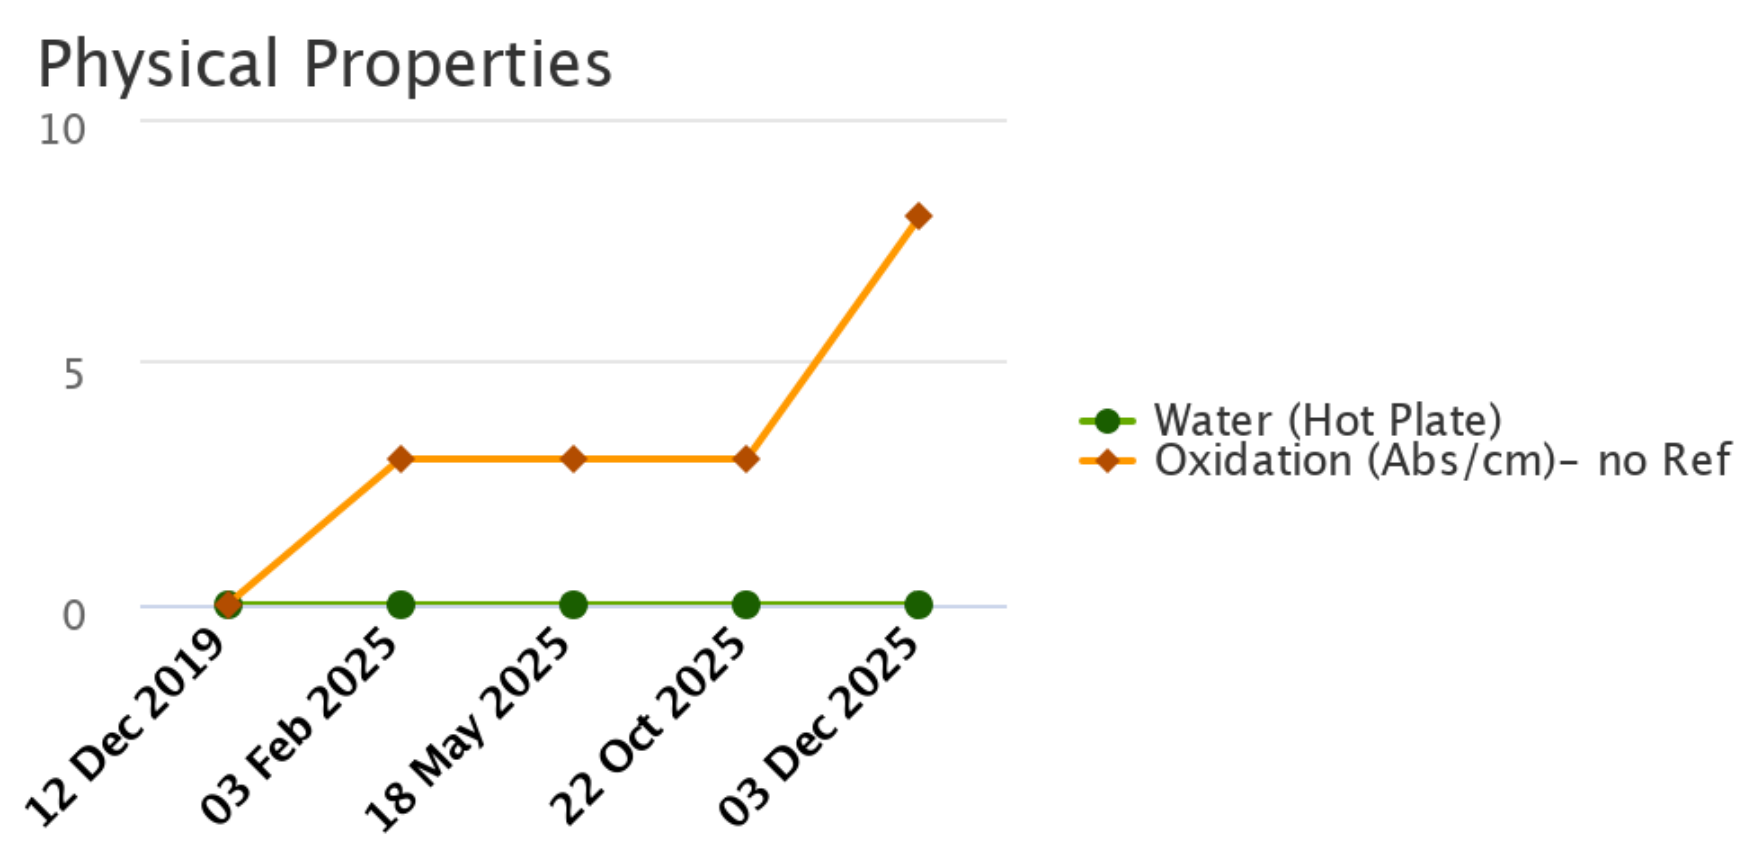

Mobil™

Alert

Unit ID: **5-BM-1** Asset ID: **50074772**

Description: **Kiln 2 Ball Mill Feed End Bearing**

Account Information

ID: **402009**

Name: **Greer Lime**

Address: **1088 Germany Valley Limestone Road, Riverton, WV 26814-0000 US**

Parent Account: **MATTHEWS LUBRICANTS, INC.**

Sample Information

Sample ID: **25342227014**

Service Level: **Essential**

Bottle ID: **a003620210**

Tested Lubricant: **MOBIL VACUOLINE 537**

Equipment Information

Asset Class: **Circulating System**

Manufacturer:

Model:

Lubricant: **MOBIL VACUOLINE 537**

Continued

Recommendation/Comments

ACTION REQUIRED - EXCESSIVE IRON LEVEL. Determine source of Iron (Fe) and take corrective action. If the iron level is excessive for the first time with no history of an increasing trend, then resample immediately to confirm condition. The oil and filter are unfit for continued use. Change the filter immediately and either centrifuge or change the oil. Prolonged usage of oil with excessive iron levels can adversely affect product performance and damage the equipment. Contact your ExxonMobil representative for further assistance if necessary.

CAUTION - ELEVATED OXIDATION. Oil oxidation is the chemical degradation of a lubricant at high temperatures and can contribute to the formation of dark varnish deposits on equipment. Determine cause of elevated oxidation and take corrective action. Potential causes of elevated oxidation include: a. High oil temperatures; b. Over-extended oil service life; c. Localized hot spots; d. Low oil level in reservoir; e. Poor oil circulation; f. Mixed lubricants of different formulations. The oil may be unfit for continued use and should be monitored closely for further condition regressions. A partial drain and refill with fresh oil may rejuvenate the oil condition. Change the oil immediately if the condition escalates. Contact your ExxonMobil representative for further assistance if necessary.

ACTION REQUIRED - REDUCED OIL VISCOSITY. Determine cause of reduced oil viscosity and take corrective action. Reduced viscosities can impair the lubricant's ability to protect the equipment. Possible causes of reduced viscosity include: a. Initial fill or contact with oil that has a lower viscosity; b. Contamination with a fuel or solvent; c. Incorrectly labeled sampled. Inspect the system for signs of fuel or coolant ingression. Resample the oil after corrective actions have been implemented. If the condition continues or escalates, recharge the system with new oil. Contact your ExxonMobil representative for further assistance if necessary.

ACTION REQUIRED - UNSATISFACTORY OIL CONDITION. Test results indicate that the condition of this oil sample is unsatisfactory. The oil may be unfit for continued use and should be closely monitored further condition regressions. Contact your ExxonMobil representative for further assistance if necessary.

ACTION REQUIRED - EXCESSIVE WATER CONTAMINATION. Determine source of water and take corrective action. Analyze the oil with an on-site water test if accessible. Possible sources of water include: a. Leaking seals; b. Condensation resulting from low operating temperatures or prolonged shutdowns; c. Compromised oil cooler; d. Direct exposure to atmosphere as a result of compromises to system components (i.e. improperly sealed tank fill access point). Remove water from oil using centrifuges or dehydration units, or drain the oil and recharge the system with new oil. Resample the system after corrective measures have been implemented. Contact your ExxonMobil representative for further assistance if necessary.

Sample Timeline

- 03 Dec 2025 10:29 PM UTC - Shawn Turner - In Service Oil Sample   Comments: Photo: