

MobilTM

Alert

Unit ID: 2-vs-1 lower

Asset ID: 50090471

Description: 2-vs-1 lower

Account Information

Sample Information

Equipment Information

ID: 402009

Name: Greer Lime

Address: 1088 Germany Valley Limestone Road, Riverton, WV 26814-0000 US

Parent Account: MATTHEWS LUBRICANTS, INC.

Sample ID: 25308280028

Service Level: Essential

Bottle ID: a037067794

Tested Lubricant: MOBIL DTE BB

Asset Class: Circulating System


Manufacturer:

Model:

Lubricant: MOBIL DTE BB

Sample Data & Trends

Sample Info	Report Status	Alert	Alert	Caution	Alert	Alert
	Sample ID	24312210013	25069424013	25154217074	25308280037	25308280028
	Service Level	Essential	Essential	Essential	Essential	Essential
	Bottle ID	a033577348	a003623639	a003624013	a037322264	a037067794
	Tested Lubricant	MOBIL DTE BB	MOBIL DTE BB	MOBIL DTE BB	MOBIL DTE BB	MOBIL DTE BB
	Sampled	25 Oct 2024	04 Mar 2025	21 May 2025	22 Oct 2025	28 Oct 2025
	Reported	11 Nov 2024	12 Mar 2025	05 Jun 2025	06 Nov 2025	06 Nov 2025
	Equipment Age					
	Oil Age					
	Make-up Volume					
	Oil Changed					
	Filter Changed					
Lubricant	Contamination Rating	Normal	Normal	Normal	Normal	Caution
	Equipment Rating	Alert	Alert	Caution	Alert	Alert
	Lubricant Rating	Normal	Normal	Normal	Normal	Normal
	Visc@40C (cSt)	234.0	235.3	230.0	232.5	226.9
	Oxidation (Abs/cm) D7414	6	3	3	3	3
	Water (Hot Plate)	NotDetected	NotDetected	NotDetected	NotDetected	NotDetected
Wear (ppm)	Ag (Silver)	0	0	0	0	0
	Al (Aluminum)	0	0	0	0	0
	Cr (Chromium)	1	0	0	0	0
	Cu (Copper)	21	22	12	8	8
	Fe (Iron)	73	72	47	89	78
	Mo (Molybdenum)	1	2	2	2	0
	Ni (Nickel)	0	0	0	0	0
	Pb (Lead)	1	2	2	2	1
	Sn (Tin)	1	2	1	0	3
Contaminant (ppm)	K (Potassium)	1	0	1	0	0
	Na (Sodium)	0	0	0	3	1
	Si (Silicon)	8	8	11	14	15
Additive (ppm)	B (Boron)	0	0	1	1	1
	Ba (Barium)	0	0	0	0	0
	Ca (Calcium)	130	123	45	42	38
	Mg (Magnesium)	1	1	0	1	1
	P (Phosphorus)	360	417	487	470	464
	Zn (Zinc)	9	10	6	16	13

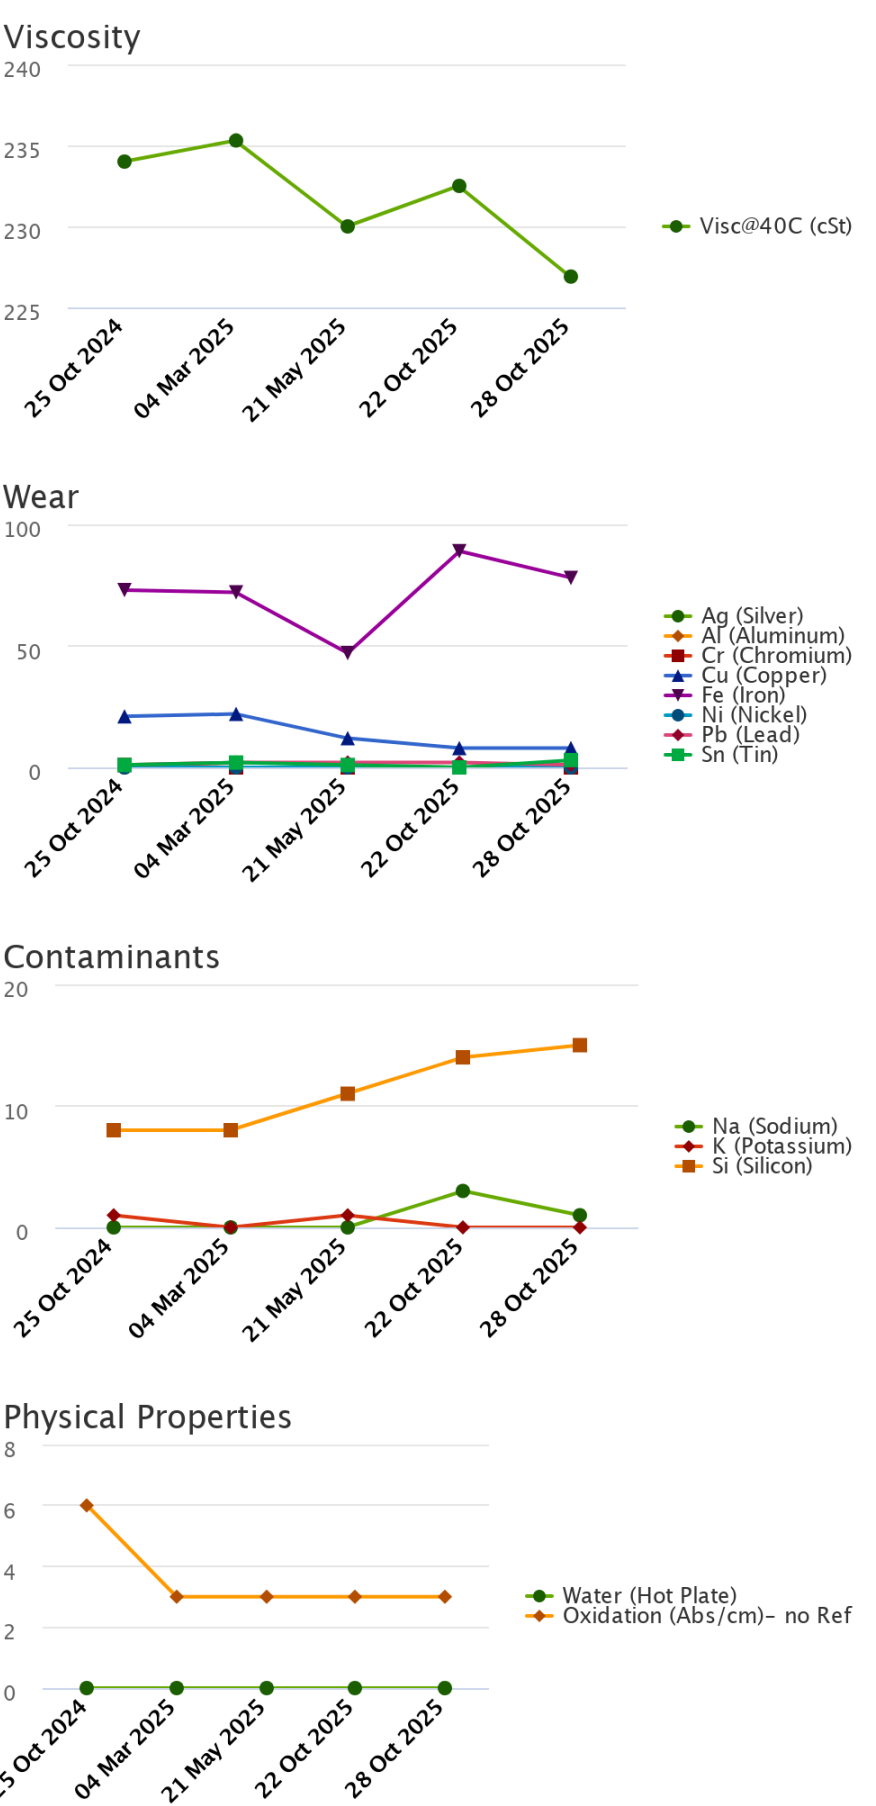



Alert

Unit ID: 2-vs-1 lowerAsset ID: 50090471

Description: 2-vs-1 lower

Account Information	Sample Information	Equipment Information
ID: 402009 Name: Greer Lime Address: 1088 Germany Valley Limestone Road, Riverton, WV 26814-0000 US Parent Account: MATTHEWS LUBRICANTS, INC.	Sample ID: 25308280028 Service Level: Essential Bottle ID: a037067794 Tested Lubricant: MOBIL DTE BB	Asset Class: Circulating System Manufacturer: Model: Lubricant: MOBIL DTE BB

Continued

Recommendation/Comments

ACTION REQUIRED - ELEVATED IRON LEVEL. Determine source of Iron (Fe) and take corrective action. If the iron level is elevated for the first time with no history of an increasing trend, then resample immediately to confirm condition. Possible sources of iron include: a. Machinery component wear; b. Metal-to-metal contact; c. Corrosion; d. Abrasive dirt contamination. The oil may be unfit for continued use and should be closely monitored for further condition regressions. Inspect the equipment for signs of damage. Change the oil after corrective measures have been implemented. Contact your ExxonMobil representative for further assistance if necessary.

CAUTION - ELEVATED SILICON LEVEL. Determine source of Silicon (Si) and take corrective action. If the silicon level is elevated for the first time with no history of an increasing trend, then resample immediately to confirm condition. If wear metals levels are low, then the silicon likely exists in a non-abrasive form. Possible sources of non-abrasive silicon include: a. Defoamants; b. Sealant compounds. If wear metal levels are elevated, then the silicon likely exists in an abrasive form. Possible sources of abrasive silicon include: a. Abrasive dirt remaining in equipment due to ineffective purification and / or filtration; b. Faulty seals, breather, fill caps; c. Improper sampling techniques that result in dirt contaminating the sample. The oil may be unfit for continued use and should be monitored closely for further condition regressions. Prolonged usage of lubricants with elevated levels of abrasive silicon can cause severe wear and damage to the equipment. Inspect the equipment for signs of excessive wear. Change the oil immediately if the condition escalates. Contact your ExxonMobil representative for further assistance if necessary.

Sample Timeline

- 28 Oct 2025 9:49 PM UTC - Brad Roy - In Service Oil Sample Comments: Photo: