✓ NO EXCEPTIONS NOTED
☐ EXCEPTIONS NOTED
☐ RETURN FOR CORRECTIONS
☐ FOR INFORMATION ONLY

REVIEWS DOES NOT RELIEVE CONTRACTOR FROM RESPONSIBILITY FOR ERRORS OR DEVIATIONS FROM CONTRACT REQUIREMENTS

PT PLN (PERSERO) UIP JBTB
SIGNATURE
Review Date 28 Mar 24

For Approval

REV.	DATE	MECH	CIVIL	ELEC	DESCRIPTION
0	05-Mar-24				ISSUED FOR APPROVAL
		CHECKED			

PT. PLN (PERSERO)
UNIT INDUK PEMBANGUNAN JAWA BAGIAN TIMUR DAN BALI

CLIENT :

MEDCOENERGI
Solar Bali Timur

CONTRACTOR :

PT. GRAHA USAHA TEKNIK

CONTRACT NO :
LOI-454/SCM/MSBT/1123_R

PREPARED	NAME	DATE
DRAWN BY	HRS	05-Mar-24
DESIGNED BY	GUT	05-Mar-24
CHECKED BY	MSBT	
APPROVED BY	PLN	
SHEET SIZE	A4	
SCALE	1 : 1	

PROJECT :
2x25MWp BALI SOLAR PV CONSTRUCTION AND INSTALLATION 150kV TRANSMISSION LINE PACKAGE MEDCO SOLAR BALI TIMUR

DRAWING TITLE :
TECHNICAL DRAWING OF INSULATOR

DRAWING NO :	REV	SHEET
0155-MBT-KBU-00-E-TL-010	0	1 OF 2

✓ NO EXCEPTIONS NOTED
EXCEPTIONS NOTED
RETURN FOR CORRECTIONS
FOR INFORMATION ONLY

REVIEWS DOES NOT RELIEVE CONTRACTOR FROM RESPONSIBILITY FOR ERRORS OR DEVIATIONS FROM CONTRACT REQUIREMENTS

PT PLN (PERSERO) UIP JBTB
SIGNATURE
Review Date 28 Mar 24

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

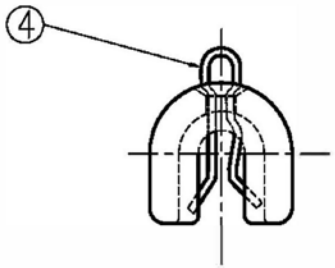

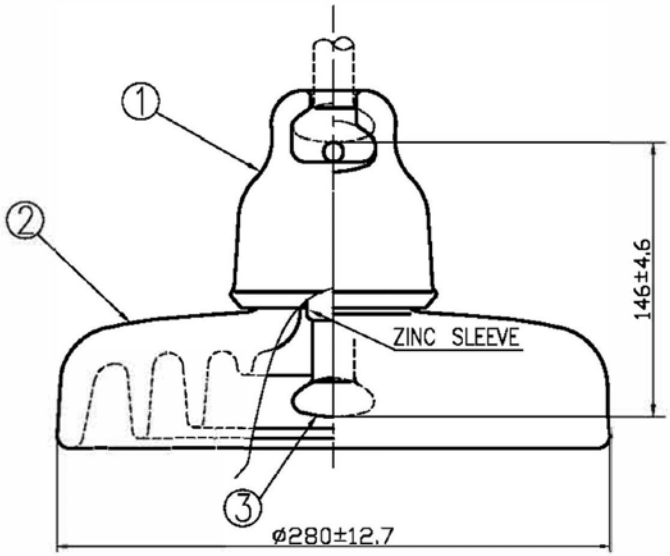

TECHNICAL DATA

Specification Applied : IEC 60383、60305

Characteristics	Rating
1. Creepage Distance ,mm	455
2. Type of ball and socket coupling	IEC 16Amm
3. Combined M & E Strength ,kN	120
4. Routine Proof Test Load ,kN	60
5. Power Frequency Flashover Voltage (Dry) ,kV	90
6. Power Frequency Withstand Voltage (Dry) ,kV	85
7. Impulse Withstand Voltage ,kV	
a.One Unit	125
b.Short Standard String	420
8. Wet Power Frequency Withstand Voltage ,kV	
a.One Unit	50
b.Short Standard String	160
9. Power Frequency Puncture Voltage ,kV	130
10.RIV Test voltage 10 kV; Max.RIV voltage at 1000 kHZ,μV	50
11. Marks on porcelain : U120BP ㊣ M — Y BATCH #	
12. All according to IEC 60383、60305 except for the drawing	
13. Dry Arcing Distance, mm	245
14. Net weight: 8.2kg.	

BITUMINOUS PAINT COATING ON METAL SURFACES IN CONTACT WITH CEMENT.

PORCELAIN : GREY GLAZED or BROWN

FERROUS PARTS : HOT DIP GALVANIZED EXCEPT STAINLESS STEEL

ITEM	MATERIAL	REQD.	REMARKS
④	STAINLESS STEEL	1	
③	STEEL	1	
②	PORCELAIN	1	
①	MALLEABLE IRON OR DUCTILE IRON	1	MFR'S OPTION

SUZHOU PORCELAIN ㊣ INSULATOR WORKS

Scale	1:1.5
Design	W.C.M
Check	L.H.X
Approve	Z.Y.X
Date	2017.10.10

SUSPENSION INSULATOR

M & E STRENGTH : 120 kN

Designation	
Cat.No.	U120BP
Drawing No.	24743E
Issue	1