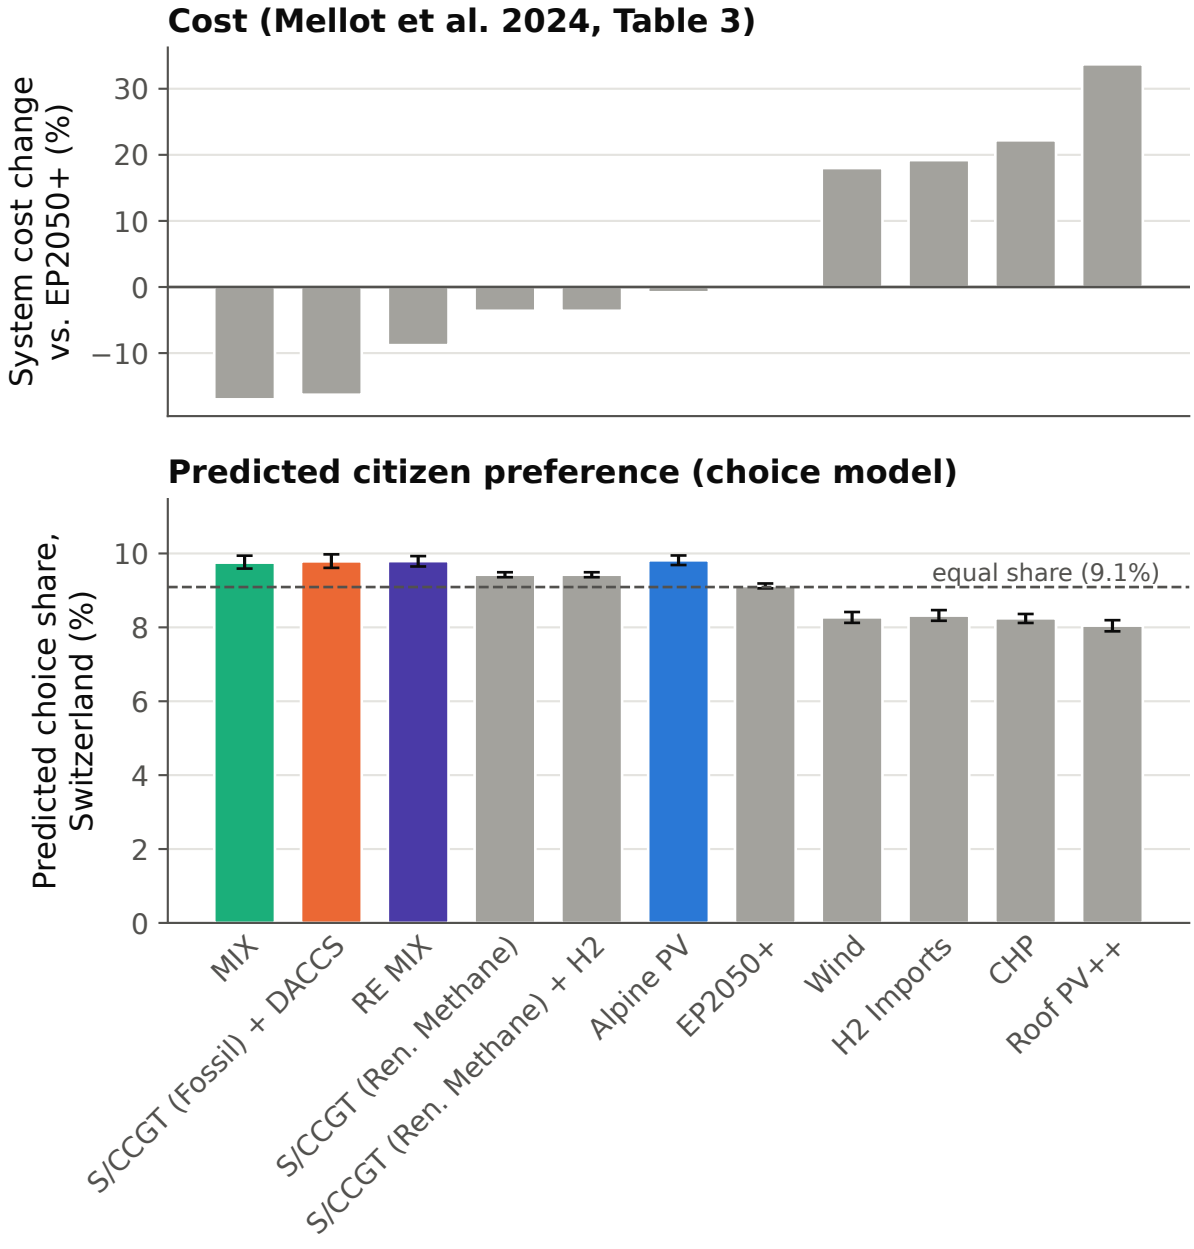

Choice shares: multinomial logit over the 11 scenarios with a cost value (IIA assumption); bars = posterior mean, whiskers = 96% HDI. Scenarios ordered by system cost change (Mellot et al. 2024, Table 3, cheapest first); EP2050+ (5 TWh winter cap): no cost value, last. National aggregate (appendix; national attribute values, survey-sample weights) · 96% HDI · ElCom prices and EUR/CHF 2025.