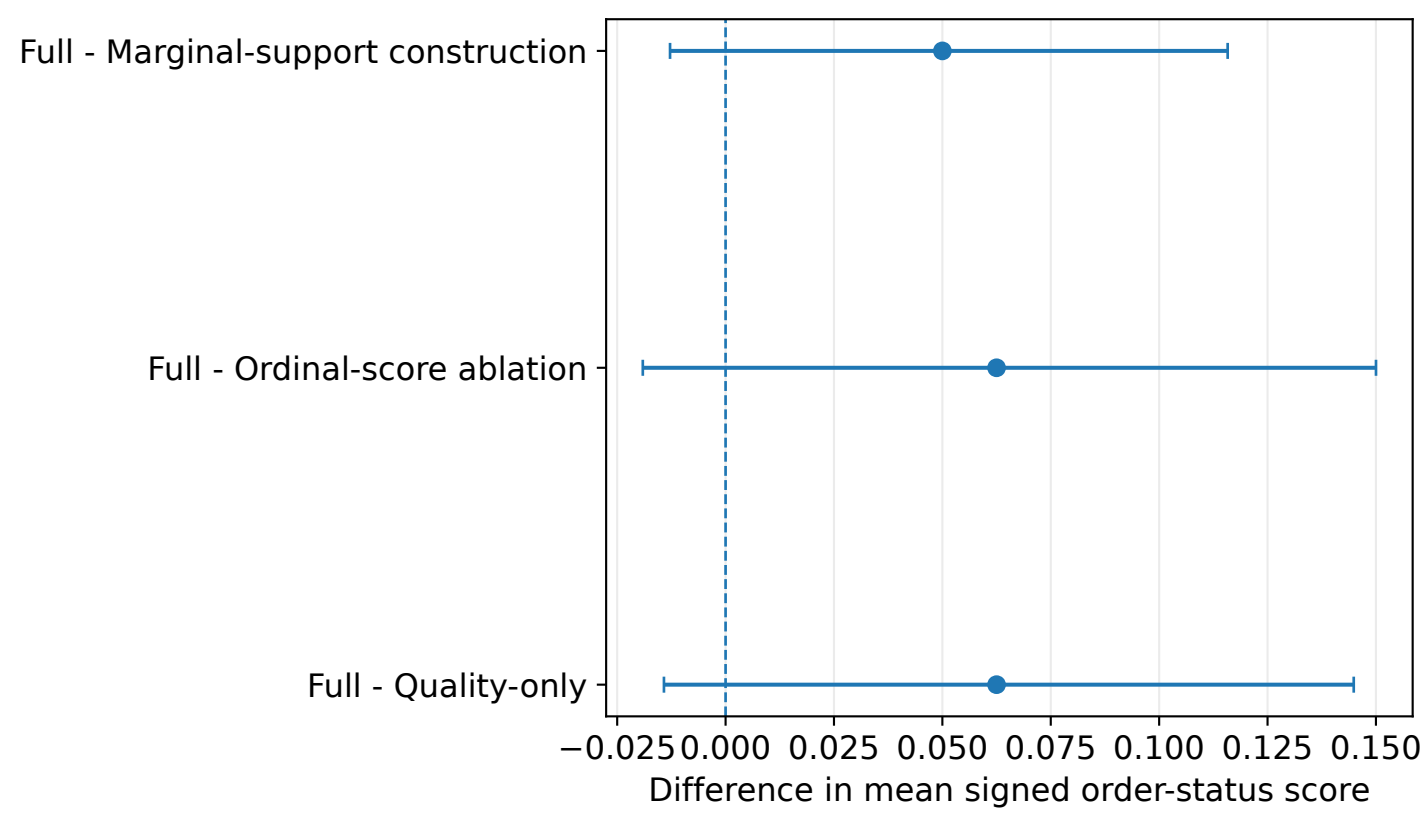
Full - Marginal-support construction
Full - Ordinal-score ablation
Full - Quality-only
−0.025
0.000
0.025
0.050
0.075
0.100
0.125
0.150
Difference in mean signed order-status score