


Miniature circuit-breaker (MCB) S200M Series



Technical Features

Electrical Data	S200 M	
Standards	IEC 60947-2, IS/IEC-60898-1	
Poles	1P, 2P, 3P, 4P, 1P +N, 3P +N	
Tripping Characteristics	B, C, D	
Rated Current	0.5A - 63 A	
Rated Voltage	1P : 230 / 400 V AC 1P + N : 230 V AC 2...4P : 400 V AC 3P + N : 400 V AC	1P : 60 V DC 2P : 120 V DC
Insulation Voltage	250 V AC (Phase to Ground) 500 V AC (Phase to Phase)	
Max Operating Voltage	1P: 253 V AC 2...4P : 440 V AC	
Min Operating Voltage	12 V AC	
Rated Frequency	50/60 Hz	
Rated Short Circuit Capacity	10kA	
Energy Limiting Class (B, C upto 40 A)	3	
Over Voltage Category	III	
Pollution Degree	2	
Rated Impulse withstand Voltage	4kV (Test Voltage 6.2kV at Sea Level, 5kV at 2,000 m)	
Dielectric Test Voltage	2kV (50/60 Hz, 1 min)	
Accessories mountable	Yes	
Cross-section of conductor (top / bottom)	35 mm ²	
Terminal	Fail safe bi-directional cylinder - lift terminal	
Contact position indication	Marking on toggle (1 ON / 0 OFF), Real CPI (red ON / green OFF)	
Real Contact position indication	Red ON / green OFF	

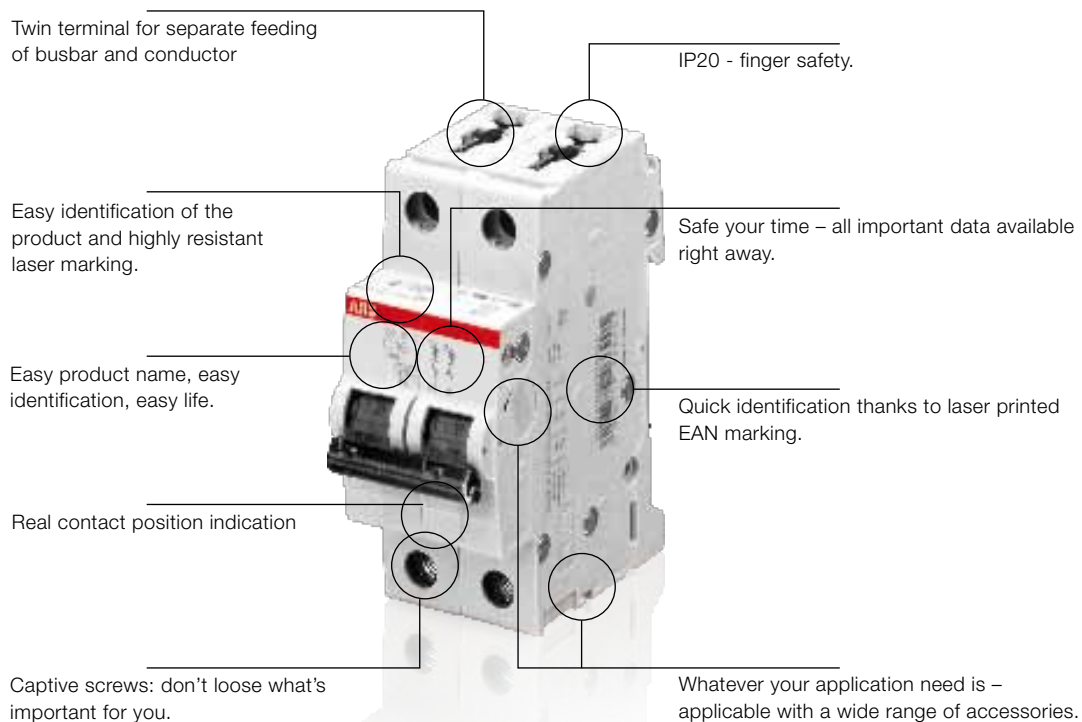

TYPE APPROVAL CERTIFICATE
No. ELE101014XG

This is to certify that the product below is found to be in compliance with the applicable requirement of the RINA type approval system.

<i>Description</i>	CIRCUIT BREAKERS
<i>Type</i>	MCB Series S200 MCB Series S200 M
<i>Applicant</i>	ABB STOTZ-KONTAKT GMBH EPPELHEIMER STR. 82 69123 HEIDELBERG GERMANY
<i>Manufacturer</i>	ABB STOTZ-KONTAKT GMBH
<i>Place of manufacture</i>	EPPELHEIMER STR. 82 69123 HEIDELBERG GERMANY
<i>Reference standards</i>	IEC 60947-2:2006 (ed.4) am1:2009 and RINA Rules for the Classification of the Ships, Part C, Ch. 3, Sec 6

Issued in **HAMBURG** on **August 20, 2013.** *This Certificate is valid until* **August 19, 2018**

RINA
Giuseppe Russo

This certificate consists of this page and 1 enclosure



TYPE APPROVAL CERTIFICATE

No. ELE101014XG

Enclosure - Page 1 of 3

MCB Series S200 MCB Series S200 M

Model type: **Series: S200 (B; C, D; K; Z)**
S201; S202; S203; S204; S201-NA; S203-NA

Ratings and principal characteristics:

133/230 V ac; 230/400 V ac; 440 V ac 0,5 -63 A
1-; 1+N-; 2-; 3-; 3+N-; 4-pole
Instantaneous tripping current type B; C, D; K; Z
Icu: 20 kA (133/230 V); 10 kA (230/400 V; 440 V)
Ics: 15 kA (133/230 V); 7,5 kA (230/400 V; 440 V)
Frequency: 50/60 Hz
Degree of protection: IP 20
Type key: S20 _ _ _
 A B C D
A: Number of poles: 1; 2; 3; 4
B: -NA: with neutral pole
C: Characteristic: B; C; D; K; Z
D: Rated current: 0,5A to 63 A for characteristic C; D; K; Z
6 A to 63 A for characteristic B

Model type: **Series: S200M (B; C, D; K; Z)**
S201M; S202M; S203M; S204M; S201M-NA; S203M-NA

Ratings and principal characteristics:

133/230 V ac; 230/400 V ac; 440 V ac 0,5 -63 A
1-; 1+N-; 2-; 3-; 3+N-; 4-pole
Instantaneous tripping current type B; C, D; K; Z
Icu: 25 kA (133/230 V); 15 kA (230/400 V; 440 V)
Ics: 18,75 kA (133/230 V, 0,5 - 40 A); 15 kA (133/230 V, 50 - 63 A)
11,25 kA (230/400 V; 440 V, 0,5 - 40 A); 7,5 kA (230/400 V; 440 V, 50 - 63 A)
Frequency: 50/60 Hz
Degree of protection: IP 20
Type key: S20_M _ _ _
 A B C D
A: Number of poles: 1; 2; 3; 4
B: -NA: with neutral pole
C: Characteristic: B; C; D; K; Z
D: Rated current: 0,5A to 63 A for characteristic C; D; K; Z
6 A to 63 A for characteristic B

TYPE APPROVAL CERTIFICATE
No. ELE101014XG
Enclosure - Page 2 of 3
MCB Series S200, MCB Series S200 M

Model type: **Series: S200; S200M (B; C, D)**
S201; S202; S203; S204; S201-NA; S203-NA
S201M; S202M; S203M; S204M; S201M-NA; S203M-NA

Ratings and principal characteristics:

133/230V ac; 230/400V ac.; 440 V ac; 0,5 - 63 A
1-; 1+N; 2-; 3-; 3+N-; 4-pole
Instantaneous tripping current type B; C, D
Icu: 10/15 kA
Ics: 7,5 /11,25 kA
Frequency: 50/60 Hz
Degree of protection: IP 20
Type key: S20 - - - -
 A B - C D
S20M - - - -
 A B C D
A: Number of poles: 1; 2; 3; 4
B: -NA: with neutral pole
C: Characteristic: B; C; D
D: Rated current: D 0,5A to 63 A; C 0,5 - 63 A; B 6 - 63 A

Additional Places of Production for the S200-B/C/D and S200M-B/C/D :

ABB LV Installation Materials Co. Ltd., Beijing
No. 17, Kangding Street, Beijing Economic-Tech.
Developm. Area, 100176 BEIJING
CHINA

ABB Automation EOOD
Plot 28, Industrial Zone
4150 Rakovski
Bulgaria


TYPE APPROVAL CERTIFICATE
No. ELE101014XG
Enclosure - Page 3 of 3
MCB Series S200, MCB Series S200 M

Documents

- CB Test Certificate Ref.No.: DE1-49285; VDE Testing and Certification Institute
- Test Report Ref. 70000-4402-0008/153700-2
- CB Test Certificate Ref.No.: DE1-49183; VDE Testing and Certification Institute
- Test Report Ref. 70000-4402-0712/158645 (-000 up to -052)
- CB Test Certificate Ref.No.: DE1-49284; VDE Testing and Certification Institute
- Test Report Ref. 70000-4402-0008/153700-1
- CB Test Certificate Ref.No.: DE1-49139; VDE Testing and Certification Institute
- Test Report Ref. 70000-4402-0712/153697 (-000 up to -078)
- CB Test Certificate Ref.No.: DE1-48076; VDE Testing and Certification Institute
- Test Report Ref. 70000-4402-0008/147554 (-000 to 019)
- CB Test Certificate Ref.No.: DE1-48070 and DE1-48071; VDE Testing and Certification Institute
- VDE Testing and Certification Institute; Ref. No. 70000-4402-0008/130180-000 and -049
- VDE Testing and Certification Institute; Ref. No. 70000-4402-0008/124234-000 and -049
- CB Test Certificate Ref.No.: DE1-51675; VDE Testing and Certification Institute
- Test Report Ref. 70000-4402-0715/179127-1
- CB Test Certificate Ref.No.: DE1-51676; VDE Testing and Certification Institute
- Test Report Ref. 70000-4402-0712/179127-2
- CB Test Certificate Ref.No.: DE1-51716; VDE Testing and Certification Institute
- Test Report Ref. 70000-4402-0008/158226-1
- CB Test Certificate Ref.No.: DE1-51718; VDE Testing and Certification Institute
- Test Report Ref. 70000-4402-0008/158226-2

This certificate annuls and replaces the previous one n° ELE095513XG.

HAMBURG August 20, 2013



IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT
(IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Circuit breaker

Name and address of the applicant

ABB-Stotz-Kontakt GmbH
Eppelheimer Straße 82, 69123 Heidelberg
GERMANY

Name and address of the manufacturer

ABB-Stotz-Kontakt GmbH
Eppelheimer Straße 82, 69123 Heidelberg
GERMANY

Name and address of the factory

ABB-Stotz-Kontakt GmbH
Eppelheimer Straße 82, 69123 Heidelberg
GERMANY*Note: When more than one factory, please report on page 2*

Ratings and principal characteristics

☐ Additional Information on page 2133/230 V a.c., 230/400 V a.c.; $I_n = 80\text{ A}$, 100 A;
Characteristic B, C; $I_{cu} = 6 / 20\text{ kA}$; $I_{cs} = 6 / 10\text{ kA}$

Trademark (if any)



Customer's Testing Facility (CTF) Stage used

CTF Stage 2

Model / Type Ref.

Series S 200

Additional information (if necessary may also
be reported on page 2)☒ Additional Information on page 2A sample of the product was tested and found
to be in conformity withIEC 60947-1:2007
IEC 60947-1:2007/AMD1:2010
IEC 60947-1:2007/AMD2:2014
IEC 60947-2:2016As shown in the Test Report Ref. No. which
forms part of this Certificate

243320-TL3-1

This CB Test Certificate is issued by the National Certification Body

VDE Prüf- und Zertifizierungsinstitut GmbH**VDE** Testing and Certification Institute

Zertifizierungsstelle und internat. Angelegenheiten

Certification Body and internat. Affairs

Date: 2019-05-09

Signature:


R. Nickel

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST
CERTIFICATES FOR ELECTRICAL EQUIPMENT
(IECEE) CB SCHEME

SYSTEME CEI D'ACCEPTATION MUTUELLE DE
CERTIFICATS D'ESSAIS DES EQUIPEMENTS
ELECTRIQUES (IECEE) METHODE OC

CB TEST CERTIFICATE CERTIFICAT D'ESSAI OC

Product
Produit

Circuit-breaker

Name and address of the applicant
Nom et adresse du demandeur

ABB-Stotz-Kontakt GmbH
Eppelheimer Straße 82, 69123 Heidelberg
GERMANY

Name and address of the manufacturer
Nom et adresse du fabricant

ABB-Stotz-Kontakt GmbH
Eppelheimer Straße 82, 69123 Heidelberg
GERMANY

Name and address of the factory
Nom et adresse de l'usine

ABB INDIA Ltd.
88/3, 88/4, Basavanahalli Village Nelamangala, 562123
NELAMANGALA, BANGALORE
INDIA

Note: When more than one factory, please report on page 2
Note: Lorsque il y plus d'une usine, veuillez utiliser la 2^{ème} page

Ratings and principal characteristics
Valeurs nominales et caractéristiques principales

☐ Additional Information on page 2
AC 230/400 V; 10A; 16A; 20 A
Number of poles: 1;
Instantaneous tripping current: C; Icn: 6 kA

Trademark (if any)
Marque de fabrique (si elle existe)



Type of Manufacturer's Testing Laboratories used
Type de programme du laboratoire d'essais constructeur

CTF Stage 2

Model / Type Ref.
Ref. De type

SH201

Additional information (if necessary may also be
reported on page 2)
Les informations complémentaires (si nécessaire,
peuvent être indiqués sur la 2^{ème} page)

☐ Additional Information on page 2

A sample of the product was tested and found
to be in conformity with
Un échantillon de ce produit a été essayé et a été
considéré conforme à la

IEC 60898-1(ed.2)

As shown in the Test Report Ref. No. which forms part
of this Certificate
Comme indiqué dans le Rapport d'essais numéro de
référence qui constitue partie de ce Certificat

226407-CC2-000 to -003

This CB Test Certificate is issued by the National Certification Body
Ce Certificat d'essai OC est établi par l'Organisme **National de Certification**

VDE Prüf- und Zertifizierungsinstitut GmbH
VDE Testing and Certification Institute
Zertifizierung Produkte / Certification Products

Dr. G. Schipper

Date: 2016-07-18

Signature: