

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

Air Compressor Motor • Compressor Room

84% HEALTH (GOOD)

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

Signals Monitored

6

Threshold Breaches

0

Excursion Events

2

System Alerts

1


DIAGNOSTIC & ENGINEERING INSIGHTS

- Operating Health Score is evaluated at 84% (Good).
- Zero critical severity threshold events were triggered during this inspection interval.
- All monitored telemetry channels remained within manufacturer engineering boundaries.

TELEMETRY SIGNALS SUMMARY & STATISTICAL LIMITS

Signal / Channel	Unit	Safe Limits	Min	Max	Mean	Samples	Status
Winding_Temp_U	°C	10 - 130	55.4	74.0	64.8	5,760	NORMAL
Winding_Temp_V	°C	10 - 130	63.4	81.2	72.4	5,760	NORMAL
Winding_Temp_W	°C	10 - 130	63.8	86.2	74.7	5,760	NORMAL
Bearing_Temp_DE	°C	10 - 95	41.6	55.0	48.3	5,760	NORMAL
Bearing_Temp_NDE	°C	10 - 95	47.6	61.6	54.5	5,760	NORMAL
Ambient_Temp	°C	0 - 50	24.6	34.0	29.3	5,760	NORMAL

SIGNAL TREND OVERVIEW (UNAGGREGATED PROFILES)

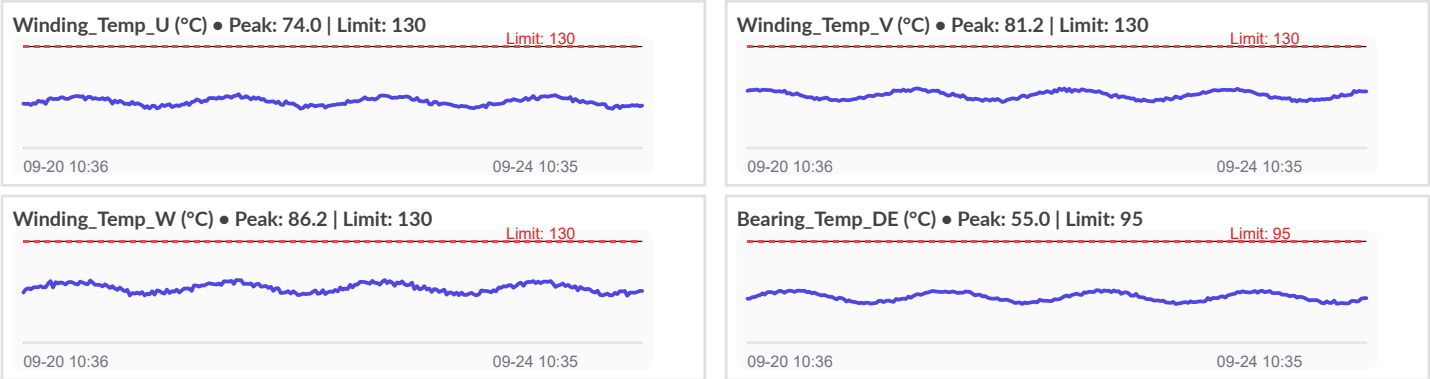

EXCURSION EVENTS LOG (2 Recorded)

Signal	Type	Start (UTC)	Duration	Peak	Limit
Oil_Level	LOW_EXCURSION	2026-09-23 23:41	110.0 m	15.6	20.0
Voltage_THD_L3	HIGH_EXCURSION	2026-09-22 00:20	107.0 m	5.2	5.0

SYSTEM ALERTS AUDIT (1 Recorded)

Signal	Severity	Triggered At	Trigger Val	Threshold	Status
Power_Factor	WARNING	2026-09-24 09:24	0.8	0.8	OPEN

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

RAW TELEMETRY READINGS LOG (UNAGGREGATED)

Chronological sequence of unaggregated sensor measurements. Each value is presented exactly as recorded in signal_data.

Signal: Winding_Temp_U (°C)				All 5,760 Raw Readings			
Operating Limits: [10.0 to 130.0] • Observed: Min 55.35, Max 73.97, Mean 64.82							
#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1	2026-09-20 10:36	62.32	OK	2	2026-09-20 10:37	59.53	OK
3	2026-09-20 10:38	59.41	OK	4	2026-09-20 10:39	61.99	OK
5	2026-09-20 10:40	61.53	OK	6	2026-09-20 10:41	61.29	OK
7	2026-09-20 10:42	61.79	OK	8	2026-09-20 10:43	61.67	OK
9	2026-09-20 10:44	60.54	OK	10	2026-09-20 10:45	58.96	OK
11	2026-09-20 10:46	61.67	OK	12	2026-09-20 10:47	61.56	OK
13	2026-09-20 10:48	60.49	OK	14	2026-09-20 10:49	60.84	OK
15	2026-09-20 10:50	62.16	OK	16	2026-09-20 10:51	60.77	OK
17	2026-09-20 10:52	61.62	OK	18	2026-09-20 10:53	61.43	OK
19	2026-09-20 10:54	59.91	OK	20	2026-09-20 10:55	63.24	OK
21	2026-09-20 10:56	61.73	OK	22	2026-09-20 10:57	61.38	OK
23	2026-09-20 10:58	61.89	OK	24	2026-09-20 10:59	62.15	OK
25	2026-09-20 11:00	59.87	OK	26	2026-09-20 11:01	61.85	OK
27	2026-09-20 11:02	61.88	OK	28	2026-09-20 11:03	58.28	OK
29	2026-09-20 11:04	61.41	OK	30	2026-09-20 11:05	60.89	OK
31	2026-09-20 11:06	62.61	OK	32	2026-09-20 11:07	62.11	OK
33	2026-09-20 11:08	59.47	OK	34	2026-09-20 11:09	61.72	OK
35	2026-09-20 11:10	63.42	OK	36	2026-09-20 11:11	63.53	OK
37	2026-09-20 11:12	60.41	OK	38	2026-09-20 11:13	64.08	OK
39	2026-09-20 11:14	62.21	OK	40	2026-09-20 11:15	63.72	OK
41	2026-09-20 11:16	63.25	OK	42	2026-09-20 11:17	61.44	OK
43	2026-09-20 11:18	60.36	OK	44	2026-09-20 11:19	61.38	OK
45	2026-09-20 11:20	60.26	OK	46	2026-09-20 11:21	63.30	OK
47	2026-09-20 11:22	62.34	OK	48	2026-09-20 11:23	59.93	OK
49	2026-09-20 11:24	63.50	OK	50	2026-09-20 11:25	62.29	OK
51	2026-09-20 11:26	62.99	OK	52	2026-09-20 11:27	62.55	OK
53	2026-09-20 11:28	61.48	OK	54	2026-09-20 11:29	64.15	OK
55	2026-09-20 11:30	62.81	OK	56	2026-09-20 11:31	61.93	OK
57	2026-09-20 11:32	61.43	OK	58	2026-09-20 11:33	61.27	OK
59	2026-09-20 11:34	63.21	OK	60	2026-09-20 11:35	60.71	OK
61	2026-09-20 11:36	63.52	OK	62	2026-09-20 11:37	64.17	OK
63	2026-09-20 11:38	60.09	OK	64	2026-09-20 11:39	62.11	OK
65	2026-09-20 11:40	61.90	OK	66	2026-09-20 11:41	59.17	OK
67	2026-09-20 11:42	62.71	OK	68	2026-09-20 11:43	60.62	OK
69	2026-09-20 11:44	64.32	OK	70	2026-09-20 11:45	60.93	OK
71	2026-09-20 11:46	60.37	OK	72	2026-09-20 11:47	62.33	OK
73	2026-09-20 11:48	63.21	OK	74	2026-09-20 11:49	61.74	OK
75	2026-09-20 11:50	64.47	OK	76	2026-09-20 11:51	59.99	OK
77	2026-09-20 11:52	64.62	OK	78	2026-09-20 11:53	64.76	OK
79	2026-09-20 11:54	61.75	OK	80	2026-09-20 11:55	63.35	OK
81	2026-09-20 11:56	63.82	OK	82	2026-09-20 11:57	62.36	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
83	2026-09-20 11:58	61.72	OK	84	2026-09-20 11:59	64.59	OK
85	2026-09-20 12:00	63.10	OK	86	2026-09-20 12:01	63.56	OK
87	2026-09-20 12:02	64.89	OK	88	2026-09-20 12:03	64.39	OK
89	2026-09-20 12:04	64.05	OK	90	2026-09-20 12:05	61.87	OK
91	2026-09-20 12:06	64.31	OK	92	2026-09-20 12:07	63.84	OK
93	2026-09-20 12:08	63.11	OK	94	2026-09-20 12:09	61.93	OK
95	2026-09-20 12:10	61.81	OK	96	2026-09-20 12:11	60.05	OK
97	2026-09-20 12:12	62.43	OK	98	2026-09-20 12:13	61.71	OK
99	2026-09-20 12:14	62.22	OK	100	2026-09-20 12:15	60.54	OK
101	2026-09-20 12:16	62.89	OK	102	2026-09-20 12:17	62.48	OK
103	2026-09-20 12:18	65.17	OK	104	2026-09-20 12:19	63.25	OK
105	2026-09-20 12:20	61.39	OK	106	2026-09-20 12:21	63.94	OK
107	2026-09-20 12:22	61.80	OK	108	2026-09-20 12:23	63.54	OK
109	2026-09-20 12:24	65.12	OK	110	2026-09-20 12:25	60.97	OK
111	2026-09-20 12:26	61.66	OK	112	2026-09-20 12:27	64.57	OK
113	2026-09-20 12:28	63.14	OK	114	2026-09-20 12:29	63.75	OK
115	2026-09-20 12:30	62.81	OK	116	2026-09-20 12:31	62.23	OK
117	2026-09-20 12:32	64.68	OK	118	2026-09-20 12:33	63.14	OK
119	2026-09-20 12:34	63.71	OK	120	2026-09-20 12:35	60.23	OK
121	2026-09-20 12:36	64.55	OK	122	2026-09-20 12:37	60.58	OK
123	2026-09-20 12:38	64.97	OK	124	2026-09-20 12:39	64.43	OK
125	2026-09-20 12:40	64.97	OK	126	2026-09-20 12:41	61.94	OK
127	2026-09-20 12:42	62.77	OK	128	2026-09-20 12:43	67.17	OK
129	2026-09-20 12:44	63.16	OK	130	2026-09-20 12:45	62.69	OK
131	2026-09-20 12:46	65.39	OK	132	2026-09-20 12:47	64.76	OK
133	2026-09-20 12:48	63.65	OK	134	2026-09-20 12:49	63.22	OK
135	2026-09-20 12:50	61.67	OK	136	2026-09-20 12:51	64.80	OK
137	2026-09-20 12:52	62.70	OK	138	2026-09-20 12:53	66.63	OK
139	2026-09-20 12:54	65.98	OK	140	2026-09-20 12:55	64.72	OK
141	2026-09-20 12:56	63.81	OK	142	2026-09-20 12:57	63.64	OK
143	2026-09-20 12:58	61.62	OK	144	2026-09-20 12:59	61.37	OK
145	2026-09-20 13:00	65.88	OK	146	2026-09-20 13:01	63.48	OK
147	2026-09-20 13:02	66.01	OK	148	2026-09-20 13:03	65.38	OK
149	2026-09-20 13:04	64.42	OK	150	2026-09-20 13:05	62.40	OK
151	2026-09-20 13:06	65.70	OK	152	2026-09-20 13:07	65.68	OK
153	2026-09-20 13:08	65.15	OK	154	2026-09-20 13:09	66.98	OK
155	2026-09-20 13:10	65.25	OK	156	2026-09-20 13:11	61.27	OK
157	2026-09-20 13:12	63.65	OK	158	2026-09-20 13:13	65.42	OK
159	2026-09-20 13:14	63.54	OK	160	2026-09-20 13:15	65.63	OK
161	2026-09-20 13:16	66.21	OK	162	2026-09-20 13:17	64.55	OK
163	2026-09-20 13:18	64.00	OK	164	2026-09-20 13:19	64.33	OK
165	2026-09-20 13:20	65.14	OK	166	2026-09-20 13:21	64.49	OK
167	2026-09-20 13:22	63.02	OK	168	2026-09-20 13:23	63.02	OK
169	2026-09-20 13:24	65.25	OK	170	2026-09-20 13:25	65.27	OK
171	2026-09-20 13:26	64.43	OK	172	2026-09-20 13:27	65.96	OK
173	2026-09-20 13:28	63.88	OK	174	2026-09-20 13:29	61.63	OK
175	2026-09-20 13:30	63.39	OK	176	2026-09-20 13:31	65.36	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
177	2026-09-20 13:32	65.32	OK	178	2026-09-20 13:33	65.23	OK
179	2026-09-20 13:34	65.96	OK	180	2026-09-20 13:35	64.92	OK
181	2026-09-20 13:36	65.66	OK	182	2026-09-20 13:37	65.51	OK
183	2026-09-20 13:38	64.67	OK	184	2026-09-20 13:39	66.89	OK
185	2026-09-20 13:40	65.27	OK	186	2026-09-20 13:41	63.53	OK
187	2026-09-20 13:42	66.48	OK	188	2026-09-20 13:43	64.81	OK
189	2026-09-20 13:44	65.03	OK	190	2026-09-20 13:45	66.85	OK
191	2026-09-20 13:46	65.66	OK	192	2026-09-20 13:47	65.21	OK
193	2026-09-20 13:48	65.53	OK	194	2026-09-20 13:49	63.00	OK
195	2026-09-20 13:50	65.49	OK	196	2026-09-20 13:51	66.08	OK
197	2026-09-20 13:52	66.54	OK	198	2026-09-20 13:53	62.83	OK
199	2026-09-20 13:54	68.21	OK	200	2026-09-20 13:55	65.32	OK
201	2026-09-20 13:56	64.68	OK	202	2026-09-20 13:57	66.19	OK
203	2026-09-20 13:58	65.93	OK	204	2026-09-20 13:59	67.89	OK
205	2026-09-20 14:00	64.84	OK	206	2026-09-20 14:01	64.33	OK
207	2026-09-20 14:02	66.55	OK	208	2026-09-20 14:03	62.20	OK
209	2026-09-20 14:04	62.92	OK	210	2026-09-20 14:05	64.16	OK
211	2026-09-20 14:06	69.78	OK	212	2026-09-20 14:07	63.24	OK
213	2026-09-20 14:08	64.39	OK	214	2026-09-20 14:09	63.90	OK
215	2026-09-20 14:10	64.49	OK	216	2026-09-20 14:11	67.35	OK
217	2026-09-20 14:12	68.59	OK	218	2026-09-20 14:13	67.59	OK
219	2026-09-20 14:14	67.29	OK	220	2026-09-20 14:15	67.61	OK
221	2026-09-20 14:16	69.24	OK	222	2026-09-20 14:17	66.31	OK
223	2026-09-20 14:18	65.70	OK	224	2026-09-20 14:19	65.91	OK
225	2026-09-20 14:20	65.71	OK	226	2026-09-20 14:21	66.71	OK
227	2026-09-20 14:22	64.83	OK	228	2026-09-20 14:23	63.26	OK
229	2026-09-20 14:24	68.46	OK	230	2026-09-20 14:25	67.42	OK
231	2026-09-20 14:26	67.60	OK	232	2026-09-20 14:27	65.96	OK
233	2026-09-20 14:28	66.46	OK	234	2026-09-20 14:29	67.45	OK
235	2026-09-20 14:30	66.29	OK	236	2026-09-20 14:31	68.55	OK
237	2026-09-20 14:32	64.47	OK	238	2026-09-20 14:33	65.36	OK
239	2026-09-20 14:34	65.66	OK	240	2026-09-20 14:35	68.51	OK
241	2026-09-20 14:36	67.86	OK	242	2026-09-20 14:37	65.86	OK
243	2026-09-20 14:38	65.61	OK	244	2026-09-20 14:39	63.81	OK
245	2026-09-20 14:40	65.45	OK	246	2026-09-20 14:41	67.03	OK
247	2026-09-20 14:42	66.67	OK	248	2026-09-20 14:43	67.08	OK
249	2026-09-20 14:44	66.14	OK	250	2026-09-20 14:45	65.86	OK
251	2026-09-20 14:46	67.10	OK	252	2026-09-20 14:47	66.35	OK
253	2026-09-20 14:48	66.89	OK	254	2026-09-20 14:49	69.20	OK
255	2026-09-20 14:50	67.86	OK	256	2026-09-20 14:51	67.15	OK
257	2026-09-20 14:52	64.22	OK	258	2026-09-20 14:53	67.65	OK
259	2026-09-20 14:54	66.86	OK	260	2026-09-20 14:55	67.83	OK
261	2026-09-20 14:56	66.27	OK	262	2026-09-20 14:57	66.79	OK
263	2026-09-20 14:58	67.15	OK	264	2026-09-20 14:59	64.58	OK
265	2026-09-20 15:00	71.29	OK	266	2026-09-20 15:01	67.00	OK
267	2026-09-20 15:02	69.17	OK	268	2026-09-20 15:03	66.30	OK
269	2026-09-20 15:04	66.07	OK	270	2026-09-20 15:05	69.60	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
271	2026-09-20 15:06	67.51	OK	272	2026-09-20 15:07	67.53	OK
273	2026-09-20 15:08	68.17	OK	274	2026-09-20 15:09	69.63	OK
275	2026-09-20 15:10	69.53	OK	276	2026-09-20 15:11	66.50	OK
277	2026-09-20 15:12	67.89	OK	278	2026-09-20 15:13	71.04	OK
279	2026-09-20 15:14	67.18	OK	280	2026-09-20 15:15	68.28	OK
281	2026-09-20 15:16	67.98	OK	282	2026-09-20 15:17	66.12	OK
283	2026-09-20 15:18	68.02	OK	284	2026-09-20 15:19	67.95	OK
285	2026-09-20 15:20	67.58	OK	286	2026-09-20 15:21	66.59	OK
287	2026-09-20 15:22	68.40	OK	288	2026-09-20 15:23	70.61	OK
289	2026-09-20 15:24	70.52	OK	290	2026-09-20 15:25	67.18	OK
291	2026-09-20 15:26	67.02	OK	292	2026-09-20 15:27	68.85	OK
293	2026-09-20 15:28	68.77	OK	294	2026-09-20 15:29	67.24	OK
295	2026-09-20 15:30	68.94	OK	296	2026-09-20 15:31	67.28	OK
297	2026-09-20 15:32	67.96	OK	298	2026-09-20 15:33	68.10	OK
299	2026-09-20 15:34	68.23	OK	300	2026-09-20 15:35	68.10	OK
301	2026-09-20 15:36	67.17	OK	302	2026-09-20 15:37	66.04	OK
303	2026-09-20 15:38	67.35	OK	304	2026-09-20 15:39	68.69	OK
305	2026-09-20 15:40	69.23	OK	306	2026-09-20 15:41	65.16	OK
307	2026-09-20 15:42	66.45	OK	308	2026-09-20 15:43	68.56	OK
309	2026-09-20 15:44	70.91	OK	310	2026-09-20 15:45	68.81	OK
311	2026-09-20 15:46	67.63	OK	312	2026-09-20 15:47	68.80	OK
313	2026-09-20 15:48	66.96	OK	314	2026-09-20 15:49	67.28	OK
315	2026-09-20 15:50	67.93	OK	316	2026-09-20 15:51	67.35	OK
317	2026-09-20 15:52	67.56	OK	318	2026-09-20 15:53	68.91	OK
319	2026-09-20 15:54	67.39	OK	320	2026-09-20 15:55	69.02	OK
321	2026-09-20 15:56	68.43	OK	322	2026-09-20 15:57	67.72	OK
323	2026-09-20 15:58	67.73	OK	324	2026-09-20 15:59	70.09	OK
325	2026-09-20 16:00	70.49	OK	326	2026-09-20 16:01	66.21	OK
327	2026-09-20 16:02	68.68	OK	328	2026-09-20 16:03	70.87	OK
329	2026-09-20 16:04	70.59	OK	330	2026-09-20 16:05	69.02	OK
331	2026-09-20 16:06	66.57	OK	332	2026-09-20 16:07	67.09	OK
333	2026-09-20 16:08	69.78	OK	334	2026-09-20 16:09	68.89	OK
335	2026-09-20 16:10	68.67	OK	336	2026-09-20 16:11	68.18	OK
337	2026-09-20 16:12	68.56	OK	338	2026-09-20 16:13	66.39	OK
339	2026-09-20 16:14	67.82	OK	340	2026-09-20 16:15	67.72	OK
341	2026-09-20 16:16	69.01	OK	342	2026-09-20 16:17	69.31	OK
343	2026-09-20 16:18	72.07	OK	344	2026-09-20 16:19	71.39	OK
345	2026-09-20 16:20	67.59	OK	346	2026-09-20 16:21	69.75	OK
347	2026-09-20 16:22	67.30	OK	348	2026-09-20 16:23	66.31	OK
349	2026-09-20 16:24	66.99	OK	350	2026-09-20 16:25	70.16	OK
351	2026-09-20 16:26	69.94	OK	352	2026-09-20 16:27	68.12	OK
353	2026-09-20 16:28	67.53	OK	354	2026-09-20 16:29	71.01	OK
355	2026-09-20 16:30	68.91	OK	356	2026-09-20 16:31	71.03	OK
357	2026-09-20 16:32	69.89	OK	358	2026-09-20 16:33	70.80	OK
359	2026-09-20 16:34	68.41	OK	360	2026-09-20 16:35	67.52	OK
361	2026-09-20 16:36	66.91	OK	362	2026-09-20 16:37	71.04	OK
363	2026-09-20 16:38	67.37	OK	364	2026-09-20 16:39	70.35	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
365	2026-09-20 16:40	67.06	OK	366	2026-09-20 16:41	69.90	OK
367	2026-09-20 16:42	70.17	OK	368	2026-09-20 16:43	67.65	OK
369	2026-09-20 16:44	70.10	OK	370	2026-09-20 16:45	71.27	OK
371	2026-09-20 16:46	70.48	OK	372	2026-09-20 16:47	68.04	OK
373	2026-09-20 16:48	69.23	OK	374	2026-09-20 16:49	70.92	OK
375	2026-09-20 16:50	69.05	OK	376	2026-09-20 16:51	69.44	OK
377	2026-09-20 16:52	69.70	OK	378	2026-09-20 16:53	68.73	OK
379	2026-09-20 16:54	70.72	OK	380	2026-09-20 16:55	68.22	OK
381	2026-09-20 16:56	71.55	OK	382	2026-09-20 16:57	68.02	OK
383	2026-09-20 16:58	68.36	OK	384	2026-09-20 16:59	69.64	OK
385	2026-09-20 17:00	70.65	OK	386	2026-09-20 17:01	70.61	OK
387	2026-09-20 17:02	70.84	OK	388	2026-09-20 17:03	71.11	OK
389	2026-09-20 17:04	69.68	OK	390	2026-09-20 17:05	70.97	OK
391	2026-09-20 17:06	69.60	OK	392	2026-09-20 17:07	68.19	OK
393	2026-09-20 17:08	67.65	OK	394	2026-09-20 17:09	67.97	OK
395	2026-09-20 17:10	70.43	OK	396	2026-09-20 17:11	67.45	OK
397	2026-09-20 17:12	67.61	OK	398	2026-09-20 17:13	70.34	OK
399	2026-09-20 17:14	71.55	OK	400	2026-09-20 17:15	68.27	OK
401	2026-09-20 17:16	72.24	OK	402	2026-09-20 17:17	68.46	OK
403	2026-09-20 17:18	66.94	OK	404	2026-09-20 17:19	69.87	OK
405	2026-09-20 17:20	71.35	OK	406	2026-09-20 17:21	67.04	OK
407	2026-09-20 17:22	70.05	OK	408	2026-09-20 17:23	69.36	OK
409	2026-09-20 17:24	67.66	OK	410	2026-09-20 17:25	68.21	OK
411	2026-09-20 17:26	71.00	OK	412	2026-09-20 17:27	69.00	OK
413	2026-09-20 17:28	68.17	OK	414	2026-09-20 17:29	69.15	OK
415	2026-09-20 17:30	67.99	OK	416	2026-09-20 17:31	71.38	OK
417	2026-09-20 17:32	69.58	OK	418	2026-09-20 17:33	68.25	OK
419	2026-09-20 17:34	69.46	OK	420	2026-09-20 17:35	72.13	OK
421	2026-09-20 17:36	69.13	OK	422	2026-09-20 17:37	69.24	OK
423	2026-09-20 17:38	70.53	OK	424	2026-09-20 17:39	69.59	OK
425	2026-09-20 17:40	70.26	OK	426	2026-09-20 17:41	70.42	OK
427	2026-09-20 17:42	71.67	OK	428	2026-09-20 17:43	71.26	OK
429	2026-09-20 17:44	70.39	OK	430	2026-09-20 17:45	71.67	OK
431	2026-09-20 17:46	69.05	OK	432	2026-09-20 17:47	69.34	OK
433	2026-09-20 17:48	68.96	OK	434	2026-09-20 17:49	66.94	OK
435	2026-09-20 17:50	69.28	OK	436	2026-09-20 17:51	70.73	OK
437	2026-09-20 17:52	70.70	OK	438	2026-09-20 17:53	69.45	OK
439	2026-09-20 17:54	67.73	OK	440	2026-09-20 17:55	69.68	OK
441	2026-09-20 17:56	69.01	OK	442	2026-09-20 17:57	69.31	OK
443	2026-09-20 17:58	70.75	OK	444	2026-09-20 17:59	69.59	OK
445	2026-09-20 18:00	71.21	OK	446	2026-09-20 18:01	71.36	OK
447	2026-09-20 18:02	69.10	OK	448	2026-09-20 18:03	67.95	OK
449	2026-09-20 18:04	70.69	OK	450	2026-09-20 18:05	70.42	OK
451	2026-09-20 18:06	69.26	OK	452	2026-09-20 18:07	70.39	OK
453	2026-09-20 18:08	70.34	OK	454	2026-09-20 18:09	69.53	OK
455	2026-09-20 18:10	67.38	OK	456	2026-09-20 18:11	72.52	OK
457	2026-09-20 18:12	67.49	OK	458	2026-09-20 18:13	69.84	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
459	2026-09-20 18:14	70.40	OK	460	2026-09-20 18:15	69.47	OK
461	2026-09-20 18:16	70.67	OK	462	2026-09-20 18:17	69.29	OK
463	2026-09-20 18:18	69.12	OK	464	2026-09-20 18:19	70.97	OK
465	2026-09-20 18:20	72.13	OK	466	2026-09-20 18:21	70.99	OK
467	2026-09-20 18:22	69.52	OK	468	2026-09-20 18:23	68.97	OK
469	2026-09-20 18:24	70.31	OK	470	2026-09-20 18:25	69.69	OK
471	2026-09-20 18:26	70.40	OK	472	2026-09-20 18:27	68.71	OK
473	2026-09-20 18:28	69.09	OK	474	2026-09-20 18:29	71.12	OK
475	2026-09-20 18:30	72.54	OK	476	2026-09-20 18:31	70.47	OK
477	2026-09-20 18:32	72.32	OK	478	2026-09-20 18:33	72.90	OK
479	2026-09-20 18:34	70.44	OK	480	2026-09-20 18:35	67.03	OK
481	2026-09-20 18:36	71.86	OK	482	2026-09-20 18:37	70.09	OK
483	2026-09-20 18:38	70.68	OK	484	2026-09-20 18:39	71.37	OK
485	2026-09-20 18:40	72.11	OK	486	2026-09-20 18:41	69.28	OK
487	2026-09-20 18:42	69.99	OK	488	2026-09-20 18:43	69.29	OK
489	2026-09-20 18:44	69.54	OK	490	2026-09-20 18:45	71.50	OK
491	2026-09-20 18:46	70.21	OK	492	2026-09-20 18:47	69.51	OK
493	2026-09-20 18:48	71.38	OK	494	2026-09-20 18:49	69.22	OK
495	2026-09-20 18:50	72.31	OK	496	2026-09-20 18:51	71.29	OK
497	2026-09-20 18:52	71.48	OK	498	2026-09-20 18:53	72.29	OK
499	2026-09-20 18:54	70.76	OK	500	2026-09-20 18:55	68.68	OK
501	2026-09-20 18:56	70.43	OK	502	2026-09-20 18:57	72.59	OK
503	2026-09-20 18:58	71.47	OK	504	2026-09-20 18:59	70.00	OK
505	2026-09-20 19:00	70.37	OK	506	2026-09-20 19:01	69.84	OK
507	2026-09-20 19:02	71.51	OK	508	2026-09-20 19:03	69.67	OK
509	2026-09-20 19:04	68.42	OK	510	2026-09-20 19:05	71.34	OK
511	2026-09-20 19:06	72.55	OK	512	2026-09-20 19:07	71.34	OK
513	2026-09-20 19:08	70.29	OK	514	2026-09-20 19:09	69.37	OK
515	2026-09-20 19:10	69.71	OK	516	2026-09-20 19:11	67.99	OK
517	2026-09-20 19:12	70.98	OK	518	2026-09-20 19:13	71.75	OK
519	2026-09-20 19:14	70.05	OK	520	2026-09-20 19:15	68.40	OK
521	2026-09-20 19:16	72.69	OK	522	2026-09-20 19:17	72.13	OK
523	2026-09-20 19:18	69.82	OK	524	2026-09-20 19:19	68.45	OK
525	2026-09-20 19:20	72.82	OK	526	2026-09-20 19:21	70.04	OK
527	2026-09-20 19:22	71.72	OK	528	2026-09-20 19:23	70.27	OK
529	2026-09-20 19:24	68.52	OK	530	2026-09-20 19:25	70.56	OK
531	2026-09-20 19:26	70.43	OK	532	2026-09-20 19:27	70.60	OK
533	2026-09-20 19:28	70.34	OK	534	2026-09-20 19:29	69.73	OK
535	2026-09-20 19:30	67.96	OK	536	2026-09-20 19:31	71.61	OK
537	2026-09-20 19:32	69.03	OK	538	2026-09-20 19:33	68.40	OK
539	2026-09-20 19:34	73.28	OK	540	2026-09-20 19:35	68.18	OK
541	2026-09-20 19:36	69.10	OK	542	2026-09-20 19:37	71.02	OK
543	2026-09-20 19:38	73.11	OK	544	2026-09-20 19:39	70.36	OK
545	2026-09-20 19:40	72.42	OK	546	2026-09-20 19:41	71.52	OK
547	2026-09-20 19:42	71.52	OK	548	2026-09-20 19:43	70.49	OK
549	2026-09-20 19:44	71.10	OK	550	2026-09-20 19:45	72.46	OK
551	2026-09-20 19:46	69.33	OK	552	2026-09-20 19:47	69.25	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
553	2026-09-20 19:48	71.13	OK	554	2026-09-20 19:49	69.89	OK
555	2026-09-20 19:50	71.96	OK	556	2026-09-20 19:51	69.39	OK
557	2026-09-20 19:52	70.55	OK	558	2026-09-20 19:53	68.54	OK
559	2026-09-20 19:54	69.23	OK	560	2026-09-20 19:55	68.39	OK
561	2026-09-20 19:56	71.36	OK	562	2026-09-20 19:57	67.65	OK
563	2026-09-20 19:58	70.27	OK	564	2026-09-20 19:59	70.02	OK
565	2026-09-20 20:00	70.26	OK	566	2026-09-20 20:01	71.49	OK
567	2026-09-20 20:02	69.84	OK	568	2026-09-20 20:03	72.06	OK
569	2026-09-20 20:04	70.83	OK	570	2026-09-20 20:05	70.12	OK
571	2026-09-20 20:06	71.79	OK	572	2026-09-20 20:07	68.29	OK
573	2026-09-20 20:08	70.27	OK	574	2026-09-20 20:09	72.43	OK
575	2026-09-20 20:10	71.32	OK	576	2026-09-20 20:11	67.05	OK
577	2026-09-20 20:12	70.80	OK	578	2026-09-20 20:13	68.75	OK
579	2026-09-20 20:14	70.09	OK	580	2026-09-20 20:15	71.15	OK
581	2026-09-20 20:16	70.64	OK	582	2026-09-20 20:17	69.44	OK
583	2026-09-20 20:18	70.65	OK	584	2026-09-20 20:19	68.07	OK
585	2026-09-20 20:20	68.80	OK	586	2026-09-20 20:21	71.23	OK
587	2026-09-20 20:22	70.66	OK	588	2026-09-20 20:23	68.10	OK
589	2026-09-20 20:24	70.09	OK	590	2026-09-20 20:25	69.45	OK
591	2026-09-20 20:26	70.50	OK	592	2026-09-20 20:27	70.49	OK
593	2026-09-20 20:28	73.22	OK	594	2026-09-20 20:29	71.14	OK
595	2026-09-20 20:30	69.25	OK	596	2026-09-20 20:31	69.36	OK
597	2026-09-20 20:32	68.60	OK	598	2026-09-20 20:33	69.51	OK
599	2026-09-20 20:34	70.26	OK	600	2026-09-20 20:35	68.98	OK
601	2026-09-20 20:36	70.45	OK	602	2026-09-20 20:37	71.22	OK
603	2026-09-20 20:38	72.39	OK	604	2026-09-20 20:39	71.03	OK
605	2026-09-20 20:40	68.72	OK	606	2026-09-20 20:41	68.60	OK
607	2026-09-20 20:42	71.30	OK	608	2026-09-20 20:43	70.41	OK
609	2026-09-20 20:44	68.23	OK	610	2026-09-20 20:45	70.51	OK
611	2026-09-20 20:46	70.84	OK	612	2026-09-20 20:47	69.07	OK
613	2026-09-20 20:48	71.47	OK	614	2026-09-20 20:49	69.13	OK
615	2026-09-20 20:50	70.84	OK	616	2026-09-20 20:51	69.30	OK
617	2026-09-20 20:52	68.42	OK	618	2026-09-20 20:53	72.02	OK
619	2026-09-20 20:54	70.11	OK	620	2026-09-20 20:55	69.88	OK
621	2026-09-20 20:56	71.03	OK	622	2026-09-20 20:57	70.55	OK
623	2026-09-20 20:58	71.06	OK	624	2026-09-20 20:59	73.02	OK
625	2026-09-20 21:00	71.43	OK	626	2026-09-20 21:01	70.85	OK
627	2026-09-20 21:02	69.47	OK	628	2026-09-20 21:03	70.90	OK
629	2026-09-20 21:04	68.92	OK	630	2026-09-20 21:05	70.30	OK
631	2026-09-20 21:06	67.58	OK	632	2026-09-20 21:07	70.26	OK
633	2026-09-20 21:08	70.88	OK	634	2026-09-20 21:09	68.55	OK
635	2026-09-20 21:10	72.15	OK	636	2026-09-20 21:11	69.04	OK
637	2026-09-20 21:12	68.39	OK	638	2026-09-20 21:13	68.30	OK
639	2026-09-20 21:14	68.11	OK	640	2026-09-20 21:15	71.53	OK
641	2026-09-20 21:16	71.29	OK	642	2026-09-20 21:17	71.92	OK
643	2026-09-20 21:18	69.95	OK	644	2026-09-20 21:19	67.80	OK
645	2026-09-20 21:20	67.97	OK	646	2026-09-20 21:21	68.57	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
647	2026-09-20 21:22	70.50	OK	648	2026-09-20 21:23	70.96	OK
649	2026-09-20 21:24	73.24	OK	650	2026-09-20 21:25	67.40	OK
651	2026-09-20 21:26	70.27	OK	652	2026-09-20 21:27	70.05	OK
653	2026-09-20 21:28	70.36	OK	654	2026-09-20 21:29	68.58	OK
655	2026-09-20 21:30	67.30	OK	656	2026-09-20 21:31	69.41	OK
657	2026-09-20 21:32	70.15	OK	658	2026-09-20 21:33	69.81	OK
659	2026-09-20 21:34	70.31	OK	660	2026-09-20 21:35	71.52	OK
661	2026-09-20 21:36	70.12	OK	662	2026-09-20 21:37	69.49	OK
663	2026-09-20 21:38	70.63	OK	664	2026-09-20 21:39	67.86	OK
665	2026-09-20 21:40	70.46	OK	666	2026-09-20 21:41	67.15	OK
667	2026-09-20 21:42	68.19	OK	668	2026-09-20 21:43	68.96	OK
669	2026-09-20 21:44	69.35	OK	670	2026-09-20 21:45	71.94	OK
671	2026-09-20 21:46	68.37	OK	672	2026-09-20 21:47	67.02	OK
673	2026-09-20 21:48	69.89	OK	674	2026-09-20 21:49	68.76	OK
675	2026-09-20 21:50	66.68	OK	676	2026-09-20 21:51	70.89	OK
677	2026-09-20 21:52	69.73	OK	678	2026-09-20 21:53	68.76	OK
679	2026-09-20 21:54	68.32	OK	680	2026-09-20 21:55	72.00	OK
681	2026-09-20 21:56	68.40	OK	682	2026-09-20 21:57	67.67	OK
683	2026-09-20 21:58	69.59	OK	684	2026-09-20 21:59	71.00	OK
685	2026-09-20 22:00	68.46	OK	686	2026-09-20 22:01	67.17	OK
687	2026-09-20 22:02	67.73	OK	688	2026-09-20 22:03	67.97	OK
689	2026-09-20 22:04	67.82	OK	690	2026-09-20 22:05	69.55	OK
691	2026-09-20 22:06	68.20	OK	692	2026-09-20 22:07	69.02	OK
693	2026-09-20 22:08	71.62	OK	694	2026-09-20 22:09	68.89	OK
695	2026-09-20 22:10	68.43	OK	696	2026-09-20 22:11	67.65	OK
697	2026-09-20 22:12	71.99	OK	698	2026-09-20 22:13	68.52	OK
699	2026-09-20 22:14	70.60	OK	700	2026-09-20 22:15	67.76	OK
701	2026-09-20 22:16	71.69	OK	702	2026-09-20 22:17	72.55	OK
703	2026-09-20 22:18	68.19	OK	704	2026-09-20 22:19	68.15	OK
705	2026-09-20 22:20	68.79	OK	706	2026-09-20 22:21	68.44	OK
707	2026-09-20 22:22	70.47	OK	708	2026-09-20 22:23	67.51	OK
709	2026-09-20 22:24	65.68	OK	710	2026-09-20 22:25	69.88	OK
711	2026-09-20 22:26	70.08	OK	712	2026-09-20 22:27	68.05	OK
713	2026-09-20 22:28	68.67	OK	714	2026-09-20 22:29	67.73	OK
715	2026-09-20 22:30	70.53	OK	716	2026-09-20 22:31	68.14	OK
717	2026-09-20 22:32	68.31	OK	718	2026-09-20 22:33	69.03	OK
719	2026-09-20 22:34	66.63	OK	720	2026-09-20 22:35	70.27	OK
721	2026-09-20 22:36	68.25	OK	722	2026-09-20 22:37	67.92	OK
723	2026-09-20 22:38	70.87	OK	724	2026-09-20 22:39	70.11	OK
725	2026-09-20 22:40	69.56	OK	726	2026-09-20 22:41	65.21	OK
727	2026-09-20 22:42	69.12	OK	728	2026-09-20 22:43	69.22	OK
729	2026-09-20 22:44	70.24	OK	730	2026-09-20 22:45	70.35	OK
731	2026-09-20 22:46	68.78	OK	732	2026-09-20 22:47	69.43	OK
733	2026-09-20 22:48	68.34	OK	734	2026-09-20 22:49	67.39	OK
735	2026-09-20 22:50	68.68	OK	736	2026-09-20 22:51	64.68	OK
737	2026-09-20 22:52	68.98	OK	738	2026-09-20 22:53	65.76	OK
739	2026-09-20 22:54	68.77	OK	740	2026-09-20 22:55	67.90	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
741	2026-09-20 22:56	69.11	OK	742	2026-09-20 22:57	67.21	OK
743	2026-09-20 22:58	67.93	OK	744	2026-09-20 22:59	64.75	OK
745	2026-09-20 23:00	70.74	OK	746	2026-09-20 23:01	69.46	OK
747	2026-09-20 23:02	69.41	OK	748	2026-09-20 23:03	67.73	OK
749	2026-09-20 23:04	67.68	OK	750	2026-09-20 23:05	69.78	OK
751	2026-09-20 23:06	67.88	OK	752	2026-09-20 23:07	66.88	OK
753	2026-09-20 23:08	70.01	OK	754	2026-09-20 23:09	70.45	OK
755	2026-09-20 23:10	65.52	OK	756	2026-09-20 23:11	67.79	OK
757	2026-09-20 23:12	66.87	OK	758	2026-09-20 23:13	70.19	OK
759	2026-09-20 23:14	66.51	OK	760	2026-09-20 23:15	67.14	OK
761	2026-09-20 23:16	68.20	OK	762	2026-09-20 23:17	67.22	OK
763	2026-09-20 23:18	68.75	OK	764	2026-09-20 23:19	68.22	OK
765	2026-09-20 23:20	68.41	OK	766	2026-09-20 23:21	70.50	OK
767	2026-09-20 23:22	64.98	OK	768	2026-09-20 23:23	69.68	OK
769	2026-09-20 23:24	67.94	OK	770	2026-09-20 23:25	66.25	OK
771	2026-09-20 23:26	69.58	OK	772	2026-09-20 23:27	66.79	OK
773	2026-09-20 23:28	67.90	OK	774	2026-09-20 23:29	66.73	OK
775	2026-09-20 23:30	69.14	OK	776	2026-09-20 23:31	66.46	OK
777	2026-09-20 23:32	67.06	OK	778	2026-09-20 23:33	69.07	OK
779	2026-09-20 23:34	66.79	OK	780	2026-09-20 23:35	69.80	OK
781	2026-09-20 23:36	68.12	OK	782	2026-09-20 23:37	69.13	OK
783	2026-09-20 23:38	69.10	OK	784	2026-09-20 23:39	66.22	OK
785	2026-09-20 23:40	65.31	OK	786	2026-09-20 23:41	69.28	OK
787	2026-09-20 23:42	65.66	OK	788	2026-09-20 23:43	66.81	OK
789	2026-09-20 23:44	66.35	OK	790	2026-09-20 23:45	68.18	OK
791	2026-09-20 23:46	67.09	OK	792	2026-09-20 23:47	64.19	OK
793	2026-09-20 23:48	66.24	OK	794	2026-09-20 23:49	67.04	OK
795	2026-09-20 23:50	65.43	OK	796	2026-09-20 23:51	65.92	OK
797	2026-09-20 23:52	64.85	OK	798	2026-09-20 23:53	67.60	OK
799	2026-09-20 23:54	69.12	OK	800	2026-09-20 23:55	68.45	OK
801	2026-09-20 23:56	64.86	OK	802	2026-09-20 23:57	66.40	OK
803	2026-09-20 23:58	67.29	OK	804	2026-09-20 23:59	67.57	OK
805	2026-09-21 00:00	65.58	OK	806	2026-09-21 00:01	66.67	OK
807	2026-09-21 00:02	67.42	OK	808	2026-09-21 00:03	69.48	OK
809	2026-09-21 00:04	67.42	OK	810	2026-09-21 00:05	65.68	OK
811	2026-09-21 00:06	66.38	OK	812	2026-09-21 00:07	66.56	OK
813	2026-09-21 00:08	69.78	OK	814	2026-09-21 00:09	65.45	OK
815	2026-09-21 00:10	68.25	OK	816	2026-09-21 00:11	66.80	OK
817	2026-09-21 00:12	68.35	OK	818	2026-09-21 00:13	66.18	OK
819	2026-09-21 00:14	67.85	OK	820	2026-09-21 00:15	66.85	OK
821	2026-09-21 00:16	67.28	OK	822	2026-09-21 00:17	68.12	OK
823	2026-09-21 00:18	67.61	OK	824	2026-09-21 00:19	67.16	OK
825	2026-09-21 00:20	64.27	OK	826	2026-09-21 00:21	66.61	OK
827	2026-09-21 00:22	68.64	OK	828	2026-09-21 00:23	66.15	OK
829	2026-09-21 00:24	62.43	OK	830	2026-09-21 00:25	64.47	OK
831	2026-09-21 00:26	67.07	OK	832	2026-09-21 00:27	66.36	OK
833	2026-09-21 00:28	66.58	OK	834	2026-09-21 00:29	68.04	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
835	2026-09-21 00:30	67.29	OK	836	2026-09-21 00:31	66.30	OK
837	2026-09-21 00:32	63.41	OK	838	2026-09-21 00:33	66.98	OK
839	2026-09-21 00:34	67.33	OK	840	2026-09-21 00:35	65.78	OK
841	2026-09-21 00:36	68.74	OK	842	2026-09-21 00:37	65.83	OK
843	2026-09-21 00:38	64.53	OK	844	2026-09-21 00:39	67.12	OK
845	2026-09-21 00:40	66.41	OK	846	2026-09-21 00:41	67.97	OK
847	2026-09-21 00:42	63.85	OK	848	2026-09-21 00:43	65.55	OK
849	2026-09-21 00:44	64.78	OK	850	2026-09-21 00:45	64.99	OK
851	2026-09-21 00:46	66.41	OK	852	2026-09-21 00:47	66.29	OK
853	2026-09-21 00:48	66.97	OK	854	2026-09-21 00:49	64.63	OK
855	2026-09-21 00:50	64.34	OK	856	2026-09-21 00:51	62.89	OK
857	2026-09-21 00:52	64.63	OK	858	2026-09-21 00:53	65.85	OK
859	2026-09-21 00:54	66.11	OK	860	2026-09-21 00:55	64.97	OK
861	2026-09-21 00:56	66.52	OK	862	2026-09-21 00:57	67.23	OK
863	2026-09-21 00:58	66.54	OK	864	2026-09-21 00:59	66.01	OK
865	2026-09-21 01:00	65.20	OK	866	2026-09-21 01:01	65.76	OK
867	2026-09-21 01:02	63.34	OK	868	2026-09-21 01:03	66.96	OK
869	2026-09-21 01:04	63.07	OK	870	2026-09-21 01:05	65.39	OK
871	2026-09-21 01:06	62.98	OK	872	2026-09-21 01:07	66.89	OK
873	2026-09-21 01:08	65.49	OK	874	2026-09-21 01:09	64.55	OK
875	2026-09-21 01:10	63.84	OK	876	2026-09-21 01:11	66.29	OK
877	2026-09-21 01:12	62.83	OK	878	2026-09-21 01:13	63.99	OK
879	2026-09-21 01:14	64.04	OK	880	2026-09-21 01:15	66.52	OK
881	2026-09-21 01:16	63.79	OK	882	2026-09-21 01:17	62.09	OK
883	2026-09-21 01:18	64.05	OK	884	2026-09-21 01:19	63.94	OK
885	2026-09-21 01:20	63.61	OK	886	2026-09-21 01:21	67.54	OK
887	2026-09-21 01:22	63.81	OK	888	2026-09-21 01:23	65.16	OK
889	2026-09-21 01:24	65.02	OK	890	2026-09-21 01:25	65.60	OK
891	2026-09-21 01:26	65.04	OK	892	2026-09-21 01:27	64.81	OK
893	2026-09-21 01:28	64.84	OK	894	2026-09-21 01:29	64.08	OK
895	2026-09-21 01:30	63.62	OK	896	2026-09-21 01:31	64.34	OK
897	2026-09-21 01:32	65.17	OK	898	2026-09-21 01:33	65.85	OK
899	2026-09-21 01:34	64.97	OK	900	2026-09-21 01:35	65.45	OK
901	2026-09-21 01:36	64.85	OK	902	2026-09-21 01:37	63.43	OK
903	2026-09-21 01:38	64.25	OK	904	2026-09-21 01:39	66.05	OK
905	2026-09-21 01:40	67.33	OK	906	2026-09-21 01:41	67.11	OK
907	2026-09-21 01:42	64.43	OK	908	2026-09-21 01:43	63.78	OK
909	2026-09-21 01:44	62.34	OK	910	2026-09-21 01:45	64.87	OK
911	2026-09-21 01:46	65.10	OK	912	2026-09-21 01:47	64.78	OK
913	2026-09-21 01:48	66.43	OK	914	2026-09-21 01:49	66.39	OK
915	2026-09-21 01:50	65.09	OK	916	2026-09-21 01:51	63.67	OK
917	2026-09-21 01:52	65.39	OK	918	2026-09-21 01:53	63.68	OK
919	2026-09-21 01:54	64.03	OK	920	2026-09-21 01:55	63.41	OK
921	2026-09-21 01:56	64.40	OK	922	2026-09-21 01:57	63.69	OK
923	2026-09-21 01:58	66.12	OK	924	2026-09-21 01:59	65.41	OK
925	2026-09-21 02:00	63.15	OK	926	2026-09-21 02:01	64.28	OK
927	2026-09-21 02:02	62.57	OK	928	2026-09-21 02:03	60.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
929	2026-09-21 02:04	60.66	OK	930	2026-09-21 02:05	64.55	OK
931	2026-09-21 02:06	66.02	OK	932	2026-09-21 02:07	63.92	OK
933	2026-09-21 02:08	64.01	OK	934	2026-09-21 02:09	62.75	OK
935	2026-09-21 02:10	63.60	OK	936	2026-09-21 02:11	66.17	OK
937	2026-09-21 02:12	64.10	OK	938	2026-09-21 02:13	65.02	OK
939	2026-09-21 02:14	62.96	OK	940	2026-09-21 02:15	65.22	OK
941	2026-09-21 02:16	64.84	OK	942	2026-09-21 02:17	65.36	OK
943	2026-09-21 02:18	63.72	OK	944	2026-09-21 02:19	62.10	OK
945	2026-09-21 02:20	61.88	OK	946	2026-09-21 02:21	64.90	OK
947	2026-09-21 02:22	63.78	OK	948	2026-09-21 02:23	62.80	OK
949	2026-09-21 02:24	61.09	OK	950	2026-09-21 02:25	64.26	OK
951	2026-09-21 02:26	63.34	OK	952	2026-09-21 02:27	64.52	OK
953	2026-09-21 02:28	60.72	OK	954	2026-09-21 02:29	62.47	OK
955	2026-09-21 02:30	62.92	OK	956	2026-09-21 02:31	62.12	OK
957	2026-09-21 02:32	63.80	OK	958	2026-09-21 02:33	62.58	OK
959	2026-09-21 02:34	62.87	OK	960	2026-09-21 02:35	63.18	OK
961	2026-09-21 02:36	59.35	OK	962	2026-09-21 02:37	61.47	OK
963	2026-09-21 02:38	65.48	OK	964	2026-09-21 02:39	65.41	OK
965	2026-09-21 02:40	62.80	OK	966	2026-09-21 02:41	66.23	OK
967	2026-09-21 02:42	62.44	OK	968	2026-09-21 02:43	64.95	OK
969	2026-09-21 02:44	61.72	OK	970	2026-09-21 02:45	65.19	OK
971	2026-09-21 02:46	62.39	OK	972	2026-09-21 02:47	61.88	OK
973	2026-09-21 02:48	62.79	OK	974	2026-09-21 02:49	62.19	OK
975	2026-09-21 02:50	63.62	OK	976	2026-09-21 02:51	64.37	OK
977	2026-09-21 02:52	64.63	OK	978	2026-09-21 02:53	61.31	OK
979	2026-09-21 02:54	62.53	OK	980	2026-09-21 02:55	62.53	OK
981	2026-09-21 02:56	60.81	OK	982	2026-09-21 02:57	62.89	OK
983	2026-09-21 02:58	62.54	OK	984	2026-09-21 02:59	63.13	OK
985	2026-09-21 03:00	65.37	OK	986	2026-09-21 03:01	61.31	OK
987	2026-09-21 03:02	62.70	OK	988	2026-09-21 03:03	61.47	OK
989	2026-09-21 03:04	63.32	OK	990	2026-09-21 03:05	61.61	OK
991	2026-09-21 03:06	60.87	OK	992	2026-09-21 03:07	63.41	OK
993	2026-09-21 03:08	64.49	OK	994	2026-09-21 03:09	58.81	OK
995	2026-09-21 03:10	61.27	OK	996	2026-09-21 03:11	58.87	OK
997	2026-09-21 03:12	61.72	OK	998	2026-09-21 03:13	64.64	OK
999	2026-09-21 03:14	61.96	OK	1000	2026-09-21 03:15	60.65	OK
1001	2026-09-21 03:16	62.45	OK	1002	2026-09-21 03:17	62.72	OK
1003	2026-09-21 03:18	61.33	OK	1004	2026-09-21 03:19	62.07	OK
1005	2026-09-21 03:20	60.75	OK	1006	2026-09-21 03:21	61.29	OK
1007	2026-09-21 03:22	64.83	OK	1008	2026-09-21 03:23	63.09	OK
1009	2026-09-21 03:24	61.78	OK	1010	2026-09-21 03:25	58.77	OK
1011	2026-09-21 03:26	60.91	OK	1012	2026-09-21 03:27	62.43	OK
1013	2026-09-21 03:28	64.77	OK	1014	2026-09-21 03:29	63.07	OK
1015	2026-09-21 03:30	62.24	OK	1016	2026-09-21 03:31	62.87	OK
1017	2026-09-21 03:32	61.71	OK	1018	2026-09-21 03:33	60.20	OK
1019	2026-09-21 03:34	60.48	OK	1020	2026-09-21 03:35	61.76	OK
1021	2026-09-21 03:36	65.10	OK	1022	2026-09-21 03:37	58.30	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1023	2026-09-21 03:38	61.15	OK	1024	2026-09-21 03:39	62.37	OK
1025	2026-09-21 03:40	59.89	OK	1026	2026-09-21 03:41	61.41	OK
1027	2026-09-21 03:42	62.11	OK	1028	2026-09-21 03:43	60.90	OK
1029	2026-09-21 03:44	63.28	OK	1030	2026-09-21 03:45	61.47	OK
1031	2026-09-21 03:46	62.72	OK	1032	2026-09-21 03:47	63.10	OK
1033	2026-09-21 03:48	61.27	OK	1034	2026-09-21 03:49	61.64	OK
1035	2026-09-21 03:50	58.57	OK	1036	2026-09-21 03:51	61.88	OK
1037	2026-09-21 03:52	61.80	OK	1038	2026-09-21 03:53	61.46	OK
1039	2026-09-21 03:54	64.07	OK	1040	2026-09-21 03:55	60.65	OK
1041	2026-09-21 03:56	60.78	OK	1042	2026-09-21 03:57	63.04	OK
1043	2026-09-21 03:58	59.30	OK	1044	2026-09-21 03:59	61.94	OK
1045	2026-09-21 04:00	61.07	OK	1046	2026-09-21 04:01	60.73	OK
1047	2026-09-21 04:02	61.30	OK	1048	2026-09-21 04:03	59.24	OK
1049	2026-09-21 04:04	62.51	OK	1050	2026-09-21 04:05	60.08	OK
1051	2026-09-21 04:06	60.36	OK	1052	2026-09-21 04:07	59.02	OK
1053	2026-09-21 04:08	63.38	OK	1054	2026-09-21 04:09	61.82	OK
1055	2026-09-21 04:10	59.58	OK	1056	2026-09-21 04:11	61.03	OK
1057	2026-09-21 04:12	61.04	OK	1058	2026-09-21 04:13	61.39	OK
1059	2026-09-21 04:14	63.17	OK	1060	2026-09-21 04:15	62.83	OK
1061	2026-09-21 04:16	59.37	OK	1062	2026-09-21 04:17	61.40	OK
1063	2026-09-21 04:18	61.79	OK	1064	2026-09-21 04:19	60.42	OK
1065	2026-09-21 04:20	61.02	OK	1066	2026-09-21 04:21	61.17	OK
1067	2026-09-21 04:22	59.67	OK	1068	2026-09-21 04:23	60.52	OK
1069	2026-09-21 04:24	60.19	OK	1070	2026-09-21 04:25	61.44	OK
1071	2026-09-21 04:26	62.40	OK	1072	2026-09-21 04:27	62.65	OK
1073	2026-09-21 04:28	60.07	OK	1074	2026-09-21 04:29	62.53	OK
1075	2026-09-21 04:30	58.26	OK	1076	2026-09-21 04:31	59.09	OK
1077	2026-09-21 04:32	61.25	OK	1078	2026-09-21 04:33	60.87	OK
1079	2026-09-21 04:34	60.82	OK	1080	2026-09-21 04:35	60.45	OK
1081	2026-09-21 04:36	59.42	OK	1082	2026-09-21 04:37	61.69	OK
1083	2026-09-21 04:38	59.01	OK	1084	2026-09-21 04:39	59.85	OK
1085	2026-09-21 04:40	60.73	OK	1086	2026-09-21 04:41	60.98	OK
1087	2026-09-21 04:42	60.37	OK	1088	2026-09-21 04:43	58.26	OK
1089	2026-09-21 04:44	59.61	OK	1090	2026-09-21 04:45	61.33	OK
1091	2026-09-21 04:46	62.70	OK	1092	2026-09-21 04:47	60.13	OK
1093	2026-09-21 04:48	57.64	OK	1094	2026-09-21 04:49	61.22	OK
1095	2026-09-21 04:50	58.26	OK	1096	2026-09-21 04:51	58.97	OK
1097	2026-09-21 04:52	60.32	OK	1098	2026-09-21 04:53	59.34	OK
1099	2026-09-21 04:54	58.93	OK	1100	2026-09-21 04:55	60.25	OK
1101	2026-09-21 04:56	60.17	OK	1102	2026-09-21 04:57	60.21	OK
1103	2026-09-21 04:58	59.75	OK	1104	2026-09-21 04:59	61.35	OK
1105	2026-09-21 05:00	60.47	OK	1106	2026-09-21 05:01	61.65	OK
1107	2026-09-21 05:02	62.87	OK	1108	2026-09-21 05:03	60.68	OK
1109	2026-09-21 05:04	61.14	OK	1110	2026-09-21 05:05	61.45	OK
1111	2026-09-21 05:06	59.64	OK	1112	2026-09-21 05:07	61.65	OK
1113	2026-09-21 05:08	58.11	OK	1114	2026-09-21 05:09	60.76	OK
1115	2026-09-21 05:10	60.36	OK	1116	2026-09-21 05:11	60.72	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1117	2026-09-21 05:12	62.03	OK	1118	2026-09-21 05:13	60.48	OK
1119	2026-09-21 05:14	61.29	OK	1120	2026-09-21 05:15	62.66	OK
1121	2026-09-21 05:16	60.10	OK	1122	2026-09-21 05:17	61.25	OK
1123	2026-09-21 05:18	61.64	OK	1124	2026-09-21 05:19	60.34	OK
1125	2026-09-21 05:20	59.46	OK	1126	2026-09-21 05:21	58.17	OK
1127	2026-09-21 05:22	57.69	OK	1128	2026-09-21 05:23	57.47	OK
1129	2026-09-21 05:24	61.01	OK	1130	2026-09-21 05:25	59.96	OK
1131	2026-09-21 05:26	59.69	OK	1132	2026-09-21 05:27	59.45	OK
1133	2026-09-21 05:28	61.41	OK	1134	2026-09-21 05:29	58.69	OK
1135	2026-09-21 05:30	60.10	OK	1136	2026-09-21 05:31	57.96	OK
1137	2026-09-21 05:32	58.79	OK	1138	2026-09-21 05:33	57.41	OK
1139	2026-09-21 05:34	59.19	OK	1140	2026-09-21 05:35	61.35	OK
1141	2026-09-21 05:36	62.06	OK	1142	2026-09-21 05:37	59.36	OK
1143	2026-09-21 05:38	60.71	OK	1144	2026-09-21 05:39	62.62	OK
1145	2026-09-21 05:40	57.32	OK	1146	2026-09-21 05:41	57.65	OK
1147	2026-09-21 05:42	60.20	OK	1148	2026-09-21 05:43	62.81	OK
1149	2026-09-21 05:44	57.96	OK	1150	2026-09-21 05:45	60.99	OK
1151	2026-09-21 05:46	59.46	OK	1152	2026-09-21 05:47	59.99	OK
1153	2026-09-21 05:48	60.61	OK	1154	2026-09-21 05:49	59.26	OK
1155	2026-09-21 05:50	59.22	OK	1156	2026-09-21 05:51	60.79	OK
1157	2026-09-21 05:52	61.02	OK	1158	2026-09-21 05:53	59.83	OK
1159	2026-09-21 05:54	58.89	OK	1160	2026-09-21 05:55	60.12	OK
1161	2026-09-21 05:56	60.67	OK	1162	2026-09-21 05:57	58.70	OK
1163	2026-09-21 05:58	59.19	OK	1164	2026-09-21 05:59	62.07	OK
1165	2026-09-21 06:00	61.17	OK	1166	2026-09-21 06:01	60.95	OK
1167	2026-09-21 06:02	61.20	OK	1168	2026-09-21 06:03	59.55	OK
1169	2026-09-21 06:04	59.00	OK	1170	2026-09-21 06:05	62.52	OK
1171	2026-09-21 06:06	58.58	OK	1172	2026-09-21 06:07	59.54	OK
1173	2026-09-21 06:08	59.38	OK	1174	2026-09-21 06:09	56.89	OK
1175	2026-09-21 06:10	59.60	OK	1176	2026-09-21 06:11	57.97	OK
1177	2026-09-21 06:12	59.54	OK	1178	2026-09-21 06:13	60.37	OK
1179	2026-09-21 06:14	59.22	OK	1180	2026-09-21 06:15	61.23	OK
1181	2026-09-21 06:16	58.32	OK	1182	2026-09-21 06:17	57.40	OK
1183	2026-09-21 06:18	56.58	OK	1184	2026-09-21 06:19	60.69	OK
1185	2026-09-21 06:20	57.95	OK	1186	2026-09-21 06:21	59.94	OK
1187	2026-09-21 06:22	59.34	OK	1188	2026-09-21 06:23	59.90	OK
1189	2026-09-21 06:24	57.15	OK	1190	2026-09-21 06:25	58.40	OK
1191	2026-09-21 06:26	58.89	OK	1192	2026-09-21 06:27	61.56	OK
1193	2026-09-21 06:28	58.66	OK	1194	2026-09-21 06:29	58.10	OK
1195	2026-09-21 06:30	59.18	OK	1196	2026-09-21 06:31	59.79	OK
1197	2026-09-21 06:32	59.85	OK	1198	2026-09-21 06:33	61.71	OK
1199	2026-09-21 06:34	61.06	OK	1200	2026-09-21 06:35	60.08	OK
1201	2026-09-21 06:36	60.07	OK	1202	2026-09-21 06:37	61.30	OK
1203	2026-09-21 06:38	57.26	OK	1204	2026-09-21 06:39	62.16	OK
1205	2026-09-21 06:40	57.02	OK	1206	2026-09-21 06:41	60.38	OK
1207	2026-09-21 06:42	58.87	OK	1208	2026-09-21 06:43	58.82	OK
1209	2026-09-21 06:44	57.66	OK	1210	2026-09-21 06:45	58.55	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1211	2026-09-21 06:46	58.06	OK	1212	2026-09-21 06:47	58.72	OK
1213	2026-09-21 06:48	59.53	OK	1214	2026-09-21 06:49	59.88	OK
1215	2026-09-21 06:50	57.85	OK	1216	2026-09-21 06:51	58.97	OK
1217	2026-09-21 06:52	57.38	OK	1218	2026-09-21 06:53	59.04	OK
1219	2026-09-21 06:54	62.66	OK	1220	2026-09-21 06:55	59.92	OK
1221	2026-09-21 06:56	58.73	OK	1222	2026-09-21 06:57	59.69	OK
1223	2026-09-21 06:58	57.01	OK	1224	2026-09-21 06:59	57.78	OK
1225	2026-09-21 07:00	58.11	OK	1226	2026-09-21 07:01	55.79	OK
1227	2026-09-21 07:02	57.66	OK	1228	2026-09-21 07:03	59.80	OK
1229	2026-09-21 07:04	59.25	OK	1230	2026-09-21 07:05	57.04	OK
1231	2026-09-21 07:06	56.28	OK	1232	2026-09-21 07:07	60.02	OK
1233	2026-09-21 07:08	59.63	OK	1234	2026-09-21 07:09	59.70	OK
1235	2026-09-21 07:10	57.62	OK	1236	2026-09-21 07:11	58.16	OK
1237	2026-09-21 07:12	59.26	OK	1238	2026-09-21 07:13	59.77	OK
1239	2026-09-21 07:14	59.47	OK	1240	2026-09-21 07:15	61.23	OK
1241	2026-09-21 07:16	58.25	OK	1242	2026-09-21 07:17	60.34	OK
1243	2026-09-21 07:18	56.88	OK	1244	2026-09-21 07:19	60.65	OK
1245	2026-09-21 07:20	60.34	OK	1246	2026-09-21 07:21	59.90	OK
1247	2026-09-21 07:22	57.47	OK	1248	2026-09-21 07:23	59.44	OK
1249	2026-09-21 07:24	59.84	OK	1250	2026-09-21 07:25	57.43	OK
1251	2026-09-21 07:26	62.85	OK	1252	2026-09-21 07:27	59.09	OK
1253	2026-09-21 07:28	60.47	OK	1254	2026-09-21 07:29	59.89	OK
1255	2026-09-21 07:30	56.72	OK	1256	2026-09-21 07:31	60.91	OK
1257	2026-09-21 07:32	57.59	OK	1258	2026-09-21 07:33	56.22	OK
1259	2026-09-21 07:34	58.53	OK	1260	2026-09-21 07:35	60.52	OK
1261	2026-09-21 07:36	58.98	OK	1262	2026-09-21 07:37	58.03	OK
1263	2026-09-21 07:38	57.04	OK	1264	2026-09-21 07:39	58.82	OK
1265	2026-09-21 07:40	56.88	OK	1266	2026-09-21 07:41	58.02	OK
1267	2026-09-21 07:42	60.44	OK	1268	2026-09-21 07:43	57.64	OK
1269	2026-09-21 07:44	59.03	OK	1270	2026-09-21 07:45	59.51	OK
1271	2026-09-21 07:46	58.99	OK	1272	2026-09-21 07:47	59.15	OK
1273	2026-09-21 07:48	58.97	OK	1274	2026-09-21 07:49	56.62	OK
1275	2026-09-21 07:50	62.08	OK	1276	2026-09-21 07:51	60.94	OK
1277	2026-09-21 07:52	58.41	OK	1278	2026-09-21 07:53	62.13	OK
1279	2026-09-21 07:54	59.51	OK	1280	2026-09-21 07:55	57.93	OK
1281	2026-09-21 07:56	61.43	OK	1282	2026-09-21 07:57	60.38	OK
1283	2026-09-21 07:58	60.90	OK	1284	2026-09-21 07:59	59.71	OK
1285	2026-09-21 08:00	59.63	OK	1286	2026-09-21 08:01	59.30	OK
1287	2026-09-21 08:02	59.27	OK	1288	2026-09-21 08:03	59.32	OK
1289	2026-09-21 08:04	61.18	OK	1290	2026-09-21 08:05	61.44	OK
1291	2026-09-21 08:06	59.36	OK	1292	2026-09-21 08:07	60.73	OK
1293	2026-09-21 08:08	60.91	OK	1294	2026-09-21 08:09	58.47	OK
1295	2026-09-21 08:10	57.51	OK	1296	2026-09-21 08:11	59.32	OK
1297	2026-09-21 08:12	59.94	OK	1298	2026-09-21 08:13	58.13	OK
1299	2026-09-21 08:14	58.78	OK	1300	2026-09-21 08:15	57.48	OK
1301	2026-09-21 08:16	60.04	OK	1302	2026-09-21 08:17	59.74	OK
1303	2026-09-21 08:18	59.92	OK	1304	2026-09-21 08:19	60.89	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1305	2026-09-21 08:20	58.47	OK	1306	2026-09-21 08:21	60.06	OK
1307	2026-09-21 08:22	60.08	OK	1308	2026-09-21 08:23	59.99	OK
1309	2026-09-21 08:24	57.02	OK	1310	2026-09-21 08:25	58.96	OK
1311	2026-09-21 08:26	58.02	OK	1312	2026-09-21 08:27	59.55	OK
1313	2026-09-21 08:28	58.05	OK	1314	2026-09-21 08:29	56.91	OK
1315	2026-09-21 08:30	58.32	OK	1316	2026-09-21 08:31	61.30	OK
1317	2026-09-21 08:32	58.86	OK	1318	2026-09-21 08:33	59.94	OK
1319	2026-09-21 08:34	59.02	OK	1320	2026-09-21 08:35	59.90	OK
1321	2026-09-21 08:36	58.48	OK	1322	2026-09-21 08:37	58.23	OK
1323	2026-09-21 08:38	59.12	OK	1324	2026-09-21 08:39	58.72	OK
1325	2026-09-21 08:40	61.07	OK	1326	2026-09-21 08:41	56.15	OK
1327	2026-09-21 08:42	60.60	OK	1328	2026-09-21 08:43	59.92	OK
1329	2026-09-21 08:44	57.38	OK	1330	2026-09-21 08:45	59.53	OK
1331	2026-09-21 08:46	61.33	OK	1332	2026-09-21 08:47	60.95	OK
1333	2026-09-21 08:48	59.86	OK	1334	2026-09-21 08:49	59.89	OK
1335	2026-09-21 08:50	60.85	OK	1336	2026-09-21 08:51	59.68	OK
1337	2026-09-21 08:52	59.95	OK	1338	2026-09-21 08:53	58.89	OK
1339	2026-09-21 08:54	61.50	OK	1340	2026-09-21 08:55	58.57	OK
1341	2026-09-21 08:56	56.49	OK	1342	2026-09-21 08:57	59.74	OK
1343	2026-09-21 08:58	58.31	OK	1344	2026-09-21 08:59	58.10	OK
1345	2026-09-21 09:00	58.13	OK	1346	2026-09-21 09:01	60.54	OK
1347	2026-09-21 09:02	59.07	OK	1348	2026-09-21 09:03	58.28	OK
1349	2026-09-21 09:04	59.64	OK	1350	2026-09-21 09:05	60.14	OK
1351	2026-09-21 09:06	60.07	OK	1352	2026-09-21 09:07	60.00	OK
1353	2026-09-21 09:08	58.83	OK	1354	2026-09-21 09:09	60.60	OK
1355	2026-09-21 09:10	60.00	OK	1356	2026-09-21 09:11	58.29	OK
1357	2026-09-21 09:12	59.38	OK	1358	2026-09-21 09:13	61.76	OK
1359	2026-09-21 09:14	59.00	OK	1360	2026-09-21 09:15	61.42	OK
1361	2026-09-21 09:16	56.26	OK	1362	2026-09-21 09:17	61.53	OK
1363	2026-09-21 09:18	60.89	OK	1364	2026-09-21 09:19	61.52	OK
1365	2026-09-21 09:20	61.93	OK	1366	2026-09-21 09:21	60.80	OK
1367	2026-09-21 09:22	58.23	OK	1368	2026-09-21 09:23	59.62	OK
1369	2026-09-21 09:24	58.76	OK	1370	2026-09-21 09:25	60.46	OK
1371	2026-09-21 09:26	60.98	OK	1372	2026-09-21 09:27	61.28	OK
1373	2026-09-21 09:28	61.92	OK	1374	2026-09-21 09:29	61.52	OK
1375	2026-09-21 09:30	59.91	OK	1376	2026-09-21 09:31	59.35	OK
1377	2026-09-21 09:32	59.78	OK	1378	2026-09-21 09:33	58.89	OK
1379	2026-09-21 09:34	60.28	OK	1380	2026-09-21 09:35	62.02	OK
1381	2026-09-21 09:36	58.33	OK	1382	2026-09-21 09:37	60.54	OK
1383	2026-09-21 09:38	58.86	OK	1384	2026-09-21 09:39	58.70	OK
1385	2026-09-21 09:40	60.02	OK	1386	2026-09-21 09:41	61.28	OK
1387	2026-09-21 09:42	58.46	OK	1388	2026-09-21 09:43	58.34	OK
1389	2026-09-21 09:44	59.16	OK	1390	2026-09-21 09:45	60.75	OK
1391	2026-09-21 09:46	61.95	OK	1392	2026-09-21 09:47	61.40	OK
1393	2026-09-21 09:48	61.66	OK	1394	2026-09-21 09:49	62.04	OK
1395	2026-09-21 09:50	58.76	OK	1396	2026-09-21 09:51	59.77	OK
1397	2026-09-21 09:52	57.62	OK	1398	2026-09-21 09:53	59.44	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1399	2026-09-21 09:54	58.91	OK	1400	2026-09-21 09:55	61.91	OK
1401	2026-09-21 09:56	59.33	OK	1402	2026-09-21 09:57	60.36	OK
1403	2026-09-21 09:58	62.36	OK	1404	2026-09-21 09:59	59.50	OK
1405	2026-09-21 10:00	57.72	OK	1406	2026-09-21 10:01	63.11	OK
1407	2026-09-21 10:02	61.29	OK	1408	2026-09-21 10:03	58.10	OK
1409	2026-09-21 10:04	63.28	OK	1410	2026-09-21 10:05	59.14	OK
1411	2026-09-21 10:06	62.52	OK	1412	2026-09-21 10:07	60.41	OK
1413	2026-09-21 10:08	60.58	OK	1414	2026-09-21 10:09	60.30	OK
1415	2026-09-21 10:10	58.73	OK	1416	2026-09-21 10:11	58.75	OK
1417	2026-09-21 10:12	60.68	OK	1418	2026-09-21 10:13	61.25	OK
1419	2026-09-21 10:14	60.68	OK	1420	2026-09-21 10:15	60.78	OK
1421	2026-09-21 10:16	60.61	OK	1422	2026-09-21 10:17	59.47	OK
1423	2026-09-21 10:18	60.87	OK	1424	2026-09-21 10:19	61.78	OK
1425	2026-09-21 10:20	59.30	OK	1426	2026-09-21 10:21	61.14	OK
1427	2026-09-21 10:22	60.51	OK	1428	2026-09-21 10:23	59.01	OK
1429	2026-09-21 10:24	59.78	OK	1430	2026-09-21 10:25	59.72	OK
1431	2026-09-21 10:26	64.33	OK	1432	2026-09-21 10:27	64.00	OK
1433	2026-09-21 10:28	58.05	OK	1434	2026-09-21 10:29	58.13	OK
1435	2026-09-21 10:30	62.32	OK	1436	2026-09-21 10:31	61.43	OK
1437	2026-09-21 10:32	62.80	OK	1438	2026-09-21 10:33	58.82	OK
1439	2026-09-21 10:34	61.13	OK	1440	2026-09-21 10:35	59.86	OK
1441	2026-09-21 10:36	62.84	OK	1442	2026-09-21 10:37	60.21	OK
1443	2026-09-21 10:38	58.58	OK	1444	2026-09-21 10:39	61.92	OK
1445	2026-09-21 10:40	62.20	OK	1446	2026-09-21 10:41	62.41	OK
1447	2026-09-21 10:42	60.50	OK	1448	2026-09-21 10:43	63.50	OK
1449	2026-09-21 10:44	61.05	OK	1450	2026-09-21 10:45	59.45	OK
1451	2026-09-21 10:46	57.97	OK	1452	2026-09-21 10:47	60.41	OK
1453	2026-09-21 10:48	60.84	OK	1454	2026-09-21 10:49	59.07	OK
1455	2026-09-21 10:50	58.14	OK	1456	2026-09-21 10:51	61.24	OK
1457	2026-09-21 10:52	60.77	OK	1458	2026-09-21 10:53	61.13	OK
1459	2026-09-21 10:54	61.56	OK	1460	2026-09-21 10:55	62.44	OK
1461	2026-09-21 10:56	59.75	OK	1462	2026-09-21 10:57	58.16	OK
1463	2026-09-21 10:58	60.30	OK	1464	2026-09-21 10:59	62.26	OK
1465	2026-09-21 11:00	62.13	OK	1466	2026-09-21 11:01	63.79	OK
1467	2026-09-21 11:02	61.56	OK	1468	2026-09-21 11:03	63.97	OK
1469	2026-09-21 11:04	61.61	OK	1470	2026-09-21 11:05	62.86	OK
1471	2026-09-21 11:06	64.19	OK	1472	2026-09-21 11:07	61.04	OK
1473	2026-09-21 11:08	61.36	OK	1474	2026-09-21 11:09	60.68	OK
1475	2026-09-21 11:10	61.27	OK	1476	2026-09-21 11:11	61.57	OK
1477	2026-09-21 11:12	61.01	OK	1478	2026-09-21 11:13	59.93	OK
1479	2026-09-21 11:14	63.74	OK	1480	2026-09-21 11:15	61.65	OK
1481	2026-09-21 11:16	60.75	OK	1482	2026-09-21 11:17	61.79	OK
1483	2026-09-21 11:18	61.29	OK	1484	2026-09-21 11:19	59.18	OK
1485	2026-09-21 11:20	62.95	OK	1486	2026-09-21 11:21	63.89	OK
1487	2026-09-21 11:22	61.05	OK	1488	2026-09-21 11:23	60.98	OK
1489	2026-09-21 11:24	60.29	OK	1490	2026-09-21 11:25	60.71	OK
1491	2026-09-21 11:26	61.01	OK	1492	2026-09-21 11:27	61.63	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1493	2026-09-21 11:28	62.92	OK	1494	2026-09-21 11:29	62.51	OK
1495	2026-09-21 11:30	58.57	OK	1496	2026-09-21 11:31	61.58	OK
1497	2026-09-21 11:32	60.66	OK	1498	2026-09-21 11:33	63.80	OK
1499	2026-09-21 11:34	64.15	OK	1500	2026-09-21 11:35	62.58	OK
1501	2026-09-21 11:36	62.06	OK	1502	2026-09-21 11:37	61.51	OK
1503	2026-09-21 11:38	63.79	OK	1504	2026-09-21 11:39	62.09	OK
1505	2026-09-21 11:40	61.79	OK	1506	2026-09-21 11:41	60.51	OK
1507	2026-09-21 11:42	61.30	OK	1508	2026-09-21 11:43	59.65	OK
1509	2026-09-21 11:44	61.37	OK	1510	2026-09-21 11:45	63.20	OK
1511	2026-09-21 11:46	63.01	OK	1512	2026-09-21 11:47	59.72	OK
1513	2026-09-21 11:48	64.19	OK	1514	2026-09-21 11:49	63.00	OK
1515	2026-09-21 11:50	64.81	OK	1516	2026-09-21 11:51	62.32	OK
1517	2026-09-21 11:52	62.82	OK	1518	2026-09-21 11:53	61.61	OK
1519	2026-09-21 11:54	63.57	OK	1520	2026-09-21 11:55	63.22	OK
1521	2026-09-21 11:56	62.76	OK	1522	2026-09-21 11:57	65.32	OK
1523	2026-09-21 11:58	62.04	OK	1524	2026-09-21 11:59	61.39	OK
1525	2026-09-21 12:00	61.28	OK	1526	2026-09-21 12:01	64.12	OK
1527	2026-09-21 12:02	61.74	OK	1528	2026-09-21 12:03	62.86	OK
1529	2026-09-21 12:04	64.96	OK	1530	2026-09-21 12:05	63.03	OK
1531	2026-09-21 12:06	63.15	OK	1532	2026-09-21 12:07	61.85	OK
1533	2026-09-21 12:08	62.21	OK	1534	2026-09-21 12:09	64.29	OK
1535	2026-09-21 12:10	62.08	OK	1536	2026-09-21 12:11	62.33	OK
1537	2026-09-21 12:12	60.95	OK	1538	2026-09-21 12:13	63.97	OK
1539	2026-09-21 12:14	63.72	OK	1540	2026-09-21 12:15	64.10	OK
1541	2026-09-21 12:16	61.78	OK	1542	2026-09-21 12:17	60.73	OK
1543	2026-09-21 12:18	63.08	OK	1544	2026-09-21 12:19	64.67	OK
1545	2026-09-21 12:20	64.43	OK	1546	2026-09-21 12:21	63.43	OK
1547	2026-09-21 12:22	65.31	OK	1548	2026-09-21 12:23	61.71	OK
1549	2026-09-21 12:24	61.05	OK	1550	2026-09-21 12:25	63.15	OK
1551	2026-09-21 12:26	63.86	OK	1552	2026-09-21 12:27	61.62	OK
1553	2026-09-21 12:28	65.03	OK	1554	2026-09-21 12:29	64.16	OK
1555	2026-09-21 12:30	65.40	OK	1556	2026-09-21 12:31	62.65	OK
1557	2026-09-21 12:32	62.88	OK	1558	2026-09-21 12:33	63.36	OK
1559	2026-09-21 12:34	62.27	OK	1560	2026-09-21 12:35	65.82	OK
1561	2026-09-21 12:36	65.00	OK	1562	2026-09-21 12:37	62.49	OK
1563	2026-09-21 12:38	63.24	OK	1564	2026-09-21 12:39	63.58	OK
1565	2026-09-21 12:40	64.41	OK	1566	2026-09-21 12:41	65.69	OK
1567	2026-09-21 12:42	64.39	OK	1568	2026-09-21 12:43	64.12	OK
1569	2026-09-21 12:44	63.84	OK	1570	2026-09-21 12:45	64.86	OK
1571	2026-09-21 12:46	62.12	OK	1572	2026-09-21 12:47	64.73	OK
1573	2026-09-21 12:48	60.97	OK	1574	2026-09-21 12:49	65.58	OK
1575	2026-09-21 12:50	60.93	OK	1576	2026-09-21 12:51	64.22	OK
1577	2026-09-21 12:52	65.70	OK	1578	2026-09-21 12:53	65.70	OK
1579	2026-09-21 12:54	63.18	OK	1580	2026-09-21 12:55	64.84	OK
1581	2026-09-21 12:56	61.78	OK	1582	2026-09-21 12:57	63.99	OK
1583	2026-09-21 12:58	63.39	OK	1584	2026-09-21 12:59	64.60	OK
1585	2026-09-21 13:00	65.57	OK	1586	2026-09-21 13:01	62.05	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1587	2026-09-21 13:02	65.80	OK	1588	2026-09-21 13:03	65.10	OK
1589	2026-09-21 13:04	63.37	OK	1590	2026-09-21 13:05	65.41	OK
1591	2026-09-21 13:06	64.76	OK	1592	2026-09-21 13:07	64.87	OK
1593	2026-09-21 13:08	64.51	OK	1594	2026-09-21 13:09	65.14	OK
1595	2026-09-21 13:10	66.05	OK	1596	2026-09-21 13:11	63.36	OK
1597	2026-09-21 13:12	63.01	OK	1598	2026-09-21 13:13	67.76	OK
1599	2026-09-21 13:14	61.75	OK	1600	2026-09-21 13:15	63.22	OK
1601	2026-09-21 13:16	67.52	OK	1602	2026-09-21 13:17	64.06	OK
1603	2026-09-21 13:18	65.47	OK	1604	2026-09-21 13:19	65.83	OK
1605	2026-09-21 13:20	62.46	OK	1606	2026-09-21 13:21	66.55	OK
1607	2026-09-21 13:22	65.72	OK	1608	2026-09-21 13:23	64.14	OK
1609	2026-09-21 13:24	62.08	OK	1610	2026-09-21 13:25	64.18	OK
1611	2026-09-21 13:26	67.36	OK	1612	2026-09-21 13:27	66.03	OK
1613	2026-09-21 13:28	64.80	OK	1614	2026-09-21 13:29	64.29	OK
1615	2026-09-21 13:30	63.51	OK	1616	2026-09-21 13:31	64.97	OK
1617	2026-09-21 13:32	63.27	OK	1618	2026-09-21 13:33	64.11	OK
1619	2026-09-21 13:34	64.21	OK	1620	2026-09-21 13:35	62.94	OK
1621	2026-09-21 13:36	64.34	OK	1622	2026-09-21 13:37	63.64	OK
1623	2026-09-21 13:38	63.71	OK	1624	2026-09-21 13:39	67.04	OK
1625	2026-09-21 13:40	66.94	OK	1626	2026-09-21 13:41	64.55	OK
1627	2026-09-21 13:42	64.98	OK	1628	2026-09-21 13:43	63.35	OK
1629	2026-09-21 13:44	65.11	OK	1630	2026-09-21 13:45	64.84	OK
1631	2026-09-21 13:46	66.94	OK	1632	2026-09-21 13:47	66.54	OK
1633	2026-09-21 13:48	66.03	OK	1634	2026-09-21 13:49	66.47	OK
1635	2026-09-21 13:50	65.31	OK	1636	2026-09-21 13:51	65.47	OK
1637	2026-09-21 13:52	66.54	OK	1638	2026-09-21 13:53	66.28	OK
1639	2026-09-21 13:54	66.44	OK	1640	2026-09-21 13:55	65.49	OK
1641	2026-09-21 13:56	64.42	OK	1642	2026-09-21 13:57	61.81	OK
1643	2026-09-21 13:58	67.91	OK	1644	2026-09-21 13:59	64.63	OK
1645	2026-09-21 14:00	66.52	OK	1646	2026-09-21 14:01	66.79	OK
1647	2026-09-21 14:02	64.97	OK	1648	2026-09-21 14:03	65.49	OK
1649	2026-09-21 14:04	65.78	OK	1650	2026-09-21 14:05	65.19	OK
1651	2026-09-21 14:06	63.11	OK	1652	2026-09-21 14:07	68.07	OK
1653	2026-09-21 14:08	64.33	OK	1654	2026-09-21 14:09	67.66	OK
1655	2026-09-21 14:10	68.48	OK	1656	2026-09-21 14:11	65.78	OK
1657	2026-09-21 14:12	64.02	OK	1658	2026-09-21 14:13	66.31	OK
1659	2026-09-21 14:14	67.51	OK	1660	2026-09-21 14:15	65.25	OK
1661	2026-09-21 14:16	64.00	OK	1662	2026-09-21 14:17	66.09	OK
1663	2026-09-21 14:18	68.72	OK	1664	2026-09-21 14:19	68.59	OK
1665	2026-09-21 14:20	65.89	OK	1666	2026-09-21 14:21	66.02	OK
1667	2026-09-21 14:22	65.05	OK	1668	2026-09-21 14:23	66.68	OK
1669	2026-09-21 14:24	65.62	OK	1670	2026-09-21 14:25	69.56	OK
1671	2026-09-21 14:26	65.36	OK	1672	2026-09-21 14:27	66.27	OK
1673	2026-09-21 14:28	63.75	OK	1674	2026-09-21 14:29	66.55	OK
1675	2026-09-21 14:30	65.93	OK	1676	2026-09-21 14:31	64.66	OK
1677	2026-09-21 14:32	63.70	OK	1678	2026-09-21 14:33	67.94	OK
1679	2026-09-21 14:34	63.91	OK	1680	2026-09-21 14:35	65.93	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1681	2026-09-21 14:36	65.76	OK	1682	2026-09-21 14:37	65.22	OK
1683	2026-09-21 14:38	66.61	OK	1684	2026-09-21 14:39	68.50	OK
1685	2026-09-21 14:40	68.13	OK	1686	2026-09-21 14:41	68.60	OK
1687	2026-09-21 14:42	67.67	OK	1688	2026-09-21 14:43	66.24	OK
1689	2026-09-21 14:44	68.87	OK	1690	2026-09-21 14:45	65.38	OK
1691	2026-09-21 14:46	64.97	OK	1692	2026-09-21 14:47	66.91	OK
1693	2026-09-21 14:48	66.31	OK	1694	2026-09-21 14:49	66.70	OK
1695	2026-09-21 14:50	67.13	OK	1696	2026-09-21 14:51	66.54	OK
1697	2026-09-21 14:52	69.22	OK	1698	2026-09-21 14:53	65.50	OK
1699	2026-09-21 14:54	65.06	OK	1700	2026-09-21 14:55	65.49	OK
1701	2026-09-21 14:56	69.14	OK	1702	2026-09-21 14:57	67.51	OK
1703	2026-09-21 14:58	65.58	OK	1704	2026-09-21 14:59	67.47	OK
1705	2026-09-21 15:00	67.80	OK	1706	2026-09-21 15:01	66.86	OK
1707	2026-09-21 15:02	68.36	OK	1708	2026-09-21 15:03	68.67	OK
1709	2026-09-21 15:04	65.92	OK	1710	2026-09-21 15:05	66.62	OK
1711	2026-09-21 15:06	66.39	OK	1712	2026-09-21 15:07	66.48	OK
1713	2026-09-21 15:08	67.84	OK	1714	2026-09-21 15:09	66.68	OK
1715	2026-09-21 15:10	66.66	OK	1716	2026-09-21 15:11	67.10	OK
1717	2026-09-21 15:12	68.85	OK	1718	2026-09-21 15:13	67.28	OK
1719	2026-09-21 15:14	68.50	OK	1720	2026-09-21 15:15	65.27	OK
1721	2026-09-21 15:16	68.05	OK	1722	2026-09-21 15:17	70.01	OK
1723	2026-09-21 15:18	66.08	OK	1724	2026-09-21 15:19	66.98	OK
1725	2026-09-21 15:20	68.18	OK	1726	2026-09-21 15:21	68.90	OK
1727	2026-09-21 15:22	69.31	OK	1728	2026-09-21 15:23	67.97	OK
1729	2026-09-21 15:24	69.51	OK	1730	2026-09-21 15:25	68.16	OK
1731	2026-09-21 15:26	65.47	OK	1732	2026-09-21 15:27	67.62	OK
1733	2026-09-21 15:28	67.51	OK	1734	2026-09-21 15:29	68.96	OK
1735	2026-09-21 15:30	67.59	OK	1736	2026-09-21 15:31	68.23	OK
1737	2026-09-21 15:32	67.50	OK	1738	2026-09-21 15:33	68.37	OK
1739	2026-09-21 15:34	68.99	OK	1740	2026-09-21 15:35	66.74	OK
1741	2026-09-21 15:36	69.02	OK	1742	2026-09-21 15:37	66.02	OK
1743	2026-09-21 15:38	67.74	OK	1744	2026-09-21 15:39	69.47	OK
1745	2026-09-21 15:40	69.72	OK	1746	2026-09-21 15:41	66.84	OK
1747	2026-09-21 15:42	69.54	OK	1748	2026-09-21 15:43	66.49	OK
1749	2026-09-21 15:44	69.07	OK	1750	2026-09-21 15:45	67.17	OK
1751	2026-09-21 15:46	68.94	OK	1752	2026-09-21 15:47	67.96	OK
1753	2026-09-21 15:48	68.93	OK	1754	2026-09-21 15:49	68.62	OK
1755	2026-09-21 15:50	66.24	OK	1756	2026-09-21 15:51	66.91	OK
1757	2026-09-21 15:52	68.02	OK	1758	2026-09-21 15:53	67.72	OK
1759	2026-09-21 15:54	68.70	OK	1760	2026-09-21 15:55	69.54	OK
1761	2026-09-21 15:56	68.53	OK	1762	2026-09-21 15:57	70.36	OK
1763	2026-09-21 15:58	67.68	OK	1764	2026-09-21 15:59	67.02	OK
1765	2026-09-21 16:00	69.66	OK	1766	2026-09-21 16:01	68.63	OK
1767	2026-09-21 16:02	67.22	OK	1768	2026-09-21 16:03	67.52	OK
1769	2026-09-21 16:04	69.96	OK	1770	2026-09-21 16:05	69.37	OK
1771	2026-09-21 16:06	70.86	OK	1772	2026-09-21 16:07	69.16	OK
1773	2026-09-21 16:08	68.54	OK	1774	2026-09-21 16:09	67.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1775	2026-09-21 16:10	68.40	OK	1776	2026-09-21 16:11	69.85	OK
1777	2026-09-21 16:12	69.32	OK	1778	2026-09-21 16:13	68.19	OK
1779	2026-09-21 16:14	69.96	OK	1780	2026-09-21 16:15	69.26	OK
1781	2026-09-21 16:16	66.86	OK	1782	2026-09-21 16:17	66.88	OK
1783	2026-09-21 16:18	70.22	OK	1784	2026-09-21 16:19	68.02	OK
1785	2026-09-21 16:20	67.41	OK	1786	2026-09-21 16:21	67.64	OK
1787	2026-09-21 16:22	67.92	OK	1788	2026-09-21 16:23	68.75	OK
1789	2026-09-21 16:24	68.14	OK	1790	2026-09-21 16:25	71.67	OK
1791	2026-09-21 16:26	70.52	OK	1792	2026-09-21 16:27	69.74	OK
1793	2026-09-21 16:28	67.93	OK	1794	2026-09-21 16:29	67.22	OK
1795	2026-09-21 16:30	68.07	OK	1796	2026-09-21 16:31	68.27	OK
1797	2026-09-21 16:32	68.03	OK	1798	2026-09-21 16:33	69.03	OK
1799	2026-09-21 16:34	69.84	OK	1800	2026-09-21 16:35	70.50	OK
1801	2026-09-21 16:36	67.73	OK	1802	2026-09-21 16:37	68.95	OK
1803	2026-09-21 16:38	70.46	OK	1804	2026-09-21 16:39	69.27	OK
1805	2026-09-21 16:40	70.45	OK	1806	2026-09-21 16:41	69.92	OK
1807	2026-09-21 16:42	67.93	OK	1808	2026-09-21 16:43	68.71	OK
1809	2026-09-21 16:44	70.27	OK	1810	2026-09-21 16:45	68.83	OK
1811	2026-09-21 16:46	71.10	OK	1812	2026-09-21 16:47	71.15	OK
1813	2026-09-21 16:48	68.45	OK	1814	2026-09-21 16:49	67.98	OK
1815	2026-09-21 16:50	69.91	OK	1816	2026-09-21 16:51	68.32	OK
1817	2026-09-21 16:52	70.55	OK	1818	2026-09-21 16:53	69.85	OK
1819	2026-09-21 16:54	69.67	OK	1820	2026-09-21 16:55	69.55	OK
1821	2026-09-21 16:56	69.98	OK	1822	2026-09-21 16:57	68.74	OK
1823	2026-09-21 16:58	69.89	OK	1824	2026-09-21 16:59	69.32	OK
1825	2026-09-21 17:00	66.49	OK	1826	2026-09-21 17:01	68.43	OK
1827	2026-09-21 17:02	70.14	OK	1828	2026-09-21 17:03	69.08	OK
1829	2026-09-21 17:04	68.61	OK	1830	2026-09-21 17:05	68.55	OK
1831	2026-09-21 17:06	69.76	OK	1832	2026-09-21 17:07	67.57	OK
1833	2026-09-21 17:08	69.14	OK	1834	2026-09-21 17:09	69.07	OK
1835	2026-09-21 17:10	70.13	OK	1836	2026-09-21 17:11	68.61	OK
1837	2026-09-21 17:12	71.63	OK	1838	2026-09-21 17:13	70.47	OK
1839	2026-09-21 17:14	69.05	OK	1840	2026-09-21 17:15	68.74	OK
1841	2026-09-21 17:16	68.42	OK	1842	2026-09-21 17:17	67.10	OK
1843	2026-09-21 17:18	69.04	OK	1844	2026-09-21 17:19	68.10	OK
1845	2026-09-21 17:20	71.02	OK	1846	2026-09-21 17:21	70.12	OK
1847	2026-09-21 17:22	68.28	OK	1848	2026-09-21 17:23	69.79	OK
1849	2026-09-21 17:24	68.51	OK	1850	2026-09-21 17:25	70.90	OK
1851	2026-09-21 17:26	71.56	OK	1852	2026-09-21 17:27	72.47	OK
1853	2026-09-21 17:28	69.54	OK	1854	2026-09-21 17:29	67.28	OK
1855	2026-09-21 17:30	69.25	OK	1856	2026-09-21 17:31	70.05	OK
1857	2026-09-21 17:32	72.70	OK	1858	2026-09-21 17:33	69.96	OK
1859	2026-09-21 17:34	69.55	OK	1860	2026-09-21 17:35	70.15	OK
1861	2026-09-21 17:36	73.00	OK	1862	2026-09-21 17:37	68.85	OK
1863	2026-09-21 17:38	68.49	OK	1864	2026-09-21 17:39	69.57	OK
1865	2026-09-21 17:40	70.68	OK	1866	2026-09-21 17:41	68.98	OK
1867	2026-09-21 17:42	70.42	OK	1868	2026-09-21 17:43	69.92	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1869	2026-09-21 17:44	69.71	OK	1870	2026-09-21 17:45	68.15	OK
1871	2026-09-21 17:46	69.12	OK	1872	2026-09-21 17:47	70.85	OK
1873	2026-09-21 17:48	71.15	OK	1874	2026-09-21 17:49	69.57	OK
1875	2026-09-21 17:50	69.07	OK	1876	2026-09-21 17:51	69.19	OK
1877	2026-09-21 17:52	69.05	OK	1878	2026-09-21 17:53	71.13	OK
1879	2026-09-21 17:54	68.74	OK	1880	2026-09-21 17:55	73.35	OK
1881	2026-09-21 17:56	68.31	OK	1882	2026-09-21 17:57	69.45	OK
1883	2026-09-21 17:58	70.26	OK	1884	2026-09-21 17:59	68.33	OK
1885	2026-09-21 18:00	72.28	OK	1886	2026-09-21 18:01	69.09	OK
1887	2026-09-21 18:02	71.23	OK	1888	2026-09-21 18:03	69.16	OK
1889	2026-09-21 18:04	71.66	OK	1890	2026-09-21 18:05	71.59	OK
1891	2026-09-21 18:06	70.19	OK	1892	2026-09-21 18:07	69.29	OK
1893	2026-09-21 18:08	69.24	OK	1894	2026-09-21 18:09	70.62	OK
1895	2026-09-21 18:10	70.90	OK	1896	2026-09-21 18:11	71.28	OK
1897	2026-09-21 18:12	68.19	OK	1898	2026-09-21 18:13	72.25	OK
1899	2026-09-21 18:14	69.29	OK	1900	2026-09-21 18:15	68.51	OK
1901	2026-09-21 18:16	68.83	OK	1902	2026-09-21 18:17	67.64	OK
1903	2026-09-21 18:18	70.75	OK	1904	2026-09-21 18:19	70.25	OK
1905	2026-09-21 18:20	69.19	OK	1906	2026-09-21 18:21	69.17	OK
1907	2026-09-21 18:22	71.01	OK	1908	2026-09-21 18:23	72.28	OK
1909	2026-09-21 18:24	71.49	OK	1910	2026-09-21 18:25	70.93	OK
1911	2026-09-21 18:26	69.24	OK	1912	2026-09-21 18:27	70.42	OK
1913	2026-09-21 18:28	71.15	OK	1914	2026-09-21 18:29	69.51	OK
1915	2026-09-21 18:30	70.43	OK	1916	2026-09-21 18:31	69.79	OK
1917	2026-09-21 18:32	72.78	OK	1918	2026-09-21 18:33	71.74	OK
1919	2026-09-21 18:34	70.98	OK	1920	2026-09-21 18:35	68.58	OK
1921	2026-09-21 18:36	69.61	OK	1922	2026-09-21 18:37	67.60	OK
1923	2026-09-21 18:38	73.26	OK	1924	2026-09-21 18:39	71.73	OK
1925	2026-09-21 18:40	69.81	OK	1926	2026-09-21 18:41	69.09	OK
1927	2026-09-21 18:42	68.18	OK	1928	2026-09-21 18:43	69.31	OK
1929	2026-09-21 18:44	68.48	OK	1930	2026-09-21 18:45	70.98	OK
1931	2026-09-21 18:46	69.54	OK	1932	2026-09-21 18:47	70.76	OK
1933	2026-09-21 18:48	69.48	OK	1934	2026-09-21 18:49	72.66	OK
1935	2026-09-21 18:50	71.17	OK	1936	2026-09-21 18:51	68.09	OK
1937	2026-09-21 18:52	71.23	OK	1938	2026-09-21 18:53	70.43	OK
1939	2026-09-21 18:54	69.15	OK	1940	2026-09-21 18:55	69.46	OK
1941	2026-09-21 18:56	70.75	OK	1942	2026-09-21 18:57	71.03	OK
1943	2026-09-21 18:58	69.86	OK	1944	2026-09-21 18:59	71.38	OK
1945	2026-09-21 19:00	69.08	OK	1946	2026-09-21 19:01	71.85	OK
1947	2026-09-21 19:02	72.28	OK	1948	2026-09-21 19:03	70.89	OK
1949	2026-09-21 19:04	70.65	OK	1950	2026-09-21 19:05	68.92	OK
1951	2026-09-21 19:06	68.37	OK	1952	2026-09-21 19:07	71.06	OK
1953	2026-09-21 19:08	69.86	OK	1954	2026-09-21 19:09	68.53	OK
1955	2026-09-21 19:10	69.75	OK	1956	2026-09-21 19:11	71.66	OK
1957	2026-09-21 19:12	70.88	OK	1958	2026-09-21 19:13	70.79	OK
1959	2026-09-21 19:14	73.14	OK	1960	2026-09-21 19:15	70.40	OK
1961	2026-09-21 19:16	68.22	OK	1962	2026-09-21 19:17	68.82	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1963	2026-09-21 19:18	70.02	OK	1964	2026-09-21 19:19	70.36	OK
1965	2026-09-21 19:20	71.23	OK	1966	2026-09-21 19:21	70.65	OK
1967	2026-09-21 19:22	72.01	OK	1968	2026-09-21 19:23	72.03	OK
1969	2026-09-21 19:24	72.08	OK	1970	2026-09-21 19:25	69.25	OK
1971	2026-09-21 19:26	70.82	OK	1972	2026-09-21 19:27	72.51	OK
1973	2026-09-21 19:28	71.46	OK	1974	2026-09-21 19:29	70.72	OK
1975	2026-09-21 19:30	70.99	OK	1976	2026-09-21 19:31	71.40	OK
1977	2026-09-21 19:32	69.85	OK	1978	2026-09-21 19:33	70.70	OK
1979	2026-09-21 19:34	71.82	OK	1980	2026-09-21 19:35	70.19	OK
1981	2026-09-21 19:36	69.27	OK	1982	2026-09-21 19:37	72.77	OK
1983	2026-09-21 19:38	68.70	OK	1984	2026-09-21 19:39	70.77	OK
1985	2026-09-21 19:40	68.13	OK	1986	2026-09-21 19:41	69.52	OK
1987	2026-09-21 19:42	68.86	OK	1988	2026-09-21 19:43	70.50	OK
1989	2026-09-21 19:44	72.14	OK	1990	2026-09-21 19:45	72.53	OK
1991	2026-09-21 19:46	72.06	OK	1992	2026-09-21 19:47	72.06	OK
1993	2026-09-21 19:48	69.80	OK	1994	2026-09-21 19:49	73.43	OK
1995	2026-09-21 19:50	69.76	OK	1996	2026-09-21 19:51	70.60	OK
1997	2026-09-21 19:52	69.94	OK	1998	2026-09-21 19:53	69.85	OK
1999	2026-09-21 19:54	70.08	OK	2000	2026-09-21 19:55	73.36	OK
2001	2026-09-21 19:56	70.67	OK	2002	2026-09-21 19:57	73.65	OK
2003	2026-09-21 19:58	70.85	OK	2004	2026-09-21 19:59	67.60	OK
2005	2026-09-21 20:00	71.15	OK	2006	2026-09-21 20:01	69.50	OK
2007	2026-09-21 20:02	66.40	OK	2008	2026-09-21 20:03	70.78	OK
2009	2026-09-21 20:04	71.19	OK	2010	2026-09-21 20:05	72.56	OK
2011	2026-09-21 20:06	69.39	OK	2012	2026-09-21 20:07	70.57	OK
2013	2026-09-21 20:08	69.33	OK	2014	2026-09-21 20:09	71.08	OK
2015	2026-09-21 20:10	70.70	OK	2016	2026-09-21 20:11	69.69	OK
2017	2026-09-21 20:12	71.32	OK	2018	2026-09-21 20:13	69.87	OK
2019	2026-09-21 20:14	70.92	OK	2020	2026-09-21 20:15	68.52	OK
2021	2026-09-21 20:16	69.32	OK	2022	2026-09-21 20:17	70.39	OK
2023	2026-09-21 20:18	70.46	OK	2024	2026-09-21 20:19	71.30	OK
2025	2026-09-21 20:20	69.44	OK	2026	2026-09-21 20:21	70.87	OK
2027	2026-09-21 20:22	71.96	OK	2028	2026-09-21 20:23	72.17	OK
2029	2026-09-21 20:24	71.41	OK	2030	2026-09-21 20:25	69.74	OK
2031	2026-09-21 20:26	71.58	OK	2032	2026-09-21 20:27	67.46	OK
2033	2026-09-21 20:28	68.47	OK	2034	2026-09-21 20:29	68.40	OK
2035	2026-09-21 20:30	71.73	OK	2036	2026-09-21 20:31	70.27	OK
2037	2026-09-21 20:32	71.21	OK	2038	2026-09-21 20:33	69.95	OK
2039	2026-09-21 20:34	70.36	OK	2040	2026-09-21 20:35	69.31	OK
2041	2026-09-21 20:36	71.39	OK	2042	2026-09-21 20:37	69.71	OK
2043	2026-09-21 20:38	70.13	OK	2044	2026-09-21 20:39	69.02	OK
2045	2026-09-21 20:40	70.37	OK	2046	2026-09-21 20:41	70.00	OK
2047	2026-09-21 20:42	68.61	OK	2048	2026-09-21 20:43	69.56	OK
2049	2026-09-21 20:44	71.99	OK	2050	2026-09-21 20:45	72.42	OK
2051	2026-09-21 20:46	72.39	OK	2052	2026-09-21 20:47	67.56	OK
2053	2026-09-21 20:48	71.59	OK	2054	2026-09-21 20:49	67.42	OK
2055	2026-09-21 20:50	68.35	OK	2056	2026-09-21 20:51	67.74	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2057	2026-09-21 20:52	72.60	OK	2058	2026-09-21 20:53	68.97	OK
2059	2026-09-21 20:54	70.05	OK	2060	2026-09-21 20:55	69.16	OK
2061	2026-09-21 20:56	71.18	OK	2062	2026-09-21 20:57	70.64	OK
2063	2026-09-21 20:58	68.18	OK	2064	2026-09-21 20:59	68.29	OK
2065	2026-09-21 21:00	70.53	OK	2066	2026-09-21 21:01	69.26	OK
2067	2026-09-21 21:02	69.45	OK	2068	2026-09-21 21:03	69.91	OK
2069	2026-09-21 21:04	70.17	OK	2070	2026-09-21 21:05	71.35	OK
2071	2026-09-21 21:06	71.42	OK	2072	2026-09-21 21:07	68.94	OK
2073	2026-09-21 21:08	71.18	OK	2074	2026-09-21 21:09	70.64	OK
2075	2026-09-21 21:10	69.28	OK	2076	2026-09-21 21:11	70.33	OK
2077	2026-09-21 21:12	69.25	OK	2078	2026-09-21 21:13	68.28	OK
2079	2026-09-21 21:14	71.12	OK	2080	2026-09-21 21:15	69.00	OK
2081	2026-09-21 21:16	68.46	OK	2082	2026-09-21 21:17	69.83	OK
2083	2026-09-21 21:18	69.01	OK	2084	2026-09-21 21:19	69.76	OK
2085	2026-09-21 21:20	72.05	OK	2086	2026-09-21 21:21	70.98	OK
2087	2026-09-21 21:22	68.20	OK	2088	2026-09-21 21:23	67.86	OK
2089	2026-09-21 21:24	70.48	OK	2090	2026-09-21 21:25	68.88	OK
2091	2026-09-21 21:26	69.22	OK	2092	2026-09-21 21:27	70.80	OK
2093	2026-09-21 21:28	71.79	OK	2094	2026-09-21 21:29	69.76	OK
2095	2026-09-21 21:30	68.89	OK	2096	2026-09-21 21:31	70.94	OK
2097	2026-09-21 21:32	71.08	OK	2098	2026-09-21 21:33	65.95	OK
2099	2026-09-21 21:34	69.08	OK	2100	2026-09-21 21:35	68.23	OK
2101	2026-09-21 21:36	73.13	OK	2102	2026-09-21 21:37	69.67	OK
2103	2026-09-21 21:38	68.94	OK	2104	2026-09-21 21:39	70.09	OK
2105	2026-09-21 21:40	66.39	OK	2106	2026-09-21 21:41	72.50	OK
2107	2026-09-21 21:42	69.20	OK	2108	2026-09-21 21:43	68.97	OK
2109	2026-09-21 21:44	68.84	OK	2110	2026-09-21 21:45	67.51	OK
2111	2026-09-21 21:46	70.21	OK	2112	2026-09-21 21:47	67.63	OK
2113	2026-09-21 21:48	67.29	OK	2114	2026-09-21 21:49	69.55	OK
2115	2026-09-21 21:50	68.95	OK	2116	2026-09-21 21:51	67.72	OK
2117	2026-09-21 21:52	67.62	OK	2118	2026-09-21 21:53	69.47	OK
2119	2026-09-21 21:54	70.27	OK	2120	2026-09-21 21:55	69.14	OK
2121	2026-09-21 21:56	69.76	OK	2122	2026-09-21 21:57	69.18	OK
2123	2026-09-21 21:58	68.53	OK	2124	2026-09-21 21:59	70.63	OK
2125	2026-09-21 22:00	65.74	OK	2126	2026-09-21 22:01	70.63	OK
2127	2026-09-21 22:02	70.13	OK	2128	2026-09-21 22:03	72.27	OK
2129	2026-09-21 22:04	70.49	OK	2130	2026-09-21 22:05	68.65	OK
2131	2026-09-21 22:06	71.08	OK	2132	2026-09-21 22:07	69.81	OK
2133	2026-09-21 22:08	69.80	OK	2134	2026-09-21 22:09	69.01	OK
2135	2026-09-21 22:10	70.90	OK	2136	2026-09-21 22:11	70.29	OK
2137	2026-09-21 22:12	70.47	OK	2138	2026-09-21 22:13	68.37	OK
2139	2026-09-21 22:14	67.79	OK	2140	2026-09-21 22:15	70.08	OK
2141	2026-09-21 22:16	66.71	OK	2142	2026-09-21 22:17	66.46	OK
2143	2026-09-21 22:18	71.93	OK	2144	2026-09-21 22:19	70.23	OK
2145	2026-09-21 22:20	70.05	OK	2146	2026-09-21 22:21	66.88	OK
2147	2026-09-21 22:22	67.11	OK	2148	2026-09-21 22:23	69.67	OK
2149	2026-09-21 22:24	67.99	OK	2150	2026-09-21 22:25	69.68	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2151	2026-09-21 22:26	69.22	OK	2152	2026-09-21 22:27	69.40	OK
2153	2026-09-21 22:28	68.96	OK	2154	2026-09-21 22:29	69.06	OK
2155	2026-09-21 22:30	68.87	OK	2156	2026-09-21 22:31	66.78	OK
2157	2026-09-21 22:32	66.49	OK	2158	2026-09-21 22:33	70.31	OK
2159	2026-09-21 22:34	69.63	OK	2160	2026-09-21 22:35	68.61	OK
2161	2026-09-21 22:36	65.72	OK	2162	2026-09-21 22:37	69.77	OK
2163	2026-09-21 22:38	68.24	OK	2164	2026-09-21 22:39	68.16	OK
2165	2026-09-21 22:40	69.22	OK	2166	2026-09-21 22:41	69.12	OK
2167	2026-09-21 22:42	67.49	OK	2168	2026-09-21 22:43	68.54	OK
2169	2026-09-21 22:44	67.17	OK	2170	2026-09-21 22:45	66.89	OK
2171	2026-09-21 22:46	71.97	OK	2172	2026-09-21 22:47	68.44	OK
2173	2026-09-21 22:48	69.63	OK	2174	2026-09-21 22:49	67.38	OK
2175	2026-09-21 22:50	67.43	OK	2176	2026-09-21 22:51	68.24	OK
2177	2026-09-21 22:52	69.29	OK	2178	2026-09-21 22:53	68.19	OK
2179	2026-09-21 22:54	67.42	OK	2180	2026-09-21 22:55	71.31	OK
2181	2026-09-21 22:56	68.49	OK	2182	2026-09-21 22:57	68.70	OK
2183	2026-09-21 22:58	67.49	OK	2184	2026-09-21 22:59	69.89	OK
2185	2026-09-21 23:00	66.83	OK	2186	2026-09-21 23:01	69.82	OK
2187	2026-09-21 23:02	69.43	OK	2188	2026-09-21 23:03	68.86	OK
2189	2026-09-21 23:04	68.59	OK	2190	2026-09-21 23:05	67.43	OK
2191	2026-09-21 23:06	67.58	OK	2192	2026-09-21 23:07	67.69	OK
2193	2026-09-21 23:08	65.62	OK	2194	2026-09-21 23:09	71.12	OK
2195	2026-09-21 23:10	66.30	OK	2196	2026-09-21 23:11	66.11	OK
2197	2026-09-21 23:12	68.87	OK	2198	2026-09-21 23:13	66.75	OK
2199	2026-09-21 23:14	67.97	OK	2200	2026-09-21 23:15	68.01	OK
2201	2026-09-21 23:16	69.50	OK	2202	2026-09-21 23:17	70.34	OK
2203	2026-09-21 23:18	68.29	OK	2204	2026-09-21 23:19	66.41	OK
2205	2026-09-21 23:20	65.83	OK	2206	2026-09-21 23:21	69.05	OK
2207	2026-09-21 23:22	68.16	OK	2208	2026-09-21 23:23	66.98	OK
2209	2026-09-21 23:24	67.21	OK	2210	2026-09-21 23:25	67.11	OK
2211	2026-09-21 23:26	68.75	OK	2212	2026-09-21 23:27	68.21	OK
2213	2026-09-21 23:28	67.60	OK	2214	2026-09-21 23:29	67.83	OK
2215	2026-09-21 23:30	66.25	OK	2216	2026-09-21 23:31	67.66	OK
2217	2026-09-21 23:32	69.27	OK	2218	2026-09-21 23:33	68.90	OK
2219	2026-09-21 23:34	69.04	OK	2220	2026-09-21 23:35	64.60	OK
2221	2026-09-21 23:36	67.37	OK	2222	2026-09-21 23:37	66.38	OK
2223	2026-09-21 23:38	69.74	OK	2224	2026-09-21 23:39	67.96	OK
2225	2026-09-21 23:40	67.53	OK	2226	2026-09-21 23:41	70.21	OK
2227	2026-09-21 23:42	67.78	OK	2228	2026-09-21 23:43	67.31	OK
2229	2026-09-21 23:44	65.83	OK	2230	2026-09-21 23:45	64.32	OK
2231	2026-09-21 23:46	65.58	OK	2232	2026-09-21 23:47	68.00	OK
2233	2026-09-21 23:48	67.68	OK	2234	2026-09-21 23:49	68.37	OK
2235	2026-09-21 23:50	65.36	OK	2236	2026-09-21 23:51	66.92	OK
2237	2026-09-21 23:52	66.65	OK	2238	2026-09-21 23:53	66.22	OK
2239	2026-09-21 23:54	67.35	OK	2240	2026-09-21 23:55	66.57	OK
2241	2026-09-21 23:56	66.58	OK	2242	2026-09-21 23:57	66.93	OK
2243	2026-09-21 23:58	64.93	OK	2244	2026-09-21 23:59	65.56	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2245	2026-09-22 00:00	67.67	OK	2246	2026-09-22 00:01	66.49	OK
2247	2026-09-22 00:02	68.65	OK	2248	2026-09-22 00:03	68.79	OK
2249	2026-09-22 00:04	67.68	OK	2250	2026-09-22 00:05	67.78	OK
2251	2026-09-22 00:06	67.46	OK	2252	2026-09-22 00:07	67.28	OK
2253	2026-09-22 00:08	66.34	OK	2254	2026-09-22 00:09	68.19	OK
2255	2026-09-22 00:10	65.19	OK	2256	2026-09-22 00:11	66.53	OK
2257	2026-09-22 00:12	65.85	OK	2258	2026-09-22 00:13	67.08	OK
2259	2026-09-22 00:14	65.17	OK	2260	2026-09-22 00:15	68.64	OK
2261	2026-09-22 00:16	68.28	OK	2262	2026-09-22 00:17	65.80	OK
2263	2026-09-22 00:18	65.62	OK	2264	2026-09-22 00:19	67.25	OK
2265	2026-09-22 00:20	66.47	OK	2266	2026-09-22 00:21	67.94	OK
2267	2026-09-22 00:22	64.78	OK	2268	2026-09-22 00:23	68.25	OK
2269	2026-09-22 00:24	66.95	OK	2270	2026-09-22 00:25	66.65	OK
2271	2026-09-22 00:26	67.28	OK	2272	2026-09-22 00:27	64.88	OK
2273	2026-09-22 00:28	67.30	OK	2274	2026-09-22 00:29	64.68	OK
2275	2026-09-22 00:30	66.51	OK	2276	2026-09-22 00:31	66.44	OK
2277	2026-09-22 00:32	68.52	OK	2278	2026-09-22 00:33	64.77	OK
2279	2026-09-22 00:34	67.75	OK	2280	2026-09-22 00:35	66.06	OK
2281	2026-09-22 00:36	66.13	OK	2282	2026-09-22 00:37	65.53	OK
2283	2026-09-22 00:38	66.42	OK	2284	2026-09-22 00:39	66.01	OK
2285	2026-09-22 00:40	67.49	OK	2286	2026-09-22 00:41	67.48	OK
2287	2026-09-22 00:42	65.74	OK	2288	2026-09-22 00:43	65.93	OK
2289	2026-09-22 00:44	66.49	OK	2290	2026-09-22 00:45	63.94	OK
2291	2026-09-22 00:46	65.02	OK	2292	2026-09-22 00:47	64.25	OK
2293	2026-09-22 00:48	64.67	OK	2294	2026-09-22 00:49	63.74	OK
2295	2026-09-22 00:50	66.93	OK	2296	2026-09-22 00:51	67.71	OK
2297	2026-09-22 00:52	66.93	OK	2298	2026-09-22 00:53	64.88	OK
2299	2026-09-22 00:54	64.23	OK	2300	2026-09-22 00:55	63.16	OK
2301	2026-09-22 00:56	64.92	OK	2302	2026-09-22 00:57	65.57	OK
2303	2026-09-22 00:58	64.37	OK	2304	2026-09-22 00:59	66.62	OK
2305	2026-09-22 01:00	63.69	OK	2306	2026-09-22 01:01	65.65	OK
2307	2026-09-22 01:02	64.41	OK	2308	2026-09-22 01:03	66.58	OK
2309	2026-09-22 01:04	66.94	OK	2310	2026-09-22 01:05	63.15	OK
2311	2026-09-22 01:06	66.85	OK	2312	2026-09-22 01:07	63.88	OK
2313	2026-09-22 01:08	64.30	OK	2314	2026-09-22 01:09	67.19	OK
2315	2026-09-22 01:10	66.81	OK	2316	2026-09-22 01:11	65.10	OK
2317	2026-09-22 01:12	66.02	OK	2318	2026-09-22 01:13	65.81	OK
2319	2026-09-22 01:14	64.72	OK	2320	2026-09-22 01:15	64.78	OK
2321	2026-09-22 01:16	68.01	OK	2322	2026-09-22 01:17	67.19	OK
2323	2026-09-22 01:18	65.34	OK	2324	2026-09-22 01:19	65.17	OK
2325	2026-09-22 01:20	62.83	OK	2326	2026-09-22 01:21	65.57	OK
2327	2026-09-22 01:22	65.21	OK	2328	2026-09-22 01:23	64.15	OK
2329	2026-09-22 01:24	66.43	OK	2330	2026-09-22 01:25	63.13	OK
2331	2026-09-22 01:26	64.24	OK	2332	2026-09-22 01:27	64.47	OK
2333	2026-09-22 01:28	62.22	OK	2334	2026-09-22 01:29	63.56	OK
2335	2026-09-22 01:30	64.59	OK	2336	2026-09-22 01:31	65.08	OK
2337	2026-09-22 01:32	64.86	OK	2338	2026-09-22 01:33	64.43	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2339	2026-09-22 01:34	66.98	OK	2340	2026-09-22 01:35	64.53	OK
2341	2026-09-22 01:36	65.94	OK	2342	2026-09-22 01:37	66.08	OK
2343	2026-09-22 01:38	63.88	OK	2344	2026-09-22 01:39	64.47	OK
2345	2026-09-22 01:40	65.64	OK	2346	2026-09-22 01:41	60.76	OK
2347	2026-09-22 01:42	63.01	OK	2348	2026-09-22 01:43	64.61	OK
2349	2026-09-22 01:44	64.16	OK	2350	2026-09-22 01:45	62.89	OK
2351	2026-09-22 01:46	67.62	OK	2352	2026-09-22 01:47	63.82	OK
2353	2026-09-22 01:48	62.98	OK	2354	2026-09-22 01:49	63.27	OK
2355	2026-09-22 01:50	63.74	OK	2356	2026-09-22 01:51	66.77	OK
2357	2026-09-22 01:52	63.42	OK	2358	2026-09-22 01:53	63.05	OK
2359	2026-09-22 01:54	64.92	OK	2360	2026-09-22 01:55	60.74	OK
2361	2026-09-22 01:56	65.96	OK	2362	2026-09-22 01:57	65.01	OK
2363	2026-09-22 01:58	64.86	OK	2364	2026-09-22 01:59	64.80	OK
2365	2026-09-22 02:00	63.18	OK	2366	2026-09-22 02:01	64.10	OK
2367	2026-09-22 02:02	65.40	OK	2368	2026-09-22 02:03	63.28	OK
2369	2026-09-22 02:04	64.38	OK	2370	2026-09-22 02:05	64.97	OK
2371	2026-09-22 02:06	63.80	OK	2372	2026-09-22 02:07	63.17	OK
2373	2026-09-22 02:08	62.85	OK	2374	2026-09-22 02:09	62.59	OK
2375	2026-09-22 02:10	66.64	OK	2376	2026-09-22 02:11	64.26	OK
2377	2026-09-22 02:12	60.99	OK	2378	2026-09-22 02:13	67.28	OK
2379	2026-09-22 02:14	64.24	OK	2380	2026-09-22 02:15	60.50	OK
2381	2026-09-22 02:16	62.36	OK	2382	2026-09-22 02:17	62.71	OK
2383	2026-09-22 02:18	66.04	OK	2384	2026-09-22 02:19	63.84	OK
2385	2026-09-22 02:20	62.43	OK	2386	2026-09-22 02:21	62.60	OK
2387	2026-09-22 02:22	65.08	OK	2388	2026-09-22 02:23	64.59	OK
2389	2026-09-22 02:24	64.01	OK	2390	2026-09-22 02:25	64.93	OK
2391	2026-09-22 02:26	65.11	OK	2392	2026-09-22 02:27	63.32	OK
2393	2026-09-22 02:28	61.61	OK	2394	2026-09-22 02:29	62.64	OK
2395	2026-09-22 02:30	63.95	OK	2396	2026-09-22 02:31	61.75	OK
2397	2026-09-22 02:32	62.78	OK	2398	2026-09-22 02:33	63.55	OK
2399	2026-09-22 02:34	62.43	OK	2400	2026-09-22 02:35	62.06	OK
2401	2026-09-22 02:36	64.74	OK	2402	2026-09-22 02:37	61.21	OK
2403	2026-09-22 02:38	64.32	OK	2404	2026-09-22 02:39	63.69	OK
2405	2026-09-22 02:40	63.37	OK	2406	2026-09-22 02:41	60.92	OK
2407	2026-09-22 02:42	60.54	OK	2408	2026-09-22 02:43	63.47	OK
2409	2026-09-22 02:44	65.27	OK	2410	2026-09-22 02:45	66.21	OK
2411	2026-09-22 02:46	62.27	OK	2412	2026-09-22 02:47	63.79	OK
2413	2026-09-22 02:48	61.58	OK	2414	2026-09-22 02:49	61.22	OK
2415	2026-09-22 02:50	62.75	OK	2416	2026-09-22 02:51	60.85	OK
2417	2026-09-22 02:52	64.52	OK	2418	2026-09-22 02:53	64.28	OK
2419	2026-09-22 02:54	62.70	OK	2420	2026-09-22 02:55	63.89	OK
2421	2026-09-22 02:56	60.65	OK	2422	2026-09-22 02:57	60.65	OK
2423	2026-09-22 02:58	61.76	OK	2424	2026-09-22 02:59	62.17	OK
2425	2026-09-22 03:00	64.15	OK	2426	2026-09-22 03:01	61.52	OK
2427	2026-09-22 03:02	58.91	OK	2428	2026-09-22 03:03	62.34	OK
2429	2026-09-22 03:04	61.18	OK	2430	2026-09-22 03:05	63.14	OK
2431	2026-09-22 03:06	61.96	OK	2432	2026-09-22 03:07	64.20	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2433	2026-09-22 03:08	64.50	OK	2434	2026-09-22 03:09	62.47	OK
2435	2026-09-22 03:10	63.15	OK	2436	2026-09-22 03:11	61.46	OK
2437	2026-09-22 03:12	63.53	OK	2438	2026-09-22 03:13	59.84	OK
2439	2026-09-22 03:14	65.27	OK	2440	2026-09-22 03:15	62.03	OK
2441	2026-09-22 03:16	59.54	OK	2442	2026-09-22 03:17	59.70	OK
2443	2026-09-22 03:18	62.59	OK	2444	2026-09-22 03:19	62.25	OK
2445	2026-09-22 03:20	63.93	OK	2446	2026-09-22 03:21	61.10	OK
2447	2026-09-22 03:22	61.54	OK	2448	2026-09-22 03:23	61.81	OK
2449	2026-09-22 03:24	60.56	OK	2450	2026-09-22 03:25	64.05	OK
2451	2026-09-22 03:26	61.48	OK	2452	2026-09-22 03:27	62.29	OK
2453	2026-09-22 03:28	61.95	OK	2454	2026-09-22 03:29	63.43	OK
2455	2026-09-22 03:30	62.06	OK	2456	2026-09-22 03:31	61.97	OK
2457	2026-09-22 03:32	61.97	OK	2458	2026-09-22 03:33	63.25	OK
2459	2026-09-22 03:34	62.27	OK	2460	2026-09-22 03:35	62.19	OK
2461	2026-09-22 03:36	60.97	OK	2462	2026-09-22 03:37	62.70	OK
2463	2026-09-22 03:38	61.95	OK	2464	2026-09-22 03:39	59.58	OK
2465	2026-09-22 03:40	62.55	OK	2466	2026-09-22 03:41	60.47	OK
2467	2026-09-22 03:42	63.17	OK	2468	2026-09-22 03:43	62.57	OK
2469	2026-09-22 03:44	61.53	OK	2470	2026-09-22 03:45	62.12	OK
2471	2026-09-22 03:46	60.63	OK	2472	2026-09-22 03:47	64.31	OK
2473	2026-09-22 03:48	60.34	OK	2474	2026-09-22 03:49	59.47	OK
2475	2026-09-22 03:50	59.95	OK	2476	2026-09-22 03:51	62.50	OK
2477	2026-09-22 03:52	62.97	OK	2478	2026-09-22 03:53	62.62	OK
2479	2026-09-22 03:54	62.38	OK	2480	2026-09-22 03:55	62.25	OK
2481	2026-09-22 03:56	60.01	OK	2482	2026-09-22 03:57	60.14	OK
2483	2026-09-22 03:58	62.89	OK	2484	2026-09-22 03:59	60.72	OK
2485	2026-09-22 04:00	62.35	OK	2486	2026-09-22 04:01	60.47	OK
2487	2026-09-22 04:02	62.58	OK	2488	2026-09-22 04:03	61.55	OK
2489	2026-09-22 04:04	62.22	OK	2490	2026-09-22 04:05	61.90	OK
2491	2026-09-22 04:06	61.37	OK	2492	2026-09-22 04:07	61.61	OK
2493	2026-09-22 04:08	61.74	OK	2494	2026-09-22 04:09	61.29	OK
2495	2026-09-22 04:10	60.97	OK	2496	2026-09-22 04:11	60.26	OK
2497	2026-09-22 04:12	59.58	OK	2498	2026-09-22 04:13	62.81	OK
2499	2026-09-22 04:14	59.70	OK	2500	2026-09-22 04:15	63.85	OK
2501	2026-09-22 04:16	61.93	OK	2502	2026-09-22 04:17	58.96	OK
2503	2026-09-22 04:18	61.21	OK	2504	2026-09-22 04:19	60.37	OK
2505	2026-09-22 04:20	62.78	OK	2506	2026-09-22 04:21	59.31	OK
2507	2026-09-22 04:22	59.90	OK	2508	2026-09-22 04:23	62.88	OK
2509	2026-09-22 04:24	60.81	OK	2510	2026-09-22 04:25	59.47	OK
2511	2026-09-22 04:26	60.66	OK	2512	2026-09-22 04:27	59.67	OK
2513	2026-09-22 04:28	60.74	OK	2514	2026-09-22 04:29	61.31	OK
2515	2026-09-22 04:30	62.56	OK	2516	2026-09-22 04:31	61.15	OK
2517	2026-09-22 04:32	59.57	OK	2518	2026-09-22 04:33	59.00	OK
2519	2026-09-22 04:34	59.00	OK	2520	2026-09-22 04:35	62.69	OK
2521	2026-09-22 04:36	62.20	OK	2522	2026-09-22 04:37	60.59	OK
2523	2026-09-22 04:38	60.69	OK	2524	2026-09-22 04:39	59.16	OK
2525	2026-09-22 04:40	61.63	OK	2526	2026-09-22 04:41	60.77	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2527	2026-09-22 04:42	60.07	OK	2528	2026-09-22 04:43	58.94	OK
2529	2026-09-22 04:44	61.35	OK	2530	2026-09-22 04:45	58.93	OK
2531	2026-09-22 04:46	60.59	OK	2532	2026-09-22 04:47	61.33	OK
2533	2026-09-22 04:48	57.68	OK	2534	2026-09-22 04:49	60.12	OK
2535	2026-09-22 04:50	62.39	OK	2536	2026-09-22 04:51	58.47	OK
2537	2026-09-22 04:52	60.72	OK	2538	2026-09-22 04:53	60.93	OK
2539	2026-09-22 04:54	62.51	OK	2540	2026-09-22 04:55	60.18	OK
2541	2026-09-22 04:56	59.12	OK	2542	2026-09-22 04:57	59.83	OK
2543	2026-09-22 04:58	61.32	OK	2544	2026-09-22 04:59	61.41	OK
2545	2026-09-22 05:00	60.35	OK	2546	2026-09-22 05:01	57.95	OK
2547	2026-09-22 05:02	57.59	OK	2548	2026-09-22 05:03	60.42	OK
2549	2026-09-22 05:04	60.02	OK	2550	2026-09-22 05:05	60.88	OK
2551	2026-09-22 05:06	60.96	OK	2552	2026-09-22 05:07	60.10	OK
2553	2026-09-22 05:08	59.98	OK	2554	2026-09-22 05:09	59.22	OK
2555	2026-09-22 05:10	59.44	OK	2556	2026-09-22 05:11	60.04	OK
2557	2026-09-22 05:12	57.32	OK	2558	2026-09-22 05:13	60.21	OK
2559	2026-09-22 05:14	56.80	OK	2560	2026-09-22 05:15	61.03	OK
2561	2026-09-22 05:16	60.54	OK	2562	2026-09-22 05:17	60.61	OK
2563	2026-09-22 05:18	59.35	OK	2564	2026-09-22 05:19	59.67	OK
2565	2026-09-22 05:20	60.00	OK	2566	2026-09-22 05:21	60.50	OK
2567	2026-09-22 05:22	63.00	OK	2568	2026-09-22 05:23	59.38	OK
2569	2026-09-22 05:24	61.24	OK	2570	2026-09-22 05:25	59.43	OK
2571	2026-09-22 05:26	58.83	OK	2572	2026-09-22 05:27	58.79	OK
2573	2026-09-22 05:28	61.45	OK	2574	2026-09-22 05:29	62.44	OK
2575	2026-09-22 05:30	60.56	OK	2576	2026-09-22 05:31	61.69	OK
2577	2026-09-22 05:32	56.53	OK	2578	2026-09-22 05:33	60.71	OK
2579	2026-09-22 05:34	60.47	OK	2580	2026-09-22 05:35	60.07	OK
2581	2026-09-22 05:36	60.12	OK	2582	2026-09-22 05:37	60.49	OK
2583	2026-09-22 05:38	56.68	OK	2584	2026-09-22 05:39	58.44	OK
2585	2026-09-22 05:40	62.72	OK	2586	2026-09-22 05:41	60.51	OK
2587	2026-09-22 05:42	59.90	OK	2588	2026-09-22 05:43	60.35	OK
2589	2026-09-22 05:44	59.27	OK	2590	2026-09-22 05:45	58.95	OK
2591	2026-09-22 05:46	57.88	OK	2592	2026-09-22 05:47	59.23	OK
2593	2026-09-22 05:48	60.52	OK	2594	2026-09-22 05:49	60.72	OK
2595	2026-09-22 05:50	58.82	OK	2596	2026-09-22 05:51	56.20	OK
2597	2026-09-22 05:52	59.22	OK	2598	2026-09-22 05:53	58.47	OK
2599	2026-09-22 05:54	58.67	OK	2600	2026-09-22 05:55	57.46	OK
2601	2026-09-22 05:56	60.92	OK	2602	2026-09-22 05:57	61.59	OK
2603	2026-09-22 05:58	60.55	OK	2604	2026-09-22 05:59	57.06	OK
2605	2026-09-22 06:00	59.68	OK	2606	2026-09-22 06:01	59.01	OK
2607	2026-09-22 06:02	60.19	OK	2608	2026-09-22 06:03	58.70	OK
2609	2026-09-22 06:04	57.89	OK	2610	2026-09-22 06:05	60.46	OK
2611	2026-09-22 06:06	60.59	OK	2612	2026-09-22 06:07	59.94	OK
2613	2026-09-22 06:08	58.61	OK	2614	2026-09-22 06:09	60.40	OK
2615	2026-09-22 06:10	61.09	OK	2616	2026-09-22 06:11	57.18	OK
2617	2026-09-22 06:12	60.04	OK	2618	2026-09-22 06:13	60.85	OK
2619	2026-09-22 06:14	57.98	OK	2620	2026-09-22 06:15	59.70	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2621	2026-09-22 06:16	59.64	OK	2622	2026-09-22 06:17	59.12	OK
2623	2026-09-22 06:18	60.43	OK	2624	2026-09-22 06:19	59.74	OK
2625	2026-09-22 06:20	59.79	OK	2626	2026-09-22 06:21	57.87	OK
2627	2026-09-22 06:22	59.37	OK	2628	2026-09-22 06:23	61.38	OK
2629	2026-09-22 06:24	58.56	OK	2630	2026-09-22 06:25	61.95	OK
2631	2026-09-22 06:26	60.47	OK	2632	2026-09-22 06:27	59.58	OK
2633	2026-09-22 06:28	59.00	OK	2634	2026-09-22 06:29	58.71	OK
2635	2026-09-22 06:30	61.33	OK	2636	2026-09-22 06:31	55.63	OK
2637	2026-09-22 06:32	57.17	OK	2638	2026-09-22 06:33	58.03	OK
2639	2026-09-22 06:34	59.04	OK	2640	2026-09-22 06:35	59.06	OK
2641	2026-09-22 06:36	59.52	OK	2642	2026-09-22 06:37	58.94	OK
2643	2026-09-22 06:38	59.78	OK	2644	2026-09-22 06:39	61.16	OK
2645	2026-09-22 06:40	59.53	OK	2646	2026-09-22 06:41	58.21	OK
2647	2026-09-22 06:42	58.43	OK	2648	2026-09-22 06:43	59.94	OK
2649	2026-09-22 06:44	59.11	OK	2650	2026-09-22 06:45	60.46	OK
2651	2026-09-22 06:46	59.81	OK	2652	2026-09-22 06:47	58.30	OK
2653	2026-09-22 06:48	60.30	OK	2654	2026-09-22 06:49	58.00	OK
2655	2026-09-22 06:50	56.71	OK	2656	2026-09-22 06:51	59.81	OK
2657	2026-09-22 06:52	57.93	OK	2658	2026-09-22 06:53	56.68	OK
2659	2026-09-22 06:54	60.57	OK	2660	2026-09-22 06:55	56.17	OK
2661	2026-09-22 06:56	60.27	OK	2662	2026-09-22 06:57	58.05	OK
2663	2026-09-22 06:58	59.02	OK	2664	2026-09-22 06:59	59.87	OK
2665	2026-09-22 07:00	55.51	OK	2666	2026-09-22 07:01	60.77	OK
2667	2026-09-22 07:02	61.63	OK	2668	2026-09-22 07:03	61.35	OK
2669	2026-09-22 07:04	61.04	OK	2670	2026-09-22 07:05	60.04	OK
2671	2026-09-22 07:06	56.83	OK	2672	2026-09-22 07:07	59.37	OK
2673	2026-09-22 07:08	58.44	OK	2674	2026-09-22 07:09	60.79	OK
2675	2026-09-22 07:10	61.70	OK	2676	2026-09-22 07:11	61.16	OK
2677	2026-09-22 07:12	59.93	OK	2678	2026-09-22 07:13	57.58	OK
2679	2026-09-22 07:14	57.97	OK	2680	2026-09-22 07:15	58.16	OK
2681	2026-09-22 07:16	57.27	OK	2682	2026-09-22 07:17	59.07	OK
2683	2026-09-22 07:18	60.20	OK	2684	2026-09-22 07:19	58.10	OK
2685	2026-09-22 07:20	57.93	OK	2686	2026-09-22 07:21	61.83	OK
2687	2026-09-22 07:22	60.19	OK	2688	2026-09-22 07:23	59.58	OK
2689	2026-09-22 07:24	60.01	OK	2690	2026-09-22 07:25	60.61	OK
2691	2026-09-22 07:26	60.46	OK	2692	2026-09-22 07:27	60.44	OK
2693	2026-09-22 07:28	59.53	OK	2694	2026-09-22 07:29	59.05	OK
2695	2026-09-22 07:30	58.76	OK	2696	2026-09-22 07:31	58.10	OK
2697	2026-09-22 07:32	58.55	OK	2698	2026-09-22 07:33	58.51	OK
2699	2026-09-22 07:34	55.86	OK	2700	2026-09-22 07:35	59.46	OK
2701	2026-09-22 07:36	58.66	OK	2702	2026-09-22 07:37	58.58	OK
2703	2026-09-22 07:38	58.86	OK	2704	2026-09-22 07:39	60.22	OK
2705	2026-09-22 07:40	59.74	OK	2706	2026-09-22 07:41	61.03	OK
2707	2026-09-22 07:42	58.38	OK	2708	2026-09-22 07:43	59.48	OK
2709	2026-09-22 07:44	58.96	OK	2710	2026-09-22 07:45	59.22	OK
2711	2026-09-22 07:46	57.82	OK	2712	2026-09-22 07:47	58.47	OK
2713	2026-09-22 07:48	60.95	OK	2714	2026-09-22 07:49	58.33	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2715	2026-09-22 07:50	59.26	OK	2716	2026-09-22 07:51	60.23	OK
2717	2026-09-22 07:52	56.66	OK	2718	2026-09-22 07:53	56.79	OK
2719	2026-09-22 07:54	57.78	OK	2720	2026-09-22 07:55	61.64	OK
2721	2026-09-22 07:56	57.98	OK	2722	2026-09-22 07:57	58.07	OK
2723	2026-09-22 07:58	61.41	OK	2724	2026-09-22 07:59	58.37	OK
2725	2026-09-22 08:00	57.43	OK	2726	2026-09-22 08:01	58.44	OK
2727	2026-09-22 08:02	58.53	OK	2728	2026-09-22 08:03	58.37	OK
2729	2026-09-22 08:04	56.95	OK	2730	2026-09-22 08:05	61.08	OK
2731	2026-09-22 08:06	61.13	OK	2732	2026-09-22 08:07	58.61	OK
2733	2026-09-22 08:08	57.13	OK	2734	2026-09-22 08:09	60.66	OK
2735	2026-09-22 08:10	57.57	OK	2736	2026-09-22 08:11	60.83	OK
2737	2026-09-22 08:12	61.03	OK	2738	2026-09-22 08:13	60.14	OK
2739	2026-09-22 08:14	60.83	OK	2740	2026-09-22 08:15	60.85	OK
2741	2026-09-22 08:16	60.97	OK	2742	2026-09-22 08:17	61.06	OK
2743	2026-09-22 08:18	60.05	OK	2744	2026-09-22 08:19	57.76	OK
2745	2026-09-22 08:20	59.41	OK	2746	2026-09-22 08:21	59.45	OK
2747	2026-09-22 08:22	59.51	OK	2748	2026-09-22 08:23	57.66	OK
2749	2026-09-22 08:24	59.87	OK	2750	2026-09-22 08:25	58.44	OK
2751	2026-09-22 08:26	59.44	OK	2752	2026-09-22 08:27	58.56	OK
2753	2026-09-22 08:28	60.00	OK	2754	2026-09-22 08:29	60.65	OK
2755	2026-09-22 08:30	58.67	OK	2756	2026-09-22 08:31	60.90	OK
2757	2026-09-22 08:32	59.46	OK	2758	2026-09-22 08:33	59.31	OK
2759	2026-09-22 08:34	59.73	OK	2760	2026-09-22 08:35	60.22	OK
2761	2026-09-22 08:36	60.64	OK	2762	2026-09-22 08:37	60.01	OK
2763	2026-09-22 08:38	60.21	OK	2764	2026-09-22 08:39	61.12	OK
2765	2026-09-22 08:40	59.27	OK	2766	2026-09-22 08:41	59.10	OK
2767	2026-09-22 08:42	61.00	OK	2768	2026-09-22 08:43	59.22	OK
2769	2026-09-22 08:44	58.89	OK	2770	2026-09-22 08:45	57.76	OK
2771	2026-09-22 08:46	60.02	OK	2772	2026-09-22 08:47	60.27	OK
2773	2026-09-22 08:48	59.23	OK	2774	2026-09-22 08:49	59.38	OK
2775	2026-09-22 08:50	61.07	OK	2776	2026-09-22 08:51	59.68	OK
2777	2026-09-22 08:52	58.96	OK	2778	2026-09-22 08:53	59.23	OK
2779	2026-09-22 08:54	59.37	OK	2780	2026-09-22 08:55	58.83	OK
2781	2026-09-22 08:56	59.23	OK	2782	2026-09-22 08:57	58.90	OK
2783	2026-09-22 08:58	58.41	OK	2784	2026-09-22 08:59	60.96	OK
2785	2026-09-22 09:00	60.08	OK	2786	2026-09-22 09:01	58.91	OK
2787	2026-09-22 09:02	60.47	OK	2788	2026-09-22 09:03	60.54	OK
2789	2026-09-22 09:04	59.69	OK	2790	2026-09-22 09:05	60.74	OK
2791	2026-09-22 09:06	59.63	OK	2792	2026-09-22 09:07	59.85	OK
2793	2026-09-22 09:08	61.00	OK	2794	2026-09-22 09:09	60.24	OK
2795	2026-09-22 09:10	56.74	OK	2796	2026-09-22 09:11	57.73	OK
2797	2026-09-22 09:12	58.37	OK	2798	2026-09-22 09:13	57.83	OK
2799	2026-09-22 09:14	60.71	OK	2800	2026-09-22 09:15	61.39	OK
2801	2026-09-22 09:16	57.49	OK	2802	2026-09-22 09:17	60.59	OK
2803	2026-09-22 09:18	59.17	OK	2804	2026-09-22 09:19	59.46	OK
2805	2026-09-22 09:20	58.41	OK	2806	2026-09-22 09:21	60.01	OK
2807	2026-09-22 09:22	57.53	OK	2808	2026-09-22 09:23	61.50	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2809	2026-09-22 09:24	57.62	OK	2810	2026-09-22 09:25	60.10	OK
2811	2026-09-22 09:26	59.94	OK	2812	2026-09-22 09:27	60.55	OK
2813	2026-09-22 09:28	58.75	OK	2814	2026-09-22 09:29	60.12	OK
2815	2026-09-22 09:30	59.08	OK	2816	2026-09-22 09:31	60.32	OK
2817	2026-09-22 09:32	60.27	OK	2818	2026-09-22 09:33	63.75	OK
2819	2026-09-22 09:34	59.72	OK	2820	2026-09-22 09:35	57.49	OK
2821	2026-09-22 09:36	60.76	OK	2822	2026-09-22 09:37	62.39	OK
2823	2026-09-22 09:38	58.48	OK	2824	2026-09-22 09:39	60.60	OK
2825	2026-09-22 09:40	59.64	OK	2826	2026-09-22 09:41	58.67	OK
2827	2026-09-22 09:42	62.70	OK	2828	2026-09-22 09:43	61.43	OK
2829	2026-09-22 09:44	61.50	OK	2830	2026-09-22 09:45	59.70	OK
2831	2026-09-22 09:46	58.61	OK	2832	2026-09-22 09:47	59.61	OK
2833	2026-09-22 09:48	61.94	OK	2834	2026-09-22 09:49	62.75	OK
2835	2026-09-22 09:50	61.23	OK	2836	2026-09-22 09:51	60.71	OK
2837	2026-09-22 09:52	62.17	OK	2838	2026-09-22 09:53	62.88	OK
2839	2026-09-22 09:54	60.62	OK	2840	2026-09-22 09:55	62.38	OK
2841	2026-09-22 09:56	60.89	OK	2842	2026-09-22 09:57	56.88	OK
2843	2026-09-22 09:58	59.54	OK	2844	2026-09-22 09:59	60.71	OK
2845	2026-09-22 10:00	62.23	OK	2846	2026-09-22 10:01	58.86	OK
2847	2026-09-22 10:02	60.66	OK	2848	2026-09-22 10:03	61.22	OK
2849	2026-09-22 10:04	61.69	OK	2850	2026-09-22 10:05	59.45	OK
2851	2026-09-22 10:06	59.85	OK	2852	2026-09-22 10:07	59.11	OK
2853	2026-09-22 10:08	60.21	OK	2854	2026-09-22 10:09	59.90	OK
2855	2026-09-22 10:10	61.63	OK	2856	2026-09-22 10:11	58.37	OK
2857	2026-09-22 10:12	60.00	OK	2858	2026-09-22 10:13	60.11	OK
2859	2026-09-22 10:14	60.16	OK	2860	2026-09-22 10:15	60.81	OK
2861	2026-09-22 10:16	60.33	OK	2862	2026-09-22 10:17	60.75	OK
2863	2026-09-22 10:18	63.03	OK	2864	2026-09-22 10:19	58.27	OK
2865	2026-09-22 10:20	61.47	OK	2866	2026-09-22 10:21	63.89	OK
2867	2026-09-22 10:22	60.44	OK	2868	2026-09-22 10:23	63.06	OK
2869	2026-09-22 10:24	60.50	OK	2870	2026-09-22 10:25	58.23	OK
2871	2026-09-22 10:26	63.60	OK	2872	2026-09-22 10:27	60.86	OK
2873	2026-09-22 10:28	60.42	OK	2874	2026-09-22 10:29	60.30	OK
2875	2026-09-22 10:30	61.97	OK	2876	2026-09-22 10:31	60.86	OK
2877	2026-09-22 10:32	61.92	OK	2878	2026-09-22 10:33	60.49	OK
2879	2026-09-22 10:34	58.20	OK	2880	2026-09-22 10:35	61.17	OK
2881	2026-09-22 10:36	62.73	OK	2882	2026-09-22 10:37	60.33	OK
2883	2026-09-22 10:38	61.58	OK	2884	2026-09-22 10:39	58.56	OK
2885	2026-09-22 10:40	59.88	OK	2886	2026-09-22 10:41	59.78	OK
2887	2026-09-22 10:42	62.23	OK	2888	2026-09-22 10:43	59.50	OK
2889	2026-09-22 10:44	61.88	OK	2890	2026-09-22 10:45	61.50	OK
2891	2026-09-22 10:46	60.32	OK	2892	2026-09-22 10:47	63.27	OK
2893	2026-09-22 10:48	61.59	OK	2894	2026-09-22 10:49	59.94	OK
2895	2026-09-22 10:50	64.26	OK	2896	2026-09-22 10:51	63.73	OK
2897	2026-09-22 10:52	62.34	OK	2898	2026-09-22 10:53	59.83	OK
2899	2026-09-22 10:54	61.19	OK	2900	2026-09-22 10:55	59.23	OK
2901	2026-09-22 10:56	61.51	OK	2902	2026-09-22 10:57	60.39	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2903	2026-09-22 10:58	61.98	OK	2904	2026-09-22 10:59	60.58	OK
2905	2026-09-22 11:00	63.61	OK	2906	2026-09-22 11:01	62.65	OK
2907	2026-09-22 11:02	62.82	OK	2908	2026-09-22 11:03	62.52	OK
2909	2026-09-22 11:04	61.16	OK	2910	2026-09-22 11:05	59.73	OK
2911	2026-09-22 11:06	61.60	OK	2912	2026-09-22 11:07	61.48	OK
2913	2026-09-22 11:08	62.66	OK	2914	2026-09-22 11:09	60.43	OK
2915	2026-09-22 11:10	59.60	OK	2916	2026-09-22 11:11	60.03	OK
2917	2026-09-22 11:12	61.35	OK	2918	2026-09-22 11:13	60.83	OK
2919	2026-09-22 11:14	59.08	OK	2920	2026-09-22 11:15	60.84	OK
2921	2026-09-22 11:16	63.40	OK	2922	2026-09-22 11:17	61.64	OK
2923	2026-09-22 11:18	62.59	OK	2924	2026-09-22 11:19	62.05	OK
2925	2026-09-22 11:20	62.28	OK	2926	2026-09-22 11:21	62.86	OK
2927	2026-09-22 11:22	61.12	OK	2928	2026-09-22 11:23	62.00	OK
2929	2026-09-22 11:24	60.94	OK	2930	2026-09-22 11:25	63.11	OK
2931	2026-09-22 11:26	61.84	OK	2932	2026-09-22 11:27	62.46	OK
2933	2026-09-22 11:28	62.23	OK	2934	2026-09-22 11:29	61.92	OK
2935	2026-09-22 11:30	62.40	OK	2936	2026-09-22 11:31	65.01	OK
2937	2026-09-22 11:32	62.43	OK	2938	2026-09-22 11:33	59.84	OK
2939	2026-09-22 11:34	61.21	OK	2940	2026-09-22 11:35	63.06	OK
2941	2026-09-22 11:36	63.05	OK	2942	2026-09-22 11:37	63.37	OK
2943	2026-09-22 11:38	60.62	OK	2944	2026-09-22 11:39	64.69	OK
2945	2026-09-22 11:40	61.67	OK	2946	2026-09-22 11:41	61.69	OK
2947	2026-09-22 11:42	63.12	OK	2948	2026-09-22 11:43	60.83	OK
2949	2026-09-22 11:44	63.11	OK	2950	2026-09-22 11:45	59.62	OK
2951	2026-09-22 11:46	61.46	OK	2952	2026-09-22 11:47	60.15	OK
2953	2026-09-22 11:48	64.09	OK	2954	2026-09-22 11:49	66.02	OK
2955	2026-09-22 11:50	61.03	OK	2956	2026-09-22 11:51	65.01	OK
2957	2026-09-22 11:52	63.14	OK	2958	2026-09-22 11:53	63.07	OK
2959	2026-09-22 11:54	64.22	OK	2960	2026-09-22 11:55	64.41	OK
2961	2026-09-22 11:56	62.65	OK	2962	2026-09-22 11:57	61.32	OK
2963	2026-09-22 11:58	62.94	OK	2964	2026-09-22 11:59	64.97	OK
2965	2026-09-22 12:00	60.79	OK	2966	2026-09-22 12:01	63.38	OK
2967	2026-09-22 12:02	64.61	OK	2968	2026-09-22 12:03	62.34	OK
2969	2026-09-22 12:04	62.54	OK	2970	2026-09-22 12:05	62.86	OK
2971	2026-09-22 12:06	64.97	OK	2972	2026-09-22 12:07	63.17	OK
2973	2026-09-22 12:08	63.81	OK	2974	2026-09-22 12:09	61.82	OK
2975	2026-09-22 12:10	63.50	OK	2976	2026-09-22 12:11	64.75	OK
2977	2026-09-22 12:12	64.54	OK	2978	2026-09-22 12:13	60.94	OK
2979	2026-09-22 12:14	63.04	OK	2980	2026-09-22 12:15	61.60	OK
2981	2026-09-22 12:16	59.83	OK	2982	2026-09-22 12:17	63.08	OK
2983	2026-09-22 12:18	65.45	OK	2984	2026-09-22 12:19	64.42	OK
2985	2026-09-22 12:20	62.92	OK	2986	2026-09-22 12:21	64.58	OK
2987	2026-09-22 12:22	66.07	OK	2988	2026-09-22 12:23	63.10	OK
2989	2026-09-22 12:24	63.30	OK	2990	2026-09-22 12:25	64.24	OK
2991	2026-09-22 12:26	61.75	OK	2992	2026-09-22 12:27	63.78	OK
2993	2026-09-22 12:28	64.21	OK	2994	2026-09-22 12:29	63.31	OK
2995	2026-09-22 12:30	63.95	OK	2996	2026-09-22 12:31	64.59	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2997	2026-09-22 12:32	63.12	OK	2998	2026-09-22 12:33	62.95	OK
2999	2026-09-22 12:34	60.80	OK	3000	2026-09-22 12:35	61.17	OK
3001	2026-09-22 12:36	62.36	OK	3002	2026-09-22 12:37	66.44	OK
3003	2026-09-22 12:38	63.22	OK	3004	2026-09-22 12:39	62.03	OK
3005	2026-09-22 12:40	65.28	OK	3006	2026-09-22 12:41	65.84	OK
3007	2026-09-22 12:42	61.90	OK	3008	2026-09-22 12:43	66.00	OK
3009	2026-09-22 12:44	61.30	OK	3010	2026-09-22 12:45	62.84	OK
3011	2026-09-22 12:46	62.85	OK	3012	2026-09-22 12:47	63.24	OK
3013	2026-09-22 12:48	61.37	OK	3014	2026-09-22 12:49	65.79	OK
3015	2026-09-22 12:50	62.69	OK	3016	2026-09-22 12:51	64.26	OK
3017	2026-09-22 12:52	62.15	OK	3018	2026-09-22 12:53	62.06	OK
3019	2026-09-22 12:54	65.94	OK	3020	2026-09-22 12:55	66.15	OK
3021	2026-09-22 12:56	64.15	OK	3022	2026-09-22 12:57	65.56	OK
3023	2026-09-22 12:58	64.92	OK	3024	2026-09-22 12:59	63.80	OK
3025	2026-09-22 13:00	64.96	OK	3026	2026-09-22 13:01	64.91	OK
3027	2026-09-22 13:02	65.25	OK	3028	2026-09-22 13:03	64.16	OK
3029	2026-09-22 13:04	64.20	OK	3030	2026-09-22 13:05	64.68	OK
3031	2026-09-22 13:06	63.26	OK	3032	2026-09-22 13:07	64.17	OK
3033	2026-09-22 13:08	64.18	OK	3034	2026-09-22 13:09	66.45	OK
3035	2026-09-22 13:10	66.54	OK	3036	2026-09-22 13:11	65.75	OK
3037	2026-09-22 13:12	64.27	OK	3038	2026-09-22 13:13	64.83	OK
3039	2026-09-22 13:14	66.61	OK	3040	2026-09-22 13:15	65.41	OK
3041	2026-09-22 13:16	65.17	OK	3042	2026-09-22 13:17	66.28	OK
3043	2026-09-22 13:18	64.86	OK	3044	2026-09-22 13:19	65.20	OK
3045	2026-09-22 13:20	65.38	OK	3046	2026-09-22 13:21	62.15	OK
3047	2026-09-22 13:22	63.55	OK	3048	2026-09-22 13:23	63.69	OK
3049	2026-09-22 13:24	65.92	OK	3050	2026-09-22 13:25	67.22	OK
3051	2026-09-22 13:26	67.27	OK	3052	2026-09-22 13:27	66.45	OK
3053	2026-09-22 13:28	65.73	OK	3054	2026-09-22 13:29	64.56	OK
3055	2026-09-22 13:30	65.91	OK	3056	2026-09-22 13:31	68.80	OK
3057	2026-09-22 13:32	65.45	OK	3058	2026-09-22 13:33	63.83	OK
3059	2026-09-22 13:34	65.30	OK	3060	2026-09-22 13:35	64.94	OK
3061	2026-09-22 13:36	65.99	OK	3062	2026-09-22 13:37	65.19	OK
3063	2026-09-22 13:38	66.45	OK	3064	2026-09-22 13:39	63.85	OK
3065	2026-09-22 13:40	64.53	OK	3066	2026-09-22 13:41	65.39	OK
3067	2026-09-22 13:42	62.43	OK	3068	2026-09-22 13:43	66.20	OK
3069	2026-09-22 13:44	68.21	OK	3070	2026-09-22 13:45	66.95	OK
3071	2026-09-22 13:46	63.45	OK	3072	2026-09-22 13:47	65.34	OK
3073	2026-09-22 13:48	64.36	OK	3074	2026-09-22 13:49	65.32	OK
3075	2026-09-22 13:50	64.42	OK	3076	2026-09-22 13:51	65.26	OK
3077	2026-09-22 13:52	66.09	OK	3078	2026-09-22 13:53	65.54	OK
3079	2026-09-22 13:54	67.79	OK	3080	2026-09-22 13:55	66.00	OK
3081	2026-09-22 13:56	66.59	OK	3082	2026-09-22 13:57	64.41	OK
3083	2026-09-22 13:58	65.55	OK	3084	2026-09-22 13:59	66.55	OK
3085	2026-09-22 14:00	65.76	OK	3086	2026-09-22 14:01	66.05	OK
3087	2026-09-22 14:02	66.34	OK	3088	2026-09-22 14:03	64.80	OK
3089	2026-09-22 14:04	66.25	OK	3090	2026-09-22 14:05	67.10	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3091	2026-09-22 14:06	67.13	OK	3092	2026-09-22 14:07	64.33	OK
3093	2026-09-22 14:08	62.84	OK	3094	2026-09-22 14:09	65.74	OK
3095	2026-09-22 14:10	66.71	OK	3096	2026-09-22 14:11	64.05	OK
3097	2026-09-22 14:12	63.12	OK	3098	2026-09-22 14:13	66.08	OK
3099	2026-09-22 14:14	65.19	OK	3100	2026-09-22 14:15	65.70	OK
3101	2026-09-22 14:16	67.04	OK	3102	2026-09-22 14:17	67.06	OK
3103	2026-09-22 14:18	66.59	OK	3104	2026-09-22 14:19	67.82	OK
3105	2026-09-22 14:20	64.45	OK	3106	2026-09-22 14:21	65.10	OK
3107	2026-09-22 14:22	66.44	OK	3108	2026-09-22 14:23	66.72	OK
3109	2026-09-22 14:24	67.30	OK	3110	2026-09-22 14:25	68.09	OK
3111	2026-09-22 14:26	62.91	OK	3112	2026-09-22 14:27	66.80	OK
3113	2026-09-22 14:28	66.74	OK	3114	2026-09-22 14:29	68.09	OK
3115	2026-09-22 14:30	66.91	OK	3116	2026-09-22 14:31	67.10	OK
3117	2026-09-22 14:32	66.98	OK	3118	2026-09-22 14:33	65.71	OK
3119	2026-09-22 14:34	69.02	OK	3120	2026-09-22 14:35	63.65	OK
3121	2026-09-22 14:36	66.79	OK	3122	2026-09-22 14:37	65.30	OK
3123	2026-09-22 14:38	65.20	OK	3124	2026-09-22 14:39	64.98	OK
3125	2026-09-22 14:40	65.38	OK	3126	2026-09-22 14:41	67.16	OK
3127	2026-09-22 14:42	67.06	OK	3128	2026-09-22 14:43	66.92	OK
3129	2026-09-22 14:44	66.17	OK	3130	2026-09-22 14:45	64.75	OK
3131	2026-09-22 14:46	68.35	OK	3132	2026-09-22 14:47	67.44	OK
3133	2026-09-22 14:48	66.85	OK	3134	2026-09-22 14:49	64.37	OK
3135	2026-09-22 14:50	67.63	OK	3136	2026-09-22 14:51	67.70	OK
3137	2026-09-22 14:52	67.02	OK	3138	2026-09-22 14:53	67.39	OK
3139	2026-09-22 14:54	66.46	OK	3140	2026-09-22 14:55	68.10	OK
3141	2026-09-22 14:56	65.07	OK	3142	2026-09-22 14:57	66.61	OK
3143	2026-09-22 14:58	67.09	OK	3144	2026-09-22 14:59	70.78	OK
3145	2026-09-22 15:00	66.16	OK	3146	2026-09-22 15:01	64.95	OK
3147	2026-09-22 15:02	67.72	OK	3148	2026-09-22 15:03	65.96	OK
3149	2026-09-22 15:04	66.55	OK	3150	2026-09-22 15:05	67.68	OK
3151	2026-09-22 15:06	69.85	OK	3152	2026-09-22 15:07	67.73	OK
3153	2026-09-22 15:08	66.51	OK	3154	2026-09-22 15:09	66.98	OK
3155	2026-09-22 15:10	65.25	OK	3156	2026-09-22 15:11	66.84	OK
3157	2026-09-22 15:12	70.51	OK	3158	2026-09-22 15:13	68.40	OK
3159	2026-09-22 15:14	67.79	OK	3160	2026-09-22 15:15	68.68	OK
3161	2026-09-22 15:16	69.02	OK	3162	2026-09-22 15:17	65.35	OK
3163	2026-09-22 15:18	66.61	OK	3164	2026-09-22 15:19	68.56	OK
3165	2026-09-22 15:20	66.71	OK	3166	2026-09-22 15:21	68.80	OK
3167	2026-09-22 15:22	65.31	OK	3168	2026-09-22 15:23	68.38	OK
3169	2026-09-22 15:24	64.89	OK	3170	2026-09-22 15:25	65.92	OK
3171	2026-09-22 15:26	67.39	OK	3172	2026-09-22 15:27	68.02	OK
3173	2026-09-22 15:28	66.36	OK	3174	2026-09-22 15:29	67.20	OK
3175	2026-09-22 15:30	69.97	OK	3176	2026-09-22 15:31	66.92	OK
3177	2026-09-22 15:32	67.55	OK	3178	2026-09-22 15:33	68.31	OK
3179	2026-09-22 15:34	70.03	OK	3180	2026-09-22 15:35	70.07	OK
3181	2026-09-22 15:36	66.85	OK	3182	2026-09-22 15:37	65.64	OK
3183	2026-09-22 15:38	69.93	OK	3184	2026-09-22 15:39	69.09	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3185	2026-09-22 15:40	68.54	OK	3186	2026-09-22 15:41	66.85	OK
3187	2026-09-22 15:42	68.37	OK	3188	2026-09-22 15:43	70.93	OK
3189	2026-09-22 15:44	67.55	OK	3190	2026-09-22 15:45	69.31	OK
3191	2026-09-22 15:46	68.28	OK	3192	2026-09-22 15:47	67.18	OK
3193	2026-09-22 15:48	67.79	OK	3194	2026-09-22 15:49	68.18	OK
3195	2026-09-22 15:50	67.01	OK	3196	2026-09-22 15:51	69.87	OK
3197	2026-09-22 15:52	70.01	OK	3198	2026-09-22 15:53	67.81	OK
3199	2026-09-22 15:54	67.96	OK	3200	2026-09-22 15:55	69.67	OK
3201	2026-09-22 15:56	66.93	OK	3202	2026-09-22 15:57	69.33	OK
3203	2026-09-22 15:58	68.46	OK	3204	2026-09-22 15:59	70.17	OK
3205	2026-09-22 16:00	66.60	OK	3206	2026-09-22 16:01	69.49	OK
3207	2026-09-22 16:02	68.10	OK	3208	2026-09-22 16:03	69.60	OK
3209	2026-09-22 16:04	69.94	OK	3210	2026-09-22 16:05	68.89	OK
3211	2026-09-22 16:06	67.78	OK	3212	2026-09-22 16:07	69.86	OK
3213	2026-09-22 16:08	68.31	OK	3214	2026-09-22 16:09	70.86	OK
3215	2026-09-22 16:10	67.23	OK	3216	2026-09-22 16:11	71.18	OK
3217	2026-09-22 16:12	69.71	OK	3218	2026-09-22 16:13	67.62	OK
3219	2026-09-22 16:14	69.01	OK	3220	2026-09-22 16:15	66.60	OK
3221	2026-09-22 16:16	67.92	OK	3222	2026-09-22 16:17	70.16	OK
3223	2026-09-22 16:18	68.16	OK	3224	2026-09-22 16:19	72.08	OK
3225	2026-09-22 16:20	69.00	OK	3226	2026-09-22 16:21	68.84	OK
3227	2026-09-22 16:22	69.03	OK	3228	2026-09-22 16:23	69.17	OK
3229	2026-09-22 16:24	69.21	OK	3230	2026-09-22 16:25	69.17	OK
3231	2026-09-22 16:26	70.78	OK	3232	2026-09-22 16:27	68.76	OK
3233	2026-09-22 16:28	68.41	OK	3234	2026-09-22 16:29	69.60	OK
3235	2026-09-22 16:30	68.49	OK	3236	2026-09-22 16:31	67.84	OK
3237	2026-09-22 16:32	69.47	OK	3238	2026-09-22 16:33	70.16	OK
3239	2026-09-22 16:34	67.43	OK	3240	2026-09-22 16:35	69.31	OK
3241	2026-09-22 16:36	67.13	OK	3242	2026-09-22 16:37	70.51	OK
3243	2026-09-22 16:38	68.67	OK	3244	2026-09-22 16:39	68.29	OK
3245	2026-09-22 16:40	67.85	OK	3246	2026-09-22 16:41	69.24	OK
3247	2026-09-22 16:42	68.21	OK	3248	2026-09-22 16:43	67.62	OK
3249	2026-09-22 16:44	67.85	OK	3250	2026-09-22 16:45	69.47	OK
3251	2026-09-22 16:46	68.61	OK	3252	2026-09-22 16:47	67.30	OK
3253	2026-09-22 16:48	68.21	OK	3254	2026-09-22 16:49	68.80	OK
3255	2026-09-22 16:50	71.73	OK	3256	2026-09-22 16:51	70.90	OK
3257	2026-09-22 16:52	69.09	OK	3258	2026-09-22 16:53	70.50	OK
3259	2026-09-22 16:54	67.42	OK	3260	2026-09-22 16:55	67.27	OK
3261	2026-09-22 16:56	69.54	OK	3262	2026-09-22 16:57	70.92	OK
3263	2026-09-22 16:58	68.55	OK	3264	2026-09-22 16:59	69.34	OK
3265	2026-09-22 17:00	68.98	OK	3266	2026-09-22 17:01	71.73	OK
3267	2026-09-22 17:02	67.01	OK	3268	2026-09-22 17:03	67.16	OK
3269	2026-09-22 17:04	70.81	OK	3270	2026-09-22 17:05	68.75	OK
3271	2026-09-22 17:06	70.59	OK	3272	2026-09-22 17:07	70.64	OK
3273	2026-09-22 17:08	69.98	OK	3274	2026-09-22 17:09	70.16	OK
3275	2026-09-22 17:10	68.72	OK	3276	2026-09-22 17:11	69.07	OK
3277	2026-09-22 17:12	68.39	OK	3278	2026-09-22 17:13	70.65	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3279	2026-09-22 17:14	70.32	OK	3280	2026-09-22 17:15	70.85	OK
3281	2026-09-22 17:16	68.48	OK	3282	2026-09-22 17:17	70.67	OK
3283	2026-09-22 17:18	69.25	OK	3284	2026-09-22 17:19	71.37	OK
3285	2026-09-22 17:20	69.46	OK	3286	2026-09-22 17:21	70.60	OK
3287	2026-09-22 17:22	70.64	OK	3288	2026-09-22 17:23	69.92	OK
3289	2026-09-22 17:24	68.49	OK	3290	2026-09-22 17:25	68.69	OK
3291	2026-09-22 17:26	69.59	OK	3292	2026-09-22 17:27	70.63	OK
3293	2026-09-22 17:28	72.36	OK	3294	2026-09-22 17:29	67.59	OK
3295	2026-09-22 17:30	67.08	OK	3296	2026-09-22 17:31	69.04	OK
3297	2026-09-22 17:32	70.62	OK	3298	2026-09-22 17:33	70.83	OK
3299	2026-09-22 17:34	71.00	OK	3300	2026-09-22 17:35	71.08	OK
3301	2026-09-22 17:36	67.08	OK	3302	2026-09-22 17:37	69.51	OK
3303	2026-09-22 17:38	70.61	OK	3304	2026-09-22 17:39	69.29	OK
3305	2026-09-22 17:40	71.48	OK	3306	2026-09-22 17:41	69.80	OK
3307	2026-09-22 17:42	71.70	OK	3308	2026-09-22 17:43	69.36	OK
3309	2026-09-22 17:44	71.01	OK	3310	2026-09-22 17:45	71.82	OK
3311	2026-09-22 17:46	70.09	OK	3312	2026-09-22 17:47	69.87	OK
3313	2026-09-22 17:48	71.54	OK	3314	2026-09-22 17:49	67.00	OK
3315	2026-09-22 17:50	71.41	OK	3316	2026-09-22 17:51	69.68	OK
3317	2026-09-22 17:52	71.65	OK	3318	2026-09-22 17:53	70.73	OK
3319	2026-09-22 17:54	68.31	OK	3320	2026-09-22 17:55	70.08	OK
3321	2026-09-22 17:56	67.65	OK	3322	2026-09-22 17:57	68.98	OK
3323	2026-09-22 17:58	71.01	OK	3324	2026-09-22 17:59	70.39	OK
3325	2026-09-22 18:00	69.42	OK	3326	2026-09-22 18:01	68.14	OK
3327	2026-09-22 18:02	70.49	OK	3328	2026-09-22 18:03	72.69	OK
3329	2026-09-22 18:04	69.66	OK	3330	2026-09-22 18:05	70.52	OK
3331	2026-09-22 18:06	69.03	OK	3332	2026-09-22 18:07	68.74	OK
3333	2026-09-22 18:08	71.68	OK	3334	2026-09-22 18:09	68.71	OK
3335	2026-09-22 18:10	68.48	OK	3336	2026-09-22 18:11	72.28	OK
3337	2026-09-22 18:12	73.97	OK	3338	2026-09-22 18:13	71.56	OK
3339	2026-09-22 18:14	69.25	OK	3340	2026-09-22 18:15	72.88	OK
3341	2026-09-22 18:16	70.46	OK	3342	2026-09-22 18:17	68.35	OK
3343	2026-09-22 18:18	71.02	OK	3344	2026-09-22 18:19	69.00	OK
3345	2026-09-22 18:20	67.96	OK	3346	2026-09-22 18:21	70.20	OK
3347	2026-09-22 18:22	72.71	OK	3348	2026-09-22 18:23	70.48	OK
3349	2026-09-22 18:24	69.66	OK	3350	2026-09-22 18:25	73.23	OK
3351	2026-09-22 18:26	68.72	OK	3352	2026-09-22 18:27	69.67	OK
3353	2026-09-22 18:28	71.29	OK	3354	2026-09-22 18:29	68.82	OK
3355	2026-09-22 18:30	68.90	OK	3356	2026-09-22 18:31	69.91	OK
3357	2026-09-22 18:32	69.27	OK	3358	2026-09-22 18:33	72.10	OK
3359	2026-09-22 18:34	71.98	OK	3360	2026-09-22 18:35	70.88	OK
3361	2026-09-22 18:36	68.30	OK	3362	2026-09-22 18:37	70.79	OK
3363	2026-09-22 18:38	70.92	OK	3364	2026-09-22 18:39	70.63	OK
3365	2026-09-22 18:40	72.78	OK	3366	2026-09-22 18:41	69.94	OK
3367	2026-09-22 18:42	70.66	OK	3368	2026-09-22 18:43	71.64	OK
3369	2026-09-22 18:44	71.11	OK	3370	2026-09-22 18:45	67.69	OK
3371	2026-09-22 18:46	72.74	OK	3372	2026-09-22 18:47	71.85	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3373	2026-09-22 18:48	69.46	OK	3374	2026-09-22 18:49	71.86	OK
3375	2026-09-22 18:50	69.89	OK	3376	2026-09-22 18:51	70.34	OK
3377	2026-09-22 18:52	71.72	OK	3378	2026-09-22 18:53	70.37	OK
3379	2026-09-22 18:54	71.25	OK	3380	2026-09-22 18:55	70.77	OK
3381	2026-09-22 18:56	71.53	OK	3382	2026-09-22 18:57	71.52	OK
3383	2026-09-22 18:58	72.99	OK	3384	2026-09-22 18:59	69.74	OK
3385	2026-09-22 19:00	70.26	OK	3386	2026-09-22 19:01	69.55	OK
3387	2026-09-22 19:02	72.11	OK	3388	2026-09-22 19:03	70.70	OK
3389	2026-09-22 19:04	71.68	OK	3390	2026-09-22 19:05	70.57	OK
3391	2026-09-22 19:06	67.32	OK	3392	2026-09-22 19:07	69.93	OK
3393	2026-09-22 19:08	71.33	OK	3394	2026-09-22 19:09	72.32	OK
3395	2026-09-22 19:10	71.05	OK	3396	2026-09-22 19:11	67.45	OK
3397	2026-09-22 19:12	72.82	OK	3398	2026-09-22 19:13	68.48	OK
3399	2026-09-22 19:14	69.77	OK	3400	2026-09-22 19:15	70.86	OK
3401	2026-09-22 19:16	71.81	OK	3402	2026-09-22 19:17	67.99	OK
3403	2026-09-22 19:18	69.94	OK	3404	2026-09-22 19:19	71.40	OK
3405	2026-09-22 19:20	70.63	OK	3406	2026-09-22 19:21	71.19	OK
3407	2026-09-22 19:22	69.45	OK	3408	2026-09-22 19:23	69.73	OK
3409	2026-09-22 19:24	69.30	OK	3410	2026-09-22 19:25	71.70	OK
3411	2026-09-22 19:26	70.02	OK	3412	2026-09-22 19:27	69.12	OK
3413	2026-09-22 19:28	70.63	OK	3414	2026-09-22 19:29	73.08	OK
3415	2026-09-22 19:30	69.96	OK	3416	2026-09-22 19:31	71.98	OK
3417	2026-09-22 19:32	69.57	OK	3418	2026-09-22 19:33	72.33	OK
3419	2026-09-22 19:34	68.93	OK	3420	2026-09-22 19:35	71.82	OK
3421	2026-09-22 19:36	71.86	OK	3422	2026-09-22 19:37	73.96	OK
3423	2026-09-22 19:38	69.33	OK	3424	2026-09-22 19:39	71.33	OK
3425	2026-09-22 19:40	70.89	OK	3426	2026-09-22 19:41	69.79	OK
3427	2026-09-22 19:42	70.52	OK	3428	2026-09-22 19:43	69.14	OK
3429	2026-09-22 19:44	69.79	OK	3430	2026-09-22 19:45	70.66	OK
3431	2026-09-22 19:46	70.40	OK	3432	2026-09-22 19:47	70.87	OK
3433	2026-09-22 19:48	69.12	OK	3434	2026-09-22 19:49	70.09	OK
3435	2026-09-22 19:50	68.74	OK	3436	2026-09-22 19:51	69.77	OK
3437	2026-09-22 19:52	72.73	OK	3438	2026-09-22 19:53	71.31	OK
3439	2026-09-22 19:54	69.89	OK	3440	2026-09-22 19:55	69.85	OK
3441	2026-09-22 19:56	71.06	OK	3442	2026-09-22 19:57	66.49	OK
3443	2026-09-22 19:58	72.10	OK	3444	2026-09-22 19:59	71.38	OK
3445	2026-09-22 20:00	69.57	OK	3446	2026-09-22 20:01	71.27	OK
3447	2026-09-22 20:02	69.93	OK	3448	2026-09-22 20:03	70.78	OK
3449	2026-09-22 20:04	69.51	OK	3450	2026-09-22 20:05	69.84	OK
3451	2026-09-22 20:06	69.79	OK	3452	2026-09-22 20:07	71.19	OK
3453	2026-09-22 20:08	67.88	OK	3454	2026-09-22 20:09	69.03	OK
3455	2026-09-22 20:10	71.37	OK	3456	2026-09-22 20:11	69.87	OK
3457	2026-09-22 20:12	69.37	OK	3458	2026-09-22 20:13	71.73	OK
3459	2026-09-22 20:14	70.18	OK	3460	2026-09-22 20:15	73.61	OK
3461	2026-09-22 20:16	69.87	OK	3462	2026-09-22 20:17	69.54	OK
3463	2026-09-22 20:18	71.51	OK	3464	2026-09-22 20:19	69.30	OK
3465	2026-09-22 20:20	70.69	OK	3466	2026-09-22 20:21	67.35	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3467	2026-09-22 20:22	68.57	OK	3468	2026-09-22 20:23	67.66	OK
3469	2026-09-22 20:24	69.94	OK	3470	2026-09-22 20:25	70.03	OK
3471	2026-09-22 20:26	69.17	OK	3472	2026-09-22 20:27	70.39	OK
3473	2026-09-22 20:28	69.75	OK	3474	2026-09-22 20:29	69.39	OK
3475	2026-09-22 20:30	69.36	OK	3476	2026-09-22 20:31	69.47	OK
3477	2026-09-22 20:32	69.54	OK	3478	2026-09-22 20:33	72.92	OK
3479	2026-09-22 20:34	68.83	OK	3480	2026-09-22 20:35	68.08	OK
3481	2026-09-22 20:36	71.41	OK	3482	2026-09-22 20:37	70.94	OK
3483	2026-09-22 20:38	70.10	OK	3484	2026-09-22 20:39	68.93	OK
3485	2026-09-22 20:40	70.01	OK	3486	2026-09-22 20:41	69.70	OK
3487	2026-09-22 20:42	71.97	OK	3488	2026-09-22 20:43	70.93	OK
3489	2026-09-22 20:44	71.05	OK	3490	2026-09-22 20:45	69.17	OK
3491	2026-09-22 20:46	71.96	OK	3492	2026-09-22 20:47	69.43	OK
3493	2026-09-22 20:48	68.50	OK	3494	2026-09-22 20:49	70.69	OK
3495	2026-09-22 20:50	71.29	OK	3496	2026-09-22 20:51	69.01	OK
3497	2026-09-22 20:52	70.55	OK	3498	2026-09-22 20:53	68.75	OK
3499	2026-09-22 20:54	69.43	OK	3500	2026-09-22 20:55	71.00	OK
3501	2026-09-22 20:56	72.50	OK	3502	2026-09-22 20:57	70.73	OK
3503	2026-09-22 20:58	68.33	OK	3504	2026-09-22 20:59	71.04	OK
3505	2026-09-22 21:00	69.34	OK	3506	2026-09-22 21:01	67.75	OK
3507	2026-09-22 21:02	71.20	OK	3508	2026-09-22 21:03	70.19	OK
3509	2026-09-22 21:04	70.33	OK	3510	2026-09-22 21:05	68.77	OK
3511	2026-09-22 21:06	69.94	OK	3512	2026-09-22 21:07	70.38	OK
3513	2026-09-22 21:08	71.36	OK	3514	2026-09-22 21:09	70.24	OK
3515	2026-09-22 21:10	72.14	OK	3516	2026-09-22 21:11	72.00	OK
3517	2026-09-22 21:12	66.52	OK	3518	2026-09-22 21:13	68.03	OK
3519	2026-09-22 21:14	68.78	OK	3520	2026-09-22 21:15	69.86	OK
3521	2026-09-22 21:16	69.58	OK	3522	2026-09-22 21:17	67.48	OK
3523	2026-09-22 21:18	69.87	OK	3524	2026-09-22 21:19	68.61	OK
3525	2026-09-22 21:20	67.23	OK	3526	2026-09-22 21:21	70.10	OK
3527	2026-09-22 21:22	70.69	OK	3528	2026-09-22 21:23	69.97	OK
3529	2026-09-22 21:24	69.74	OK	3530	2026-09-22 21:25	69.98	OK
3531	2026-09-22 21:26	71.00	OK	3532	2026-09-22 21:27	69.51	OK
3533	2026-09-22 21:28	67.90	OK	3534	2026-09-22 21:29	68.62	OK
3535	2026-09-22 21:30	70.66	OK	3536	2026-09-22 21:31	67.91	OK
3537	2026-09-22 21:32	69.54	OK	3538	2026-09-22 21:33	69.90	OK
3539	2026-09-22 21:34	70.48	OK	3540	2026-09-22 21:35	69.36	OK
3541	2026-09-22 21:36	67.69	OK	3542	2026-09-22 21:37	70.34	OK
3543	2026-09-22 21:38	70.61	OK	3544	2026-09-22 21:39	70.37	OK
3545	2026-09-22 21:40	67.29	OK	3546	2026-09-22 21:41	68.30	OK
3547	2026-09-22 21:42	70.22	OK	3548	2026-09-22 21:43	70.04	OK
3549	2026-09-22 21:44	69.29	OK	3550	2026-09-22 21:45	66.83	OK
3551	2026-09-22 21:46	70.95	OK	3552	2026-09-22 21:47	68.77	OK
3553	2026-09-22 21:48	69.24	OK	3554	2026-09-22 21:49	68.10	OK
3555	2026-09-22 21:50	68.91	OK	3556	2026-09-22 21:51	69.24	OK
3557	2026-09-22 21:52	70.61	OK	3558	2026-09-22 21:53	72.71	OK
3559	2026-09-22 21:54	69.54	OK	3560	2026-09-22 21:55	68.20	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3561	2026-09-22 21:56	72.79	OK	3562	2026-09-22 21:57	68.70	OK
3563	2026-09-22 21:58	69.01	OK	3564	2026-09-22 21:59	68.61	OK
3565	2026-09-22 22:00	67.75	OK	3566	2026-09-22 22:01	71.03	OK
3567	2026-09-22 22:02	70.41	OK	3568	2026-09-22 22:03	66.59	OK
3569	2026-09-22 22:04	71.53	OK	3570	2026-09-22 22:05	67.62	OK
3571	2026-09-22 22:06	68.16	OK	3572	2026-09-22 22:07	68.55	OK
3573	2026-09-22 22:08	69.03	OK	3574	2026-09-22 22:09	67.93	OK
3575	2026-09-22 22:10	66.30	OK	3576	2026-09-22 22:11	69.12	OK
3577	2026-09-22 22:12	71.06	OK	3578	2026-09-22 22:13	66.39	OK
3579	2026-09-22 22:14	67.79	OK	3580	2026-09-22 22:15	68.27	OK
3581	2026-09-22 22:16	71.75	OK	3582	2026-09-22 22:17	68.99	OK
3583	2026-09-22 22:18	68.57	OK	3584	2026-09-22 22:19	67.10	OK
3585	2026-09-22 22:20	71.26	OK	3586	2026-09-22 22:21	70.19	OK
3587	2026-09-22 22:22	70.31	OK	3588	2026-09-22 22:23	67.72	OK
3589	2026-09-22 22:24	70.07	OK	3590	2026-09-22 22:25	69.14	OK
3591	2026-09-22 22:26	67.74	OK	3592	2026-09-22 22:27	69.29	OK
3593	2026-09-22 22:28	68.94	OK	3594	2026-09-22 22:29	66.42	OK
3595	2026-09-22 22:30	69.78	OK	3596	2026-09-22 22:31	68.88	OK
3597	2026-09-22 22:32	70.03	OK	3598	2026-09-22 22:33	68.99	OK
3599	2026-09-22 22:34	68.54	OK	3600	2026-09-22 22:35	67.98	OK
3601	2026-09-22 22:36	67.69	OK	3602	2026-09-22 22:37	72.03	OK
3603	2026-09-22 22:38	68.56	OK	3604	2026-09-22 22:39	68.86	OK
3605	2026-09-22 22:40	68.99	OK	3606	2026-09-22 22:41	67.51	OK
3607	2026-09-22 22:42	68.15	OK	3608	2026-09-22 22:43	71.14	OK
3609	2026-09-22 22:44	67.66	OK	3610	2026-09-22 22:45	71.53	OK
3611	2026-09-22 22:46	70.11	OK	3612	2026-09-22 22:47	67.08	OK
3613	2026-09-22 22:48	68.76	OK	3614	2026-09-22 22:49	66.64	OK
3615	2026-09-22 22:50	70.96	OK	3616	2026-09-22 22:51	67.84	OK
3617	2026-09-22 22:52	67.52	OK	3618	2026-09-22 22:53	69.33	OK
3619	2026-09-22 22:54	70.34	OK	3620	2026-09-22 22:55	67.72	OK
3621	2026-09-22 22:56	70.22	OK	3622	2026-09-22 22:57	67.49	OK
3623	2026-09-22 22:58	67.27	OK	3624	2026-09-22 22:59	68.02	OK
3625	2026-09-22 23:00	68.75	OK	3626	2026-09-22 23:01	69.49	OK
3627	2026-09-22 23:02	69.20	OK	3628	2026-09-22 23:03	67.28	OK
3629	2026-09-22 23:04	68.86	OK	3630	2026-09-22 23:05	66.16	OK
3631	2026-09-22 23:06	69.32	OK	3632	2026-09-22 23:07	65.41	OK
3633	2026-09-22 23:08	69.93	OK	3634	2026-09-22 23:09	66.47	OK
3635	2026-09-22 23:10	66.80	OK	3636	2026-09-22 23:11	63.99	OK
3637	2026-09-22 23:12	70.41	OK	3638	2026-09-22 23:13	67.15	OK
3639	2026-09-22 23:14	66.71	OK	3640	2026-09-22 23:15	67.37	OK
3641	2026-09-22 23:16	66.20	OK	3642	2026-09-22 23:17	67.34	OK
3643	2026-09-22 23:18	69.11	OK	3644	2026-09-22 23:19	66.75	OK
3645	2026-09-22 23:20	66.89	OK	3646	2026-09-22 23:21	68.22	OK
3647	2026-09-22 23:22	66.56	OK	3648	2026-09-22 23:23	67.72	OK
3649	2026-09-22 23:24	67.25	OK	3650	2026-09-22 23:25	68.62	OK
3651	2026-09-22 23:26	68.43	OK	3652	2026-09-22 23:27	69.62	OK
3653	2026-09-22 23:28	65.17	OK	3654	2026-09-22 23:29	64.17	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3655	2026-09-22 23:30	67.80	OK	3656	2026-09-22 23:31	67.75	OK
3657	2026-09-22 23:32	67.95	OK	3658	2026-09-22 23:33	69.40	OK
3659	2026-09-22 23:34	67.80	OK	3660	2026-09-22 23:35	67.40	OK
3661	2026-09-22 23:36	68.74	OK	3662	2026-09-22 23:37	67.39	OK
3663	2026-09-22 23:38	66.61	OK	3664	2026-09-22 23:39	66.97	OK
3665	2026-09-22 23:40	67.64	OK	3666	2026-09-22 23:41	68.98	OK
3667	2026-09-22 23:42	66.19	OK	3668	2026-09-22 23:43	66.70	OK
3669	2026-09-22 23:44	67.36	OK	3670	2026-09-22 23:45	63.72	OK
3671	2026-09-22 23:46	67.21	OK	3672	2026-09-22 23:47	69.13	OK
3673	2026-09-22 23:48	67.88	OK	3674	2026-09-22 23:49	69.86	OK
3675	2026-09-22 23:50	67.52	OK	3676	2026-09-22 23:51	66.84	OK
3677	2026-09-22 23:52	67.78	OK	3678	2026-09-22 23:53	68.07	OK
3679	2026-09-22 23:54	68.98	OK	3680	2026-09-22 23:55	68.95	OK
3681	2026-09-22 23:56	65.51	OK	3682	2026-09-22 23:57	67.80	OK
3683	2026-09-22 23:58	64.43	OK	3684	2026-09-22 23:59	67.00	OK
3685	2026-09-23 00:00	68.86	OK	3686	2026-09-23 00:01	66.39	OK
3687	2026-09-23 00:02	67.28	OK	3688	2026-09-23 00:03	68.82	OK
3689	2026-09-23 00:04	66.81	OK	3690	2026-09-23 00:05	68.71	OK
3691	2026-09-23 00:06	65.77	OK	3692	2026-09-23 00:07	67.78	OK
3693	2026-09-23 00:08	66.74	OK	3694	2026-09-23 00:09	66.40	OK
3695	2026-09-23 00:10	69.49	OK	3696	2026-09-23 00:11	68.77	OK
3697	2026-09-23 00:12	65.71	OK	3698	2026-09-23 00:13	62.88	OK
3699	2026-09-23 00:14	65.30	OK	3700	2026-09-23 00:15	66.77	OK
3701	2026-09-23 00:16	64.63	OK	3702	2026-09-23 00:17	65.22	OK
3703	2026-09-23 00:18	66.40	OK	3704	2026-09-23 00:19	65.36	OK
3705	2026-09-23 00:20	68.32	OK	3706	2026-09-23 00:21	68.12	OK
3707	2026-09-23 00:22	67.09	OK	3708	2026-09-23 00:23	63.27	OK
3709	2026-09-23 00:24	66.64	OK	3710	2026-09-23 00:25	65.13	OK
3711	2026-09-23 00:26	68.42	OK	3712	2026-09-23 00:27	65.91	OK
3713	2026-09-23 00:28	66.39	OK	3714	2026-09-23 00:29	69.76	OK
3715	2026-09-23 00:30	67.26	OK	3716	2026-09-23 00:31	64.89	OK
3717	2026-09-23 00:32	67.36	OK	3718	2026-09-23 00:33	66.50	OK
3719	2026-09-23 00:34	65.30	OK	3720	2026-09-23 00:35	66.74	OK
3721	2026-09-23 00:36	67.27	OK	3722	2026-09-23 00:37	67.45	OK
3723	2026-09-23 00:38	64.71	OK	3724	2026-09-23 00:39	66.27	OK
3725	2026-09-23 00:40	66.24	OK	3726	2026-09-23 00:41	66.89	OK
3727	2026-09-23 00:42	64.99	OK	3728	2026-09-23 00:43	64.34	OK
3729	2026-09-23 00:44	67.79	OK	3730	2026-09-23 00:45	65.78	OK
3731	2026-09-23 00:46	64.25	OK	3732	2026-09-23 00:47	63.73	OK
3733	2026-09-23 00:48	65.54	OK	3734	2026-09-23 00:49	65.55	OK
3735	2026-09-23 00:50	67.63	OK	3736	2026-09-23 00:51	66.75	OK
3737	2026-09-23 00:52	66.67	OK	3738	2026-09-23 00:53	67.24	OK
3739	2026-09-23 00:54	65.37	OK	3740	2026-09-23 00:55	68.91	OK
3741	2026-09-23 00:56	65.59	OK	3742	2026-09-23 00:57	67.39	OK
3743	2026-09-23 00:58	66.31	OK	3744	2026-09-23 00:59	67.97	OK
3745	2026-09-23 01:00	65.60	OK	3746	2026-09-23 01:01	65.48	OK
3747	2026-09-23 01:02	63.25	OK	3748	2026-09-23 01:03	65.58	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3749	2026-09-23 01:04	66.12	OK	3750	2026-09-23 01:05	66.52	OK
3751	2026-09-23 01:06	68.82	OK	3752	2026-09-23 01:07	64.10	OK
3753	2026-09-23 01:08	67.07	OK	3754	2026-09-23 01:09	65.53	OK
3755	2026-09-23 01:10	65.95	OK	3756	2026-09-23 01:11	64.26	OK
3757	2026-09-23 01:12	66.98	OK	3758	2026-09-23 01:13	65.41	OK
3759	2026-09-23 01:14	64.08	OK	3760	2026-09-23 01:15	64.83	OK
3761	2026-09-23 01:16	65.86	OK	3762	2026-09-23 01:17	66.25	OK
3763	2026-09-23 01:18	63.86	OK	3764	2026-09-23 01:19	66.02	OK
3765	2026-09-23 01:20	66.42	OK	3766	2026-09-23 01:21	65.63	OK
3767	2026-09-23 01:22	65.80	OK	3768	2026-09-23 01:23	67.81	OK
3769	2026-09-23 01:24	65.66	OK	3770	2026-09-23 01:25	65.03	OK
3771	2026-09-23 01:26	65.74	OK	3772	2026-09-23 01:27	64.33	OK
3773	2026-09-23 01:28	61.82	OK	3774	2026-09-23 01:29	64.65	OK
3775	2026-09-23 01:30	62.77	OK	3776	2026-09-23 01:31	61.83	OK
3777	2026-09-23 01:32	65.42	OK	3778	2026-09-23 01:33	63.66	OK
3779	2026-09-23 01:34	63.81	OK	3780	2026-09-23 01:35	65.52	OK
3781	2026-09-23 01:36	63.31	OK	3782	2026-09-23 01:37	62.48	OK
3783	2026-09-23 01:38	64.53	OK	3784	2026-09-23 01:39	63.76	OK
3785	2026-09-23 01:40	62.85	OK	3786	2026-09-23 01:41	67.20	OK
3787	2026-09-23 01:42	63.50	OK	3788	2026-09-23 01:43	65.76	OK
3789	2026-09-23 01:44	63.48	OK	3790	2026-09-23 01:45	63.92	OK
3791	2026-09-23 01:46	67.17	OK	3792	2026-09-23 01:47	64.46	OK
3793	2026-09-23 01:48	67.25	OK	3794	2026-09-23 01:49	63.90	OK
3795	2026-09-23 01:50	62.79	OK	3796	2026-09-23 01:51	61.35	OK
3797	2026-09-23 01:52	65.83	OK	3798	2026-09-23 01:53	63.59	OK
3799	2026-09-23 01:54	62.01	OK	3800	2026-09-23 01:55	63.30	OK
3801	2026-09-23 01:56	64.93	OK	3802	2026-09-23 01:57	64.38	OK
3803	2026-09-23 01:58	61.54	OK	3804	2026-09-23 01:59	61.49	OK
3805	2026-09-23 02:00	65.45	OK	3806	2026-09-23 02:01	65.06	OK
3807	2026-09-23 02:02	62.42	OK	3808	2026-09-23 02:03	65.87	OK
3809	2026-09-23 02:04	63.41	OK	3810	2026-09-23 02:05	66.95	OK
3811	2026-09-23 02:06	62.29	OK	3812	2026-09-23 02:07	63.49	OK
3813	2026-09-23 02:08	66.17	OK	3814	2026-09-23 02:09	63.34	OK
3815	2026-09-23 02:10	65.36	OK	3816	2026-09-23 02:11	64.11	OK
3817	2026-09-23 02:12	64.36	OK	3818	2026-09-23 02:13	62.35	OK
3819	2026-09-23 02:14	64.67	OK	3820	2026-09-23 02:15	64.27	OK
3821	2026-09-23 02:16	64.47	OK	3822	2026-09-23 02:17	61.43	OK
3823	2026-09-23 02:18	61.48	OK	3824	2026-09-23 02:19	65.23	OK
3825	2026-09-23 02:20	64.22	OK	3826	2026-09-23 02:21	64.37	OK
3827	2026-09-23 02:22	63.72	OK	3828	2026-09-23 02:23	63.92	OK
3829	2026-09-23 02:24	61.69	OK	3830	2026-09-23 02:25	62.70	OK
3831	2026-09-23 02:26	64.38	OK	3832	2026-09-23 02:27	60.15	OK
3833	2026-09-23 02:28	61.96	OK	3834	2026-09-23 02:29	64.35	OK
3835	2026-09-23 02:30	61.74	OK	3836	2026-09-23 02:31	62.43	OK
3837	2026-09-23 02:32	62.40	OK	3838	2026-09-23 02:33	62.87	OK
3839	2026-09-23 02:34	62.15	OK	3840	2026-09-23 02:35	61.65	OK
3841	2026-09-23 02:36	59.00	OK	3842	2026-09-23 02:37	64.27	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3843	2026-09-23 02:38	62.57	OK	3844	2026-09-23 02:39	60.40	OK
3845	2026-09-23 02:40	64.54	OK	3846	2026-09-23 02:41	61.56	OK
3847	2026-09-23 02:42	63.48	OK	3848	2026-09-23 02:43	61.08	OK
3849	2026-09-23 02:44	60.25	OK	3850	2026-09-23 02:45	60.07	OK
3851	2026-09-23 02:46	65.11	OK	3852	2026-09-23 02:47	64.25	OK
3853	2026-09-23 02:48	65.33	OK	3854	2026-09-23 02:49	63.19	OK
3855	2026-09-23 02:50	64.33	OK	3856	2026-09-23 02:51	64.23	OK
3857	2026-09-23 02:52	60.55	OK	3858	2026-09-23 02:53	62.19	OK
3859	2026-09-23 02:54	61.19	OK	3860	2026-09-23 02:55	64.43	OK
3861	2026-09-23 02:56	63.44	OK	3862	2026-09-23 02:57	62.55	OK
3863	2026-09-23 02:58	65.31	OK	3864	2026-09-23 02:59	60.40	OK
3865	2026-09-23 03:00	61.15	OK	3866	2026-09-23 03:01	61.82	OK
3867	2026-09-23 03:02	61.94	OK	3868	2026-09-23 03:03	62.51	OK
3869	2026-09-23 03:04	62.44	OK	3870	2026-09-23 03:05	61.60	OK
3871	2026-09-23 03:06	60.66	OK	3872	2026-09-23 03:07	63.01	OK
3873	2026-09-23 03:08	61.54	OK	3874	2026-09-23 03:09	63.22	OK
3875	2026-09-23 03:10	61.14	OK	3876	2026-09-23 03:11	65.11	OK
3877	2026-09-23 03:12	58.59	OK	3878	2026-09-23 03:13	61.52	OK
3879	2026-09-23 03:14	62.23	OK	3880	2026-09-23 03:15	63.29	OK
3881	2026-09-23 03:16	63.40	OK	3882	2026-09-23 03:17	61.81	OK
3883	2026-09-23 03:18	60.89	OK	3884	2026-09-23 03:19	61.78	OK
3885	2026-09-23 03:20	60.64	OK	3886	2026-09-23 03:21	62.18	OK
3887	2026-09-23 03:22	62.49	OK	3888	2026-09-23 03:23	62.40	OK
3889	2026-09-23 03:24	62.42	OK	3890	2026-09-23 03:25	61.79	OK
3891	2026-09-23 03:26	61.28	OK	3892	2026-09-23 03:27	63.40	OK
3893	2026-09-23 03:28	60.23	OK	3894	2026-09-23 03:29	58.53	OK
3895	2026-09-23 03:30	61.49	OK	3896	2026-09-23 03:31	62.27	OK
3897	2026-09-23 03:32	64.88	OK	3898	2026-09-23 03:33	61.08	OK
3899	2026-09-23 03:34	60.77	OK	3900	2026-09-23 03:35	62.58	OK
3901	2026-09-23 03:36	60.70	OK	3902	2026-09-23 03:37	61.40	OK
3903	2026-09-23 03:38	58.73	OK	3904	2026-09-23 03:39	61.27	OK
3905	2026-09-23 03:40	61.14	OK	3906	2026-09-23 03:41	62.89	OK
3907	2026-09-23 03:42	62.69	OK	3908	2026-09-23 03:43	61.63	OK
3909	2026-09-23 03:44	63.04	OK	3910	2026-09-23 03:45	61.84	OK
3911	2026-09-23 03:46	62.72	OK	3912	2026-09-23 03:47	62.16	OK
3913	2026-09-23 03:48	61.81	OK	3914	2026-09-23 03:49	60.43	OK
3915	2026-09-23 03:50	63.12	OK	3916	2026-09-23 03:51	59.84	OK
3917	2026-09-23 03:52	64.13	OK	3918	2026-09-23 03:53	62.84	OK
3919	2026-09-23 03:54	58.28	OK	3920	2026-09-23 03:55	61.98	OK
3921	2026-09-23 03:56	60.21	OK	3922	2026-09-23 03:57	60.59	OK
3923	2026-09-23 03:58	59.74	OK	3924	2026-09-23 03:59	58.51	OK
3925	2026-09-23 04:00	62.67	OK	3926	2026-09-23 04:01	62.45	OK
3927	2026-09-23 04:02	61.36	OK	3928	2026-09-23 04:03	58.62	OK
3929	2026-09-23 04:04	59.84	OK	3930	2026-09-23 04:05	61.20	OK
3931	2026-09-23 04:06	60.12	OK	3932	2026-09-23 04:07	59.00	OK
3933	2026-09-23 04:08	59.58	OK	3934	2026-09-23 04:09	62.53	OK
3935	2026-09-23 04:10	60.95	OK	3936	2026-09-23 04:11	59.56	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3937	2026-09-23 04:12	63.18	OK	3938	2026-09-23 04:13	62.85	OK
3939	2026-09-23 04:14	62.03	OK	3940	2026-09-23 04:15	60.51	OK
3941	2026-09-23 04:16	60.37	OK	3942	2026-09-23 04:17	62.21	OK
3943	2026-09-23 04:18	62.27	OK	3944	2026-09-23 04:19	58.48	OK
3945	2026-09-23 04:20	60.51	OK	3946	2026-09-23 04:21	62.89	OK
3947	2026-09-23 04:22	59.78	OK	3948	2026-09-23 04:23	59.30	OK
3949	2026-09-23 04:24	57.83	OK	3950	2026-09-23 04:25	60.30	OK
3951	2026-09-23 04:26	60.91	OK	3952	2026-09-23 04:27	59.81	OK
3953	2026-09-23 04:28	61.63	OK	3954	2026-09-23 04:29	59.39	OK
3955	2026-09-23 04:30	64.02	OK	3956	2026-09-23 04:31	59.61	OK
3957	2026-09-23 04:32	61.70	OK	3958	2026-09-23 04:33	60.66	OK
3959	2026-09-23 04:34	60.52	OK	3960	2026-09-23 04:35	59.87	OK
3961	2026-09-23 04:36	59.07	OK	3962	2026-09-23 04:37	61.71	OK
3963	2026-09-23 04:38	60.04	OK	3964	2026-09-23 04:39	58.31	OK
3965	2026-09-23 04:40	60.09	OK	3966	2026-09-23 04:41	57.13	OK
3967	2026-09-23 04:42	60.74	OK	3968	2026-09-23 04:43	60.12	OK
3969	2026-09-23 04:44	62.86	OK	3970	2026-09-23 04:45	60.24	OK
3971	2026-09-23 04:46	60.72	OK	3972	2026-09-23 04:47	59.95	OK
3973	2026-09-23 04:48	60.12	OK	3974	2026-09-23 04:49	58.93	OK
3975	2026-09-23 04:50	58.75	OK	3976	2026-09-23 04:51	59.67	OK
3977	2026-09-23 04:52	57.65	OK	3978	2026-09-23 04:53	60.95	OK
3979	2026-09-23 04:54	59.72	OK	3980	2026-09-23 04:55	61.02	OK
3981	2026-09-23 04:56	57.86	OK	3982	2026-09-23 04:57	61.85	OK
3983	2026-09-23 04:58	58.60	OK	3984	2026-09-23 04:59	60.40	OK
3985	2026-09-23 05:00	58.66	OK	3986	2026-09-23 05:01	61.06	OK
3987	2026-09-23 05:02	59.92	OK	3988	2026-09-23 05:03	61.52	OK
3989	2026-09-23 05:04	59.94	OK	3990	2026-09-23 05:05	59.18	OK
3991	2026-09-23 05:06	61.60	OK	3992	2026-09-23 05:07	60.14	OK
3993	2026-09-23 05:08	61.42	OK	3994	2026-09-23 05:09	62.52	OK
3995	2026-09-23 05:10	59.53	OK	3996	2026-09-23 05:11	59.66	OK
3997	2026-09-23 05:12	59.41	OK	3998	2026-09-23 05:13	61.42	OK
3999	2026-09-23 05:14	58.20	OK	4000	2026-09-23 05:15	57.16	OK
4001	2026-09-23 05:16	58.61	OK	4002	2026-09-23 05:17	59.63	OK
4003	2026-09-23 05:18	59.90	OK	4004	2026-09-23 05:19	62.55	OK
4005	2026-09-23 05:20	58.92	OK	4006	2026-09-23 05:21	57.70	OK
4007	2026-09-23 05:22	58.08	OK	4008	2026-09-23 05:23	61.16	OK
4009	2026-09-23 05:24	56.69	OK	4010	2026-09-23 05:25	59.79	OK
4011	2026-09-23 05:26	58.85	OK	4012	2026-09-23 05:27	61.82	OK
4013	2026-09-23 05:28	60.39	OK	4014	2026-09-23 05:29	61.74	OK
4015	2026-09-23 05:30	59.62	OK	4016	2026-09-23 05:31	59.17	OK
4017	2026-09-23 05:32	57.42	OK	4018	2026-09-23 05:33	59.96	OK
4019	2026-09-23 05:34	60.99	OK	4020	2026-09-23 05:35	59.32	OK
4021	2026-09-23 05:36	59.31	OK	4022	2026-09-23 05:37	57.51	OK
4023	2026-09-23 05:38	62.28	OK	4024	2026-09-23 05:39	58.72	OK
4025	2026-09-23 05:40	56.65	OK	4026	2026-09-23 05:41	59.46	OK
4027	2026-09-23 05:42	61.82	OK	4028	2026-09-23 05:43	60.00	OK
4029	2026-09-23 05:44	58.26	OK	4030	2026-09-23 05:45	58.25	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4031	2026-09-23 05:46	61.61	OK	4032	2026-09-23 05:47	57.48	OK
4033	2026-09-23 05:48	60.91	OK	4034	2026-09-23 05:49	61.75	OK
4035	2026-09-23 05:50	58.64	OK	4036	2026-09-23 05:51	58.24	OK
4037	2026-09-23 05:52	58.81	OK	4038	2026-09-23 05:53	59.82	OK
4039	2026-09-23 05:54	60.00	OK	4040	2026-09-23 05:55	58.72	OK
4041	2026-09-23 05:56	60.52	OK	4042	2026-09-23 05:57	57.90	OK
4043	2026-09-23 05:58	63.31	OK	4044	2026-09-23 05:59	60.64	OK
4045	2026-09-23 06:00	60.15	OK	4046	2026-09-23 06:01	59.06	OK
4047	2026-09-23 06:02	59.53	OK	4048	2026-09-23 06:03	59.39	OK
4049	2026-09-23 06:04	58.70	OK	4050	2026-09-23 06:05	59.61	OK
4051	2026-09-23 06:06	61.43	OK	4052	2026-09-23 06:07	62.13	OK
4053	2026-09-23 06:08	60.32	OK	4054	2026-09-23 06:09	57.16	OK
4055	2026-09-23 06:10	59.06	OK	4056	2026-09-23 06:11	61.24	OK
4057	2026-09-23 06:12	59.02	OK	4058	2026-09-23 06:13	57.28	OK
4059	2026-09-23 06:14	62.36	OK	4060	2026-09-23 06:15	59.86	OK
4061	2026-09-23 06:16	59.39	OK	4062	2026-09-23 06:17	58.51	OK
4063	2026-09-23 06:18	59.79	OK	4064	2026-09-23 06:19	57.74	OK
4065	2026-09-23 06:20	60.93	OK	4066	2026-09-23 06:21	60.31	OK
4067	2026-09-23 06:22	58.90	OK	4068	2026-09-23 06:23	58.16	OK
4069	2026-09-23 06:24	59.59	OK	4070	2026-09-23 06:25	59.95	OK
4071	2026-09-23 06:26	57.95	OK	4072	2026-09-23 06:27	59.92	OK
4073	2026-09-23 06:28	60.39	OK	4074	2026-09-23 06:29	59.86	OK
4075	2026-09-23 06:30	58.52	OK	4076	2026-09-23 06:31	58.93	OK
4077	2026-09-23 06:32	59.10	OK	4078	2026-09-23 06:33	59.68	OK
4079	2026-09-23 06:34	57.81	OK	4080	2026-09-23 06:35	59.24	OK
4081	2026-09-23 06:36	57.46	OK	4082	2026-09-23 06:37	60.11	OK
4083	2026-09-23 06:38	59.93	OK	4084	2026-09-23 06:39	56.36	OK
4085	2026-09-23 06:40	60.22	OK	4086	2026-09-23 06:41	58.72	OK
4087	2026-09-23 06:42	56.93	OK	4088	2026-09-23 06:43	60.93	OK
4089	2026-09-23 06:44	57.98	OK	4090	2026-09-23 06:45	58.61	OK
4091	2026-09-23 06:46	57.81	OK	4092	2026-09-23 06:47	60.84	OK
4093	2026-09-23 06:48	62.07	OK	4094	2026-09-23 06:49	60.15	OK
4095	2026-09-23 06:50	59.17	OK	4096	2026-09-23 06:51	59.79	OK
4097	2026-09-23 06:52	59.82	OK	4098	2026-09-23 06:53	60.59	OK
4099	2026-09-23 06:54	58.80	OK	4100	2026-09-23 06:55	59.37	OK
4101	2026-09-23 06:56	60.13	OK	4102	2026-09-23 06:57	61.51	OK
4103	2026-09-23 06:58	57.83	OK	4104	2026-09-23 06:59	56.64	OK
4105	2026-09-23 07:00	62.39	OK	4106	2026-09-23 07:01	57.56	OK
4107	2026-09-23 07:02	58.61	OK	4108	2026-09-23 07:03	56.49	OK
4109	2026-09-23 07:04	59.08	OK	4110	2026-09-23 07:05	57.95	OK
4111	2026-09-23 07:06	57.43	OK	4112	2026-09-23 07:07	61.69	OK
4113	2026-09-23 07:08	59.63	OK	4114	2026-09-23 07:09	59.67	OK
4115	2026-09-23 07:10	58.04	OK	4116	2026-09-23 07:11	58.07	OK
4117	2026-09-23 07:12	59.52	OK	4118	2026-09-23 07:13	59.27	OK
4119	2026-09-23 07:14	56.81	OK	4120	2026-09-23 07:15	58.32	OK
4121	2026-09-23 07:16	58.07	OK	4122	2026-09-23 07:17	62.54	OK
4123	2026-09-23 07:18	60.27	OK	4124	2026-09-23 07:19	58.68	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4125	2026-09-23 07:20	59.24	OK	4126	2026-09-23 07:21	61.47	OK
4127	2026-09-23 07:22	59.86	OK	4128	2026-09-23 07:23	61.30	OK
4129	2026-09-23 07:24	59.10	OK	4130	2026-09-23 07:25	59.28	OK
4131	2026-09-23 07:26	59.23	OK	4132	2026-09-23 07:27	61.38	OK
4133	2026-09-23 07:28	59.85	OK	4134	2026-09-23 07:29	60.03	OK
4135	2026-09-23 07:30	57.38	OK	4136	2026-09-23 07:31	61.64	OK
4137	2026-09-23 07:32	57.92	OK	4138	2026-09-23 07:33	60.82	OK
4139	2026-09-23 07:34	58.21	OK	4140	2026-09-23 07:35	60.86	OK
4141	2026-09-23 07:36	57.95	OK	4142	2026-09-23 07:37	60.01	OK
4143	2026-09-23 07:38	58.64	OK	4144	2026-09-23 07:39	56.70	OK
4145	2026-09-23 07:40	57.73	OK	4146	2026-09-23 07:41	59.16	OK
4147	2026-09-23 07:42	59.04	OK	4148	2026-09-23 07:43	59.66	OK
4149	2026-09-23 07:44	57.82	OK	4150	2026-09-23 07:45	58.50	OK
4151	2026-09-23 07:46	58.37	OK	4152	2026-09-23 07:47	60.44	OK
4153	2026-09-23 07:48	60.60	OK	4154	2026-09-23 07:49	61.71	OK
4155	2026-09-23 07:50	58.04	OK	4156	2026-09-23 07:51	59.45	OK
4157	2026-09-23 07:52	58.33	OK	4158	2026-09-23 07:53	59.23	OK
4159	2026-09-23 07:54	59.17	OK	4160	2026-09-23 07:55	57.80	OK
4161	2026-09-23 07:56	60.40	OK	4162	2026-09-23 07:57	57.93	OK
4163	2026-09-23 07:58	58.57	OK	4164	2026-09-23 07:59	57.52	OK
4165	2026-09-23 08:00	61.34	OK	4166	2026-09-23 08:01	58.95	OK
4167	2026-09-23 08:02	62.82	OK	4168	2026-09-23 08:03	56.92	OK
4169	2026-09-23 08:04	59.64	OK	4170	2026-09-23 08:05	62.35	OK
4171	2026-09-23 08:06	58.47	OK	4172	2026-09-23 08:07	61.44	OK
4173	2026-09-23 08:08	60.70	OK	4174	2026-09-23 08:09	60.17	OK
4175	2026-09-23 08:10	57.35	OK	4176	2026-09-23 08:11	60.02	OK
4177	2026-09-23 08:12	60.10	OK	4178	2026-09-23 08:13	58.72	OK
4179	2026-09-23 08:14	57.78	OK	4180	2026-09-23 08:15	60.06	OK
4181	2026-09-23 08:16	59.62	OK	4182	2026-09-23 08:17	60.53	OK
4183	2026-09-23 08:18	57.34	OK	4184	2026-09-23 08:19	59.99	OK
4185	2026-09-23 08:20	57.63	OK	4186	2026-09-23 08:21	57.51	OK
4187	2026-09-23 08:22	56.96	OK	4188	2026-09-23 08:23	59.59	OK
4189	2026-09-23 08:24	59.36	OK	4190	2026-09-23 08:25	56.93	OK
4191	2026-09-23 08:26	57.31	OK	4192	2026-09-23 08:27	58.46	OK
4193	2026-09-23 08:28	60.63	OK	4194	2026-09-23 08:29	62.15	OK
4195	2026-09-23 08:30	57.90	OK	4196	2026-09-23 08:31	58.07	OK
4197	2026-09-23 08:32	60.61	OK	4198	2026-09-23 08:33	61.23	OK
4199	2026-09-23 08:34	59.76	OK	4200	2026-09-23 08:35	58.54	OK
4201	2026-09-23 08:36	58.62	OK	4202	2026-09-23 08:37	59.65	OK
4203	2026-09-23 08:38	59.14	OK	4204	2026-09-23 08:39	58.11	OK
4205	2026-09-23 08:40	62.76	OK	4206	2026-09-23 08:41	60.54	OK
4207	2026-09-23 08:42	59.53	OK	4208	2026-09-23 08:43	61.80	OK
4209	2026-09-23 08:44	60.95	OK	4210	2026-09-23 08:45	58.41	OK
4211	2026-09-23 08:46	59.80	OK	4212	2026-09-23 08:47	60.75	OK
4213	2026-09-23 08:48	60.51	OK	4214	2026-09-23 08:49	60.88	OK
4215	2026-09-23 08:50	58.56	OK	4216	2026-09-23 08:51	59.98	OK
4217	2026-09-23 08:52	60.42	OK	4218	2026-09-23 08:53	59.71	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4219	2026-09-23 08:54	56.38	OK	4220	2026-09-23 08:55	60.69	OK
4221	2026-09-23 08:56	62.20	OK	4222	2026-09-23 08:57	60.48	OK
4223	2026-09-23 08:58	59.96	OK	4224	2026-09-23 08:59	58.87	OK
4225	2026-09-23 09:00	61.24	OK	4226	2026-09-23 09:01	57.61	OK
4227	2026-09-23 09:02	58.84	OK	4228	2026-09-23 09:03	60.46	OK
4229	2026-09-23 09:04	61.19	OK	4230	2026-09-23 09:05	59.70	OK
4231	2026-09-23 09:06	62.37	OK	4232	2026-09-23 09:07	59.83	OK
4233	2026-09-23 09:08	58.44	OK	4234	2026-09-23 09:09	59.24	OK
4235	2026-09-23 09:10	59.07	OK	4236	2026-09-23 09:11	58.87	OK
4237	2026-09-23 09:12	58.60	OK	4238	2026-09-23 09:13	59.88	OK
4239	2026-09-23 09:14	61.64	OK	4240	2026-09-23 09:15	60.04	OK
4241	2026-09-23 09:16	59.53	OK	4242	2026-09-23 09:17	61.70	OK
4243	2026-09-23 09:18	62.68	OK	4244	2026-09-23 09:19	60.47	OK
4245	2026-09-23 09:20	57.34	OK	4246	2026-09-23 09:21	57.10	OK
4247	2026-09-23 09:22	62.63	OK	4248	2026-09-23 09:23	61.28	OK
4249	2026-09-23 09:24	60.21	OK	4250	2026-09-23 09:25	59.59	OK
4251	2026-09-23 09:26	59.65	OK	4252	2026-09-23 09:27	58.04	OK
4253	2026-09-23 09:28	59.68	OK	4254	2026-09-23 09:29	60.43	OK
4255	2026-09-23 09:30	59.32	OK	4256	2026-09-23 09:31	59.51	OK
4257	2026-09-23 09:32	60.46	OK	4258	2026-09-23 09:33	59.79	OK
4259	2026-09-23 09:34	59.44	OK	4260	2026-09-23 09:35	61.98	OK
4261	2026-09-23 09:36	60.06	OK	4262	2026-09-23 09:37	60.02	OK
4263	2026-09-23 09:38	57.31	OK	4264	2026-09-23 09:39	57.82	OK
4265	2026-09-23 09:40	59.84	OK	4266	2026-09-23 09:41	58.09	OK
4267	2026-09-23 09:42	59.44	OK	4268	2026-09-23 09:43	60.67	OK
4269	2026-09-23 09:44	59.60	OK	4270	2026-09-23 09:45	62.15	OK
4271	2026-09-23 09:46	60.31	OK	4272	2026-09-23 09:47	60.61	OK
4273	2026-09-23 09:48	58.90	OK	4274	2026-09-23 09:49	61.62	OK
4275	2026-09-23 09:50	57.02	OK	4276	2026-09-23 09:51	60.56	OK
4277	2026-09-23 09:52	60.71	OK	4278	2026-09-23 09:53	60.12	OK
4279	2026-09-23 09:54	60.38	OK	4280	2026-09-23 09:55	60.86	OK
4281	2026-09-23 09:56	61.74	OK	4282	2026-09-23 09:57	61.15	OK
4283	2026-09-23 09:58	58.57	OK	4284	2026-09-23 09:59	60.36	OK
4285	2026-09-23 10:00	59.66	OK	4286	2026-09-23 10:01	62.06	OK
4287	2026-09-23 10:02	62.74	OK	4288	2026-09-23 10:03	60.53	OK
4289	2026-09-23 10:04	59.18	OK	4290	2026-09-23 10:05	60.68	OK
4291	2026-09-23 10:06	62.53	OK	4292	2026-09-23 10:07	59.93	OK
4293	2026-09-23 10:08	57.58	OK	4294	2026-09-23 10:09	59.40	OK
4295	2026-09-23 10:10	61.08	OK	4296	2026-09-23 10:11	60.55	OK
4297	2026-09-23 10:12	63.09	OK	4298	2026-09-23 10:13	62.74	OK
4299	2026-09-23 10:14	60.64	OK	4300	2026-09-23 10:15	58.55	OK
4301	2026-09-23 10:16	59.38	OK	4302	2026-09-23 10:17	58.06	OK
4303	2026-09-23 10:18	60.30	OK	4304	2026-09-23 10:19	60.68	OK
4305	2026-09-23 10:20	59.56	OK	4306	2026-09-23 10:21	60.04	OK
4307	2026-09-23 10:22	58.02	OK	4308	2026-09-23 10:23	62.65	OK
4309	2026-09-23 10:24	59.74	OK	4310	2026-09-23 10:25	61.91	OK
4311	2026-09-23 10:26	60.97	OK	4312	2026-09-23 10:27	62.46	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4313	2026-09-23 10:28	57.81	OK	4314	2026-09-23 10:29	61.49	OK
4315	2026-09-23 10:30	60.55	OK	4316	2026-09-23 10:31	58.30	OK
4317	2026-09-23 10:32	61.99	OK	4318	2026-09-23 10:33	60.28	OK
4319	2026-09-23 10:34	59.70	OK	4320	2026-09-23 10:35	60.00	OK
4321	2026-09-23 10:36	59.03	OK	4322	2026-09-23 10:37	62.66	OK
4323	2026-09-23 10:38	59.96	OK	4324	2026-09-23 10:39	61.22	OK
4325	2026-09-23 10:40	63.16	OK	4326	2026-09-23 10:41	60.81	OK
4327	2026-09-23 10:42	61.72	OK	4328	2026-09-23 10:43	61.93	OK
4329	2026-09-23 10:44	62.06	OK	4330	2026-09-23 10:45	61.99	OK
4331	2026-09-23 10:46	58.98	OK	4332	2026-09-23 10:47	60.95	OK
4333	2026-09-23 10:48	59.98	OK	4334	2026-09-23 10:49	58.42	OK
4335	2026-09-23 10:50	60.71	OK	4336	2026-09-23 10:51	60.54	OK
4337	2026-09-23 10:52	60.85	OK	4338	2026-09-23 10:53	60.58	OK
4339	2026-09-23 10:54	63.26	OK	4340	2026-09-23 10:55	58.96	OK
4341	2026-09-23 10:56	61.40	OK	4342	2026-09-23 10:57	63.81	OK
4343	2026-09-23 10:58	60.79	OK	4344	2026-09-23 10:59	61.33	OK
4345	2026-09-23 11:00	59.36	OK	4346	2026-09-23 11:01	61.89	OK
4347	2026-09-23 11:02	59.00	OK	4348	2026-09-23 11:03	62.46	OK
4349	2026-09-23 11:04	60.47	OK	4350	2026-09-23 11:05	60.73	OK
4351	2026-09-23 11:06	61.84	OK	4352	2026-09-23 11:07	61.53	OK
4353	2026-09-23 11:08	61.89	OK	4354	2026-09-23 11:09	63.45	OK
4355	2026-09-23 11:10	61.45	OK	4356	2026-09-23 11:11	62.66	OK
4357	2026-09-23 11:12	61.90	OK	4358	2026-09-23 11:13	62.93	OK
4359	2026-09-23 11:14	63.71	OK	4360	2026-09-23 11:15	63.69	OK
4361	2026-09-23 11:16	61.01	OK	4362	2026-09-23 11:17	63.17	OK
4363	2026-09-23 11:18	64.78	OK	4364	2026-09-23 11:19	65.69	OK
4365	2026-09-23 11:20	61.12	OK	4366	2026-09-23 11:21	64.03	OK
4367	2026-09-23 11:22	60.90	OK	4368	2026-09-23 11:23	61.18	OK
4369	2026-09-23 11:24	64.90	OK	4370	2026-09-23 11:25	59.32	OK
4371	2026-09-23 11:26	61.47	OK	4372	2026-09-23 11:27	62.05	OK
4373	2026-09-23 11:28	63.58	OK	4374	2026-09-23 11:29	61.69	OK
4375	2026-09-23 11:30	64.05	OK	4376	2026-09-23 11:31	62.84	OK
4377	2026-09-23 11:32	62.36	OK	4378	2026-09-23 11:33	63.62	OK
4379	2026-09-23 11:34	63.16	OK	4380	2026-09-23 11:35	64.51	OK
4381	2026-09-23 11:36	63.50	OK	4382	2026-09-23 11:37	63.65	OK
4383	2026-09-23 11:38	59.53	OK	4384	2026-09-23 11:39	61.91	OK
4385	2026-09-23 11:40	61.28	OK	4386	2026-09-23 11:41	60.34	OK
4387	2026-09-23 11:42	63.74	OK	4388	2026-09-23 11:43	63.20	OK
4389	2026-09-23 11:44	63.61	OK	4390	2026-09-23 11:45	62.03	OK
4391	2026-09-23 11:46	63.02	OK	4392	2026-09-23 11:47	63.69	OK
4393	2026-09-23 11:48	63.53	OK	4394	2026-09-23 11:49	61.74	OK
4395	2026-09-23 11:50	62.65	OK	4396	2026-09-23 11:51	63.35	OK
4397	2026-09-23 11:52	60.40	OK	4398	2026-09-23 11:53	63.78	OK
4399	2026-09-23 11:54	60.75	OK	4400	2026-09-23 11:55	63.30	OK
4401	2026-09-23 11:56	63.01	OK	4402	2026-09-23 11:57	61.72	OK
4403	2026-09-23 11:58	61.60	OK	4404	2026-09-23 11:59	65.20	OK
4405	2026-09-23 12:00	62.41	OK	4406	2026-09-23 12:01	63.36	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4407	2026-09-23 12:02	64.61	OK	4408	2026-09-23 12:03	63.72	OK
4409	2026-09-23 12:04	62.63	OK	4410	2026-09-23 12:05	62.98	OK
4411	2026-09-23 12:06	64.56	OK	4412	2026-09-23 12:07	63.25	OK
4413	2026-09-23 12:08	60.84	OK	4414	2026-09-23 12:09	63.10	OK
4415	2026-09-23 12:10	61.74	OK	4416	2026-09-23 12:11	62.66	OK
4417	2026-09-23 12:12	61.96	OK	4418	2026-09-23 12:13	64.79	OK
4419	2026-09-23 12:14	61.23	OK	4420	2026-09-23 12:15	62.73	OK
4421	2026-09-23 12:16	62.50	OK	4422	2026-09-23 12:17	62.52	OK
4423	2026-09-23 12:18	67.00	OK	4424	2026-09-23 12:19	63.72	OK
4425	2026-09-23 12:20	63.92	OK	4426	2026-09-23 12:21	62.47	OK
4427	2026-09-23 12:22	64.03	OK	4428	2026-09-23 12:23	61.36	OK
4429	2026-09-23 12:24	62.98	OK	4430	2026-09-23 12:25	62.47	OK
4431	2026-09-23 12:26	65.58	OK	4432	2026-09-23 12:27	64.64	OK
4433	2026-09-23 12:28	63.79	OK	4434	2026-09-23 12:29	61.81	OK
4435	2026-09-23 12:30	66.58	OK	4436	2026-09-23 12:31	62.30	OK
4437	2026-09-23 12:32	63.17	OK	4438	2026-09-23 12:33	65.79	OK
4439	2026-09-23 12:34	64.04	OK	4440	2026-09-23 12:35	62.52	OK
4441	2026-09-23 12:36	63.53	OK	4442	2026-09-23 12:37	63.97	OK
4443	2026-09-23 12:38	65.18	OK	4444	2026-09-23 12:39	65.15	OK
4445	2026-09-23 12:40	64.59	OK	4446	2026-09-23 12:41	64.50	OK
4447	2026-09-23 12:42	64.57	OK	4448	2026-09-23 12:43	61.26	OK
4449	2026-09-23 12:44	63.77	OK	4450	2026-09-23 12:45	64.31	OK
4451	2026-09-23 12:46	62.91	OK	4452	2026-09-23 12:47	64.36	OK
4453	2026-09-23 12:48	62.91	OK	4454	2026-09-23 12:49	61.89	OK
4455	2026-09-23 12:50	65.09	OK	4456	2026-09-23 12:51	65.15	OK
4457	2026-09-23 12:52	62.71	OK	4458	2026-09-23 12:53	64.75	OK
4459	2026-09-23 12:54	63.79	OK	4460	2026-09-23 12:55	65.98	OK
4461	2026-09-23 12:56	66.43	OK	4462	2026-09-23 12:57	64.40	OK
4463	2026-09-23 12:58	63.10	OK	4464	2026-09-23 12:59	63.21	OK
4465	2026-09-23 13:00	63.11	OK	4466	2026-09-23 13:01	65.81	OK
4467	2026-09-23 13:02	63.98	OK	4468	2026-09-23 13:03	63.64	OK
4469	2026-09-23 13:04	62.54	OK	4470	2026-09-23 13:05	63.77	OK
4471	2026-09-23 13:06	64.35	OK	4472	2026-09-23 13:07	63.88	OK
4473	2026-09-23 13:08	65.59	OK	4474	2026-09-23 13:09	65.44	OK
4475	2026-09-23 13:10	61.15	OK	4476	2026-09-23 13:11	63.14	OK
4477	2026-09-23 13:12	64.19	OK	4478	2026-09-23 13:13	66.92	OK
4479	2026-09-23 13:14	63.52	OK	4480	2026-09-23 13:15	65.66	OK
4481	2026-09-23 13:16	64.35	OK	4482	2026-09-23 13:17	65.88	OK
4483	2026-09-23 13:18	65.43	OK	4484	2026-09-23 13:19	63.58	OK
4485	2026-09-23 13:20	63.76	OK	4486	2026-09-23 13:21	65.87	OK
4487	2026-09-23 13:22	63.91	OK	4488	2026-09-23 13:23	64.98	OK
4489	2026-09-23 13:24	64.07	OK	4490	2026-09-23 13:25	63.55	OK
4491	2026-09-23 13:26	62.61	OK	4492	2026-09-23 13:27	67.00	OK
4493	2026-09-23 13:28	63.76	OK	4494	2026-09-23 13:29	66.34	OK
4495	2026-09-23 13:30	63.59	OK	4496	2026-09-23 13:31	64.10	OK
4497	2026-09-23 13:32	64.39	OK	4498	2026-09-23 13:33	65.02	OK
4499	2026-09-23 13:34	68.12	OK	4500	2026-09-23 13:35	65.79	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4501	2026-09-23 13:36	63.85	OK	4502	2026-09-23 13:37	64.80	OK
4503	2026-09-23 13:38	64.45	OK	4504	2026-09-23 13:39	64.23	OK
4505	2026-09-23 13:40	66.56	OK	4506	2026-09-23 13:41	66.07	OK
4507	2026-09-23 13:42	64.98	OK	4508	2026-09-23 13:43	64.86	OK
4509	2026-09-23 13:44	66.07	OK	4510	2026-09-23 13:45	67.20	OK
4511	2026-09-23 13:46	64.71	OK	4512	2026-09-23 13:47	64.86	OK
4513	2026-09-23 13:48	65.79	OK	4514	2026-09-23 13:49	63.64	OK
4515	2026-09-23 13:50	65.46	OK	4516	2026-09-23 13:51	66.99	OK
4517	2026-09-23 13:52	63.74	OK	4518	2026-09-23 13:53	66.80	OK
4519	2026-09-23 13:54	65.42	OK	4520	2026-09-23 13:55	67.62	OK
4521	2026-09-23 13:56	67.21	OK	4522	2026-09-23 13:57	65.39	OK
4523	2026-09-23 13:58	65.46	OK	4524	2026-09-23 13:59	65.01	OK
4525	2026-09-23 14:00	67.66	OK	4526	2026-09-23 14:01	64.70	OK
4527	2026-09-23 14:02	65.78	OK	4528	2026-09-23 14:03	67.13	OK
4529	2026-09-23 14:04	63.42	OK	4530	2026-09-23 14:05	66.55	OK
4531	2026-09-23 14:06	64.05	OK	4532	2026-09-23 14:07	65.87	OK
4533	2026-09-23 14:08	67.60	OK	4534	2026-09-23 14:09	67.38	OK
4535	2026-09-23 14:10	65.95	OK	4536	2026-09-23 14:11	65.36	OK
4537	2026-09-23 14:12	65.00	OK	4538	2026-09-23 14:13	63.85	OK
4539	2026-09-23 14:14	65.93	OK	4540	2026-09-23 14:15	64.32	OK
4541	2026-09-23 14:16	68.88	OK	4542	2026-09-23 14:17	66.49	OK
4543	2026-09-23 14:18	64.74	OK	4544	2026-09-23 14:19	67.58	OK
4545	2026-09-23 14:20	66.59	OK	4546	2026-09-23 14:21	65.51	OK
4547	2026-09-23 14:22	65.25	OK	4548	2026-09-23 14:23	66.25	OK
4549	2026-09-23 14:24	67.12	OK	4550	2026-09-23 14:25	66.47	OK
4551	2026-09-23 14:26	68.40	OK	4552	2026-09-23 14:27	67.74	OK
4553	2026-09-23 14:28	65.03	OK	4554	2026-09-23 14:29	68.35	OK
4555	2026-09-23 14:30	67.91	OK	4556	2026-09-23 14:31	66.05	OK
4557	2026-09-23 14:32	65.80	OK	4558	2026-09-23 14:33	66.55	OK
4559	2026-09-23 14:34	69.14	OK	4560	2026-09-23 14:35	68.66	OK
4561	2026-09-23 14:36	66.33	OK	4562	2026-09-23 14:37	67.52	OK
4563	2026-09-23 14:38	67.37	OK	4564	2026-09-23 14:39	66.23	OK
4565	2026-09-23 14:40	65.35	OK	4566	2026-09-23 14:41	66.01	OK
4567	2026-09-23 14:42	66.40	OK	4568	2026-09-23 14:43	66.22	OK
4569	2026-09-23 14:44	66.25	OK	4570	2026-09-23 14:45	66.10	OK
4571	2026-09-23 14:46	66.23	OK	4572	2026-09-23 14:47	67.55	OK
4573	2026-09-23 14:48	68.60	OK	4574	2026-09-23 14:49	68.76	OK
4575	2026-09-23 14:50	67.22	OK	4576	2026-09-23 14:51	67.91	OK
4577	2026-09-23 14:52	64.72	OK	4578	2026-09-23 14:53	66.69	OK
4579	2026-09-23 14:54	67.42	OK	4580	2026-09-23 14:55	67.84	OK
4581	2026-09-23 14:56	65.87	OK	4582	2026-09-23 14:57	66.41	OK
4583	2026-09-23 14:58	66.56	OK	4584	2026-09-23 14:59	65.30	OK
4585	2026-09-23 15:00	67.27	OK	4586	2026-09-23 15:01	66.82	OK
4587	2026-09-23 15:02	68.51	OK	4588	2026-09-23 15:03	65.56	OK
4589	2026-09-23 15:04	66.27	OK	4590	2026-09-23 15:05	64.65	OK
4591	2026-09-23 15:06	67.69	OK	4592	2026-09-23 15:07	64.97	OK
4593	2026-09-23 15:08	65.28	OK	4594	2026-09-23 15:09	68.11	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4595	2026-09-23 15:10	70.62	OK	4596	2026-09-23 15:11	68.48	OK
4597	2026-09-23 15:12	68.09	OK	4598	2026-09-23 15:13	66.42	OK
4599	2026-09-23 15:14	66.24	OK	4600	2026-09-23 15:15	67.64	OK
4601	2026-09-23 15:16	66.06	OK	4602	2026-09-23 15:17	67.67	OK
4603	2026-09-23 15:18	68.85	OK	4604	2026-09-23 15:19	66.69	OK
4605	2026-09-23 15:20	66.29	OK	4606	2026-09-23 15:21	67.39	OK
4607	2026-09-23 15:22	66.05	OK	4608	2026-09-23 15:23	68.70	OK
4609	2026-09-23 15:24	68.29	OK	4610	2026-09-23 15:25	65.37	OK
4611	2026-09-23 15:26	68.71	OK	4612	2026-09-23 15:27	65.78	OK
4613	2026-09-23 15:28	68.15	OK	4614	2026-09-23 15:29	69.35	OK
4615	2026-09-23 15:30	68.96	OK	4616	2026-09-23 15:31	67.26	OK
4617	2026-09-23 15:32	67.55	OK	4618	2026-09-23 15:33	68.33	OK
4619	2026-09-23 15:34	68.20	OK	4620	2026-09-23 15:35	66.74	OK
4621	2026-09-23 15:36	67.16	OK	4622	2026-09-23 15:37	68.39	OK
4623	2026-09-23 15:38	68.93	OK	4624	2026-09-23 15:39	65.61	OK
4625	2026-09-23 15:40	68.94	OK	4626	2026-09-23 15:41	69.44	OK
4627	2026-09-23 15:42	68.02	OK	4628	2026-09-23 15:43	70.70	OK
4629	2026-09-23 15:44	69.49	OK	4630	2026-09-23 15:45	69.63	OK
4631	2026-09-23 15:46	67.56	OK	4632	2026-09-23 15:47	69.50	OK
4633	2026-09-23 15:48	69.09	OK	4634	2026-09-23 15:49	67.93	OK
4635	2026-09-23 15:50	67.33	OK	4636	2026-09-23 15:51	68.45	OK
4637	2026-09-23 15:52	66.55	OK	4638	2026-09-23 15:53	70.06	OK
4639	2026-09-23 15:54	66.72	OK	4640	2026-09-23 15:55	70.23	OK
4641	2026-09-23 15:56	69.41	OK	4642	2026-09-23 15:57	66.96	OK
4643	2026-09-23 15:58	67.46	OK	4644	2026-09-23 15:59	67.59	OK
4645	2026-09-23 16:00	69.72	OK	4646	2026-09-23 16:01	67.48	OK
4647	2026-09-23 16:02	67.31	OK	4648	2026-09-23 16:03	65.82	OK
4649	2026-09-23 16:04	66.71	OK	4650	2026-09-23 16:05	67.40	OK
4651	2026-09-23 16:06	68.58	OK	4652	2026-09-23 16:07	69.35	OK
4653	2026-09-23 16:08	67.28	OK	4654	2026-09-23 16:09	68.12	OK
4655	2026-09-23 16:10	66.30	OK	4656	2026-09-23 16:11	69.07	OK
4657	2026-09-23 16:12	67.72	OK	4658	2026-09-23 16:13	68.53	OK
4659	2026-09-23 16:14	68.47	OK	4660	2026-09-23 16:15	68.52	OK
4661	2026-09-23 16:16	69.03	OK	4662	2026-09-23 16:17	70.58	OK
4663	2026-09-23 16:18	67.98	OK	4664	2026-09-23 16:19	68.96	OK
4665	2026-09-23 16:20	69.78	OK	4666	2026-09-23 16:21	69.80	OK
4667	2026-09-23 16:22	71.52	OK	4668	2026-09-23 16:23	69.91	OK
4669	2026-09-23 16:24	70.64	OK	4670	2026-09-23 16:25	69.26	OK
4671	2026-09-23 16:26	67.30	OK	4672	2026-09-23 16:27	69.76	OK
4673	2026-09-23 16:28	68.35	OK	4674	2026-09-23 16:29	67.10	OK
4675	2026-09-23 16:30	67.64	OK	4676	2026-09-23 16:31	67.77	OK
4677	2026-09-23 16:32	69.93	OK	4678	2026-09-23 16:33	69.42	OK
4679	2026-09-23 16:34	69.37	OK	4680	2026-09-23 16:35	70.34	OK
4681	2026-09-23 16:36	71.22	OK	4682	2026-09-23 16:37	68.44	OK
4683	2026-09-23 16:38	68.33	OK	4684	2026-09-23 16:39	67.61	OK
4685	2026-09-23 16:40	67.99	OK	4686	2026-09-23 16:41	68.96	OK
4687	2026-09-23 16:42	69.75	OK	4688	2026-09-23 16:43	67.06	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4689	2026-09-23 16:44	71.85	OK	4690	2026-09-23 16:45	67.94	OK
4691	2026-09-23 16:46	69.88	OK	4692	2026-09-23 16:47	68.59	OK
4693	2026-09-23 16:48	66.71	OK	4694	2026-09-23 16:49	68.90	OK
4695	2026-09-23 16:50	69.49	OK	4696	2026-09-23 16:51	68.43	OK
4697	2026-09-23 16:52	70.09	OK	4698	2026-09-23 16:53	72.21	OK
4699	2026-09-23 16:54	70.24	OK	4700	2026-09-23 16:55	71.30	OK
4701	2026-09-23 16:56	68.92	OK	4702	2026-09-23 16:57	68.42	OK
4703	2026-09-23 16:58	69.23	OK	4704	2026-09-23 16:59	71.09	OK
4705	2026-09-23 17:00	67.61	OK	4706	2026-09-23 17:01	70.00	OK
4707	2026-09-23 17:02	69.26	OK	4708	2026-09-23 17:03	68.42	OK
4709	2026-09-23 17:04	71.44	OK	4710	2026-09-23 17:05	70.78	OK
4711	2026-09-23 17:06	69.45	OK	4712	2026-09-23 17:07	69.38	OK
4713	2026-09-23 17:08	70.50	OK	4714	2026-09-23 17:09	70.42	OK
4715	2026-09-23 17:10	70.37	OK	4716	2026-09-23 17:11	68.86	OK
4717	2026-09-23 17:12	70.30	OK	4718	2026-09-23 17:13	66.82	OK
4719	2026-09-23 17:14	69.74	OK	4720	2026-09-23 17:15	70.70	OK
4721	2026-09-23 17:16	67.70	OK	4722	2026-09-23 17:17	69.56	OK
4723	2026-09-23 17:18	68.24	OK	4724	2026-09-23 17:19	71.09	OK
4725	2026-09-23 17:20	65.96	OK	4726	2026-09-23 17:21	66.94	OK
4727	2026-09-23 17:22	69.82	OK	4728	2026-09-23 17:23	69.91	OK
4729	2026-09-23 17:24	68.73	OK	4730	2026-09-23 17:25	71.22	OK
4731	2026-09-23 17:26	68.23	OK	4732	2026-09-23 17:27	70.98	OK
4733	2026-09-23 17:28	72.20	OK	4734	2026-09-23 17:29	68.18	OK
4735	2026-09-23 17:30	70.18	OK	4736	2026-09-23 17:31	69.04	OK
4737	2026-09-23 17:32	70.97	OK	4738	2026-09-23 17:33	69.47	OK
4739	2026-09-23 17:34	71.62	OK	4740	2026-09-23 17:35	67.79	OK
4741	2026-09-23 17:36	67.49	OK	4742	2026-09-23 17:37	72.58	OK
4743	2026-09-23 17:38	69.16	OK	4744	2026-09-23 17:39	71.18	OK
4745	2026-09-23 17:40	71.16	OK	4746	2026-09-23 17:41	67.16	OK
4747	2026-09-23 17:42	69.74	OK	4748	2026-09-23 17:43	68.67	OK
4749	2026-09-23 17:44	68.54	OK	4750	2026-09-23 17:45	70.54	OK
4751	2026-09-23 17:46	69.76	OK	4752	2026-09-23 17:47	72.20	OK
4753	2026-09-23 17:48	67.96	OK	4754	2026-09-23 17:49	67.71	OK
4755	2026-09-23 17:50	72.18	OK	4756	2026-09-23 17:51	69.79	OK
4757	2026-09-23 17:52	68.11	OK	4758	2026-09-23 17:53	69.42	OK
4759	2026-09-23 17:54	70.93	OK	4760	2026-09-23 17:55	69.65	OK
4761	2026-09-23 17:56	69.09	OK	4762	2026-09-23 17:57	68.00	OK
4763	2026-09-23 17:58	72.09	OK	4764	2026-09-23 17:59	71.43	OK
4765	2026-09-23 18:00	70.33	OK	4766	2026-09-23 18:01	70.93	OK
4767	2026-09-23 18:02	67.76	OK	4768	2026-09-23 18:03	68.38	OK
4769	2026-09-23 18:04	67.28	OK	4770	2026-09-23 18:05	70.62	OK
4771	2026-09-23 18:06	69.50	OK	4772	2026-09-23 18:07	67.81	OK
4773	2026-09-23 18:08	70.21	OK	4774	2026-09-23 18:09	69.25	OK
4775	2026-09-23 18:10	70.55	OK	4776	2026-09-23 18:11	71.36	OK
4777	2026-09-23 18:12	73.14	OK	4778	2026-09-23 18:13	70.20	OK
4779	2026-09-23 18:14	68.25	OK	4780	2026-09-23 18:15	70.21	OK
4781	2026-09-23 18:16	70.25	OK	4782	2026-09-23 18:17	72.55	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4783	2026-09-23 18:18	68.72	OK	4784	2026-09-23 18:19	68.59	OK
4785	2026-09-23 18:20	67.32	OK	4786	2026-09-23 18:21	69.95	OK
4787	2026-09-23 18:22	69.84	OK	4788	2026-09-23 18:23	70.89	OK
4789	2026-09-23 18:24	71.53	OK	4790	2026-09-23 18:25	71.98	OK
4791	2026-09-23 18:26	69.53	OK	4792	2026-09-23 18:27	71.34	OK
4793	2026-09-23 18:28	72.42	OK	4794	2026-09-23 18:29	68.16	OK
4795	2026-09-23 18:30	70.78	OK	4796	2026-09-23 18:31	71.67	OK
4797	2026-09-23 18:32	69.29	OK	4798	2026-09-23 18:33	70.69	OK
4799	2026-09-23 18:34	71.10	OK	4800	2026-09-23 18:35	69.77	OK
4801	2026-09-23 18:36	69.01	OK	4802	2026-09-23 18:37	70.35	OK
4803	2026-09-23 18:38	70.35	OK	4804	2026-09-23 18:39	71.72	OK
4805	2026-09-23 18:40	70.53	OK	4806	2026-09-23 18:41	70.51	OK
4807	2026-09-23 18:42	69.50	OK	4808	2026-09-23 18:43	71.04	OK
4809	2026-09-23 18:44	68.51	OK	4810	2026-09-23 18:45	68.92	OK
4811	2026-09-23 18:46	69.53	OK	4812	2026-09-23 18:47	69.13	OK
4813	2026-09-23 18:48	72.55	OK	4814	2026-09-23 18:49	71.01	OK
4815	2026-09-23 18:50	70.71	OK	4816	2026-09-23 18:51	70.22	OK
4817	2026-09-23 18:52	70.91	OK	4818	2026-09-23 18:53	69.75	OK
4819	2026-09-23 18:54	68.67	OK	4820	2026-09-23 18:55	72.63	OK
4821	2026-09-23 18:56	68.58	OK	4822	2026-09-23 18:57	68.47	OK
4823	2026-09-23 18:58	69.44	OK	4824	2026-09-23 18:59	69.36	OK
4825	2026-09-23 19:00	69.89	OK	4826	2026-09-23 19:01	70.60	OK
4827	2026-09-23 19:02	68.73	OK	4828	2026-09-23 19:03	68.45	OK
4829	2026-09-23 19:04	70.96	OK	4830	2026-09-23 19:05	72.42	OK
4831	2026-09-23 19:06	71.00	OK	4832	2026-09-23 19:07	68.75	OK
4833	2026-09-23 19:08	72.03	OK	4834	2026-09-23 19:09	70.09	OK
4835	2026-09-23 19:10	71.36	OK	4836	2026-09-23 19:11	70.61	OK
4837	2026-09-23 19:12	70.41	OK	4838	2026-09-23 19:13	69.95	OK
4839	2026-09-23 19:14	69.31	OK	4840	2026-09-23 19:15	71.16	OK
4841	2026-09-23 19:16	68.59	OK	4842	2026-09-23 19:17	70.36	OK
4843	2026-09-23 19:18	67.72	OK	4844	2026-09-23 19:19	71.48	OK
4845	2026-09-23 19:20	71.24	OK	4846	2026-09-23 19:21	72.48	OK
4847	2026-09-23 19:22	70.81	OK	4848	2026-09-23 19:23	69.15	OK
4849	2026-09-23 19:24	72.50	OK	4850	2026-09-23 19:25	69.27	OK
4851	2026-09-23 19:26	69.73	OK	4852	2026-09-23 19:27	70.86	OK
4853	2026-09-23 19:28	68.82	OK	4854	2026-09-23 19:29	71.37	OK
4855	2026-09-23 19:30	73.15	OK	4856	2026-09-23 19:31	71.99	OK
4857	2026-09-23 19:32	69.78	OK	4858	2026-09-23 19:33	69.79	OK
4859	2026-09-23 19:34	71.19	OK	4860	2026-09-23 19:35	71.04	OK
4861	2026-09-23 19:36	70.97	OK	4862	2026-09-23 19:37	69.26	OK
4863	2026-09-23 19:38	73.31	OK	4864	2026-09-23 19:39	71.89	OK
4865	2026-09-23 19:40	69.71	OK	4866	2026-09-23 19:41	68.39	OK
4867	2026-09-23 19:42	68.66	OK	4868	2026-09-23 19:43	70.88	OK
4869	2026-09-23 19:44	68.60	OK	4870	2026-09-23 19:45	70.06	OK
4871	2026-09-23 19:46	70.00	OK	4872	2026-09-23 19:47	70.51	OK
4873	2026-09-23 19:48	71.13	OK	4874	2026-09-23 19:49	69.83	OK
4875	2026-09-23 19:50	68.96	OK	4876	2026-09-23 19:51	71.09	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4877	2026-09-23 19:52	70.58	OK	4878	2026-09-23 19:53	69.71	OK
4879	2026-09-23 19:54	70.90	OK	4880	2026-09-23 19:55	71.07	OK
4881	2026-09-23 19:56	72.41	OK	4882	2026-09-23 19:57	68.58	OK
4883	2026-09-23 19:58	68.82	OK	4884	2026-09-23 19:59	71.84	OK
4885	2026-09-23 20:00	68.91	OK	4886	2026-09-23 20:01	72.99	OK
4887	2026-09-23 20:02	69.87	OK	4888	2026-09-23 20:03	71.48	OK
4889	2026-09-23 20:04	69.80	OK	4890	2026-09-23 20:05	72.12	OK
4891	2026-09-23 20:06	67.46	OK	4892	2026-09-23 20:07	69.83	OK
4893	2026-09-23 20:08	70.02	OK	4894	2026-09-23 20:09	73.75	OK
4895	2026-09-23 20:10	68.19	OK	4896	2026-09-23 20:11	70.59	OK
4897	2026-09-23 20:12	68.43	OK	4898	2026-09-23 20:13	72.19	OK
4899	2026-09-23 20:14	71.60	OK	4900	2026-09-23 20:15	71.61	OK
4901	2026-09-23 20:16	70.62	OK	4902	2026-09-23 20:17	70.57	OK
4903	2026-09-23 20:18	70.83	OK	4904	2026-09-23 20:19	69.97	OK
4905	2026-09-23 20:20	66.78	OK	4906	2026-09-23 20:21	69.49	OK
4907	2026-09-23 20:22	72.80	OK	4908	2026-09-23 20:23	72.24	OK
4909	2026-09-23 20:24	71.87	OK	4910	2026-09-23 20:25	70.34	OK
4911	2026-09-23 20:26	72.37	OK	4912	2026-09-23 20:27	69.53	OK
4913	2026-09-23 20:28	70.87	OK	4914	2026-09-23 20:29	68.10	OK
4915	2026-09-23 20:30	69.53	OK	4916	2026-09-23 20:31	71.09	OK
4917	2026-09-23 20:32	69.07	OK	4918	2026-09-23 20:33	70.38	OK
4919	2026-09-23 20:34	70.74	OK	4920	2026-09-23 20:35	69.49	OK
4921	2026-09-23 20:36	69.42	OK	4922	2026-09-23 20:37	69.90	OK
4923	2026-09-23 20:38	72.04	OK	4924	2026-09-23 20:39	71.25	OK
4925	2026-09-23 20:40	69.48	OK	4926	2026-09-23 20:41	72.88	OK
4927	2026-09-23 20:42	69.62	OK	4928	2026-09-23 20:43	70.47	OK
4929	2026-09-23 20:44	69.78	OK	4930	2026-09-23 20:45	71.45	OK
4931	2026-09-23 20:46	68.43	OK	4932	2026-09-23 20:47	70.01	OK
4933	2026-09-23 20:48	70.27	OK	4934	2026-09-23 20:49	68.33	OK
4935	2026-09-23 20:50	73.05	OK	4936	2026-09-23 20:51	68.39	OK
4937	2026-09-23 20:52	68.68	OK	4938	2026-09-23 20:53	71.04	OK
4939	2026-09-23 20:54	71.16	OK	4940	2026-09-23 20:55	69.03	OK
4941	2026-09-23 20:56	71.01	OK	4942	2026-09-23 20:57	69.87	OK
4943	2026-09-23 20:58	69.84	OK	4944	2026-09-23 20:59	67.68	OK
4945	2026-09-23 21:00	70.25	OK	4946	2026-09-23 21:01	72.55	OK
4947	2026-09-23 21:02	70.10	OK	4948	2026-09-23 21:03	69.78	OK
4949	2026-09-23 21:04	69.96	OK	4950	2026-09-23 21:05	69.11	OK
4951	2026-09-23 21:06	69.32	OK	4952	2026-09-23 21:07	71.52	OK
4953	2026-09-23 21:08	70.93	OK	4954	2026-09-23 21:09	68.50	OK
4955	2026-09-23 21:10	71.56	OK	4956	2026-09-23 21:11	67.13	OK
4957	2026-09-23 21:12	68.31	OK	4958	2026-09-23 21:13	68.78	OK
4959	2026-09-23 21:14	71.44	OK	4960	2026-09-23 21:15	67.97	OK
4961	2026-09-23 21:16	69.79	OK	4962	2026-09-23 21:17	70.31	OK
4963	2026-09-23 21:18	69.82	OK	4964	2026-09-23 21:19	69.43	OK
4965	2026-09-23 21:20	68.73	OK	4966	2026-09-23 21:21	68.67	OK
4967	2026-09-23 21:22	66.65	OK	4968	2026-09-23 21:23	70.74	OK
4969	2026-09-23 21:24	70.96	OK	4970	2026-09-23 21:25	71.73	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4971	2026-09-23 21:26	69.95	OK	4972	2026-09-23 21:27	70.07	OK
4973	2026-09-23 21:28	68.68	OK	4974	2026-09-23 21:29	71.01	OK
4975	2026-09-23 21:30	69.71	OK	4976	2026-09-23 21:31	70.90	OK
4977	2026-09-23 21:32	70.10	OK	4978	2026-09-23 21:33	69.41	OK
4979	2026-09-23 21:34	68.36	OK	4980	2026-09-23 21:35	70.44	OK
4981	2026-09-23 21:36	67.32	OK	4982	2026-09-23 21:37	66.62	OK
4983	2026-09-23 21:38	68.91	OK	4984	2026-09-23 21:39	69.84	OK
4985	2026-09-23 21:40	70.30	OK	4986	2026-09-23 21:41	70.15	OK
4987	2026-09-23 21:42	67.78	OK	4988	2026-09-23 21:43	68.92	OK
4989	2026-09-23 21:44	69.70	OK	4990	2026-09-23 21:45	69.00	OK
4991	2026-09-23 21:46	68.23	OK	4992	2026-09-23 21:47	69.78	OK
4993	2026-09-23 21:48	68.39	OK	4994	2026-09-23 21:49	68.35	OK
4995	2026-09-23 21:50	69.22	OK	4996	2026-09-23 21:51	68.13	OK
4997	2026-09-23 21:52	70.39	OK	4998	2026-09-23 21:53	69.94	OK
4999	2026-09-23 21:54	69.16	OK	5000	2026-09-23 21:55	69.67	OK
5001	2026-09-23 21:56	66.65	OK	5002	2026-09-23 21:57	69.74	OK
5003	2026-09-23 21:58	71.70	OK	5004	2026-09-23 21:59	69.50	OK
5005	2026-09-23 22:00	68.03	OK	5006	2026-09-23 22:01	69.44	OK
5007	2026-09-23 22:02	69.19	OK	5008	2026-09-23 22:03	70.19	OK
5009	2026-09-23 22:04	70.39	OK	5010	2026-09-23 22:05	67.85	OK
5011	2026-09-23 22:06	67.29	OK	5012	2026-09-23 22:07	68.38	OK
5013	2026-09-23 22:08	69.44	OK	5014	2026-09-23 22:09	69.89	OK
5015	2026-09-23 22:10	68.85	OK	5016	2026-09-23 22:11	68.17	OK
5017	2026-09-23 22:12	69.16	OK	5018	2026-09-23 22:13	67.52	OK
5019	2026-09-23 22:14	71.94	OK	5020	2026-09-23 22:15	70.07	OK
5021	2026-09-23 22:16	70.34	OK	5022	2026-09-23 22:17	68.14	OK
5023	2026-09-23 22:18	67.12	OK	5024	2026-09-23 22:19	67.62	OK
5025	2026-09-23 22:20	67.86	OK	5026	2026-09-23 22:21	66.47	OK
5027	2026-09-23 22:22	71.08	OK	5028	2026-09-23 22:23	67.85	OK
5029	2026-09-23 22:24	68.09	OK	5030	2026-09-23 22:25	69.52	OK
5031	2026-09-23 22:26	68.86	OK	5032	2026-09-23 22:27	70.22	OK
5033	2026-09-23 22:28	65.88	OK	5034	2026-09-23 22:29	67.85	OK
5035	2026-09-23 22:30	70.26	OK	5036	2026-09-23 22:31	68.38	OK
5037	2026-09-23 22:32	72.24	OK	5038	2026-09-23 22:33	68.89	OK
5039	2026-09-23 22:34	69.92	OK	5040	2026-09-23 22:35	67.72	OK
5041	2026-09-23 22:36	69.56	OK	5042	2026-09-23 22:37	70.70	OK
5043	2026-09-23 22:38	68.28	OK	5044	2026-09-23 22:39	69.99	OK
5045	2026-09-23 22:40	69.23	OK	5046	2026-09-23 22:41	68.10	OK
5047	2026-09-23 22:42	70.61	OK	5048	2026-09-23 22:43	66.50	OK
5049	2026-09-23 22:44	69.69	OK	5050	2026-09-23 22:45	69.13	OK
5051	2026-09-23 22:46	70.05	OK	5052	2026-09-23 22:47	67.47	OK
5053	2026-09-23 22:48	71.53	OK	5054	2026-09-23 22:49	67.77	OK
5055	2026-09-23 22:50	69.31	OK	5056	2026-09-23 22:51	67.33	OK
5057	2026-09-23 22:52	67.33	OK	5058	2026-09-23 22:53	66.96	OK
5059	2026-09-23 22:54	67.53	OK	5060	2026-09-23 22:55	68.29	OK
5061	2026-09-23 22:56	68.47	OK	5062	2026-09-23 22:57	67.17	OK
5063	2026-09-23 22:58	70.39	OK	5064	2026-09-23 22:59	67.75	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5065	2026-09-23 23:00	69.34	OK	5066	2026-09-23 23:01	67.48	OK
5067	2026-09-23 23:02	67.51	OK	5068	2026-09-23 23:03	69.62	OK
5069	2026-09-23 23:04	68.98	OK	5070	2026-09-23 23:05	67.26	OK
5071	2026-09-23 23:06	66.84	OK	5072	2026-09-23 23:07	65.82	OK
5073	2026-09-23 23:08	70.24	OK	5074	2026-09-23 23:09	69.54	OK
5075	2026-09-23 23:10	70.68	OK	5076	2026-09-23 23:11	68.26	OK
5077	2026-09-23 23:12	68.07	OK	5078	2026-09-23 23:13	68.75	OK
5079	2026-09-23 23:14	68.81	OK	5080	2026-09-23 23:15	67.60	OK
5081	2026-09-23 23:16	68.12	OK	5082	2026-09-23 23:17	68.07	OK
5083	2026-09-23 23:18	67.47	OK	5084	2026-09-23 23:19	70.18	OK
5085	2026-09-23 23:20	67.90	OK	5086	2026-09-23 23:21	67.98	OK
5087	2026-09-23 23:22	66.65	OK	5088	2026-09-23 23:23	68.35	OK
5089	2026-09-23 23:24	68.95	OK	5090	2026-09-23 23:25	66.48	OK
5091	2026-09-23 23:26	67.18	OK	5092	2026-09-23 23:27	69.58	OK
5093	2026-09-23 23:28	66.05	OK	5094	2026-09-23 23:29	69.18	OK
5095	2026-09-23 23:30	67.26	OK	5096	2026-09-23 23:31	67.19	OK
5097	2026-09-23 23:32	68.08	OK	5098	2026-09-23 23:33	67.33	OK
5099	2026-09-23 23:34	65.80	OK	5100	2026-09-23 23:35	64.62	OK
5101	2026-09-23 23:36	65.39	OK	5102	2026-09-23 23:37	69.70	OK
5103	2026-09-23 23:38	66.35	OK	5104	2026-09-23 23:39	65.27	OK
5105	2026-09-23 23:40	67.48	OK	5106	2026-09-23 23:41	67.97	OK
5107	2026-09-23 23:42	65.00	OK	5108	2026-09-23 23:43	67.89	OK
5109	2026-09-23 23:44	66.45	OK	5110	2026-09-23 23:45	66.86	OK
5111	2026-09-23 23:46	67.08	OK	5112	2026-09-23 23:47	65.39	OK
5113	2026-09-23 23:48	69.43	OK	5114	2026-09-23 23:49	69.44	OK
5115	2026-09-23 23:50	68.30	OK	5116	2026-09-23 23:51	64.63	OK
5117	2026-09-23 23:52	67.20	OK	5118	2026-09-23 23:53	68.60	OK
5119	2026-09-23 23:54	68.45	OK	5120	2026-09-23 23:55	66.43	OK
5121	2026-09-23 23:56	63.52	OK	5122	2026-09-23 23:57	65.14	OK
5123	2026-09-23 23:58	65.15	OK	5124	2026-09-23 23:59	68.35	OK
5125	2026-09-24 00:00	66.08	OK	5126	2026-09-24 00:01	66.21	OK
5127	2026-09-24 00:02	66.57	OK	5128	2026-09-24 00:03	67.42	OK
5129	2026-09-24 00:04	69.44	OK	5130	2026-09-24 00:05	67.98	OK
5131	2026-09-24 00:06	64.45	OK	5132	2026-09-24 00:07	66.12	OK
5133	2026-09-24 00:08	68.75	OK	5134	2026-09-24 00:09	65.89	OK
5135	2026-09-24 00:10	65.05	OK	5136	2026-09-24 00:11	67.48	OK
5137	2026-09-24 00:12	68.59	OK	5138	2026-09-24 00:13	68.45	OK
5139	2026-09-24 00:14	64.80	OK	5140	2026-09-24 00:15	67.02	OK
5141	2026-09-24 00:16	68.32	OK	5142	2026-09-24 00:17	65.97	OK
5143	2026-09-24 00:18	66.36	OK	5144	2026-09-24 00:19	65.41	OK
5145	2026-09-24 00:20	68.67	OK	5146	2026-09-24 00:21	65.81	OK
5147	2026-09-24 00:22	66.28	OK	5148	2026-09-24 00:23	63.80	OK
5149	2026-09-24 00:24	65.93	OK	5150	2026-09-24 00:25	65.62	OK
5151	2026-09-24 00:26	68.92	OK	5152	2026-09-24 00:27	67.50	OK
5153	2026-09-24 00:28	65.74	OK	5154	2026-09-24 00:29	69.13	OK
5155	2026-09-24 00:30	67.13	OK	5156	2026-09-24 00:31	65.11	OK
5157	2026-09-24 00:32	65.74	OK	5158	2026-09-24 00:33	63.36	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5159	2026-09-24 00:34	64.61	OK	5160	2026-09-24 00:35	64.09	OK
5161	2026-09-24 00:36	65.90	OK	5162	2026-09-24 00:37	66.70	OK
5163	2026-09-24 00:38	65.46	OK	5164	2026-09-24 00:39	65.40	OK
5165	2026-09-24 00:40	67.61	OK	5166	2026-09-24 00:41	67.18	OK
5167	2026-09-24 00:42	67.87	OK	5168	2026-09-24 00:43	65.68	OK
5169	2026-09-24 00:44	66.48	OK	5170	2026-09-24 00:45	65.91	OK
5171	2026-09-24 00:46	67.16	OK	5172	2026-09-24 00:47	66.15	OK
5173	2026-09-24 00:48	66.10	OK	5174	2026-09-24 00:49	64.81	OK
5175	2026-09-24 00:50	65.14	OK	5176	2026-09-24 00:51	64.06	OK
5177	2026-09-24 00:52	64.16	OK	5178	2026-09-24 00:53	64.19	OK
5179	2026-09-24 00:54	66.54	OK	5180	2026-09-24 00:55	66.16	OK
5181	2026-09-24 00:56	65.62	OK	5182	2026-09-24 00:57	64.69	OK
5183	2026-09-24 00:58	64.99	OK	5184	2026-09-24 00:59	67.09	OK
5185	2026-09-24 01:00	66.66	OK	5186	2026-09-24 01:01	64.66	OK
5187	2026-09-24 01:02	64.80	OK	5188	2026-09-24 01:03	64.62	OK
5189	2026-09-24 01:04	62.78	OK	5190	2026-09-24 01:05	66.59	OK
5191	2026-09-24 01:06	66.95	OK	5192	2026-09-24 01:07	66.63	OK
5193	2026-09-24 01:08	64.91	OK	5194	2026-09-24 01:09	65.82	OK
5195	2026-09-24 01:10	67.86	OK	5196	2026-09-24 01:11	63.82	OK
5197	2026-09-24 01:12	64.14	OK	5198	2026-09-24 01:13	64.84	OK
5199	2026-09-24 01:14	65.93	OK	5200	2026-09-24 01:15	61.59	OK
5201	2026-09-24 01:16	64.31	OK	5202	2026-09-24 01:17	65.45	OK
5203	2026-09-24 01:18	63.65	OK	5204	2026-09-24 01:19	64.23	OK
5205	2026-09-24 01:20	64.54	OK	5206	2026-09-24 01:21	64.75	OK
5207	2026-09-24 01:22	64.81	OK	5208	2026-09-24 01:23	63.70	OK
5209	2026-09-24 01:24	65.46	OK	5210	2026-09-24 01:25	62.26	OK
5211	2026-09-24 01:26	64.21	OK	5212	2026-09-24 01:27	64.46	OK
5213	2026-09-24 01:28	63.15	OK	5214	2026-09-24 01:29	62.87	OK
5215	2026-09-24 01:30	64.71	OK	5216	2026-09-24 01:31	65.48	OK
5217	2026-09-24 01:32	64.91	OK	5218	2026-09-24 01:33	65.02	OK
5219	2026-09-24 01:34	64.39	OK	5220	2026-09-24 01:35	63.26	OK
5221	2026-09-24 01:36	66.53	OK	5222	2026-09-24 01:37	64.04	OK
5223	2026-09-24 01:38	65.41	OK	5224	2026-09-24 01:39	65.38	OK
5225	2026-09-24 01:40	63.43	OK	5226	2026-09-24 01:41	62.82	OK
5227	2026-09-24 01:42	63.08	OK	5228	2026-09-24 01:43	61.96	OK
5229	2026-09-24 01:44	62.32	OK	5230	2026-09-24 01:45	66.78	OK
5231	2026-09-24 01:46	63.75	OK	5232	2026-09-24 01:47	66.08	OK
5233	2026-09-24 01:48	63.17	OK	5234	2026-09-24 01:49	64.16	OK
5235	2026-09-24 01:50	62.14	OK	5236	2026-09-24 01:51	65.94	OK
5237	2026-09-24 01:52	61.85	OK	5238	2026-09-24 01:53	65.26	OK
5239	2026-09-24 01:54	61.78	OK	5240	2026-09-24 01:55	63.14	OK
5241	2026-09-24 01:56	62.70	OK	5242	2026-09-24 01:57	63.61	OK
5243	2026-09-24 01:58	64.56	OK	5244	2026-09-24 01:59	65.04	OK
5245	2026-09-24 02:00	63.45	OK	5246	2026-09-24 02:01	63.34	OK
5247	2026-09-24 02:02	63.83	OK	5248	2026-09-24 02:03	63.75	OK
5249	2026-09-24 02:04	63.15	OK	5250	2026-09-24 02:05	63.12	OK
5251	2026-09-24 02:06	64.53	OK	5252	2026-09-24 02:07	64.75	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5253	2026-09-24 02:08	64.91	OK	5254	2026-09-24 02:09	61.69	OK
5255	2026-09-24 02:10	65.50	OK	5256	2026-09-24 02:11	65.06	OK
5257	2026-09-24 02:12	63.82	OK	5258	2026-09-24 02:13	65.92	OK
5259	2026-09-24 02:14	63.09	OK	5260	2026-09-24 02:15	62.06	OK
5261	2026-09-24 02:16	63.90	OK	5262	2026-09-24 02:17	62.40	OK
5263	2026-09-24 02:18	64.29	OK	5264	2026-09-24 02:19	61.90	OK
5265	2026-09-24 02:20	62.76	OK	5266	2026-09-24 02:21	64.07	OK
5267	2026-09-24 02:22	60.53	OK	5268	2026-09-24 02:23	64.30	OK
5269	2026-09-24 02:24	64.51	OK	5270	2026-09-24 02:25	64.97	OK
5271	2026-09-24 02:26	63.19	OK	5272	2026-09-24 02:27	64.73	OK
5273	2026-09-24 02:28	60.57	OK	5274	2026-09-24 02:29	64.59	OK
5275	2026-09-24 02:30	62.26	OK	5276	2026-09-24 02:31	63.20	OK
5277	2026-09-24 02:32	62.37	OK	5278	2026-09-24 02:33	61.44	OK
5279	2026-09-24 02:34	62.99	OK	5280	2026-09-24 02:35	64.42	OK
5281	2026-09-24 02:36	60.94	OK	5282	2026-09-24 02:37	62.06	OK
5283	2026-09-24 02:38	66.47	OK	5284	2026-09-24 02:39	65.22	OK
5285	2026-09-24 02:40	64.78	OK	5286	2026-09-24 02:41	61.24	OK
5287	2026-09-24 02:42	61.15	OK	5288	2026-09-24 02:43	63.86	OK
5289	2026-09-24 02:44	61.67	OK	5290	2026-09-24 02:45	64.09	OK
5291	2026-09-24 02:46	63.94	OK	5292	2026-09-24 02:47	62.62	OK
5293	2026-09-24 02:48	64.26	OK	5294	2026-09-24 02:49	61.69	OK
5295	2026-09-24 02:50	63.43	OK	5296	2026-09-24 02:51	61.50	OK
5297	2026-09-24 02:52	60.25	OK	5298	2026-09-24 02:53	63.23	OK
5299	2026-09-24 02:54	64.34	OK	5300	2026-09-24 02:55	65.37	OK
5301	2026-09-24 02:56	62.86	OK	5302	2026-09-24 02:57	65.38	OK
5303	2026-09-24 02:58	62.92	OK	5304	2026-09-24 02:59	63.41	OK
5305	2026-09-24 03:00	64.06	OK	5306	2026-09-24 03:01	60.81	OK
5307	2026-09-24 03:02	64.99	OK	5308	2026-09-24 03:03	62.43	OK
5309	2026-09-24 03:04	64.99	OK	5310	2026-09-24 03:05	62.18	OK
5311	2026-09-24 03:06	58.33	OK	5312	2026-09-24 03:07	64.43	OK
5313	2026-09-24 03:08	59.03	OK	5314	2026-09-24 03:09	62.68	OK
5315	2026-09-24 03:10	58.93	OK	5316	2026-09-24 03:11	62.00	OK
5317	2026-09-24 03:12	62.56	OK	5318	2026-09-24 03:13	62.48	OK
5319	2026-09-24 03:14	62.97	OK	5320	2026-09-24 03:15	59.17	OK
5321	2026-09-24 03:16	62.66	OK	5322	2026-09-24 03:17	61.62	OK
5323	2026-09-24 03:18	63.11	OK	5324	2026-09-24 03:19	61.36	OK
5325	2026-09-24 03:20	64.24	OK	5326	2026-09-24 03:21	63.08	OK
5327	2026-09-24 03:22	60.92	OK	5328	2026-09-24 03:23	61.36	OK
5329	2026-09-24 03:24	60.30	OK	5330	2026-09-24 03:25	63.37	OK
5331	2026-09-24 03:26	59.98	OK	5332	2026-09-24 03:27	62.52	OK
5333	2026-09-24 03:28	59.82	OK	5334	2026-09-24 03:29	61.80	OK
5335	2026-09-24 03:30	62.35	OK	5336	2026-09-24 03:31	62.54	OK
5337	2026-09-24 03:32	61.44	OK	5338	2026-09-24 03:33	59.15	OK
5339	2026-09-24 03:34	62.79	OK	5340	2026-09-24 03:35	59.54	OK
5341	2026-09-24 03:36	60.47	OK	5342	2026-09-24 03:37	60.17	OK
5343	2026-09-24 03:38	62.21	OK	5344	2026-09-24 03:39	60.42	OK
5345	2026-09-24 03:40	60.25	OK	5346	2026-09-24 03:41	60.10	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5347	2026-09-24 03:42	61.44	OK	5348	2026-09-24 03:43	64.37	OK
5349	2026-09-24 03:44	62.98	OK	5350	2026-09-24 03:45	61.16	OK
5351	2026-09-24 03:46	58.01	OK	5352	2026-09-24 03:47	63.18	OK
5353	2026-09-24 03:48	61.80	OK	5354	2026-09-24 03:49	59.78	OK
5355	2026-09-24 03:50	61.45	OK	5356	2026-09-24 03:51	61.84	OK
5357	2026-09-24 03:52	64.24	OK	5358	2026-09-24 03:53	63.07	OK
5359	2026-09-24 03:54	59.30	OK	5360	2026-09-24 03:55	61.47	OK
5361	2026-09-24 03:56	62.07	OK	5362	2026-09-24 03:57	61.67	OK
5363	2026-09-24 03:58	61.86	OK	5364	2026-09-24 03:59	61.38	OK
5365	2026-09-24 04:00	58.39	OK	5366	2026-09-24 04:01	62.11	OK
5367	2026-09-24 04:02	59.91	OK	5368	2026-09-24 04:03	62.84	OK
5369	2026-09-24 04:04	61.57	OK	5370	2026-09-24 04:05	62.81	OK
5371	2026-09-24 04:06	60.91	OK	5372	2026-09-24 04:07	61.84	OK
5373	2026-09-24 04:08	62.56	OK	5374	2026-09-24 04:09	61.53	OK
5375	2026-09-24 04:10	60.75	OK	5376	2026-09-24 04:11	63.54	OK
5377	2026-09-24 04:12	61.09	OK	5378	2026-09-24 04:13	60.57	OK
5379	2026-09-24 04:14	62.69	OK	5380	2026-09-24 04:15	62.08	OK
5381	2026-09-24 04:16	60.71	OK	5382	2026-09-24 04:17	61.81	OK
5383	2026-09-24 04:18	62.26	OK	5384	2026-09-24 04:19	61.32	OK
5385	2026-09-24 04:20	61.17	OK	5386	2026-09-24 04:21	61.60	OK
5387	2026-09-24 04:22	59.71	OK	5388	2026-09-24 04:23	62.51	OK
5389	2026-09-24 04:24	61.03	OK	5390	2026-09-24 04:25	58.63	OK
5391	2026-09-24 04:26	61.19	OK	5392	2026-09-24 04:27	59.71	OK
5393	2026-09-24 04:28	61.96	OK	5394	2026-09-24 04:29	63.43	OK
5395	2026-09-24 04:30	61.82	OK	5396	2026-09-24 04:31	62.12	OK
5397	2026-09-24 04:32	61.07	OK	5398	2026-09-24 04:33	60.03	OK
5399	2026-09-24 04:34	62.88	OK	5400	2026-09-24 04:35	60.40	OK
5401	2026-09-24 04:36	63.25	OK	5402	2026-09-24 04:37	63.40	OK
5403	2026-09-24 04:38	60.80	OK	5404	2026-09-24 04:39	57.66	OK
5405	2026-09-24 04:40	58.93	OK	5406	2026-09-24 04:41	61.94	OK
5407	2026-09-24 04:42	61.60	OK	5408	2026-09-24 04:43	62.35	OK
5409	2026-09-24 04:44	59.75	OK	5410	2026-09-24 04:45	61.96	OK
5411	2026-09-24 04:46	59.83	OK	5412	2026-09-24 04:47	58.15	OK
5413	2026-09-24 04:48	58.41	OK	5414	2026-09-24 04:49	63.50	OK
5415	2026-09-24 04:50	58.54	OK	5416	2026-09-24 04:51	59.87	OK
5417	2026-09-24 04:52	62.29	OK	5418	2026-09-24 04:53	61.54	OK
5419	2026-09-24 04:54	60.21	OK	5420	2026-09-24 04:55	60.25	OK
5421	2026-09-24 04:56	61.00	OK	5422	2026-09-24 04:57	58.05	OK
5423	2026-09-24 04:58	62.46	OK	5424	2026-09-24 04:59	63.13	OK
5425	2026-09-24 05:00	57.22	OK	5426	2026-09-24 05:01	60.44	OK
5427	2026-09-24 05:02	60.86	OK	5428	2026-09-24 05:03	60.72	OK
5429	2026-09-24 05:04	57.52	OK	5430	2026-09-24 05:05	60.24	OK
5431	2026-09-24 05:06	62.15	OK	5432	2026-09-24 05:07	59.89	OK
5433	2026-09-24 05:08	61.90	OK	5434	2026-09-24 05:09	62.05	OK
5435	2026-09-24 05:10	59.67	OK	5436	2026-09-24 05:11	58.02	OK
5437	2026-09-24 05:12	59.38	OK	5438	2026-09-24 05:13	60.12	OK
5439	2026-09-24 05:14	61.53	OK	5440	2026-09-24 05:15	61.44	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5441	2026-09-24 05:16	58.45	OK	5442	2026-09-24 05:17	60.20	OK
5443	2026-09-24 05:18	59.17	OK	5444	2026-09-24 05:19	61.11	OK
5445	2026-09-24 05:20	59.84	OK	5446	2026-09-24 05:21	61.05	OK
5447	2026-09-24 05:22	61.66	OK	5448	2026-09-24 05:23	61.69	OK
5449	2026-09-24 05:24	60.43	OK	5450	2026-09-24 05:25	59.66	OK
5451	2026-09-24 05:26	60.11	OK	5452	2026-09-24 05:27	56.94	OK
5453	2026-09-24 05:28	57.50	OK	5454	2026-09-24 05:29	59.07	OK
5455	2026-09-24 05:30	62.40	OK	5456	2026-09-24 05:31	63.39	OK
5457	2026-09-24 05:32	61.84	OK	5458	2026-09-24 05:33	59.55	OK
5459	2026-09-24 05:34	58.44	OK	5460	2026-09-24 05:35	58.14	OK
5461	2026-09-24 05:36	60.64	OK	5462	2026-09-24 05:37	59.71	OK
5463	2026-09-24 05:38	58.95	OK	5464	2026-09-24 05:39	59.96	OK
5465	2026-09-24 05:40	61.36	OK	5466	2026-09-24 05:41	62.43	OK
5467	2026-09-24 05:42	58.16	OK	5468	2026-09-24 05:43	59.43	OK
5469	2026-09-24 05:44	58.71	OK	5470	2026-09-24 05:45	60.19	OK
5471	2026-09-24 05:46	60.12	OK	5472	2026-09-24 05:47	58.56	OK
5473	2026-09-24 05:48	60.53	OK	5474	2026-09-24 05:49	59.69	OK
5475	2026-09-24 05:50	56.54	OK	5476	2026-09-24 05:51	59.51	OK
5477	2026-09-24 05:52	61.20	OK	5478	2026-09-24 05:53	59.89	OK
5479	2026-09-24 05:54	62.07	OK	5480	2026-09-24 05:55	58.70	OK
5481	2026-09-24 05:56	59.03	OK	5482	2026-09-24 05:57	56.66	OK
5483	2026-09-24 05:58	59.97	OK	5484	2026-09-24 05:59	59.80	OK
5485	2026-09-24 06:00	57.85	OK	5486	2026-09-24 06:01	58.44	OK
5487	2026-09-24 06:02	62.32	OK	5488	2026-09-24 06:03	60.81	OK
5489	2026-09-24 06:04	60.85	OK	5490	2026-09-24 06:05	59.62	OK
5491	2026-09-24 06:06	57.34	OK	5492	2026-09-24 06:07	58.59	OK
5493	2026-09-24 06:08	60.33	OK	5494	2026-09-24 06:09	59.12	OK
5495	2026-09-24 06:10	59.64	OK	5496	2026-09-24 06:11	56.94	OK
5497	2026-09-24 06:12	62.46	OK	5498	2026-09-24 06:13	59.34	OK
5499	2026-09-24 06:14	60.56	OK	5500	2026-09-24 06:15	61.66	OK
5501	2026-09-24 06:16	59.84	OK	5502	2026-09-24 06:17	60.61	OK
5503	2026-09-24 06:18	60.19	OK	5504	2026-09-24 06:19	59.08	OK
5505	2026-09-24 06:20	58.67	OK	5506	2026-09-24 06:21	58.94	OK
5507	2026-09-24 06:22	58.28	OK	5508	2026-09-24 06:23	58.68	OK
5509	2026-09-24 06:24	60.03	OK	5510	2026-09-24 06:25	60.34	OK
5511	2026-09-24 06:26	59.96	OK	5512	2026-09-24 06:27	58.55	OK
5513	2026-09-24 06:28	58.84	OK	5514	2026-09-24 06:29	56.40	OK
5515	2026-09-24 06:30	55.70	OK	5516	2026-09-24 06:31	58.61	OK
5517	2026-09-24 06:32	60.51	OK	5518	2026-09-24 06:33	59.48	OK
5519	2026-09-24 06:34	55.35	OK	5520	2026-09-24 06:35	59.28	OK
5521	2026-09-24 06:36	60.07	OK	5522	2026-09-24 06:37	59.64	OK
5523	2026-09-24 06:38	59.12	OK	5524	2026-09-24 06:39	59.17	OK
5525	2026-09-24 06:40	57.62	OK	5526	2026-09-24 06:41	59.46	OK
5527	2026-09-24 06:42	56.85	OK	5528	2026-09-24 06:43	60.76	OK
5529	2026-09-24 06:44	57.77	OK	5530	2026-09-24 06:45	58.15	OK
5531	2026-09-24 06:46	59.10	OK	5532	2026-09-24 06:47	59.75	OK
5533	2026-09-24 06:48	58.38	OK	5534	2026-09-24 06:49	59.11	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5535	2026-09-24 06:50	58.77	OK	5536	2026-09-24 06:51	60.57	OK
5537	2026-09-24 06:52	58.14	OK	5538	2026-09-24 06:53	57.23	OK
5539	2026-09-24 06:54	57.56	OK	5540	2026-09-24 06:55	60.00	OK
5541	2026-09-24 06:56	60.61	OK	5542	2026-09-24 06:57	57.89	OK
5543	2026-09-24 06:58	59.27	OK	5544	2026-09-24 06:59	57.06	OK
5545	2026-09-24 07:00	59.62	OK	5546	2026-09-24 07:01	59.55	OK
5547	2026-09-24 07:02	62.36	OK	5548	2026-09-24 07:03	58.33	OK
5549	2026-09-24 07:04	62.00	OK	5550	2026-09-24 07:05	56.33	OK
5551	2026-09-24 07:06	60.87	OK	5552	2026-09-24 07:07	58.87	OK
5553	2026-09-24 07:08	61.33	OK	5554	2026-09-24 07:09	59.48	OK
5555	2026-09-24 07:10	59.82	OK	5556	2026-09-24 07:11	59.09	OK
5557	2026-09-24 07:12	59.83	OK	5558	2026-09-24 07:13	60.72	OK
5559	2026-09-24 07:14	59.10	OK	5560	2026-09-24 07:15	60.00	OK
5561	2026-09-24 07:16	60.35	OK	5562	2026-09-24 07:17	57.03	OK
5563	2026-09-24 07:18	59.87	OK	5564	2026-09-24 07:19	58.56	OK
5565	2026-09-24 07:20	58.86	OK	5566	2026-09-24 07:21	58.50	OK
5567	2026-09-24 07:22	60.02	OK	5568	2026-09-24 07:23	61.94	OK
5569	2026-09-24 07:24	58.74	OK	5570	2026-09-24 07:25	61.54	OK
5571	2026-09-24 07:26	58.26	OK	5572	2026-09-24 07:27	58.24	OK
5573	2026-09-24 07:28	56.64	OK	5574	2026-09-24 07:29	58.56	OK
5575	2026-09-24 07:30	57.83	OK	5576	2026-09-24 07:31	58.54	OK
5577	2026-09-24 07:32	59.58	OK	5578	2026-09-24 07:33	60.27	OK
5579	2026-09-24 07:34	57.82	OK	5580	2026-09-24 07:35	58.02	OK
5581	2026-09-24 07:36	61.32	OK	5582	2026-09-24 07:37	56.81	OK
5583	2026-09-24 07:38	58.78	OK	5584	2026-09-24 07:39	57.47	OK
5585	2026-09-24 07:40	59.41	OK	5586	2026-09-24 07:41	56.53	OK
5587	2026-09-24 07:42	58.29	OK	5588	2026-09-24 07:43	60.47	OK
5589	2026-09-24 07:44	58.34	OK	5590	2026-09-24 07:45	59.33	OK
5591	2026-09-24 07:46	60.84	OK	5592	2026-09-24 07:47	59.06	OK
5593	2026-09-24 07:48	59.53	OK	5594	2026-09-24 07:49	56.03	OK
5595	2026-09-24 07:50	58.92	OK	5596	2026-09-24 07:51	59.93	OK
5597	2026-09-24 07:52	57.60	OK	5598	2026-09-24 07:53	58.91	OK
5599	2026-09-24 07:54	59.09	OK	5600	2026-09-24 07:55	58.72	OK
5601	2026-09-24 07:56	60.00	OK	5602	2026-09-24 07:57	60.62	OK
5603	2026-09-24 07:58	57.60	OK	5604	2026-09-24 07:59	60.25	OK
5605	2026-09-24 08:00	61.48	OK	5606	2026-09-24 08:01	60.04	OK
5607	2026-09-24 08:02	59.68	OK	5608	2026-09-24 08:03	59.02	OK
5609	2026-09-24 08:04	58.26	OK	5610	2026-09-24 08:05	59.69	OK
5611	2026-09-24 08:06	58.36	OK	5612	2026-09-24 08:07	60.37	OK
5613	2026-09-24 08:08	59.60	OK	5614	2026-09-24 08:09	62.15	OK
5615	2026-09-24 08:10	59.61	OK	5616	2026-09-24 08:11	59.49	OK
5617	2026-09-24 08:12	55.37	OK	5618	2026-09-24 08:13	60.91	OK
5619	2026-09-24 08:14	57.35	OK	5620	2026-09-24 08:15	59.35	OK
5621	2026-09-24 08:16	59.96	OK	5622	2026-09-24 08:17	58.50	OK
5623	2026-09-24 08:18	59.37	OK	5624	2026-09-24 08:19	57.93	OK
5625	2026-09-24 08:20	61.76	OK	5626	2026-09-24 08:21	59.96	OK
5627	2026-09-24 08:22	60.76	OK	5628	2026-09-24 08:23	60.20	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5629	2026-09-24 08:24	59.01	OK	5630	2026-09-24 08:25	58.74	OK
5631	2026-09-24 08:26	58.40	OK	5632	2026-09-24 08:27	58.68	OK
5633	2026-09-24 08:28	60.30	OK	5634	2026-09-24 08:29	60.71	OK
5635	2026-09-24 08:30	57.96	OK	5636	2026-09-24 08:31	59.45	OK
5637	2026-09-24 08:32	59.87	OK	5638	2026-09-24 08:33	61.07	OK
5639	2026-09-24 08:34	58.85	OK	5640	2026-09-24 08:35	59.49	OK
5641	2026-09-24 08:36	59.55	OK	5642	2026-09-24 08:37	61.75	OK
5643	2026-09-24 08:38	62.02	OK	5644	2026-09-24 08:39	58.00	OK
5645	2026-09-24 08:40	58.57	OK	5646	2026-09-24 08:41	58.43	OK
5647	2026-09-24 08:42	59.89	OK	5648	2026-09-24 08:43	59.39	OK
5649	2026-09-24 08:44	60.52	OK	5650	2026-09-24 08:45	59.54	OK
5651	2026-09-24 08:46	61.17	OK	5652	2026-09-24 08:47	59.50	OK
5653	2026-09-24 08:48	61.02	OK	5654	2026-09-24 08:49	62.81	OK
5655	2026-09-24 08:50	57.62	OK	5656	2026-09-24 08:51	59.68	OK
5657	2026-09-24 08:52	61.06	OK	5658	2026-09-24 08:53	57.98	OK
5659	2026-09-24 08:54	60.96	OK	5660	2026-09-24 08:55	59.22	OK
5661	2026-09-24 08:56	61.26	OK	5662	2026-09-24 08:57	61.65	OK
5663	2026-09-24 08:58	62.44	OK	5664	2026-09-24 08:59	56.16	OK
5665	2026-09-24 09:00	58.13	OK	5666	2026-09-24 09:01	58.19	OK
5667	2026-09-24 09:02	59.72	OK	5668	2026-09-24 09:03	59.36	OK
5669	2026-09-24 09:04	60.63	OK	5670	2026-09-24 09:05	58.32	OK
5671	2026-09-24 09:06	58.10	OK	5672	2026-09-24 09:07	58.66	OK
5673	2026-09-24 09:08	60.14	OK	5674	2026-09-24 09:09	58.99	OK
5675	2026-09-24 09:10	61.04	OK	5676	2026-09-24 09:11	63.07	OK
5677	2026-09-24 09:12	57.61	OK	5678	2026-09-24 09:13	61.75	OK
5679	2026-09-24 09:14	60.01	OK	5680	2026-09-24 09:15	60.49	OK
5681	2026-09-24 09:16	58.62	OK	5682	2026-09-24 09:17	59.89	OK
5683	2026-09-24 09:18	62.01	OK	5684	2026-09-24 09:19	61.68	OK
5685	2026-09-24 09:20	58.93	OK	5686	2026-09-24 09:21	60.95	OK
5687	2026-09-24 09:22	61.40	OK	5688	2026-09-24 09:23	60.29	OK
5689	2026-09-24 09:24	58.92	OK	5690	2026-09-24 09:25	58.95	OK
5691	2026-09-24 09:26	61.63	OK	5692	2026-09-24 09:27	59.79	OK
5693	2026-09-24 09:28	58.83	OK	5694	2026-09-24 09:29	60.80	OK
5695	2026-09-24 09:30	59.16	OK	5696	2026-09-24 09:31	57.74	OK
5697	2026-09-24 09:32	60.17	OK	5698	2026-09-24 09:33	59.16	OK
5699	2026-09-24 09:34	61.39	OK	5700	2026-09-24 09:35	58.27	OK
5701	2026-09-24 09:36	60.02	OK	5702	2026-09-24 09:37	60.26	OK
5703	2026-09-24 09:38	60.44	OK	5704	2026-09-24 09:39	61.58	OK
5705	2026-09-24 09:40	60.81	OK	5706	2026-09-24 09:41	60.03	OK
5707	2026-09-24 09:42	59.86	OK	5708	2026-09-24 09:43	58.76	OK
5709	2026-09-24 09:44	58.27	OK	5710	2026-09-24 09:45	57.43	OK
5711	2026-09-24 09:46	60.50	OK	5712	2026-09-24 09:47	57.04	OK
5713	2026-09-24 09:48	59.46	OK	5714	2026-09-24 09:49	58.63	OK
5715	2026-09-24 09:50	60.74	OK	5716	2026-09-24 09:51	59.35	OK
5717	2026-09-24 09:52	60.48	OK	5718	2026-09-24 09:53	63.58	OK
5719	2026-09-24 09:54	60.41	OK	5720	2026-09-24 09:55	62.52	OK
5721	2026-09-24 09:56	61.52	OK	5722	2026-09-24 09:57	59.13	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5723	2026-09-24 09:58	59.60	OK	5724	2026-09-24 09:59	60.05	OK
5725	2026-09-24 10:00	61.41	OK	5726	2026-09-24 10:01	61.81	OK
5727	2026-09-24 10:02	60.02	OK	5728	2026-09-24 10:03	59.28	OK
5729	2026-09-24 10:04	61.47	OK	5730	2026-09-24 10:05	60.63	OK
5731	2026-09-24 10:06	59.45	OK	5732	2026-09-24 10:07	60.95	OK
5733	2026-09-24 10:08	60.91	OK	5734	2026-09-24 10:09	62.63	OK
5735	2026-09-24 10:10	58.42	OK	5736	2026-09-24 10:11	59.05	OK
5737	2026-09-24 10:12	58.23	OK	5738	2026-09-24 10:13	60.18	OK
5739	2026-09-24 10:14	59.05	OK	5740	2026-09-24 10:15	61.18	OK
5741	2026-09-24 10:16	61.41	OK	5742	2026-09-24 10:17	60.68	OK
5743	2026-09-24 10:18	62.68	OK	5744	2026-09-24 10:19	60.52	OK
5745	2026-09-24 10:20	61.36	OK	5746	2026-09-24 10:21	59.61	OK
5747	2026-09-24 10:22	59.62	OK	5748	2026-09-24 10:23	60.25	OK
5749	2026-09-24 10:24	60.98	OK	5750	2026-09-24 10:25	60.21	OK
5751	2026-09-24 10:26	60.15	OK	5752	2026-09-24 10:27	57.81	OK
5753	2026-09-24 10:28	60.89	OK	5754	2026-09-24 10:29	60.81	OK
5755	2026-09-24 10:30	60.24	OK	5756	2026-09-24 10:31	62.10	OK
5757	2026-09-24 10:32	59.34	OK	5758	2026-09-24 10:33	59.88	OK
5759	2026-09-24 10:34	59.86	OK	5760	2026-09-24 10:35	61.15	OK

Signal: Winding_Temp_V (°C)

Operating Limits: [10.0 to 130.0] • Observed: Min 63.36, Max 81.18, Mean 72.41

All 5,760 Raw Readings

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1	2026-09-20 10:36	77.65	OK	2	2026-09-20 10:37	78.09	OK
3	2026-09-20 10:38	77.37	OK	4	2026-09-20 10:39	76.66	OK
5	2026-09-20 10:40	79.21	OK	6	2026-09-20 10:41	78.65	OK
7	2026-09-20 10:42	77.60	OK	8	2026-09-20 10:43	77.88	OK
9	2026-09-20 10:44	76.16	OK	10	2026-09-20 10:45	78.13	OK
11	2026-09-20 10:46	77.88	OK	12	2026-09-20 10:47	79.31	OK
13	2026-09-20 10:48	80.23	OK	14	2026-09-20 10:49	76.09	OK
15	2026-09-20 10:50	80.38	OK	16	2026-09-20 10:51	75.57	OK
17	2026-09-20 10:52	77.64	OK	18	2026-09-20 10:53	78.07	OK
19	2026-09-20 10:54	78.20	OK	20	2026-09-20 10:55	78.90	OK
21	2026-09-20 10:56	80.01	OK	22	2026-09-20 10:57	78.42	OK
23	2026-09-20 10:58	77.79	OK	24	2026-09-20 10:59	78.42	OK
25	2026-09-20 11:00	77.94	OK	26	2026-09-20 11:01	77.27	OK
27	2026-09-20 11:02	77.61	OK	28	2026-09-20 11:03	78.88	OK
29	2026-09-20 11:04	76.73	OK	30	2026-09-20 11:05	77.93	OK
31	2026-09-20 11:06	77.13	OK	32	2026-09-20 11:07	78.50	OK
33	2026-09-20 11:08	77.21	OK	34	2026-09-20 11:09	78.43	OK
35	2026-09-20 11:10	78.72	OK	36	2026-09-20 11:11	77.34	OK
37	2026-09-20 11:12	79.73	OK	38	2026-09-20 11:13	79.64	OK
39	2026-09-20 11:14	76.81	OK	40	2026-09-20 11:15	77.57	OK
41	2026-09-20 11:16	79.27	OK	42	2026-09-20 11:17	78.45	OK
43	2026-09-20 11:18	75.25	OK	44	2026-09-20 11:19	77.79	OK
45	2026-09-20 11:20	78.41	OK	46	2026-09-20 11:21	78.71	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
47	2026-09-20 11:22	78.64	OK	48	2026-09-20 11:23	76.24	OK
49	2026-09-20 11:24	78.31	OK	50	2026-09-20 11:25	78.50	OK
51	2026-09-20 11:26	76.88	OK	52	2026-09-20 11:27	78.02	OK
53	2026-09-20 11:28	78.83	OK	54	2026-09-20 11:29	79.34	OK
55	2026-09-20 11:30	80.23	OK	56	2026-09-20 11:31	78.29	OK
57	2026-09-20 11:32	77.74	OK	58	2026-09-20 11:33	78.88	OK
59	2026-09-20 11:34	76.88	OK	60	2026-09-20 11:35	78.05	OK
61	2026-09-20 11:36	79.24	OK	62	2026-09-20 11:37	79.01	OK
63	2026-09-20 11:38	79.42	OK	64	2026-09-20 11:39	77.90	OK
65	2026-09-20 11:40	79.62	OK	66	2026-09-20 11:41	78.79	OK
67	2026-09-20 11:42	78.82	OK	68	2026-09-20 11:43	78.48	OK
69	2026-09-20 11:44	79.05	OK	70	2026-09-20 11:45	78.75	OK
71	2026-09-20 11:46	77.39	OK	72	2026-09-20 11:47	79.46	OK
73	2026-09-20 11:48	77.02	OK	74	2026-09-20 11:49	78.40	OK
75	2026-09-20 11:50	76.86	OK	76	2026-09-20 11:51	78.75	OK
77	2026-09-20 11:52	80.92	OK	78	2026-09-20 11:53	77.28	OK
79	2026-09-20 11:54	77.02	OK	80	2026-09-20 11:55	77.79	OK
81	2026-09-20 11:56	76.92	OK	82	2026-09-20 11:57	79.73	OK
83	2026-09-20 11:58	79.11	OK	84	2026-09-20 11:59	80.18	OK
85	2026-09-20 12:00	77.17	OK	86	2026-09-20 12:01	79.85	OK
87	2026-09-20 12:02	79.82	OK	88	2026-09-20 12:03	77.06	OK
89	2026-09-20 12:04	79.91	OK	90	2026-09-20 12:05	77.83	OK
91	2026-09-20 12:06	78.78	OK	92	2026-09-20 12:07	78.42	OK
93	2026-09-20 12:08	79.20	OK	94	2026-09-20 12:09	76.70	OK
95	2026-09-20 12:10	77.42	OK	96	2026-09-20 12:11	78.47	OK
97	2026-09-20 12:12	77.83	OK	98	2026-09-20 12:13	79.87	OK
99	2026-09-20 12:14	78.33	OK	100	2026-09-20 12:15	79.96	OK
101	2026-09-20 12:16	79.85	OK	102	2026-09-20 12:17	78.16	OK
103	2026-09-20 12:18	77.85	OK	104	2026-09-20 12:19	79.92	OK
105	2026-09-20 12:20	78.08	OK	106	2026-09-20 12:21	79.47	OK
107	2026-09-20 12:22	80.53	OK	108	2026-09-20 12:23	78.23	OK
109	2026-09-20 12:24	77.37	OK	110	2026-09-20 12:25	79.84	OK
111	2026-09-20 12:26	76.95	OK	112	2026-09-20 12:27	78.76	OK
113	2026-09-20 12:28	78.28	OK	114	2026-09-20 12:29	77.86	OK
115	2026-09-20 12:30	78.09	OK	116	2026-09-20 12:31	77.73	OK
117	2026-09-20 12:32	80.09	OK	118	2026-09-20 12:33	81.18	OK
119	2026-09-20 12:34	76.43	OK	120	2026-09-20 12:35	78.50	OK
121	2026-09-20 12:36	80.31	OK	122	2026-09-20 12:37	80.80	OK
123	2026-09-20 12:38	79.03	OK	124	2026-09-20 12:39	78.23	OK
125	2026-09-20 12:40	78.65	OK	126	2026-09-20 12:41	79.29	OK
127	2026-09-20 12:42	78.20	OK	128	2026-09-20 12:43	79.18	OK
129	2026-09-20 12:44	77.26	OK	130	2026-09-20 12:45	79.99	OK
131	2026-09-20 12:46	79.86	OK	132	2026-09-20 12:47	79.80	OK
133	2026-09-20 12:48	79.78	OK	134	2026-09-20 12:49	77.77	OK
135	2026-09-20 12:50	80.03	OK	136	2026-09-20 12:51	78.51	OK
137	2026-09-20 12:52	79.14	OK	138	2026-09-20 12:53	77.92	OK
139	2026-09-20 12:54	78.88	OK	140	2026-09-20 12:55	79.88	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
141	2026-09-20 12:56	78.31	OK	142	2026-09-20 12:57	79.73	OK
143	2026-09-20 12:58	78.82	OK	144	2026-09-20 12:59	78.06	OK
145	2026-09-20 13:00	78.31	OK	146	2026-09-20 13:01	79.16	OK
147	2026-09-20 13:02	77.35	OK	148	2026-09-20 13:03	77.39	OK
149	2026-09-20 13:04	79.32	OK	150	2026-09-20 13:05	78.91	OK
151	2026-09-20 13:06	78.55	OK	152	2026-09-20 13:07	79.40	OK
153	2026-09-20 13:08	77.78	OK	154	2026-09-20 13:09	79.96	OK
155	2026-09-20 13:10	78.85	OK	156	2026-09-20 13:11	77.38	OK
157	2026-09-20 13:12	79.31	OK	158	2026-09-20 13:13	79.47	OK
159	2026-09-20 13:14	79.67	OK	160	2026-09-20 13:15	78.13	OK
161	2026-09-20 13:16	79.43	OK	162	2026-09-20 13:17	78.80	OK
163	2026-09-20 13:18	79.02	OK	164	2026-09-20 13:19	79.91	OK
165	2026-09-20 13:20	79.67	OK	166	2026-09-20 13:21	79.04	OK
167	2026-09-20 13:22	80.90	OK	168	2026-09-20 13:23	77.54	OK
169	2026-09-20 13:24	78.90	OK	170	2026-09-20 13:25	79.22	OK
171	2026-09-20 13:26	78.62	OK	172	2026-09-20 13:27	77.43	OK
173	2026-09-20 13:28	77.95	OK	174	2026-09-20 13:29	79.81	OK
175	2026-09-20 13:30	79.24	OK	176	2026-09-20 13:31	78.61	OK
177	2026-09-20 13:32	77.70	OK	178	2026-09-20 13:33	77.61	OK
179	2026-09-20 13:34	79.04	OK	180	2026-09-20 13:35	79.54	OK
181	2026-09-20 13:36	79.63	OK	182	2026-09-20 13:37	79.63	OK
183	2026-09-20 13:38	78.72	OK	184	2026-09-20 13:39	79.08	OK
185	2026-09-20 13:40	78.47	OK	186	2026-09-20 13:41	81.08	OK
187	2026-09-20 13:42	79.83	OK	188	2026-09-20 13:43	79.46	OK
189	2026-09-20 13:44	78.45	OK	190	2026-09-20 13:45	78.89	OK
191	2026-09-20 13:46	78.07	OK	192	2026-09-20 13:47	76.51	OK
193	2026-09-20 13:48	77.95	OK	194	2026-09-20 13:49	78.37	OK
195	2026-09-20 13:50	77.25	OK	196	2026-09-20 13:51	77.51	OK
197	2026-09-20 13:52	77.16	OK	198	2026-09-20 13:53	77.98	OK
199	2026-09-20 13:54	77.74	OK	200	2026-09-20 13:55	78.56	OK
201	2026-09-20 13:56	76.18	OK	202	2026-09-20 13:57	79.13	OK
203	2026-09-20 13:58	77.72	OK	204	2026-09-20 13:59	78.42	OK
205	2026-09-20 14:00	79.41	OK	206	2026-09-20 14:01	77.49	OK
207	2026-09-20 14:02	79.35	OK	208	2026-09-20 14:03	78.42	OK
209	2026-09-20 14:04	79.30	OK	210	2026-09-20 14:05	78.72	OK
211	2026-09-20 14:06	79.71	OK	212	2026-09-20 14:07	77.41	OK
213	2026-09-20 14:08	77.64	OK	214	2026-09-20 14:09	78.13	OK
215	2026-09-20 14:10	80.39	OK	216	2026-09-20 14:11	78.82	OK
217	2026-09-20 14:12	77.94	OK	218	2026-09-20 14:13	78.19	OK
219	2026-09-20 14:14	78.24	OK	220	2026-09-20 14:15	80.15	OK
221	2026-09-20 14:16	78.76	OK	222	2026-09-20 14:17	78.58	OK
223	2026-09-20 14:18	75.26	OK	224	2026-09-20 14:19	77.96	OK
225	2026-09-20 14:20	76.65	OK	226	2026-09-20 14:21	77.32	OK
227	2026-09-20 14:22	78.16	OK	228	2026-09-20 14:23	79.01	OK
229	2026-09-20 14:24	77.83	OK	230	2026-09-20 14:25	80.75	OK
231	2026-09-20 14:26	77.90	OK	232	2026-09-20 14:27	79.08	OK
233	2026-09-20 14:28	78.49	OK	234	2026-09-20 14:29	77.58	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
235	2026-09-20 14:30	79.25	OK	236	2026-09-20 14:31	79.73	OK
237	2026-09-20 14:32	77.56	OK	238	2026-09-20 14:33	78.35	OK
239	2026-09-20 14:34	76.59	OK	240	2026-09-20 14:35	78.91	OK
241	2026-09-20 14:36	78.70	OK	242	2026-09-20 14:37	77.23	OK
243	2026-09-20 14:38	77.13	OK	244	2026-09-20 14:39	77.68	OK
245	2026-09-20 14:40	78.96	OK	246	2026-09-20 14:41	76.26	OK
247	2026-09-20 14:42	76.84	OK	248	2026-09-20 14:43	76.67	OK
249	2026-09-20 14:44	77.20	OK	250	2026-09-20 14:45	77.43	OK
251	2026-09-20 14:46	77.32	OK	252	2026-09-20 14:47	78.14	OK
253	2026-09-20 14:48	77.84	OK	254	2026-09-20 14:49	76.81	OK
255	2026-09-20 14:50	79.22	OK	256	2026-09-20 14:51	78.79	OK
257	2026-09-20 14:52	79.31	OK	258	2026-09-20 14:53	78.96	OK
259	2026-09-20 14:54	78.54	OK	260	2026-09-20 14:55	77.99	OK
261	2026-09-20 14:56	78.00	OK	262	2026-09-20 14:57	78.42	OK
263	2026-09-20 14:58	78.75	OK	264	2026-09-20 14:59	77.91	OK
265	2026-09-20 15:00	79.48	OK	266	2026-09-20 15:01	78.05	OK
267	2026-09-20 15:02	75.50	OK	268	2026-09-20 15:03	78.41	OK
269	2026-09-20 15:04	76.73	OK	270	2026-09-20 15:05	78.89	OK
271	2026-09-20 15:06	78.69	OK	272	2026-09-20 15:07	78.68	OK
273	2026-09-20 15:08	79.14	OK	274	2026-09-20 15:09	78.64	OK
275	2026-09-20 15:10	77.16	OK	276	2026-09-20 15:11	77.94	OK
277	2026-09-20 15:12	77.03	OK	278	2026-09-20 15:13	78.18	OK
279	2026-09-20 15:14	77.24	OK	280	2026-09-20 15:15	77.43	OK
281	2026-09-20 15:16	78.35	OK	282	2026-09-20 15:17	77.94	OK
283	2026-09-20 15:18	79.30	OK	284	2026-09-20 15:19	77.38	OK
285	2026-09-20 15:20	78.28	OK	286	2026-09-20 15:21	78.37	OK
287	2026-09-20 15:22	79.31	OK	288	2026-09-20 15:23	77.70	OK
289	2026-09-20 15:24	78.63	OK	290	2026-09-20 15:25	77.73	OK
291	2026-09-20 15:26	79.24	OK	292	2026-09-20 15:27	75.87	OK
293	2026-09-20 15:28	75.85	OK	294	2026-09-20 15:29	78.61	OK
295	2026-09-20 15:30	76.94	OK	296	2026-09-20 15:31	77.51	OK
297	2026-09-20 15:32	77.30	OK	298	2026-09-20 15:33	76.57	OK
299	2026-09-20 15:34	74.44	OK	300	2026-09-20 15:35	77.36	OK
301	2026-09-20 15:36	77.90	OK	302	2026-09-20 15:37	78.20	OK
303	2026-09-20 15:38	76.91	OK	304	2026-09-20 15:39	76.87	OK
305	2026-09-20 15:40	77.86	OK	306	2026-09-20 15:41	76.71	OK
307	2026-09-20 15:42	77.19	OK	308	2026-09-20 15:43	77.93	OK
309	2026-09-20 15:44	78.37	OK	310	2026-09-20 15:45	76.46	OK
311	2026-09-20 15:46	75.92	OK	312	2026-09-20 15:47	77.36	OK
313	2026-09-20 15:48	78.40	OK	314	2026-09-20 15:49	76.57	OK
315	2026-09-20 15:50	78.36	OK	316	2026-09-20 15:51	76.33	OK
317	2026-09-20 15:52	76.97	OK	318	2026-09-20 15:53	75.93	OK
319	2026-09-20 15:54	76.21	OK	320	2026-09-20 15:55	76.94	OK
321	2026-09-20 15:56	76.30	OK	322	2026-09-20 15:57	78.56	OK
323	2026-09-20 15:58	76.44	OK	324	2026-09-20 15:59	75.93	OK
325	2026-09-20 16:00	75.20	OK	326	2026-09-20 16:01	77.25	OK
327	2026-09-20 16:02	77.00	OK	328	2026-09-20 16:03	77.74	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
329	2026-09-20 16:04	75.46	OK	330	2026-09-20 16:05	75.65	OK
331	2026-09-20 16:06	77.83	OK	332	2026-09-20 16:07	77.59	OK
333	2026-09-20 16:08	78.12	OK	334	2026-09-20 16:09	75.34	OK
335	2026-09-20 16:10	74.91	OK	336	2026-09-20 16:11	76.43	OK
337	2026-09-20 16:12	75.22	OK	338	2026-09-20 16:13	76.29	OK
339	2026-09-20 16:14	76.77	OK	340	2026-09-20 16:15	76.09	OK
341	2026-09-20 16:16	76.97	OK	342	2026-09-20 16:17	76.73	OK
343	2026-09-20 16:18	75.41	OK	344	2026-09-20 16:19	77.33	OK
345	2026-09-20 16:20	75.82	OK	346	2026-09-20 16:21	77.74	OK
347	2026-09-20 16:22	77.45	OK	348	2026-09-20 16:23	76.26	OK
349	2026-09-20 16:24	74.82	OK	350	2026-09-20 16:25	74.79	OK
351	2026-09-20 16:26	75.18	OK	352	2026-09-20 16:27	76.31	OK
353	2026-09-20 16:28	76.59	OK	354	2026-09-20 16:29	75.27	OK
355	2026-09-20 16:30	75.81	OK	356	2026-09-20 16:31	75.47	OK
357	2026-09-20 16:32	75.33	OK	358	2026-09-20 16:33	74.99	OK
359	2026-09-20 16:34	74.49	OK	360	2026-09-20 16:35	76.89	OK
361	2026-09-20 16:36	75.70	OK	362	2026-09-20 16:37	73.90	OK
363	2026-09-20 16:38	74.71	OK	364	2026-09-20 16:39	76.27	OK
365	2026-09-20 16:40	75.94	OK	366	2026-09-20 16:41	77.43	OK
367	2026-09-20 16:42	76.92	OK	368	2026-09-20 16:43	76.44	OK
369	2026-09-20 16:44	74.39	OK	370	2026-09-20 16:45	77.12	OK
371	2026-09-20 16:46	75.74	OK	372	2026-09-20 16:47	75.52	OK
373	2026-09-20 16:48	76.66	OK	374	2026-09-20 16:49	74.50	OK
375	2026-09-20 16:50	75.62	OK	376	2026-09-20 16:51	77.61	OK
377	2026-09-20 16:52	76.10	OK	378	2026-09-20 16:53	74.23	OK
379	2026-09-20 16:54	75.51	OK	380	2026-09-20 16:55	74.53	OK
381	2026-09-20 16:56	75.13	OK	382	2026-09-20 16:57	76.78	OK
383	2026-09-20 16:58	75.38	OK	384	2026-09-20 16:59	76.77	OK
385	2026-09-20 17:00	76.57	OK	386	2026-09-20 17:01	75.52	OK
387	2026-09-20 17:02	76.10	OK	388	2026-09-20 17:03	76.07	OK
389	2026-09-20 17:04	74.30	OK	390	2026-09-20 17:05	75.88	OK
391	2026-09-20 17:06	73.83	OK	392	2026-09-20 17:07	75.00	OK
393	2026-09-20 17:08	74.42	OK	394	2026-09-20 17:09	74.16	OK
395	2026-09-20 17:10	76.60	OK	396	2026-09-20 17:11	72.46	OK
397	2026-09-20 17:12	76.62	OK	398	2026-09-20 17:13	75.42	OK
399	2026-09-20 17:14	73.72	OK	400	2026-09-20 17:15	75.60	OK
401	2026-09-20 17:16	74.97	OK	402	2026-09-20 17:17	74.94	OK
403	2026-09-20 17:18	76.64	OK	404	2026-09-20 17:19	75.39	OK
405	2026-09-20 17:20	73.60	OK	406	2026-09-20 17:21	75.11	OK
407	2026-09-20 17:22	74.64	OK	408	2026-09-20 17:23	76.78	OK
409	2026-09-20 17:24	73.30	OK	410	2026-09-20 17:25	74.24	OK
411	2026-09-20 17:26	76.09	OK	412	2026-09-20 17:27	73.24	OK
413	2026-09-20 17:28	72.93	OK	414	2026-09-20 17:29	74.12	OK
415	2026-09-20 17:30	73.20	OK	416	2026-09-20 17:31	75.28	OK
417	2026-09-20 17:32	75.48	OK	418	2026-09-20 17:33	76.51	OK
419	2026-09-20 17:34	74.48	OK	420	2026-09-20 17:35	73.74	OK
421	2026-09-20 17:36	73.25	OK	422	2026-09-20 17:37	75.29	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
423	2026-09-20 17:38	74.67	OK	424	2026-09-20 17:39	73.86	OK
425	2026-09-20 17:40	73.14	OK	426	2026-09-20 17:41	73.71	OK
427	2026-09-20 17:42	74.75	OK	428	2026-09-20 17:43	73.99	OK
429	2026-09-20 17:44	74.32	OK	430	2026-09-20 17:45	73.54	OK
431	2026-09-20 17:46	74.26	OK	432	2026-09-20 17:47	73.56	OK
433	2026-09-20 17:48	75.23	OK	434	2026-09-20 17:49	74.15	OK
435	2026-09-20 17:50	75.09	OK	436	2026-09-20 17:51	73.73	OK
437	2026-09-20 17:52	75.43	OK	438	2026-09-20 17:53	73.45	OK
439	2026-09-20 17:54	74.80	OK	440	2026-09-20 17:55	75.52	OK
441	2026-09-20 17:56	71.93	OK	442	2026-09-20 17:57	75.27	OK
443	2026-09-20 17:58	75.40	OK	444	2026-09-20 17:59	76.33	OK
445	2026-09-20 18:00	73.77	OK	446	2026-09-20 18:01	74.65	OK
447	2026-09-20 18:02	74.00	OK	448	2026-09-20 18:03	72.51	OK
449	2026-09-20 18:04	73.95	OK	450	2026-09-20 18:05	72.84	OK
451	2026-09-20 18:06	73.51	OK	452	2026-09-20 18:07	73.43	OK
453	2026-09-20 18:08	73.81	OK	454	2026-09-20 18:09	73.51	OK
455	2026-09-20 18:10	72.95	OK	456	2026-09-20 18:11	74.71	OK
457	2026-09-20 18:12	74.46	OK	458	2026-09-20 18:13	72.30	OK
459	2026-09-20 18:14	73.88	OK	460	2026-09-20 18:15	70.79	OK
461	2026-09-20 18:16	74.68	OK	462	2026-09-20 18:17	73.29	OK
463	2026-09-20 18:18	72.13	OK	464	2026-09-20 18:19	74.11	OK
465	2026-09-20 18:20	72.85	OK	466	2026-09-20 18:21	74.51	OK
467	2026-09-20 18:22	73.00	OK	468	2026-09-20 18:23	73.22	OK
469	2026-09-20 18:24	73.81	OK	470	2026-09-20 18:25	74.81	OK
471	2026-09-20 18:26	71.97	OK	472	2026-09-20 18:27	74.26	OK
473	2026-09-20 18:28	73.88	OK	474	2026-09-20 18:29	73.68	OK
475	2026-09-20 18:30	72.16	OK	476	2026-09-20 18:31	71.10	OK
477	2026-09-20 18:32	73.83	OK	478	2026-09-20 18:33	74.02	OK
479	2026-09-20 18:34	73.77	OK	480	2026-09-20 18:35	71.68	OK
481	2026-09-20 18:36	70.69	OK	482	2026-09-20 18:37	71.68	OK
483	2026-09-20 18:38	71.49	OK	484	2026-09-20 18:39	72.72	OK
485	2026-09-20 18:40	73.98	OK	486	2026-09-20 18:41	70.91	OK
487	2026-09-20 18:42	73.59	OK	488	2026-09-20 18:43	71.96	OK
489	2026-09-20 18:44	73.11	OK	490	2026-09-20 18:45	72.78	OK
491	2026-09-20 18:46	73.47	OK	492	2026-09-20 18:47	72.03	OK
493	2026-09-20 18:48	73.58	OK	494	2026-09-20 18:49	70.71	OK
495	2026-09-20 18:50	72.05	OK	496	2026-09-20 18:51	72.84	OK
497	2026-09-20 18:52	70.43	OK	498	2026-09-20 18:53	72.48	OK
499	2026-09-20 18:54	70.45	OK	500	2026-09-20 18:55	72.57	OK
501	2026-09-20 18:56	72.27	OK	502	2026-09-20 18:57	73.12	OK
503	2026-09-20 18:58	71.41	OK	504	2026-09-20 18:59	73.97	OK
505	2026-09-20 19:00	72.50	OK	506	2026-09-20 19:01	72.27	OK
507	2026-09-20 19:02	71.90	OK	508	2026-09-20 19:03	72.47	OK
509	2026-09-20 19:04	71.17	OK	510	2026-09-20 19:05	74.31	OK
511	2026-09-20 19:06	73.35	OK	512	2026-09-20 19:07	73.27	OK
513	2026-09-20 19:08	71.69	OK	514	2026-09-20 19:09	70.99	OK
515	2026-09-20 19:10	74.40	OK	516	2026-09-20 19:11	72.68	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
517	2026-09-20 19:12	73.04	OK	518	2026-09-20 19:13	70.41	OK
519	2026-09-20 19:14	72.24	OK	520	2026-09-20 19:15	71.44	OK
521	2026-09-20 19:16	70.45	OK	522	2026-09-20 19:17	70.90	OK
523	2026-09-20 19:18	71.62	OK	524	2026-09-20 19:19	73.15	OK
525	2026-09-20 19:20	72.03	OK	526	2026-09-20 19:21	71.78	OK
527	2026-09-20 19:22	70.29	OK	528	2026-09-20 19:23	71.68	OK
529	2026-09-20 19:24	72.15	OK	530	2026-09-20 19:25	70.91	OK
531	2026-09-20 19:26	72.98	OK	532	2026-09-20 19:27	71.72	OK
533	2026-09-20 19:28	73.38	OK	534	2026-09-20 19:29	73.84	OK
535	2026-09-20 19:30	70.15	OK	536	2026-09-20 19:31	69.43	OK
537	2026-09-20 19:32	68.85	OK	538	2026-09-20 19:33	70.26	OK
539	2026-09-20 19:34	70.84	OK	540	2026-09-20 19:35	69.86	OK
541	2026-09-20 19:36	70.56	OK	542	2026-09-20 19:37	71.11	OK
543	2026-09-20 19:38	71.62	OK	544	2026-09-20 19:39	70.75	OK
545	2026-09-20 19:40	70.54	OK	546	2026-09-20 19:41	69.31	OK
547	2026-09-20 19:42	72.26	OK	548	2026-09-20 19:43	69.47	OK
549	2026-09-20 19:44	72.11	OK	550	2026-09-20 19:45	71.51	OK
551	2026-09-20 19:46	69.74	OK	552	2026-09-20 19:47	71.30	OK
553	2026-09-20 19:48	69.97	OK	554	2026-09-20 19:49	67.79	OK
555	2026-09-20 19:50	70.02	OK	556	2026-09-20 19:51	71.94	OK
557	2026-09-20 19:52	70.34	OK	558	2026-09-20 19:53	69.14	OK
559	2026-09-20 19:54	70.35	OK	560	2026-09-20 19:55	69.79	OK
561	2026-09-20 19:56	70.72	OK	562	2026-09-20 19:57	68.83	OK
563	2026-09-20 19:58	70.37	OK	564	2026-09-20 19:59	72.03	OK
565	2026-09-20 20:00	71.32	OK	566	2026-09-20 20:01	72.82	OK
567	2026-09-20 20:02	68.22	OK	568	2026-09-20 20:03	70.66	OK
569	2026-09-20 20:04	71.32	OK	570	2026-09-20 20:05	71.27	OK
571	2026-09-20 20:06	70.46	OK	572	2026-09-20 20:07	69.43	OK
573	2026-09-20 20:08	70.91	OK	574	2026-09-20 20:09	69.71	OK
575	2026-09-20 20:10	69.18	OK	576	2026-09-20 20:11	69.91	OK
577	2026-09-20 20:12	70.15	OK	578	2026-09-20 20:13	71.74	OK
579	2026-09-20 20:14	69.47	OK	580	2026-09-20 20:15	69.85	OK
581	2026-09-20 20:16	69.49	OK	582	2026-09-20 20:17	72.11	OK
583	2026-09-20 20:18	68.94	OK	584	2026-09-20 20:19	70.88	OK
585	2026-09-20 20:20	69.03	OK	586	2026-09-20 20:21	68.47	OK
587	2026-09-20 20:22	68.54	OK	588	2026-09-20 20:23	70.95	OK
589	2026-09-20 20:24	69.51	OK	590	2026-09-20 20:25	69.34	OK
591	2026-09-20 20:26	70.28	OK	592	2026-09-20 20:27	71.54	OK
593	2026-09-20 20:28	69.88	OK	594	2026-09-20 20:29	69.42	OK
595	2026-09-20 20:30	68.28	OK	596	2026-09-20 20:31	70.10	OK
597	2026-09-20 20:32	70.81	OK	598	2026-09-20 20:33	70.16	OK
599	2026-09-20 20:34	70.11	OK	600	2026-09-20 20:35	69.45	OK
601	2026-09-20 20:36	71.59	OK	602	2026-09-20 20:37	68.82	OK
603	2026-09-20 20:38	69.65	OK	604	2026-09-20 20:39	69.88	OK
605	2026-09-20 20:40	70.44	OK	606	2026-09-20 20:41	69.98	OK
607	2026-09-20 20:42	69.46	OK	608	2026-09-20 20:43	70.68	OK
609	2026-09-20 20:44	69.14	OK	610	2026-09-20 20:45	68.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
611	2026-09-20 20:46	70.19	OK	612	2026-09-20 20:47	69.02	OK
613	2026-09-20 20:48	69.87	OK	614	2026-09-20 20:49	71.64	OK
615	2026-09-20 20:50	69.17	OK	616	2026-09-20 20:51	69.21	OK
617	2026-09-20 20:52	68.26	OK	618	2026-09-20 20:53	70.06	OK
619	2026-09-20 20:54	68.71	OK	620	2026-09-20 20:55	67.83	OK
621	2026-09-20 20:56	67.78	OK	622	2026-09-20 20:57	67.89	OK
623	2026-09-20 20:58	68.55	OK	624	2026-09-20 20:59	67.44	OK
625	2026-09-20 21:00	67.31	OK	626	2026-09-20 21:01	68.85	OK
627	2026-09-20 21:02	69.11	OK	628	2026-09-20 21:03	68.95	OK
629	2026-09-20 21:04	69.61	OK	630	2026-09-20 21:05	69.60	OK
631	2026-09-20 21:06	68.40	OK	632	2026-09-20 21:07	70.68	OK
633	2026-09-20 21:08	68.23	OK	634	2026-09-20 21:09	68.60	OK
635	2026-09-20 21:10	68.16	OK	636	2026-09-20 21:11	68.78	OK
637	2026-09-20 21:12	70.39	OK	638	2026-09-20 21:13	69.74	OK
639	2026-09-20 21:14	68.36	OK	640	2026-09-20 21:15	70.01	OK
641	2026-09-20 21:16	67.71	OK	642	2026-09-20 21:17	68.23	OK
643	2026-09-20 21:18	69.18	OK	644	2026-09-20 21:19	70.22	OK
645	2026-09-20 21:20	69.31	OK	646	2026-09-20 21:21	66.07	OK
647	2026-09-20 21:22	68.03	OK	648	2026-09-20 21:23	67.54	OK
649	2026-09-20 21:24	69.26	OK	650	2026-09-20 21:25	69.83	OK
651	2026-09-20 21:26	68.09	OK	652	2026-09-20 21:27	69.33	OK
653	2026-09-20 21:28	67.61	OK	654	2026-09-20 21:29	65.89	OK
655	2026-09-20 21:30	69.00	OK	656	2026-09-20 21:31	69.02	OK
657	2026-09-20 21:32	69.65	OK	658	2026-09-20 21:33	69.94	OK
659	2026-09-20 21:34	69.58	OK	660	2026-09-20 21:35	66.69	OK
661	2026-09-20 21:36	69.45	OK	662	2026-09-20 21:37	68.89	OK
663	2026-09-20 21:38	67.12	OK	664	2026-09-20 21:39	66.59	OK
665	2026-09-20 21:40	68.64	OK	666	2026-09-20 21:41	68.10	OK
667	2026-09-20 21:42	67.66	OK	668	2026-09-20 21:43	67.29	OK
669	2026-09-20 21:44	68.55	OK	670	2026-09-20 21:45	66.84	OK
671	2026-09-20 21:46	67.26	OK	672	2026-09-20 21:47	68.69	OK
673	2026-09-20 21:48	66.79	OK	674	2026-09-20 21:49	68.09	OK
675	2026-09-20 21:50	68.31	OK	676	2026-09-20 21:51	69.10	OK
677	2026-09-20 21:52	68.04	OK	678	2026-09-20 21:53	66.10	OK
679	2026-09-20 21:54	68.42	OK	680	2026-09-20 21:55	68.07	OK
681	2026-09-20 21:56	68.59	OK	682	2026-09-20 21:57	67.15	OK
683	2026-09-20 21:58	68.60	OK	684	2026-09-20 21:59	69.52	OK
685	2026-09-20 22:00	67.65	OK	686	2026-09-20 22:01	66.93	OK
687	2026-09-20 22:02	70.14	OK	688	2026-09-20 22:03	69.50	OK
689	2026-09-20 22:04	67.83	OK	690	2026-09-20 22:05	67.71	OK
691	2026-09-20 22:06	68.35	OK	692	2026-09-20 22:07	67.96	OK
693	2026-09-20 22:08	64.88	OK	694	2026-09-20 22:09	66.90	OK
695	2026-09-20 22:10	65.87	OK	696	2026-09-20 22:11	67.66	OK
697	2026-09-20 22:12	67.38	OK	698	2026-09-20 22:13	66.55	OK
699	2026-09-20 22:14	68.35	OK	700	2026-09-20 22:15	67.56	OK
701	2026-09-20 22:16	65.28	OK	702	2026-09-20 22:17	68.14	OK
703	2026-09-20 22:18	67.29	OK	704	2026-09-20 22:19	69.29	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
705	2026-09-20 22:20	67.76	OK	706	2026-09-20 22:21	69.60	OK
707	2026-09-20 22:22	67.04	OK	708	2026-09-20 22:23	65.99	OK
709	2026-09-20 22:24	64.79	OK	710	2026-09-20 22:25	67.51	OK
711	2026-09-20 22:26	68.42	OK	712	2026-09-20 22:27	68.80	OK
713	2026-09-20 22:28	66.14	OK	714	2026-09-20 22:29	68.91	OK
715	2026-09-20 22:30	66.43	OK	716	2026-09-20 22:31	66.88	OK
717	2026-09-20 22:32	67.38	OK	718	2026-09-20 22:33	66.92	OK
719	2026-09-20 22:34	68.66	OK	720	2026-09-20 22:35	66.40	OK
721	2026-09-20 22:36	67.44	OK	722	2026-09-20 22:37	67.25	OK
723	2026-09-20 22:38	66.55	OK	724	2026-09-20 22:39	67.82	OK
725	2026-09-20 22:40	66.49	OK	726	2026-09-20 22:41	67.52	OK
727	2026-09-20 22:42	66.94	OK	728	2026-09-20 22:43	64.86	OK
729	2026-09-20 22:44	67.76	OK	730	2026-09-20 22:45	67.32	OK
731	2026-09-20 22:46	66.39	OK	732	2026-09-20 22:47	66.66	OK
733	2026-09-20 22:48	67.82	OK	734	2026-09-20 22:49	64.90	OK
735	2026-09-20 22:50	66.90	OK	736	2026-09-20 22:51	67.10	OK
737	2026-09-20 22:52	69.78	OK	738	2026-09-20 22:53	65.41	OK
739	2026-09-20 22:54	65.06	OK	740	2026-09-20 22:55	66.16	OK
741	2026-09-20 22:56	68.09	OK	742	2026-09-20 22:57	66.20	OK
743	2026-09-20 22:58	66.07	OK	744	2026-09-20 22:59	67.89	OK
745	2026-09-20 23:00	68.07	OK	746	2026-09-20 23:01	67.55	OK
747	2026-09-20 23:02	65.59	OK	748	2026-09-20 23:03	65.40	OK
749	2026-09-20 23:04	67.88	OK	750	2026-09-20 23:05	68.67	OK
751	2026-09-20 23:06	66.24	OK	752	2026-09-20 23:07	68.08	OK
753	2026-09-20 23:08	67.98	OK	754	2026-09-20 23:09	66.15	OK
755	2026-09-20 23:10	67.46	OK	756	2026-09-20 23:11	66.35	OK
757	2026-09-20 23:12	67.90	OK	758	2026-09-20 23:13	66.13	OK
759	2026-09-20 23:14	67.44	OK	760	2026-09-20 23:15	67.36	OK
761	2026-09-20 23:16	64.81	OK	762	2026-09-20 23:17	65.53	OK
763	2026-09-20 23:18	65.75	OK	764	2026-09-20 23:19	66.24	OK
765	2026-09-20 23:20	64.76	OK	766	2026-09-20 23:21	67.00	OK
767	2026-09-20 23:22	68.66	OK	768	2026-09-20 23:23	65.86	OK
769	2026-09-20 23:24	66.15	OK	770	2026-09-20 23:25	66.26	OK
771	2026-09-20 23:26	68.93	OK	772	2026-09-20 23:27	67.11	OK
773	2026-09-20 23:28	66.25	OK	774	2026-09-20 23:29	68.28	OK
775	2026-09-20 23:30	67.53	OK	776	2026-09-20 23:31	68.03	OK
777	2026-09-20 23:32	67.95	OK	778	2026-09-20 23:33	66.82	OK
779	2026-09-20 23:34	65.33	OK	780	2026-09-20 23:35	64.62	OK
781	2026-09-20 23:36	66.60	OK	782	2026-09-20 23:37	66.78	OK
783	2026-09-20 23:38	66.66	OK	784	2026-09-20 23:39	65.40	OK
785	2026-09-20 23:40	67.33	OK	786	2026-09-20 23:41	66.79	OK
787	2026-09-20 23:42	67.36	OK	788	2026-09-20 23:43	65.05	OK
789	2026-09-20 23:44	66.17	OK	790	2026-09-20 23:45	66.08	OK
791	2026-09-20 23:46	66.35	OK	792	2026-09-20 23:47	65.97	OK
793	2026-09-20 23:48	65.11	OK	794	2026-09-20 23:49	66.64	OK
795	2026-09-20 23:50	65.20	OK	796	2026-09-20 23:51	65.89	OK
797	2026-09-20 23:52	66.76	OK	798	2026-09-20 23:53	65.92	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
799	2026-09-20 23:54	66.99	OK	800	2026-09-20 23:55	65.39	OK
801	2026-09-20 23:56	67.24	OK	802	2026-09-20 23:57	65.40	OK
803	2026-09-20 23:58	65.42	OK	804	2026-09-20 23:59	65.71	OK
805	2026-09-21 00:00	67.58	OK	806	2026-09-21 00:01	66.82	OK
807	2026-09-21 00:02	66.31	OK	808	2026-09-21 00:03	68.25	OK
809	2026-09-21 00:04	66.11	OK	810	2026-09-21 00:05	67.02	OK
811	2026-09-21 00:06	67.78	OK	812	2026-09-21 00:07	65.41	OK
813	2026-09-21 00:08	66.62	OK	814	2026-09-21 00:09	67.27	OK
815	2026-09-21 00:10	64.21	OK	816	2026-09-21 00:11	64.52	OK
817	2026-09-21 00:12	64.15	OK	818	2026-09-21 00:13	67.31	OK
819	2026-09-21 00:14	67.10	OK	820	2026-09-21 00:15	65.38	OK
821	2026-09-21 00:16	66.87	OK	822	2026-09-21 00:17	66.31	OK
823	2026-09-21 00:18	65.85	OK	824	2026-09-21 00:19	66.63	OK
825	2026-09-21 00:20	65.51	OK	826	2026-09-21 00:21	65.52	OK
827	2026-09-21 00:22	64.69	OK	828	2026-09-21 00:23	67.83	OK
829	2026-09-21 00:24	66.70	OK	830	2026-09-21 00:25	65.46	OK
831	2026-09-21 00:26	64.65	OK	832	2026-09-21 00:27	65.87	OK
833	2026-09-21 00:28	64.69	OK	834	2026-09-21 00:29	65.89	OK
835	2026-09-21 00:30	66.17	OK	836	2026-09-21 00:31	65.90	OK
837	2026-09-21 00:32	67.15	OK	838	2026-09-21 00:33	66.28	OK
839	2026-09-21 00:34	65.99	OK	840	2026-09-21 00:35	65.50	OK
841	2026-09-21 00:36	66.60	OK	842	2026-09-21 00:37	64.57	OK
843	2026-09-21 00:38	67.25	OK	844	2026-09-21 00:39	67.98	OK
845	2026-09-21 00:40	66.53	OK	846	2026-09-21 00:41	65.79	OK
847	2026-09-21 00:42	67.56	OK	848	2026-09-21 00:43	68.22	OK
849	2026-09-21 00:44	65.14	OK	850	2026-09-21 00:45	67.53	OK
851	2026-09-21 00:46	65.81	OK	852	2026-09-21 00:47	65.68	OK
853	2026-09-21 00:48	65.41	OK	854	2026-09-21 00:49	67.12	OK
855	2026-09-21 00:50	64.02	OK	856	2026-09-21 00:51	65.46	OK
857	2026-09-21 00:52	65.49	OK	858	2026-09-21 00:53	64.91	OK
859	2026-09-21 00:54	66.90	OK	860	2026-09-21 00:55	65.18	OK
861	2026-09-21 00:56	67.37	OK	862	2026-09-21 00:57	65.28	OK
863	2026-09-21 00:58	67.90	OK	864	2026-09-21 00:59	65.97	OK
865	2026-09-21 01:00	66.93	OK	866	2026-09-21 01:01	68.30	OK
867	2026-09-21 01:02	65.86	OK	868	2026-09-21 01:03	68.58	OK
869	2026-09-21 01:04	64.88	OK	870	2026-09-21 01:05	65.90	OK
871	2026-09-21 01:06	67.07	OK	872	2026-09-21 01:07	65.84	OK
873	2026-09-21 01:08	65.93	OK	874	2026-09-21 01:09	66.05	OK
875	2026-09-21 01:10	66.90	OK	876	2026-09-21 01:11	66.51	OK
877	2026-09-21 01:12	65.21	OK	878	2026-09-21 01:13	66.41	OK
879	2026-09-21 01:14	67.02	OK	880	2026-09-21 01:15	66.42	OK
881	2026-09-21 01:16	67.94	OK	882	2026-09-21 01:17	65.58	OK
883	2026-09-21 01:18	67.30	OK	884	2026-09-21 01:19	64.94	OK
885	2026-09-21 01:20	68.36	OK	886	2026-09-21 01:21	64.69	OK
887	2026-09-21 01:22	67.38	OK	888	2026-09-21 01:23	67.23	OK
889	2026-09-21 01:24	65.60	OK	890	2026-09-21 01:25	64.63	OK
891	2026-09-21 01:26	65.76	OK	892	2026-09-21 01:27	67.20	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
893	2026-09-21 01:28	67.00	OK	894	2026-09-21 01:29	66.86	OK
895	2026-09-21 01:30	66.14	OK	896	2026-09-21 01:31	63.98	OK
897	2026-09-21 01:32	64.59	OK	898	2026-09-21 01:33	67.01	OK
899	2026-09-21 01:34	64.45	OK	900	2026-09-21 01:35	68.51	OK
901	2026-09-21 01:36	67.09	OK	902	2026-09-21 01:37	65.73	OK
903	2026-09-21 01:38	66.14	OK	904	2026-09-21 01:39	67.22	OK
905	2026-09-21 01:40	65.91	OK	906	2026-09-21 01:41	66.20	OK
907	2026-09-21 01:42	65.25	OK	908	2026-09-21 01:43	66.96	OK
909	2026-09-21 01:44	66.59	OK	910	2026-09-21 01:45	67.38	OK
911	2026-09-21 01:46	65.48	OK	912	2026-09-21 01:47	66.36	OK
913	2026-09-21 01:48	67.67	OK	914	2026-09-21 01:49	64.86	OK
915	2026-09-21 01:50	65.15	OK	916	2026-09-21 01:51	66.17	OK
917	2026-09-21 01:52	65.07	OK	918	2026-09-21 01:53	67.35	OK
919	2026-09-21 01:54	64.24	OK	920	2026-09-21 01:55	63.39	OK
921	2026-09-21 01:56	66.52	OK	922	2026-09-21 01:57	67.50	OK
923	2026-09-21 01:58	67.23	OK	924	2026-09-21 01:59	67.48	OK
925	2026-09-21 02:00	65.24	OK	926	2026-09-21 02:01	67.00	OK
927	2026-09-21 02:02	66.49	OK	928	2026-09-21 02:03	67.02	OK
929	2026-09-21 02:04	65.59	OK	930	2026-09-21 02:05	66.25	OK
931	2026-09-21 02:06	66.06	OK	932	2026-09-21 02:07	65.05	OK
933	2026-09-21 02:08	69.09	OK	934	2026-09-21 02:09	67.38	OK
935	2026-09-21 02:10	66.70	OK	936	2026-09-21 02:11	66.94	OK
937	2026-09-21 02:12	64.43	OK	938	2026-09-21 02:13	65.87	OK
939	2026-09-21 02:14	66.64	OK	940	2026-09-21 02:15	65.02	OK
941	2026-09-21 02:16	65.82	OK	942	2026-09-21 02:17	66.88	OK
943	2026-09-21 02:18	66.71	OK	944	2026-09-21 02:19	66.53	OK
945	2026-09-21 02:20	66.53	OK	946	2026-09-21 02:21	65.94	OK
947	2026-09-21 02:22	65.02	OK	948	2026-09-21 02:23	65.50	OK
949	2026-09-21 02:24	66.96	OK	950	2026-09-21 02:25	66.77	OK
951	2026-09-21 02:26	65.52	OK	952	2026-09-21 02:27	66.76	OK
953	2026-09-21 02:28	65.82	OK	954	2026-09-21 02:29	65.88	OK
955	2026-09-21 02:30	66.87	OK	956	2026-09-21 02:31	65.93	OK
957	2026-09-21 02:32	67.93	OK	958	2026-09-21 02:33	68.36	OK
959	2026-09-21 02:34	66.46	OK	960	2026-09-21 02:35	65.95	OK
961	2026-09-21 02:36	67.56	OK	962	2026-09-21 02:37	65.44	OK
963	2026-09-21 02:38	67.64	OK	964	2026-09-21 02:39	66.80	OK
965	2026-09-21 02:40	66.65	OK	966	2026-09-21 02:41	65.81	OK
967	2026-09-21 02:42	67.13	OK	968	2026-09-21 02:43	66.54	OK
969	2026-09-21 02:44	66.26	OK	970	2026-09-21 02:45	67.05	OK
971	2026-09-21 02:46	66.38	OK	972	2026-09-21 02:47	68.33	OK
973	2026-09-21 02:48	69.14	OK	974	2026-09-21 02:49	66.82	OK
975	2026-09-21 02:50	67.92	OK	976	2026-09-21 02:51	66.84	OK
977	2026-09-21 02:52	67.55	OK	978	2026-09-21 02:53	66.00	OK
979	2026-09-21 02:54	67.05	OK	980	2026-09-21 02:55	65.84	OK
981	2026-09-21 02:56	67.63	OK	982	2026-09-21 02:57	68.78	OK
983	2026-09-21 02:58	65.62	OK	984	2026-09-21 02:59	68.31	OK
985	2026-09-21 03:00	67.99	OK	986	2026-09-21 03:01	66.59	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
987	2026-09-21 03:02	66.84	OK	988	2026-09-21 03:03	67.58	OK
989	2026-09-21 03:04	67.35	OK	990	2026-09-21 03:05	67.67	OK
991	2026-09-21 03:06	67.50	OK	992	2026-09-21 03:07	65.67	OK
993	2026-09-21 03:08	67.45	OK	994	2026-09-21 03:09	67.83	OK
995	2026-09-21 03:10	69.07	OK	996	2026-09-21 03:11	67.26	OK
997	2026-09-21 03:12	68.08	OK	998	2026-09-21 03:13	67.70	OK
999	2026-09-21 03:14	67.28	OK	1000	2026-09-21 03:15	67.93	OK
1001	2026-09-21 03:16	68.25	OK	1002	2026-09-21 03:17	67.57	OK
1003	2026-09-21 03:18	68.81	OK	1004	2026-09-21 03:19	67.64	OK
1005	2026-09-21 03:20	67.73	OK	1006	2026-09-21 03:21	68.94	OK
1007	2026-09-21 03:22	68.96	OK	1008	2026-09-21 03:23	66.84	OK
1009	2026-09-21 03:24	67.29	OK	1010	2026-09-21 03:25	68.55	OK
1011	2026-09-21 03:26	68.64	OK	1012	2026-09-21 03:27	66.85	OK
1013	2026-09-21 03:28	68.14	OK	1014	2026-09-21 03:29	68.98	OK
1015	2026-09-21 03:30	68.72	OK	1016	2026-09-21 03:31	65.96	OK
1017	2026-09-21 03:32	69.31	OK	1018	2026-09-21 03:33	67.77	OK
1019	2026-09-21 03:34	69.82	OK	1020	2026-09-21 03:35	68.07	OK
1021	2026-09-21 03:36	66.71	OK	1022	2026-09-21 03:37	68.86	OK
1023	2026-09-21 03:38	67.50	OK	1024	2026-09-21 03:39	67.94	OK
1025	2026-09-21 03:40	66.86	OK	1026	2026-09-21 03:41	67.81	OK
1027	2026-09-21 03:42	67.31	OK	1028	2026-09-21 03:43	66.68	OK
1029	2026-09-21 03:44	69.60	OK	1030	2026-09-21 03:45	68.55	OK
1031	2026-09-21 03:46	69.13	OK	1032	2026-09-21 03:47	66.24	OK
1033	2026-09-21 03:48	68.67	OK	1034	2026-09-21 03:49	67.45	OK
1035	2026-09-21 03:50	68.51	OK	1036	2026-09-21 03:51	69.63	OK
1037	2026-09-21 03:52	67.50	OK	1038	2026-09-21 03:53	68.71	OK
1039	2026-09-21 03:54	66.32	OK	1040	2026-09-21 03:55	69.84	OK
1041	2026-09-21 03:56	67.97	OK	1042	2026-09-21 03:57	65.93	OK
1043	2026-09-21 03:58	67.98	OK	1044	2026-09-21 03:59	65.83	OK
1045	2026-09-21 04:00	68.04	OK	1046	2026-09-21 04:01	68.31	OK
1047	2026-09-21 04:02	66.84	OK	1048	2026-09-21 04:03	69.61	OK
1049	2026-09-21 04:04	65.83	OK	1050	2026-09-21 04:05	68.51	OK
1051	2026-09-21 04:06	70.65	OK	1052	2026-09-21 04:07	69.41	OK
1053	2026-09-21 04:08	68.16	OK	1054	2026-09-21 04:09	67.70	OK
1055	2026-09-21 04:10	69.14	OK	1056	2026-09-21 04:11	70.25	OK
1057	2026-09-21 04:12	67.00	OK	1058	2026-09-21 04:13	67.28	OK
1059	2026-09-21 04:14	69.67	OK	1060	2026-09-21 04:15	68.19	OK
1061	2026-09-21 04:16	68.43	OK	1062	2026-09-21 04:17	66.41	OK
1063	2026-09-21 04:18	66.44	OK	1064	2026-09-21 04:19	69.38	OK
1065	2026-09-21 04:20	67.70	OK	1066	2026-09-21 04:21	68.96	OK
1067	2026-09-21 04:22	68.02	OK	1068	2026-09-21 04:23	69.91	OK
1069	2026-09-21 04:24	68.74	OK	1070	2026-09-21 04:25	69.68	OK
1071	2026-09-21 04:26	67.95	OK	1072	2026-09-21 04:27	66.36	OK
1073	2026-09-21 04:28	67.89	OK	1074	2026-09-21 04:29	69.03	OK
1075	2026-09-21 04:30	67.82	OK	1076	2026-09-21 04:31	67.56	OK
1077	2026-09-21 04:32	69.52	OK	1078	2026-09-21 04:33	68.32	OK
1079	2026-09-21 04:34	70.75	OK	1080	2026-09-21 04:35	69.16	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1081	2026-09-21 04:36	69.12	OK	1082	2026-09-21 04:37	68.79	OK
1083	2026-09-21 04:38	69.28	OK	1084	2026-09-21 04:39	70.42	OK
1085	2026-09-21 04:40	70.13	OK	1086	2026-09-21 04:41	68.71	OK
1087	2026-09-21 04:42	71.26	OK	1088	2026-09-21 04:43	69.37	OK
1089	2026-09-21 04:44	68.16	OK	1090	2026-09-21 04:45	69.05	OK
1091	2026-09-21 04:46	70.21	OK	1092	2026-09-21 04:47	67.06	OK
1093	2026-09-21 04:48	70.25	OK	1094	2026-09-21 04:49	68.19	OK
1095	2026-09-21 04:50	66.62	OK	1096	2026-09-21 04:51	70.88	OK
1097	2026-09-21 04:52	70.63	OK	1098	2026-09-21 04:53	67.73	OK
1099	2026-09-21 04:54	69.97	OK	1100	2026-09-21 04:55	70.42	OK
1101	2026-09-21 04:56	68.80	OK	1102	2026-09-21 04:57	70.22	OK
1103	2026-09-21 04:58	69.46	OK	1104	2026-09-21 04:59	70.38	OK
1105	2026-09-21 05:00	70.67	OK	1106	2026-09-21 05:01	69.54	OK
1107	2026-09-21 05:02	70.34	OK	1108	2026-09-21 05:03	67.70	OK
1109	2026-09-21 05:04	67.91	OK	1110	2026-09-21 05:05	71.12	OK
1111	2026-09-21 05:06	70.56	OK	1112	2026-09-21 05:07	68.73	OK
1113	2026-09-21 05:08	70.57	OK	1114	2026-09-21 05:09	68.87	OK
1115	2026-09-21 05:10	70.24	OK	1116	2026-09-21 05:11	71.54	OK
1117	2026-09-21 05:12	71.28	OK	1118	2026-09-21 05:13	70.96	OK
1119	2026-09-21 05:14	69.12	OK	1120	2026-09-21 05:15	68.65	OK
1121	2026-09-21 05:16	70.80	OK	1122	2026-09-21 05:17	70.52	OK
1123	2026-09-21 05:18	69.41	OK	1124	2026-09-21 05:19	69.86	OK
1125	2026-09-21 05:20	70.53	OK	1126	2026-09-21 05:21	69.52	OK
1127	2026-09-21 05:22	70.84	OK	1128	2026-09-21 05:23	72.04	OK
1129	2026-09-21 05:24	71.31	OK	1130	2026-09-21 05:25	69.68	OK
1131	2026-09-21 05:26	68.93	OK	1132	2026-09-21 05:27	70.26	OK
1133	2026-09-21 05:28	68.64	OK	1134	2026-09-21 05:29	71.80	OK
1135	2026-09-21 05:30	70.23	OK	1136	2026-09-21 05:31	70.01	OK
1137	2026-09-21 05:32	69.47	OK	1138	2026-09-21 05:33	69.45	OK
1139	2026-09-21 05:34	68.65	OK	1140	2026-09-21 05:35	71.72	OK
1141	2026-09-21 05:36	68.66	OK	1142	2026-09-21 05:37	72.35	OK
1143	2026-09-21 05:38	71.18	OK	1144	2026-09-21 05:39	71.21	OK
1145	2026-09-21 05:40	70.80	OK	1146	2026-09-21 05:41	71.36	OK
1147	2026-09-21 05:42	71.77	OK	1148	2026-09-21 05:43	70.99	OK
1149	2026-09-21 05:44	70.62	OK	1150	2026-09-21 05:45	71.28	OK
1151	2026-09-21 05:46	71.70	OK	1152	2026-09-21 05:47	70.75	OK
1153	2026-09-21 05:48	69.85	OK	1154	2026-09-21 05:49	69.40	OK
1155	2026-09-21 05:50	68.39	OK	1156	2026-09-21 05:51	69.96	OK
1157	2026-09-21 05:52	70.14	OK	1158	2026-09-21 05:53	70.91	OK
1159	2026-09-21 05:54	71.07	OK	1160	2026-09-21 05:55	71.02	OK
1161	2026-09-21 05:56	72.10	OK	1162	2026-09-21 05:57	70.17	OK
1163	2026-09-21 05:58	70.06	OK	1164	2026-09-21 05:59	70.65	OK
1165	2026-09-21 06:00	71.00	OK	1166	2026-09-21 06:01	71.17	OK
1167	2026-09-21 06:02	70.02	OK	1168	2026-09-21 06:03	71.65	OK
1169	2026-09-21 06:04	71.40	OK	1170	2026-09-21 06:05	69.64	OK
1171	2026-09-21 06:06	71.66	OK	1172	2026-09-21 06:07	71.43	OK
1173	2026-09-21 06:08	71.71	OK	1174	2026-09-21 06:09	71.16	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1175	2026-09-21 06:10	72.60	OK	1176	2026-09-21 06:11	71.25	OK
1177	2026-09-21 06:12	69.56	OK	1178	2026-09-21 06:13	72.19	OK
1179	2026-09-21 06:14	71.75	OK	1180	2026-09-21 06:15	71.44	OK
1181	2026-09-21 06:16	72.33	OK	1182	2026-09-21 06:17	72.13	OK
1183	2026-09-21 06:18	70.42	OK	1184	2026-09-21 06:19	72.95	OK
1185	2026-09-21 06:20	70.57	OK	1186	2026-09-21 06:21	70.73	OK
1187	2026-09-21 06:22	73.62	OK	1188	2026-09-21 06:23	71.15	OK
1189	2026-09-21 06:24	71.71	OK	1190	2026-09-21 06:25	71.31	OK
1191	2026-09-21 06:26	71.35	OK	1192	2026-09-21 06:27	73.81	OK
1193	2026-09-21 06:28	72.60	OK	1194	2026-09-21 06:29	70.68	OK
1195	2026-09-21 06:30	72.65	OK	1196	2026-09-21 06:31	70.87	OK
1197	2026-09-21 06:32	73.13	OK	1198	2026-09-21 06:33	71.46	OK
1199	2026-09-21 06:34	73.44	OK	1200	2026-09-21 06:35	71.08	OK
1201	2026-09-21 06:36	71.97	OK	1202	2026-09-21 06:37	72.18	OK
1203	2026-09-21 06:38	70.90	OK	1204	2026-09-21 06:39	70.93	OK
1205	2026-09-21 06:40	71.46	OK	1206	2026-09-21 06:41	71.59	OK
1207	2026-09-21 06:42	73.11	OK	1208	2026-09-21 06:43	72.96	OK
1209	2026-09-21 06:44	72.81	OK	1210	2026-09-21 06:45	71.65	OK
1211	2026-09-21 06:46	70.72	OK	1212	2026-09-21 06:47	71.23	OK
1213	2026-09-21 06:48	72.11	OK	1214	2026-09-21 06:49	73.51	OK
1215	2026-09-21 06:50	73.54	OK	1216	2026-09-21 06:51	71.59	OK
1217	2026-09-21 06:52	72.50	OK	1218	2026-09-21 06:53	73.07	OK
1219	2026-09-21 06:54	71.44	OK	1220	2026-09-21 06:55	73.20	OK
1221	2026-09-21 06:56	73.54	OK	1222	2026-09-21 06:57	71.91	OK
1223	2026-09-21 06:58	73.41	OK	1224	2026-09-21 06:59	70.88	OK
1225	2026-09-21 07:00	72.96	OK	1226	2026-09-21 07:01	73.49	OK
1227	2026-09-21 07:02	69.94	OK	1228	2026-09-21 07:03	73.66	OK
1229	2026-09-21 07:04	73.12	OK	1230	2026-09-21 07:05	72.30	OK
1231	2026-09-21 07:06	72.95	OK	1232	2026-09-21 07:07	74.82	OK
1233	2026-09-21 07:08	73.31	OK	1234	2026-09-21 07:09	72.71	OK
1235	2026-09-21 07:10	73.06	OK	1236	2026-09-21 07:11	72.52	OK
1237	2026-09-21 07:12	71.88	OK	1238	2026-09-21 07:13	71.97	OK
1239	2026-09-21 07:14	75.24	OK	1240	2026-09-21 07:15	73.03	OK
1241	2026-09-21 07:16	71.43	OK	1242	2026-09-21 07:17	73.02	OK
1243	2026-09-21 07:18	72.47	OK	1244	2026-09-21 07:19	74.49	OK
1245	2026-09-21 07:20	73.76	OK	1246	2026-09-21 07:21	75.69	OK
1247	2026-09-21 07:22	73.29	OK	1248	2026-09-21 07:23	73.04	OK
1249	2026-09-21 07:24	71.47	OK	1250	2026-09-21 07:25	74.41	OK
1251	2026-09-21 07:26	72.00	OK	1252	2026-09-21 07:27	73.57	OK
1253	2026-09-21 07:28	72.75	OK	1254	2026-09-21 07:29	74.10	OK
1255	2026-09-21 07:30	73.01	OK	1256	2026-09-21 07:31	74.00	OK
1257	2026-09-21 07:32	73.33	OK	1258	2026-09-21 07:33	75.47	OK
1259	2026-09-21 07:34	73.38	OK	1260	2026-09-21 07:35	74.01	OK
1261	2026-09-21 07:36	72.08	OK	1262	2026-09-21 07:37	75.36	OK
1263	2026-09-21 07:38	72.65	OK	1264	2026-09-21 07:39	73.54	OK
1265	2026-09-21 07:40	72.87	OK	1266	2026-09-21 07:41	72.97	OK
1267	2026-09-21 07:42	73.09	OK	1268	2026-09-21 07:43	71.89	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1269	2026-09-21 07:44	73.31	OK	1270	2026-09-21 07:45	75.13	OK
1271	2026-09-21 07:46	74.46	OK	1272	2026-09-21 07:47	75.76	OK
1273	2026-09-21 07:48	73.65	OK	1274	2026-09-21 07:49	73.11	OK
1275	2026-09-21 07:50	73.77	OK	1276	2026-09-21 07:51	75.53	OK
1277	2026-09-21 07:52	73.44	OK	1278	2026-09-21 07:53	73.49	OK
1279	2026-09-21 07:54	73.24	OK	1280	2026-09-21 07:55	74.76	OK
1281	2026-09-21 07:56	74.57	OK	1282	2026-09-21 07:57	74.13	OK
1283	2026-09-21 07:58	75.11	OK	1284	2026-09-21 07:59	72.95	OK
1285	2026-09-21 08:00	74.89	OK	1286	2026-09-21 08:01	74.10	OK
1287	2026-09-21 08:02	71.83	OK	1288	2026-09-21 08:03	74.11	OK
1289	2026-09-21 08:04	74.33	OK	1290	2026-09-21 08:05	74.29	OK
1291	2026-09-21 08:06	73.81	OK	1292	2026-09-21 08:07	73.69	OK
1293	2026-09-21 08:08	73.66	OK	1294	2026-09-21 08:09	74.09	OK
1295	2026-09-21 08:10	75.31	OK	1296	2026-09-21 08:11	74.49	OK
1297	2026-09-21 08:12	74.93	OK	1298	2026-09-21 08:13	73.89	OK
1299	2026-09-21 08:14	73.14	OK	1300	2026-09-21 08:15	74.40	OK
1301	2026-09-21 08:16	74.59	OK	1302	2026-09-21 08:17	74.99	OK
1303	2026-09-21 08:18	74.42	OK	1304	2026-09-21 08:19	74.63	OK
1305	2026-09-21 08:20	74.29	OK	1306	2026-09-21 08:21	73.93	OK
1307	2026-09-21 08:22	74.34	OK	1308	2026-09-21 08:23	74.25	OK
1309	2026-09-21 08:24	74.10	OK	1310	2026-09-21 08:25	74.73	OK
1311	2026-09-21 08:26	73.93	OK	1312	2026-09-21 08:27	73.58	OK
1313	2026-09-21 08:28	75.43	OK	1314	2026-09-21 08:29	76.40	OK
1315	2026-09-21 08:30	76.81	OK	1316	2026-09-21 08:31	76.22	OK
1317	2026-09-21 08:32	76.41	OK	1318	2026-09-21 08:33	73.47	OK
1319	2026-09-21 08:34	74.13	OK	1320	2026-09-21 08:35	75.10	OK
1321	2026-09-21 08:36	75.63	OK	1322	2026-09-21 08:37	75.81	OK
1323	2026-09-21 08:38	74.00	OK	1324	2026-09-21 08:39	74.19	OK
1325	2026-09-21 08:40	74.78	OK	1326	2026-09-21 08:41	75.64	OK
1327	2026-09-21 08:42	75.50	OK	1328	2026-09-21 08:43	74.59	OK
1329	2026-09-21 08:44	75.19	OK	1330	2026-09-21 08:45	75.17	OK
1331	2026-09-21 08:46	75.83	OK	1332	2026-09-21 08:47	74.54	OK
1333	2026-09-21 08:48	75.19	OK	1334	2026-09-21 08:49	77.85	OK
1335	2026-09-21 08:50	74.89	OK	1336	2026-09-21 08:51	76.47	OK
1337	2026-09-21 08:52	77.09	OK	1338	2026-09-21 08:53	75.88	OK
1339	2026-09-21 08:54	76.86	OK	1340	2026-09-21 08:55	75.19	OK
1341	2026-09-21 08:56	74.52	OK	1342	2026-09-21 08:57	73.90	OK
1343	2026-09-21 08:58	74.23	OK	1344	2026-09-21 08:59	74.47	OK
1345	2026-09-21 09:00	75.72	OK	1346	2026-09-21 09:01	76.78	OK
1347	2026-09-21 09:02	77.23	OK	1348	2026-09-21 09:03	75.54	OK
1349	2026-09-21 09:04	74.87	OK	1350	2026-09-21 09:05	75.87	OK
1351	2026-09-21 09:06	77.74	OK	1352	2026-09-21 09:07	75.18	OK
1353	2026-09-21 09:08	76.07	OK	1354	2026-09-21 09:09	75.78	OK
1355	2026-09-21 09:10	76.51	OK	1356	2026-09-21 09:11	75.64	OK
1357	2026-09-21 09:12	75.40	OK	1358	2026-09-21 09:13	78.30	OK
1359	2026-09-21 09:14	75.24	OK	1360	2026-09-21 09:15	76.03	OK
1361	2026-09-21 09:16	75.92	OK	1362	2026-09-21 09:17	73.70	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1363	2026-09-21 09:18	76.45	OK	1364	2026-09-21 09:19	75.61	OK
1365	2026-09-21 09:20	77.32	OK	1366	2026-09-21 09:21	75.79	OK
1367	2026-09-21 09:22	75.17	OK	1368	2026-09-21 09:23	74.97	OK
1369	2026-09-21 09:24	75.28	OK	1370	2026-09-21 09:25	78.63	OK
1371	2026-09-21 09:26	75.63	OK	1372	2026-09-21 09:27	75.42	OK
1373	2026-09-21 09:28	74.41	OK	1374	2026-09-21 09:29	77.18	OK
1375	2026-09-21 09:30	75.70	OK	1376	2026-09-21 09:31	76.00	OK
1377	2026-09-21 09:32	77.33	OK	1378	2026-09-21 09:33	78.12	OK
1379	2026-09-21 09:34	77.40	OK	1380	2026-09-21 09:35	77.08	OK
1381	2026-09-21 09:36	77.49	OK	1382	2026-09-21 09:37	73.99	OK
1383	2026-09-21 09:38	76.26	OK	1384	2026-09-21 09:39	75.52	OK
1385	2026-09-21 09:40	75.96	OK	1386	2026-09-21 09:41	75.01	OK
1387	2026-09-21 09:42	76.61	OK	1388	2026-09-21 09:43	76.21	OK
1389	2026-09-21 09:44	78.17	OK	1390	2026-09-21 09:45	75.39	OK
1391	2026-09-21 09:46	75.74	OK	1392	2026-09-21 09:47	75.80	OK
1393	2026-09-21 09:48	77.68	OK	1394	2026-09-21 09:49	78.05	OK
1395	2026-09-21 09:50	77.28	OK	1396	2026-09-21 09:51	77.87	OK
1397	2026-09-21 09:52	76.57	OK	1398	2026-09-21 09:53	76.93	OK
1399	2026-09-21 09:54	75.66	OK	1400	2026-09-21 09:55	74.81	OK
1401	2026-09-21 09:56	76.82	OK	1402	2026-09-21 09:57	74.97	OK
1403	2026-09-21 09:58	76.16	OK	1404	2026-09-21 09:59	77.74	OK
1405	2026-09-21 10:00	78.76	OK	1406	2026-09-21 10:01	75.70	OK
1407	2026-09-21 10:02	75.37	OK	1408	2026-09-21 10:03	77.08	OK
1409	2026-09-21 10:04	76.16	OK	1410	2026-09-21 10:05	78.37	OK
1411	2026-09-21 10:06	74.55	OK	1412	2026-09-21 10:07	76.58	OK
1413	2026-09-21 10:08	77.67	OK	1414	2026-09-21 10:09	78.42	OK
1415	2026-09-21 10:10	76.25	OK	1416	2026-09-21 10:11	75.95	OK
1417	2026-09-21 10:12	76.34	OK	1418	2026-09-21 10:13	78.02	OK
1419	2026-09-21 10:14	78.25	OK	1420	2026-09-21 10:15	78.11	OK
1421	2026-09-21 10:16	77.52	OK	1422	2026-09-21 10:17	75.38	OK
1423	2026-09-21 10:18	79.46	OK	1424	2026-09-21 10:19	76.20	OK
1425	2026-09-21 10:20	77.07	OK	1426	2026-09-21 10:21	77.09	OK
1427	2026-09-21 10:22	77.31	OK	1428	2026-09-21 10:23	76.51	OK
1429	2026-09-21 10:24	76.30	OK	1430	2026-09-21 10:25	75.56	OK
1431	2026-09-21 10:26	77.55	OK	1432	2026-09-21 10:27	78.84	OK
1433	2026-09-21 10:28	76.16	OK	1434	2026-09-21 10:29	78.24	OK
1435	2026-09-21 10:30	75.63	OK	1436	2026-09-21 10:31	76.46	OK
1437	2026-09-21 10:32	76.84	OK	1438	2026-09-21 10:33	77.11	OK
1439	2026-09-21 10:34	77.73	OK	1440	2026-09-21 10:35	76.90	OK
1441	2026-09-21 10:36	75.80	OK	1442	2026-09-21 10:37	79.09	OK
1443	2026-09-21 10:38	79.12	OK	1444	2026-09-21 10:39	77.24	OK
1445	2026-09-21 10:40	78.35	OK	1446	2026-09-21 10:41	77.33	OK
1447	2026-09-21 10:42	77.68	OK	1448	2026-09-21 10:43	76.70	OK
1449	2026-09-21 10:44	78.71	OK	1450	2026-09-21 10:45	79.14	OK
1451	2026-09-21 10:46	76.49	OK	1452	2026-09-21 10:47	78.87	OK
1453	2026-09-21 10:48	77.89	OK	1454	2026-09-21 10:49	78.49	OK
1455	2026-09-21 10:50	76.61	OK	1456	2026-09-21 10:51	78.06	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1457	2026-09-21 10:52	78.35	OK	1458	2026-09-21 10:53	79.00	OK
1459	2026-09-21 10:54	76.89	OK	1460	2026-09-21 10:55	78.37	OK
1461	2026-09-21 10:56	78.59	OK	1462	2026-09-21 10:57	77.89	OK
1463	2026-09-21 10:58	78.22	OK	1464	2026-09-21 10:59	79.43	OK
1465	2026-09-21 11:00	78.22	OK	1466	2026-09-21 11:01	80.16	OK
1467	2026-09-21 11:02	78.46	OK	1468	2026-09-21 11:03	76.89	OK
1469	2026-09-21 11:04	76.16	OK	1470	2026-09-21 11:05	77.80	OK
1471	2026-09-21 11:06	79.17	OK	1472	2026-09-21 11:07	78.44	OK
1473	2026-09-21 11:08	77.35	OK	1474	2026-09-21 11:09	77.23	OK
1475	2026-09-21 11:10	76.97	OK	1476	2026-09-21 11:11	79.77	OK
1477	2026-09-21 11:12	79.50	OK	1478	2026-09-21 11:13	78.44	OK
1479	2026-09-21 11:14	77.10	OK	1480	2026-09-21 11:15	77.97	OK
1481	2026-09-21 11:16	78.09	OK	1482	2026-09-21 11:17	79.54	OK
1483	2026-09-21 11:18	77.76	OK	1484	2026-09-21 11:19	79.22	OK
1485	2026-09-21 11:20	77.53	OK	1486	2026-09-21 11:21	78.57	OK
1487	2026-09-21 11:22	79.39	OK	1488	2026-09-21 11:23	77.83	OK
1489	2026-09-21 11:24	79.23	OK	1490	2026-09-21 11:25	78.11	OK
1491	2026-09-21 11:26	77.49	OK	1492	2026-09-21 11:27	78.07	OK
1493	2026-09-21 11:28	78.58	OK	1494	2026-09-21 11:29	77.38	OK
1495	2026-09-21 11:30	78.87	OK	1496	2026-09-21 11:31	78.45	OK
1497	2026-09-21 11:32	76.59	OK	1498	2026-09-21 11:33	80.07	OK
1499	2026-09-21 11:34	79.29	OK	1500	2026-09-21 11:35	77.87	OK
1501	2026-09-21 11:36	78.66	OK	1502	2026-09-21 11:37	79.06	OK
1503	2026-09-21 11:38	79.55	OK	1504	2026-09-21 11:39	77.62	OK
1505	2026-09-21 11:40	76.42	OK	1506	2026-09-21 11:41	79.54	OK
1507	2026-09-21 11:42	77.42	OK	1508	2026-09-21 11:43	78.85	OK
1509	2026-09-21 11:44	79.26	OK	1510	2026-09-21 11:45	79.34	OK
1511	2026-09-21 11:46	79.94	OK	1512	2026-09-21 11:47	77.13	OK
1513	2026-09-21 11:48	77.05	OK	1514	2026-09-21 11:49	78.24	OK
1515	2026-09-21 11:50	79.84	OK	1516	2026-09-21 11:51	80.96	OK
1517	2026-09-21 11:52	79.07	OK	1518	2026-09-21 11:53	78.06	OK
1519	2026-09-21 11:54	77.30	OK	1520	2026-09-21 11:55	78.39	OK
1521	2026-09-21 11:56	79.01	OK	1522	2026-09-21 11:57	77.84	OK
1523	2026-09-21 11:58	78.94	OK	1524	2026-09-21 11:59	78.60	OK
1525	2026-09-21 12:00	78.35	OK	1526	2026-09-21 12:01	79.26	OK
1527	2026-09-21 12:02	78.40	OK	1528	2026-09-21 12:03	78.85	OK
1529	2026-09-21 12:04	79.10	OK	1530	2026-09-21 12:05	77.87	OK
1531	2026-09-21 12:06	79.92	OK	1532	2026-09-21 12:07	77.73	OK
1533	2026-09-21 12:08	79.28	OK	1534	2026-09-21 12:09	78.05	OK
1535	2026-09-21 12:10	77.87	OK	1536	2026-09-21 12:11	78.03	OK
1537	2026-09-21 12:12	77.84	OK	1538	2026-09-21 12:13	79.10	OK
1539	2026-09-21 12:14	77.55	OK	1540	2026-09-21 12:15	78.80	OK
1541	2026-09-21 12:16	78.52	OK	1542	2026-09-21 12:17	79.33	OK
1543	2026-09-21 12:18	80.05	OK	1544	2026-09-21 12:19	79.24	OK
1545	2026-09-21 12:20	79.77	OK	1546	2026-09-21 12:21	77.98	OK
1547	2026-09-21 12:22	79.90	OK	1548	2026-09-21 12:23	78.39	OK
1549	2026-09-21 12:24	79.12	OK	1550	2026-09-21 12:25	80.04	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1551	2026-09-21 12:26	80.12	OK	1552	2026-09-21 12:27	76.42	OK
1553	2026-09-21 12:28	77.88	OK	1554	2026-09-21 12:29	76.83	OK
1555	2026-09-21 12:30	78.71	OK	1556	2026-09-21 12:31	78.78	OK
1557	2026-09-21 12:32	78.40	OK	1558	2026-09-21 12:33	78.92	OK
1559	2026-09-21 12:34	77.54	OK	1560	2026-09-21 12:35	77.96	OK
1561	2026-09-21 12:36	80.41	OK	1562	2026-09-21 12:37	76.41	OK
1563	2026-09-21 12:38	78.50	OK	1564	2026-09-21 12:39	78.00	OK
1565	2026-09-21 12:40	80.42	OK	1566	2026-09-21 12:41	78.50	OK
1567	2026-09-21 12:42	78.37	OK	1568	2026-09-21 12:43	78.18	OK
1569	2026-09-21 12:44	79.13	OK	1570	2026-09-21 12:45	78.52	OK
1571	2026-09-21 12:46	78.61	OK	1572	2026-09-21 12:47	79.62	OK
1573	2026-09-21 12:48	78.87	OK	1574	2026-09-21 12:49	79.63	OK
1575	2026-09-21 12:50	77.66	OK	1576	2026-09-21 12:51	81.01	OK
1577	2026-09-21 12:52	78.06	OK	1578	2026-09-21 12:53	79.61	OK
1579	2026-09-21 12:54	80.20	OK	1580	2026-09-21 12:55	78.06	OK
1581	2026-09-21 12:56	81.15	OK	1582	2026-09-21 12:57	80.83	OK
1583	2026-09-21 12:58	78.51	OK	1584	2026-09-21 12:59	79.73	OK
1585	2026-09-21 13:00	78.58	OK	1586	2026-09-21 13:01	79.41	OK
1587	2026-09-21 13:02	79.66	OK	1588	2026-09-21 13:03	80.50	OK
1589	2026-09-21 13:04	78.54	OK	1590	2026-09-21 13:05	77.39	OK
1591	2026-09-21 13:06	79.71	OK	1592	2026-09-21 13:07	79.75	OK
1593	2026-09-21 13:08	78.38	OK	1594	2026-09-21 13:09	77.33	OK
1595	2026-09-21 13:10	78.92	OK	1596	2026-09-21 13:11	80.24	OK
1597	2026-09-21 13:12	78.04	OK	1598	2026-09-21 13:13	79.21	OK
1599	2026-09-21 13:14	78.30	OK	1600	2026-09-21 13:15	77.52	OK
1601	2026-09-21 13:16	77.76	OK	1602	2026-09-21 13:17	77.98	OK
1603	2026-09-21 13:18	79.79	OK	1604	2026-09-21 13:19	78.45	OK
1605	2026-09-21 13:20	80.41	OK	1606	2026-09-21 13:21	78.45	OK
1607	2026-09-21 13:22	77.65	OK	1608	2026-09-21 13:23	78.74	OK
1609	2026-09-21 13:24	78.56	OK	1610	2026-09-21 13:25	77.27	OK
1611	2026-09-21 13:26	79.48	OK	1612	2026-09-21 13:27	76.84	OK
1613	2026-09-21 13:28	77.35	OK	1614	2026-09-21 13:29	78.03	OK
1615	2026-09-21 13:30	78.22	OK	1616	2026-09-21 13:31	76.16	OK
1617	2026-09-21 13:32	76.44	OK	1618	2026-09-21 13:33	79.46	OK
1619	2026-09-21 13:34	80.73	OK	1620	2026-09-21 13:35	77.94	OK
1621	2026-09-21 13:36	76.95	OK	1622	2026-09-21 13:37	77.58	OK
1623	2026-09-21 13:38	79.18	OK	1624	2026-09-21 13:39	79.27	OK
1625	2026-09-21 13:40	79.19	OK	1626	2026-09-21 13:41	78.66	OK
1627	2026-09-21 13:42	79.27	OK	1628	2026-09-21 13:43	78.57	OK
1629	2026-09-21 13:44	79.68	OK	1630	2026-09-21 13:45	79.54	OK
1631	2026-09-21 13:46	80.01	OK	1632	2026-09-21 13:47	77.98	OK
1633	2026-09-21 13:48	78.46	OK	1634	2026-09-21 13:49	78.64	OK
1635	2026-09-21 13:50	80.64	OK	1636	2026-09-21 13:51	76.75	OK
1637	2026-09-21 13:52	78.18	OK	1638	2026-09-21 13:53	79.94	OK
1639	2026-09-21 13:54	78.04	OK	1640	2026-09-21 13:55	79.83	OK
1641	2026-09-21 13:56	80.67	OK	1642	2026-09-21 13:57	80.99	OK
1643	2026-09-21 13:58	77.09	OK	1644	2026-09-21 13:59	78.52	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1645	2026-09-21 14:00	77.62	OK	1646	2026-09-21 14:01	79.40	OK
1647	2026-09-21 14:02	77.86	OK	1648	2026-09-21 14:03	77.85	OK
1649	2026-09-21 14:04	79.23	OK	1650	2026-09-21 14:05	78.85	OK
1651	2026-09-21 14:06	77.40	OK	1652	2026-09-21 14:07	77.76	OK
1653	2026-09-21 14:08	77.96	OK	1654	2026-09-21 14:09	78.07	OK
1655	2026-09-21 14:10	79.51	OK	1656	2026-09-21 14:11	79.24	OK
1657	2026-09-21 14:12	78.51	OK	1658	2026-09-21 14:13	79.29	OK
1659	2026-09-21 14:14	80.43	OK	1660	2026-09-21 14:15	78.88	OK
1661	2026-09-21 14:16	79.03	OK	1662	2026-09-21 14:17	78.38	OK
1663	2026-09-21 14:18	79.27	OK	1664	2026-09-21 14:19	79.81	OK
1665	2026-09-21 14:20	76.98	OK	1666	2026-09-21 14:21	79.10	OK
1667	2026-09-21 14:22	77.25	OK	1668	2026-09-21 14:23	79.77	OK
1669	2026-09-21 14:24	77.62	OK	1670	2026-09-21 14:25	78.17	OK
1671	2026-09-21 14:26	79.14	OK	1672	2026-09-21 14:27	77.03	OK
1673	2026-09-21 14:28	77.82	OK	1674	2026-09-21 14:29	76.04	OK
1675	2026-09-21 14:30	78.58	OK	1676	2026-09-21 14:31	77.64	OK
1677	2026-09-21 14:32	79.44	OK	1678	2026-09-21 14:33	77.02	OK
1679	2026-09-21 14:34	77.51	OK	1680	2026-09-21 14:35	76.41	OK
1681	2026-09-21 14:36	77.94	OK	1682	2026-09-21 14:37	75.97	OK
1683	2026-09-21 14:38	78.15	OK	1684	2026-09-21 14:39	77.65	OK
1685	2026-09-21 14:40	77.24	OK	1686	2026-09-21 14:41	77.70	OK
1687	2026-09-21 14:42	77.10	OK	1688	2026-09-21 14:43	76.77	OK
1689	2026-09-21 14:44	76.22	OK	1690	2026-09-21 14:45	77.99	OK
1691	2026-09-21 14:46	77.00	OK	1692	2026-09-21 14:47	79.42	OK
1693	2026-09-21 14:48	78.10	OK	1694	2026-09-21 14:49	77.40	OK
1695	2026-09-21 14:50	78.58	OK	1696	2026-09-21 14:51	77.57	OK
1697	2026-09-21 14:52	77.62	OK	1698	2026-09-21 14:53	76.60	OK
1699	2026-09-21 14:54	77.17	OK	1700	2026-09-21 14:55	76.97	OK
1701	2026-09-21 14:56	80.20	OK	1702	2026-09-21 14:57	77.06	OK
1703	2026-09-21 14:58	77.39	OK	1704	2026-09-21 14:59	76.91	OK
1705	2026-09-21 15:00	78.61	OK	1706	2026-09-21 15:01	78.68	OK
1707	2026-09-21 15:02	77.24	OK	1708	2026-09-21 15:03	79.76	OK
1709	2026-09-21 15:04	79.87	OK	1710	2026-09-21 15:05	76.08	OK
1711	2026-09-21 15:06	78.45	OK	1712	2026-09-21 15:07	76.93	OK
1713	2026-09-21 15:08	77.66	OK	1714	2026-09-21 15:09	78.11	OK
1715	2026-09-21 15:10	78.16	OK	1716	2026-09-21 15:11	75.29	OK
1717	2026-09-21 15:12	76.70	OK	1718	2026-09-21 15:13	77.31	OK
1719	2026-09-21 15:14	77.15	OK	1720	2026-09-21 15:15	76.63	OK
1721	2026-09-21 15:16	77.65	OK	1722	2026-09-21 15:17	77.12	OK
1723	2026-09-21 15:18	79.90	OK	1724	2026-09-21 15:19	78.14	OK
1725	2026-09-21 15:20	78.15	OK	1726	2026-09-21 15:21	78.05	OK
1727	2026-09-21 15:22	74.96	OK	1728	2026-09-21 15:23	79.41	OK
1729	2026-09-21 15:24	75.80	OK	1730	2026-09-21 15:25	78.22	OK
1731	2026-09-21 15:26	75.51	OK	1732	2026-09-21 15:27	76.31	OK
1733	2026-09-21 15:28	76.77	OK	1734	2026-09-21 15:29	76.77	OK
1735	2026-09-21 15:30	75.63	OK	1736	2026-09-21 15:31	75.86	OK
1737	2026-09-21 15:32	76.65	OK	1738	2026-09-21 15:33	78.97	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1739	2026-09-21 15:34	77.67	OK	1740	2026-09-21 15:35	79.16	OK
1741	2026-09-21 15:36	77.35	OK	1742	2026-09-21 15:37	77.49	OK
1743	2026-09-21 15:38	77.41	OK	1744	2026-09-21 15:39	77.03	OK
1745	2026-09-21 15:40	76.84	OK	1746	2026-09-21 15:41	74.77	OK
1747	2026-09-21 15:42	76.02	OK	1748	2026-09-21 15:43	76.38	OK
1749	2026-09-21 15:44	77.43	OK	1750	2026-09-21 15:45	78.47	OK
1751	2026-09-21 15:46	77.15	OK	1752	2026-09-21 15:47	76.67	OK
1753	2026-09-21 15:48	77.18	OK	1754	2026-09-21 15:49	77.74	OK
1755	2026-09-21 15:50	76.81	OK	1756	2026-09-21 15:51	74.83	OK
1757	2026-09-21 15:52	76.98	OK	1758	2026-09-21 15:53	76.03	OK
1759	2026-09-21 15:54	77.55	OK	1760	2026-09-21 15:55	76.30	OK
1761	2026-09-21 15:56	77.99	OK	1762	2026-09-21 15:57	76.76	OK
1763	2026-09-21 15:58	75.70	OK	1764	2026-09-21 15:59	74.75	OK
1765	2026-09-21 16:00	76.22	OK	1766	2026-09-21 16:01	77.29	OK
1767	2026-09-21 16:02	76.31	OK	1768	2026-09-21 16:03	76.30	OK
1769	2026-09-21 16:04	75.01	OK	1770	2026-09-21 16:05	76.63	OK
1771	2026-09-21 16:06	76.56	OK	1772	2026-09-21 16:07	77.93	OK
1773	2026-09-21 16:08	76.26	OK	1774	2026-09-21 16:09	75.77	OK
1775	2026-09-21 16:10	74.19	OK	1776	2026-09-21 16:11	75.60	OK
1777	2026-09-21 16:12	75.18	OK	1778	2026-09-21 16:13	76.28	OK
1779	2026-09-21 16:14	77.77	OK	1780	2026-09-21 16:15	76.19	OK
1781	2026-09-21 16:16	75.62	OK	1782	2026-09-21 16:17	76.68	OK
1783	2026-09-21 16:18	76.22	OK	1784	2026-09-21 16:19	74.92	OK
1785	2026-09-21 16:20	77.21	OK	1786	2026-09-21 16:21	76.17	OK
1787	2026-09-21 16:22	77.18	OK	1788	2026-09-21 16:23	75.90	OK
1789	2026-09-21 16:24	78.33	OK	1790	2026-09-21 16:25	75.66	OK
1791	2026-09-21 16:26	76.67	OK	1792	2026-09-21 16:27	76.68	OK
1793	2026-09-21 16:28	76.99	OK	1794	2026-09-21 16:29	76.02	OK
1795	2026-09-21 16:30	75.10	OK	1796	2026-09-21 16:31	74.07	OK
1797	2026-09-21 16:32	76.05	OK	1798	2026-09-21 16:33	78.61	OK
1799	2026-09-21 16:34	75.63	OK	1800	2026-09-21 16:35	75.29	OK
1801	2026-09-21 16:36	75.47	OK	1802	2026-09-21 16:37	76.62	OK
1803	2026-09-21 16:38	75.85	OK	1804	2026-09-21 16:39	75.49	OK
1805	2026-09-21 16:40	73.57	OK	1806	2026-09-21 16:41	76.35	OK
1807	2026-09-21 16:42	76.34	OK	1808	2026-09-21 16:43	76.03	OK
1809	2026-09-21 16:44	77.64	OK	1810	2026-09-21 16:45	75.25	OK
1811	2026-09-21 16:46	76.68	OK	1812	2026-09-21 16:47	74.91	OK
1813	2026-09-21 16:48	76.34	OK	1814	2026-09-21 16:49	74.16	OK
1815	2026-09-21 16:50	76.47	OK	1816	2026-09-21 16:51	74.38	OK
1817	2026-09-21 16:52	76.66	OK	1818	2026-09-21 16:53	75.27	OK
1819	2026-09-21 16:54	73.77	OK	1820	2026-09-21 16:55	76.65	OK
1821	2026-09-21 16:56	75.19	OK	1822	2026-09-21 16:57	76.55	OK
1823	2026-09-21 16:58	75.19	OK	1824	2026-09-21 16:59	76.49	OK
1825	2026-09-21 17:00	74.77	OK	1826	2026-09-21 17:01	73.92	OK
1827	2026-09-21 17:02	75.29	OK	1828	2026-09-21 17:03	77.55	OK
1829	2026-09-21 17:04	76.78	OK	1830	2026-09-21 17:05	77.19	OK
1831	2026-09-21 17:06	73.90	OK	1832	2026-09-21 17:07	74.88	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1833	2026-09-21 17:08	73.63	OK	1834	2026-09-21 17:09	77.15	OK
1835	2026-09-21 17:10	75.11	OK	1836	2026-09-21 17:11	74.83	OK
1837	2026-09-21 17:12	76.14	OK	1838	2026-09-21 17:13	76.70	OK
1839	2026-09-21 17:14	74.50	OK	1840	2026-09-21 17:15	74.65	OK
1841	2026-09-21 17:16	73.63	OK	1842	2026-09-21 17:17	73.38	OK
1843	2026-09-21 17:18	73.94	OK	1844	2026-09-21 17:19	72.89	OK
1845	2026-09-21 17:20	74.62	OK	1846	2026-09-21 17:21	76.29	OK
1847	2026-09-21 17:22	74.25	OK	1848	2026-09-21 17:23	75.92	OK
1849	2026-09-21 17:24	74.31	OK	1850	2026-09-21 17:25	73.91	OK
1851	2026-09-21 17:26	74.50	OK	1852	2026-09-21 17:27	72.87	OK
1853	2026-09-21 17:28	75.43	OK	1854	2026-09-21 17:29	73.27	OK
1855	2026-09-21 17:30	73.62	OK	1856	2026-09-21 17:31	74.13	OK
1857	2026-09-21 17:32	74.87	OK	1858	2026-09-21 17:33	75.89	OK
1859	2026-09-21 17:34	74.88	OK	1860	2026-09-21 17:35	73.11	OK
1861	2026-09-21 17:36	73.25	OK	1862	2026-09-21 17:37	74.74	OK
1863	2026-09-21 17:38	73.75	OK	1864	2026-09-21 17:39	72.04	OK
1865	2026-09-21 17:40	75.75	OK	1866	2026-09-21 17:41	72.69	OK
1867	2026-09-21 17:42	76.31	OK	1868	2026-09-21 17:43	74.98	OK
1869	2026-09-21 17:44	73.71	OK	1870	2026-09-21 17:45	73.22	OK
1871	2026-09-21 17:46	72.45	OK	1872	2026-09-21 17:47	72.42	OK
1873	2026-09-21 17:48	74.01	OK	1874	2026-09-21 17:49	71.90	OK
1875	2026-09-21 17:50	73.39	OK	1876	2026-09-21 17:51	74.71	OK
1877	2026-09-21 17:52	75.44	OK	1878	2026-09-21 17:53	72.98	OK
1879	2026-09-21 17:54	72.07	OK	1880	2026-09-21 17:55	72.63	OK
1881	2026-09-21 17:56	75.79	OK	1882	2026-09-21 17:57	73.05	OK
1883	2026-09-21 17:58	73.12	OK	1884	2026-09-21 17:59	74.21	OK
1885	2026-09-21 18:00	72.88	OK	1886	2026-09-21 18:01	72.18	OK
1887	2026-09-21 18:02	72.42	OK	1888	2026-09-21 18:03	73.19	OK
1889	2026-09-21 18:04	73.05	OK	1890	2026-09-21 18:05	73.15	OK
1891	2026-09-21 18:06	73.51	OK	1892	2026-09-21 18:07	71.23	OK
1893	2026-09-21 18:08	72.77	OK	1894	2026-09-21 18:09	72.91	OK
1895	2026-09-21 18:10	74.03	OK	1896	2026-09-21 18:11	73.77	OK
1897	2026-09-21 18:12	71.97	OK	1898	2026-09-21 18:13	73.85	OK
1899	2026-09-21 18:14	74.94	OK	1900	2026-09-21 18:15	73.18	OK
1901	2026-09-21 18:16	74.67	OK	1902	2026-09-21 18:17	72.03	OK
1903	2026-09-21 18:18	72.27	OK	1904	2026-09-21 18:19	74.78	OK
1905	2026-09-21 18:20	72.42	OK	1906	2026-09-21 18:21	71.52	OK
1907	2026-09-21 18:22	74.60	OK	1908	2026-09-21 18:23	72.76	OK
1909	2026-09-21 18:24	72.37	OK	1910	2026-09-21 18:25	74.32	OK
1911	2026-09-21 18:26	73.83	OK	1912	2026-09-21 18:27	73.73	OK
1913	2026-09-21 18:28	75.44	OK	1914	2026-09-21 18:29	72.39	OK
1915	2026-09-21 18:30	71.24	OK	1916	2026-09-21 18:31	72.73	OK
1917	2026-09-21 18:32	73.02	OK	1918	2026-09-21 18:33	71.41	OK
1919	2026-09-21 18:34	73.05	OK	1920	2026-09-21 18:35	71.95	OK
1921	2026-09-21 18:36	73.86	OK	1922	2026-09-21 18:37	73.77	OK
1923	2026-09-21 18:38	73.00	OK	1924	2026-09-21 18:39	73.41	OK
1925	2026-09-21 18:40	72.96	OK	1926	2026-09-21 18:41	73.25	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1927	2026-09-21 18:42	73.35	OK	1928	2026-09-21 18:43	73.73	OK
1929	2026-09-21 18:44	72.73	OK	1930	2026-09-21 18:45	71.85	OK
1931	2026-09-21 18:46	70.86	OK	1932	2026-09-21 18:47	72.97	OK
1933	2026-09-21 18:48	71.76	OK	1934	2026-09-21 18:49	73.58	OK
1935	2026-09-21 18:50	71.39	OK	1936	2026-09-21 18:51	74.33	OK
1937	2026-09-21 18:52	72.53	OK	1938	2026-09-21 18:53	72.07	OK
1939	2026-09-21 18:54	73.10	OK	1940	2026-09-21 18:55	73.25	OK
1941	2026-09-21 18:56	73.20	OK	1942	2026-09-21 18:57	72.22	OK
1943	2026-09-21 18:58	72.89	OK	1944	2026-09-21 18:59	70.94	OK
1945	2026-09-21 19:00	72.20	OK	1946	2026-09-21 19:01	71.76	OK
1947	2026-09-21 19:02	71.30	OK	1948	2026-09-21 19:03	71.20	OK
1949	2026-09-21 19:04	72.16	OK	1950	2026-09-21 19:05	74.60	OK
1951	2026-09-21 19:06	69.56	OK	1952	2026-09-21 19:07	74.07	OK
1953	2026-09-21 19:08	73.09	OK	1954	2026-09-21 19:09	72.73	OK
1955	2026-09-21 19:10	70.24	OK	1956	2026-09-21 19:11	72.17	OK
1957	2026-09-21 19:12	73.45	OK	1958	2026-09-21 19:13	71.13	OK
1959	2026-09-21 19:14	72.45	OK	1960	2026-09-21 19:15	72.10	OK
1961	2026-09-21 19:16	71.10	OK	1962	2026-09-21 19:17	72.57	OK
1963	2026-09-21 19:18	69.47	OK	1964	2026-09-21 19:19	71.34	OK
1965	2026-09-21 19:20	71.45	OK	1966	2026-09-21 19:21	71.15	OK
1967	2026-09-21 19:22	73.17	OK	1968	2026-09-21 19:23	69.86	OK
1969	2026-09-21 19:24	68.72	OK	1970	2026-09-21 19:25	71.86	OK
1971	2026-09-21 19:26	70.48	OK	1972	2026-09-21 19:27	73.93	OK
1973	2026-09-21 19:28	72.70	OK	1974	2026-09-21 19:29	71.63	OK
1975	2026-09-21 19:30	70.18	OK	1976	2026-09-21 19:31	70.45	OK
1977	2026-09-21 19:32	71.87	OK	1978	2026-09-21 19:33	70.71	OK
1979	2026-09-21 19:34	70.41	OK	1980	2026-09-21 19:35	70.24	OK
1981	2026-09-21 19:36	69.28	OK	1982	2026-09-21 19:37	72.29	OK
1983	2026-09-21 19:38	70.06	OK	1984	2026-09-21 19:39	70.81	OK
1985	2026-09-21 19:40	71.54	OK	1986	2026-09-21 19:41	72.50	OK
1987	2026-09-21 19:42	71.83	OK	1988	2026-09-21 19:43	69.85	OK
1989	2026-09-21 19:44	72.96	OK	1990	2026-09-21 19:45	70.31	OK
1991	2026-09-21 19:46	71.47	OK	1992	2026-09-21 19:47	72.82	OK
1993	2026-09-21 19:48	70.05	OK	1994	2026-09-21 19:49	72.06	OK
1995	2026-09-21 19:50	72.35	OK	1996	2026-09-21 19:51	70.67	OK
1997	2026-09-21 19:52	70.56	OK	1998	2026-09-21 19:53	71.94	OK
1999	2026-09-21 19:54	70.37	OK	2000	2026-09-21 19:55	72.14	OK
2001	2026-09-21 19:56	70.32	OK	2002	2026-09-21 19:57	72.43	OK
2003	2026-09-21 19:58	70.26	OK	2004	2026-09-21 19:59	71.40	OK
2005	2026-09-21 20:00	68.57	OK	2006	2026-09-21 20:01	68.43	OK
2007	2026-09-21 20:02	68.06	OK	2008	2026-09-21 20:03	71.81	OK
2009	2026-09-21 20:04	71.11	OK	2010	2026-09-21 20:05	68.24	OK
2011	2026-09-21 20:06	69.18	OK	2012	2026-09-21 20:07	70.17	OK
2013	2026-09-21 20:08	70.20	OK	2014	2026-09-21 20:09	69.92	OK
2015	2026-09-21 20:10	70.45	OK	2016	2026-09-21 20:11	71.18	OK
2017	2026-09-21 20:12	68.72	OK	2018	2026-09-21 20:13	70.33	OK
2019	2026-09-21 20:14	70.61	OK	2020	2026-09-21 20:15	71.77	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2021	2026-09-21 20:16	70.42	OK	2022	2026-09-21 20:17	69.56	OK
2023	2026-09-21 20:18	69.31	OK	2024	2026-09-21 20:19	69.97	OK
2025	2026-09-21 20:20	69.89	OK	2026	2026-09-21 20:21	72.13	OK
2027	2026-09-21 20:22	68.90	OK	2028	2026-09-21 20:23	70.21	OK
2029	2026-09-21 20:24	71.13	OK	2030	2026-09-21 20:25	69.33	OK
2031	2026-09-21 20:26	70.32	OK	2032	2026-09-21 20:27	69.02	OK
2033	2026-09-21 20:28	70.66	OK	2034	2026-09-21 20:29	72.44	OK
2035	2026-09-21 20:30	71.45	OK	2036	2026-09-21 20:31	67.85	OK
2037	2026-09-21 20:32	68.97	OK	2038	2026-09-21 20:33	69.10	OK
2039	2026-09-21 20:34	67.76	OK	2040	2026-09-21 20:35	69.71	OK
2041	2026-09-21 20:36	69.65	OK	2042	2026-09-21 20:37	69.85	OK
2043	2026-09-21 20:38	68.53	OK	2044	2026-09-21 20:39	68.18	OK
2045	2026-09-21 20:40	68.49	OK	2046	2026-09-21 20:41	69.76	OK
2047	2026-09-21 20:42	68.93	OK	2048	2026-09-21 20:43	67.46	OK
2049	2026-09-21 20:44	68.04	OK	2050	2026-09-21 20:45	69.07	OK
2051	2026-09-21 20:46	69.61	OK	2052	2026-09-21 20:47	69.82	OK
2053	2026-09-21 20:48	70.71	OK	2054	2026-09-21 20:49	70.52	OK
2055	2026-09-21 20:50	69.31	OK	2056	2026-09-21 20:51	69.16	OK
2057	2026-09-21 20:52	69.97	OK	2058	2026-09-21 20:53	69.09	OK
2059	2026-09-21 20:54	70.20	OK	2060	2026-09-21 20:55	69.08	OK
2061	2026-09-21 20:56	68.65	OK	2062	2026-09-21 20:57	68.59	OK
2063	2026-09-21 20:58	70.43	OK	2064	2026-09-21 20:59	71.16	OK
2065	2026-09-21 21:00	69.59	OK	2066	2026-09-21 21:01	68.40	OK
2067	2026-09-21 21:02	67.94	OK	2068	2026-09-21 21:03	69.69	OK
2069	2026-09-21 21:04	69.10	OK	2070	2026-09-21 21:05	67.96	OK
2071	2026-09-21 21:06	68.33	OK	2072	2026-09-21 21:07	70.05	OK
2073	2026-09-21 21:08	68.41	OK	2074	2026-09-21 21:09	68.37	OK
2075	2026-09-21 21:10	68.65	OK	2076	2026-09-21 21:11	67.07	OK
2077	2026-09-21 21:12	68.07	OK	2078	2026-09-21 21:13	68.69	OK
2079	2026-09-21 21:14	70.34	OK	2080	2026-09-21 21:15	67.68	OK
2081	2026-09-21 21:16	68.38	OK	2082	2026-09-21 21:17	68.53	OK
2083	2026-09-21 21:18	66.38	OK	2084	2026-09-21 21:19	68.73	OK
2085	2026-09-21 21:20	69.41	OK	2086	2026-09-21 21:21	66.95	OK
2087	2026-09-21 21:22	68.52	OK	2088	2026-09-21 21:23	66.46	OK
2089	2026-09-21 21:24	68.83	OK	2090	2026-09-21 21:25	69.91	OK
2091	2026-09-21 21:26	68.55	OK	2092	2026-09-21 21:27	67.73	OK
2093	2026-09-21 21:28	69.04	OK	2094	2026-09-21 21:29	67.24	OK
2095	2026-09-21 21:30	69.43	OK	2096	2026-09-21 21:31	67.54	OK
2097	2026-09-21 21:32	69.24	OK	2098	2026-09-21 21:33	67.44	OK
2099	2026-09-21 21:34	70.06	OK	2100	2026-09-21 21:35	67.09	OK
2101	2026-09-21 21:36	68.41	OK	2102	2026-09-21 21:37	68.70	OK
2103	2026-09-21 21:38	68.31	OK	2104	2026-09-21 21:39	69.18	OK
2105	2026-09-21 21:40	66.42	OK	2106	2026-09-21 21:41	66.14	OK
2107	2026-09-21 21:42	68.97	OK	2108	2026-09-21 21:43	70.02	OK
2109	2026-09-21 21:44	68.94	OK	2110	2026-09-21 21:45	68.77	OK
2111	2026-09-21 21:46	68.39	OK	2112	2026-09-21 21:47	66.00	OK
2113	2026-09-21 21:48	66.77	OK	2114	2026-09-21 21:49	68.15	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2115	2026-09-21 21:50	67.33	OK	2116	2026-09-21 21:51	68.07	OK
2117	2026-09-21 21:52	68.41	OK	2118	2026-09-21 21:53	69.54	OK
2119	2026-09-21 21:54	67.17	OK	2120	2026-09-21 21:55	68.12	OK
2121	2026-09-21 21:56	68.88	OK	2122	2026-09-21 21:57	68.02	OK
2123	2026-09-21 21:58	66.43	OK	2124	2026-09-21 21:59	68.79	OK
2125	2026-09-21 22:00	68.04	OK	2126	2026-09-21 22:01	67.48	OK
2127	2026-09-21 22:02	67.80	OK	2128	2026-09-21 22:03	69.14	OK
2129	2026-09-21 22:04	66.04	OK	2130	2026-09-21 22:05	69.32	OK
2131	2026-09-21 22:06	67.78	OK	2132	2026-09-21 22:07	67.48	OK
2133	2026-09-21 22:08	68.16	OK	2134	2026-09-21 22:09	66.61	OK
2135	2026-09-21 22:10	66.51	OK	2136	2026-09-21 22:11	65.89	OK
2137	2026-09-21 22:12	66.76	OK	2138	2026-09-21 22:13	67.14	OK
2139	2026-09-21 22:14	69.27	OK	2140	2026-09-21 22:15	67.93	OK
2141	2026-09-21 22:16	68.65	OK	2142	2026-09-21 22:17	65.52	OK
2143	2026-09-21 22:18	66.75	OK	2144	2026-09-21 22:19	67.46	OK
2145	2026-09-21 22:20	66.15	OK	2146	2026-09-21 22:21	67.74	OK
2147	2026-09-21 22:22	66.56	OK	2148	2026-09-21 22:23	67.23	OK
2149	2026-09-21 22:24	69.12	OK	2150	2026-09-21 22:25	67.07	OK
2151	2026-09-21 22:26	68.90	OK	2152	2026-09-21 22:27	66.82	OK
2153	2026-09-21 22:28	66.41	OK	2154	2026-09-21 22:29	67.48	OK
2155	2026-09-21 22:30	66.06	OK	2156	2026-09-21 22:31	67.31	OK
2157	2026-09-21 22:32	66.23	OK	2158	2026-09-21 22:33	67.32	OK
2159	2026-09-21 22:34	65.78	OK	2160	2026-09-21 22:35	68.58	OK
2161	2026-09-21 22:36	67.11	OK	2162	2026-09-21 22:37	67.61	OK
2163	2026-09-21 22:38	67.08	OK	2164	2026-09-21 22:39	69.30	OK
2165	2026-09-21 22:40	68.84	OK	2166	2026-09-21 22:41	68.56	OK
2167	2026-09-21 22:42	66.56	OK	2168	2026-09-21 22:43	66.57	OK
2169	2026-09-21 22:44	67.62	OK	2170	2026-09-21 22:45	65.72	OK
2171	2026-09-21 22:46	66.49	OK	2172	2026-09-21 22:47	67.14	OK
2173	2026-09-21 22:48	67.84	OK	2174	2026-09-21 22:49	67.20	OK
2175	2026-09-21 22:50	66.00	OK	2176	2026-09-21 22:51	67.95	OK
2177	2026-09-21 22:52	66.87	OK	2178	2026-09-21 22:53	67.01	OK
2179	2026-09-21 22:54	66.90	OK	2180	2026-09-21 22:55	67.15	OK
2181	2026-09-21 22:56	66.51	OK	2182	2026-09-21 22:57	67.31	OK
2183	2026-09-21 22:58	64.90	OK	2184	2026-09-21 22:59	67.81	OK
2185	2026-09-21 23:00	65.64	OK	2186	2026-09-21 23:01	65.66	OK
2187	2026-09-21 23:02	67.09	OK	2188	2026-09-21 23:03	66.32	OK
2189	2026-09-21 23:04	66.36	OK	2190	2026-09-21 23:05	67.72	OK
2191	2026-09-21 23:06	66.08	OK	2192	2026-09-21 23:07	68.90	OK
2193	2026-09-21 23:08	66.44	OK	2194	2026-09-21 23:09	67.39	OK
2195	2026-09-21 23:10	65.35	OK	2196	2026-09-21 23:11	67.67	OK
2197	2026-09-21 23:12	66.37	OK	2198	2026-09-21 23:13	66.46	OK
2199	2026-09-21 23:14	65.84	OK	2200	2026-09-21 23:15	66.69	OK
2201	2026-09-21 23:16	67.04	OK	2202	2026-09-21 23:17	65.76	OK
2203	2026-09-21 23:18	67.27	OK	2204	2026-09-21 23:19	66.27	OK
2205	2026-09-21 23:20	67.40	OK	2206	2026-09-21 23:21	66.90	OK
2207	2026-09-21 23:22	64.92	OK	2208	2026-09-21 23:23	65.85	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2209	2026-09-21 23:24	67.72	OK	2210	2026-09-21 23:25	68.05	OK
2211	2026-09-21 23:26	66.66	OK	2212	2026-09-21 23:27	65.88	OK
2213	2026-09-21 23:28	66.88	OK	2214	2026-09-21 23:29	66.07	OK
2215	2026-09-21 23:30	66.59	OK	2216	2026-09-21 23:31	67.43	OK
2217	2026-09-21 23:32	64.25	OK	2218	2026-09-21 23:33	68.00	OK
2219	2026-09-21 23:34	65.47	OK	2220	2026-09-21 23:35	66.83	OK
2221	2026-09-21 23:36	66.58	OK	2222	2026-09-21 23:37	66.76	OK
2223	2026-09-21 23:38	65.73	OK	2224	2026-09-21 23:39	67.62	OK
2225	2026-09-21 23:40	66.29	OK	2226	2026-09-21 23:41	68.55	OK
2227	2026-09-21 23:42	65.52	OK	2228	2026-09-21 23:43	67.25	OK
2229	2026-09-21 23:44	65.61	OK	2230	2026-09-21 23:45	64.29	OK
2231	2026-09-21 23:46	65.33	OK	2232	2026-09-21 23:47	67.28	OK
2233	2026-09-21 23:48	67.87	OK	2234	2026-09-21 23:49	65.59	OK
2235	2026-09-21 23:50	66.20	OK	2236	2026-09-21 23:51	67.86	OK
2237	2026-09-21 23:52	65.50	OK	2238	2026-09-21 23:53	66.62	OK
2239	2026-09-21 23:54	64.88	OK	2240	2026-09-21 23:55	66.99	OK
2241	2026-09-21 23:56	64.78	OK	2242	2026-09-21 23:57	66.81	OK
2243	2026-09-21 23:58	65.29	OK	2244	2026-09-21 23:59	66.00	OK
2245	2026-09-22 00:00	66.73	OK	2246	2026-09-22 00:01	65.62	OK
2247	2026-09-22 00:02	66.40	OK	2248	2026-09-22 00:03	66.29	OK
2249	2026-09-22 00:04	65.42	OK	2250	2026-09-22 00:05	66.22	OK
2251	2026-09-22 00:06	65.91	OK	2252	2026-09-22 00:07	64.80	OK
2253	2026-09-22 00:08	68.19	OK	2254	2026-09-22 00:09	65.71	OK
2255	2026-09-22 00:10	65.87	OK	2256	2026-09-22 00:11	66.09	OK
2257	2026-09-22 00:12	66.85	OK	2258	2026-09-22 00:13	65.85	OK
2259	2026-09-22 00:14	66.59	OK	2260	2026-09-22 00:15	67.40	OK
2261	2026-09-22 00:16	66.90	OK	2262	2026-09-22 00:17	65.69	OK
2263	2026-09-22 00:18	66.01	OK	2264	2026-09-22 00:19	68.64	OK
2265	2026-09-22 00:20	66.61	OK	2266	2026-09-22 00:21	67.63	OK
2267	2026-09-22 00:22	66.36	OK	2268	2026-09-22 00:23	65.79	OK
2269	2026-09-22 00:24	65.33	OK	2270	2026-09-22 00:25	65.34	OK
2271	2026-09-22 00:26	66.32	OK	2272	2026-09-22 00:27	66.75	OK
2273	2026-09-22 00:28	65.48	OK	2274	2026-09-22 00:29	66.74	OK
2275	2026-09-22 00:30	66.76	OK	2276	2026-09-22 00:31	66.49	OK
2277	2026-09-22 00:32	64.91	OK	2278	2026-09-22 00:33	67.80	OK
2279	2026-09-22 00:34	67.93	OK	2280	2026-09-22 00:35	65.84	OK
2281	2026-09-22 00:36	63.50	OK	2282	2026-09-22 00:37	64.93	OK
2283	2026-09-22 00:38	64.71	OK	2284	2026-09-22 00:39	68.08	OK
2285	2026-09-22 00:40	66.14	OK	2286	2026-09-22 00:41	66.14	OK
2287	2026-09-22 00:42	65.86	OK	2288	2026-09-22 00:43	64.73	OK
2289	2026-09-22 00:44	66.71	OK	2290	2026-09-22 00:45	66.71	OK
2291	2026-09-22 00:46	66.35	OK	2292	2026-09-22 00:47	64.63	OK
2293	2026-09-22 00:48	65.16	OK	2294	2026-09-22 00:49	66.58	OK
2295	2026-09-22 00:50	65.36	OK	2296	2026-09-22 00:51	67.71	OK
2297	2026-09-22 00:52	64.84	OK	2298	2026-09-22 00:53	66.14	OK
2299	2026-09-22 00:54	67.61	OK	2300	2026-09-22 00:55	65.58	OK
2301	2026-09-22 00:56	66.38	OK	2302	2026-09-22 00:57	66.01	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2303	2026-09-22 00:58	64.42	OK	2304	2026-09-22 00:59	67.27	OK
2305	2026-09-22 01:00	66.28	OK	2306	2026-09-22 01:01	66.97	OK
2307	2026-09-22 01:02	66.49	OK	2308	2026-09-22 01:03	66.07	OK
2309	2026-09-22 01:04	66.46	OK	2310	2026-09-22 01:05	65.92	OK
2311	2026-09-22 01:06	66.29	OK	2312	2026-09-22 01:07	65.61	OK
2313	2026-09-22 01:08	65.92	OK	2314	2026-09-22 01:09	66.45	OK
2315	2026-09-22 01:10	64.86	OK	2316	2026-09-22 01:11	64.76	OK
2317	2026-09-22 01:12	66.63	OK	2318	2026-09-22 01:13	65.11	OK
2319	2026-09-22 01:14	66.10	OK	2320	2026-09-22 01:15	66.05	OK
2321	2026-09-22 01:16	64.98	OK	2322	2026-09-22 01:17	66.23	OK
2323	2026-09-22 01:18	64.53	OK	2324	2026-09-22 01:19	68.22	OK
2325	2026-09-22 01:20	66.49	OK	2326	2026-09-22 01:21	67.12	OK
2327	2026-09-22 01:22	68.35	OK	2328	2026-09-22 01:23	65.49	OK
2329	2026-09-22 01:24	64.87	OK	2330	2026-09-22 01:25	66.56	OK
2331	2026-09-22 01:26	64.95	OK	2332	2026-09-22 01:27	67.65	OK
2333	2026-09-22 01:28	66.64	OK	2334	2026-09-22 01:29	66.41	OK
2335	2026-09-22 01:30	66.46	OK	2336	2026-09-22 01:31	64.63	OK
2337	2026-09-22 01:32	64.91	OK	2338	2026-09-22 01:33	64.68	OK
2339	2026-09-22 01:34	64.04	OK	2340	2026-09-22 01:35	66.91	OK
2341	2026-09-22 01:36	65.59	OK	2342	2026-09-22 01:37	66.93	OK
2343	2026-09-22 01:38	67.87	OK	2344	2026-09-22 01:39	63.72	OK
2345	2026-09-22 01:40	64.22	OK	2346	2026-09-22 01:41	66.12	OK
2347	2026-09-22 01:42	66.31	OK	2348	2026-09-22 01:43	67.11	OK
2349	2026-09-22 01:44	66.28	OK	2350	2026-09-22 01:45	67.82	OK
2351	2026-09-22 01:46	67.39	OK	2352	2026-09-22 01:47	64.87	OK
2353	2026-09-22 01:48	64.29	OK	2354	2026-09-22 01:49	65.17	OK
2355	2026-09-22 01:50	67.06	OK	2356	2026-09-22 01:51	65.13	OK
2357	2026-09-22 01:52	66.06	OK	2358	2026-09-22 01:53	67.25	OK
2359	2026-09-22 01:54	65.53	OK	2360	2026-09-22 01:55	66.35	OK
2361	2026-09-22 01:56	67.21	OK	2362	2026-09-22 01:57	66.03	OK
2363	2026-09-22 01:58	67.65	OK	2364	2026-09-22 01:59	67.12	OK
2365	2026-09-22 02:00	67.68	OK	2366	2026-09-22 02:01	65.73	OK
2367	2026-09-22 02:02	66.36	OK	2368	2026-09-22 02:03	65.78	OK
2369	2026-09-22 02:04	66.48	OK	2370	2026-09-22 02:05	64.38	OK
2371	2026-09-22 02:06	65.23	OK	2372	2026-09-22 02:07	64.41	OK
2373	2026-09-22 02:08	65.99	OK	2374	2026-09-22 02:09	65.55	OK
2375	2026-09-22 02:10	66.31	OK	2376	2026-09-22 02:11	64.70	OK
2377	2026-09-22 02:12	66.16	OK	2378	2026-09-22 02:13	65.52	OK
2379	2026-09-22 02:14	66.19	OK	2380	2026-09-22 02:15	65.01	OK
2381	2026-09-22 02:16	65.23	OK	2382	2026-09-22 02:17	66.67	OK
2383	2026-09-22 02:18	65.71	OK	2384	2026-09-22 02:19	66.76	OK
2385	2026-09-22 02:20	66.34	OK	2386	2026-09-22 02:21	66.82	OK
2387	2026-09-22 02:22	64.55	OK	2388	2026-09-22 02:23	66.31	OK
2389	2026-09-22 02:24	67.24	OK	2390	2026-09-22 02:25	65.99	OK
2391	2026-09-22 02:26	68.45	OK	2392	2026-09-22 02:27	66.17	OK
2393	2026-09-22 02:28	65.42	OK	2394	2026-09-22 02:29	67.65	OK
2395	2026-09-22 02:30	66.28	OK	2396	2026-09-22 02:31	66.75	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2397	2026-09-22 02:32	65.46	OK	2398	2026-09-22 02:33	67.12	OK
2399	2026-09-22 02:34	66.06	OK	2400	2026-09-22 02:35	65.25	OK
2401	2026-09-22 02:36	67.55	OK	2402	2026-09-22 02:37	65.37	OK
2403	2026-09-22 02:38	65.64	OK	2404	2026-09-22 02:39	67.37	OK
2405	2026-09-22 02:40	67.34	OK	2406	2026-09-22 02:41	67.44	OK
2407	2026-09-22 02:42	67.72	OK	2408	2026-09-22 02:43	66.25	OK
2409	2026-09-22 02:44	66.22	OK	2410	2026-09-22 02:45	67.18	OK
2411	2026-09-22 02:46	65.36	OK	2412	2026-09-22 02:47	64.15	OK
2413	2026-09-22 02:48	65.99	OK	2414	2026-09-22 02:49	66.56	OK
2415	2026-09-22 02:50	65.91	OK	2416	2026-09-22 02:51	67.01	OK
2417	2026-09-22 02:52	65.78	OK	2418	2026-09-22 02:53	67.18	OK
2419	2026-09-22 02:54	69.03	OK	2420	2026-09-22 02:55	66.37	OK
2421	2026-09-22 02:56	65.21	OK	2422	2026-09-22 02:57	68.43	OK
2423	2026-09-22 02:58	64.76	OK	2424	2026-09-22 02:59	66.35	OK
2425	2026-09-22 03:00	67.74	OK	2426	2026-09-22 03:01	67.59	OK
2427	2026-09-22 03:02	67.67	OK	2428	2026-09-22 03:03	67.63	OK
2429	2026-09-22 03:04	67.74	OK	2430	2026-09-22 03:05	68.56	OK
2431	2026-09-22 03:06	65.37	OK	2432	2026-09-22 03:07	67.20	OK
2433	2026-09-22 03:08	67.10	OK	2434	2026-09-22 03:09	66.99	OK
2435	2026-09-22 03:10	67.27	OK	2436	2026-09-22 03:11	68.31	OK
2437	2026-09-22 03:12	66.57	OK	2438	2026-09-22 03:13	68.37	OK
2439	2026-09-22 03:14	67.64	OK	2440	2026-09-22 03:15	66.61	OK
2441	2026-09-22 03:16	67.71	OK	2442	2026-09-22 03:17	65.60	OK
2443	2026-09-22 03:18	67.84	OK	2444	2026-09-22 03:19	68.09	OK
2445	2026-09-22 03:20	66.83	OK	2446	2026-09-22 03:21	68.44	OK
2447	2026-09-22 03:22	66.73	OK	2448	2026-09-22 03:23	66.85	OK
2449	2026-09-22 03:24	65.03	OK	2450	2026-09-22 03:25	66.99	OK
2451	2026-09-22 03:26	69.40	OK	2452	2026-09-22 03:27	68.04	OK
2453	2026-09-22 03:28	68.24	OK	2454	2026-09-22 03:29	68.05	OK
2455	2026-09-22 03:30	67.93	OK	2456	2026-09-22 03:31	68.59	OK
2457	2026-09-22 03:32	67.51	OK	2458	2026-09-22 03:33	67.85	OK
2459	2026-09-22 03:34	68.50	OK	2460	2026-09-22 03:35	67.50	OK
2461	2026-09-22 03:36	68.24	OK	2462	2026-09-22 03:37	68.87	OK
2463	2026-09-22 03:38	67.53	OK	2464	2026-09-22 03:39	66.39	OK
2465	2026-09-22 03:40	68.40	OK	2466	2026-09-22 03:41	68.64	OK
2467	2026-09-22 03:42	69.68	OK	2468	2026-09-22 03:43	69.19	OK
2469	2026-09-22 03:44	65.79	OK	2470	2026-09-22 03:45	66.79	OK
2471	2026-09-22 03:46	67.78	OK	2472	2026-09-22 03:47	67.46	OK
2473	2026-09-22 03:48	67.33	OK	2474	2026-09-22 03:49	68.00	OK
2475	2026-09-22 03:50	68.54	OK	2476	2026-09-22 03:51	67.44	OK
2477	2026-09-22 03:52	69.18	OK	2478	2026-09-22 03:53	67.38	OK
2479	2026-09-22 03:54	66.89	OK	2480	2026-09-22 03:55	68.67	OK
2481	2026-09-22 03:56	66.04	OK	2482	2026-09-22 03:57	67.52	OK
2483	2026-09-22 03:58	67.11	OK	2484	2026-09-22 03:59	69.92	OK
2485	2026-09-22 04:00	68.40	OK	2486	2026-09-22 04:01	67.57	OK
2487	2026-09-22 04:02	67.58	OK	2488	2026-09-22 04:03	69.10	OK
2489	2026-09-22 04:04	66.89	OK	2490	2026-09-22 04:05	67.63	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2491	2026-09-22 04:06	68.01	OK	2492	2026-09-22 04:07	67.34	OK
2493	2026-09-22 04:08	70.17	OK	2494	2026-09-22 04:09	67.99	OK
2495	2026-09-22 04:10	67.74	OK	2496	2026-09-22 04:11	69.34	OK
2497	2026-09-22 04:12	68.65	OK	2498	2026-09-22 04:13	69.05	OK
2499	2026-09-22 04:14	69.24	OK	2500	2026-09-22 04:15	67.49	OK
2501	2026-09-22 04:16	66.97	OK	2502	2026-09-22 04:17	68.18	OK
2503	2026-09-22 04:18	67.93	OK	2504	2026-09-22 04:19	67.29	OK
2505	2026-09-22 04:20	69.11	OK	2506	2026-09-22 04:21	69.38	OK
2507	2026-09-22 04:22	68.51	OK	2508	2026-09-22 04:23	67.84	OK
2509	2026-09-22 04:24	68.91	OK	2510	2026-09-22 04:25	68.34	OK
2511	2026-09-22 04:26	69.33	OK	2512	2026-09-22 04:27	67.79	OK
2513	2026-09-22 04:28	70.85	OK	2514	2026-09-22 04:29	67.15	OK
2515	2026-09-22 04:30	67.69	OK	2516	2026-09-22 04:31	69.21	OK
2517	2026-09-22 04:32	69.23	OK	2518	2026-09-22 04:33	68.66	OK
2519	2026-09-22 04:34	68.58	OK	2520	2026-09-22 04:35	71.09	OK
2521	2026-09-22 04:36	68.20	OK	2522	2026-09-22 04:37	69.94	OK
2523	2026-09-22 04:38	70.24	OK	2524	2026-09-22 04:39	70.04	OK
2525	2026-09-22 04:40	69.34	OK	2526	2026-09-22 04:41	69.24	OK
2527	2026-09-22 04:42	68.52	OK	2528	2026-09-22 04:43	69.37	OK
2529	2026-09-22 04:44	67.04	OK	2530	2026-09-22 04:45	70.43	OK
2531	2026-09-22 04:46	70.15	OK	2532	2026-09-22 04:47	69.54	OK
2533	2026-09-22 04:48	69.46	OK	2534	2026-09-22 04:49	68.46	OK
2535	2026-09-22 04:50	69.37	OK	2536	2026-09-22 04:51	69.23	OK
2537	2026-09-22 04:52	69.21	OK	2538	2026-09-22 04:53	68.37	OK
2539	2026-09-22 04:54	70.10	OK	2540	2026-09-22 04:55	68.44	OK
2541	2026-09-22 04:56	68.58	OK	2542	2026-09-22 04:57	69.35	OK
2543	2026-09-22 04:58	67.99	OK	2544	2026-09-22 04:59	69.74	OK
2545	2026-09-22 05:00	70.09	OK	2546	2026-09-22 05:01	70.28	OK
2547	2026-09-22 05:02	69.74	OK	2548	2026-09-22 05:03	70.01	OK
2549	2026-09-22 05:04	69.01	OK	2550	2026-09-22 05:05	68.33	OK
2551	2026-09-22 05:06	71.77	OK	2552	2026-09-22 05:07	69.65	OK
2553	2026-09-22 05:08	71.28	OK	2554	2026-09-22 05:09	71.83	OK
2555	2026-09-22 05:10	71.14	OK	2556	2026-09-22 05:11	69.22	OK
2557	2026-09-22 05:12	69.36	OK	2558	2026-09-22 05:13	68.54	OK
2559	2026-09-22 05:14	69.49	OK	2560	2026-09-22 05:15	68.20	OK
2561	2026-09-22 05:16	70.15	OK	2562	2026-09-22 05:17	72.71	OK
2563	2026-09-22 05:18	69.68	OK	2564	2026-09-22 05:19	68.22	OK
2565	2026-09-22 05:20	69.27	OK	2566	2026-09-22 05:21	69.09	OK
2567	2026-09-22 05:22	68.93	OK	2568	2026-09-22 05:23	70.40	OK
2569	2026-09-22 05:24	69.62	OK	2570	2026-09-22 05:25	71.17	OK
2571	2026-09-22 05:26	70.76	OK	2572	2026-09-22 05:27	70.73	OK
2573	2026-09-22 05:28	70.33	OK	2574	2026-09-22 05:29	68.65	OK
2575	2026-09-22 05:30	70.28	OK	2576	2026-09-22 05:31	71.71	OK
2577	2026-09-22 05:32	71.89	OK	2578	2026-09-22 05:33	69.59	OK
2579	2026-09-22 05:34	69.75	OK	2580	2026-09-22 05:35	70.03	OK
2581	2026-09-22 05:36	69.67	OK	2582	2026-09-22 05:37	71.76	OK
2583	2026-09-22 05:38	70.14	OK	2584	2026-09-22 05:39	69.34	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2585	2026-09-22 05:40	71.12	OK	2586	2026-09-22 05:41	69.87	OK
2587	2026-09-22 05:42	71.19	OK	2588	2026-09-22 05:43	69.50	OK
2589	2026-09-22 05:44	71.09	OK	2590	2026-09-22 05:45	72.25	OK
2591	2026-09-22 05:46	71.29	OK	2592	2026-09-22 05:47	70.30	OK
2593	2026-09-22 05:48	69.12	OK	2594	2026-09-22 05:49	70.48	OK
2595	2026-09-22 05:50	70.64	OK	2596	2026-09-22 05:51	71.82	OK
2597	2026-09-22 05:52	72.16	OK	2598	2026-09-22 05:53	70.69	OK
2599	2026-09-22 05:54	70.53	OK	2600	2026-09-22 05:55	70.10	OK
2601	2026-09-22 05:56	69.32	OK	2602	2026-09-22 05:57	70.84	OK
2603	2026-09-22 05:58	72.32	OK	2604	2026-09-22 05:59	71.39	OK
2605	2026-09-22 06:00	70.72	OK	2606	2026-09-22 06:01	69.99	OK
2607	2026-09-22 06:02	71.04	OK	2608	2026-09-22 06:03	68.57	OK
2609	2026-09-22 06:04	70.53	OK	2610	2026-09-22 06:05	72.61	OK
2611	2026-09-22 06:06	70.66	OK	2612	2026-09-22 06:07	71.89	OK
2613	2026-09-22 06:08	73.25	OK	2614	2026-09-22 06:09	70.80	OK
2615	2026-09-22 06:10	70.24	OK	2616	2026-09-22 06:11	72.17	OK
2617	2026-09-22 06:12	70.99	OK	2618	2026-09-22 06:13	73.35	OK
2619	2026-09-22 06:14	70.38	OK	2620	2026-09-22 06:15	72.60	OK
2621	2026-09-22 06:16	72.41	OK	2622	2026-09-22 06:17	71.90	OK
2623	2026-09-22 06:18	72.33	OK	2624	2026-09-22 06:19	72.64	OK
2625	2026-09-22 06:20	71.92	OK	2626	2026-09-22 06:21	69.83	OK
2627	2026-09-22 06:22	69.20	OK	2628	2026-09-22 06:23	69.52	OK
2629	2026-09-22 06:24	71.51	OK	2630	2026-09-22 06:25	70.32	OK
2631	2026-09-22 06:26	72.49	OK	2632	2026-09-22 06:27	71.71	OK
2633	2026-09-22 06:28	71.35	OK	2634	2026-09-22 06:29	71.86	OK
2635	2026-09-22 06:30	72.29	OK	2636	2026-09-22 06:31	70.95	OK
2637	2026-09-22 06:32	72.09	OK	2638	2026-09-22 06:33	73.29	OK
2639	2026-09-22 06:34	71.11	OK	2640	2026-09-22 06:35	71.48	OK
2641	2026-09-22 06:36	73.09	OK	2642	2026-09-22 06:37	70.51	OK
2643	2026-09-22 06:38	73.11	OK	2644	2026-09-22 06:39	72.41	OK
2645	2026-09-22 06:40	72.54	OK	2646	2026-09-22 06:41	72.75	OK
2647	2026-09-22 06:42	71.59	OK	2648	2026-09-22 06:43	70.98	OK
2649	2026-09-22 06:44	72.52	OK	2650	2026-09-22 06:45	74.31	OK
2651	2026-09-22 06:46	71.80	OK	2652	2026-09-22 06:47	72.98	OK
2653	2026-09-22 06:48	72.11	OK	2654	2026-09-22 06:49	70.95	OK
2655	2026-09-22 06:50	72.69	OK	2656	2026-09-22 06:51	71.74	OK
2657	2026-09-22 06:52	72.66	OK	2658	2026-09-22 06:53	71.99	OK
2659	2026-09-22 06:54	72.67	OK	2660	2026-09-22 06:55	71.97	OK
2661	2026-09-22 06:56	75.03	OK	2662	2026-09-22 06:57	73.66	OK
2663	2026-09-22 06:58	72.44	OK	2664	2026-09-22 06:59	71.69	OK
2665	2026-09-22 07:00	72.46	OK	2666	2026-09-22 07:01	73.39	OK
2667	2026-09-22 07:02	73.96	OK	2668	2026-09-22 07:03	71.86	OK
2669	2026-09-22 07:04	73.58	OK	2670	2026-09-22 07:05	74.37	OK
2671	2026-09-22 07:06	74.50	OK	2672	2026-09-22 07:07	72.59	OK
2673	2026-09-22 07:08	74.28	OK	2674	2026-09-22 07:09	74.39	OK
2675	2026-09-22 07:10	74.32	OK	2676	2026-09-22 07:11	73.97	OK
2677	2026-09-22 07:12	71.76	OK	2678	2026-09-22 07:13	73.83	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2679	2026-09-22 07:14	73.65	OK	2680	2026-09-22 07:15	72.36	OK
2681	2026-09-22 07:16	71.92	OK	2682	2026-09-22 07:17	71.21	OK
2683	2026-09-22 07:18	75.00	OK	2684	2026-09-22 07:19	73.51	OK
2685	2026-09-22 07:20	70.71	OK	2686	2026-09-22 07:21	73.91	OK
2687	2026-09-22 07:22	71.66	OK	2688	2026-09-22 07:23	72.46	OK
2689	2026-09-22 07:24	74.49	OK	2690	2026-09-22 07:25	72.93	OK
2691	2026-09-22 07:26	73.85	OK	2692	2026-09-22 07:27	74.03	OK
2693	2026-09-22 07:28	72.12	OK	2694	2026-09-22 07:29	72.81	OK
2695	2026-09-22 07:30	73.08	OK	2696	2026-09-22 07:31	74.26	OK
2697	2026-09-22 07:32	73.57	OK	2698	2026-09-22 07:33	72.20	OK
2699	2026-09-22 07:34	73.55	OK	2700	2026-09-22 07:35	72.85	OK
2701	2026-09-22 07:36	75.07	OK	2702	2026-09-22 07:37	73.31	OK
2703	2026-09-22 07:38	74.88	OK	2704	2026-09-22 07:39	73.73	OK
2705	2026-09-22 07:40	72.99	OK	2706	2026-09-22 07:41	74.90	OK
2707	2026-09-22 07:42	74.18	OK	2708	2026-09-22 07:43	72.58	OK
2709	2026-09-22 07:44	74.11	OK	2710	2026-09-22 07:45	74.13	OK
2711	2026-09-22 07:46	73.00	OK	2712	2026-09-22 07:47	74.94	OK
2713	2026-09-22 07:48	72.80	OK	2714	2026-09-22 07:49	72.99	OK
2715	2026-09-22 07:50	75.87	OK	2716	2026-09-22 07:51	71.80	OK
2717	2026-09-22 07:52	74.73	OK	2718	2026-09-22 07:53	74.97	OK
2719	2026-09-22 07:54	72.90	OK	2720	2026-09-22 07:55	74.54	OK
2721	2026-09-22 07:56	76.83	OK	2722	2026-09-22 07:57	74.94	OK
2723	2026-09-22 07:58	72.96	OK	2724	2026-09-22 07:59	74.29	OK
2725	2026-09-22 08:00	73.08	OK	2726	2026-09-22 08:01	75.91	OK
2727	2026-09-22 08:02	72.19	OK	2728	2026-09-22 08:03	72.83	OK
2729	2026-09-22 08:04	71.61	OK	2730	2026-09-22 08:05	73.64	OK
2731	2026-09-22 08:06	74.17	OK	2732	2026-09-22 08:07	75.30	OK
2733	2026-09-22 08:08	73.21	OK	2734	2026-09-22 08:09	76.06	OK
2735	2026-09-22 08:10	72.83	OK	2736	2026-09-22 08:11	73.55	OK
2737	2026-09-22 08:12	74.29	OK	2738	2026-09-22 08:13	75.04	OK
2739	2026-09-22 08:14	74.57	OK	2740	2026-09-22 08:15	74.24	OK
2741	2026-09-22 08:16	73.40	OK	2742	2026-09-22 08:17	75.31	OK
2743	2026-09-22 08:18	74.98	OK	2744	2026-09-22 08:19	74.28	OK
2745	2026-09-22 08:20	74.98	OK	2746	2026-09-22 08:21	74.99	OK
2747	2026-09-22 08:22	75.23	OK	2748	2026-09-22 08:23	74.93	OK
2749	2026-09-22 08:24	75.23	OK	2750	2026-09-22 08:25	77.09	OK
2751	2026-09-22 08:26	76.18	OK	2752	2026-09-22 08:27	74.48	OK
2753	2026-09-22 08:28	73.81	OK	2754	2026-09-22 08:29	74.65	OK
2755	2026-09-22 08:30	76.24	OK	2756	2026-09-22 08:31	75.85	OK
2757	2026-09-22 08:32	74.96	OK	2758	2026-09-22 08:33	75.34	OK
2759	2026-09-22 08:34	76.10	OK	2760	2026-09-22 08:35	75.16	OK
2761	2026-09-22 08:36	75.60	OK	2762	2026-09-22 08:37	76.27	OK
2763	2026-09-22 08:38	76.13	OK	2764	2026-09-22 08:39	75.47	OK
2765	2026-09-22 08:40	77.72	OK	2766	2026-09-22 08:41	75.30	OK
2767	2026-09-22 08:42	74.76	OK	2768	2026-09-22 08:43	77.16	OK
2769	2026-09-22 08:44	73.49	OK	2770	2026-09-22 08:45	73.74	OK
2771	2026-09-22 08:46	76.12	OK	2772	2026-09-22 08:47	72.61	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2773	2026-09-22 08:48	75.09	OK	2774	2026-09-22 08:49	77.06	OK
2775	2026-09-22 08:50	75.83	OK	2776	2026-09-22 08:51	75.57	OK
2777	2026-09-22 08:52	74.39	OK	2778	2026-09-22 08:53	75.42	OK
2779	2026-09-22 08:54	74.77	OK	2780	2026-09-22 08:55	75.30	OK
2781	2026-09-22 08:56	74.43	OK	2782	2026-09-22 08:57	74.66	OK
2783	2026-09-22 08:58	77.29	OK	2784	2026-09-22 08:59	77.27	OK
2785	2026-09-22 09:00	75.45	OK	2786	2026-09-22 09:01	74.21	OK
2787	2026-09-22 09:02	76.40	OK	2788	2026-09-22 09:03	75.81	OK
2789	2026-09-22 09:04	76.84	OK	2790	2026-09-22 09:05	76.54	OK
2791	2026-09-22 09:06	76.53	OK	2792	2026-09-22 09:07	75.13	OK
2793	2026-09-22 09:08	76.82	OK	2794	2026-09-22 09:09	76.16	OK
2795	2026-09-22 09:10	76.08	OK	2796	2026-09-22 09:11	76.60	OK
2797	2026-09-22 09:12	76.38	OK	2798	2026-09-22 09:13	75.01	OK
2799	2026-09-22 09:14	76.53	OK	2800	2026-09-22 09:15	75.84	OK
2801	2026-09-22 09:16	77.59	OK	2802	2026-09-22 09:17	76.74	OK
2803	2026-09-22 09:18	74.55	OK	2804	2026-09-22 09:19	75.80	OK
2805	2026-09-22 09:20	75.60	OK	2806	2026-09-22 09:21	77.83	OK
2807	2026-09-22 09:22	76.20	OK	2808	2026-09-22 09:23	75.88	OK
2809	2026-09-22 09:24	75.69	OK	2810	2026-09-22 09:25	75.21	OK
2811	2026-09-22 09:26	78.08	OK	2812	2026-09-22 09:27	77.15	OK
2813	2026-09-22 09:28	77.02	OK	2814	2026-09-22 09:29	76.35	OK
2815	2026-09-22 09:30	75.75	OK	2816	2026-09-22 09:31	76.22	OK
2817	2026-09-22 09:32	77.65	OK	2818	2026-09-22 09:33	75.32	OK
2819	2026-09-22 09:34	76.69	OK	2820	2026-09-22 09:35	76.52	OK
2821	2026-09-22 09:36	77.37	OK	2822	2026-09-22 09:37	78.64	OK
2823	2026-09-22 09:38	75.44	OK	2824	2026-09-22 09:39	77.00	OK
2825	2026-09-22 09:40	76.81	OK	2826	2026-09-22 09:41	77.33	OK
2827	2026-09-22 09:42	76.00	OK	2828	2026-09-22 09:43	78.00	OK
2829	2026-09-22 09:44	75.78	OK	2830	2026-09-22 09:45	75.09	OK
2831	2026-09-22 09:46	76.09	OK	2832	2026-09-22 09:47	76.97	OK
2833	2026-09-22 09:48	75.51	OK	2834	2026-09-22 09:49	74.89	OK
2835	2026-09-22 09:50	77.04	OK	2836	2026-09-22 09:51	74.17	OK
2837	2026-09-22 09:52	78.19	OK	2838	2026-09-22 09:53	76.90	OK
2839	2026-09-22 09:54	78.60	OK	2840	2026-09-22 09:55	77.32	OK
2841	2026-09-22 09:56	76.58	OK	2842	2026-09-22 09:57	75.56	OK
2843	2026-09-22 09:58	77.08	OK	2844	2026-09-22 09:59	78.13	OK
2845	2026-09-22 10:00	76.69	OK	2846	2026-09-22 10:01	77.55	OK
2847	2026-09-22 10:02	76.70	OK	2848	2026-09-22 10:03	76.76	OK
2849	2026-09-22 10:04	76.25	OK	2850	2026-09-22 10:05	77.91	OK
2851	2026-09-22 10:06	75.57	OK	2852	2026-09-22 10:07	76.87	OK
2853	2026-09-22 10:08	78.45	OK	2854	2026-09-22 10:09	77.42	OK
2855	2026-09-22 10:10	75.38	OK	2856	2026-09-22 10:11	76.45	OK
2857	2026-09-22 10:12	77.56	OK	2858	2026-09-22 10:13	79.04	OK
2859	2026-09-22 10:14	76.66	OK	2860	2026-09-22 10:15	78.01	OK
2861	2026-09-22 10:16	78.71	OK	2862	2026-09-22 10:17	77.87	OK
2863	2026-09-22 10:18	77.48	OK	2864	2026-09-22 10:19	76.89	OK
2865	2026-09-22 10:20	79.14	OK	2866	2026-09-22 10:21	77.97	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2867	2026-09-22 10:22	76.10	OK	2868	2026-09-22 10:23	79.03	OK
2869	2026-09-22 10:24	77.95	OK	2870	2026-09-22 10:25	77.98	OK
2871	2026-09-22 10:26	77.09	OK	2872	2026-09-22 10:27	76.70	OK
2873	2026-09-22 10:28	76.92	OK	2874	2026-09-22 10:29	78.42	OK
2875	2026-09-22 10:30	77.21	OK	2876	2026-09-22 10:31	76.74	OK
2877	2026-09-22 10:32	79.15	OK	2878	2026-09-22 10:33	78.49	OK
2879	2026-09-22 10:34	78.17	OK	2880	2026-09-22 10:35	78.06	OK
2881	2026-09-22 10:36	78.00	OK	2882	2026-09-22 10:37	77.57	OK
2883	2026-09-22 10:38	79.43	OK	2884	2026-09-22 10:39	80.73	OK
2885	2026-09-22 10:40	77.73	OK	2886	2026-09-22 10:41	78.12	OK
2887	2026-09-22 10:42	78.05	OK	2888	2026-09-22 10:43	77.19	OK
2889	2026-09-22 10:44	78.51	OK	2890	2026-09-22 10:45	78.11	OK
2891	2026-09-22 10:46	78.95	OK	2892	2026-09-22 10:47	77.46	OK
2893	2026-09-22 10:48	77.50	OK	2894	2026-09-22 10:49	77.15	OK
2895	2026-09-22 10:50	78.50	OK	2896	2026-09-22 10:51	76.39	OK
2897	2026-09-22 10:52	77.95	OK	2898	2026-09-22 10:53	79.18	OK
2899	2026-09-22 10:54	80.42	OK	2900	2026-09-22 10:55	79.83	OK
2901	2026-09-22 10:56	78.13	OK	2902	2026-09-22 10:57	77.42	OK
2903	2026-09-22 10:58	77.38	OK	2904	2026-09-22 10:59	76.17	OK
2905	2026-09-22 11:00	79.40	OK	2906	2026-09-22 11:01	76.71	OK
2907	2026-09-22 11:02	78.19	OK	2908	2026-09-22 11:03	78.89	OK
2909	2026-09-22 11:04	76.96	OK	2910	2026-09-22 11:05	77.89	OK
2911	2026-09-22 11:06	78.47	OK	2912	2026-09-22 11:07	76.83	OK
2913	2026-09-22 11:08	77.88	OK	2914	2026-09-22 11:09	76.17	OK
2915	2026-09-22 11:10	76.63	OK	2916	2026-09-22 11:11	77.82	OK
2917	2026-09-22 11:12	76.06	OK	2918	2026-09-22 11:13	76.83	OK
2919	2026-09-22 11:14	77.32	OK	2920	2026-09-22 11:15	76.17	OK
2921	2026-09-22 11:16	77.14	OK	2922	2026-09-22 11:17	78.54	OK
2923	2026-09-22 11:18	80.16	OK	2924	2026-09-22 11:19	80.04	OK
2925	2026-09-22 11:20	77.83	OK	2926	2026-09-22 11:21	79.16	OK
2927	2026-09-22 11:22	78.86	OK	2928	2026-09-22 11:23	78.05	OK
2929	2026-09-22 11:24	78.43	OK	2930	2026-09-22 11:25	77.93	OK
2931	2026-09-22 11:26	78.02	OK	2932	2026-09-22 11:27	78.13	OK
2933	2026-09-22 11:28	78.36	OK	2934	2026-09-22 11:29	79.57	OK
2935	2026-09-22 11:30	77.15	OK	2936	2026-09-22 11:31	78.46	OK
2937	2026-09-22 11:32	79.92	OK	2938	2026-09-22 11:33	77.44	OK
2939	2026-09-22 11:34	79.03	OK	2940	2026-09-22 11:35	79.28	OK
2941	2026-09-22 11:36	79.61	OK	2942	2026-09-22 11:37	77.62	OK
2943	2026-09-22 11:38	79.37	OK	2944	2026-09-22 11:39	78.60	OK
2945	2026-09-22 11:40	80.44	OK	2946	2026-09-22 11:41	78.31	OK
2947	2026-09-22 11:42	79.17	OK	2948	2026-09-22 11:43	79.54	OK
2949	2026-09-22 11:44	77.92	OK	2950	2026-09-22 11:45	78.09	OK
2951	2026-09-22 11:46	78.08	OK	2952	2026-09-22 11:47	79.62	OK
2953	2026-09-22 11:48	78.74	OK	2954	2026-09-22 11:49	76.78	OK
2955	2026-09-22 11:50	78.03	OK	2956	2026-09-22 11:51	78.32	OK
2957	2026-09-22 11:52	78.90	OK	2958	2026-09-22 11:53	78.61	OK
2959	2026-09-22 11:54	77.88	OK	2960	2026-09-22 11:55	78.02	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2961	2026-09-22 11:56	77.88	OK	2962	2026-09-22 11:57	80.15	OK
2963	2026-09-22 11:58	78.40	OK	2964	2026-09-22 11:59	77.59	OK
2965	2026-09-22 12:00	77.87	OK	2966	2026-09-22 12:01	78.71	OK
2967	2026-09-22 12:02	78.80	OK	2968	2026-09-22 12:03	76.84	OK
2969	2026-09-22 12:04	78.55	OK	2970	2026-09-22 12:05	78.83	OK
2971	2026-09-22 12:06	80.83	OK	2972	2026-09-22 12:07	78.11	OK
2973	2026-09-22 12:08	77.81	OK	2974	2026-09-22 12:09	77.87	OK
2975	2026-09-22 12:10	80.83	OK	2976	2026-09-22 12:11	79.28	OK
2977	2026-09-22 12:12	78.06	OK	2978	2026-09-22 12:13	79.96	OK
2979	2026-09-22 12:14	79.53	OK	2980	2026-09-22 12:15	77.82	OK
2981	2026-09-22 12:16	79.45	OK	2982	2026-09-22 12:17	77.94	OK
2983	2026-09-22 12:18	78.44	OK	2984	2026-09-22 12:19	78.09	OK
2985	2026-09-22 12:20	79.23	OK	2986	2026-09-22 12:21	79.55	OK
2987	2026-09-22 12:22	79.14	OK	2988	2026-09-22 12:23	77.00	OK
2989	2026-09-22 12:24	77.56	OK	2990	2026-09-22 12:25	79.08	OK
2991	2026-09-22 12:26	80.17	OK	2992	2026-09-22 12:27	79.13	OK
2993	2026-09-22 12:28	80.18	OK	2994	2026-09-22 12:29	77.52	OK
2995	2026-09-22 12:30	79.49	OK	2996	2026-09-22 12:31	77.47	OK
2997	2026-09-22 12:32	79.37	OK	2998	2026-09-22 12:33	80.10	OK
2999	2026-09-22 12:34	76.51	OK	3000	2026-09-22 12:35	79.24	OK
3001	2026-09-22 12:36	78.55	OK	3002	2026-09-22 12:37	79.11	OK
3003	2026-09-22 12:38	79.69	OK	3004	2026-09-22 12:39	77.62	OK
3005	2026-09-22 12:40	78.13	OK	3006	2026-09-22 12:41	80.30	OK
3007	2026-09-22 12:42	78.20	OK	3008	2026-09-22 12:43	77.52	OK
3009	2026-09-22 12:44	78.37	OK	3010	2026-09-22 12:45	76.90	OK
3011	2026-09-22 12:46	78.72	OK	3012	2026-09-22 12:47	79.36	OK
3013	2026-09-22 12:48	79.17	OK	3014	2026-09-22 12:49	76.41	OK
3015	2026-09-22 12:50	79.47	OK	3016	2026-09-22 12:51	78.00	OK
3017	2026-09-22 12:52	78.78	OK	3018	2026-09-22 12:53	79.54	OK
3019	2026-09-22 12:54	78.05	OK	3020	2026-09-22 12:55	79.20	OK
3021	2026-09-22 12:56	77.98	OK	3022	2026-09-22 12:57	77.63	OK
3023	2026-09-22 12:58	79.33	OK	3024	2026-09-22 12:59	78.51	OK
3025	2026-09-22 13:00	77.60	OK	3026	2026-09-22 13:01	76.49	OK
3027	2026-09-22 13:02	77.82	OK	3028	2026-09-22 13:03	77.57	OK
3029	2026-09-22 13:04	78.21	OK	3030	2026-09-22 13:05	78.28	OK
3031	2026-09-22 13:06	78.89	OK	3032	2026-09-22 13:07	78.60	OK
3033	2026-09-22 13:08	79.03	OK	3034	2026-09-22 13:09	77.74	OK
3035	2026-09-22 13:10	78.14	OK	3036	2026-09-22 13:11	77.35	OK
3037	2026-09-22 13:12	78.80	OK	3038	2026-09-22 13:13	78.01	OK
3039	2026-09-22 13:14	78.22	OK	3040	2026-09-22 13:15	77.93	OK
3041	2026-09-22 13:16	78.11	OK	3042	2026-09-22 13:17	79.22	OK
3043	2026-09-22 13:18	78.46	OK	3044	2026-09-22 13:19	79.69	OK
3045	2026-09-22 13:20	78.59	OK	3046	2026-09-22 13:21	77.72	OK
3047	2026-09-22 13:22	78.43	OK	3048	2026-09-22 13:23	78.67	OK
3049	2026-09-22 13:24	78.51	OK	3050	2026-09-22 13:25	78.09	OK
3051	2026-09-22 13:26	77.94	OK	3052	2026-09-22 13:27	78.98	OK
3053	2026-09-22 13:28	76.71	OK	3054	2026-09-22 13:29	80.24	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3055	2026-09-22 13:30	78.40	OK	3056	2026-09-22 13:31	77.24	OK
3057	2026-09-22 13:32	79.41	OK	3058	2026-09-22 13:33	76.74	OK
3059	2026-09-22 13:34	78.06	OK	3060	2026-09-22 13:35	78.13	OK
3061	2026-09-22 13:36	77.58	OK	3062	2026-09-22 13:37	79.62	OK
3063	2026-09-22 13:38	78.80	OK	3064	2026-09-22 13:39	80.30	OK
3065	2026-09-22 13:40	78.82	OK	3066	2026-09-22 13:41	79.15	OK
3067	2026-09-22 13:42	78.73	OK	3068	2026-09-22 13:43	77.75	OK
3069	2026-09-22 13:44	78.50	OK	3070	2026-09-22 13:45	78.94	OK
3071	2026-09-22 13:46	78.97	OK	3072	2026-09-22 13:47	77.17	OK
3073	2026-09-22 13:48	77.36	OK	3074	2026-09-22 13:49	79.01	OK
3075	2026-09-22 13:50	80.07	OK	3076	2026-09-22 13:51	79.97	OK
3077	2026-09-22 13:52	78.80	OK	3078	2026-09-22 13:53	77.81	OK
3079	2026-09-22 13:54	78.15	OK	3080	2026-09-22 13:55	78.77	OK
3081	2026-09-22 13:56	77.58	OK	3082	2026-09-22 13:57	78.85	OK
3083	2026-09-22 13:58	77.38	OK	3084	2026-09-22 13:59	76.86	OK
3085	2026-09-22 14:00	78.65	OK	3086	2026-09-22 14:01	79.29	OK
3087	2026-09-22 14:02	78.02	OK	3088	2026-09-22 14:03	77.38	OK
3089	2026-09-22 14:04	79.64	OK	3090	2026-09-22 14:05	78.51	OK
3091	2026-09-22 14:06	77.88	OK	3092	2026-09-22 14:07	76.03	OK
3093	2026-09-22 14:08	77.63	OK	3094	2026-09-22 14:09	80.35	OK
3095	2026-09-22 14:10	80.33	OK	3096	2026-09-22 14:11	79.79	OK
3097	2026-09-22 14:12	78.45	OK	3098	2026-09-22 14:13	77.58	OK
3099	2026-09-22 14:14	80.67	OK	3100	2026-09-22 14:15	78.12	OK
3101	2026-09-22 14:16	79.00	OK	3102	2026-09-22 14:17	77.82	OK
3103	2026-09-22 14:18	77.96	OK	3104	2026-09-22 14:19	79.42	OK
3105	2026-09-22 14:20	78.59	OK	3106	2026-09-22 14:21	79.35	OK
3107	2026-09-22 14:22	77.90	OK	3108	2026-09-22 14:23	78.01	OK
3109	2026-09-22 14:24	77.50	OK	3110	2026-09-22 14:25	77.34	OK
3111	2026-09-22 14:26	79.76	OK	3112	2026-09-22 14:27	76.10	OK
3113	2026-09-22 14:28	78.33	OK	3114	2026-09-22 14:29	77.42	OK
3115	2026-09-22 14:30	79.86	OK	3116	2026-09-22 14:31	80.13	OK
3117	2026-09-22 14:32	76.47	OK	3118	2026-09-22 14:33	77.40	OK
3119	2026-09-22 14:34	76.49	OK	3120	2026-09-22 14:35	76.68	OK
3121	2026-09-22 14:36	77.29	OK	3122	2026-09-22 14:37	76.88	OK
3123	2026-09-22 14:38	75.94	OK	3124	2026-09-22 14:39	75.94	OK
3125	2026-09-22 14:40	78.83	OK	3126	2026-09-22 14:41	77.97	OK
3127	2026-09-22 14:42	76.47	OK	3128	2026-09-22 14:43	78.40	OK
3129	2026-09-22 14:44	78.91	OK	3130	2026-09-22 14:45	78.22	OK
3131	2026-09-22 14:46	79.99	OK	3132	2026-09-22 14:47	76.01	OK
3133	2026-09-22 14:48	76.43	OK	3134	2026-09-22 14:49	78.61	OK
3135	2026-09-22 14:50	76.75	OK	3136	2026-09-22 14:51	76.70	OK
3137	2026-09-22 14:52	77.93	OK	3138	2026-09-22 14:53	77.86	OK
3139	2026-09-22 14:54	78.82	OK	3140	2026-09-22 14:55	78.50	OK
3141	2026-09-22 14:56	79.09	OK	3142	2026-09-22 14:57	79.44	OK
3143	2026-09-22 14:58	77.50	OK	3144	2026-09-22 14:59	77.58	OK
3145	2026-09-22 15:00	75.82	OK	3146	2026-09-22 15:01	77.94	OK
3147	2026-09-22 15:02	77.99	OK	3148	2026-09-22 15:03	79.22	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3149	2026-09-22 15:04	77.39	OK	3150	2026-09-22 15:05	77.85	OK
3151	2026-09-22 15:06	77.96	OK	3152	2026-09-22 15:07	77.52	OK
3153	2026-09-22 15:08	77.36	OK	3154	2026-09-22 15:09	77.13	OK
3155	2026-09-22 15:10	78.85	OK	3156	2026-09-22 15:11	79.01	OK
3157	2026-09-22 15:12	77.28	OK	3158	2026-09-22 15:13	78.67	OK
3159	2026-09-22 15:14	78.26	OK	3160	2026-09-22 15:15	76.27	OK
3161	2026-09-22 15:16	76.94	OK	3162	2026-09-22 15:17	78.89	OK
3163	2026-09-22 15:18	78.41	OK	3164	2026-09-22 15:19	78.55	OK
3165	2026-09-22 15:20	77.62	OK	3166	2026-09-22 15:21	76.32	OK
3167	2026-09-22 15:22	76.46	OK	3168	2026-09-22 15:23	78.70	OK
3169	2026-09-22 15:24	76.18	OK	3170	2026-09-22 15:25	78.47	OK
3171	2026-09-22 15:26	77.24	OK	3172	2026-09-22 15:27	78.35	OK
3173	2026-09-22 15:28	77.75	OK	3174	2026-09-22 15:29	77.32	OK
3175	2026-09-22 15:30	77.99	OK	3176	2026-09-22 15:31	75.75	OK
3177	2026-09-22 15:32	77.21	OK	3178	2026-09-22 15:33	77.50	OK
3179	2026-09-22 15:34	77.14	OK	3180	2026-09-22 15:35	77.24	OK
3181	2026-09-22 15:36	77.68	OK	3182	2026-09-22 15:37	78.27	OK
3183	2026-09-22 15:38	75.81	OK	3184	2026-09-22 15:39	75.75	OK
3185	2026-09-22 15:40	75.94	OK	3186	2026-09-22 15:41	77.11	OK
3187	2026-09-22 15:42	75.18	OK	3188	2026-09-22 15:43	76.35	OK
3189	2026-09-22 15:44	78.14	OK	3190	2026-09-22 15:45	78.07	OK
3191	2026-09-22 15:46	78.77	OK	3192	2026-09-22 15:47	77.65	OK
3193	2026-09-22 15:48	78.50	OK	3194	2026-09-22 15:49	77.31	OK
3195	2026-09-22 15:50	77.55	OK	3196	2026-09-22 15:51	77.04	OK
3197	2026-09-22 15:52	73.83	OK	3198	2026-09-22 15:53	77.73	OK
3199	2026-09-22 15:54	77.51	OK	3200	2026-09-22 15:55	76.09	OK
3201	2026-09-22 15:56	77.04	OK	3202	2026-09-22 15:57	77.29	OK
3203	2026-09-22 15:58	75.79	OK	3204	2026-09-22 15:59	77.57	OK
3205	2026-09-22 16:00	77.69	OK	3206	2026-09-22 16:01	76.25	OK
3207	2026-09-22 16:02	77.06	OK	3208	2026-09-22 16:03	75.42	OK
3209	2026-09-22 16:04	74.57	OK	3210	2026-09-22 16:05	74.61	OK
3211	2026-09-22 16:06	75.19	OK	3212	2026-09-22 16:07	78.08	OK
3213	2026-09-22 16:08	77.55	OK	3214	2026-09-22 16:09	77.46	OK
3215	2026-09-22 16:10	75.59	OK	3216	2026-09-22 16:11	73.85	OK
3217	2026-09-22 16:12	76.71	OK	3218	2026-09-22 16:13	75.13	OK
3219	2026-09-22 16:14	76.97	OK	3220	2026-09-22 16:15	76.47	OK
3221	2026-09-22 16:16	76.66	OK	3222	2026-09-22 16:17	77.46	OK
3223	2026-09-22 16:18	75.13	OK	3224	2026-09-22 16:19	76.88	OK
3225	2026-09-22 16:20	75.63	OK	3226	2026-09-22 16:21	75.51	OK
3227	2026-09-22 16:22	76.73	OK	3228	2026-09-22 16:23	78.35	OK
3229	2026-09-22 16:24	77.51	OK	3230	2026-09-22 16:25	76.50	OK
3231	2026-09-22 16:26	74.92	OK	3232	2026-09-22 16:27	79.02	OK
3233	2026-09-22 16:28	76.81	OK	3234	2026-09-22 16:29	74.65	OK
3235	2026-09-22 16:30	75.65	OK	3236	2026-09-22 16:31	77.05	OK
3237	2026-09-22 16:32	75.50	OK	3238	2026-09-22 16:33	77.97	OK
3239	2026-09-22 16:34	74.80	OK	3240	2026-09-22 16:35	76.73	OK
3241	2026-09-22 16:36	77.29	OK	3242	2026-09-22 16:37	75.82	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3243	2026-09-22 16:38	76.33	OK	3244	2026-09-22 16:39	76.35	OK
3245	2026-09-22 16:40	75.63	OK	3246	2026-09-22 16:41	75.70	OK
3247	2026-09-22 16:42	74.52	OK	3248	2026-09-22 16:43	76.90	OK
3249	2026-09-22 16:44	76.65	OK	3250	2026-09-22 16:45	76.04	OK
3251	2026-09-22 16:46	74.58	OK	3252	2026-09-22 16:47	75.64	OK
3253	2026-09-22 16:48	76.27	OK	3254	2026-09-22 16:49	76.24	OK
3255	2026-09-22 16:50	76.89	OK	3256	2026-09-22 16:51	75.09	OK
3257	2026-09-22 16:52	76.25	OK	3258	2026-09-22 16:53	75.27	OK
3259	2026-09-22 16:54	75.99	OK	3260	2026-09-22 16:55	75.33	OK
3261	2026-09-22 16:56	76.91	OK	3262	2026-09-22 16:57	73.60	OK
3263	2026-09-22 16:58	74.16	OK	3264	2026-09-22 16:59	74.54	OK
3265	2026-09-22 17:00	73.44	OK	3266	2026-09-22 17:01	75.75	OK
3267	2026-09-22 17:02	77.39	OK	3268	2026-09-22 17:03	73.63	OK
3269	2026-09-22 17:04	75.45	OK	3270	2026-09-22 17:05	74.03	OK
3271	2026-09-22 17:06	72.81	OK	3272	2026-09-22 17:07	76.26	OK
3273	2026-09-22 17:08	74.79	OK	3274	2026-09-22 17:09	75.88	OK
3275	2026-09-22 17:10	74.23	OK	3276	2026-09-22 17:11	75.12	OK
3277	2026-09-22 17:12	73.16	OK	3278	2026-09-22 17:13	74.42	OK
3279	2026-09-22 17:14	74.34	OK	3280	2026-09-22 17:15	76.76	OK
3281	2026-09-22 17:16	74.68	OK	3282	2026-09-22 17:17	74.78	OK
3283	2026-09-22 17:18	74.58	OK	3284	2026-09-22 17:19	76.23	OK
3285	2026-09-22 17:20	75.15	OK	3286	2026-09-22 17:21	74.70	OK
3287	2026-09-22 17:22	77.09	OK	3288	2026-09-22 17:23	75.03	OK
3289	2026-09-22 17:24	74.78	OK	3290	2026-09-22 17:25	75.46	OK
3291	2026-09-22 17:26	73.10	OK	3292	2026-09-22 17:27	73.47	OK
3293	2026-09-22 17:28	74.81	OK	3294	2026-09-22 17:29	75.77	OK
3295	2026-09-22 17:30	73.10	OK	3296	2026-09-22 17:31	74.43	OK
3297	2026-09-22 17:32	75.82	OK	3298	2026-09-22 17:33	74.35	OK
3299	2026-09-22 17:34	76.20	OK	3300	2026-09-22 17:35	75.13	OK
3301	2026-09-22 17:36	74.94	OK	3302	2026-09-22 17:37	73.48	OK
3303	2026-09-22 17:38	74.43	OK	3304	2026-09-22 17:39	76.06	OK
3305	2026-09-22 17:40	74.66	OK	3306	2026-09-22 17:41	74.01	OK
3307	2026-09-22 17:42	72.21	OK	3308	2026-09-22 17:43	75.29	OK
3309	2026-09-22 17:44	72.33	OK	3310	2026-09-22 17:45	74.67	OK
3311	2026-09-22 17:46	75.28	OK	3312	2026-09-22 17:47	72.63	OK
3313	2026-09-22 17:48	74.31	OK	3314	2026-09-22 17:49	72.46	OK
3315	2026-09-22 17:50	75.95	OK	3316	2026-09-22 17:51	73.78	OK
3317	2026-09-22 17:52	76.43	OK	3318	2026-09-22 17:53	71.28	OK
3319	2026-09-22 17:54	73.23	OK	3320	2026-09-22 17:55	73.49	OK
3321	2026-09-22 17:56	74.74	OK	3322	2026-09-22 17:57	75.56	OK
3323	2026-09-22 17:58	73.60	OK	3324	2026-09-22 17:59	73.86	OK
3325	2026-09-22 18:00	74.41	OK	3326	2026-09-22 18:01	72.66	OK
3327	2026-09-22 18:02	73.67	OK	3328	2026-09-22 18:03	72.87	OK
3329	2026-09-22 18:04	75.00	OK	3330	2026-09-22 18:05	75.07	OK
3331	2026-09-22 18:06	74.74	OK	3332	2026-09-22 18:07	72.40	OK
3333	2026-09-22 18:08	71.69	OK	3334	2026-09-22 18:09	74.73	OK
3335	2026-09-22 18:10	73.31	OK	3336	2026-09-22 18:11	74.24	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3337	2026-09-22 18:12	71.81	OK	3338	2026-09-22 18:13	72.97	OK
3339	2026-09-22 18:14	73.64	OK	3340	2026-09-22 18:15	71.94	OK
3341	2026-09-22 18:16	72.88	OK	3342	2026-09-22 18:17	71.32	OK
3343	2026-09-22 18:18	74.92	OK	3344	2026-09-22 18:19	74.16	OK
3345	2026-09-22 18:20	73.07	OK	3346	2026-09-22 18:21	75.76	OK
3347	2026-09-22 18:22	74.15	OK	3348	2026-09-22 18:23	72.34	OK
3349	2026-09-22 18:24	75.75	OK	3350	2026-09-22 18:25	72.86	OK
3351	2026-09-22 18:26	73.04	OK	3352	2026-09-22 18:27	74.72	OK
3353	2026-09-22 18:28	74.19	OK	3354	2026-09-22 18:29	71.10	OK
3355	2026-09-22 18:30	72.44	OK	3356	2026-09-22 18:31	72.92	OK
3357	2026-09-22 18:32	73.74	OK	3358	2026-09-22 18:33	72.36	OK
3359	2026-09-22 18:34	72.24	OK	3360	2026-09-22 18:35	72.63	OK
3361	2026-09-22 18:36	72.80	OK	3362	2026-09-22 18:37	72.96	OK
3363	2026-09-22 18:38	73.75	OK	3364	2026-09-22 18:39	73.89	OK
3365	2026-09-22 18:40	73.99	OK	3366	2026-09-22 18:41	73.15	OK
3367	2026-09-22 18:42	70.94	OK	3368	2026-09-22 18:43	74.26	OK
3369	2026-09-22 18:44	73.51	OK	3370	2026-09-22 18:45	70.76	OK
3371	2026-09-22 18:46	71.34	OK	3372	2026-09-22 18:47	71.15	OK
3373	2026-09-22 18:48	72.30	OK	3374	2026-09-22 18:49	72.73	OK
3375	2026-09-22 18:50	74.39	OK	3376	2026-09-22 18:51	69.95	OK
3377	2026-09-22 18:52	73.24	OK	3378	2026-09-22 18:53	70.69	OK
3379	2026-09-22 18:54	71.63	OK	3380	2026-09-22 18:55	71.19	OK
3381	2026-09-22 18:56	72.09	OK	3382	2026-09-22 18:57	70.37	OK
3383	2026-09-22 18:58	71.89	OK	3384	2026-09-22 18:59	71.73	OK
3385	2026-09-22 19:00	71.70	OK	3386	2026-09-22 19:01	73.07	OK
3387	2026-09-22 19:02	69.99	OK	3388	2026-09-22 19:03	71.87	OK
3389	2026-09-22 19:04	72.74	OK	3390	2026-09-22 19:05	70.76	OK
3391	2026-09-22 19:06	71.70	OK	3392	2026-09-22 19:07	71.38	OK
3393	2026-09-22 19:08	71.85	OK	3394	2026-09-22 19:09	71.61	OK
3395	2026-09-22 19:10	72.18	OK	3396	2026-09-22 19:11	70.61	OK
3397	2026-09-22 19:12	70.95	OK	3398	2026-09-22 19:13	71.83	OK
3399	2026-09-22 19:14	71.19	OK	3400	2026-09-22 19:15	70.66	OK
3401	2026-09-22 19:16	72.39	OK	3402	2026-09-22 19:17	71.46	OK
3403	2026-09-22 19:18	74.53	OK	3404	2026-09-22 19:19	69.86	OK
3405	2026-09-22 19:20	72.19	OK	3406	2026-09-22 19:21	70.64	OK
3407	2026-09-22 19:22	71.26	OK	3408	2026-09-22 19:23	72.72	OK
3409	2026-09-22 19:24	70.50	OK	3410	2026-09-22 19:25	70.88	OK
3411	2026-09-22 19:26	71.15	OK	3412	2026-09-22 19:27	72.23	OK
3413	2026-09-22 19:28	72.60	OK	3414	2026-09-22 19:29	70.79	OK
3415	2026-09-22 19:30	70.11	OK	3416	2026-09-22 19:31	71.57	OK
3417	2026-09-22 19:32	72.77	OK	3418	2026-09-22 19:33	72.73	OK
3419	2026-09-22 19:34	73.00	OK	3420	2026-09-22 19:35	70.87	OK
3421	2026-09-22 19:36	69.97	OK	3422	2026-09-22 19:37	71.71	OK
3423	2026-09-22 19:38	69.90	OK	3424	2026-09-22 19:39	70.92	OK
3425	2026-09-22 19:40	70.19	OK	3426	2026-09-22 19:41	71.54	OK
3427	2026-09-22 19:42	72.54	OK	3428	2026-09-22 19:43	72.97	OK
3429	2026-09-22 19:44	70.10	OK	3430	2026-09-22 19:45	72.89	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3431	2026-09-22 19:46	71.00	OK	3432	2026-09-22 19:47	69.93	OK
3433	2026-09-22 19:48	71.31	OK	3434	2026-09-22 19:49	71.66	OK
3435	2026-09-22 19:50	71.63	OK	3436	2026-09-22 19:51	71.68	OK
3437	2026-09-22 19:52	70.91	OK	3438	2026-09-22 19:53	68.89	OK
3439	2026-09-22 19:54	70.45	OK	3440	2026-09-22 19:55	71.06	OK
3441	2026-09-22 19:56	70.13	OK	3442	2026-09-22 19:57	72.83	OK
3443	2026-09-22 19:58	71.51	OK	3444	2026-09-22 19:59	70.08	OK
3445	2026-09-22 20:00	71.30	OK	3446	2026-09-22 20:01	70.36	OK
3447	2026-09-22 20:02	70.26	OK	3448	2026-09-22 20:03	69.21	OK
3449	2026-09-22 20:04	71.15	OK	3450	2026-09-22 20:05	69.51	OK
3451	2026-09-22 20:06	69.57	OK	3452	2026-09-22 20:07	71.57	OK
3453	2026-09-22 20:08	70.30	OK	3454	2026-09-22 20:09	69.97	OK
3455	2026-09-22 20:10	69.37	OK	3456	2026-09-22 20:11	69.59	OK
3457	2026-09-22 20:12	71.13	OK	3458	2026-09-22 20:13	69.03	OK
3459	2026-09-22 20:14	68.76	OK	3460	2026-09-22 20:15	69.77	OK
3461	2026-09-22 20:16	70.49	OK	3462	2026-09-22 20:17	69.54	OK
3463	2026-09-22 20:18	69.71	OK	3464	2026-09-22 20:19	68.97	OK
3465	2026-09-22 20:20	68.58	OK	3466	2026-09-22 20:21	70.30	OK
3467	2026-09-22 20:22	69.64	OK	3468	2026-09-22 20:23	71.12	OK
3469	2026-09-22 20:24	71.40	OK	3470	2026-09-22 20:25	69.27	OK
3471	2026-09-22 20:26	67.89	OK	3472	2026-09-22 20:27	68.35	OK
3473	2026-09-22 20:28	70.16	OK	3474	2026-09-22 20:29	70.79	OK
3475	2026-09-22 20:30	70.01	OK	3476	2026-09-22 20:31	70.57	OK
3477	2026-09-22 20:32	68.96	OK	3478	2026-09-22 20:33	70.48	OK
3479	2026-09-22 20:34	70.44	OK	3480	2026-09-22 20:35	69.67	OK
3481	2026-09-22 20:36	68.73	OK	3482	2026-09-22 20:37	67.30	OK
3483	2026-09-22 20:38	70.69	OK	3484	2026-09-22 20:39	67.84	OK
3485	2026-09-22 20:40	68.97	OK	3486	2026-09-22 20:41	67.01	OK
3487	2026-09-22 20:42	70.56	OK	3488	2026-09-22 20:43	69.26	OK
3489	2026-09-22 20:44	70.20	OK	3490	2026-09-22 20:45	68.62	OK
3491	2026-09-22 20:46	68.81	OK	3492	2026-09-22 20:47	69.60	OK
3493	2026-09-22 20:48	69.21	OK	3494	2026-09-22 20:49	69.13	OK
3495	2026-09-22 20:50	68.99	OK	3496	2026-09-22 20:51	71.45	OK
3497	2026-09-22 20:52	71.05	OK	3498	2026-09-22 20:53	68.34	OK
3499	2026-09-22 20:54	69.94	OK	3500	2026-09-22 20:55	69.62	OK
3501	2026-09-22 20:56	67.58	OK	3502	2026-09-22 20:57	68.75	OK
3503	2026-09-22 20:58	68.24	OK	3504	2026-09-22 20:59	69.83	OK
3505	2026-09-22 21:00	70.36	OK	3506	2026-09-22 21:01	68.32	OK
3507	2026-09-22 21:02	70.49	OK	3508	2026-09-22 21:03	69.53	OK
3509	2026-09-22 21:04	67.64	OK	3510	2026-09-22 21:05	69.12	OK
3511	2026-09-22 21:06	68.84	OK	3512	2026-09-22 21:07	69.41	OK
3513	2026-09-22 21:08	68.16	OK	3514	2026-09-22 21:09	68.30	OK
3515	2026-09-22 21:10	70.54	OK	3516	2026-09-22 21:11	66.93	OK
3517	2026-09-22 21:12	69.74	OK	3518	2026-09-22 21:13	68.60	OK
3519	2026-09-22 21:14	67.04	OK	3520	2026-09-22 21:15	69.61	OK
3521	2026-09-22 21:16	68.49	OK	3522	2026-09-22 21:17	68.43	OK
3523	2026-09-22 21:18	69.74	OK	3524	2026-09-22 21:19	67.38	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3525	2026-09-22 21:20	68.69	OK	3526	2026-09-22 21:21	68.77	OK
3527	2026-09-22 21:22	70.27	OK	3528	2026-09-22 21:23	69.75	OK
3529	2026-09-22 21:24	69.89	OK	3530	2026-09-22 21:25	67.69	OK
3531	2026-09-22 21:26	68.34	OK	3532	2026-09-22 21:27	68.87	OK
3533	2026-09-22 21:28	67.08	OK	3534	2026-09-22 21:29	70.66	OK
3535	2026-09-22 21:30	70.11	OK	3536	2026-09-22 21:31	66.26	OK
3537	2026-09-22 21:32	67.55	OK	3538	2026-09-22 21:33	70.74	OK
3539	2026-09-22 21:34	67.02	OK	3540	2026-09-22 21:35	67.24	OK
3541	2026-09-22 21:36	68.61	OK	3542	2026-09-22 21:37	69.26	OK
3543	2026-09-22 21:38	69.30	OK	3544	2026-09-22 21:39	67.79	OK
3545	2026-09-22 21:40	69.07	OK	3546	2026-09-22 21:41	67.31	OK
3547	2026-09-22 21:42	68.14	OK	3548	2026-09-22 21:43	65.75	OK
3549	2026-09-22 21:44	69.74	OK	3550	2026-09-22 21:45	69.87	OK
3551	2026-09-22 21:46	68.91	OK	3552	2026-09-22 21:47	66.40	OK
3553	2026-09-22 21:48	67.80	OK	3554	2026-09-22 21:49	67.30	OK
3555	2026-09-22 21:50	66.10	OK	3556	2026-09-22 21:51	66.79	OK
3557	2026-09-22 21:52	68.15	OK	3558	2026-09-22 21:53	68.00	OK
3559	2026-09-22 21:54	66.43	OK	3560	2026-09-22 21:55	67.39	OK
3561	2026-09-22 21:56	66.85	OK	3562	2026-09-22 21:57	65.93	OK
3563	2026-09-22 21:58	67.51	OK	3564	2026-09-22 21:59	67.48	OK
3565	2026-09-22 22:00	69.30	OK	3566	2026-09-22 22:01	68.40	OK
3567	2026-09-22 22:02	67.13	OK	3568	2026-09-22 22:03	67.54	OK
3569	2026-09-22 22:04	67.25	OK	3570	2026-09-22 22:05	67.89	OK
3571	2026-09-22 22:06	67.89	OK	3572	2026-09-22 22:07	67.26	OK
3573	2026-09-22 22:08	68.10	OK	3574	2026-09-22 22:09	67.49	OK
3575	2026-09-22 22:10	67.64	OK	3576	2026-09-22 22:11	68.99	OK
3577	2026-09-22 22:12	67.83	OK	3578	2026-09-22 22:13	67.96	OK
3579	2026-09-22 22:14	68.14	OK	3580	2026-09-22 22:15	68.47	OK
3581	2026-09-22 22:16	68.95	OK	3582	2026-09-22 22:17	66.90	OK
3583	2026-09-22 22:18	65.80	OK	3584	2026-09-22 22:19	67.67	OK
3585	2026-09-22 22:20	67.00	OK	3586	2026-09-22 22:21	66.78	OK
3587	2026-09-22 22:22	67.99	OK	3588	2026-09-22 22:23	66.63	OK
3589	2026-09-22 22:24	68.65	OK	3590	2026-09-22 22:25	68.61	OK
3591	2026-09-22 22:26	67.19	OK	3592	2026-09-22 22:27	66.95	OK
3593	2026-09-22 22:28	67.44	OK	3594	2026-09-22 22:29	67.43	OK
3595	2026-09-22 22:30	68.93	OK	3596	2026-09-22 22:31	67.14	OK
3597	2026-09-22 22:32	69.87	OK	3598	2026-09-22 22:33	68.07	OK
3599	2026-09-22 22:34	67.17	OK	3600	2026-09-22 22:35	67.26	OK
3601	2026-09-22 22:36	65.12	OK	3602	2026-09-22 22:37	67.18	OK
3603	2026-09-22 22:38	67.66	OK	3604	2026-09-22 22:39	66.34	OK
3605	2026-09-22 22:40	67.42	OK	3606	2026-09-22 22:41	67.96	OK
3607	2026-09-22 22:42	67.60	OK	3608	2026-09-22 22:43	66.66	OK
3609	2026-09-22 22:44	67.59	OK	3610	2026-09-22 22:45	67.56	OK
3611	2026-09-22 22:46	67.39	OK	3612	2026-09-22 22:47	65.74	OK
3613	2026-09-22 22:48	65.72	OK	3614	2026-09-22 22:49	68.62	OK
3615	2026-09-22 22:50	66.14	OK	3616	2026-09-22 22:51	68.62	OK
3617	2026-09-22 22:52	65.75	OK	3618	2026-09-22 22:53	68.41	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3619	2026-09-22 22:54	65.92	OK	3620	2026-09-22 22:55	68.13	OK
3621	2026-09-22 22:56	67.28	OK	3622	2026-09-22 22:57	68.48	OK
3623	2026-09-22 22:58	65.90	OK	3624	2026-09-22 22:59	64.88	OK
3625	2026-09-22 23:00	67.23	OK	3626	2026-09-22 23:01	67.89	OK
3627	2026-09-22 23:02	65.46	OK	3628	2026-09-22 23:03	66.78	OK
3629	2026-09-22 23:04	66.95	OK	3630	2026-09-22 23:05	66.53	OK
3631	2026-09-22 23:06	67.35	OK	3632	2026-09-22 23:07	66.42	OK
3633	2026-09-22 23:08	66.51	OK	3634	2026-09-22 23:09	67.09	OK
3635	2026-09-22 23:10	66.76	OK	3636	2026-09-22 23:11	68.00	OK
3637	2026-09-22 23:12	66.50	OK	3638	2026-09-22 23:13	66.08	OK
3639	2026-09-22 23:14	66.59	OK	3640	2026-09-22 23:15	66.12	OK
3641	2026-09-22 23:16	65.79	OK	3642	2026-09-22 23:17	66.80	OK
3643	2026-09-22 23:18	66.00	OK	3644	2026-09-22 23:19	67.49	OK
3645	2026-09-22 23:20	66.17	OK	3646	2026-09-22 23:21	66.94	OK
3647	2026-09-22 23:22	64.56	OK	3648	2026-09-22 23:23	65.22	OK
3649	2026-09-22 23:24	66.83	OK	3650	2026-09-22 23:25	66.46	OK
3651	2026-09-22 23:26	65.78	OK	3652	2026-09-22 23:27	66.87	OK
3653	2026-09-22 23:28	67.32	OK	3654	2026-09-22 23:29	65.44	OK
3655	2026-09-22 23:30	67.74	OK	3656	2026-09-22 23:31	66.37	OK
3657	2026-09-22 23:32	66.53	OK	3658	2026-09-22 23:33	65.49	OK
3659	2026-09-22 23:34	67.63	OK	3660	2026-09-22 23:35	66.75	OK
3661	2026-09-22 23:36	68.81	OK	3662	2026-09-22 23:37	65.59	OK
3663	2026-09-22 23:38	66.95	OK	3664	2026-09-22 23:39	65.35	OK
3665	2026-09-22 23:40	65.53	OK	3666	2026-09-22 23:41	66.33	OK
3667	2026-09-22 23:42	67.81	OK	3668	2026-09-22 23:43	67.05	OK
3669	2026-09-22 23:44	67.08	OK	3670	2026-09-22 23:45	65.98	OK
3671	2026-09-22 23:46	65.52	OK	3672	2026-09-22 23:47	65.68	OK
3673	2026-09-22 23:48	65.18	OK	3674	2026-09-22 23:49	64.87	OK
3675	2026-09-22 23:50	66.22	OK	3676	2026-09-22 23:51	66.06	OK
3677	2026-09-22 23:52	65.72	OK	3678	2026-09-22 23:53	67.93	OK
3679	2026-09-22 23:54	67.81	OK	3680	2026-09-22 23:55	66.66	OK
3681	2026-09-22 23:56	67.35	OK	3682	2026-09-22 23:57	67.71	OK
3683	2026-09-22 23:58	65.95	OK	3684	2026-09-22 23:59	66.58	OK
3685	2026-09-23 00:00	66.64	OK	3686	2026-09-23 00:01	67.60	OK
3687	2026-09-23 00:02	64.94	OK	3688	2026-09-23 00:03	67.78	OK
3689	2026-09-23 00:04	68.18	OK	3690	2026-09-23 00:05	66.17	OK
3691	2026-09-23 00:06	65.34	OK	3692	2026-09-23 00:07	67.20	OK
3693	2026-09-23 00:08	65.12	OK	3694	2026-09-23 00:09	66.23	OK
3695	2026-09-23 00:10	67.92	OK	3696	2026-09-23 00:11	67.37	OK
3697	2026-09-23 00:12	65.20	OK	3698	2026-09-23 00:13	65.88	OK
3699	2026-09-23 00:14	66.23	OK	3700	2026-09-23 00:15	64.57	OK
3701	2026-09-23 00:16	67.86	OK	3702	2026-09-23 00:17	65.51	OK
3703	2026-09-23 00:18	67.81	OK	3704	2026-09-23 00:19	66.24	OK
3705	2026-09-23 00:20	66.06	OK	3706	2026-09-23 00:21	66.93	OK
3707	2026-09-23 00:22	64.83	OK	3708	2026-09-23 00:23	67.11	OK
3709	2026-09-23 00:24	66.89	OK	3710	2026-09-23 00:25	64.19	OK
3711	2026-09-23 00:26	63.36	OK	3712	2026-09-23 00:27	66.95	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3713	2026-09-23 00:28	65.54	OK	3714	2026-09-23 00:29	67.69	OK
3715	2026-09-23 00:30	67.08	OK	3716	2026-09-23 00:31	64.91	OK
3717	2026-09-23 00:32	65.25	OK	3718	2026-09-23 00:33	65.33	OK
3719	2026-09-23 00:34	64.07	OK	3720	2026-09-23 00:35	66.87	OK
3721	2026-09-23 00:36	63.72	OK	3722	2026-09-23 00:37	65.93	OK
3723	2026-09-23 00:38	67.07	OK	3724	2026-09-23 00:39	67.66	OK
3725	2026-09-23 00:40	66.43	OK	3726	2026-09-23 00:41	66.77	OK
3727	2026-09-23 00:42	65.54	OK	3728	2026-09-23 00:43	63.50	OK
3729	2026-09-23 00:44	64.13	OK	3730	2026-09-23 00:45	65.40	OK
3731	2026-09-23 00:46	66.38	OK	3732	2026-09-23 00:47	64.92	OK
3733	2026-09-23 00:48	64.48	OK	3734	2026-09-23 00:49	66.10	OK
3735	2026-09-23 00:50	66.80	OK	3736	2026-09-23 00:51	65.79	OK
3737	2026-09-23 00:52	68.23	OK	3738	2026-09-23 00:53	66.04	OK
3739	2026-09-23 00:54	65.31	OK	3740	2026-09-23 00:55	65.55	OK
3741	2026-09-23 00:56	65.68	OK	3742	2026-09-23 00:57	65.30	OK
3743	2026-09-23 00:58	65.74	OK	3744	2026-09-23 00:59	67.71	OK
3745	2026-09-23 01:00	65.52	OK	3746	2026-09-23 01:01	65.88	OK
3747	2026-09-23 01:02	67.59	OK	3748	2026-09-23 01:03	65.21	OK
3749	2026-09-23 01:04	66.25	OK	3750	2026-09-23 01:05	65.18	OK
3751	2026-09-23 01:06	64.86	OK	3752	2026-09-23 01:07	67.33	OK
3753	2026-09-23 01:08	66.85	OK	3754	2026-09-23 01:09	66.09	OK
3755	2026-09-23 01:10	65.13	OK	3756	2026-09-23 01:11	66.57	OK
3757	2026-09-23 01:12	66.42	OK	3758	2026-09-23 01:13	67.09	OK
3759	2026-09-23 01:14	65.65	OK	3760	2026-09-23 01:15	67.02	OK
3761	2026-09-23 01:16	65.25	OK	3762	2026-09-23 01:17	64.83	OK
3763	2026-09-23 01:18	68.32	OK	3764	2026-09-23 01:19	66.39	OK
3765	2026-09-23 01:20	66.76	OK	3766	2026-09-23 01:21	65.36	OK
3767	2026-09-23 01:22	65.32	OK	3768	2026-09-23 01:23	66.60	OK
3769	2026-09-23 01:24	66.45	OK	3770	2026-09-23 01:25	65.66	OK
3771	2026-09-23 01:26	66.07	OK	3772	2026-09-23 01:27	67.15	OK
3773	2026-09-23 01:28	64.82	OK	3774	2026-09-23 01:29	65.37	OK
3775	2026-09-23 01:30	66.86	OK	3776	2026-09-23 01:31	67.52	OK
3777	2026-09-23 01:32	67.98	OK	3778	2026-09-23 01:33	66.89	OK
3779	2026-09-23 01:34	67.23	OK	3780	2026-09-23 01:35	66.42	OK
3781	2026-09-23 01:36	68.42	OK	3782	2026-09-23 01:37	65.66	OK
3783	2026-09-23 01:38	65.87	OK	3784	2026-09-23 01:39	66.63	OK
3785	2026-09-23 01:40	67.68	OK	3786	2026-09-23 01:41	64.74	OK
3787	2026-09-23 01:42	68.25	OK	3788	2026-09-23 01:43	66.21	OK
3789	2026-09-23 01:44	65.77	OK	3790	2026-09-23 01:45	66.64	OK
3791	2026-09-23 01:46	66.20	OK	3792	2026-09-23 01:47	65.23	OK
3793	2026-09-23 01:48	65.51	OK	3794	2026-09-23 01:49	65.64	OK
3795	2026-09-23 01:50	67.74	OK	3796	2026-09-23 01:51	67.11	OK
3797	2026-09-23 01:52	67.48	OK	3798	2026-09-23 01:53	67.13	OK
3799	2026-09-23 01:54	67.20	OK	3800	2026-09-23 01:55	68.08	OK
3801	2026-09-23 01:56	65.86	OK	3802	2026-09-23 01:57	63.66	OK
3803	2026-09-23 01:58	67.41	OK	3804	2026-09-23 01:59	64.90	OK
3805	2026-09-23 02:00	65.70	OK	3806	2026-09-23 02:01	67.54	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3807	2026-09-23 02:02	66.29	OK	3808	2026-09-23 02:03	67.02	OK
3809	2026-09-23 02:04	66.66	OK	3810	2026-09-23 02:05	65.56	OK
3811	2026-09-23 02:06	65.82	OK	3812	2026-09-23 02:07	67.24	OK
3813	2026-09-23 02:08	65.24	OK	3814	2026-09-23 02:09	66.34	OK
3815	2026-09-23 02:10	65.95	OK	3816	2026-09-23 02:11	65.72	OK
3817	2026-09-23 02:12	67.02	OK	3818	2026-09-23 02:13	66.77	OK
3819	2026-09-23 02:14	66.84	OK	3820	2026-09-23 02:15	66.66	OK
3821	2026-09-23 02:16	67.05	OK	3822	2026-09-23 02:17	65.98	OK
3823	2026-09-23 02:18	68.45	OK	3824	2026-09-23 02:19	66.33	OK
3825	2026-09-23 02:20	68.34	OK	3826	2026-09-23 02:21	65.75	OK
3827	2026-09-23 02:22	66.00	OK	3828	2026-09-23 02:23	65.85	OK
3829	2026-09-23 02:24	67.05	OK	3830	2026-09-23 02:25	65.35	OK
3831	2026-09-23 02:26	65.81	OK	3832	2026-09-23 02:27	66.18	OK
3833	2026-09-23 02:28	66.25	OK	3834	2026-09-23 02:29	66.96	OK
3835	2026-09-23 02:30	67.70	OK	3836	2026-09-23 02:31	67.08	OK
3837	2026-09-23 02:32	66.98	OK	3838	2026-09-23 02:33	66.65	OK
3839	2026-09-23 02:34	65.38	OK	3840	2026-09-23 02:35	66.02	OK
3841	2026-09-23 02:36	64.40	OK	3842	2026-09-23 02:37	67.56	OK
3843	2026-09-23 02:38	66.88	OK	3844	2026-09-23 02:39	64.78	OK
3845	2026-09-23 02:40	65.97	OK	3846	2026-09-23 02:41	67.53	OK
3847	2026-09-23 02:42	66.55	OK	3848	2026-09-23 02:43	68.64	OK
3849	2026-09-23 02:44	67.12	OK	3850	2026-09-23 02:45	66.57	OK
3851	2026-09-23 02:46	66.63	OK	3852	2026-09-23 02:47	67.89	OK
3853	2026-09-23 02:48	66.62	OK	3854	2026-09-23 02:49	67.22	OK
3855	2026-09-23 02:50	67.57	OK	3856	2026-09-23 02:51	68.48	OK
3857	2026-09-23 02:52	67.69	OK	3858	2026-09-23 02:53	67.49	OK
3859	2026-09-23 02:54	66.47	OK	3860	2026-09-23 02:55	67.26	OK
3861	2026-09-23 02:56	66.35	OK	3862	2026-09-23 02:57	67.68	OK
3863	2026-09-23 02:58	67.97	OK	3864	2026-09-23 02:59	69.26	OK
3865	2026-09-23 03:00	66.03	OK	3866	2026-09-23 03:01	66.86	OK
3867	2026-09-23 03:02	66.31	OK	3868	2026-09-23 03:03	67.82	OK
3869	2026-09-23 03:04	67.93	OK	3870	2026-09-23 03:05	67.99	OK
3871	2026-09-23 03:06	67.34	OK	3872	2026-09-23 03:07	67.94	OK
3873	2026-09-23 03:08	65.45	OK	3874	2026-09-23 03:09	66.65	OK
3875	2026-09-23 03:10	68.46	OK	3876	2026-09-23 03:11	67.47	OK
3877	2026-09-23 03:12	66.90	OK	3878	2026-09-23 03:13	67.55	OK
3879	2026-09-23 03:14	67.68	OK	3880	2026-09-23 03:15	67.43	OK
3881	2026-09-23 03:16	66.46	OK	3882	2026-09-23 03:17	66.66	OK
3883	2026-09-23 03:18	65.76	OK	3884	2026-09-23 03:19	68.83	OK
3885	2026-09-23 03:20	67.81	OK	3886	2026-09-23 03:21	68.00	OK
3887	2026-09-23 03:22	66.53	OK	3888	2026-09-23 03:23	69.13	OK
3889	2026-09-23 03:24	67.35	OK	3890	2026-09-23 03:25	67.60	OK
3891	2026-09-23 03:26	67.93	OK	3892	2026-09-23 03:27	68.10	OK
3893	2026-09-23 03:28	66.81	OK	3894	2026-09-23 03:29	66.55	OK
3895	2026-09-23 03:30	69.15	OK	3896	2026-09-23 03:31	67.29	OK
3897	2026-09-23 03:32	66.78	OK	3898	2026-09-23 03:33	67.28	OK
3899	2026-09-23 03:34	68.26	OK	3900	2026-09-23 03:35	66.43	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3901	2026-09-23 03:36	67.08	OK	3902	2026-09-23 03:37	66.91	OK
3903	2026-09-23 03:38	67.99	OK	3904	2026-09-23 03:39	67.65	OK
3905	2026-09-23 03:40	66.59	OK	3906	2026-09-23 03:41	68.06	OK
3907	2026-09-23 03:42	67.21	OK	3908	2026-09-23 03:43	66.88	OK
3909	2026-09-23 03:44	68.66	OK	3910	2026-09-23 03:45	68.03	OK
3911	2026-09-23 03:46	68.31	OK	3912	2026-09-23 03:47	68.38	OK
3913	2026-09-23 03:48	67.43	OK	3914	2026-09-23 03:49	66.23	OK
3915	2026-09-23 03:50	67.41	OK	3916	2026-09-23 03:51	67.47	OK
3917	2026-09-23 03:52	67.06	OK	3918	2026-09-23 03:53	67.36	OK
3919	2026-09-23 03:54	68.01	OK	3920	2026-09-23 03:55	69.10	OK
3921	2026-09-23 03:56	69.08	OK	3922	2026-09-23 03:57	68.89	OK
3923	2026-09-23 03:58	65.91	OK	3924	2026-09-23 03:59	66.72	OK
3925	2026-09-23 04:00	68.26	OK	3926	2026-09-23 04:01	67.41	OK
3927	2026-09-23 04:02	67.89	OK	3928	2026-09-23 04:03	69.25	OK
3929	2026-09-23 04:04	66.03	OK	3930	2026-09-23 04:05	67.53	OK
3931	2026-09-23 04:06	68.73	OK	3932	2026-09-23 04:07	67.72	OK
3933	2026-09-23 04:08	68.49	OK	3934	2026-09-23 04:09	67.10	OK
3935	2026-09-23 04:10	68.30	OK	3936	2026-09-23 04:11	70.47	OK
3937	2026-09-23 04:12	68.97	OK	3938	2026-09-23 04:13	69.01	OK
3939	2026-09-23 04:14	68.05	OK	3940	2026-09-23 04:15	67.42	OK
3941	2026-09-23 04:16	67.77	OK	3942	2026-09-23 04:17	67.42	OK
3943	2026-09-23 04:18	67.30	OK	3944	2026-09-23 04:19	68.05	OK
3945	2026-09-23 04:20	67.03	OK	3946	2026-09-23 04:21	69.93	OK
3947	2026-09-23 04:22	70.92	OK	3948	2026-09-23 04:23	68.98	OK
3949	2026-09-23 04:24	69.13	OK	3950	2026-09-23 04:25	69.83	OK
3951	2026-09-23 04:26	68.56	OK	3952	2026-09-23 04:27	67.56	OK
3953	2026-09-23 04:28	68.79	OK	3954	2026-09-23 04:29	69.68	OK
3955	2026-09-23 04:30	68.88	OK	3956	2026-09-23 04:31	69.23	OK
3957	2026-09-23 04:32	68.27	OK	3958	2026-09-23 04:33	66.31	OK
3959	2026-09-23 04:34	67.85	OK	3960	2026-09-23 04:35	69.44	OK
3961	2026-09-23 04:36	68.66	OK	3962	2026-09-23 04:37	69.59	OK
3963	2026-09-23 04:38	66.69	OK	3964	2026-09-23 04:39	69.39	OK
3965	2026-09-23 04:40	67.99	OK	3966	2026-09-23 04:41	67.12	OK
3967	2026-09-23 04:42	68.21	OK	3968	2026-09-23 04:43	69.02	OK
3969	2026-09-23 04:44	68.96	OK	3970	2026-09-23 04:45	68.85	OK
3971	2026-09-23 04:46	69.13	OK	3972	2026-09-23 04:47	69.74	OK
3973	2026-09-23 04:48	68.06	OK	3974	2026-09-23 04:49	68.60	OK
3975	2026-09-23 04:50	70.05	OK	3976	2026-09-23 04:51	70.66	OK
3977	2026-09-23 04:52	69.16	OK	3978	2026-09-23 04:53	69.73	OK
3979	2026-09-23 04:54	70.23	OK	3980	2026-09-23 04:55	70.92	OK
3981	2026-09-23 04:56	69.96	OK	3982	2026-09-23 04:57	70.82	OK
3983	2026-09-23 04:58	70.67	OK	3984	2026-09-23 04:59	68.40	OK
3985	2026-09-23 05:00	69.42	OK	3986	2026-09-23 05:01	69.64	OK
3987	2026-09-23 05:02	70.02	OK	3988	2026-09-23 05:03	70.20	OK
3989	2026-09-23 05:04	69.47	OK	3990	2026-09-23 05:05	71.19	OK
3991	2026-09-23 05:06	70.69	OK	3992	2026-09-23 05:07	69.71	OK
3993	2026-09-23 05:08	69.46	OK	3994	2026-09-23 05:09	69.00	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3995	2026-09-23 05:10	68.90	OK	3996	2026-09-23 05:11	68.22	OK
3997	2026-09-23 05:12	69.70	OK	3998	2026-09-23 05:13	69.17	OK
3999	2026-09-23 05:14	68.95	OK	4000	2026-09-23 05:15	68.03	OK
4001	2026-09-23 05:16	71.37	OK	4002	2026-09-23 05:17	69.47	OK
4003	2026-09-23 05:18	69.95	OK	4004	2026-09-23 05:19	71.11	OK
4005	2026-09-23 05:20	72.43	OK	4006	2026-09-23 05:21	71.13	OK
4007	2026-09-23 05:22	71.08	OK	4008	2026-09-23 05:23	70.34	OK
4009	2026-09-23 05:24	69.53	OK	4010	2026-09-23 05:25	67.36	OK
4011	2026-09-23 05:26	69.78	OK	4012	2026-09-23 05:27	71.08	OK
4013	2026-09-23 05:28	70.67	OK	4014	2026-09-23 05:29	70.83	OK
4015	2026-09-23 05:30	72.23	OK	4016	2026-09-23 05:31	70.55	OK
4017	2026-09-23 05:32	71.09	OK	4018	2026-09-23 05:33	71.95	OK
4019	2026-09-23 05:34	69.60	OK	4020	2026-09-23 05:35	69.59	OK
4021	2026-09-23 05:36	69.75	OK	4022	2026-09-23 05:37	69.63	OK
4023	2026-09-23 05:38	70.09	OK	4024	2026-09-23 05:39	71.24	OK
4025	2026-09-23 05:40	69.80	OK	4026	2026-09-23 05:41	68.59	OK
4027	2026-09-23 05:42	70.89	OK	4028	2026-09-23 05:43	70.55	OK
4029	2026-09-23 05:44	71.40	OK	4030	2026-09-23 05:45	72.64	OK
4031	2026-09-23 05:46	68.62	OK	4032	2026-09-23 05:47	70.55	OK
4033	2026-09-23 05:48	72.35	OK	4034	2026-09-23 05:49	70.04	OK
4035	2026-09-23 05:50	71.34	OK	4036	2026-09-23 05:51	71.68	OK
4037	2026-09-23 05:52	70.44	OK	4038	2026-09-23 05:53	70.11	OK
4039	2026-09-23 05:54	71.56	OK	4040	2026-09-23 05:55	68.66	OK
4041	2026-09-23 05:56	70.34	OK	4042	2026-09-23 05:57	70.18	OK
4043	2026-09-23 05:58	71.33	OK	4044	2026-09-23 05:59	71.08	OK
4045	2026-09-23 06:00	70.76	OK	4046	2026-09-23 06:01	70.86	OK
4047	2026-09-23 06:02	70.23	OK	4048	2026-09-23 06:03	71.16	OK
4049	2026-09-23 06:04	71.06	OK	4050	2026-09-23 06:05	69.58	OK
4051	2026-09-23 06:06	71.92	OK	4052	2026-09-23 06:07	70.97	OK
4053	2026-09-23 06:08	70.06	OK	4054	2026-09-23 06:09	69.64	OK
4055	2026-09-23 06:10	71.14	OK	4056	2026-09-23 06:11	70.56	OK
4057	2026-09-23 06:12	71.69	OK	4058	2026-09-23 06:13	70.46	OK
4059	2026-09-23 06:14	70.00	OK	4060	2026-09-23 06:15	71.84	OK
4061	2026-09-23 06:16	69.47	OK	4062	2026-09-23 06:17	73.21	OK
4063	2026-09-23 06:18	70.87	OK	4064	2026-09-23 06:19	73.05	OK
4065	2026-09-23 06:20	72.42	OK	4066	2026-09-23 06:21	70.30	OK
4067	2026-09-23 06:22	71.45	OK	4068	2026-09-23 06:23	72.76	OK
4069	2026-09-23 06:24	73.74	OK	4070	2026-09-23 06:25	69.46	OK
4071	2026-09-23 06:26	72.19	OK	4072	2026-09-23 06:27	71.90	OK
4073	2026-09-23 06:28	72.20	OK	4074	2026-09-23 06:29	73.34	OK
4075	2026-09-23 06:30	70.20	OK	4076	2026-09-23 06:31	72.85	OK
4077	2026-09-23 06:32	71.23	OK	4078	2026-09-23 06:33	73.96	OK
4079	2026-09-23 06:34	71.48	OK	4080	2026-09-23 06:35	71.05	OK
4081	2026-09-23 06:36	73.82	OK	4082	2026-09-23 06:37	70.34	OK
4083	2026-09-23 06:38	71.42	OK	4084	2026-09-23 06:39	71.07	OK
4085	2026-09-23 06:40	73.39	OK	4086	2026-09-23 06:41	70.54	OK
4087	2026-09-23 06:42	72.20	OK	4088	2026-09-23 06:43	72.84	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4089	2026-09-23 06:44	73.53	OK	4090	2026-09-23 06:45	72.26	OK
4091	2026-09-23 06:46	71.89	OK	4092	2026-09-23 06:47	72.11	OK
4093	2026-09-23 06:48	73.55	OK	4094	2026-09-23 06:49	71.31	OK
4095	2026-09-23 06:50	73.49	OK	4096	2026-09-23 06:51	73.34	OK
4097	2026-09-23 06:52	72.06	OK	4098	2026-09-23 06:53	73.94	OK
4099	2026-09-23 06:54	71.03	OK	4100	2026-09-23 06:55	71.18	OK
4101	2026-09-23 06:56	71.89	OK	4102	2026-09-23 06:57	73.85	OK
4103	2026-09-23 06:58	72.85	OK	4104	2026-09-23 06:59	74.08	OK
4105	2026-09-23 07:00	71.97	OK	4106	2026-09-23 07:01	71.51	OK
4107	2026-09-23 07:02	73.48	OK	4108	2026-09-23 07:03	71.69	OK
4109	2026-09-23 07:04	73.85	OK	4110	2026-09-23 07:05	73.75	OK
4111	2026-09-23 07:06	74.03	OK	4112	2026-09-23 07:07	74.44	OK
4113	2026-09-23 07:08	73.69	OK	4114	2026-09-23 07:09	73.92	OK
4115	2026-09-23 07:10	74.18	OK	4116	2026-09-23 07:11	72.17	OK
4117	2026-09-23 07:12	73.80	OK	4118	2026-09-23 07:13	72.26	OK
4119	2026-09-23 07:14	73.37	OK	4120	2026-09-23 07:15	71.24	OK
4121	2026-09-23 07:16	75.39	OK	4122	2026-09-23 07:17	74.48	OK
4123	2026-09-23 07:18	71.61	OK	4124	2026-09-23 07:19	75.11	OK
4125	2026-09-23 07:20	71.25	OK	4126	2026-09-23 07:21	73.54	OK
4127	2026-09-23 07:22	73.01	OK	4128	2026-09-23 07:23	73.99	OK
4129	2026-09-23 07:24	73.15	OK	4130	2026-09-23 07:25	74.09	OK
4131	2026-09-23 07:26	74.62	OK	4132	2026-09-23 07:27	73.51	OK
4133	2026-09-23 07:28	74.28	OK	4134	2026-09-23 07:29	74.17	OK
4135	2026-09-23 07:30	74.81	OK	4136	2026-09-23 07:31	72.53	OK
4137	2026-09-23 07:32	74.25	OK	4138	2026-09-23 07:33	72.06	OK
4139	2026-09-23 07:34	73.53	OK	4140	2026-09-23 07:35	74.42	OK
4141	2026-09-23 07:36	72.71	OK	4142	2026-09-23 07:37	74.25	OK
4143	2026-09-23 07:38	73.56	OK	4144	2026-09-23 07:39	73.68	OK
4145	2026-09-23 07:40	74.05	OK	4146	2026-09-23 07:41	74.54	OK
4147	2026-09-23 07:42	73.87	OK	4148	2026-09-23 07:43	72.31	OK
4149	2026-09-23 07:44	73.22	OK	4150	2026-09-23 07:45	72.85	OK
4151	2026-09-23 07:46	72.60	OK	4152	2026-09-23 07:47	72.98	OK
4153	2026-09-23 07:48	75.66	OK	4154	2026-09-23 07:49	71.71	OK
4155	2026-09-23 07:50	72.50	OK	4156	2026-09-23 07:51	74.39	OK
4157	2026-09-23 07:52	75.84	OK	4158	2026-09-23 07:53	72.35	OK
4159	2026-09-23 07:54	72.12	OK	4160	2026-09-23 07:55	75.01	OK
4161	2026-09-23 07:56	76.05	OK	4162	2026-09-23 07:57	73.44	OK
4163	2026-09-23 07:58	75.17	OK	4164	2026-09-23 07:59	73.23	OK
4165	2026-09-23 08:00	76.21	OK	4166	2026-09-23 08:01	76.02	OK
4167	2026-09-23 08:02	77.06	OK	4168	2026-09-23 08:03	73.67	OK
4169	2026-09-23 08:04	73.42	OK	4170	2026-09-23 08:05	75.49	OK
4171	2026-09-23 08:06	72.31	OK	4172	2026-09-23 08:07	73.29	OK
4173	2026-09-23 08:08	74.93	OK	4174	2026-09-23 08:09	74.39	OK
4175	2026-09-23 08:10	76.01	OK	4176	2026-09-23 08:11	75.14	OK
4177	2026-09-23 08:12	75.03	OK	4178	2026-09-23 08:13	73.53	OK
4179	2026-09-23 08:14	73.76	OK	4180	2026-09-23 08:15	74.36	OK
4181	2026-09-23 08:16	75.86	OK	4182	2026-09-23 08:17	73.41	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4183	2026-09-23 08:18	75.16	OK	4184	2026-09-23 08:19	76.36	OK
4185	2026-09-23 08:20	76.53	OK	4186	2026-09-23 08:21	76.29	OK
4187	2026-09-23 08:22	73.59	OK	4188	2026-09-23 08:23	75.21	OK
4189	2026-09-23 08:24	76.30	OK	4190	2026-09-23 08:25	75.91	OK
4191	2026-09-23 08:26	73.90	OK	4192	2026-09-23 08:27	75.87	OK
4193	2026-09-23 08:28	75.04	OK	4194	2026-09-23 08:29	75.20	OK
4195	2026-09-23 08:30	76.20	OK	4196	2026-09-23 08:31	73.90	OK
4197	2026-09-23 08:32	74.95	OK	4198	2026-09-23 08:33	78.06	OK
4199	2026-09-23 08:34	75.39	OK	4200	2026-09-23 08:35	76.33	OK
4201	2026-09-23 08:36	74.66	OK	4202	2026-09-23 08:37	75.97	OK
4203	2026-09-23 08:38	76.78	OK	4204	2026-09-23 08:39	74.26	OK
4205	2026-09-23 08:40	76.04	OK	4206	2026-09-23 08:41	76.32	OK
4207	2026-09-23 08:42	75.10	OK	4208	2026-09-23 08:43	76.09	OK
4209	2026-09-23 08:44	74.98	OK	4210	2026-09-23 08:45	74.25	OK
4211	2026-09-23 08:46	75.12	OK	4212	2026-09-23 08:47	74.79	OK
4213	2026-09-23 08:48	75.33	OK	4214	2026-09-23 08:49	75.72	OK
4215	2026-09-23 08:50	77.63	OK	4216	2026-09-23 08:51	77.68	OK
4217	2026-09-23 08:52	74.38	OK	4218	2026-09-23 08:53	75.62	OK
4219	2026-09-23 08:54	77.45	OK	4220	2026-09-23 08:55	74.89	OK
4221	2026-09-23 08:56	76.20	OK	4222	2026-09-23 08:57	74.85	OK
4223	2026-09-23 08:58	73.90	OK	4224	2026-09-23 08:59	74.99	OK
4225	2026-09-23 09:00	77.67	OK	4226	2026-09-23 09:01	76.64	OK
4227	2026-09-23 09:02	76.41	OK	4228	2026-09-23 09:03	74.21	OK
4229	2026-09-23 09:04	76.81	OK	4230	2026-09-23 09:05	76.68	OK
4231	2026-09-23 09:06	73.96	OK	4232	2026-09-23 09:07	76.00	OK
4233	2026-09-23 09:08	76.44	OK	4234	2026-09-23 09:09	75.81	OK
4235	2026-09-23 09:10	74.76	OK	4236	2026-09-23 09:11	75.33	OK
4237	2026-09-23 09:12	76.17	OK	4238	2026-09-23 09:13	77.38	OK
4239	2026-09-23 09:14	74.79	OK	4240	2026-09-23 09:15	75.64	OK
4241	2026-09-23 09:16	76.57	OK	4242	2026-09-23 09:17	76.04	OK
4243	2026-09-23 09:18	75.04	OK	4244	2026-09-23 09:19	77.54	OK
4245	2026-09-23 09:20	76.50	OK	4246	2026-09-23 09:21	76.62	OK
4247	2026-09-23 09:22	76.56	OK	4248	2026-09-23 09:23	76.52	OK
4249	2026-09-23 09:24	76.29	OK	4250	2026-09-23 09:25	75.74	OK
4251	2026-09-23 09:26	77.11	OK	4252	2026-09-23 09:27	75.81	OK
4253	2026-09-23 09:28	74.64	OK	4254	2026-09-23 09:29	76.04	OK
4255	2026-09-23 09:30	76.97	OK	4256	2026-09-23 09:31	75.11	OK
4257	2026-09-23 09:32	75.89	OK	4258	2026-09-23 09:33	78.15	OK
4259	2026-09-23 09:34	77.30	OK	4260	2026-09-23 09:35	75.85	OK
4261	2026-09-23 09:36	75.89	OK	4262	2026-09-23 09:37	75.11	OK
4263	2026-09-23 09:38	75.75	OK	4264	2026-09-23 09:39	77.81	OK
4265	2026-09-23 09:40	75.57	OK	4266	2026-09-23 09:41	76.32	OK
4267	2026-09-23 09:42	75.25	OK	4268	2026-09-23 09:43	79.08	OK
4269	2026-09-23 09:44	75.96	OK	4270	2026-09-23 09:45	74.93	OK
4271	2026-09-23 09:46	75.81	OK	4272	2026-09-23 09:47	76.66	OK
4273	2026-09-23 09:48	76.35	OK	4274	2026-09-23 09:49	76.93	OK
4275	2026-09-23 09:50	78.05	OK	4276	2026-09-23 09:51	78.57	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4277	2026-09-23 09:52	76.32	OK	4278	2026-09-23 09:53	77.74	OK
4279	2026-09-23 09:54	75.92	OK	4280	2026-09-23 09:55	75.81	OK
4281	2026-09-23 09:56	75.70	OK	4282	2026-09-23 09:57	76.77	OK
4283	2026-09-23 09:58	76.30	OK	4284	2026-09-23 09:59	77.19	OK
4285	2026-09-23 10:00	77.11	OK	4286	2026-09-23 10:01	74.40	OK
4287	2026-09-23 10:02	77.83	OK	4288	2026-09-23 10:03	77.46	OK
4289	2026-09-23 10:04	77.20	OK	4290	2026-09-23 10:05	77.25	OK
4291	2026-09-23 10:06	78.06	OK	4292	2026-09-23 10:07	78.53	OK
4293	2026-09-23 10:08	79.85	OK	4294	2026-09-23 10:09	76.09	OK
4295	2026-09-23 10:10	76.56	OK	4296	2026-09-23 10:11	76.17	OK
4297	2026-09-23 10:12	74.97	OK	4298	2026-09-23 10:13	76.24	OK
4299	2026-09-23 10:14	76.98	OK	4300	2026-09-23 10:15	77.49	OK
4301	2026-09-23 10:16	76.71	OK	4302	2026-09-23 10:17	77.00	OK
4303	2026-09-23 10:18	77.61	OK	4304	2026-09-23 10:19	76.36	OK
4305	2026-09-23 10:20	78.02	OK	4306	2026-09-23 10:21	76.46	OK
4307	2026-09-23 10:22	78.16	OK	4308	2026-09-23 10:23	77.01	OK
4309	2026-09-23 10:24	74.71	OK	4310	2026-09-23 10:25	77.02	OK
4311	2026-09-23 10:26	75.53	OK	4312	2026-09-23 10:27	79.38	OK
4313	2026-09-23 10:28	78.68	OK	4314	2026-09-23 10:29	76.66	OK
4315	2026-09-23 10:30	76.22	OK	4316	2026-09-23 10:31	74.89	OK
4317	2026-09-23 10:32	77.69	OK	4318	2026-09-23 10:33	77.89	OK
4319	2026-09-23 10:34	78.30	OK	4320	2026-09-23 10:35	77.72	OK
4321	2026-09-23 10:36	77.68	OK	4322	2026-09-23 10:37	78.05	OK
4323	2026-09-23 10:38	78.23	OK	4324	2026-09-23 10:39	78.94	OK
4325	2026-09-23 10:40	78.31	OK	4326	2026-09-23 10:41	78.83	OK
4327	2026-09-23 10:42	78.30	OK	4328	2026-09-23 10:43	78.14	OK
4329	2026-09-23 10:44	75.96	OK	4330	2026-09-23 10:45	78.40	OK
4331	2026-09-23 10:46	77.35	OK	4332	2026-09-23 10:47	76.01	OK
4333	2026-09-23 10:48	76.83	OK	4334	2026-09-23 10:49	78.17	OK
4335	2026-09-23 10:50	76.80	OK	4336	2026-09-23 10:51	76.78	OK
4337	2026-09-23 10:52	76.49	OK	4338	2026-09-23 10:53	77.79	OK
4339	2026-09-23 10:54	78.71	OK	4340	2026-09-23 10:55	76.71	OK
4341	2026-09-23 10:56	80.39	OK	4342	2026-09-23 10:57	79.95	OK
4343	2026-09-23 10:58	77.05	OK	4344	2026-09-23 10:59	78.37	OK
4345	2026-09-23 11:00	78.09	OK	4346	2026-09-23 11:01	78.56	OK
4347	2026-09-23 11:02	78.53	OK	4348	2026-09-23 11:03	78.47	OK
4349	2026-09-23 11:04	78.17	OK	4350	2026-09-23 11:05	78.26	OK
4351	2026-09-23 11:06	79.31	OK	4352	2026-09-23 11:07	76.76	OK
4353	2026-09-23 11:08	78.35	OK	4354	2026-09-23 11:09	78.27	OK
4355	2026-09-23 11:10	77.99	OK	4356	2026-09-23 11:11	77.46	OK
4357	2026-09-23 11:12	77.45	OK	4358	2026-09-23 11:13	77.72	OK
4359	2026-09-23 11:14	78.15	OK	4360	2026-09-23 11:15	80.08	OK
4361	2026-09-23 11:16	77.27	OK	4362	2026-09-23 11:17	78.48	OK
4363	2026-09-23 11:18	80.74	OK	4364	2026-09-23 11:19	78.25	OK
4365	2026-09-23 11:20	76.93	OK	4366	2026-09-23 11:21	77.50	OK
4367	2026-09-23 11:22	79.85	OK	4368	2026-09-23 11:23	78.38	OK
4369	2026-09-23 11:24	76.72	OK	4370	2026-09-23 11:25	77.13	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4371	2026-09-23 11:26	77.82	OK	4372	2026-09-23 11:27	77.68	OK
4373	2026-09-23 11:28	78.57	OK	4374	2026-09-23 11:29	78.63	OK
4375	2026-09-23 11:30	77.99	OK	4376	2026-09-23 11:31	77.03	OK
4377	2026-09-23 11:32	79.62	OK	4378	2026-09-23 11:33	77.98	OK
4379	2026-09-23 11:34	78.35	OK	4380	2026-09-23 11:35	76.58	OK
4381	2026-09-23 11:36	78.87	OK	4382	2026-09-23 11:37	77.45	OK
4383	2026-09-23 11:38	77.97	OK	4384	2026-09-23 11:39	79.41	OK
4385	2026-09-23 11:40	78.15	OK	4386	2026-09-23 11:41	79.54	OK
4387	2026-09-23 11:42	78.65	OK	4388	2026-09-23 11:43	77.82	OK
4389	2026-09-23 11:44	79.66	OK	4390	2026-09-23 11:45	79.41	OK
4391	2026-09-23 11:46	79.36	OK	4392	2026-09-23 11:47	76.77	OK
4393	2026-09-23 11:48	78.41	OK	4394	2026-09-23 11:49	78.24	OK
4395	2026-09-23 11:50	76.70	OK	4396	2026-09-23 11:51	76.38	OK
4397	2026-09-23 11:52	78.43	OK	4398	2026-09-23 11:53	77.96	OK
4399	2026-09-23 11:54	79.48	OK	4400	2026-09-23 11:55	77.34	OK
4401	2026-09-23 11:56	78.18	OK	4402	2026-09-23 11:57	79.28	OK
4403	2026-09-23 11:58	78.14	OK	4404	2026-09-23 11:59	77.98	OK
4405	2026-09-23 12:00	78.20	OK	4406	2026-09-23 12:01	79.78	OK
4407	2026-09-23 12:02	78.55	OK	4408	2026-09-23 12:03	78.69	OK
4409	2026-09-23 12:04	77.99	OK	4410	2026-09-23 12:05	77.90	OK
4411	2026-09-23 12:06	79.50	OK	4412	2026-09-23 12:07	79.32	OK
4413	2026-09-23 12:08	79.26	OK	4414	2026-09-23 12:09	78.34	OK
4415	2026-09-23 12:10	79.04	OK	4416	2026-09-23 12:11	79.80	OK
4417	2026-09-23 12:12	78.75	OK	4418	2026-09-23 12:13	78.83	OK
4419	2026-09-23 12:14	80.81	OK	4420	2026-09-23 12:15	80.02	OK
4421	2026-09-23 12:16	77.74	OK	4422	2026-09-23 12:17	80.15	OK
4423	2026-09-23 12:18	78.15	OK	4424	2026-09-23 12:19	79.24	OK
4425	2026-09-23 12:20	77.35	OK	4426	2026-09-23 12:21	77.97	OK
4427	2026-09-23 12:22	80.74	OK	4428	2026-09-23 12:23	77.39	OK
4429	2026-09-23 12:24	78.49	OK	4430	2026-09-23 12:25	79.29	OK
4431	2026-09-23 12:26	79.33	OK	4432	2026-09-23 12:27	79.11	OK
4433	2026-09-23 12:28	77.69	OK	4434	2026-09-23 12:29	77.51	OK
4435	2026-09-23 12:30	77.38	OK	4436	2026-09-23 12:31	78.21	OK
4437	2026-09-23 12:32	80.45	OK	4438	2026-09-23 12:33	78.90	OK
4439	2026-09-23 12:34	76.87	OK	4440	2026-09-23 12:35	78.71	OK
4441	2026-09-23 12:36	79.87	OK	4442	2026-09-23 12:37	80.00	OK
4443	2026-09-23 12:38	80.19	OK	4444	2026-09-23 12:39	80.01	OK
4445	2026-09-23 12:40	79.56	OK	4446	2026-09-23 12:41	76.89	OK
4447	2026-09-23 12:42	80.95	OK	4448	2026-09-23 12:43	79.25	OK
4449	2026-09-23 12:44	78.84	OK	4450	2026-09-23 12:45	77.32	OK
4451	2026-09-23 12:46	76.83	OK	4452	2026-09-23 12:47	79.18	OK
4453	2026-09-23 12:48	79.28	OK	4454	2026-09-23 12:49	78.57	OK
4455	2026-09-23 12:50	80.93	OK	4456	2026-09-23 12:51	78.24	OK
4457	2026-09-23 12:52	78.14	OK	4458	2026-09-23 12:53	78.51	OK
4459	2026-09-23 12:54	77.78	OK	4460	2026-09-23 12:55	77.49	OK
4461	2026-09-23 12:56	78.01	OK	4462	2026-09-23 12:57	78.14	OK
4463	2026-09-23 12:58	78.55	OK	4464	2026-09-23 12:59	76.54	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4465	2026-09-23 13:00	77.87	OK	4466	2026-09-23 13:01	77.74	OK
4467	2026-09-23 13:02	77.77	OK	4468	2026-09-23 13:03	79.36	OK
4469	2026-09-23 13:04	77.38	OK	4470	2026-09-23 13:05	79.86	OK
4471	2026-09-23 13:06	78.82	OK	4472	2026-09-23 13:07	80.79	OK
4473	2026-09-23 13:08	79.08	OK	4474	2026-09-23 13:09	80.52	OK
4475	2026-09-23 13:10	79.19	OK	4476	2026-09-23 13:11	79.80	OK
4477	2026-09-23 13:12	79.73	OK	4478	2026-09-23 13:13	78.89	OK
4479	2026-09-23 13:14	76.59	OK	4480	2026-09-23 13:15	78.13	OK
4481	2026-09-23 13:16	77.34	OK	4482	2026-09-23 13:17	79.03	OK
4483	2026-09-23 13:18	78.07	OK	4484	2026-09-23 13:19	77.01	OK
4485	2026-09-23 13:20	79.17	OK	4486	2026-09-23 13:21	78.96	OK
4487	2026-09-23 13:22	76.44	OK	4488	2026-09-23 13:23	79.38	OK
4489	2026-09-23 13:24	78.31	OK	4490	2026-09-23 13:25	77.11	OK
4491	2026-09-23 13:26	78.48	OK	4492	2026-09-23 13:27	77.42	OK
4493	2026-09-23 13:28	76.24	OK	4494	2026-09-23 13:29	79.77	OK
4495	2026-09-23 13:30	76.68	OK	4496	2026-09-23 13:31	77.86	OK
4497	2026-09-23 13:32	80.15	OK	4498	2026-09-23 13:33	78.37	OK
4499	2026-09-23 13:34	79.65	OK	4500	2026-09-23 13:35	78.00	OK
4501	2026-09-23 13:36	78.72	OK	4502	2026-09-23 13:37	78.24	OK
4503	2026-09-23 13:38	77.49	OK	4504	2026-09-23 13:39	77.98	OK
4505	2026-09-23 13:40	80.11	OK	4506	2026-09-23 13:41	78.29	OK
4507	2026-09-23 13:42	78.28	OK	4508	2026-09-23 13:43	78.18	OK
4509	2026-09-23 13:44	78.10	OK	4510	2026-09-23 13:45	77.54	OK
4511	2026-09-23 13:46	77.06	OK	4512	2026-09-23 13:47	76.53	OK
4513	2026-09-23 13:48	78.14	OK	4514	2026-09-23 13:49	78.10	OK
4515	2026-09-23 13:50	79.04	OK	4516	2026-09-23 13:51	79.07	OK
4517	2026-09-23 13:52	79.22	OK	4518	2026-09-23 13:53	78.99	OK
4519	2026-09-23 13:54	77.60	OK	4520	2026-09-23 13:55	78.12	OK
4521	2026-09-23 13:56	78.00	OK	4522	2026-09-23 13:57	79.83	OK
4523	2026-09-23 13:58	78.03	OK	4524	2026-09-23 13:59	77.69	OK
4525	2026-09-23 14:00	78.91	OK	4526	2026-09-23 14:01	78.54	OK
4527	2026-09-23 14:02	78.81	OK	4528	2026-09-23 14:03	78.51	OK
4529	2026-09-23 14:04	77.63	OK	4530	2026-09-23 14:05	78.17	OK
4531	2026-09-23 14:06	79.02	OK	4532	2026-09-23 14:07	78.64	OK
4533	2026-09-23 14:08	77.46	OK	4534	2026-09-23 14:09	77.53	OK
4535	2026-09-23 14:10	77.73	OK	4536	2026-09-23 14:11	78.34	OK
4537	2026-09-23 14:12	78.51	OK	4538	2026-09-23 14:13	79.64	OK
4539	2026-09-23 14:14	77.53	OK	4540	2026-09-23 14:15	79.52	OK
4541	2026-09-23 14:16	77.61	OK	4542	2026-09-23 14:17	78.35	OK
4543	2026-09-23 14:18	79.33	OK	4544	2026-09-23 14:19	77.90	OK
4545	2026-09-23 14:20	78.51	OK	4546	2026-09-23 14:21	79.08	OK
4547	2026-09-23 14:22	77.32	OK	4548	2026-09-23 14:23	77.67	OK
4549	2026-09-23 14:24	77.64	OK	4550	2026-09-23 14:25	78.73	OK
4551	2026-09-23 14:26	76.94	OK	4552	2026-09-23 14:27	77.95	OK
4553	2026-09-23 14:28	80.33	OK	4554	2026-09-23 14:29	78.60	OK
4555	2026-09-23 14:30	80.08	OK	4556	2026-09-23 14:31	77.18	OK
4557	2026-09-23 14:32	78.75	OK	4558	2026-09-23 14:33	78.29	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4559	2026-09-23 14:34	77.95	OK	4560	2026-09-23 14:35	77.42	OK
4561	2026-09-23 14:36	77.94	OK	4562	2026-09-23 14:37	76.69	OK
4563	2026-09-23 14:38	79.87	OK	4564	2026-09-23 14:39	76.84	OK
4565	2026-09-23 14:40	79.79	OK	4566	2026-09-23 14:41	78.03	OK
4567	2026-09-23 14:42	80.15	OK	4568	2026-09-23 14:43	78.37	OK
4569	2026-09-23 14:44	78.54	OK	4570	2026-09-23 14:45	77.08	OK
4571	2026-09-23 14:46	78.41	OK	4572	2026-09-23 14:47	78.13	OK
4573	2026-09-23 14:48	77.03	OK	4574	2026-09-23 14:49	78.28	OK
4575	2026-09-23 14:50	79.42	OK	4576	2026-09-23 14:51	76.50	OK
4577	2026-09-23 14:52	77.07	OK	4578	2026-09-23 14:53	78.34	OK
4579	2026-09-23 14:54	77.55	OK	4580	2026-09-23 14:55	78.29	OK
4581	2026-09-23 14:56	78.46	OK	4582	2026-09-23 14:57	76.98	OK
4583	2026-09-23 14:58	77.53	OK	4584	2026-09-23 14:59	76.73	OK
4585	2026-09-23 15:00	77.09	OK	4586	2026-09-23 15:01	77.19	OK
4587	2026-09-23 15:02	78.15	OK	4588	2026-09-23 15:03	78.92	OK
4589	2026-09-23 15:04	77.58	OK	4590	2026-09-23 15:05	78.36	OK
4591	2026-09-23 15:06	76.34	OK	4592	2026-09-23 15:07	75.95	OK
4593	2026-09-23 15:08	76.82	OK	4594	2026-09-23 15:09	76.19	OK
4595	2026-09-23 15:10	77.66	OK	4596	2026-09-23 15:11	80.26	OK
4597	2026-09-23 15:12	76.92	OK	4598	2026-09-23 15:13	77.47	OK
4599	2026-09-23 15:14	76.02	OK	4600	2026-09-23 15:15	78.93	OK
4601	2026-09-23 15:16	78.14	OK	4602	2026-09-23 15:17	75.65	OK
4603	2026-09-23 15:18	76.99	OK	4604	2026-09-23 15:19	78.04	OK
4605	2026-09-23 15:20	78.33	OK	4606	2026-09-23 15:21	77.57	OK
4607	2026-09-23 15:22	77.39	OK	4608	2026-09-23 15:23	77.12	OK
4609	2026-09-23 15:24	78.85	OK	4610	2026-09-23 15:25	76.99	OK
4611	2026-09-23 15:26	77.26	OK	4612	2026-09-23 15:27	77.56	OK
4613	2026-09-23 15:28	75.55	OK	4614	2026-09-23 15:29	76.47	OK
4615	2026-09-23 15:30	77.51	OK	4616	2026-09-23 15:31	75.86	OK
4617	2026-09-23 15:32	79.29	OK	4618	2026-09-23 15:33	77.14	OK
4619	2026-09-23 15:34	77.19	OK	4620	2026-09-23 15:35	78.51	OK
4621	2026-09-23 15:36	78.30	OK	4622	2026-09-23 15:37	75.97	OK
4623	2026-09-23 15:38	78.27	OK	4624	2026-09-23 15:39	76.86	OK
4625	2026-09-23 15:40	76.72	OK	4626	2026-09-23 15:41	77.23	OK
4627	2026-09-23 15:42	78.28	OK	4628	2026-09-23 15:43	76.67	OK
4629	2026-09-23 15:44	76.06	OK	4630	2026-09-23 15:45	77.51	OK
4631	2026-09-23 15:46	75.03	OK	4632	2026-09-23 15:47	77.02	OK
4633	2026-09-23 15:48	76.17	OK	4634	2026-09-23 15:49	74.95	OK
4635	2026-09-23 15:50	76.22	OK	4636	2026-09-23 15:51	77.29	OK
4637	2026-09-23 15:52	75.22	OK	4638	2026-09-23 15:53	76.64	OK
4639	2026-09-23 15:54	78.11	OK	4640	2026-09-23 15:55	77.89	OK
4641	2026-09-23 15:56	76.73	OK	4642	2026-09-23 15:57	77.16	OK
4643	2026-09-23 15:58	76.74	OK	4644	2026-09-23 15:59	75.07	OK
4645	2026-09-23 16:00	76.35	OK	4646	2026-09-23 16:01	76.70	OK
4647	2026-09-23 16:02	77.65	OK	4648	2026-09-23 16:03	77.97	OK
4649	2026-09-23 16:04	78.72	OK	4650	2026-09-23 16:05	77.54	OK
4651	2026-09-23 16:06	78.30	OK	4652	2026-09-23 16:07	77.55	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4653	2026-09-23 16:08	77.51	OK	4654	2026-09-23 16:09	76.14	OK
4655	2026-09-23 16:10	76.52	OK	4656	2026-09-23 16:11	79.20	OK
4657	2026-09-23 16:12	77.69	OK	4658	2026-09-23 16:13	76.18	OK
4659	2026-09-23 16:14	75.78	OK	4660	2026-09-23 16:15	77.44	OK
4661	2026-09-23 16:16	76.51	OK	4662	2026-09-23 16:17	75.15	OK
4663	2026-09-23 16:18	76.64	OK	4664	2026-09-23 16:19	75.15	OK
4665	2026-09-23 16:20	75.85	OK	4666	2026-09-23 16:21	74.71	OK
4667	2026-09-23 16:22	76.06	OK	4668	2026-09-23 16:23	75.53	OK
4669	2026-09-23 16:24	76.33	OK	4670	2026-09-23 16:25	77.26	OK
4671	2026-09-23 16:26	75.44	OK	4672	2026-09-23 16:27	77.04	OK
4673	2026-09-23 16:28	74.22	OK	4674	2026-09-23 16:29	74.83	OK
4675	2026-09-23 16:30	77.97	OK	4676	2026-09-23 16:31	75.88	OK
4677	2026-09-23 16:32	76.82	OK	4678	2026-09-23 16:33	76.03	OK
4679	2026-09-23 16:34	75.44	OK	4680	2026-09-23 16:35	73.75	OK
4681	2026-09-23 16:36	77.13	OK	4682	2026-09-23 16:37	77.04	OK
4683	2026-09-23 16:38	75.65	OK	4684	2026-09-23 16:39	76.02	OK
4685	2026-09-23 16:40	75.44	OK	4686	2026-09-23 16:41	73.94	OK
4687	2026-09-23 16:42	74.18	OK	4688	2026-09-23 16:43	73.21	OK
4689	2026-09-23 16:44	76.31	OK	4690	2026-09-23 16:45	74.44	OK
4691	2026-09-23 16:46	74.78	OK	4692	2026-09-23 16:47	74.89	OK
4693	2026-09-23 16:48	76.18	OK	4694	2026-09-23 16:49	75.39	OK
4695	2026-09-23 16:50	76.92	OK	4696	2026-09-23 16:51	76.58	OK
4697	2026-09-23 16:52	76.07	OK	4698	2026-09-23 16:53	75.11	OK
4699	2026-09-23 16:54	76.61	OK	4700	2026-09-23 16:55	75.81	OK
4701	2026-09-23 16:56	74.85	OK	4702	2026-09-23 16:57	74.06	OK
4703	2026-09-23 16:58	74.48	OK	4704	2026-09-23 16:59	76.79	OK
4705	2026-09-23 17:00	75.66	OK	4706	2026-09-23 17:01	74.73	OK
4707	2026-09-23 17:02	75.06	OK	4708	2026-09-23 17:03	73.40	OK
4709	2026-09-23 17:04	74.36	OK	4710	2026-09-23 17:05	76.41	OK
4711	2026-09-23 17:06	75.91	OK	4712	2026-09-23 17:07	75.32	OK
4713	2026-09-23 17:08	74.03	OK	4714	2026-09-23 17:09	76.08	OK
4715	2026-09-23 17:10	74.71	OK	4716	2026-09-23 17:11	75.01	OK
4717	2026-09-23 17:12	74.97	OK	4718	2026-09-23 17:13	75.83	OK
4719	2026-09-23 17:14	75.50	OK	4720	2026-09-23 17:15	74.96	OK
4721	2026-09-23 17:16	74.63	OK	4722	2026-09-23 17:17	73.77	OK
4723	2026-09-23 17:18	72.76	OK	4724	2026-09-23 17:19	73.58	OK
4725	2026-09-23 17:20	73.75	OK	4726	2026-09-23 17:21	74.34	OK
4727	2026-09-23 17:22	76.84	OK	4728	2026-09-23 17:23	74.50	OK
4729	2026-09-23 17:24	75.03	OK	4730	2026-09-23 17:25	74.18	OK
4731	2026-09-23 17:26	75.98	OK	4732	2026-09-23 17:27	73.79	OK
4733	2026-09-23 17:28	75.12	OK	4734	2026-09-23 17:29	74.04	OK
4735	2026-09-23 17:30	75.76	OK	4736	2026-09-23 17:31	73.27	OK
4737	2026-09-23 17:32	76.63	OK	4738	2026-09-23 17:33	74.28	OK
4739	2026-09-23 17:34	73.81	OK	4740	2026-09-23 17:35	74.17	OK
4741	2026-09-23 17:36	73.85	OK	4742	2026-09-23 17:37	76.05	OK
4743	2026-09-23 17:38	74.58	OK	4744	2026-09-23 17:39	73.39	OK
4745	2026-09-23 17:40	75.88	OK	4746	2026-09-23 17:41	75.32	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4747	2026-09-23 17:42	72.62	OK	4748	2026-09-23 17:43	74.56	OK
4749	2026-09-23 17:44	74.94	OK	4750	2026-09-23 17:45	75.55	OK
4751	2026-09-23 17:46	73.52	OK	4752	2026-09-23 17:47	72.46	OK
4753	2026-09-23 17:48	72.89	OK	4754	2026-09-23 17:49	76.10	OK
4755	2026-09-23 17:50	72.19	OK	4756	2026-09-23 17:51	72.15	OK
4757	2026-09-23 17:52	74.22	OK	4758	2026-09-23 17:53	74.66	OK
4759	2026-09-23 17:54	74.25	OK	4760	2026-09-23 17:55	75.60	OK
4761	2026-09-23 17:56	74.09	OK	4762	2026-09-23 17:57	72.99	OK
4763	2026-09-23 17:58	74.11	OK	4764	2026-09-23 17:59	75.04	OK
4765	2026-09-23 18:00	71.50	OK	4766	2026-09-23 18:01	72.30	OK
4767	2026-09-23 18:02	72.97	OK	4768	2026-09-23 18:03	72.75	OK
4769	2026-09-23 18:04	74.00	OK	4770	2026-09-23 18:05	73.71	OK
4771	2026-09-23 18:06	72.82	OK	4772	2026-09-23 18:07	73.25	OK
4773	2026-09-23 18:08	72.48	OK	4774	2026-09-23 18:09	75.12	OK
4775	2026-09-23 18:10	74.59	OK	4776	2026-09-23 18:11	71.61	OK
4777	2026-09-23 18:12	72.42	OK	4778	2026-09-23 18:13	73.17	OK
4779	2026-09-23 18:14	74.59	OK	4780	2026-09-23 18:15	73.86	OK
4781	2026-09-23 18:16	74.07	OK	4782	2026-09-23 18:17	74.02	OK
4783	2026-09-23 18:18	74.89	OK	4784	2026-09-23 18:19	74.10	OK
4785	2026-09-23 18:20	73.59	OK	4786	2026-09-23 18:21	73.91	OK
4787	2026-09-23 18:22	74.30	OK	4788	2026-09-23 18:23	72.03	OK
4789	2026-09-23 18:24	74.57	OK	4790	2026-09-23 18:25	73.93	OK
4791	2026-09-23 18:26	72.90	OK	4792	2026-09-23 18:27	73.96	OK
4793	2026-09-23 18:28	73.71	OK	4794	2026-09-23 18:29	72.36	OK
4795	2026-09-23 18:30	73.58	OK	4796	2026-09-23 18:31	72.72	OK
4797	2026-09-23 18:32	73.02	OK	4798	2026-09-23 18:33	71.24	OK
4799	2026-09-23 18:34	74.00	OK	4800	2026-09-23 18:35	72.88	OK
4801	2026-09-23 18:36	73.55	OK	4802	2026-09-23 18:37	72.25	OK
4803	2026-09-23 18:38	73.69	OK	4804	2026-09-23 18:39	70.26	OK
4805	2026-09-23 18:40	73.38	OK	4806	2026-09-23 18:41	73.53	OK
4807	2026-09-23 18:42	73.91	OK	4808	2026-09-23 18:43	73.20	OK
4809	2026-09-23 18:44	74.54	OK	4810	2026-09-23 18:45	70.18	OK
4811	2026-09-23 18:46	71.22	OK	4812	2026-09-23 18:47	72.43	OK
4813	2026-09-23 18:48	71.23	OK	4814	2026-09-23 18:49	72.13	OK
4815	2026-09-23 18:50	72.62	OK	4816	2026-09-23 18:51	72.50	OK
4817	2026-09-23 18:52	72.22	OK	4818	2026-09-23 18:53	72.38	OK
4819	2026-09-23 18:54	72.79	OK	4820	2026-09-23 18:55	74.05	OK
4821	2026-09-23 18:56	72.67	OK	4822	2026-09-23 18:57	70.63	OK
4823	2026-09-23 18:58	71.25	OK	4824	2026-09-23 18:59	71.39	OK
4825	2026-09-23 19:00	71.54	OK	4826	2026-09-23 19:01	71.67	OK
4827	2026-09-23 19:02	72.01	OK	4828	2026-09-23 19:03	72.48	OK
4829	2026-09-23 19:04	73.49	OK	4830	2026-09-23 19:05	72.29	OK
4831	2026-09-23 19:06	72.73	OK	4832	2026-09-23 19:07	71.78	OK
4833	2026-09-23 19:08	72.62	OK	4834	2026-09-23 19:09	72.25	OK
4835	2026-09-23 19:10	71.12	OK	4836	2026-09-23 19:11	71.64	OK
4837	2026-09-23 19:12	70.24	OK	4838	2026-09-23 19:13	73.60	OK
4839	2026-09-23 19:14	72.62	OK	4840	2026-09-23 19:15	72.50	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4841	2026-09-23 19:16	71.77	OK	4842	2026-09-23 19:17	73.26	OK
4843	2026-09-23 19:18	72.10	OK	4844	2026-09-23 19:19	70.83	OK
4845	2026-09-23 19:20	70.73	OK	4846	2026-09-23 19:21	69.33	OK
4847	2026-09-23 19:22	70.66	OK	4848	2026-09-23 19:23	71.37	OK
4849	2026-09-23 19:24	70.47	OK	4850	2026-09-23 19:25	71.77	OK
4851	2026-09-23 19:26	71.64	OK	4852	2026-09-23 19:27	71.22	OK
4853	2026-09-23 19:28	70.22	OK	4854	2026-09-23 19:29	69.42	OK
4855	2026-09-23 19:30	72.79	OK	4856	2026-09-23 19:31	69.60	OK
4857	2026-09-23 19:32	71.01	OK	4858	2026-09-23 19:33	70.64	OK
4859	2026-09-23 19:34	71.39	OK	4860	2026-09-23 19:35	71.36	OK
4861	2026-09-23 19:36	69.40	OK	4862	2026-09-23 19:37	72.28	OK
4863	2026-09-23 19:38	71.06	OK	4864	2026-09-23 19:39	71.14	OK
4865	2026-09-23 19:40	70.66	OK	4866	2026-09-23 19:41	70.98	OK
4867	2026-09-23 19:42	71.99	OK	4868	2026-09-23 19:43	69.61	OK
4869	2026-09-23 19:44	70.73	OK	4870	2026-09-23 19:45	69.04	OK
4871	2026-09-23 19:46	71.82	OK	4872	2026-09-23 19:47	70.26	OK
4873	2026-09-23 19:48	70.78	OK	4874	2026-09-23 19:49	69.73	OK
4875	2026-09-23 19:50	71.24	OK	4876	2026-09-23 19:51	72.12	OK
4877	2026-09-23 19:52	69.49	OK	4878	2026-09-23 19:53	70.99	OK
4879	2026-09-23 19:54	71.45	OK	4880	2026-09-23 19:55	70.83	OK
4881	2026-09-23 19:56	72.52	OK	4882	2026-09-23 19:57	71.03	OK
4883	2026-09-23 19:58	69.81	OK	4884	2026-09-23 19:59	70.73	OK
4885	2026-09-23 20:00	69.69	OK	4886	2026-09-23 20:01	69.74	OK
4887	2026-09-23 20:02	69.15	OK	4888	2026-09-23 20:03	68.19	OK
4889	2026-09-23 20:04	71.27	OK	4890	2026-09-23 20:05	70.62	OK
4891	2026-09-23 20:06	70.45	OK	4892	2026-09-23 20:07	71.44	OK
4893	2026-09-23 20:08	69.75	OK	4894	2026-09-23 20:09	70.80	OK
4895	2026-09-23 20:10	71.25	OK	4896	2026-09-23 20:11	68.51	OK
4897	2026-09-23 20:12	69.90	OK	4898	2026-09-23 20:13	70.68	OK
4899	2026-09-23 20:14	68.69	OK	4900	2026-09-23 20:15	70.45	OK
4901	2026-09-23 20:16	68.53	OK	4902	2026-09-23 20:17	69.85	OK
4903	2026-09-23 20:18	69.32	OK	4904	2026-09-23 20:19	69.63	OK
4905	2026-09-23 20:20	72.25	OK	4906	2026-09-23 20:21	69.70	OK
4907	2026-09-23 20:22	70.31	OK	4908	2026-09-23 20:23	70.40	OK
4909	2026-09-23 20:24	71.17	OK	4910	2026-09-23 20:25	70.11	OK
4911	2026-09-23 20:26	69.82	OK	4912	2026-09-23 20:27	69.70	OK
4913	2026-09-23 20:28	69.77	OK	4914	2026-09-23 20:29	69.23	OK
4915	2026-09-23 20:30	69.19	OK	4916	2026-09-23 20:31	70.68	OK
4917	2026-09-23 20:32	71.25	OK	4918	2026-09-23 20:33	68.55	OK
4919	2026-09-23 20:34	69.33	OK	4920	2026-09-23 20:35	72.39	OK
4921	2026-09-23 20:36	68.64	OK	4922	2026-09-23 20:37	70.75	OK
4923	2026-09-23 20:38	69.76	OK	4924	2026-09-23 20:39	69.47	OK
4925	2026-09-23 20:40	68.96	OK	4926	2026-09-23 20:41	68.16	OK
4927	2026-09-23 20:42	68.97	OK	4928	2026-09-23 20:43	71.14	OK
4929	2026-09-23 20:44	69.10	OK	4930	2026-09-23 20:45	70.29	OK
4931	2026-09-23 20:46	69.08	OK	4932	2026-09-23 20:47	68.02	OK
4933	2026-09-23 20:48	70.66	OK	4934	2026-09-23 20:49	70.27	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4935	2026-09-23 20:50	68.81	OK	4936	2026-09-23 20:51	68.84	OK
4937	2026-09-23 20:52	68.05	OK	4938	2026-09-23 20:53	70.46	OK
4939	2026-09-23 20:54	69.70	OK	4940	2026-09-23 20:55	68.78	OK
4941	2026-09-23 20:56	69.20	OK	4942	2026-09-23 20:57	69.43	OK
4943	2026-09-23 20:58	68.78	OK	4944	2026-09-23 20:59	68.56	OK
4945	2026-09-23 21:00	70.07	OK	4946	2026-09-23 21:01	69.42	OK
4947	2026-09-23 21:02	70.39	OK	4948	2026-09-23 21:03	68.76	OK
4949	2026-09-23 21:04	67.31	OK	4950	2026-09-23 21:05	69.54	OK
4951	2026-09-23 21:06	68.45	OK	4952	2026-09-23 21:07	69.67	OK
4953	2026-09-23 21:08	68.93	OK	4954	2026-09-23 21:09	67.44	OK
4955	2026-09-23 21:10	68.60	OK	4956	2026-09-23 21:11	67.68	OK
4957	2026-09-23 21:12	67.81	OK	4958	2026-09-23 21:13	67.66	OK
4959	2026-09-23 21:14	70.10	OK	4960	2026-09-23 21:15	68.22	OK
4961	2026-09-23 21:16	67.27	OK	4962	2026-09-23 21:17	68.33	OK
4963	2026-09-23 21:18	70.98	OK	4964	2026-09-23 21:19	70.38	OK
4965	2026-09-23 21:20	69.59	OK	4966	2026-09-23 21:21	67.61	OK
4967	2026-09-23 21:22	67.19	OK	4968	2026-09-23 21:23	69.29	OK
4969	2026-09-23 21:24	68.51	OK	4970	2026-09-23 21:25	66.90	OK
4971	2026-09-23 21:26	70.28	OK	4972	2026-09-23 21:27	70.52	OK
4973	2026-09-23 21:28	69.13	OK	4974	2026-09-23 21:29	68.22	OK
4975	2026-09-23 21:30	68.92	OK	4976	2026-09-23 21:31	67.59	OK
4977	2026-09-23 21:32	67.12	OK	4978	2026-09-23 21:33	68.23	OK
4979	2026-09-23 21:34	69.43	OK	4980	2026-09-23 21:35	68.01	OK
4981	2026-09-23 21:36	68.42	OK	4982	2026-09-23 21:37	69.74	OK
4983	2026-09-23 21:38	68.42	OK	4984	2026-09-23 21:39	65.61	OK
4985	2026-09-23 21:40	67.04	OK	4986	2026-09-23 21:41	69.85	OK
4987	2026-09-23 21:42	68.56	OK	4988	2026-09-23 21:43	69.04	OK
4989	2026-09-23 21:44	68.00	OK	4990	2026-09-23 21:45	66.54	OK
4991	2026-09-23 21:46	68.46	OK	4992	2026-09-23 21:47	68.80	OK
4993	2026-09-23 21:48	67.18	OK	4994	2026-09-23 21:49	68.40	OK
4995	2026-09-23 21:50	68.49	OK	4996	2026-09-23 21:51	67.28	OK
4997	2026-09-23 21:52	67.00	OK	4998	2026-09-23 21:53	67.50	OK
4999	2026-09-23 21:54	67.75	OK	5000	2026-09-23 21:55	66.77	OK
5001	2026-09-23 21:56	66.36	OK	5002	2026-09-23 21:57	68.00	OK
5003	2026-09-23 21:58	67.06	OK	5004	2026-09-23 21:59	67.73	OK
5005	2026-09-23 22:00	66.14	OK	5006	2026-09-23 22:01	67.92	OK
5007	2026-09-23 22:02	67.32	OK	5008	2026-09-23 22:03	67.84	OK
5009	2026-09-23 22:04	67.06	OK	5010	2026-09-23 22:05	67.70	OK
5011	2026-09-23 22:06	67.93	OK	5012	2026-09-23 22:07	66.15	OK
5013	2026-09-23 22:08	66.43	OK	5014	2026-09-23 22:09	69.05	OK
5015	2026-09-23 22:10	68.31	OK	5016	2026-09-23 22:11	66.33	OK
5017	2026-09-23 22:12	65.69	OK	5018	2026-09-23 22:13	69.65	OK
5019	2026-09-23 22:14	66.65	OK	5020	2026-09-23 22:15	67.06	OK
5021	2026-09-23 22:16	70.18	OK	5022	2026-09-23 22:17	68.75	OK
5023	2026-09-23 22:18	68.15	OK	5024	2026-09-23 22:19	68.62	OK
5025	2026-09-23 22:20	69.33	OK	5026	2026-09-23 22:21	67.19	OK
5027	2026-09-23 22:22	68.75	OK	5028	2026-09-23 22:23	66.19	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5029	2026-09-23 22:24	67.53	OK	5030	2026-09-23 22:25	68.47	OK
5031	2026-09-23 22:26	66.53	OK	5032	2026-09-23 22:27	68.64	OK
5033	2026-09-23 22:28	65.79	OK	5034	2026-09-23 22:29	68.24	OK
5035	2026-09-23 22:30	66.10	OK	5036	2026-09-23 22:31	67.44	OK
5037	2026-09-23 22:32	66.94	OK	5038	2026-09-23 22:33	69.19	OK
5039	2026-09-23 22:34	66.96	OK	5040	2026-09-23 22:35	67.14	OK
5041	2026-09-23 22:36	68.55	OK	5042	2026-09-23 22:37	67.45	OK
5043	2026-09-23 22:38	68.45	OK	5044	2026-09-23 22:39	67.09	OK
5045	2026-09-23 22:40	67.61	OK	5046	2026-09-23 22:41	69.25	OK
5047	2026-09-23 22:42	67.56	OK	5048	2026-09-23 22:43	66.29	OK
5049	2026-09-23 22:44	67.16	OK	5050	2026-09-23 22:45	66.90	OK
5051	2026-09-23 22:46	68.38	OK	5052	2026-09-23 22:47	68.61	OK
5053	2026-09-23 22:48	67.17	OK	5054	2026-09-23 22:49	69.36	OK
5055	2026-09-23 22:50	68.71	OK	5056	2026-09-23 22:51	69.54	OK
5057	2026-09-23 22:52	66.37	OK	5058	2026-09-23 22:53	67.32	OK
5059	2026-09-23 22:54	66.69	OK	5060	2026-09-23 22:55	69.29	OK
5061	2026-09-23 22:56	65.63	OK	5062	2026-09-23 22:57	68.01	OK
5063	2026-09-23 22:58	66.67	OK	5064	2026-09-23 22:59	67.86	OK
5065	2026-09-23 23:00	66.50	OK	5066	2026-09-23 23:01	67.54	OK
5067	2026-09-23 23:02	64.66	OK	5068	2026-09-23 23:03	67.20	OK
5069	2026-09-23 23:04	66.14	OK	5070	2026-09-23 23:05	68.25	OK
5071	2026-09-23 23:06	67.89	OK	5072	2026-09-23 23:07	66.75	OK
5073	2026-09-23 23:08	64.47	OK	5074	2026-09-23 23:09	68.54	OK
5075	2026-09-23 23:10	68.76	OK	5076	2026-09-23 23:11	67.34	OK
5077	2026-09-23 23:12	67.77	OK	5078	2026-09-23 23:13	65.73	OK
5079	2026-09-23 23:14	67.15	OK	5080	2026-09-23 23:15	66.76	OK
5081	2026-09-23 23:16	65.00	OK	5082	2026-09-23 23:17	68.78	OK
5083	2026-09-23 23:18	66.35	OK	5084	2026-09-23 23:19	66.84	OK
5085	2026-09-23 23:20	67.56	OK	5086	2026-09-23 23:21	66.02	OK
5087	2026-09-23 23:22	66.74	OK	5088	2026-09-23 23:23	66.52	OK
5089	2026-09-23 23:24	64.89	OK	5090	2026-09-23 23:25	64.71	OK
5091	2026-09-23 23:26	65.78	OK	5092	2026-09-23 23:27	68.63	OK
5093	2026-09-23 23:28	65.22	OK	5094	2026-09-23 23:29	66.59	OK
5095	2026-09-23 23:30	68.30	OK	5096	2026-09-23 23:31	66.24	OK
5097	2026-09-23 23:32	67.56	OK	5098	2026-09-23 23:33	67.26	OK
5099	2026-09-23 23:34	69.48	OK	5100	2026-09-23 23:35	64.84	OK
5101	2026-09-23 23:36	67.79	OK	5102	2026-09-23 23:37	65.18	OK
5103	2026-09-23 23:38	68.66	OK	5104	2026-09-23 23:39	67.97	OK
5105	2026-09-23 23:40	65.46	OK	5106	2026-09-23 23:41	66.52	OK
5107	2026-09-23 23:42	64.97	OK	5108	2026-09-23 23:43	64.98	OK
5109	2026-09-23 23:44	64.94	OK	5110	2026-09-23 23:45	67.81	OK
5111	2026-09-23 23:46	65.55	OK	5112	2026-09-23 23:47	64.48	OK
5113	2026-09-23 23:48	66.80	OK	5114	2026-09-23 23:49	66.95	OK
5115	2026-09-23 23:50	67.08	OK	5116	2026-09-23 23:51	67.43	OK
5117	2026-09-23 23:52	66.44	OK	5118	2026-09-23 23:53	66.22	OK
5119	2026-09-23 23:54	66.66	OK	5120	2026-09-23 23:55	67.39	OK
5121	2026-09-23 23:56	65.35	OK	5122	2026-09-23 23:57	65.32	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5123	2026-09-23 23:58	67.56	OK	5124	2026-09-23 23:59	65.44	OK
5125	2026-09-24 00:00	68.22	OK	5126	2026-09-24 00:01	66.39	OK
5127	2026-09-24 00:02	67.97	OK	5128	2026-09-24 00:03	66.28	OK
5129	2026-09-24 00:04	64.49	OK	5130	2026-09-24 00:05	67.31	OK
5131	2026-09-24 00:06	67.30	OK	5132	2026-09-24 00:07	67.55	OK
5133	2026-09-24 00:08	68.50	OK	5134	2026-09-24 00:09	68.69	OK
5135	2026-09-24 00:10	64.64	OK	5136	2026-09-24 00:11	66.11	OK
5137	2026-09-24 00:12	65.85	OK	5138	2026-09-24 00:13	66.28	OK
5139	2026-09-24 00:14	65.98	OK	5140	2026-09-24 00:15	66.22	OK
5141	2026-09-24 00:16	65.04	OK	5142	2026-09-24 00:17	66.56	OK
5143	2026-09-24 00:18	65.64	OK	5144	2026-09-24 00:19	66.40	OK
5145	2026-09-24 00:20	66.46	OK	5146	2026-09-24 00:21	66.33	OK
5147	2026-09-24 00:22	67.17	OK	5148	2026-09-24 00:23	67.87	OK
5149	2026-09-24 00:24	65.11	OK	5150	2026-09-24 00:25	65.20	OK
5151	2026-09-24 00:26	64.56	OK	5152	2026-09-24 00:27	68.79	OK
5153	2026-09-24 00:28	65.79	OK	5154	2026-09-24 00:29	65.30	OK
5155	2026-09-24 00:30	66.36	OK	5156	2026-09-24 00:31	66.90	OK
5157	2026-09-24 00:32	67.31	OK	5158	2026-09-24 00:33	65.92	OK
5159	2026-09-24 00:34	65.39	OK	5160	2026-09-24 00:35	65.62	OK
5161	2026-09-24 00:36	67.70	OK	5162	2026-09-24 00:37	66.98	OK
5163	2026-09-24 00:38	66.10	OK	5164	2026-09-24 00:39	64.74	OK
5165	2026-09-24 00:40	66.42	OK	5166	2026-09-24 00:41	64.67	OK
5167	2026-09-24 00:42	66.05	OK	5168	2026-09-24 00:43	64.56	OK
5169	2026-09-24 00:44	66.95	OK	5170	2026-09-24 00:45	64.98	OK
5171	2026-09-24 00:46	66.79	OK	5172	2026-09-24 00:47	65.95	OK
5173	2026-09-24 00:48	64.72	OK	5174	2026-09-24 00:49	65.49	OK
5175	2026-09-24 00:50	63.76	OK	5176	2026-09-24 00:51	65.76	OK
5177	2026-09-24 00:52	65.74	OK	5178	2026-09-24 00:53	67.83	OK
5179	2026-09-24 00:54	65.79	OK	5180	2026-09-24 00:55	68.56	OK
5181	2026-09-24 00:56	65.40	OK	5182	2026-09-24 00:57	65.99	OK
5183	2026-09-24 00:58	65.96	OK	5184	2026-09-24 00:59	66.41	OK
5185	2026-09-24 01:00	65.02	OK	5186	2026-09-24 01:01	66.14	OK
5187	2026-09-24 01:02	67.88	OK	5188	2026-09-24 01:03	66.70	OK
5189	2026-09-24 01:04	66.80	OK	5190	2026-09-24 01:05	67.33	OK
5191	2026-09-24 01:06	65.62	OK	5192	2026-09-24 01:07	66.17	OK
5193	2026-09-24 01:08	65.12	OK	5194	2026-09-24 01:09	66.44	OK
5195	2026-09-24 01:10	65.53	OK	5196	2026-09-24 01:11	64.74	OK
5197	2026-09-24 01:12	64.80	OK	5198	2026-09-24 01:13	65.64	OK
5199	2026-09-24 01:14	65.35	OK	5200	2026-09-24 01:15	64.06	OK
5201	2026-09-24 01:16	65.67	OK	5202	2026-09-24 01:17	64.06	OK
5203	2026-09-24 01:18	67.02	OK	5204	2026-09-24 01:19	67.57	OK
5205	2026-09-24 01:20	65.82	OK	5206	2026-09-24 01:21	67.21	OK
5207	2026-09-24 01:22	66.60	OK	5208	2026-09-24 01:23	66.25	OK
5209	2026-09-24 01:24	66.83	OK	5210	2026-09-24 01:25	66.25	OK
5211	2026-09-24 01:26	65.50	OK	5212	2026-09-24 01:27	65.34	OK
5213	2026-09-24 01:28	67.31	OK	5214	2026-09-24 01:29	67.99	OK
5215	2026-09-24 01:30	66.42	OK	5216	2026-09-24 01:31	67.04	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5217	2026-09-24 01:32	66.85	OK	5218	2026-09-24 01:33	67.48	OK
5219	2026-09-24 01:34	65.24	OK	5220	2026-09-24 01:35	68.44	OK
5221	2026-09-24 01:36	65.51	OK	5222	2026-09-24 01:37	67.46	OK
5223	2026-09-24 01:38	66.04	OK	5224	2026-09-24 01:39	67.23	OK
5225	2026-09-24 01:40	65.08	OK	5226	2026-09-24 01:41	67.07	OK
5227	2026-09-24 01:42	64.48	OK	5228	2026-09-24 01:43	66.79	OK
5229	2026-09-24 01:44	67.55	OK	5230	2026-09-24 01:45	64.50	OK
5231	2026-09-24 01:46	64.24	OK	5232	2026-09-24 01:47	66.49	OK
5233	2026-09-24 01:48	66.33	OK	5234	2026-09-24 01:49	66.63	OK
5235	2026-09-24 01:50	65.80	OK	5236	2026-09-24 01:51	65.67	OK
5237	2026-09-24 01:52	66.03	OK	5238	2026-09-24 01:53	67.23	OK
5239	2026-09-24 01:54	67.16	OK	5240	2026-09-24 01:55	67.01	OK
5241	2026-09-24 01:56	68.75	OK	5242	2026-09-24 01:57	64.15	OK
5243	2026-09-24 01:58	67.74	OK	5244	2026-09-24 01:59	66.38	OK
5245	2026-09-24 02:00	67.60	OK	5246	2026-09-24 02:01	65.87	OK
5247	2026-09-24 02:02	67.97	OK	5248	2026-09-24 02:03	67.30	OK
5249	2026-09-24 02:04	65.42	OK	5250	2026-09-24 02:05	66.28	OK
5251	2026-09-24 02:06	66.28	OK	5252	2026-09-24 02:07	65.27	OK
5253	2026-09-24 02:08	65.27	OK	5254	2026-09-24 02:09	66.90	OK
5255	2026-09-24 02:10	66.14	OK	5256	2026-09-24 02:11	67.38	OK
5257	2026-09-24 02:12	66.46	OK	5258	2026-09-24 02:13	67.43	OK
5259	2026-09-24 02:14	67.59	OK	5260	2026-09-24 02:15	66.90	OK
5261	2026-09-24 02:16	66.84	OK	5262	2026-09-24 02:17	66.77	OK
5263	2026-09-24 02:18	67.37	OK	5264	2026-09-24 02:19	67.23	OK
5265	2026-09-24 02:20	65.17	OK	5266	2026-09-24 02:21	67.39	OK
5267	2026-09-24 02:22	66.29	OK	5268	2026-09-24 02:23	66.14	OK
5269	2026-09-24 02:24	66.14	OK	5270	2026-09-24 02:25	66.66	OK
5271	2026-09-24 02:26	65.77	OK	5272	2026-09-24 02:27	66.90	OK
5273	2026-09-24 02:28	64.98	OK	5274	2026-09-24 02:29	64.91	OK
5275	2026-09-24 02:30	66.88	OK	5276	2026-09-24 02:31	66.96	OK
5277	2026-09-24 02:32	66.67	OK	5278	2026-09-24 02:33	66.14	OK
5279	2026-09-24 02:34	66.61	OK	5280	2026-09-24 02:35	66.74	OK
5281	2026-09-24 02:36	66.74	OK	5282	2026-09-24 02:37	65.12	OK
5283	2026-09-24 02:38	66.83	OK	5284	2026-09-24 02:39	65.89	OK
5285	2026-09-24 02:40	67.05	OK	5286	2026-09-24 02:41	66.37	OK
5287	2026-09-24 02:42	68.92	OK	5288	2026-09-24 02:43	66.87	OK
5289	2026-09-24 02:44	66.16	OK	5290	2026-09-24 02:45	66.11	OK
5291	2026-09-24 02:46	67.55	OK	5292	2026-09-24 02:47	68.35	OK
5293	2026-09-24 02:48	65.90	OK	5294	2026-09-24 02:49	66.35	OK
5295	2026-09-24 02:50	67.67	OK	5296	2026-09-24 02:51	65.69	OK
5297	2026-09-24 02:52	68.33	OK	5298	2026-09-24 02:53	67.53	OK
5299	2026-09-24 02:54	67.15	OK	5300	2026-09-24 02:55	66.81	OK
5301	2026-09-24 02:56	69.30	OK	5302	2026-09-24 02:57	66.07	OK
5303	2026-09-24 02:58	66.35	OK	5304	2026-09-24 02:59	64.32	OK
5305	2026-09-24 03:00	66.94	OK	5306	2026-09-24 03:01	66.94	OK
5307	2026-09-24 03:02	68.58	OK	5308	2026-09-24 03:03	67.20	OK
5309	2026-09-24 03:04	68.40	OK	5310	2026-09-24 03:05	66.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5311	2026-09-24 03:06	66.48	OK	5312	2026-09-24 03:07	68.02	OK
5313	2026-09-24 03:08	66.94	OK	5314	2026-09-24 03:09	66.81	OK
5315	2026-09-24 03:10	66.67	OK	5316	2026-09-24 03:11	68.13	OK
5317	2026-09-24 03:12	68.11	OK	5318	2026-09-24 03:13	67.10	OK
5319	2026-09-24 03:14	67.32	OK	5320	2026-09-24 03:15	66.97	OK
5321	2026-09-24 03:16	67.25	OK	5322	2026-09-24 03:17	66.18	OK
5323	2026-09-24 03:18	67.31	OK	5324	2026-09-24 03:19	68.47	OK
5325	2026-09-24 03:20	67.48	OK	5326	2026-09-24 03:21	67.31	OK
5327	2026-09-24 03:22	67.84	OK	5328	2026-09-24 03:23	65.87	OK
5329	2026-09-24 03:24	66.31	OK	5330	2026-09-24 03:25	68.84	OK
5331	2026-09-24 03:26	68.98	OK	5332	2026-09-24 03:27	66.34	OK
5333	2026-09-24 03:28	69.68	OK	5334	2026-09-24 03:29	67.52	OK
5335	2026-09-24 03:30	68.37	OK	5336	2026-09-24 03:31	67.60	OK
5337	2026-09-24 03:32	67.64	OK	5338	2026-09-24 03:33	67.28	OK
5339	2026-09-24 03:34	66.16	OK	5340	2026-09-24 03:35	68.54	OK
5341	2026-09-24 03:36	67.32	OK	5342	2026-09-24 03:37	68.51	OK
5343	2026-09-24 03:38	69.40	OK	5344	2026-09-24 03:39	67.46	OK
5345	2026-09-24 03:40	67.64	OK	5346	2026-09-24 03:41	68.36	OK
5347	2026-09-24 03:42	68.69	OK	5348	2026-09-24 03:43	69.96	OK
5349	2026-09-24 03:44	68.65	OK	5350	2026-09-24 03:45	66.00	OK
5351	2026-09-24 03:46	67.78	OK	5352	2026-09-24 03:47	69.51	OK
5353	2026-09-24 03:48	66.00	OK	5354	2026-09-24 03:49	68.09	OK
5355	2026-09-24 03:50	69.23	OK	5356	2026-09-24 03:51	68.89	OK
5357	2026-09-24 03:52	69.37	OK	5358	2026-09-24 03:53	69.64	OK
5359	2026-09-24 03:54	67.79	OK	5360	2026-09-24 03:55	67.58	OK
5361	2026-09-24 03:56	69.25	OK	5362	2026-09-24 03:57	68.46	OK
5363	2026-09-24 03:58	68.50	OK	5364	2026-09-24 03:59	69.71	OK
5365	2026-09-24 04:00	68.66	OK	5366	2026-09-24 04:01	67.44	OK
5367	2026-09-24 04:02	67.16	OK	5368	2026-09-24 04:03	67.42	OK
5369	2026-09-24 04:04	68.97	OK	5370	2026-09-24 04:05	69.92	OK
5371	2026-09-24 04:06	69.01	OK	5372	2026-09-24 04:07	68.10	OK
5373	2026-09-24 04:08	69.29	OK	5374	2026-09-24 04:09	68.10	OK
5375	2026-09-24 04:10	67.98	OK	5376	2026-09-24 04:11	70.26	OK
5377	2026-09-24 04:12	66.80	OK	5378	2026-09-24 04:13	67.94	OK
5379	2026-09-24 04:14	69.56	OK	5380	2026-09-24 04:15	67.83	OK
5381	2026-09-24 04:16	69.06	OK	5382	2026-09-24 04:17	67.25	OK
5383	2026-09-24 04:18	68.01	OK	5384	2026-09-24 04:19	68.25	OK
5385	2026-09-24 04:20	67.43	OK	5386	2026-09-24 04:21	70.19	OK
5387	2026-09-24 04:22	67.98	OK	5388	2026-09-24 04:23	68.60	OK
5389	2026-09-24 04:24	67.76	OK	5390	2026-09-24 04:25	67.81	OK
5391	2026-09-24 04:26	70.19	OK	5392	2026-09-24 04:27	68.74	OK
5393	2026-09-24 04:28	67.66	OK	5394	2026-09-24 04:29	68.49	OK
5395	2026-09-24 04:30	70.24	OK	5396	2026-09-24 04:31	67.76	OK
5397	2026-09-24 04:32	69.10	OK	5398	2026-09-24 04:33	68.71	OK
5399	2026-09-24 04:34	69.82	OK	5400	2026-09-24 04:35	69.28	OK
5401	2026-09-24 04:36	67.69	OK	5402	2026-09-24 04:37	68.77	OK
5403	2026-09-24 04:38	68.18	OK	5404	2026-09-24 04:39	70.55	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5405	2026-09-24 04:40	69.05	OK	5406	2026-09-24 04:41	67.80	OK
5407	2026-09-24 04:42	69.11	OK	5408	2026-09-24 04:43	68.22	OK
5409	2026-09-24 04:44	67.92	OK	5410	2026-09-24 04:45	70.94	OK
5411	2026-09-24 04:46	68.82	OK	5412	2026-09-24 04:47	68.69	OK
5413	2026-09-24 04:48	69.58	OK	5414	2026-09-24 04:49	67.14	OK
5415	2026-09-24 04:50	69.03	OK	5416	2026-09-24 04:51	68.32	OK
5417	2026-09-24 04:52	68.91	OK	5418	2026-09-24 04:53	71.01	OK
5419	2026-09-24 04:54	67.76	OK	5420	2026-09-24 04:55	70.04	OK
5421	2026-09-24 04:56	67.86	OK	5422	2026-09-24 04:57	70.01	OK
5423	2026-09-24 04:58	69.69	OK	5424	2026-09-24 04:59	71.25	OK
5425	2026-09-24 05:00	69.78	OK	5426	2026-09-24 05:01	69.09	OK
5427	2026-09-24 05:02	68.67	OK	5428	2026-09-24 05:03	70.80	OK
5429	2026-09-24 05:04	68.61	OK	5430	2026-09-24 05:05	69.07	OK
5431	2026-09-24 05:06	67.87	OK	5432	2026-09-24 05:07	67.89	OK
5433	2026-09-24 05:08	69.54	OK	5434	2026-09-24 05:09	68.84	OK
5435	2026-09-24 05:10	71.08	OK	5436	2026-09-24 05:11	70.56	OK
5437	2026-09-24 05:12	71.04	OK	5438	2026-09-24 05:13	69.11	OK
5439	2026-09-24 05:14	70.47	OK	5440	2026-09-24 05:15	68.95	OK
5441	2026-09-24 05:16	71.15	OK	5442	2026-09-24 05:17	70.68	OK
5443	2026-09-24 05:18	70.52	OK	5444	2026-09-24 05:19	72.18	OK
5445	2026-09-24 05:20	69.03	OK	5446	2026-09-24 05:21	70.11	OK
5447	2026-09-24 05:22	69.24	OK	5448	2026-09-24 05:23	69.95	OK
5449	2026-09-24 05:24	70.26	OK	5450	2026-09-24 05:25	70.27	OK
5451	2026-09-24 05:26	70.58	OK	5452	2026-09-24 05:27	71.72	OK
5453	2026-09-24 05:28	68.50	OK	5454	2026-09-24 05:29	68.40	OK
5455	2026-09-24 05:30	69.00	OK	5456	2026-09-24 05:31	70.67	OK
5457	2026-09-24 05:32	70.66	OK	5458	2026-09-24 05:33	73.14	OK
5459	2026-09-24 05:34	70.68	OK	5460	2026-09-24 05:35	68.85	OK
5461	2026-09-24 05:36	70.07	OK	5462	2026-09-24 05:37	70.84	OK
5463	2026-09-24 05:38	70.02	OK	5464	2026-09-24 05:39	70.82	OK
5465	2026-09-24 05:40	72.17	OK	5466	2026-09-24 05:41	69.86	OK
5467	2026-09-24 05:42	70.62	OK	5468	2026-09-24 05:43	70.27	OK
5469	2026-09-24 05:44	69.41	OK	5470	2026-09-24 05:45	68.80	OK
5471	2026-09-24 05:46	70.63	OK	5472	2026-09-24 05:47	70.09	OK
5473	2026-09-24 05:48	69.64	OK	5474	2026-09-24 05:49	70.97	OK
5475	2026-09-24 05:50	70.01	OK	5476	2026-09-24 05:51	70.30	OK
5477	2026-09-24 05:52	71.23	OK	5478	2026-09-24 05:53	68.76	OK
5479	2026-09-24 05:54	73.13	OK	5480	2026-09-24 05:55	69.68	OK
5481	2026-09-24 05:56	69.32	OK	5482	2026-09-24 05:57	70.06	OK
5483	2026-09-24 05:58	68.98	OK	5484	2026-09-24 05:59	69.48	OK
5485	2026-09-24 06:00	71.13	OK	5486	2026-09-24 06:01	71.87	OK
5487	2026-09-24 06:02	71.35	OK	5488	2026-09-24 06:03	70.89	OK
5489	2026-09-24 06:04	69.83	OK	5490	2026-09-24 06:05	71.47	OK
5491	2026-09-24 06:06	72.44	OK	5492	2026-09-24 06:07	70.13	OK
5493	2026-09-24 06:08	69.54	OK	5494	2026-09-24 06:09	71.45	OK
5495	2026-09-24 06:10	72.18	OK	5496	2026-09-24 06:11	70.94	OK
5497	2026-09-24 06:12	70.25	OK	5498	2026-09-24 06:13	70.75	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5499	2026-09-24 06:14	70.70	OK	5500	2026-09-24 06:15	70.44	OK
5501	2026-09-24 06:16	72.23	OK	5502	2026-09-24 06:17	69.98	OK
5503	2026-09-24 06:18	69.89	OK	5504	2026-09-24 06:19	71.72	OK
5505	2026-09-24 06:20	71.99	OK	5506	2026-09-24 06:21	71.85	OK
5507	2026-09-24 06:22	71.02	OK	5508	2026-09-24 06:23	70.82	OK
5509	2026-09-24 06:24	69.95	OK	5510	2026-09-24 06:25	70.24	OK
5511	2026-09-24 06:26	71.81	OK	5512	2026-09-24 06:27	71.40	OK
5513	2026-09-24 06:28	70.98	OK	5514	2026-09-24 06:29	72.96	OK
5515	2026-09-24 06:30	73.12	OK	5516	2026-09-24 06:31	71.86	OK
5517	2026-09-24 06:32	73.34	OK	5518	2026-09-24 06:33	72.53	OK
5519	2026-09-24 06:34	73.36	OK	5520	2026-09-24 06:35	73.05	OK
5521	2026-09-24 06:36	73.34	OK	5522	2026-09-24 06:37	72.88	OK
5523	2026-09-24 06:38	71.23	OK	5524	2026-09-24 06:39	72.70	OK
5525	2026-09-24 06:40	71.28	OK	5526	2026-09-24 06:41	72.66	OK
5527	2026-09-24 06:42	71.90	OK	5528	2026-09-24 06:43	72.66	OK
5529	2026-09-24 06:44	72.04	OK	5530	2026-09-24 06:45	72.56	OK
5531	2026-09-24 06:46	71.35	OK	5532	2026-09-24 06:47	72.20	OK
5533	2026-09-24 06:48	72.87	OK	5534	2026-09-24 06:49	72.67	OK
5535	2026-09-24 06:50	72.94	OK	5536	2026-09-24 06:51	71.85	OK
5537	2026-09-24 06:52	72.97	OK	5538	2026-09-24 06:53	72.31	OK
5539	2026-09-24 06:54	72.53	OK	5540	2026-09-24 06:55	72.86	OK
5541	2026-09-24 06:56	74.09	OK	5542	2026-09-24 06:57	71.69	OK
5543	2026-09-24 06:58	72.21	OK	5544	2026-09-24 06:59	71.91	OK
5545	2026-09-24 07:00	73.76	OK	5546	2026-09-24 07:01	71.20	OK
5547	2026-09-24 07:02	70.65	OK	5548	2026-09-24 07:03	71.67	OK
5549	2026-09-24 07:04	73.05	OK	5550	2026-09-24 07:05	73.99	OK
5551	2026-09-24 07:06	72.08	OK	5552	2026-09-24 07:07	72.58	OK
5553	2026-09-24 07:08	72.67	OK	5554	2026-09-24 07:09	72.93	OK
5555	2026-09-24 07:10	72.73	OK	5556	2026-09-24 07:11	73.73	OK
5557	2026-09-24 07:12	72.79	OK	5558	2026-09-24 07:13	72.51	OK
5559	2026-09-24 07:14	74.20	OK	5560	2026-09-24 07:15	72.93	OK
5561	2026-09-24 07:16	75.62	OK	5562	2026-09-24 07:17	74.74	OK
5563	2026-09-24 07:18	74.28	OK	5564	2026-09-24 07:19	71.92	OK
5565	2026-09-24 07:20	73.85	OK	5566	2026-09-24 07:21	72.19	OK
5567	2026-09-24 07:22	72.15	OK	5568	2026-09-24 07:23	74.03	OK
5569	2026-09-24 07:24	73.79	OK	5570	2026-09-24 07:25	75.13	OK
5571	2026-09-24 07:26	74.94	OK	5572	2026-09-24 07:27	73.46	OK
5573	2026-09-24 07:28	73.30	OK	5574	2026-09-24 07:29	73.74	OK
5575	2026-09-24 07:30	72.54	OK	5576	2026-09-24 07:31	76.42	OK
5577	2026-09-24 07:32	74.41	OK	5578	2026-09-24 07:33	75.54	OK
5579	2026-09-24 07:34	73.14	OK	5580	2026-09-24 07:35	73.93	OK
5581	2026-09-24 07:36	71.42	OK	5582	2026-09-24 07:37	74.99	OK
5583	2026-09-24 07:38	75.29	OK	5584	2026-09-24 07:39	74.40	OK
5585	2026-09-24 07:40	72.66	OK	5586	2026-09-24 07:41	74.33	OK
5587	2026-09-24 07:42	74.13	OK	5588	2026-09-24 07:43	74.34	OK
5589	2026-09-24 07:44	73.06	OK	5590	2026-09-24 07:45	72.70	OK
5591	2026-09-24 07:46	72.75	OK	5592	2026-09-24 07:47	75.66	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5593	2026-09-24 07:48	73.87	OK	5594	2026-09-24 07:49	73.06	OK
5595	2026-09-24 07:50	74.12	OK	5596	2026-09-24 07:51	72.43	OK
5597	2026-09-24 07:52	72.57	OK	5598	2026-09-24 07:53	74.27	OK
5599	2026-09-24 07:54	73.65	OK	5600	2026-09-24 07:55	73.84	OK
5601	2026-09-24 07:56	74.42	OK	5602	2026-09-24 07:57	72.04	OK
5603	2026-09-24 07:58	73.57	OK	5604	2026-09-24 07:59	71.85	OK
5605	2026-09-24 08:00	73.37	OK	5606	2026-09-24 08:01	73.75	OK
5607	2026-09-24 08:02	75.44	OK	5608	2026-09-24 08:03	73.62	OK
5609	2026-09-24 08:04	74.78	OK	5610	2026-09-24 08:05	74.06	OK
5611	2026-09-24 08:06	75.02	OK	5612	2026-09-24 08:07	75.23	OK
5613	2026-09-24 08:08	72.98	OK	5614	2026-09-24 08:09	74.75	OK
5615	2026-09-24 08:10	72.49	OK	5616	2026-09-24 08:11	73.85	OK
5617	2026-09-24 08:12	75.05	OK	5618	2026-09-24 08:13	74.79	OK
5619	2026-09-24 08:14	74.82	OK	5620	2026-09-24 08:15	75.24	OK
5621	2026-09-24 08:16	75.76	OK	5622	2026-09-24 08:17	74.31	OK
5623	2026-09-24 08:18	74.68	OK	5624	2026-09-24 08:19	73.49	OK
5625	2026-09-24 08:20	74.57	OK	5626	2026-09-24 08:21	73.90	OK
5627	2026-09-24 08:22	74.24	OK	5628	2026-09-24 08:23	75.41	OK
5629	2026-09-24 08:24	75.78	OK	5630	2026-09-24 08:25	73.73	OK
5631	2026-09-24 08:26	75.56	OK	5632	2026-09-24 08:27	76.37	OK
5633	2026-09-24 08:28	74.61	OK	5634	2026-09-24 08:29	75.89	OK
5635	2026-09-24 08:30	75.45	OK	5636	2026-09-24 08:31	77.50	OK
5637	2026-09-24 08:32	75.91	OK	5638	2026-09-24 08:33	75.78	OK
5639	2026-09-24 08:34	75.25	OK	5640	2026-09-24 08:35	75.32	OK
5641	2026-09-24 08:36	75.45	OK	5642	2026-09-24 08:37	76.16	OK
5643	2026-09-24 08:38	73.84	OK	5644	2026-09-24 08:39	76.04	OK
5645	2026-09-24 08:40	75.66	OK	5646	2026-09-24 08:41	75.16	OK
5647	2026-09-24 08:42	75.82	OK	5648	2026-09-24 08:43	75.53	OK
5649	2026-09-24 08:44	73.65	OK	5650	2026-09-24 08:45	75.56	OK
5651	2026-09-24 08:46	75.05	OK	5652	2026-09-24 08:47	77.13	OK
5653	2026-09-24 08:48	75.82	OK	5654	2026-09-24 08:49	75.05	OK
5655	2026-09-24 08:50	76.15	OK	5656	2026-09-24 08:51	75.07	OK
5657	2026-09-24 08:52	75.96	OK	5658	2026-09-24 08:53	75.21	OK
5659	2026-09-24 08:54	75.92	OK	5660	2026-09-24 08:55	75.50	OK
5661	2026-09-24 08:56	75.38	OK	5662	2026-09-24 08:57	76.27	OK
5663	2026-09-24 08:58	76.87	OK	5664	2026-09-24 08:59	76.86	OK
5665	2026-09-24 09:00	75.33	OK	5666	2026-09-24 09:01	76.02	OK
5667	2026-09-24 09:02	76.05	OK	5668	2026-09-24 09:03	75.75	OK
5669	2026-09-24 09:04	77.63	OK	5670	2026-09-24 09:05	76.01	OK
5671	2026-09-24 09:06	78.52	OK	5672	2026-09-24 09:07	76.73	OK
5673	2026-09-24 09:08	76.78	OK	5674	2026-09-24 09:09	75.89	OK
5675	2026-09-24 09:10	76.06	OK	5676	2026-09-24 09:11	75.39	OK
5677	2026-09-24 09:12	77.17	OK	5678	2026-09-24 09:13	74.71	OK
5679	2026-09-24 09:14	75.28	OK	5680	2026-09-24 09:15	75.48	OK
5681	2026-09-24 09:16	76.60	OK	5682	2026-09-24 09:17	77.63	OK
5683	2026-09-24 09:18	75.66	OK	5684	2026-09-24 09:19	75.01	OK
5685	2026-09-24 09:20	75.17	OK	5686	2026-09-24 09:21	76.12	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5687	2026-09-24 09:22	77.52	OK	5688	2026-09-24 09:23	75.65	OK
5689	2026-09-24 09:24	77.39	OK	5690	2026-09-24 09:25	76.26	OK
5691	2026-09-24 09:26	74.55	OK	5692	2026-09-24 09:27	77.58	OK
5693	2026-09-24 09:28	75.26	OK	5694	2026-09-24 09:29	76.34	OK
5695	2026-09-24 09:30	76.77	OK	5696	2026-09-24 09:31	76.48	OK
5697	2026-09-24 09:32	75.48	OK	5698	2026-09-24 09:33	77.50	OK
5699	2026-09-24 09:34	77.35	OK	5700	2026-09-24 09:35	77.66	OK
5701	2026-09-24 09:36	74.59	OK	5702	2026-09-24 09:37	78.56	OK
5703	2026-09-24 09:38	77.14	OK	5704	2026-09-24 09:39	75.86	OK
5705	2026-09-24 09:40	77.03	OK	5706	2026-09-24 09:41	75.81	OK
5707	2026-09-24 09:42	75.88	OK	5708	2026-09-24 09:43	75.32	OK
5709	2026-09-24 09:44	77.62	OK	5710	2026-09-24 09:45	78.10	OK
5711	2026-09-24 09:46	76.75	OK	5712	2026-09-24 09:47	77.78	OK
5713	2026-09-24 09:48	78.03	OK	5714	2026-09-24 09:49	75.33	OK
5715	2026-09-24 09:50	76.81	OK	5716	2026-09-24 09:51	77.53	OK
5717	2026-09-24 09:52	77.37	OK	5718	2026-09-24 09:53	78.50	OK
5719	2026-09-24 09:54	77.01	OK	5720	2026-09-24 09:55	77.31	OK
5721	2026-09-24 09:56	77.13	OK	5722	2026-09-24 09:57	77.06	OK
5723	2026-09-24 09:58	75.77	OK	5724	2026-09-24 09:59	76.84	OK
5725	2026-09-24 10:00	78.04	OK	5726	2026-09-24 10:01	79.63	OK
5727	2026-09-24 10:02	75.68	OK	5728	2026-09-24 10:03	76.90	OK
5729	2026-09-24 10:04	76.40	OK	5730	2026-09-24 10:05	76.83	OK
5731	2026-09-24 10:06	77.73	OK	5732	2026-09-24 10:07	76.19	OK
5733	2026-09-24 10:08	76.48	OK	5734	2026-09-24 10:09	78.16	OK
5735	2026-09-24 10:10	77.36	OK	5736	2026-09-24 10:11	77.31	OK
5737	2026-09-24 10:12	77.27	OK	5738	2026-09-24 10:13	77.34	OK
5739	2026-09-24 10:14	77.49	OK	5740	2026-09-24 10:15	78.27	OK
5741	2026-09-24 10:16	77.75	OK	5742	2026-09-24 10:17	75.11	OK
5743	2026-09-24 10:18	76.16	OK	5744	2026-09-24 10:19	77.46	OK
5745	2026-09-24 10:20	77.11	OK	5746	2026-09-24 10:21	76.69	OK
5747	2026-09-24 10:22	78.25	OK	5748	2026-09-24 10:23	78.12	OK
5749	2026-09-24 10:24	79.44	OK	5750	2026-09-24 10:25	77.48	OK
5751	2026-09-24 10:26	76.86	OK	5752	2026-09-24 10:27	76.93	OK
5753	2026-09-24 10:28	75.49	OK	5754	2026-09-24 10:29	77.32	OK
5755	2026-09-24 10:30	77.89	OK	5756	2026-09-24 10:31	80.28	OK
5757	2026-09-24 10:32	77.51	OK	5758	2026-09-24 10:33	77.38	OK
5759	2026-09-24 10:34	78.34	OK	5760	2026-09-24 10:35	76.80	OK

Signal: Winding_Temp_W (°C)

All 5,760 Raw Readings

Operating Limits: [10.0 to 130.0] • Observed: Min 63.76, Max 86.23, Mean 74.73

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1	2026-09-20 10:36	69.33	OK	2	2026-09-20 10:37	69.93	OK
3	2026-09-20 10:38	70.32	OK	4	2026-09-20 10:39	69.38	OK
5	2026-09-20 10:40	72.55	OK	6	2026-09-20 10:41	72.23	OK
7	2026-09-20 10:42	71.99	OK	8	2026-09-20 10:43	69.50	OK
9	2026-09-20 10:44	68.32	OK	10	2026-09-20 10:45	73.70	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
11	2026-09-20 10:46	68.24	OK	12	2026-09-20 10:47	72.42	OK
13	2026-09-20 10:48	70.53	OK	14	2026-09-20 10:49	71.32	OK
15	2026-09-20 10:50	72.43	OK	16	2026-09-20 10:51	71.79	OK
17	2026-09-20 10:52	71.69	OK	18	2026-09-20 10:53	71.23	OK
19	2026-09-20 10:54	70.22	OK	20	2026-09-20 10:55	69.63	OK
21	2026-09-20 10:56	73.63	OK	22	2026-09-20 10:57	70.47	OK
23	2026-09-20 10:58	71.37	OK	24	2026-09-20 10:59	73.25	OK
25	2026-09-20 11:00	72.33	OK	26	2026-09-20 11:01	70.18	OK
27	2026-09-20 11:02	72.73	OK	28	2026-09-20 11:03	70.53	OK
29	2026-09-20 11:04	69.76	OK	30	2026-09-20 11:05	72.36	OK
31	2026-09-20 11:06	74.45	OK	32	2026-09-20 11:07	70.21	OK
33	2026-09-20 11:08	70.49	OK	34	2026-09-20 11:09	71.58	OK
35	2026-09-20 11:10	71.08	OK	36	2026-09-20 11:11	69.26	OK
37	2026-09-20 11:12	72.47	OK	38	2026-09-20 11:13	72.80	OK
39	2026-09-20 11:14	71.84	OK	40	2026-09-20 11:15	76.48	OK
41	2026-09-20 11:16	73.79	OK	42	2026-09-20 11:17	72.38	OK
43	2026-09-20 11:18	68.91	OK	44	2026-09-20 11:19	73.66	OK
45	2026-09-20 11:20	72.14	OK	46	2026-09-20 11:21	71.14	OK
47	2026-09-20 11:22	74.39	OK	48	2026-09-20 11:23	74.30	OK
49	2026-09-20 11:24	73.08	OK	50	2026-09-20 11:25	72.92	OK
51	2026-09-20 11:26	72.41	OK	52	2026-09-20 11:27	72.85	OK
53	2026-09-20 11:28	71.35	OK	54	2026-09-20 11:29	72.88	OK
55	2026-09-20 11:30	73.09	OK	56	2026-09-20 11:31	71.54	OK
57	2026-09-20 11:32	74.54	OK	58	2026-09-20 11:33	70.48	OK
59	2026-09-20 11:34	73.37	OK	60	2026-09-20 11:35	76.47	OK
61	2026-09-20 11:36	73.36	OK	62	2026-09-20 11:37	72.81	OK
63	2026-09-20 11:38	75.15	OK	64	2026-09-20 11:39	73.19	OK
65	2026-09-20 11:40	72.87	OK	66	2026-09-20 11:41	73.00	OK
67	2026-09-20 11:42	74.18	OK	68	2026-09-20 11:43	73.43	OK
69	2026-09-20 11:44	73.40	OK	70	2026-09-20 11:45	73.22	OK
71	2026-09-20 11:46	73.00	OK	72	2026-09-20 11:47	76.29	OK
73	2026-09-20 11:48	73.08	OK	74	2026-09-20 11:49	75.54	OK
75	2026-09-20 11:50	72.44	OK	76	2026-09-20 11:51	73.36	OK
77	2026-09-20 11:52	73.19	OK	78	2026-09-20 11:53	71.15	OK
79	2026-09-20 11:54	76.10	OK	80	2026-09-20 11:55	74.16	OK
81	2026-09-20 11:56	72.63	OK	82	2026-09-20 11:57	74.49	OK
83	2026-09-20 11:58	74.14	OK	84	2026-09-20 11:59	73.41	OK
85	2026-09-20 12:00	74.60	OK	86	2026-09-20 12:01	78.03	OK
87	2026-09-20 12:02	76.08	OK	88	2026-09-20 12:03	77.86	OK
89	2026-09-20 12:04	74.71	OK	90	2026-09-20 12:05	73.45	OK
91	2026-09-20 12:06	75.03	OK	92	2026-09-20 12:07	77.23	OK
93	2026-09-20 12:08	75.34	OK	94	2026-09-20 12:09	73.17	OK
95	2026-09-20 12:10	73.43	OK	96	2026-09-20 12:11	75.80	OK
97	2026-09-20 12:12	71.76	OK	98	2026-09-20 12:13	74.30	OK
99	2026-09-20 12:14	75.77	OK	100	2026-09-20 12:15	73.25	OK
101	2026-09-20 12:16	75.30	OK	102	2026-09-20 12:17	74.54	OK
103	2026-09-20 12:18	74.07	OK	104	2026-09-20 12:19	72.10	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
105	2026-09-20 12:20	70.21	OK	106	2026-09-20 12:21	74.78	OK
107	2026-09-20 12:22	72.15	OK	108	2026-09-20 12:23	75.90	OK
109	2026-09-20 12:24	74.10	OK	110	2026-09-20 12:25	71.06	OK
111	2026-09-20 12:26	74.66	OK	112	2026-09-20 12:27	76.04	OK
113	2026-09-20 12:28	77.72	OK	114	2026-09-20 12:29	73.53	OK
115	2026-09-20 12:30	74.07	OK	116	2026-09-20 12:31	75.56	OK
117	2026-09-20 12:32	72.65	OK	118	2026-09-20 12:33	73.46	OK
119	2026-09-20 12:34	76.15	OK	120	2026-09-20 12:35	72.65	OK
121	2026-09-20 12:36	77.66	OK	122	2026-09-20 12:37	78.60	OK
123	2026-09-20 12:38	75.00	OK	124	2026-09-20 12:39	75.89	OK
125	2026-09-20 12:40	74.38	OK	126	2026-09-20 12:41	72.32	OK
127	2026-09-20 12:42	74.11	OK	128	2026-09-20 12:43	74.24	OK
129	2026-09-20 12:44	77.94	OK	130	2026-09-20 12:45	75.94	OK
131	2026-09-20 12:46	75.44	OK	132	2026-09-20 12:47	73.85	OK
133	2026-09-20 12:48	77.04	OK	134	2026-09-20 12:49	73.18	OK
135	2026-09-20 12:50	73.93	OK	136	2026-09-20 12:51	77.48	OK
137	2026-09-20 12:52	74.36	OK	138	2026-09-20 12:53	78.00	OK
139	2026-09-20 12:54	75.79	OK	140	2026-09-20 12:55	75.97	OK
141	2026-09-20 12:56	71.73	OK	142	2026-09-20 12:57	74.48	OK
143	2026-09-20 12:58	77.42	OK	144	2026-09-20 12:59	73.10	OK
145	2026-09-20 13:00	72.70	OK	146	2026-09-20 13:01	76.97	OK
147	2026-09-20 13:02	74.94	OK	148	2026-09-20 13:03	76.86	OK
149	2026-09-20 13:04	76.41	OK	150	2026-09-20 13:05	76.35	OK
151	2026-09-20 13:06	76.08	OK	152	2026-09-20 13:07	77.36	OK
153	2026-09-20 13:08	76.42	OK	154	2026-09-20 13:09	73.81	OK
155	2026-09-20 13:10	72.51	OK	156	2026-09-20 13:11	74.30	OK
157	2026-09-20 13:12	75.76	OK	158	2026-09-20 13:13	74.01	OK
159	2026-09-20 13:14	76.79	OK	160	2026-09-20 13:15	77.96	OK
161	2026-09-20 13:16	74.22	OK	162	2026-09-20 13:17	76.94	OK
163	2026-09-20 13:18	72.69	OK	164	2026-09-20 13:19	73.33	OK
165	2026-09-20 13:20	77.22	OK	166	2026-09-20 13:21	77.15	OK
167	2026-09-20 13:22	76.14	OK	168	2026-09-20 13:23	75.94	OK
169	2026-09-20 13:24	76.47	OK	170	2026-09-20 13:25	76.69	OK
171	2026-09-20 13:26	74.13	OK	172	2026-09-20 13:27	78.42	OK
173	2026-09-20 13:28	77.34	OK	174	2026-09-20 13:29	75.54	OK
175	2026-09-20 13:30	75.41	OK	176	2026-09-20 13:31	80.80	OK
177	2026-09-20 13:32	75.59	OK	178	2026-09-20 13:33	78.47	OK
179	2026-09-20 13:34	75.29	OK	180	2026-09-20 13:35	77.28	OK
181	2026-09-20 13:36	75.62	OK	182	2026-09-20 13:37	77.79	OK
183	2026-09-20 13:38	76.09	OK	184	2026-09-20 13:39	74.33	OK
185	2026-09-20 13:40	75.46	OK	186	2026-09-20 13:41	76.41	OK
187	2026-09-20 13:42	74.70	OK	188	2026-09-20 13:43	74.69	OK
189	2026-09-20 13:44	77.72	OK	190	2026-09-20 13:45	78.17	OK
191	2026-09-20 13:46	78.38	OK	192	2026-09-20 13:47	78.29	OK
193	2026-09-20 13:48	75.17	OK	194	2026-09-20 13:49	77.91	OK
195	2026-09-20 13:50	79.58	OK	196	2026-09-20 13:51	75.90	OK
197	2026-09-20 13:52	74.88	OK	198	2026-09-20 13:53	74.68	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
199	2026-09-20 13:54	78.70	OK	200	2026-09-20 13:55	75.32	OK
201	2026-09-20 13:56	79.35	OK	202	2026-09-20 13:57	77.34	OK
203	2026-09-20 13:58	77.08	OK	204	2026-09-20 13:59	74.96	OK
205	2026-09-20 14:00	79.96	OK	206	2026-09-20 14:01	79.18	OK
207	2026-09-20 14:02	75.13	OK	208	2026-09-20 14:03	75.76	OK
209	2026-09-20 14:04	76.56	OK	210	2026-09-20 14:05	75.86	OK
211	2026-09-20 14:06	80.16	OK	212	2026-09-20 14:07	78.45	OK
213	2026-09-20 14:08	79.64	OK	214	2026-09-20 14:09	74.45	OK
215	2026-09-20 14:10	78.93	OK	216	2026-09-20 14:11	79.40	OK
217	2026-09-20 14:12	75.66	OK	218	2026-09-20 14:13	74.76	OK
219	2026-09-20 14:14	77.87	OK	220	2026-09-20 14:15	78.57	OK
221	2026-09-20 14:16	78.15	OK	222	2026-09-20 14:17	77.01	OK
223	2026-09-20 14:18	80.60	OK	224	2026-09-20 14:19	77.48	OK
225	2026-09-20 14:20	77.58	OK	226	2026-09-20 14:21	76.25	OK
227	2026-09-20 14:22	79.49	OK	228	2026-09-20 14:23	76.93	OK
229	2026-09-20 14:24	76.06	OK	230	2026-09-20 14:25	79.05	OK
231	2026-09-20 14:26	80.11	OK	232	2026-09-20 14:27	79.69	OK
233	2026-09-20 14:28	79.91	OK	234	2026-09-20 14:29	74.59	OK
235	2026-09-20 14:30	77.22	OK	236	2026-09-20 14:31	80.11	OK
237	2026-09-20 14:32	80.62	OK	238	2026-09-20 14:33	79.20	OK
239	2026-09-20 14:34	81.71	OK	240	2026-09-20 14:35	77.93	OK
241	2026-09-20 14:36	81.27	OK	242	2026-09-20 14:37	79.28	OK
243	2026-09-20 14:38	78.16	OK	244	2026-09-20 14:39	79.35	OK
245	2026-09-20 14:40	76.46	OK	246	2026-09-20 14:41	77.80	OK
247	2026-09-20 14:42	78.01	OK	248	2026-09-20 14:43	80.27	OK
249	2026-09-20 14:44	79.38	OK	250	2026-09-20 14:45	80.36	OK
251	2026-09-20 14:46	78.59	OK	252	2026-09-20 14:47	77.80	OK
253	2026-09-20 14:48	78.33	OK	254	2026-09-20 14:49	82.83	OK
255	2026-09-20 14:50	77.60	OK	256	2026-09-20 14:51	79.09	OK
257	2026-09-20 14:52	80.50	OK	258	2026-09-20 14:53	82.15	OK
259	2026-09-20 14:54	78.75	OK	260	2026-09-20 14:55	80.71	OK
261	2026-09-20 14:56	79.70	OK	262	2026-09-20 14:57	78.73	OK
263	2026-09-20 14:58	77.52	OK	264	2026-09-20 14:59	80.58	OK
265	2026-09-20 15:00	80.01	OK	266	2026-09-20 15:01	80.21	OK
267	2026-09-20 15:02	79.31	OK	268	2026-09-20 15:03	80.62	OK
269	2026-09-20 15:04	77.59	OK	270	2026-09-20 15:05	80.31	OK
271	2026-09-20 15:06	79.26	OK	272	2026-09-20 15:07	78.01	OK
273	2026-09-20 15:08	76.66	OK	274	2026-09-20 15:09	77.29	OK
275	2026-09-20 15:10	80.83	OK	276	2026-09-20 15:11	79.28	OK
277	2026-09-20 15:12	75.34	OK	278	2026-09-20 15:13	80.09	OK
279	2026-09-20 15:14	78.01	OK	280	2026-09-20 15:15	76.95	OK
281	2026-09-20 15:16	80.28	OK	282	2026-09-20 15:17	77.09	OK
283	2026-09-20 15:18	80.61	OK	284	2026-09-20 15:19	83.31	OK
285	2026-09-20 15:20	76.82	OK	286	2026-09-20 15:21	77.32	OK
287	2026-09-20 15:22	81.80	OK	288	2026-09-20 15:23	78.78	OK
289	2026-09-20 15:24	79.29	OK	290	2026-09-20 15:25	81.52	OK
291	2026-09-20 15:26	79.47	OK	292	2026-09-20 15:27	81.80	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
293	2026-09-20 15:28	80.77	OK	294	2026-09-20 15:29	81.56	OK
295	2026-09-20 15:30	78.68	OK	296	2026-09-20 15:31	80.41	OK
297	2026-09-20 15:32	84.21	OK	298	2026-09-20 15:33	79.48	OK
299	2026-09-20 15:34	79.45	OK	300	2026-09-20 15:35	81.77	OK
301	2026-09-20 15:36	80.72	OK	302	2026-09-20 15:37	81.37	OK
303	2026-09-20 15:38	79.74	OK	304	2026-09-20 15:39	79.54	OK
305	2026-09-20 15:40	79.28	OK	306	2026-09-20 15:41	80.42	OK
307	2026-09-20 15:42	77.81	OK	308	2026-09-20 15:43	81.58	OK
309	2026-09-20 15:44	79.30	OK	310	2026-09-20 15:45	77.94	OK
311	2026-09-20 15:46	79.77	OK	312	2026-09-20 15:47	78.61	OK
313	2026-09-20 15:48	80.49	OK	314	2026-09-20 15:49	80.85	OK
315	2026-09-20 15:50	80.33	OK	316	2026-09-20 15:51	80.06	OK
317	2026-09-20 15:52	77.63	OK	318	2026-09-20 15:53	79.49	OK
319	2026-09-20 15:54	82.80	OK	320	2026-09-20 15:55	76.82	OK
321	2026-09-20 15:56	83.27	OK	322	2026-09-20 15:57	81.52	OK
323	2026-09-20 15:58	80.23	OK	324	2026-09-20 15:59	79.16	OK
325	2026-09-20 16:00	81.60	OK	326	2026-09-20 16:01	80.44	OK
327	2026-09-20 16:02	82.47	OK	328	2026-09-20 16:03	81.44	OK
329	2026-09-20 16:04	76.99	OK	330	2026-09-20 16:05	80.23	OK
331	2026-09-20 16:06	81.03	OK	332	2026-09-20 16:07	80.04	OK
333	2026-09-20 16:08	80.14	OK	334	2026-09-20 16:09	79.85	OK
335	2026-09-20 16:10	80.65	OK	336	2026-09-20 16:11	80.56	OK
337	2026-09-20 16:12	80.42	OK	338	2026-09-20 16:13	80.88	OK
339	2026-09-20 16:14	80.01	OK	340	2026-09-20 16:15	83.00	OK
341	2026-09-20 16:16	81.24	OK	342	2026-09-20 16:17	81.84	OK
343	2026-09-20 16:18	77.74	OK	344	2026-09-20 16:19	79.37	OK
345	2026-09-20 16:20	80.33	OK	346	2026-09-20 16:21	81.25	OK
347	2026-09-20 16:22	81.34	OK	348	2026-09-20 16:23	79.70	OK
349	2026-09-20 16:24	82.65	OK	350	2026-09-20 16:25	82.76	OK
351	2026-09-20 16:26	82.06	OK	352	2026-09-20 16:27	77.77	OK
353	2026-09-20 16:28	79.24	OK	354	2026-09-20 16:29	80.44	OK
355	2026-09-20 16:30	77.55	OK	356	2026-09-20 16:31	81.44	OK
357	2026-09-20 16:32	80.74	OK	358	2026-09-20 16:33	80.67	OK
359	2026-09-20 16:34	78.11	OK	360	2026-09-20 16:35	81.83	OK
361	2026-09-20 16:36	81.72	OK	362	2026-09-20 16:37	80.25	OK
363	2026-09-20 16:38	78.12	OK	364	2026-09-20 16:39	80.40	OK
365	2026-09-20 16:40	80.84	OK	366	2026-09-20 16:41	81.21	OK
367	2026-09-20 16:42	83.82	OK	368	2026-09-20 16:43	84.76	OK
369	2026-09-20 16:44	80.74	OK	370	2026-09-20 16:45	81.08	OK
371	2026-09-20 16:46	78.63	OK	372	2026-09-20 16:47	81.22	OK
373	2026-09-20 16:48	80.33	OK	374	2026-09-20 16:49	78.75	OK
375	2026-09-20 16:50	80.62	OK	376	2026-09-20 16:51	85.18	OK
377	2026-09-20 16:52	83.96	OK	378	2026-09-20 16:53	81.31	OK
379	2026-09-20 16:54	81.57	OK	380	2026-09-20 16:55	81.37	OK
381	2026-09-20 16:56	79.22	OK	382	2026-09-20 16:57	80.02	OK
383	2026-09-20 16:58	77.69	OK	384	2026-09-20 16:59	80.96	OK
385	2026-09-20 17:00	82.64	OK	386	2026-09-20 17:01	82.22	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
387	2026-09-20 17:02	79.84	OK	388	2026-09-20 17:03	79.11	OK
389	2026-09-20 17:04	80.95	OK	390	2026-09-20 17:05	83.24	OK
391	2026-09-20 17:06	81.02	OK	392	2026-09-20 17:07	78.92	OK
393	2026-09-20 17:08	82.83	OK	394	2026-09-20 17:09	80.32	OK
395	2026-09-20 17:10	81.73	OK	396	2026-09-20 17:11	81.67	OK
397	2026-09-20 17:12	82.42	OK	398	2026-09-20 17:13	84.19	OK
399	2026-09-20 17:14	84.28	OK	400	2026-09-20 17:15	80.05	OK
401	2026-09-20 17:16	77.32	OK	402	2026-09-20 17:17	83.72	OK
403	2026-09-20 17:18	81.20	OK	404	2026-09-20 17:19	79.36	OK
405	2026-09-20 17:20	81.54	OK	406	2026-09-20 17:21	84.53	OK
407	2026-09-20 17:22	77.22	OK	408	2026-09-20 17:23	82.83	OK
409	2026-09-20 17:24	83.33	OK	410	2026-09-20 17:25	79.15	OK
411	2026-09-20 17:26	80.84	OK	412	2026-09-20 17:27	82.58	OK
413	2026-09-20 17:28	82.53	OK	414	2026-09-20 17:29	80.85	OK
415	2026-09-20 17:30	81.24	OK	416	2026-09-20 17:31	82.70	OK
417	2026-09-20 17:32	81.44	OK	418	2026-09-20 17:33	84.27	OK
419	2026-09-20 17:34	78.59	OK	420	2026-09-20 17:35	83.89	OK
421	2026-09-20 17:36	82.37	OK	422	2026-09-20 17:37	80.06	OK
423	2026-09-20 17:38	82.66	OK	424	2026-09-20 17:39	83.41	OK
425	2026-09-20 17:40	81.59	OK	426	2026-09-20 17:41	79.65	OK
427	2026-09-20 17:42	83.32	OK	428	2026-09-20 17:43	82.15	OK
429	2026-09-20 17:44	82.14	OK	430	2026-09-20 17:45	82.05	OK
431	2026-09-20 17:46	79.65	OK	432	2026-09-20 17:47	84.19	OK
433	2026-09-20 17:48	81.39	OK	434	2026-09-20 17:49	78.22	OK
435	2026-09-20 17:50	79.85	OK	436	2026-09-20 17:51	81.49	OK
437	2026-09-20 17:52	80.21	OK	438	2026-09-20 17:53	82.09	OK
439	2026-09-20 17:54	80.18	OK	440	2026-09-20 17:55	79.87	OK
441	2026-09-20 17:56	82.22	OK	442	2026-09-20 17:57	81.62	OK
443	2026-09-20 17:58	81.60	OK	444	2026-09-20 17:59	81.32	OK
445	2026-09-20 18:00	81.68	OK	446	2026-09-20 18:01	81.57	OK
447	2026-09-20 18:02	81.99	OK	448	2026-09-20 18:03	81.21	OK
449	2026-09-20 18:04	85.29	OK	450	2026-09-20 18:05	83.01	OK
451	2026-09-20 18:06	84.59	OK	452	2026-09-20 18:07	80.01	OK
453	2026-09-20 18:08	79.00	OK	454	2026-09-20 18:09	80.62	OK
455	2026-09-20 18:10	79.48	OK	456	2026-09-20 18:11	85.19	OK
457	2026-09-20 18:12	82.74	OK	458	2026-09-20 18:13	81.08	OK
459	2026-09-20 18:14	81.38	OK	460	2026-09-20 18:15	77.79	OK
461	2026-09-20 18:16	80.94	OK	462	2026-09-20 18:17	84.32	OK
463	2026-09-20 18:18	81.34	OK	464	2026-09-20 18:19	81.69	OK
465	2026-09-20 18:20	83.72	OK	466	2026-09-20 18:21	79.28	OK
467	2026-09-20 18:22	81.65	OK	468	2026-09-20 18:23	80.20	OK
469	2026-09-20 18:24	81.42	OK	470	2026-09-20 18:25	83.33	OK
471	2026-09-20 18:26	83.32	OK	472	2026-09-20 18:27	81.40	OK
473	2026-09-20 18:28	81.40	OK	474	2026-09-20 18:29	81.37	OK
475	2026-09-20 18:30	84.09	OK	476	2026-09-20 18:31	82.10	OK
477	2026-09-20 18:32	81.70	OK	478	2026-09-20 18:33	82.11	OK
479	2026-09-20 18:34	83.48	OK	480	2026-09-20 18:35	78.40	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
481	2026-09-20 18:36	81.19	OK	482	2026-09-20 18:37	84.10	OK
483	2026-09-20 18:38	77.91	OK	484	2026-09-20 18:39	79.54	OK
485	2026-09-20 18:40	83.50	OK	486	2026-09-20 18:41	82.63	OK
487	2026-09-20 18:42	79.01	OK	488	2026-09-20 18:43	82.18	OK
489	2026-09-20 18:44	80.47	OK	490	2026-09-20 18:45	83.54	OK
491	2026-09-20 18:46	80.74	OK	492	2026-09-20 18:47	81.79	OK
493	2026-09-20 18:48	81.47	OK	494	2026-09-20 18:49	83.45	OK
495	2026-09-20 18:50	79.33	OK	496	2026-09-20 18:51	80.69	OK
497	2026-09-20 18:52	81.59	OK	498	2026-09-20 18:53	82.83	OK
499	2026-09-20 18:54	78.78	OK	500	2026-09-20 18:55	77.78	OK
501	2026-09-20 18:56	81.27	OK	502	2026-09-20 18:57	83.48	OK
503	2026-09-20 18:58	78.91	OK	504	2026-09-20 18:59	83.58	OK
505	2026-09-20 19:00	81.54	OK	506	2026-09-20 19:01	84.78	OK
507	2026-09-20 19:02	78.76	OK	508	2026-09-20 19:03	79.96	OK
509	2026-09-20 19:04	79.05	OK	510	2026-09-20 19:05	79.40	OK
511	2026-09-20 19:06	84.29	OK	512	2026-09-20 19:07	82.26	OK
513	2026-09-20 19:08	81.95	OK	514	2026-09-20 19:09	84.17	OK
515	2026-09-20 19:10	79.81	OK	516	2026-09-20 19:11	80.88	OK
517	2026-09-20 19:12	80.25	OK	518	2026-09-20 19:13	82.06	OK
519	2026-09-20 19:14	81.11	OK	520	2026-09-20 19:15	78.77	OK
521	2026-09-20 19:16	80.57	OK	522	2026-09-20 19:17	80.89	OK
523	2026-09-20 19:18	79.27	OK	524	2026-09-20 19:19	82.31	OK
525	2026-09-20 19:20	80.90	OK	526	2026-09-20 19:21	80.69	OK
527	2026-09-20 19:22	82.48	OK	528	2026-09-20 19:23	81.83	OK
529	2026-09-20 19:24	79.58	OK	530	2026-09-20 19:25	82.35	OK
531	2026-09-20 19:26	81.80	OK	532	2026-09-20 19:27	84.35	OK
533	2026-09-20 19:28	81.55	OK	534	2026-09-20 19:29	78.65	OK
535	2026-09-20 19:30	83.54	OK	536	2026-09-20 19:31	85.47	OK
537	2026-09-20 19:32	82.03	OK	538	2026-09-20 19:33	81.34	OK
539	2026-09-20 19:34	81.02	OK	540	2026-09-20 19:35	81.49	OK
541	2026-09-20 19:36	80.36	OK	542	2026-09-20 19:37	80.96	OK
543	2026-09-20 19:38	82.29	OK	544	2026-09-20 19:39	80.15	OK
545	2026-09-20 19:40	85.14	OK	546	2026-09-20 19:41	78.43	OK
547	2026-09-20 19:42	79.74	OK	548	2026-09-20 19:43	83.57	OK
549	2026-09-20 19:44	80.51	OK	550	2026-09-20 19:45	80.96	OK
551	2026-09-20 19:46	79.16	OK	552	2026-09-20 19:47	83.18	OK
553	2026-09-20 19:48	81.14	OK	554	2026-09-20 19:49	83.57	OK
555	2026-09-20 19:50	79.54	OK	556	2026-09-20 19:51	82.97	OK
557	2026-09-20 19:52	83.48	OK	558	2026-09-20 19:53	77.35	OK
559	2026-09-20 19:54	83.12	OK	560	2026-09-20 19:55	82.85	OK
561	2026-09-20 19:56	82.19	OK	562	2026-09-20 19:57	80.88	OK
563	2026-09-20 19:58	82.12	OK	564	2026-09-20 19:59	82.54	OK
565	2026-09-20 20:00	79.64	OK	566	2026-09-20 20:01	78.16	OK
567	2026-09-20 20:02	82.73	OK	568	2026-09-20 20:03	80.80	OK
569	2026-09-20 20:04	81.38	OK	570	2026-09-20 20:05	83.13	OK
571	2026-09-20 20:06	83.39	OK	572	2026-09-20 20:07	82.56	OK
573	2026-09-20 20:08	84.33	OK	574	2026-09-20 20:09	80.13	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
575	2026-09-20 20:10	79.38	OK	576	2026-09-20 20:11	79.69	OK
577	2026-09-20 20:12	84.60	OK	578	2026-09-20 20:13	81.37	OK
579	2026-09-20 20:14	78.87	OK	580	2026-09-20 20:15	82.49	OK
581	2026-09-20 20:16	82.09	OK	582	2026-09-20 20:17	79.77	OK
583	2026-09-20 20:18	81.44	OK	584	2026-09-20 20:19	83.16	OK
585	2026-09-20 20:20	80.42	OK	586	2026-09-20 20:21	84.36	OK
587	2026-09-20 20:22	82.40	OK	588	2026-09-20 20:23	79.50	OK
589	2026-09-20 20:24	81.21	OK	590	2026-09-20 20:25	82.57	OK
591	2026-09-20 20:26	80.45	OK	592	2026-09-20 20:27	81.24	OK
593	2026-09-20 20:28	84.09	OK	594	2026-09-20 20:29	78.97	OK
595	2026-09-20 20:30	82.96	OK	596	2026-09-20 20:31	83.92	OK
597	2026-09-20 20:32	79.80	OK	598	2026-09-20 20:33	80.03	OK
599	2026-09-20 20:34	79.19	OK	600	2026-09-20 20:35	78.77	OK
601	2026-09-20 20:36	78.33	OK	602	2026-09-20 20:37	82.22	OK
603	2026-09-20 20:38	81.07	OK	604	2026-09-20 20:39	80.25	OK
605	2026-09-20 20:40	82.97	OK	606	2026-09-20 20:41	77.94	OK
607	2026-09-20 20:42	78.85	OK	608	2026-09-20 20:43	82.37	OK
609	2026-09-20 20:44	80.44	OK	610	2026-09-20 20:45	80.25	OK
611	2026-09-20 20:46	80.73	OK	612	2026-09-20 20:47	81.74	OK
613	2026-09-20 20:48	80.66	OK	614	2026-09-20 20:49	81.08	OK
615	2026-09-20 20:50	78.62	OK	616	2026-09-20 20:51	80.14	OK
617	2026-09-20 20:52	80.15	OK	618	2026-09-20 20:53	80.60	OK
619	2026-09-20 20:54	79.67	OK	620	2026-09-20 20:55	79.22	OK
621	2026-09-20 20:56	81.43	OK	622	2026-09-20 20:57	83.64	OK
623	2026-09-20 20:58	80.89	OK	624	2026-09-20 20:59	78.75	OK
625	2026-09-20 21:00	78.94	OK	626	2026-09-20 21:01	79.29	OK
627	2026-09-20 21:02	80.15	OK	628	2026-09-20 21:03	78.64	OK
629	2026-09-20 21:04	77.66	OK	630	2026-09-20 21:05	76.22	OK
631	2026-09-20 21:06	79.96	OK	632	2026-09-20 21:07	78.28	OK
633	2026-09-20 21:08	80.49	OK	634	2026-09-20 21:09	79.59	OK
635	2026-09-20 21:10	78.37	OK	636	2026-09-20 21:11	78.80	OK
637	2026-09-20 21:12	80.68	OK	638	2026-09-20 21:13	82.92	OK
639	2026-09-20 21:14	80.34	OK	640	2026-09-20 21:15	79.86	OK
641	2026-09-20 21:16	79.54	OK	642	2026-09-20 21:17	80.06	OK
643	2026-09-20 21:18	80.53	OK	644	2026-09-20 21:19	76.25	OK
645	2026-09-20 21:20	80.92	OK	646	2026-09-20 21:21	80.64	OK
647	2026-09-20 21:22	79.23	OK	648	2026-09-20 21:23	77.86	OK
649	2026-09-20 21:24	83.66	OK	650	2026-09-20 21:25	80.96	OK
651	2026-09-20 21:26	83.14	OK	652	2026-09-20 21:27	81.13	OK
653	2026-09-20 21:28	77.99	OK	654	2026-09-20 21:29	81.72	OK
655	2026-09-20 21:30	81.36	OK	656	2026-09-20 21:31	78.69	OK
657	2026-09-20 21:32	79.49	OK	658	2026-09-20 21:33	77.82	OK
659	2026-09-20 21:34	78.78	OK	660	2026-09-20 21:35	79.30	OK
661	2026-09-20 21:36	80.30	OK	662	2026-09-20 21:37	80.48	OK
663	2026-09-20 21:38	80.85	OK	664	2026-09-20 21:39	79.08	OK
665	2026-09-20 21:40	77.39	OK	666	2026-09-20 21:41	79.73	OK
667	2026-09-20 21:42	77.49	OK	668	2026-09-20 21:43	78.57	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
669	2026-09-20 21:44	79.02	OK	670	2026-09-20 21:45	78.90	OK
671	2026-09-20 21:46	80.31	OK	672	2026-09-20 21:47	78.41	OK
673	2026-09-20 21:48	78.40	OK	674	2026-09-20 21:49	82.26	OK
675	2026-09-20 21:50	79.97	OK	676	2026-09-20 21:51	77.50	OK
677	2026-09-20 21:52	79.43	OK	678	2026-09-20 21:53	76.43	OK
679	2026-09-20 21:54	78.98	OK	680	2026-09-20 21:55	78.93	OK
681	2026-09-20 21:56	81.77	OK	682	2026-09-20 21:57	78.21	OK
683	2026-09-20 21:58	78.69	OK	684	2026-09-20 21:59	77.05	OK
685	2026-09-20 22:00	79.66	OK	686	2026-09-20 22:01	79.11	OK
687	2026-09-20 22:02	79.23	OK	688	2026-09-20 22:03	78.19	OK
689	2026-09-20 22:04	78.08	OK	690	2026-09-20 22:05	77.03	OK
691	2026-09-20 22:06	78.38	OK	692	2026-09-20 22:07	78.80	OK
693	2026-09-20 22:08	79.97	OK	694	2026-09-20 22:09	79.68	OK
695	2026-09-20 22:10	79.46	OK	696	2026-09-20 22:11	77.83	OK
697	2026-09-20 22:12	83.00	OK	698	2026-09-20 22:13	80.81	OK
699	2026-09-20 22:14	77.18	OK	700	2026-09-20 22:15	79.06	OK
701	2026-09-20 22:16	77.18	OK	702	2026-09-20 22:17	81.58	OK
703	2026-09-20 22:18	78.65	OK	704	2026-09-20 22:19	77.84	OK
705	2026-09-20 22:20	75.20	OK	706	2026-09-20 22:21	79.73	OK
707	2026-09-20 22:22	79.75	OK	708	2026-09-20 22:23	79.26	OK
709	2026-09-20 22:24	77.30	OK	710	2026-09-20 22:25	76.38	OK
711	2026-09-20 22:26	78.97	OK	712	2026-09-20 22:27	80.94	OK
713	2026-09-20 22:28	82.18	OK	714	2026-09-20 22:29	78.18	OK
715	2026-09-20 22:30	75.82	OK	716	2026-09-20 22:31	78.78	OK
717	2026-09-20 22:32	75.45	OK	718	2026-09-20 22:33	81.40	OK
719	2026-09-20 22:34	75.18	OK	720	2026-09-20 22:35	79.14	OK
721	2026-09-20 22:36	76.34	OK	722	2026-09-20 22:37	80.88	OK
723	2026-09-20 22:38	77.01	OK	724	2026-09-20 22:39	80.06	OK
725	2026-09-20 22:40	78.47	OK	726	2026-09-20 22:41	77.16	OK
727	2026-09-20 22:42	78.85	OK	728	2026-09-20 22:43	76.19	OK
729	2026-09-20 22:44	80.70	OK	730	2026-09-20 22:45	74.42	OK
731	2026-09-20 22:46	77.63	OK	732	2026-09-20 22:47	75.70	OK
733	2026-09-20 22:48	76.08	OK	734	2026-09-20 22:49	81.41	OK
735	2026-09-20 22:50	79.79	OK	736	2026-09-20 22:51	79.16	OK
737	2026-09-20 22:52	76.55	OK	738	2026-09-20 22:53	78.25	OK
739	2026-09-20 22:54	75.95	OK	740	2026-09-20 22:55	77.42	OK
741	2026-09-20 22:56	80.63	OK	742	2026-09-20 22:57	77.37	OK
743	2026-09-20 22:58	77.43	OK	744	2026-09-20 22:59	77.23	OK
745	2026-09-20 23:00	77.88	OK	746	2026-09-20 23:01	74.71	OK
747	2026-09-20 23:02	78.40	OK	748	2026-09-20 23:03	77.58	OK
749	2026-09-20 23:04	78.36	OK	750	2026-09-20 23:05	75.93	OK
751	2026-09-20 23:06	74.92	OK	752	2026-09-20 23:07	76.15	OK
753	2026-09-20 23:08	79.09	OK	754	2026-09-20 23:09	75.05	OK
755	2026-09-20 23:10	77.30	OK	756	2026-09-20 23:11	78.17	OK
757	2026-09-20 23:12	78.70	OK	758	2026-09-20 23:13	80.22	OK
759	2026-09-20 23:14	76.47	OK	760	2026-09-20 23:15	79.06	OK
761	2026-09-20 23:16	77.55	OK	762	2026-09-20 23:17	81.08	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
763	2026-09-20 23:18	74.22	OK	764	2026-09-20 23:19	79.42	OK
765	2026-09-20 23:20	76.70	OK	766	2026-09-20 23:21	76.63	OK
767	2026-09-20 23:22	76.87	OK	768	2026-09-20 23:23	76.57	OK
769	2026-09-20 23:24	75.42	OK	770	2026-09-20 23:25	74.12	OK
771	2026-09-20 23:26	76.26	OK	772	2026-09-20 23:27	77.60	OK
773	2026-09-20 23:28	77.56	OK	774	2026-09-20 23:29	75.89	OK
775	2026-09-20 23:30	77.22	OK	776	2026-09-20 23:31	76.38	OK
777	2026-09-20 23:32	78.23	OK	778	2026-09-20 23:33	77.04	OK
779	2026-09-20 23:34	78.95	OK	780	2026-09-20 23:35	75.16	OK
781	2026-09-20 23:36	77.44	OK	782	2026-09-20 23:37	74.65	OK
783	2026-09-20 23:38	76.81	OK	784	2026-09-20 23:39	77.60	OK
785	2026-09-20 23:40	73.32	OK	786	2026-09-20 23:41	78.47	OK
787	2026-09-20 23:42	79.26	OK	788	2026-09-20 23:43	78.23	OK
789	2026-09-20 23:44	77.28	OK	790	2026-09-20 23:45	76.01	OK
791	2026-09-20 23:46	75.53	OK	792	2026-09-20 23:47	76.33	OK
793	2026-09-20 23:48	77.36	OK	794	2026-09-20 23:49	74.85	OK
795	2026-09-20 23:50	73.95	OK	796	2026-09-20 23:51	76.39	OK
797	2026-09-20 23:52	72.84	OK	798	2026-09-20 23:53	75.64	OK
799	2026-09-20 23:54	73.75	OK	800	2026-09-20 23:55	78.36	OK
801	2026-09-20 23:56	76.54	OK	802	2026-09-20 23:57	73.55	OK
803	2026-09-20 23:58	75.22	OK	804	2026-09-20 23:59	75.44	OK
805	2026-09-21 00:00	76.86	OK	806	2026-09-21 00:01	74.73	OK
807	2026-09-21 00:02	76.03	OK	808	2026-09-21 00:03	73.63	OK
809	2026-09-21 00:04	74.98	OK	810	2026-09-21 00:05	74.38	OK
811	2026-09-21 00:06	77.01	OK	812	2026-09-21 00:07	72.22	OK
813	2026-09-21 00:08	75.40	OK	814	2026-09-21 00:09	75.63	OK
815	2026-09-21 00:10	73.62	OK	816	2026-09-21 00:11	77.73	OK
817	2026-09-21 00:12	76.61	OK	818	2026-09-21 00:13	75.29	OK
819	2026-09-21 00:14	75.23	OK	820	2026-09-21 00:15	76.60	OK
821	2026-09-21 00:16	74.07	OK	822	2026-09-21 00:17	71.41	OK
823	2026-09-21 00:18	76.91	OK	824	2026-09-21 00:19	73.43	OK
825	2026-09-21 00:20	72.22	OK	826	2026-09-21 00:21	75.75	OK
827	2026-09-21 00:22	74.55	OK	828	2026-09-21 00:23	78.77	OK
829	2026-09-21 00:24	76.86	OK	830	2026-09-21 00:25	73.18	OK
831	2026-09-21 00:26	72.99	OK	832	2026-09-21 00:27	75.67	OK
833	2026-09-21 00:28	74.21	OK	834	2026-09-21 00:29	74.79	OK
835	2026-09-21 00:30	73.47	OK	836	2026-09-21 00:31	74.49	OK
837	2026-09-21 00:32	74.42	OK	838	2026-09-21 00:33	78.16	OK
839	2026-09-21 00:34	74.69	OK	840	2026-09-21 00:35	73.95	OK
841	2026-09-21 00:36	77.09	OK	842	2026-09-21 00:37	72.36	OK
843	2026-09-21 00:38	77.57	OK	844	2026-09-21 00:39	73.18	OK
845	2026-09-21 00:40	76.63	OK	846	2026-09-21 00:41	75.79	OK
847	2026-09-21 00:42	73.28	OK	848	2026-09-21 00:43	71.17	OK
849	2026-09-21 00:44	76.71	OK	850	2026-09-21 00:45	75.78	OK
851	2026-09-21 00:46	72.80	OK	852	2026-09-21 00:47	74.03	OK
853	2026-09-21 00:48	69.45	OK	854	2026-09-21 00:49	72.03	OK
855	2026-09-21 00:50	74.77	OK	856	2026-09-21 00:51	72.82	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
857	2026-09-21 00:52	73.47	OK	858	2026-09-21 00:53	73.95	OK
859	2026-09-21 00:54	71.28	OK	860	2026-09-21 00:55	74.86	OK
861	2026-09-21 00:56	73.65	OK	862	2026-09-21 00:57	73.95	OK
863	2026-09-21 00:58	74.66	OK	864	2026-09-21 00:59	70.73	OK
865	2026-09-21 01:00	72.53	OK	866	2026-09-21 01:01	75.13	OK
867	2026-09-21 01:02	74.88	OK	868	2026-09-21 01:03	71.52	OK
869	2026-09-21 01:04	71.25	OK	870	2026-09-21 01:05	72.21	OK
871	2026-09-21 01:06	75.10	OK	872	2026-09-21 01:07	76.43	OK
873	2026-09-21 01:08	74.44	OK	874	2026-09-21 01:09	73.21	OK
875	2026-09-21 01:10	72.46	OK	876	2026-09-21 01:11	74.19	OK
877	2026-09-21 01:12	75.18	OK	878	2026-09-21 01:13	72.27	OK
879	2026-09-21 01:14	76.48	OK	880	2026-09-21 01:15	73.18	OK
881	2026-09-21 01:16	71.31	OK	882	2026-09-21 01:17	72.96	OK
883	2026-09-21 01:18	69.73	OK	884	2026-09-21 01:19	73.36	OK
885	2026-09-21 01:20	72.36	OK	886	2026-09-21 01:21	72.88	OK
887	2026-09-21 01:22	73.65	OK	888	2026-09-21 01:23	69.38	OK
889	2026-09-21 01:24	69.83	OK	890	2026-09-21 01:25	72.29	OK
891	2026-09-21 01:26	73.90	OK	892	2026-09-21 01:27	70.78	OK
893	2026-09-21 01:28	74.61	OK	894	2026-09-21 01:29	73.51	OK
895	2026-09-21 01:30	72.37	OK	896	2026-09-21 01:31	73.04	OK
897	2026-09-21 01:32	72.99	OK	898	2026-09-21 01:33	75.32	OK
899	2026-09-21 01:34	70.24	OK	900	2026-09-21 01:35	72.94	OK
901	2026-09-21 01:36	72.80	OK	902	2026-09-21 01:37	71.47	OK
903	2026-09-21 01:38	75.41	OK	904	2026-09-21 01:39	70.20	OK
905	2026-09-21 01:40	69.88	OK	906	2026-09-21 01:41	72.39	OK
907	2026-09-21 01:42	72.75	OK	908	2026-09-21 01:43	75.10	OK
909	2026-09-21 01:44	72.78	OK	910	2026-09-21 01:45	71.03	OK
911	2026-09-21 01:46	73.70	OK	912	2026-09-21 01:47	71.10	OK
913	2026-09-21 01:48	75.95	OK	914	2026-09-21 01:49	75.69	OK
915	2026-09-21 01:50	72.96	OK	916	2026-09-21 01:51	71.19	OK
917	2026-09-21 01:52	72.47	OK	918	2026-09-21 01:53	70.18	OK
919	2026-09-21 01:54	72.87	OK	920	2026-09-21 01:55	71.00	OK
921	2026-09-21 01:56	72.77	OK	922	2026-09-21 01:57	71.29	OK
923	2026-09-21 01:58	70.83	OK	924	2026-09-21 01:59	70.36	OK
925	2026-09-21 02:00	73.57	OK	926	2026-09-21 02:01	68.86	OK
927	2026-09-21 02:02	72.04	OK	928	2026-09-21 02:03	73.57	OK
929	2026-09-21 02:04	68.75	OK	930	2026-09-21 02:05	72.11	OK
931	2026-09-21 02:06	70.48	OK	932	2026-09-21 02:07	72.38	OK
933	2026-09-21 02:08	71.12	OK	934	2026-09-21 02:09	71.02	OK
935	2026-09-21 02:10	71.96	OK	936	2026-09-21 02:11	72.75	OK
937	2026-09-21 02:12	72.76	OK	938	2026-09-21 02:13	70.53	OK
939	2026-09-21 02:14	72.47	OK	940	2026-09-21 02:15	73.02	OK
941	2026-09-21 02:16	70.94	OK	942	2026-09-21 02:17	70.61	OK
943	2026-09-21 02:18	70.38	OK	944	2026-09-21 02:19	70.90	OK
945	2026-09-21 02:20	73.20	OK	946	2026-09-21 02:21	69.57	OK
947	2026-09-21 02:22	73.74	OK	948	2026-09-21 02:23	69.20	OK
949	2026-09-21 02:24	70.46	OK	950	2026-09-21 02:25	70.43	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
951	2026-09-21 02:26	71.96	OK	952	2026-09-21 02:27	72.33	OK
953	2026-09-21 02:28	72.45	OK	954	2026-09-21 02:29	69.47	OK
955	2026-09-21 02:30	73.19	OK	956	2026-09-21 02:31	73.33	OK
957	2026-09-21 02:32	68.71	OK	958	2026-09-21 02:33	71.76	OK
959	2026-09-21 02:34	71.60	OK	960	2026-09-21 02:35	72.86	OK
961	2026-09-21 02:36	71.14	OK	962	2026-09-21 02:37	67.36	OK
963	2026-09-21 02:38	71.99	OK	964	2026-09-21 02:39	70.04	OK
965	2026-09-21 02:40	73.12	OK	966	2026-09-21 02:41	72.48	OK
967	2026-09-21 02:42	72.49	OK	968	2026-09-21 02:43	70.91	OK
969	2026-09-21 02:44	71.62	OK	970	2026-09-21 02:45	71.54	OK
971	2026-09-21 02:46	72.28	OK	972	2026-09-21 02:47	69.55	OK
973	2026-09-21 02:48	70.72	OK	974	2026-09-21 02:49	71.39	OK
975	2026-09-21 02:50	69.18	OK	976	2026-09-21 02:51	70.03	OK
977	2026-09-21 02:52	71.23	OK	978	2026-09-21 02:53	72.02	OK
979	2026-09-21 02:54	70.33	OK	980	2026-09-21 02:55	68.19	OK
981	2026-09-21 02:56	70.72	OK	982	2026-09-21 02:57	69.00	OK
983	2026-09-21 02:58	69.91	OK	984	2026-09-21 02:59	70.98	OK
985	2026-09-21 03:00	73.55	OK	986	2026-09-21 03:01	69.38	OK
987	2026-09-21 03:02	69.64	OK	988	2026-09-21 03:03	68.88	OK
989	2026-09-21 03:04	70.49	OK	990	2026-09-21 03:05	66.05	OK
991	2026-09-21 03:06	68.71	OK	992	2026-09-21 03:07	69.93	OK
993	2026-09-21 03:08	70.98	OK	994	2026-09-21 03:09	69.08	OK
995	2026-09-21 03:10	70.59	OK	996	2026-09-21 03:11	68.59	OK
997	2026-09-21 03:12	69.49	OK	998	2026-09-21 03:13	70.28	OK
999	2026-09-21 03:14	70.49	OK	1000	2026-09-21 03:15	71.25	OK
1001	2026-09-21 03:16	68.44	OK	1002	2026-09-21 03:17	73.17	OK
1003	2026-09-21 03:18	65.44	OK	1004	2026-09-21 03:19	68.36	OK
1005	2026-09-21 03:20	73.14	OK	1006	2026-09-21 03:21	68.18	OK
1007	2026-09-21 03:22	69.34	OK	1008	2026-09-21 03:23	70.19	OK
1009	2026-09-21 03:24	70.27	OK	1010	2026-09-21 03:25	68.34	OK
1011	2026-09-21 03:26	70.03	OK	1012	2026-09-21 03:27	70.17	OK
1013	2026-09-21 03:28	68.61	OK	1014	2026-09-21 03:29	71.82	OK
1015	2026-09-21 03:30	70.21	OK	1016	2026-09-21 03:31	70.83	OK
1017	2026-09-21 03:32	69.78	OK	1018	2026-09-21 03:33	69.22	OK
1019	2026-09-21 03:34	72.22	OK	1020	2026-09-21 03:35	72.79	OK
1021	2026-09-21 03:36	70.62	OK	1022	2026-09-21 03:37	68.94	OK
1023	2026-09-21 03:38	69.90	OK	1024	2026-09-21 03:39	66.57	OK
1025	2026-09-21 03:40	71.30	OK	1026	2026-09-21 03:41	72.00	OK
1027	2026-09-21 03:42	70.84	OK	1028	2026-09-21 03:43	70.60	OK
1029	2026-09-21 03:44	72.18	OK	1030	2026-09-21 03:45	70.89	OK
1031	2026-09-21 03:46	70.80	OK	1032	2026-09-21 03:47	68.99	OK
1033	2026-09-21 03:48	69.21	OK	1034	2026-09-21 03:49	70.10	OK
1035	2026-09-21 03:50	72.60	OK	1036	2026-09-21 03:51	68.14	OK
1037	2026-09-21 03:52	70.18	OK	1038	2026-09-21 03:53	66.79	OK
1039	2026-09-21 03:54	69.40	OK	1040	2026-09-21 03:55	71.12	OK
1041	2026-09-21 03:56	68.95	OK	1042	2026-09-21 03:57	70.14	OK
1043	2026-09-21 03:58	68.35	OK	1044	2026-09-21 03:59	70.45	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1045	2026-09-21 04:00	67.58	OK	1046	2026-09-21 04:01	69.81	OK
1047	2026-09-21 04:02	69.68	OK	1048	2026-09-21 04:03	69.71	OK
1049	2026-09-21 04:04	67.45	OK	1050	2026-09-21 04:05	71.40	OK
1051	2026-09-21 04:06	65.24	OK	1052	2026-09-21 04:07	66.58	OK
1053	2026-09-21 04:08	65.19	OK	1054	2026-09-21 04:09	70.52	OK
1055	2026-09-21 04:10	71.42	OK	1056	2026-09-21 04:11	69.72	OK
1057	2026-09-21 04:12	68.78	OK	1058	2026-09-21 04:13	68.60	OK
1059	2026-09-21 04:14	69.22	OK	1060	2026-09-21 04:15	71.96	OK
1061	2026-09-21 04:16	70.93	OK	1062	2026-09-21 04:17	67.50	OK
1063	2026-09-21 04:18	67.85	OK	1064	2026-09-21 04:19	69.11	OK
1065	2026-09-21 04:20	70.08	OK	1066	2026-09-21 04:21	65.23	OK
1067	2026-09-21 04:22	65.23	OK	1068	2026-09-21 04:23	65.99	OK
1069	2026-09-21 04:24	71.71	OK	1070	2026-09-21 04:25	69.48	OK
1071	2026-09-21 04:26	70.82	OK	1072	2026-09-21 04:27	69.06	OK
1073	2026-09-21 04:28	68.43	OK	1074	2026-09-21 04:29	67.27	OK
1075	2026-09-21 04:30	69.30	OK	1076	2026-09-21 04:31	69.20	OK
1077	2026-09-21 04:32	68.64	OK	1078	2026-09-21 04:33	68.82	OK
1079	2026-09-21 04:34	69.71	OK	1080	2026-09-21 04:35	66.62	OK
1081	2026-09-21 04:36	70.08	OK	1082	2026-09-21 04:37	67.89	OK
1083	2026-09-21 04:38	71.41	OK	1084	2026-09-21 04:39	69.50	OK
1085	2026-09-21 04:40	70.74	OK	1086	2026-09-21 04:41	68.85	OK
1087	2026-09-21 04:42	68.23	OK	1088	2026-09-21 04:43	67.00	OK
1089	2026-09-21 04:44	67.07	OK	1090	2026-09-21 04:45	67.05	OK
1091	2026-09-21 04:46	69.42	OK	1092	2026-09-21 04:47	65.66	OK
1093	2026-09-21 04:48	68.17	OK	1094	2026-09-21 04:49	68.32	OK
1095	2026-09-21 04:50	70.48	OK	1096	2026-09-21 04:51	66.40	OK
1097	2026-09-21 04:52	69.68	OK	1098	2026-09-21 04:53	67.16	OK
1099	2026-09-21 04:54	68.02	OK	1100	2026-09-21 04:55	70.37	OK
1101	2026-09-21 04:56	65.75	OK	1102	2026-09-21 04:57	70.11	OK
1103	2026-09-21 04:58	69.23	OK	1104	2026-09-21 04:59	67.50	OK
1105	2026-09-21 05:00	70.06	OK	1106	2026-09-21 05:01	67.65	OK
1107	2026-09-21 05:02	66.01	OK	1108	2026-09-21 05:03	65.63	OK
1109	2026-09-21 05:04	67.06	OK	1110	2026-09-21 05:05	70.00	OK
1111	2026-09-21 05:06	72.40	OK	1112	2026-09-21 05:07	67.11	OK
1113	2026-09-21 05:08	68.11	OK	1114	2026-09-21 05:09	69.82	OK
1115	2026-09-21 05:10	63.95	OK	1116	2026-09-21 05:11	68.90	OK
1117	2026-09-21 05:12	67.32	OK	1118	2026-09-21 05:13	69.02	OK
1119	2026-09-21 05:14	69.42	OK	1120	2026-09-21 05:15	64.28	OK
1121	2026-09-21 05:16	70.16	OK	1122	2026-09-21 05:17	68.01	OK
1123	2026-09-21 05:18	69.02	OK	1124	2026-09-21 05:19	69.10	OK
1125	2026-09-21 05:20	65.28	OK	1126	2026-09-21 05:21	66.18	OK
1127	2026-09-21 05:22	69.64	OK	1128	2026-09-21 05:23	66.00	OK
1129	2026-09-21 05:24	67.06	OK	1130	2026-09-21 05:25	67.77	OK
1131	2026-09-21 05:26	71.91	OK	1132	2026-09-21 05:27	66.14	OK
1133	2026-09-21 05:28	67.41	OK	1134	2026-09-21 05:29	67.18	OK
1135	2026-09-21 05:30	68.44	OK	1136	2026-09-21 05:31	66.07	OK
1137	2026-09-21 05:32	67.98	OK	1138	2026-09-21 05:33	68.85	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1139	2026-09-21 05:34	69.97	OK	1140	2026-09-21 05:35	68.36	OK
1141	2026-09-21 05:36	67.26	OK	1142	2026-09-21 05:37	67.65	OK
1143	2026-09-21 05:38	65.32	OK	1144	2026-09-21 05:39	65.95	OK
1145	2026-09-21 05:40	67.06	OK	1146	2026-09-21 05:41	69.99	OK
1147	2026-09-21 05:42	69.30	OK	1148	2026-09-21 05:43	69.92	OK
1149	2026-09-21 05:44	65.87	OK	1150	2026-09-21 05:45	68.80	OK
1151	2026-09-21 05:46	68.07	OK	1152	2026-09-21 05:47	69.96	OK
1153	2026-09-21 05:48	66.58	OK	1154	2026-09-21 05:49	68.60	OK
1155	2026-09-21 05:50	66.86	OK	1156	2026-09-21 05:51	68.73	OK
1157	2026-09-21 05:52	64.34	OK	1158	2026-09-21 05:53	66.95	OK
1159	2026-09-21 05:54	67.72	OK	1160	2026-09-21 05:55	68.86	OK
1161	2026-09-21 05:56	64.93	OK	1162	2026-09-21 05:57	68.73	OK
1163	2026-09-21 05:58	66.66	OK	1164	2026-09-21 05:59	66.51	OK
1165	2026-09-21 06:00	67.70	OK	1166	2026-09-21 06:01	69.31	OK
1167	2026-09-21 06:02	68.97	OK	1168	2026-09-21 06:03	66.83	OK
1169	2026-09-21 06:04	66.05	OK	1170	2026-09-21 06:05	66.27	OK
1171	2026-09-21 06:06	68.04	OK	1172	2026-09-21 06:07	69.59	OK
1173	2026-09-21 06:08	69.31	OK	1174	2026-09-21 06:09	67.30	OK
1175	2026-09-21 06:10	67.90	OK	1176	2026-09-21 06:11	67.39	OK
1177	2026-09-21 06:12	68.90	OK	1178	2026-09-21 06:13	66.44	OK
1179	2026-09-21 06:14	70.32	OK	1180	2026-09-21 06:15	66.64	OK
1181	2026-09-21 06:16	69.74	OK	1182	2026-09-21 06:17	68.52	OK
1183	2026-09-21 06:18	66.59	OK	1184	2026-09-21 06:19	67.53	OK
1185	2026-09-21 06:20	69.11	OK	1186	2026-09-21 06:21	68.12	OK
1187	2026-09-21 06:22	67.62	OK	1188	2026-09-21 06:23	69.08	OK
1189	2026-09-21 06:24	67.75	OK	1190	2026-09-21 06:25	67.10	OK
1191	2026-09-21 06:26	65.08	OK	1192	2026-09-21 06:27	69.46	OK
1193	2026-09-21 06:28	72.59	OK	1194	2026-09-21 06:29	68.56	OK
1195	2026-09-21 06:30	65.63	OK	1196	2026-09-21 06:31	66.94	OK
1197	2026-09-21 06:32	71.04	OK	1198	2026-09-21 06:33	68.94	OK
1199	2026-09-21 06:34	66.95	OK	1200	2026-09-21 06:35	65.88	OK
1201	2026-09-21 06:36	69.62	OK	1202	2026-09-21 06:37	68.96	OK
1203	2026-09-21 06:38	67.89	OK	1204	2026-09-21 06:39	66.36	OK
1205	2026-09-21 06:40	67.90	OK	1206	2026-09-21 06:41	70.24	OK
1207	2026-09-21 06:42	67.45	OK	1208	2026-09-21 06:43	70.70	OK
1209	2026-09-21 06:44	66.74	OK	1210	2026-09-21 06:45	68.43	OK
1211	2026-09-21 06:46	68.99	OK	1212	2026-09-21 06:47	66.85	OK
1213	2026-09-21 06:48	65.89	OK	1214	2026-09-21 06:49	70.47	OK
1215	2026-09-21 06:50	67.13	OK	1216	2026-09-21 06:51	66.69	OK
1217	2026-09-21 06:52	67.27	OK	1218	2026-09-21 06:53	68.69	OK
1219	2026-09-21 06:54	67.50	OK	1220	2026-09-21 06:55	66.96	OK
1221	2026-09-21 06:56	71.21	OK	1222	2026-09-21 06:57	68.19	OK
1223	2026-09-21 06:58	65.04	OK	1224	2026-09-21 06:59	67.91	OK
1225	2026-09-21 07:00	65.17	OK	1226	2026-09-21 07:01	66.09	OK
1227	2026-09-21 07:02	70.59	OK	1228	2026-09-21 07:03	68.14	OK
1229	2026-09-21 07:04	65.72	OK	1230	2026-09-21 07:05	67.91	OK
1231	2026-09-21 07:06	66.01	OK	1232	2026-09-21 07:07	67.13	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1233	2026-09-21 07:08	70.03	OK	1234	2026-09-21 07:09	68.08	OK
1235	2026-09-21 07:10	68.57	OK	1236	2026-09-21 07:11	68.72	OK
1237	2026-09-21 07:12	68.59	OK	1238	2026-09-21 07:13	69.35	OK
1239	2026-09-21 07:14	68.73	OK	1240	2026-09-21 07:15	66.47	OK
1241	2026-09-21 07:16	67.85	OK	1242	2026-09-21 07:17	70.04	OK
1243	2026-09-21 07:18	71.80	OK	1244	2026-09-21 07:19	67.24	OK
1245	2026-09-21 07:20	68.51	OK	1246	2026-09-21 07:21	69.12	OK
1247	2026-09-21 07:22	65.89	OK	1248	2026-09-21 07:23	66.42	OK
1249	2026-09-21 07:24	65.65	OK	1250	2026-09-21 07:25	68.30	OK
1251	2026-09-21 07:26	68.18	OK	1252	2026-09-21 07:27	66.19	OK
1253	2026-09-21 07:28	65.33	OK	1254	2026-09-21 07:29	66.97	OK
1255	2026-09-21 07:30	66.92	OK	1256	2026-09-21 07:31	67.49	OK
1257	2026-09-21 07:32	68.27	OK	1258	2026-09-21 07:33	67.18	OK
1259	2026-09-21 07:34	66.27	OK	1260	2026-09-21 07:35	66.60	OK
1261	2026-09-21 07:36	67.33	OK	1262	2026-09-21 07:37	67.43	OK
1263	2026-09-21 07:38	67.32	OK	1264	2026-09-21 07:39	67.49	OK
1265	2026-09-21 07:40	65.44	OK	1266	2026-09-21 07:41	71.14	OK
1267	2026-09-21 07:42	66.56	OK	1268	2026-09-21 07:43	67.93	OK
1269	2026-09-21 07:44	70.57	OK	1270	2026-09-21 07:45	67.13	OK
1271	2026-09-21 07:46	68.10	OK	1272	2026-09-21 07:47	68.16	OK
1273	2026-09-21 07:48	66.19	OK	1274	2026-09-21 07:49	66.08	OK
1275	2026-09-21 07:50	67.13	OK	1276	2026-09-21 07:51	66.94	OK
1277	2026-09-21 07:52	70.32	OK	1278	2026-09-21 07:53	68.92	OK
1279	2026-09-21 07:54	69.86	OK	1280	2026-09-21 07:55	72.56	OK
1281	2026-09-21 07:56	65.00	OK	1282	2026-09-21 07:57	69.51	OK
1283	2026-09-21 07:58	69.05	OK	1284	2026-09-21 07:59	65.67	OK
1285	2026-09-21 08:00	69.81	OK	1286	2026-09-21 08:01	70.53	OK
1287	2026-09-21 08:02	67.82	OK	1288	2026-09-21 08:03	66.16	OK
1289	2026-09-21 08:04	68.98	OK	1290	2026-09-21 08:05	68.10	OK
1291	2026-09-21 08:06	66.98	OK	1292	2026-09-21 08:07	67.07	OK
1293	2026-09-21 08:08	69.79	OK	1294	2026-09-21 08:09	68.24	OK
1295	2026-09-21 08:10	67.13	OK	1296	2026-09-21 08:11	66.95	OK
1297	2026-09-21 08:12	67.78	OK	1298	2026-09-21 08:13	68.95	OK
1299	2026-09-21 08:14	68.63	OK	1300	2026-09-21 08:15	69.56	OK
1301	2026-09-21 08:16	70.04	OK	1302	2026-09-21 08:17	72.75	OK
1303	2026-09-21 08:18	68.91	OK	1304	2026-09-21 08:19	66.17	OK
1305	2026-09-21 08:20	69.44	OK	1306	2026-09-21 08:21	67.33	OK
1307	2026-09-21 08:22	70.16	OK	1308	2026-09-21 08:23	67.08	OK
1309	2026-09-21 08:24	68.95	OK	1310	2026-09-21 08:25	69.89	OK
1311	2026-09-21 08:26	66.67	OK	1312	2026-09-21 08:27	68.04	OK
1313	2026-09-21 08:28	69.71	OK	1314	2026-09-21 08:29	66.41	OK
1315	2026-09-21 08:30	69.25	OK	1316	2026-09-21 08:31	68.55	OK
1317	2026-09-21 08:32	69.75	OK	1318	2026-09-21 08:33	68.54	OK
1319	2026-09-21 08:34	65.79	OK	1320	2026-09-21 08:35	68.78	OK
1321	2026-09-21 08:36	67.67	OK	1322	2026-09-21 08:37	68.82	OK
1323	2026-09-21 08:38	68.67	OK	1324	2026-09-21 08:39	69.98	OK
1325	2026-09-21 08:40	67.11	OK	1326	2026-09-21 08:41	68.35	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1327	2026-09-21 08:42	67.12	OK	1328	2026-09-21 08:43	66.86	OK
1329	2026-09-21 08:44	66.23	OK	1330	2026-09-21 08:45	73.12	OK
1331	2026-09-21 08:46	69.01	OK	1332	2026-09-21 08:47	69.12	OK
1333	2026-09-21 08:48	69.64	OK	1334	2026-09-21 08:49	71.29	OK
1335	2026-09-21 08:50	73.00	OK	1336	2026-09-21 08:51	71.49	OK
1337	2026-09-21 08:52	66.64	OK	1338	2026-09-21 08:53	64.75	OK
1339	2026-09-21 08:54	68.43	OK	1340	2026-09-21 08:55	67.85	OK
1341	2026-09-21 08:56	69.68	OK	1342	2026-09-21 08:57	69.70	OK
1343	2026-09-21 08:58	69.20	OK	1344	2026-09-21 08:59	69.63	OK
1345	2026-09-21 09:00	69.02	OK	1346	2026-09-21 09:01	70.93	OK
1347	2026-09-21 09:02	65.66	OK	1348	2026-09-21 09:03	69.35	OK
1349	2026-09-21 09:04	70.03	OK	1350	2026-09-21 09:05	70.06	OK
1351	2026-09-21 09:06	69.16	OK	1352	2026-09-21 09:07	68.47	OK
1353	2026-09-21 09:08	69.46	OK	1354	2026-09-21 09:09	67.29	OK
1355	2026-09-21 09:10	66.39	OK	1356	2026-09-21 09:11	70.71	OK
1357	2026-09-21 09:12	71.95	OK	1358	2026-09-21 09:13	68.86	OK
1359	2026-09-21 09:14	68.64	OK	1360	2026-09-21 09:15	68.34	OK
1361	2026-09-21 09:16	69.06	OK	1362	2026-09-21 09:17	72.06	OK
1363	2026-09-21 09:18	69.69	OK	1364	2026-09-21 09:19	71.59	OK
1365	2026-09-21 09:20	68.58	OK	1366	2026-09-21 09:21	66.95	OK
1367	2026-09-21 09:22	69.96	OK	1368	2026-09-21 09:23	69.00	OK
1369	2026-09-21 09:24	69.41	OK	1370	2026-09-21 09:25	67.73	OK
1371	2026-09-21 09:26	69.21	OK	1372	2026-09-21 09:27	71.46	OK
1373	2026-09-21 09:28	69.85	OK	1374	2026-09-21 09:29	72.73	OK
1375	2026-09-21 09:30	68.10	OK	1376	2026-09-21 09:31	69.16	OK
1377	2026-09-21 09:32	69.30	OK	1378	2026-09-21 09:33	70.09	OK
1379	2026-09-21 09:34	70.49	OK	1380	2026-09-21 09:35	69.40	OK
1381	2026-09-21 09:36	70.95	OK	1382	2026-09-21 09:37	70.49	OK
1383	2026-09-21 09:38	72.43	OK	1384	2026-09-21 09:39	70.93	OK
1385	2026-09-21 09:40	69.47	OK	1386	2026-09-21 09:41	72.55	OK
1387	2026-09-21 09:42	70.95	OK	1388	2026-09-21 09:43	67.87	OK
1389	2026-09-21 09:44	69.99	OK	1390	2026-09-21 09:45	70.80	OK
1391	2026-09-21 09:46	73.10	OK	1392	2026-09-21 09:47	68.51	OK
1393	2026-09-21 09:48	71.52	OK	1394	2026-09-21 09:49	70.97	OK
1395	2026-09-21 09:50	71.50	OK	1396	2026-09-21 09:51	71.13	OK
1397	2026-09-21 09:52	72.09	OK	1398	2026-09-21 09:53	71.72	OK
1399	2026-09-21 09:54	70.48	OK	1400	2026-09-21 09:55	68.78	OK
1401	2026-09-21 09:56	73.57	OK	1402	2026-09-21 09:57	69.53	OK
1403	2026-09-21 09:58	71.89	OK	1404	2026-09-21 09:59	70.25	OK
1405	2026-09-21 10:00	72.65	OK	1406	2026-09-21 10:01	69.33	OK
1407	2026-09-21 10:02	72.05	OK	1408	2026-09-21 10:03	69.79	OK
1409	2026-09-21 10:04	68.91	OK	1410	2026-09-21 10:05	71.79	OK
1411	2026-09-21 10:06	65.70	OK	1412	2026-09-21 10:07	68.19	OK
1413	2026-09-21 10:08	69.17	OK	1414	2026-09-21 10:09	72.67	OK
1415	2026-09-21 10:10	70.09	OK	1416	2026-09-21 10:11	72.08	OK
1417	2026-09-21 10:12	72.74	OK	1418	2026-09-21 10:13	69.53	OK
1419	2026-09-21 10:14	68.56	OK	1420	2026-09-21 10:15	68.20	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1421	2026-09-21 10:16	74.13	OK	1422	2026-09-21 10:17	71.62	OK
1423	2026-09-21 10:18	70.55	OK	1424	2026-09-21 10:19	72.44	OK
1425	2026-09-21 10:20	69.74	OK	1426	2026-09-21 10:21	69.83	OK
1427	2026-09-21 10:22	72.75	OK	1428	2026-09-21 10:23	69.83	OK
1429	2026-09-21 10:24	70.34	OK	1430	2026-09-21 10:25	74.47	OK
1431	2026-09-21 10:26	68.72	OK	1432	2026-09-21 10:27	72.34	OK
1433	2026-09-21 10:28	71.07	OK	1434	2026-09-21 10:29	69.13	OK
1435	2026-09-21 10:30	73.90	OK	1436	2026-09-21 10:31	70.20	OK
1437	2026-09-21 10:32	71.12	OK	1438	2026-09-21 10:33	71.22	OK
1439	2026-09-21 10:34	70.07	OK	1440	2026-09-21 10:35	71.48	OK
1441	2026-09-21 10:36	72.30	OK	1442	2026-09-21 10:37	71.00	OK
1443	2026-09-21 10:38	68.13	OK	1444	2026-09-21 10:39	68.30	OK
1445	2026-09-21 10:40	70.00	OK	1446	2026-09-21 10:41	72.82	OK
1447	2026-09-21 10:42	71.27	OK	1448	2026-09-21 10:43	72.47	OK
1449	2026-09-21 10:44	68.40	OK	1450	2026-09-21 10:45	69.31	OK
1451	2026-09-21 10:46	73.46	OK	1452	2026-09-21 10:47	70.91	OK
1453	2026-09-21 10:48	71.96	OK	1454	2026-09-21 10:49	70.62	OK
1455	2026-09-21 10:50	72.09	OK	1456	2026-09-21 10:51	72.04	OK
1457	2026-09-21 10:52	73.56	OK	1458	2026-09-21 10:53	73.66	OK
1459	2026-09-21 10:54	73.49	OK	1460	2026-09-21 10:55	72.38	OK
1461	2026-09-21 10:56	71.12	OK	1462	2026-09-21 10:57	70.82	OK
1463	2026-09-21 10:58	75.47	OK	1464	2026-09-21 10:59	71.55	OK
1465	2026-09-21 11:00	71.85	OK	1466	2026-09-21 11:01	72.95	OK
1467	2026-09-21 11:02	72.26	OK	1468	2026-09-21 11:03	73.42	OK
1469	2026-09-21 11:04	73.26	OK	1470	2026-09-21 11:05	71.33	OK
1471	2026-09-21 11:06	68.54	OK	1472	2026-09-21 11:07	69.68	OK
1473	2026-09-21 11:08	71.82	OK	1474	2026-09-21 11:09	69.44	OK
1475	2026-09-21 11:10	71.49	OK	1476	2026-09-21 11:11	71.70	OK
1477	2026-09-21 11:12	69.23	OK	1478	2026-09-21 11:13	73.44	OK
1479	2026-09-21 11:14	71.06	OK	1480	2026-09-21 11:15	67.97	OK
1481	2026-09-21 11:16	76.77	OK	1482	2026-09-21 11:17	68.99	OK
1483	2026-09-21 11:18	74.68	OK	1484	2026-09-21 11:19	72.13	OK
1485	2026-09-21 11:20	74.58	OK	1486	2026-09-21 11:21	74.95	OK
1487	2026-09-21 11:22	73.71	OK	1488	2026-09-21 11:23	73.42	OK
1489	2026-09-21 11:24	74.64	OK	1490	2026-09-21 11:25	71.52	OK
1491	2026-09-21 11:26	71.48	OK	1492	2026-09-21 11:27	71.49	OK
1493	2026-09-21 11:28	71.33	OK	1494	2026-09-21 11:29	70.57	OK
1495	2026-09-21 11:30	72.90	OK	1496	2026-09-21 11:31	74.02	OK
1497	2026-09-21 11:32	73.68	OK	1498	2026-09-21 11:33	72.74	OK
1499	2026-09-21 11:34	74.61	OK	1500	2026-09-21 11:35	71.05	OK
1501	2026-09-21 11:36	72.99	OK	1502	2026-09-21 11:37	75.05	OK
1503	2026-09-21 11:38	75.33	OK	1504	2026-09-21 11:39	72.72	OK
1505	2026-09-21 11:40	73.87	OK	1506	2026-09-21 11:41	71.74	OK
1507	2026-09-21 11:42	73.54	OK	1508	2026-09-21 11:43	74.60	OK
1509	2026-09-21 11:44	71.56	OK	1510	2026-09-21 11:45	69.73	OK
1511	2026-09-21 11:46	74.82	OK	1512	2026-09-21 11:47	72.68	OK
1513	2026-09-21 11:48	74.36	OK	1514	2026-09-21 11:49	78.22	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1515	2026-09-21 11:50	73.35	OK	1516	2026-09-21 11:51	75.13	OK
1517	2026-09-21 11:52	74.46	OK	1518	2026-09-21 11:53	71.57	OK
1519	2026-09-21 11:54	74.08	OK	1520	2026-09-21 11:55	72.89	OK
1521	2026-09-21 11:56	72.61	OK	1522	2026-09-21 11:57	72.52	OK
1523	2026-09-21 11:58	75.65	OK	1524	2026-09-21 11:59	75.57	OK
1525	2026-09-21 12:00	73.08	OK	1526	2026-09-21 12:01	75.65	OK
1527	2026-09-21 12:02	73.20	OK	1528	2026-09-21 12:03	74.99	OK
1529	2026-09-21 12:04	76.54	OK	1530	2026-09-21 12:05	75.57	OK
1531	2026-09-21 12:06	71.81	OK	1532	2026-09-21 12:07	71.32	OK
1533	2026-09-21 12:08	73.44	OK	1534	2026-09-21 12:09	74.34	OK
1535	2026-09-21 12:10	73.98	OK	1536	2026-09-21 12:11	76.81	OK
1537	2026-09-21 12:12	73.77	OK	1538	2026-09-21 12:13	74.78	OK
1539	2026-09-21 12:14	74.16	OK	1540	2026-09-21 12:15	75.00	OK
1541	2026-09-21 12:16	77.04	OK	1542	2026-09-21 12:17	74.22	OK
1543	2026-09-21 12:18	72.23	OK	1544	2026-09-21 12:19	75.18	OK
1545	2026-09-21 12:20	73.38	OK	1546	2026-09-21 12:21	73.88	OK
1547	2026-09-21 12:22	73.76	OK	1548	2026-09-21 12:23	76.15	OK
1549	2026-09-21 12:24	75.10	OK	1550	2026-09-21 12:25	73.59	OK
1551	2026-09-21 12:26	72.25	OK	1552	2026-09-21 12:27	74.46	OK
1553	2026-09-21 12:28	73.44	OK	1554	2026-09-21 12:29	75.11	OK
1555	2026-09-21 12:30	75.01	OK	1556	2026-09-21 12:31	72.30	OK
1557	2026-09-21 12:32	75.08	OK	1558	2026-09-21 12:33	73.85	OK
1559	2026-09-21 12:34	77.71	OK	1560	2026-09-21 12:35	78.32	OK
1561	2026-09-21 12:36	73.85	OK	1562	2026-09-21 12:37	76.40	OK
1563	2026-09-21 12:38	72.01	OK	1564	2026-09-21 12:39	74.10	OK
1565	2026-09-21 12:40	71.33	OK	1566	2026-09-21 12:41	76.44	OK
1567	2026-09-21 12:42	75.03	OK	1568	2026-09-21 12:43	76.19	OK
1569	2026-09-21 12:44	73.89	OK	1570	2026-09-21 12:45	75.12	OK
1571	2026-09-21 12:46	77.45	OK	1572	2026-09-21 12:47	78.13	OK
1573	2026-09-21 12:48	74.31	OK	1574	2026-09-21 12:49	77.56	OK
1575	2026-09-21 12:50	76.87	OK	1576	2026-09-21 12:51	76.35	OK
1577	2026-09-21 12:52	74.72	OK	1578	2026-09-21 12:53	75.22	OK
1579	2026-09-21 12:54	77.08	OK	1580	2026-09-21 12:55	76.42	OK
1581	2026-09-21 12:56	75.24	OK	1582	2026-09-21 12:57	75.37	OK
1583	2026-09-21 12:58	76.41	OK	1584	2026-09-21 12:59	76.07	OK
1585	2026-09-21 13:00	75.38	OK	1586	2026-09-21 13:01	75.63	OK
1587	2026-09-21 13:02	77.01	OK	1588	2026-09-21 13:03	77.76	OK
1589	2026-09-21 13:04	73.92	OK	1590	2026-09-21 13:05	74.87	OK
1591	2026-09-21 13:06	75.46	OK	1592	2026-09-21 13:07	74.34	OK
1593	2026-09-21 13:08	75.70	OK	1594	2026-09-21 13:09	74.29	OK
1595	2026-09-21 13:10	77.49	OK	1596	2026-09-21 13:11	72.78	OK
1597	2026-09-21 13:12	78.57	OK	1598	2026-09-21 13:13	77.32	OK
1599	2026-09-21 13:14	75.02	OK	1600	2026-09-21 13:15	75.98	OK
1601	2026-09-21 13:16	76.20	OK	1602	2026-09-21 13:17	74.34	OK
1603	2026-09-21 13:18	77.50	OK	1604	2026-09-21 13:19	74.25	OK
1605	2026-09-21 13:20	78.79	OK	1606	2026-09-21 13:21	79.63	OK
1607	2026-09-21 13:22	76.95	OK	1608	2026-09-21 13:23	74.27	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1609	2026-09-21 13:24	76.17	OK	1610	2026-09-21 13:25	74.93	OK
1611	2026-09-21 13:26	77.54	OK	1612	2026-09-21 13:27	73.97	OK
1613	2026-09-21 13:28	77.27	OK	1614	2026-09-21 13:29	78.21	OK
1615	2026-09-21 13:30	75.21	OK	1616	2026-09-21 13:31	73.89	OK
1617	2026-09-21 13:32	76.28	OK	1618	2026-09-21 13:33	80.05	OK
1619	2026-09-21 13:34	73.76	OK	1620	2026-09-21 13:35	76.00	OK
1621	2026-09-21 13:36	76.79	OK	1622	2026-09-21 13:37	73.81	OK
1623	2026-09-21 13:38	77.22	OK	1624	2026-09-21 13:39	78.86	OK
1625	2026-09-21 13:40	78.24	OK	1626	2026-09-21 13:41	74.70	OK
1627	2026-09-21 13:42	75.17	OK	1628	2026-09-21 13:43	76.94	OK
1629	2026-09-21 13:44	76.41	OK	1630	2026-09-21 13:45	75.64	OK
1631	2026-09-21 13:46	76.69	OK	1632	2026-09-21 13:47	76.00	OK
1633	2026-09-21 13:48	73.70	OK	1634	2026-09-21 13:49	76.22	OK
1635	2026-09-21 13:50	79.51	OK	1636	2026-09-21 13:51	79.32	OK
1637	2026-09-21 13:52	76.85	OK	1638	2026-09-21 13:53	77.17	OK
1639	2026-09-21 13:54	76.96	OK	1640	2026-09-21 13:55	73.04	OK
1641	2026-09-21 13:56	76.52	OK	1642	2026-09-21 13:57	74.91	OK
1643	2026-09-21 13:58	75.71	OK	1644	2026-09-21 13:59	77.84	OK
1645	2026-09-21 14:00	73.17	OK	1646	2026-09-21 14:01	79.57	OK
1647	2026-09-21 14:02	77.31	OK	1648	2026-09-21 14:03	75.82	OK
1649	2026-09-21 14:04	77.87	OK	1650	2026-09-21 14:05	76.85	OK
1651	2026-09-21 14:06	77.69	OK	1652	2026-09-21 14:07	78.65	OK
1653	2026-09-21 14:08	76.68	OK	1654	2026-09-21 14:09	80.07	OK
1655	2026-09-21 14:10	77.27	OK	1656	2026-09-21 14:11	77.31	OK
1657	2026-09-21 14:12	77.99	OK	1658	2026-09-21 14:13	77.73	OK
1659	2026-09-21 14:14	78.51	OK	1660	2026-09-21 14:15	76.13	OK
1661	2026-09-21 14:16	77.43	OK	1662	2026-09-21 14:17	80.59	OK
1663	2026-09-21 14:18	78.33	OK	1664	2026-09-21 14:19	77.43	OK
1665	2026-09-21 14:20	78.87	OK	1666	2026-09-21 14:21	80.97	OK
1667	2026-09-21 14:22	80.16	OK	1668	2026-09-21 14:23	76.29	OK
1669	2026-09-21 14:24	78.15	OK	1670	2026-09-21 14:25	79.72	OK
1671	2026-09-21 14:26	75.70	OK	1672	2026-09-21 14:27	77.77	OK
1673	2026-09-21 14:28	81.14	OK	1674	2026-09-21 14:29	76.92	OK
1675	2026-09-21 14:30	82.34	OK	1676	2026-09-21 14:31	75.24	OK
1677	2026-09-21 14:32	75.70	OK	1678	2026-09-21 14:33	80.95	OK
1679	2026-09-21 14:34	80.09	OK	1680	2026-09-21 14:35	77.48	OK
1681	2026-09-21 14:36	76.74	OK	1682	2026-09-21 14:37	78.07	OK
1683	2026-09-21 14:38	77.96	OK	1684	2026-09-21 14:39	79.96	OK
1685	2026-09-21 14:40	76.00	OK	1686	2026-09-21 14:41	79.85	OK
1687	2026-09-21 14:42	77.40	OK	1688	2026-09-21 14:43	77.80	OK
1689	2026-09-21 14:44	77.85	OK	1690	2026-09-21 14:45	75.99	OK
1691	2026-09-21 14:46	76.58	OK	1692	2026-09-21 14:47	76.27	OK
1693	2026-09-21 14:48	79.73	OK	1694	2026-09-21 14:49	78.98	OK
1695	2026-09-21 14:50	77.54	OK	1696	2026-09-21 14:51	76.21	OK
1697	2026-09-21 14:52	79.26	OK	1698	2026-09-21 14:53	79.78	OK
1699	2026-09-21 14:54	77.81	OK	1700	2026-09-21 14:55	75.30	OK
1701	2026-09-21 14:56	77.91	OK	1702	2026-09-21 14:57	78.49	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1703	2026-09-21 14:58	79.18	OK	1704	2026-09-21 14:59	77.42	OK
1705	2026-09-21 15:00	77.79	OK	1706	2026-09-21 15:01	80.52	OK
1707	2026-09-21 15:02	77.63	OK	1708	2026-09-21 15:03	79.63	OK
1709	2026-09-21 15:04	79.43	OK	1710	2026-09-21 15:05	76.85	OK
1711	2026-09-21 15:06	79.62	OK	1712	2026-09-21 15:07	79.90	OK
1713	2026-09-21 15:08	81.81	OK	1714	2026-09-21 15:09	78.60	OK
1715	2026-09-21 15:10	82.86	OK	1716	2026-09-21 15:11	80.66	OK
1717	2026-09-21 15:12	79.75	OK	1718	2026-09-21 15:13	80.29	OK
1719	2026-09-21 15:14	75.84	OK	1720	2026-09-21 15:15	83.28	OK
1721	2026-09-21 15:16	82.55	OK	1722	2026-09-21 15:17	78.40	OK
1723	2026-09-21 15:18	79.50	OK	1724	2026-09-21 15:19	80.35	OK
1725	2026-09-21 15:20	80.56	OK	1726	2026-09-21 15:21	80.47	OK
1727	2026-09-21 15:22	76.69	OK	1728	2026-09-21 15:23	81.99	OK
1729	2026-09-21 15:24	79.36	OK	1730	2026-09-21 15:25	81.49	OK
1731	2026-09-21 15:26	78.40	OK	1732	2026-09-21 15:27	77.34	OK
1733	2026-09-21 15:28	79.93	OK	1734	2026-09-21 15:29	78.73	OK
1735	2026-09-21 15:30	78.88	OK	1736	2026-09-21 15:31	78.14	OK
1737	2026-09-21 15:32	80.41	OK	1738	2026-09-21 15:33	80.18	OK
1739	2026-09-21 15:34	76.72	OK	1740	2026-09-21 15:35	83.02	OK
1741	2026-09-21 15:36	83.64	OK	1742	2026-09-21 15:37	80.63	OK
1743	2026-09-21 15:38	79.54	OK	1744	2026-09-21 15:39	79.98	OK
1745	2026-09-21 15:40	78.31	OK	1746	2026-09-21 15:41	81.02	OK
1747	2026-09-21 15:42	80.49	OK	1748	2026-09-21 15:43	78.68	OK
1749	2026-09-21 15:44	79.92	OK	1750	2026-09-21 15:45	81.23	OK
1751	2026-09-21 15:46	81.61	OK	1752	2026-09-21 15:47	78.16	OK
1753	2026-09-21 15:48	82.67	OK	1754	2026-09-21 15:49	80.27	OK
1755	2026-09-21 15:50	79.85	OK	1756	2026-09-21 15:51	79.48	OK
1757	2026-09-21 15:52	80.34	OK	1758	2026-09-21 15:53	77.66	OK
1759	2026-09-21 15:54	81.38	OK	1760	2026-09-21 15:55	79.30	OK
1761	2026-09-21 15:56	81.62	OK	1762	2026-09-21 15:57	79.42	OK
1763	2026-09-21 15:58	83.17	OK	1764	2026-09-21 15:59	76.73	OK
1765	2026-09-21 16:00	82.85	OK	1766	2026-09-21 16:01	82.07	OK
1767	2026-09-21 16:02	80.07	OK	1768	2026-09-21 16:03	81.58	OK
1769	2026-09-21 16:04	80.70	OK	1770	2026-09-21 16:05	79.47	OK
1771	2026-09-21 16:06	81.36	OK	1772	2026-09-21 16:07	79.04	OK
1773	2026-09-21 16:08	78.93	OK	1774	2026-09-21 16:09	84.18	OK
1775	2026-09-21 16:10	78.47	OK	1776	2026-09-21 16:11	79.83	OK
1777	2026-09-21 16:12	81.70	OK	1778	2026-09-21 16:13	81.84	OK
1779	2026-09-21 16:14	80.50	OK	1780	2026-09-21 16:15	79.50	OK
1781	2026-09-21 16:16	83.72	OK	1782	2026-09-21 16:17	78.74	OK
1783	2026-09-21 16:18	78.38	OK	1784	2026-09-21 16:19	83.49	OK
1785	2026-09-21 16:20	81.09	OK	1786	2026-09-21 16:21	82.30	OK
1787	2026-09-21 16:22	80.67	OK	1788	2026-09-21 16:23	80.65	OK
1789	2026-09-21 16:24	81.20	OK	1790	2026-09-21 16:25	79.90	OK
1791	2026-09-21 16:26	79.36	OK	1792	2026-09-21 16:27	80.63	OK
1793	2026-09-21 16:28	79.77	OK	1794	2026-09-21 16:29	81.25	OK
1795	2026-09-21 16:30	78.93	OK	1796	2026-09-21 16:31	80.32	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1797	2026-09-21 16:32	80.76	OK	1798	2026-09-21 16:33	79.32	OK
1799	2026-09-21 16:34	84.13	OK	1800	2026-09-21 16:35	81.46	OK
1801	2026-09-21 16:36	84.88	OK	1802	2026-09-21 16:37	79.69	OK
1803	2026-09-21 16:38	78.39	OK	1804	2026-09-21 16:39	82.65	OK
1805	2026-09-21 16:40	80.62	OK	1806	2026-09-21 16:41	84.98	OK
1807	2026-09-21 16:42	76.87	OK	1808	2026-09-21 16:43	81.07	OK
1809	2026-09-21 16:44	79.40	OK	1810	2026-09-21 16:45	80.84	OK
1811	2026-09-21 16:46	81.79	OK	1812	2026-09-21 16:47	82.49	OK
1813	2026-09-21 16:48	82.26	OK	1814	2026-09-21 16:49	82.12	OK
1815	2026-09-21 16:50	84.92	OK	1816	2026-09-21 16:51	79.18	OK
1817	2026-09-21 16:52	83.45	OK	1818	2026-09-21 16:53	80.07	OK
1819	2026-09-21 16:54	83.61	OK	1820	2026-09-21 16:55	81.21	OK
1821	2026-09-21 16:56	80.20	OK	1822	2026-09-21 16:57	81.36	OK
1823	2026-09-21 16:58	79.24	OK	1824	2026-09-21 16:59	79.96	OK
1825	2026-09-21 17:00	81.69	OK	1826	2026-09-21 17:01	79.54	OK
1827	2026-09-21 17:02	82.48	OK	1828	2026-09-21 17:03	84.47	OK
1829	2026-09-21 17:04	81.97	OK	1830	2026-09-21 17:05	79.70	OK
1831	2026-09-21 17:06	79.82	OK	1832	2026-09-21 17:07	82.25	OK
1833	2026-09-21 17:08	80.95	OK	1834	2026-09-21 17:09	80.17	OK
1835	2026-09-21 17:10	82.71	OK	1836	2026-09-21 17:11	79.80	OK
1837	2026-09-21 17:12	83.13	OK	1838	2026-09-21 17:13	82.26	OK
1839	2026-09-21 17:14	78.35	OK	1840	2026-09-21 17:15	82.67	OK
1841	2026-09-21 17:16	78.14	OK	1842	2026-09-21 17:17	83.10	OK
1843	2026-09-21 17:18	81.98	OK	1844	2026-09-21 17:19	79.35	OK
1845	2026-09-21 17:20	82.62	OK	1846	2026-09-21 17:21	77.50	OK
1847	2026-09-21 17:22	82.28	OK	1848	2026-09-21 17:23	82.68	OK
1849	2026-09-21 17:24	84.20	OK	1850	2026-09-21 17:25	80.65	OK
1851	2026-09-21 17:26	78.49	OK	1852	2026-09-21 17:27	82.23	OK
1853	2026-09-21 17:28	81.94	OK	1854	2026-09-21 17:29	80.23	OK
1855	2026-09-21 17:30	80.64	OK	1856	2026-09-21 17:31	81.90	OK
1857	2026-09-21 17:32	85.03	OK	1858	2026-09-21 17:33	79.54	OK
1859	2026-09-21 17:34	83.91	OK	1860	2026-09-21 17:35	79.22	OK
1861	2026-09-21 17:36	82.10	OK	1862	2026-09-21 17:37	81.78	OK
1863	2026-09-21 17:38	80.74	OK	1864	2026-09-21 17:39	82.58	OK
1865	2026-09-21 17:40	79.51	OK	1866	2026-09-21 17:41	83.60	OK
1867	2026-09-21 17:42	85.11	OK	1868	2026-09-21 17:43	78.90	OK
1869	2026-09-21 17:44	83.05	OK	1870	2026-09-21 17:45	82.62	OK
1871	2026-09-21 17:46	80.67	OK	1872	2026-09-21 17:47	82.50	OK
1873	2026-09-21 17:48	79.83	OK	1874	2026-09-21 17:49	83.18	OK
1875	2026-09-21 17:50	80.13	OK	1876	2026-09-21 17:51	81.94	OK
1877	2026-09-21 17:52	84.01	OK	1878	2026-09-21 17:53	84.02	OK
1879	2026-09-21 17:54	79.49	OK	1880	2026-09-21 17:55	82.13	OK
1881	2026-09-21 17:56	79.43	OK	1882	2026-09-21 17:57	83.45	OK
1883	2026-09-21 17:58	79.35	OK	1884	2026-09-21 17:59	85.86	OK
1885	2026-09-21 18:00	84.97	OK	1886	2026-09-21 18:01	81.21	OK
1887	2026-09-21 18:02	82.71	OK	1888	2026-09-21 18:03	83.35	OK
1889	2026-09-21 18:04	82.47	OK	1890	2026-09-21 18:05	81.99	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1891	2026-09-21 18:06	82.00	OK	1892	2026-09-21 18:07	77.92	OK
1893	2026-09-21 18:08	80.15	OK	1894	2026-09-21 18:09	80.85	OK
1895	2026-09-21 18:10	81.93	OK	1896	2026-09-21 18:11	83.71	OK
1897	2026-09-21 18:12	81.60	OK	1898	2026-09-21 18:13	80.28	OK
1899	2026-09-21 18:14	83.98	OK	1900	2026-09-21 18:15	83.20	OK
1901	2026-09-21 18:16	81.53	OK	1902	2026-09-21 18:17	81.52	OK
1903	2026-09-21 18:18	80.45	OK	1904	2026-09-21 18:19	82.33	OK
1905	2026-09-21 18:20	81.27	OK	1906	2026-09-21 18:21	82.58	OK
1907	2026-09-21 18:22	83.03	OK	1908	2026-09-21 18:23	84.61	OK
1909	2026-09-21 18:24	81.16	OK	1910	2026-09-21 18:25	82.38	OK
1911	2026-09-21 18:26	80.54	OK	1912	2026-09-21 18:27	81.32	OK
1913	2026-09-21 18:28	84.13	OK	1914	2026-09-21 18:29	80.87	OK
1915	2026-09-21 18:30	79.86	OK	1916	2026-09-21 18:31	80.26	OK
1917	2026-09-21 18:32	81.67	OK	1918	2026-09-21 18:33	82.17	OK
1919	2026-09-21 18:34	83.69	OK	1920	2026-09-21 18:35	81.41	OK
1921	2026-09-21 18:36	81.19	OK	1922	2026-09-21 18:37	82.27	OK
1923	2026-09-21 18:38	82.78	OK	1924	2026-09-21 18:39	80.90	OK
1925	2026-09-21 18:40	82.93	OK	1926	2026-09-21 18:41	82.97	OK
1927	2026-09-21 18:42	77.97	OK	1928	2026-09-21 18:43	79.08	OK
1929	2026-09-21 18:44	82.35	OK	1930	2026-09-21 18:45	84.58	OK
1931	2026-09-21 18:46	82.69	OK	1932	2026-09-21 18:47	81.21	OK
1933	2026-09-21 18:48	83.22	OK	1934	2026-09-21 18:49	80.19	OK
1935	2026-09-21 18:50	83.22	OK	1936	2026-09-21 18:51	80.29	OK
1937	2026-09-21 18:52	79.44	OK	1938	2026-09-21 18:53	80.98	OK
1939	2026-09-21 18:54	82.03	OK	1940	2026-09-21 18:55	81.95	OK
1941	2026-09-21 18:56	83.48	OK	1942	2026-09-21 18:57	82.17	OK
1943	2026-09-21 18:58	83.18	OK	1944	2026-09-21 18:59	83.45	OK
1945	2026-09-21 19:00	85.02	OK	1946	2026-09-21 19:01	81.58	OK
1947	2026-09-21 19:02	82.67	OK	1948	2026-09-21 19:03	83.44	OK
1949	2026-09-21 19:04	80.71	OK	1950	2026-09-21 19:05	82.53	OK
1951	2026-09-21 19:06	82.62	OK	1952	2026-09-21 19:07	82.65	OK
1953	2026-09-21 19:08	80.24	OK	1954	2026-09-21 19:09	83.17	OK
1955	2026-09-21 19:10	84.08	OK	1956	2026-09-21 19:11	79.59	OK
1957	2026-09-21 19:12	81.49	OK	1958	2026-09-21 19:13	80.93	OK
1959	2026-09-21 19:14	80.91	OK	1960	2026-09-21 19:15	80.43	OK
1961	2026-09-21 19:16	82.67	OK	1962	2026-09-21 19:17	81.83	OK
1963	2026-09-21 19:18	79.81	OK	1964	2026-09-21 19:19	82.69	OK
1965	2026-09-21 19:20	79.20	OK	1966	2026-09-21 19:21	80.71	OK
1967	2026-09-21 19:22	82.94	OK	1968	2026-09-21 19:23	79.91	OK
1969	2026-09-21 19:24	84.50	OK	1970	2026-09-21 19:25	79.55	OK
1971	2026-09-21 19:26	81.00	OK	1972	2026-09-21 19:27	82.08	OK
1973	2026-09-21 19:28	81.49	OK	1974	2026-09-21 19:29	83.18	OK
1975	2026-09-21 19:30	79.12	OK	1976	2026-09-21 19:31	82.44	OK
1977	2026-09-21 19:32	78.78	OK	1978	2026-09-21 19:33	83.21	OK
1979	2026-09-21 19:34	84.32	OK	1980	2026-09-21 19:35	82.79	OK
1981	2026-09-21 19:36	81.96	OK	1982	2026-09-21 19:37	83.10	OK
1983	2026-09-21 19:38	84.13	OK	1984	2026-09-21 19:39	80.83	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1985	2026-09-21 19:40	83.51	OK	1986	2026-09-21 19:41	78.69	OK
1987	2026-09-21 19:42	82.07	OK	1988	2026-09-21 19:43	84.16	OK
1989	2026-09-21 19:44	80.77	OK	1990	2026-09-21 19:45	80.76	OK
1991	2026-09-21 19:46	81.00	OK	1992	2026-09-21 19:47	81.06	OK
1993	2026-09-21 19:48	78.33	OK	1994	2026-09-21 19:49	77.79	OK
1995	2026-09-21 19:50	80.97	OK	1996	2026-09-21 19:51	83.75	OK
1997	2026-09-21 19:52	79.97	OK	1998	2026-09-21 19:53	82.67	OK
1999	2026-09-21 19:54	80.81	OK	2000	2026-09-21 19:55	80.95	OK
2001	2026-09-21 19:56	78.42	OK	2002	2026-09-21 19:57	83.85	OK
2003	2026-09-21 19:58	84.44	OK	2004	2026-09-21 19:59	81.18	OK
2005	2026-09-21 20:00	83.15	OK	2006	2026-09-21 20:01	80.68	OK
2007	2026-09-21 20:02	78.63	OK	2008	2026-09-21 20:03	81.44	OK
2009	2026-09-21 20:04	81.45	OK	2010	2026-09-21 20:05	80.14	OK
2011	2026-09-21 20:06	81.42	OK	2012	2026-09-21 20:07	82.06	OK
2013	2026-09-21 20:08	83.30	OK	2014	2026-09-21 20:09	82.88	OK
2015	2026-09-21 20:10	82.76	OK	2016	2026-09-21 20:11	83.51	OK
2017	2026-09-21 20:12	82.06	OK	2018	2026-09-21 20:13	81.60	OK
2019	2026-09-21 20:14	84.00	OK	2020	2026-09-21 20:15	81.22	OK
2021	2026-09-21 20:16	77.60	OK	2022	2026-09-21 20:17	83.84	OK
2023	2026-09-21 20:18	80.33	OK	2024	2026-09-21 20:19	82.53	OK
2025	2026-09-21 20:20	83.98	OK	2026	2026-09-21 20:21	81.64	OK
2027	2026-09-21 20:22	77.91	OK	2028	2026-09-21 20:23	83.27	OK
2029	2026-09-21 20:24	77.61	OK	2030	2026-09-21 20:25	79.73	OK
2031	2026-09-21 20:26	79.23	OK	2032	2026-09-21 20:27	79.19	OK
2033	2026-09-21 20:28	79.25	OK	2034	2026-09-21 20:29	80.49	OK
2035	2026-09-21 20:30	79.71	OK	2036	2026-09-21 20:31	82.57	OK
2037	2026-09-21 20:32	83.70	OK	2038	2026-09-21 20:33	83.84	OK
2039	2026-09-21 20:34	79.02	OK	2040	2026-09-21 20:35	80.50	OK
2041	2026-09-21 20:36	79.89	OK	2042	2026-09-21 20:37	79.33	OK
2043	2026-09-21 20:38	80.78	OK	2044	2026-09-21 20:39	83.00	OK
2045	2026-09-21 20:40	80.47	OK	2046	2026-09-21 20:41	82.61	OK
2047	2026-09-21 20:42	82.60	OK	2048	2026-09-21 20:43	79.41	OK
2049	2026-09-21 20:44	80.06	OK	2050	2026-09-21 20:45	81.17	OK
2051	2026-09-21 20:46	78.48	OK	2052	2026-09-21 20:47	77.36	OK
2053	2026-09-21 20:48	82.82	OK	2054	2026-09-21 20:49	80.48	OK
2055	2026-09-21 20:50	80.99	OK	2056	2026-09-21 20:51	81.17	OK
2057	2026-09-21 20:52	80.80	OK	2058	2026-09-21 20:53	79.00	OK
2059	2026-09-21 20:54	79.49	OK	2060	2026-09-21 20:55	79.75	OK
2061	2026-09-21 20:56	80.17	OK	2062	2026-09-21 20:57	80.73	OK
2063	2026-09-21 20:58	77.99	OK	2064	2026-09-21 20:59	78.19	OK
2065	2026-09-21 21:00	80.42	OK	2066	2026-09-21 21:01	80.47	OK
2067	2026-09-21 21:02	81.75	OK	2068	2026-09-21 21:03	81.77	OK
2069	2026-09-21 21:04	78.42	OK	2070	2026-09-21 21:05	79.43	OK
2071	2026-09-21 21:06	79.72	OK	2072	2026-09-21 21:07	84.44	OK
2073	2026-09-21 21:08	78.83	OK	2074	2026-09-21 21:09	80.11	OK
2075	2026-09-21 21:10	79.18	OK	2076	2026-09-21 21:11	79.11	OK
2077	2026-09-21 21:12	80.07	OK	2078	2026-09-21 21:13	76.72	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2079	2026-09-21 21:14	82.55	OK	2080	2026-09-21 21:15	80.93	OK
2081	2026-09-21 21:16	82.13	OK	2082	2026-09-21 21:17	79.48	OK
2083	2026-09-21 21:18	77.48	OK	2084	2026-09-21 21:19	80.94	OK
2085	2026-09-21 21:20	81.84	OK	2086	2026-09-21 21:21	82.70	OK
2087	2026-09-21 21:22	79.79	OK	2088	2026-09-21 21:23	82.14	OK
2089	2026-09-21 21:24	80.43	OK	2090	2026-09-21 21:25	80.16	OK
2091	2026-09-21 21:26	82.21	OK	2092	2026-09-21 21:27	80.30	OK
2093	2026-09-21 21:28	80.70	OK	2094	2026-09-21 21:29	79.47	OK
2095	2026-09-21 21:30	79.14	OK	2096	2026-09-21 21:31	80.03	OK
2097	2026-09-21 21:32	81.00	OK	2098	2026-09-21 21:33	76.49	OK
2099	2026-09-21 21:34	77.49	OK	2100	2026-09-21 21:35	77.38	OK
2101	2026-09-21 21:36	79.53	OK	2102	2026-09-21 21:37	81.73	OK
2103	2026-09-21 21:38	76.96	OK	2104	2026-09-21 21:39	76.26	OK
2105	2026-09-21 21:40	79.67	OK	2106	2026-09-21 21:41	81.10	OK
2107	2026-09-21 21:42	81.54	OK	2108	2026-09-21 21:43	79.75	OK
2109	2026-09-21 21:44	78.86	OK	2110	2026-09-21 21:45	78.90	OK
2111	2026-09-21 21:46	82.27	OK	2112	2026-09-21 21:47	77.37	OK
2113	2026-09-21 21:48	77.89	OK	2114	2026-09-21 21:49	79.10	OK
2115	2026-09-21 21:50	79.07	OK	2116	2026-09-21 21:51	80.12	OK
2117	2026-09-21 21:52	80.14	OK	2118	2026-09-21 21:53	80.20	OK
2119	2026-09-21 21:54	80.18	OK	2120	2026-09-21 21:55	79.62	OK
2121	2026-09-21 21:56	80.47	OK	2122	2026-09-21 21:57	78.97	OK
2123	2026-09-21 21:58	80.84	OK	2124	2026-09-21 21:59	79.96	OK
2125	2026-09-21 22:00	77.93	OK	2126	2026-09-21 22:01	79.05	OK
2127	2026-09-21 22:02	80.46	OK	2128	2026-09-21 22:03	79.60	OK
2129	2026-09-21 22:04	77.77	OK	2130	2026-09-21 22:05	77.37	OK
2131	2026-09-21 22:06	77.47	OK	2132	2026-09-21 22:07	80.62	OK
2133	2026-09-21 22:08	79.35	OK	2134	2026-09-21 22:09	78.89	OK
2135	2026-09-21 22:10	78.42	OK	2136	2026-09-21 22:11	79.98	OK
2137	2026-09-21 22:12	80.61	OK	2138	2026-09-21 22:13	76.10	OK
2139	2026-09-21 22:14	78.18	OK	2140	2026-09-21 22:15	76.23	OK
2141	2026-09-21 22:16	76.19	OK	2142	2026-09-21 22:17	80.12	OK
2143	2026-09-21 22:18	81.73	OK	2144	2026-09-21 22:19	77.67	OK
2145	2026-09-21 22:20	75.50	OK	2146	2026-09-21 22:21	78.51	OK
2147	2026-09-21 22:22	80.41	OK	2148	2026-09-21 22:23	77.72	OK
2149	2026-09-21 22:24	78.96	OK	2150	2026-09-21 22:25	78.10	OK
2151	2026-09-21 22:26	76.49	OK	2152	2026-09-21 22:27	80.56	OK
2153	2026-09-21 22:28	78.51	OK	2154	2026-09-21 22:29	80.14	OK
2155	2026-09-21 22:30	78.69	OK	2156	2026-09-21 22:31	79.35	OK
2157	2026-09-21 22:32	74.90	OK	2158	2026-09-21 22:33	77.08	OK
2159	2026-09-21 22:34	76.85	OK	2160	2026-09-21 22:35	77.72	OK
2161	2026-09-21 22:36	78.74	OK	2162	2026-09-21 22:37	78.48	OK
2163	2026-09-21 22:38	79.12	OK	2164	2026-09-21 22:39	76.45	OK
2165	2026-09-21 22:40	76.51	OK	2166	2026-09-21 22:41	79.30	OK
2167	2026-09-21 22:42	76.92	OK	2168	2026-09-21 22:43	75.68	OK
2169	2026-09-21 22:44	75.80	OK	2170	2026-09-21 22:45	77.17	OK
2171	2026-09-21 22:46	79.29	OK	2172	2026-09-21 22:47	79.12	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2173	2026-09-21 22:48	76.17	OK	2174	2026-09-21 22:49	78.33	OK
2175	2026-09-21 22:50	77.66	OK	2176	2026-09-21 22:51	76.40	OK
2177	2026-09-21 22:52	79.40	OK	2178	2026-09-21 22:53	78.81	OK
2179	2026-09-21 22:54	76.35	OK	2180	2026-09-21 22:55	77.43	OK
2181	2026-09-21 22:56	77.48	OK	2182	2026-09-21 22:57	78.10	OK
2183	2026-09-21 22:58	76.07	OK	2184	2026-09-21 22:59	76.31	OK
2185	2026-09-21 23:00	73.87	OK	2186	2026-09-21 23:01	79.83	OK
2187	2026-09-21 23:02	75.38	OK	2188	2026-09-21 23:03	81.18	OK
2189	2026-09-21 23:04	78.44	OK	2190	2026-09-21 23:05	77.63	OK
2191	2026-09-21 23:06	76.42	OK	2192	2026-09-21 23:07	77.71	OK
2193	2026-09-21 23:08	79.75	OK	2194	2026-09-21 23:09	75.66	OK
2195	2026-09-21 23:10	79.16	OK	2196	2026-09-21 23:11	74.66	OK
2197	2026-09-21 23:12	73.26	OK	2198	2026-09-21 23:13	77.48	OK
2199	2026-09-21 23:14	77.93	OK	2200	2026-09-21 23:15	76.64	OK
2201	2026-09-21 23:16	75.98	OK	2202	2026-09-21 23:17	76.58	OK
2203	2026-09-21 23:18	76.27	OK	2204	2026-09-21 23:19	76.25	OK
2205	2026-09-21 23:20	75.14	OK	2206	2026-09-21 23:21	77.20	OK
2207	2026-09-21 23:22	78.77	OK	2208	2026-09-21 23:23	77.10	OK
2209	2026-09-21 23:24	76.16	OK	2210	2026-09-21 23:25	78.17	OK
2211	2026-09-21 23:26	74.65	OK	2212	2026-09-21 23:27	78.08	OK
2213	2026-09-21 23:28	80.06	OK	2214	2026-09-21 23:29	76.84	OK
2215	2026-09-21 23:30	74.60	OK	2216	2026-09-21 23:31	80.41	OK
2217	2026-09-21 23:32	77.22	OK	2218	2026-09-21 23:33	74.32	OK
2219	2026-09-21 23:34	74.73	OK	2220	2026-09-21 23:35	74.87	OK
2221	2026-09-21 23:36	77.58	OK	2222	2026-09-21 23:37	79.20	OK
2223	2026-09-21 23:38	78.91	OK	2224	2026-09-21 23:39	73.47	OK
2225	2026-09-21 23:40	75.51	OK	2226	2026-09-21 23:41	75.04	OK
2227	2026-09-21 23:42	74.10	OK	2228	2026-09-21 23:43	72.65	OK
2229	2026-09-21 23:44	74.73	OK	2230	2026-09-21 23:45	78.18	OK
2231	2026-09-21 23:46	76.81	OK	2232	2026-09-21 23:47	76.48	OK
2233	2026-09-21 23:48	77.85	OK	2234	2026-09-21 23:49	73.98	OK
2235	2026-09-21 23:50	76.15	OK	2236	2026-09-21 23:51	76.21	OK
2237	2026-09-21 23:52	77.54	OK	2238	2026-09-21 23:53	76.40	OK
2239	2026-09-21 23:54	75.98	OK	2240	2026-09-21 23:55	73.73	OK
2241	2026-09-21 23:56	77.32	OK	2242	2026-09-21 23:57	75.13	OK
2243	2026-09-21 23:58	77.63	OK	2244	2026-09-21 23:59	76.46	OK
2245	2026-09-22 00:00	75.43	OK	2246	2026-09-22 00:01	76.15	OK
2247	2026-09-22 00:02	72.45	OK	2248	2026-09-22 00:03	77.78	OK
2249	2026-09-22 00:04	78.02	OK	2250	2026-09-22 00:05	76.52	OK
2251	2026-09-22 00:06	71.55	OK	2252	2026-09-22 00:07	76.30	OK
2253	2026-09-22 00:08	77.69	OK	2254	2026-09-22 00:09	78.51	OK
2255	2026-09-22 00:10	77.34	OK	2256	2026-09-22 00:11	75.27	OK
2257	2026-09-22 00:12	74.30	OK	2258	2026-09-22 00:13	75.93	OK
2259	2026-09-22 00:14	75.63	OK	2260	2026-09-22 00:15	74.37	OK
2261	2026-09-22 00:16	72.03	OK	2262	2026-09-22 00:17	76.46	OK
2263	2026-09-22 00:18	73.83	OK	2264	2026-09-22 00:19	74.78	OK
2265	2026-09-22 00:20	73.12	OK	2266	2026-09-22 00:21	74.45	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2267	2026-09-22 00:22	76.14	OK	2268	2026-09-22 00:23	76.03	OK
2269	2026-09-22 00:24	78.79	OK	2270	2026-09-22 00:25	75.96	OK
2271	2026-09-22 00:26	73.14	OK	2272	2026-09-22 00:27	74.21	OK
2273	2026-09-22 00:28	75.83	OK	2274	2026-09-22 00:29	75.35	OK
2275	2026-09-22 00:30	74.98	OK	2276	2026-09-22 00:31	73.03	OK
2277	2026-09-22 00:32	73.26	OK	2278	2026-09-22 00:33	74.65	OK
2279	2026-09-22 00:34	72.80	OK	2280	2026-09-22 00:35	73.69	OK
2281	2026-09-22 00:36	74.46	OK	2282	2026-09-22 00:37	74.81	OK
2283	2026-09-22 00:38	74.83	OK	2284	2026-09-22 00:39	76.20	OK
2285	2026-09-22 00:40	75.05	OK	2286	2026-09-22 00:41	73.47	OK
2287	2026-09-22 00:42	76.42	OK	2288	2026-09-22 00:43	71.02	OK
2289	2026-09-22 00:44	75.84	OK	2290	2026-09-22 00:45	71.27	OK
2291	2026-09-22 00:46	71.76	OK	2292	2026-09-22 00:47	71.77	OK
2293	2026-09-22 00:48	72.92	OK	2294	2026-09-22 00:49	77.52	OK
2295	2026-09-22 00:50	75.56	OK	2296	2026-09-22 00:51	74.87	OK
2297	2026-09-22 00:52	71.97	OK	2298	2026-09-22 00:53	74.09	OK
2299	2026-09-22 00:54	74.73	OK	2300	2026-09-22 00:55	74.76	OK
2301	2026-09-22 00:56	76.18	OK	2302	2026-09-22 00:57	75.18	OK
2303	2026-09-22 00:58	72.27	OK	2304	2026-09-22 00:59	75.36	OK
2305	2026-09-22 01:00	74.86	OK	2306	2026-09-22 01:01	77.32	OK
2307	2026-09-22 01:02	70.58	OK	2308	2026-09-22 01:03	73.62	OK
2309	2026-09-22 01:04	73.42	OK	2310	2026-09-22 01:05	74.21	OK
2311	2026-09-22 01:06	76.02	OK	2312	2026-09-22 01:07	71.42	OK
2313	2026-09-22 01:08	73.88	OK	2314	2026-09-22 01:09	72.32	OK
2315	2026-09-22 01:10	73.11	OK	2316	2026-09-22 01:11	73.05	OK
2317	2026-09-22 01:12	74.33	OK	2318	2026-09-22 01:13	71.44	OK
2319	2026-09-22 01:14	74.11	OK	2320	2026-09-22 01:15	73.43	OK
2321	2026-09-22 01:16	71.49	OK	2322	2026-09-22 01:17	71.56	OK
2323	2026-09-22 01:18	75.00	OK	2324	2026-09-22 01:19	71.40	OK
2325	2026-09-22 01:20	75.59	OK	2326	2026-09-22 01:21	70.21	OK
2327	2026-09-22 01:22	73.16	OK	2328	2026-09-22 01:23	75.68	OK
2329	2026-09-22 01:24	74.17	OK	2330	2026-09-22 01:25	69.03	OK
2331	2026-09-22 01:26	74.28	OK	2332	2026-09-22 01:27	75.62	OK
2333	2026-09-22 01:28	72.86	OK	2334	2026-09-22 01:29	75.47	OK
2335	2026-09-22 01:30	72.98	OK	2336	2026-09-22 01:31	73.28	OK
2337	2026-09-22 01:32	73.66	OK	2338	2026-09-22 01:33	72.46	OK
2339	2026-09-22 01:34	72.01	OK	2340	2026-09-22 01:35	72.30	OK
2341	2026-09-22 01:36	74.51	OK	2342	2026-09-22 01:37	75.18	OK
2343	2026-09-22 01:38	70.44	OK	2344	2026-09-22 01:39	75.65	OK
2345	2026-09-22 01:40	69.18	OK	2346	2026-09-22 01:41	70.06	OK
2347	2026-09-22 01:42	74.42	OK	2348	2026-09-22 01:43	71.93	OK
2349	2026-09-22 01:44	72.72	OK	2350	2026-09-22 01:45	72.68	OK
2351	2026-09-22 01:46	73.85	OK	2352	2026-09-22 01:47	71.96	OK
2353	2026-09-22 01:48	71.40	OK	2354	2026-09-22 01:49	70.51	OK
2355	2026-09-22 01:50	72.00	OK	2356	2026-09-22 01:51	71.30	OK
2357	2026-09-22 01:52	73.98	OK	2358	2026-09-22 01:53	71.52	OK
2359	2026-09-22 01:54	73.37	OK	2360	2026-09-22 01:55	73.14	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2361	2026-09-22 01:56	73.30	OK	2362	2026-09-22 01:57	72.13	OK
2363	2026-09-22 01:58	75.04	OK	2364	2026-09-22 01:59	69.91	OK
2365	2026-09-22 02:00	71.78	OK	2366	2026-09-22 02:01	71.36	OK
2367	2026-09-22 02:02	71.37	OK	2368	2026-09-22 02:03	69.63	OK
2369	2026-09-22 02:04	74.18	OK	2370	2026-09-22 02:05	74.53	OK
2371	2026-09-22 02:06	73.40	OK	2372	2026-09-22 02:07	74.65	OK
2373	2026-09-22 02:08	73.37	OK	2374	2026-09-22 02:09	74.97	OK
2375	2026-09-22 02:10	72.22	OK	2376	2026-09-22 02:11	69.67	OK
2377	2026-09-22 02:12	71.64	OK	2378	2026-09-22 02:13	71.31	OK
2379	2026-09-22 02:14	72.77	OK	2380	2026-09-22 02:15	71.04	OK
2381	2026-09-22 02:16	74.69	OK	2382	2026-09-22 02:17	71.44	OK
2383	2026-09-22 02:18	68.73	OK	2384	2026-09-22 02:19	69.00	OK
2385	2026-09-22 02:20	71.59	OK	2386	2026-09-22 02:21	71.66	OK
2387	2026-09-22 02:22	70.19	OK	2388	2026-09-22 02:23	71.46	OK
2389	2026-09-22 02:24	70.92	OK	2390	2026-09-22 02:25	70.44	OK
2391	2026-09-22 02:26	67.67	OK	2392	2026-09-22 02:27	70.99	OK
2393	2026-09-22 02:28	68.88	OK	2394	2026-09-22 02:29	71.07	OK
2395	2026-09-22 02:30	72.00	OK	2396	2026-09-22 02:31	69.63	OK
2397	2026-09-22 02:32	70.34	OK	2398	2026-09-22 02:33	69.95	OK
2399	2026-09-22 02:34	73.97	OK	2400	2026-09-22 02:35	72.33	OK
2401	2026-09-22 02:36	68.93	OK	2402	2026-09-22 02:37	74.08	OK
2403	2026-09-22 02:38	68.74	OK	2404	2026-09-22 02:39	70.59	OK
2405	2026-09-22 02:40	67.71	OK	2406	2026-09-22 02:41	71.61	OK
2407	2026-09-22 02:42	67.19	OK	2408	2026-09-22 02:43	69.49	OK
2409	2026-09-22 02:44	69.72	OK	2410	2026-09-22 02:45	71.72	OK
2411	2026-09-22 02:46	69.85	OK	2412	2026-09-22 02:47	72.06	OK
2413	2026-09-22 02:48	72.27	OK	2414	2026-09-22 02:49	71.87	OK
2415	2026-09-22 02:50	72.34	OK	2416	2026-09-22 02:51	68.96	OK
2417	2026-09-22 02:52	72.77	OK	2418	2026-09-22 02:53	72.80	OK
2419	2026-09-22 02:54	74.39	OK	2420	2026-09-22 02:55	71.49	OK
2421	2026-09-22 02:56	71.64	OK	2422	2026-09-22 02:57	74.10	OK
2423	2026-09-22 02:58	73.71	OK	2424	2026-09-22 02:59	74.40	OK
2425	2026-09-22 03:00	68.25	OK	2426	2026-09-22 03:01	71.60	OK
2427	2026-09-22 03:02	71.87	OK	2428	2026-09-22 03:03	69.12	OK
2429	2026-09-22 03:04	70.99	OK	2430	2026-09-22 03:05	68.33	OK
2431	2026-09-22 03:06	69.75	OK	2432	2026-09-22 03:07	71.55	OK
2433	2026-09-22 03:08	70.85	OK	2434	2026-09-22 03:09	66.70	OK
2435	2026-09-22 03:10	69.95	OK	2436	2026-09-22 03:11	69.62	OK
2437	2026-09-22 03:12	69.47	OK	2438	2026-09-22 03:13	67.42	OK
2439	2026-09-22 03:14	69.77	OK	2440	2026-09-22 03:15	71.24	OK
2441	2026-09-22 03:16	70.58	OK	2442	2026-09-22 03:17	69.80	OK
2443	2026-09-22 03:18	72.88	OK	2444	2026-09-22 03:19	69.78	OK
2445	2026-09-22 03:20	72.59	OK	2446	2026-09-22 03:21	67.89	OK
2447	2026-09-22 03:22	71.43	OK	2448	2026-09-22 03:23	69.86	OK
2449	2026-09-22 03:24	67.94	OK	2450	2026-09-22 03:25	70.67	OK
2451	2026-09-22 03:26	72.53	OK	2452	2026-09-22 03:27	70.35	OK
2453	2026-09-22 03:28	69.45	OK	2454	2026-09-22 03:29	69.88	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2455	2026-09-22 03:30	68.11	OK	2456	2026-09-22 03:31	67.82	OK
2457	2026-09-22 03:32	68.48	OK	2458	2026-09-22 03:33	70.40	OK
2459	2026-09-22 03:34	69.24	OK	2460	2026-09-22 03:35	69.14	OK
2461	2026-09-22 03:36	67.57	OK	2462	2026-09-22 03:37	70.98	OK
2463	2026-09-22 03:38	67.60	OK	2464	2026-09-22 03:39	68.73	OK
2465	2026-09-22 03:40	65.33	OK	2466	2026-09-22 03:41	66.34	OK
2467	2026-09-22 03:42	68.84	OK	2468	2026-09-22 03:43	71.47	OK
2469	2026-09-22 03:44	68.69	OK	2470	2026-09-22 03:45	70.11	OK
2471	2026-09-22 03:46	65.66	OK	2472	2026-09-22 03:47	69.96	OK
2473	2026-09-22 03:48	69.77	OK	2474	2026-09-22 03:49	70.72	OK
2475	2026-09-22 03:50	70.94	OK	2476	2026-09-22 03:51	67.96	OK
2477	2026-09-22 03:52	70.16	OK	2478	2026-09-22 03:53	67.75	OK
2479	2026-09-22 03:54	72.58	OK	2480	2026-09-22 03:55	65.47	OK
2481	2026-09-22 03:56	69.65	OK	2482	2026-09-22 03:57	71.39	OK
2483	2026-09-22 03:58	70.55	OK	2484	2026-09-22 03:59	66.50	OK
2485	2026-09-22 04:00	68.19	OK	2486	2026-09-22 04:01	67.88	OK
2487	2026-09-22 04:02	67.71	OK	2488	2026-09-22 04:03	70.45	OK
2489	2026-09-22 04:04	67.12	OK	2490	2026-09-22 04:05	69.77	OK
2491	2026-09-22 04:06	71.44	OK	2492	2026-09-22 04:07	66.56	OK
2493	2026-09-22 04:08	69.07	OK	2494	2026-09-22 04:09	69.33	OK
2495	2026-09-22 04:10	67.70	OK	2496	2026-09-22 04:11	67.71	OK
2497	2026-09-22 04:12	68.75	OK	2498	2026-09-22 04:13	69.45	OK
2499	2026-09-22 04:14	67.45	OK	2500	2026-09-22 04:15	69.20	OK
2501	2026-09-22 04:16	71.66	OK	2502	2026-09-22 04:17	72.19	OK
2503	2026-09-22 04:18	67.71	OK	2504	2026-09-22 04:19	70.21	OK
2505	2026-09-22 04:20	68.03	OK	2506	2026-09-22 04:21	67.36	OK
2507	2026-09-22 04:22	67.42	OK	2508	2026-09-22 04:23	70.94	OK
2509	2026-09-22 04:24	66.40	OK	2510	2026-09-22 04:25	69.29	OK
2511	2026-09-22 04:26	69.67	OK	2512	2026-09-22 04:27	65.39	OK
2513	2026-09-22 04:28	71.89	OK	2514	2026-09-22 04:29	66.84	OK
2515	2026-09-22 04:30	66.61	OK	2516	2026-09-22 04:31	66.44	OK
2517	2026-09-22 04:32	68.29	OK	2518	2026-09-22 04:33	71.30	OK
2519	2026-09-22 04:34	68.40	OK	2520	2026-09-22 04:35	70.51	OK
2521	2026-09-22 04:36	69.77	OK	2522	2026-09-22 04:37	68.94	OK
2523	2026-09-22 04:38	68.88	OK	2524	2026-09-22 04:39	66.31	OK
2525	2026-09-22 04:40	67.78	OK	2526	2026-09-22 04:41	67.35	OK
2527	2026-09-22 04:42	69.18	OK	2528	2026-09-22 04:43	68.19	OK
2529	2026-09-22 04:44	69.98	OK	2530	2026-09-22 04:45	65.17	OK
2531	2026-09-22 04:46	68.69	OK	2532	2026-09-22 04:47	69.98	OK
2533	2026-09-22 04:48	65.46	OK	2534	2026-09-22 04:49	69.12	OK
2535	2026-09-22 04:50	69.71	OK	2536	2026-09-22 04:51	70.09	OK
2537	2026-09-22 04:52	69.99	OK	2538	2026-09-22 04:53	69.91	OK
2539	2026-09-22 04:54	66.80	OK	2540	2026-09-22 04:55	66.86	OK
2541	2026-09-22 04:56	67.69	OK	2542	2026-09-22 04:57	69.30	OK
2543	2026-09-22 04:58	71.20	OK	2544	2026-09-22 04:59	68.10	OK
2545	2026-09-22 05:00	68.26	OK	2546	2026-09-22 05:01	69.67	OK
2547	2026-09-22 05:02	70.93	OK	2548	2026-09-22 05:03	69.18	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2549	2026-09-22 05:04	69.23	OK	2550	2026-09-22 05:05	68.88	OK
2551	2026-09-22 05:06	68.13	OK	2552	2026-09-22 05:07	69.89	OK
2553	2026-09-22 05:08	71.67	OK	2554	2026-09-22 05:09	66.34	OK
2555	2026-09-22 05:10	66.98	OK	2556	2026-09-22 05:11	66.23	OK
2557	2026-09-22 05:12	68.23	OK	2558	2026-09-22 05:13	67.67	OK
2559	2026-09-22 05:14	68.64	OK	2560	2026-09-22 05:15	66.93	OK
2561	2026-09-22 05:16	65.08	OK	2562	2026-09-22 05:17	66.17	OK
2563	2026-09-22 05:18	67.95	OK	2564	2026-09-22 05:19	68.48	OK
2565	2026-09-22 05:20	68.45	OK	2566	2026-09-22 05:21	67.41	OK
2567	2026-09-22 05:22	66.38	OK	2568	2026-09-22 05:23	67.88	OK
2569	2026-09-22 05:24	71.20	OK	2570	2026-09-22 05:25	68.04	OK
2571	2026-09-22 05:26	68.94	OK	2572	2026-09-22 05:27	67.44	OK
2573	2026-09-22 05:28	70.46	OK	2574	2026-09-22 05:29	64.73	OK
2575	2026-09-22 05:30	71.35	OK	2576	2026-09-22 05:31	68.18	OK
2577	2026-09-22 05:32	66.91	OK	2578	2026-09-22 05:33	68.01	OK
2579	2026-09-22 05:34	67.03	OK	2580	2026-09-22 05:35	65.81	OK
2581	2026-09-22 05:36	68.49	OK	2582	2026-09-22 05:37	67.00	OK
2583	2026-09-22 05:38	67.96	OK	2584	2026-09-22 05:39	67.49	OK
2585	2026-09-22 05:40	68.49	OK	2586	2026-09-22 05:41	70.42	OK
2587	2026-09-22 05:42	68.71	OK	2588	2026-09-22 05:43	71.15	OK
2589	2026-09-22 05:44	68.84	OK	2590	2026-09-22 05:45	68.59	OK
2591	2026-09-22 05:46	68.90	OK	2592	2026-09-22 05:47	69.07	OK
2593	2026-09-22 05:48	70.47	OK	2594	2026-09-22 05:49	69.36	OK
2595	2026-09-22 05:50	65.45	OK	2596	2026-09-22 05:51	64.06	OK
2597	2026-09-22 05:52	70.46	OK	2598	2026-09-22 05:53	64.57	OK
2599	2026-09-22 05:54	68.16	OK	2600	2026-09-22 05:55	67.96	OK
2601	2026-09-22 05:56	66.40	OK	2602	2026-09-22 05:57	67.34	OK
2603	2026-09-22 05:58	70.77	OK	2604	2026-09-22 05:59	68.83	OK
2605	2026-09-22 06:00	67.67	OK	2606	2026-09-22 06:01	67.49	OK
2607	2026-09-22 06:02	67.07	OK	2608	2026-09-22 06:03	67.17	OK
2609	2026-09-22 06:04	63.76	OK	2610	2026-09-22 06:05	63.88	OK
2611	2026-09-22 06:06	68.71	OK	2612	2026-09-22 06:07	66.64	OK
2613	2026-09-22 06:08	65.97	OK	2614	2026-09-22 06:09	68.21	OK
2615	2026-09-22 06:10	69.07	OK	2616	2026-09-22 06:11	68.67	OK
2617	2026-09-22 06:12	67.72	OK	2618	2026-09-22 06:13	67.00	OK
2619	2026-09-22 06:14	66.73	OK	2620	2026-09-22 06:15	66.55	OK
2621	2026-09-22 06:16	65.25	OK	2622	2026-09-22 06:17	69.03	OK
2623	2026-09-22 06:18	67.56	OK	2624	2026-09-22 06:19	67.52	OK
2625	2026-09-22 06:20	67.07	OK	2626	2026-09-22 06:21	70.69	OK
2627	2026-09-22 06:22	66.58	OK	2628	2026-09-22 06:23	66.71	OK
2629	2026-09-22 06:24	67.82	OK	2630	2026-09-22 06:25	67.33	OK
2631	2026-09-22 06:26	67.34	OK	2632	2026-09-22 06:27	68.69	OK
2633	2026-09-22 06:28	65.80	OK	2634	2026-09-22 06:29	65.28	OK
2635	2026-09-22 06:30	68.36	OK	2636	2026-09-22 06:31	68.54	OK
2637	2026-09-22 06:32	64.03	OK	2638	2026-09-22 06:33	67.36	OK
2639	2026-09-22 06:34	69.29	OK	2640	2026-09-22 06:35	68.64	OK
2641	2026-09-22 06:36	68.22	OK	2642	2026-09-22 06:37	67.58	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2643	2026-09-22 06:38	66.63	OK	2644	2026-09-22 06:39	67.52	OK
2645	2026-09-22 06:40	66.19	OK	2646	2026-09-22 06:41	67.71	OK
2647	2026-09-22 06:42	66.89	OK	2648	2026-09-22 06:43	67.38	OK
2649	2026-09-22 06:44	70.98	OK	2650	2026-09-22 06:45	66.22	OK
2651	2026-09-22 06:46	64.17	OK	2652	2026-09-22 06:47	68.93	OK
2653	2026-09-22 06:48	66.40	OK	2654	2026-09-22 06:49	67.05	OK
2655	2026-09-22 06:50	65.56	OK	2656	2026-09-22 06:51	68.42	OK
2657	2026-09-22 06:52	65.61	OK	2658	2026-09-22 06:53	65.07	OK
2659	2026-09-22 06:54	69.86	OK	2660	2026-09-22 06:55	70.62	OK
2661	2026-09-22 06:56	68.08	OK	2662	2026-09-22 06:57	68.90	OK
2663	2026-09-22 06:58	69.31	OK	2664	2026-09-22 06:59	68.30	OK
2665	2026-09-22 07:00	68.63	OK	2666	2026-09-22 07:01	70.27	OK
2667	2026-09-22 07:02	71.56	OK	2668	2026-09-22 07:03	70.47	OK
2669	2026-09-22 07:04	68.13	OK	2670	2026-09-22 07:05	66.44	OK
2671	2026-09-22 07:06	66.69	OK	2672	2026-09-22 07:07	67.04	OK
2673	2026-09-22 07:08	67.04	OK	2674	2026-09-22 07:09	70.35	OK
2675	2026-09-22 07:10	68.50	OK	2676	2026-09-22 07:11	64.07	OK
2677	2026-09-22 07:12	68.20	OK	2678	2026-09-22 07:13	68.36	OK
2679	2026-09-22 07:14	67.69	OK	2680	2026-09-22 07:15	67.57	OK
2681	2026-09-22 07:16	71.37	OK	2682	2026-09-22 07:17	68.28	OK
2683	2026-09-22 07:18	67.32	OK	2684	2026-09-22 07:19	68.89	OK
2685	2026-09-22 07:20	67.52	OK	2686	2026-09-22 07:21	70.90	OK
2687	2026-09-22 07:22	68.96	OK	2688	2026-09-22 07:23	68.66	OK
2689	2026-09-22 07:24	65.80	OK	2690	2026-09-22 07:25	70.91	OK
2691	2026-09-22 07:26	69.01	OK	2692	2026-09-22 07:27	70.22	OK
2693	2026-09-22 07:28	67.12	OK	2694	2026-09-22 07:29	69.25	OK
2695	2026-09-22 07:30	71.90	OK	2696	2026-09-22 07:31	66.61	OK
2697	2026-09-22 07:32	69.14	OK	2698	2026-09-22 07:33	66.36	OK
2699	2026-09-22 07:34	64.35	OK	2700	2026-09-22 07:35	68.81	OK
2701	2026-09-22 07:36	69.12	OK	2702	2026-09-22 07:37	65.38	OK
2703	2026-09-22 07:38	67.61	OK	2704	2026-09-22 07:39	67.48	OK
2705	2026-09-22 07:40	67.88	OK	2706	2026-09-22 07:41	68.75	OK
2707	2026-09-22 07:42	67.16	OK	2708	2026-09-22 07:43	63.90	OK
2709	2026-09-22 07:44	68.00	OK	2710	2026-09-22 07:45	66.92	OK
2711	2026-09-22 07:46	64.97	OK	2712	2026-09-22 07:47	66.81	OK
2713	2026-09-22 07:48	70.21	OK	2714	2026-09-22 07:49	69.80	OK
2715	2026-09-22 07:50	72.05	OK	2716	2026-09-22 07:51	69.99	OK
2717	2026-09-22 07:52	67.65	OK	2718	2026-09-22 07:53	70.39	OK
2719	2026-09-22 07:54	69.73	OK	2720	2026-09-22 07:55	68.59	OK
2721	2026-09-22 07:56	66.72	OK	2722	2026-09-22 07:57	68.77	OK
2723	2026-09-22 07:58	67.80	OK	2724	2026-09-22 07:59	69.05	OK
2725	2026-09-22 08:00	66.20	OK	2726	2026-09-22 08:01	70.96	OK
2727	2026-09-22 08:02	68.41	OK	2728	2026-09-22 08:03	69.97	OK
2729	2026-09-22 08:04	70.16	OK	2730	2026-09-22 08:05	64.86	OK
2731	2026-09-22 08:06	66.42	OK	2732	2026-09-22 08:07	72.26	OK
2733	2026-09-22 08:08	72.15	OK	2734	2026-09-22 08:09	70.97	OK
2735	2026-09-22 08:10	67.63	OK	2736	2026-09-22 08:11	65.38	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2737	2026-09-22 08:12	70.82	OK	2738	2026-09-22 08:13	67.69	OK
2739	2026-09-22 08:14	70.95	OK	2740	2026-09-22 08:15	67.61	OK
2741	2026-09-22 08:16	70.08	OK	2742	2026-09-22 08:17	71.61	OK
2743	2026-09-22 08:18	70.72	OK	2744	2026-09-22 08:19	66.04	OK
2745	2026-09-22 08:20	66.47	OK	2746	2026-09-22 08:21	67.80	OK
2747	2026-09-22 08:22	69.32	OK	2748	2026-09-22 08:23	68.23	OK
2749	2026-09-22 08:24	67.72	OK	2750	2026-09-22 08:25	65.79	OK
2751	2026-09-22 08:26	71.69	OK	2752	2026-09-22 08:27	69.76	OK
2753	2026-09-22 08:28	71.55	OK	2754	2026-09-22 08:29	66.13	OK
2755	2026-09-22 08:30	70.54	OK	2756	2026-09-22 08:31	71.03	OK
2757	2026-09-22 08:32	66.81	OK	2758	2026-09-22 08:33	70.25	OK
2759	2026-09-22 08:34	64.50	OK	2760	2026-09-22 08:35	67.65	OK
2761	2026-09-22 08:36	68.84	OK	2762	2026-09-22 08:37	68.78	OK
2763	2026-09-22 08:38	67.37	OK	2764	2026-09-22 08:39	71.80	OK
2765	2026-09-22 08:40	69.33	OK	2766	2026-09-22 08:41	68.53	OK
2767	2026-09-22 08:42	70.01	OK	2768	2026-09-22 08:43	65.21	OK
2769	2026-09-22 08:44	71.88	OK	2770	2026-09-22 08:45	66.28	OK
2771	2026-09-22 08:46	66.34	OK	2772	2026-09-22 08:47	68.35	OK
2773	2026-09-22 08:48	68.95	OK	2774	2026-09-22 08:49	68.71	OK
2775	2026-09-22 08:50	71.31	OK	2776	2026-09-22 08:51	70.93	OK
2777	2026-09-22 08:52	72.35	OK	2778	2026-09-22 08:53	68.44	OK
2779	2026-09-22 08:54	68.31	OK	2780	2026-09-22 08:55	72.00	OK
2781	2026-09-22 08:56	67.17	OK	2782	2026-09-22 08:57	70.47	OK
2783	2026-09-22 08:58	70.58	OK	2784	2026-09-22 08:59	72.36	OK
2785	2026-09-22 09:00	68.90	OK	2786	2026-09-22 09:01	67.31	OK
2787	2026-09-22 09:02	66.48	OK	2788	2026-09-22 09:03	72.06	OK
2789	2026-09-22 09:04	66.35	OK	2790	2026-09-22 09:05	70.81	OK
2791	2026-09-22 09:06	71.06	OK	2792	2026-09-22 09:07	67.44	OK
2793	2026-09-22 09:08	66.31	OK	2794	2026-09-22 09:09	68.87	OK
2795	2026-09-22 09:10	71.15	OK	2796	2026-09-22 09:11	68.00	OK
2797	2026-09-22 09:12	70.50	OK	2798	2026-09-22 09:13	70.06	OK
2799	2026-09-22 09:14	69.26	OK	2800	2026-09-22 09:15	69.48	OK
2801	2026-09-22 09:16	66.50	OK	2802	2026-09-22 09:17	70.91	OK
2803	2026-09-22 09:18	68.78	OK	2804	2026-09-22 09:19	69.89	OK
2805	2026-09-22 09:20	70.51	OK	2806	2026-09-22 09:21	71.35	OK
2807	2026-09-22 09:22	67.63	OK	2808	2026-09-22 09:23	66.80	OK
2809	2026-09-22 09:24	69.42	OK	2810	2026-09-22 09:25	68.11	OK
2811	2026-09-22 09:26	68.38	OK	2812	2026-09-22 09:27	70.56	OK
2813	2026-09-22 09:28	68.51	OK	2814	2026-09-22 09:29	68.93	OK
2815	2026-09-22 09:30	74.47	OK	2816	2026-09-22 09:31	69.61	OK
2817	2026-09-22 09:32	70.78	OK	2818	2026-09-22 09:33	67.33	OK
2819	2026-09-22 09:34	71.93	OK	2820	2026-09-22 09:35	72.44	OK
2821	2026-09-22 09:36	71.58	OK	2822	2026-09-22 09:37	69.22	OK
2823	2026-09-22 09:38	72.06	OK	2824	2026-09-22 09:39	70.61	OK
2825	2026-09-22 09:40	70.82	OK	2826	2026-09-22 09:41	69.52	OK
2827	2026-09-22 09:42	72.57	OK	2828	2026-09-22 09:43	68.65	OK
2829	2026-09-22 09:44	70.24	OK	2830	2026-09-22 09:45	69.57	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2831	2026-09-22 09:46	70.11	OK	2832	2026-09-22 09:47	72.97	OK
2833	2026-09-22 09:48	70.27	OK	2834	2026-09-22 09:49	72.01	OK
2835	2026-09-22 09:50	69.51	OK	2836	2026-09-22 09:51	70.84	OK
2837	2026-09-22 09:52	71.34	OK	2838	2026-09-22 09:53	73.10	OK
2839	2026-09-22 09:54	69.95	OK	2840	2026-09-22 09:55	67.76	OK
2841	2026-09-22 09:56	70.89	OK	2842	2026-09-22 09:57	70.22	OK
2843	2026-09-22 09:58	71.06	OK	2844	2026-09-22 09:59	70.57	OK
2845	2026-09-22 10:00	71.37	OK	2846	2026-09-22 10:01	67.78	OK
2847	2026-09-22 10:02	70.76	OK	2848	2026-09-22 10:03	67.96	OK
2849	2026-09-22 10:04	74.12	OK	2850	2026-09-22 10:05	68.66	OK
2851	2026-09-22 10:06	72.66	OK	2852	2026-09-22 10:07	67.50	OK
2853	2026-09-22 10:08	70.50	OK	2854	2026-09-22 10:09	71.12	OK
2855	2026-09-22 10:10	68.30	OK	2856	2026-09-22 10:11	70.84	OK
2857	2026-09-22 10:12	71.67	OK	2858	2026-09-22 10:13	73.19	OK
2859	2026-09-22 10:14	68.19	OK	2860	2026-09-22 10:15	71.63	OK
2861	2026-09-22 10:16	70.21	OK	2862	2026-09-22 10:17	71.70	OK
2863	2026-09-22 10:18	72.31	OK	2864	2026-09-22 10:19	69.35	OK
2865	2026-09-22 10:20	71.43	OK	2866	2026-09-22 10:21	70.99	OK
2867	2026-09-22 10:22	68.91	OK	2868	2026-09-22 10:23	71.24	OK
2869	2026-09-22 10:24	69.04	OK	2870	2026-09-22 10:25	70.67	OK
2871	2026-09-22 10:26	72.09	OK	2872	2026-09-22 10:27	66.83	OK
2873	2026-09-22 10:28	69.25	OK	2874	2026-09-22 10:29	72.00	OK
2875	2026-09-22 10:30	67.06	OK	2876	2026-09-22 10:31	69.89	OK
2877	2026-09-22 10:32	70.73	OK	2878	2026-09-22 10:33	68.96	OK
2879	2026-09-22 10:34	72.90	OK	2880	2026-09-22 10:35	73.82	OK
2881	2026-09-22 10:36	71.82	OK	2882	2026-09-22 10:37	73.36	OK
2883	2026-09-22 10:38	71.12	OK	2884	2026-09-22 10:39	71.59	OK
2885	2026-09-22 10:40	70.72	OK	2886	2026-09-22 10:41	69.32	OK
2887	2026-09-22 10:42	68.98	OK	2888	2026-09-22 10:43	71.00	OK
2889	2026-09-22 10:44	73.34	OK	2890	2026-09-22 10:45	71.46	OK
2891	2026-09-22 10:46	73.44	OK	2892	2026-09-22 10:47	71.55	OK
2893	2026-09-22 10:48	70.98	OK	2894	2026-09-22 10:49	70.83	OK
2895	2026-09-22 10:50	70.73	OK	2896	2026-09-22 10:51	72.51	OK
2897	2026-09-22 10:52	72.23	OK	2898	2026-09-22 10:53	75.95	OK
2899	2026-09-22 10:54	72.59	OK	2900	2026-09-22 10:55	72.54	OK
2901	2026-09-22 10:56	73.61	OK	2902	2026-09-22 10:57	70.77	OK
2903	2026-09-22 10:58	72.52	OK	2904	2026-09-22 10:59	69.63	OK
2905	2026-09-22 11:00	70.63	OK	2906	2026-09-22 11:01	72.34	OK
2907	2026-09-22 11:02	69.87	OK	2908	2026-09-22 11:03	71.13	OK
2909	2026-09-22 11:04	74.43	OK	2910	2026-09-22 11:05	76.18	OK
2911	2026-09-22 11:06	71.66	OK	2912	2026-09-22 11:07	72.76	OK
2913	2026-09-22 11:08	71.61	OK	2914	2026-09-22 11:09	71.30	OK
2915	2026-09-22 11:10	73.35	OK	2916	2026-09-22 11:11	71.93	OK
2917	2026-09-22 11:12	71.70	OK	2918	2026-09-22 11:13	75.23	OK
2919	2026-09-22 11:14	74.98	OK	2920	2026-09-22 11:15	70.47	OK
2921	2026-09-22 11:16	73.28	OK	2922	2026-09-22 11:17	70.75	OK
2923	2026-09-22 11:18	70.85	OK	2924	2026-09-22 11:19	71.44	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2925	2026-09-22 11:20	70.85	OK	2926	2026-09-22 11:21	71.21	OK
2927	2026-09-22 11:22	75.96	OK	2928	2026-09-22 11:23	73.43	OK
2929	2026-09-22 11:24	74.17	OK	2930	2026-09-22 11:25	73.22	OK
2931	2026-09-22 11:26	72.84	OK	2932	2026-09-22 11:27	70.89	OK
2933	2026-09-22 11:28	72.76	OK	2934	2026-09-22 11:29	73.04	OK
2935	2026-09-22 11:30	71.01	OK	2936	2026-09-22 11:31	73.17	OK
2937	2026-09-22 11:32	74.56	OK	2938	2026-09-22 11:33	75.34	OK
2939	2026-09-22 11:34	71.54	OK	2940	2026-09-22 11:35	73.38	OK
2941	2026-09-22 11:36	74.50	OK	2942	2026-09-22 11:37	73.58	OK
2943	2026-09-22 11:38	70.98	OK	2944	2026-09-22 11:39	74.63	OK
2945	2026-09-22 11:40	75.45	OK	2946	2026-09-22 11:41	70.86	OK
2947	2026-09-22 11:42	75.17	OK	2948	2026-09-22 11:43	74.03	OK
2949	2026-09-22 11:44	73.19	OK	2950	2026-09-22 11:45	73.80	OK
2951	2026-09-22 11:46	75.02	OK	2952	2026-09-22 11:47	75.89	OK
2953	2026-09-22 11:48	72.62	OK	2954	2026-09-22 11:49	73.09	OK
2955	2026-09-22 11:50	73.09	OK	2956	2026-09-22 11:51	71.75	OK
2957	2026-09-22 11:52	70.49	OK	2958	2026-09-22 11:53	74.84	OK
2959	2026-09-22 11:54	74.79	OK	2960	2026-09-22 11:55	76.33	OK
2961	2026-09-22 11:56	72.91	OK	2962	2026-09-22 11:57	74.60	OK
2963	2026-09-22 11:58	72.14	OK	2964	2026-09-22 11:59	69.36	OK
2965	2026-09-22 12:00	72.87	OK	2966	2026-09-22 12:01	78.77	OK
2967	2026-09-22 12:02	77.62	OK	2968	2026-09-22 12:03	72.80	OK
2969	2026-09-22 12:04	73.04	OK	2970	2026-09-22 12:05	76.46	OK
2971	2026-09-22 12:06	75.12	OK	2972	2026-09-22 12:07	71.96	OK
2973	2026-09-22 12:08	72.72	OK	2974	2026-09-22 12:09	75.53	OK
2975	2026-09-22 12:10	72.13	OK	2976	2026-09-22 12:11	71.51	OK
2977	2026-09-22 12:12	73.83	OK	2978	2026-09-22 12:13	69.99	OK
2979	2026-09-22 12:14	76.43	OK	2980	2026-09-22 12:15	73.63	OK
2981	2026-09-22 12:16	74.65	OK	2982	2026-09-22 12:17	75.92	OK
2983	2026-09-22 12:18	75.65	OK	2984	2026-09-22 12:19	73.41	OK
2985	2026-09-22 12:20	77.85	OK	2986	2026-09-22 12:21	75.17	OK
2987	2026-09-22 12:22	72.06	OK	2988	2026-09-22 12:23	74.32	OK
2989	2026-09-22 12:24	77.85	OK	2990	2026-09-22 12:25	75.46	OK
2991	2026-09-22 12:26	74.06	OK	2992	2026-09-22 12:27	74.34	OK
2993	2026-09-22 12:28	76.34	OK	2994	2026-09-22 12:29	78.22	OK
2995	2026-09-22 12:30	71.77	OK	2996	2026-09-22 12:31	73.10	OK
2997	2026-09-22 12:32	75.54	OK	2998	2026-09-22 12:33	76.50	OK
2999	2026-09-22 12:34	74.88	OK	3000	2026-09-22 12:35	73.85	OK
3001	2026-09-22 12:36	74.45	OK	3002	2026-09-22 12:37	75.00	OK
3003	2026-09-22 12:38	72.13	OK	3004	2026-09-22 12:39	76.15	OK
3005	2026-09-22 12:40	73.73	OK	3006	2026-09-22 12:41	73.07	OK
3007	2026-09-22 12:42	72.94	OK	3008	2026-09-22 12:43	78.89	OK
3009	2026-09-22 12:44	74.14	OK	3010	2026-09-22 12:45	74.96	OK
3011	2026-09-22 12:46	76.71	OK	3012	2026-09-22 12:47	77.61	OK
3013	2026-09-22 12:48	74.26	OK	3014	2026-09-22 12:49	73.39	OK
3015	2026-09-22 12:50	76.58	OK	3016	2026-09-22 12:51	76.83	OK
3017	2026-09-22 12:52	76.51	OK	3018	2026-09-22 12:53	76.61	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3019	2026-09-22 12:54	77.92	OK	3020	2026-09-22 12:55	74.74	OK
3021	2026-09-22 12:56	73.60	OK	3022	2026-09-22 12:57	74.30	OK
3023	2026-09-22 12:58	75.43	OK	3024	2026-09-22 12:59	75.44	OK
3025	2026-09-22 13:00	74.84	OK	3026	2026-09-22 13:01	77.27	OK
3027	2026-09-22 13:02	73.06	OK	3028	2026-09-22 13:03	75.09	OK
3029	2026-09-22 13:04	73.86	OK	3030	2026-09-22 13:05	73.63	OK
3031	2026-09-22 13:06	76.81	OK	3032	2026-09-22 13:07	72.52	OK
3033	2026-09-22 13:08	78.76	OK	3034	2026-09-22 13:09	78.99	OK
3035	2026-09-22 13:10	74.80	OK	3036	2026-09-22 13:11	79.14	OK
3037	2026-09-22 13:12	78.61	OK	3038	2026-09-22 13:13	77.78	OK
3039	2026-09-22 13:14	74.54	OK	3040	2026-09-22 13:15	74.77	OK
3041	2026-09-22 13:16	76.31	OK	3042	2026-09-22 13:17	76.04	OK
3043	2026-09-22 13:18	78.14	OK	3044	2026-09-22 13:19	76.51	OK
3045	2026-09-22 13:20	74.89	OK	3046	2026-09-22 13:21	77.64	OK
3047	2026-09-22 13:22	80.68	OK	3048	2026-09-22 13:23	75.39	OK
3049	2026-09-22 13:24	76.47	OK	3050	2026-09-22 13:25	76.66	OK
3051	2026-09-22 13:26	77.15	OK	3052	2026-09-22 13:27	75.20	OK
3053	2026-09-22 13:28	75.42	OK	3054	2026-09-22 13:29	75.37	OK
3055	2026-09-22 13:30	75.19	OK	3056	2026-09-22 13:31	77.02	OK
3057	2026-09-22 13:32	77.56	OK	3058	2026-09-22 13:33	75.55	OK
3059	2026-09-22 13:34	74.30	OK	3060	2026-09-22 13:35	75.50	OK
3061	2026-09-22 13:36	78.78	OK	3062	2026-09-22 13:37	76.98	OK
3063	2026-09-22 13:38	75.69	OK	3064	2026-09-22 13:39	76.17	OK
3065	2026-09-22 13:40	75.41	OK	3066	2026-09-22 13:41	78.16	OK
3067	2026-09-22 13:42	74.19	OK	3068	2026-09-22 13:43	78.95	OK
3069	2026-09-22 13:44	76.00	OK	3070	2026-09-22 13:45	79.44	OK
3071	2026-09-22 13:46	78.02	OK	3072	2026-09-22 13:47	76.62	OK
3073	2026-09-22 13:48	80.19	OK	3074	2026-09-22 13:49	78.50	OK
3075	2026-09-22 13:50	79.66	OK	3076	2026-09-22 13:51	77.47	OK
3077	2026-09-22 13:52	76.55	OK	3078	2026-09-22 13:53	81.32	OK
3079	2026-09-22 13:54	79.14	OK	3080	2026-09-22 13:55	78.19	OK
3081	2026-09-22 13:56	75.15	OK	3082	2026-09-22 13:57	78.04	OK
3083	2026-09-22 13:58	78.75	OK	3084	2026-09-22 13:59	79.12	OK
3085	2026-09-22 14:00	76.28	OK	3086	2026-09-22 14:01	73.00	OK
3087	2026-09-22 14:02	76.75	OK	3088	2026-09-22 14:03	78.14	OK
3089	2026-09-22 14:04	75.01	OK	3090	2026-09-22 14:05	78.00	OK
3091	2026-09-22 14:06	75.41	OK	3092	2026-09-22 14:07	76.38	OK
3093	2026-09-22 14:08	74.73	OK	3094	2026-09-22 14:09	77.65	OK
3095	2026-09-22 14:10	75.71	OK	3096	2026-09-22 14:11	77.26	OK
3097	2026-09-22 14:12	74.89	OK	3098	2026-09-22 14:13	77.75	OK
3099	2026-09-22 14:14	78.06	OK	3100	2026-09-22 14:15	79.48	OK
3101	2026-09-22 14:16	77.47	OK	3102	2026-09-22 14:17	76.19	OK
3103	2026-09-22 14:18	79.83	OK	3104	2026-09-22 14:19	78.46	OK
3105	2026-09-22 14:20	78.17	OK	3106	2026-09-22 14:21	78.98	OK
3107	2026-09-22 14:22	78.07	OK	3108	2026-09-22 14:23	75.83	OK
3109	2026-09-22 14:24	77.87	OK	3110	2026-09-22 14:25	78.65	OK
3111	2026-09-22 14:26	79.73	OK	3112	2026-09-22 14:27	78.71	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3113	2026-09-22 14:28	76.52	OK	3114	2026-09-22 14:29	81.63	OK
3115	2026-09-22 14:30	78.36	OK	3116	2026-09-22 14:31	81.38	OK
3117	2026-09-22 14:32	80.79	OK	3118	2026-09-22 14:33	77.87	OK
3119	2026-09-22 14:34	80.92	OK	3120	2026-09-22 14:35	75.70	OK
3121	2026-09-22 14:36	78.12	OK	3122	2026-09-22 14:37	79.03	OK
3123	2026-09-22 14:38	78.70	OK	3124	2026-09-22 14:39	77.70	OK
3125	2026-09-22 14:40	77.10	OK	3126	2026-09-22 14:41	78.20	OK
3127	2026-09-22 14:42	80.15	OK	3128	2026-09-22 14:43	80.12	OK
3129	2026-09-22 14:44	81.89	OK	3130	2026-09-22 14:45	77.52	OK
3131	2026-09-22 14:46	78.24	OK	3132	2026-09-22 14:47	76.04	OK
3133	2026-09-22 14:48	80.99	OK	3134	2026-09-22 14:49	79.45	OK
3135	2026-09-22 14:50	79.78	OK	3136	2026-09-22 14:51	78.42	OK
3137	2026-09-22 14:52	79.68	OK	3138	2026-09-22 14:53	79.66	OK
3139	2026-09-22 14:54	83.54	OK	3140	2026-09-22 14:55	76.85	OK
3141	2026-09-22 14:56	76.89	OK	3142	2026-09-22 14:57	75.97	OK
3143	2026-09-22 14:58	79.87	OK	3144	2026-09-22 14:59	82.15	OK
3145	2026-09-22 15:00	82.54	OK	3146	2026-09-22 15:01	81.30	OK
3147	2026-09-22 15:02	77.66	OK	3148	2026-09-22 15:03	74.98	OK
3149	2026-09-22 15:04	81.58	OK	3150	2026-09-22 15:05	82.29	OK
3151	2026-09-22 15:06	81.31	OK	3152	2026-09-22 15:07	82.01	OK
3153	2026-09-22 15:08	80.89	OK	3154	2026-09-22 15:09	81.30	OK
3155	2026-09-22 15:10	80.86	OK	3156	2026-09-22 15:11	79.34	OK
3157	2026-09-22 15:12	77.83	OK	3158	2026-09-22 15:13	79.40	OK
3159	2026-09-22 15:14	80.79	OK	3160	2026-09-22 15:15	78.77	OK
3161	2026-09-22 15:16	79.26	OK	3162	2026-09-22 15:17	78.92	OK
3163	2026-09-22 15:18	77.87	OK	3164	2026-09-22 15:19	80.12	OK
3165	2026-09-22 15:20	78.95	OK	3166	2026-09-22 15:21	81.36	OK
3167	2026-09-22 15:22	80.79	OK	3168	2026-09-22 15:23	79.84	OK
3169	2026-09-22 15:24	80.88	OK	3170	2026-09-22 15:25	80.12	OK
3171	2026-09-22 15:26	80.75	OK	3172	2026-09-22 15:27	77.85	OK
3173	2026-09-22 15:28	80.59	OK	3174	2026-09-22 15:29	78.21	OK
3175	2026-09-22 15:30	81.71	OK	3176	2026-09-22 15:31	78.33	OK
3177	2026-09-22 15:32	79.24	OK	3178	2026-09-22 15:33	80.52	OK
3179	2026-09-22 15:34	80.61	OK	3180	2026-09-22 15:35	81.91	OK
3181	2026-09-22 15:36	77.79	OK	3182	2026-09-22 15:37	79.37	OK
3183	2026-09-22 15:38	78.52	OK	3184	2026-09-22 15:39	82.04	OK
3185	2026-09-22 15:40	79.70	OK	3186	2026-09-22 15:41	76.85	OK
3187	2026-09-22 15:42	81.96	OK	3188	2026-09-22 15:43	77.43	OK
3189	2026-09-22 15:44	81.10	OK	3190	2026-09-22 15:45	78.37	OK
3191	2026-09-22 15:46	80.54	OK	3192	2026-09-22 15:47	79.45	OK
3193	2026-09-22 15:48	79.70	OK	3194	2026-09-22 15:49	82.34	OK
3195	2026-09-22 15:50	80.08	OK	3196	2026-09-22 15:51	78.61	OK
3197	2026-09-22 15:52	82.06	OK	3198	2026-09-22 15:53	80.77	OK
3199	2026-09-22 15:54	81.98	OK	3200	2026-09-22 15:55	79.22	OK
3201	2026-09-22 15:56	81.38	OK	3202	2026-09-22 15:57	80.54	OK
3203	2026-09-22 15:58	81.60	OK	3204	2026-09-22 15:59	82.40	OK
3205	2026-09-22 16:00	77.28	OK	3206	2026-09-22 16:01	79.46	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3207	2026-09-22 16:02	80.72	OK	3208	2026-09-22 16:03	79.00	OK
3209	2026-09-22 16:04	80.12	OK	3210	2026-09-22 16:05	76.88	OK
3211	2026-09-22 16:06	79.76	OK	3212	2026-09-22 16:07	82.98	OK
3213	2026-09-22 16:08	80.87	OK	3214	2026-09-22 16:09	81.05	OK
3215	2026-09-22 16:10	77.05	OK	3216	2026-09-22 16:11	80.60	OK
3217	2026-09-22 16:12	79.48	OK	3218	2026-09-22 16:13	78.62	OK
3219	2026-09-22 16:14	82.75	OK	3220	2026-09-22 16:15	81.90	OK
3221	2026-09-22 16:16	79.91	OK	3222	2026-09-22 16:17	80.18	OK
3223	2026-09-22 16:18	81.07	OK	3224	2026-09-22 16:19	79.55	OK
3225	2026-09-22 16:20	81.07	OK	3226	2026-09-22 16:21	81.25	OK
3227	2026-09-22 16:22	78.84	OK	3228	2026-09-22 16:23	82.08	OK
3229	2026-09-22 16:24	82.18	OK	3230	2026-09-22 16:25	80.89	OK
3231	2026-09-22 16:26	79.96	OK	3232	2026-09-22 16:27	82.55	OK
3233	2026-09-22 16:28	77.28	OK	3234	2026-09-22 16:29	82.59	OK
3235	2026-09-22 16:30	82.44	OK	3236	2026-09-22 16:31	82.60	OK
3237	2026-09-22 16:32	80.63	OK	3238	2026-09-22 16:33	81.49	OK
3239	2026-09-22 16:34	80.00	OK	3240	2026-09-22 16:35	79.82	OK
3241	2026-09-22 16:36	79.41	OK	3242	2026-09-22 16:37	80.99	OK
3243	2026-09-22 16:38	80.53	OK	3244	2026-09-22 16:39	83.34	OK
3245	2026-09-22 16:40	82.17	OK	3246	2026-09-22 16:41	77.81	OK
3247	2026-09-22 16:42	82.49	OK	3248	2026-09-22 16:43	81.65	OK
3249	2026-09-22 16:44	84.45	OK	3250	2026-09-22 16:45	79.74	OK
3251	2026-09-22 16:46	77.48	OK	3252	2026-09-22 16:47	82.96	OK
3253	2026-09-22 16:48	81.86	OK	3254	2026-09-22 16:49	79.87	OK
3255	2026-09-22 16:50	79.41	OK	3256	2026-09-22 16:51	82.60	OK
3257	2026-09-22 16:52	83.48	OK	3258	2026-09-22 16:53	82.23	OK
3259	2026-09-22 16:54	82.62	OK	3260	2026-09-22 16:55	77.34	OK
3261	2026-09-22 16:56	79.73	OK	3262	2026-09-22 16:57	83.20	OK
3263	2026-09-22 16:58	81.89	OK	3264	2026-09-22 16:59	80.45	OK
3265	2026-09-22 17:00	79.39	OK	3266	2026-09-22 17:01	79.39	OK
3267	2026-09-22 17:02	80.73	OK	3268	2026-09-22 17:03	82.56	OK
3269	2026-09-22 17:04	81.49	OK	3270	2026-09-22 17:05	80.24	OK
3271	2026-09-22 17:06	82.20	OK	3272	2026-09-22 17:07	81.33	OK
3273	2026-09-22 17:08	81.75	OK	3274	2026-09-22 17:09	80.47	OK
3275	2026-09-22 17:10	81.73	OK	3276	2026-09-22 17:11	82.22	OK
3277	2026-09-22 17:12	82.92	OK	3278	2026-09-22 17:13	84.13	OK
3279	2026-09-22 17:14	81.52	OK	3280	2026-09-22 17:15	83.19	OK
3281	2026-09-22 17:16	83.96	OK	3282	2026-09-22 17:17	82.02	OK
3283	2026-09-22 17:18	79.37	OK	3284	2026-09-22 17:19	85.46	OK
3285	2026-09-22 17:20	81.96	OK	3286	2026-09-22 17:21	80.91	OK
3287	2026-09-22 17:22	81.61	OK	3288	2026-09-22 17:23	83.57	OK
3289	2026-09-22 17:24	81.22	OK	3290	2026-09-22 17:25	80.61	OK
3291	2026-09-22 17:26	81.23	OK	3292	2026-09-22 17:27	82.38	OK
3293	2026-09-22 17:28	81.44	OK	3294	2026-09-22 17:29	77.40	OK
3295	2026-09-22 17:30	80.51	OK	3296	2026-09-22 17:31	80.26	OK
3297	2026-09-22 17:32	81.22	OK	3298	2026-09-22 17:33	80.77	OK
3299	2026-09-22 17:34	80.64	OK	3300	2026-09-22 17:35	83.09	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3301	2026-09-22 17:36	84.21	OK	3302	2026-09-22 17:37	81.11	OK
3303	2026-09-22 17:38	80.33	OK	3304	2026-09-22 17:39	78.56	OK
3305	2026-09-22 17:40	83.30	OK	3306	2026-09-22 17:41	81.88	OK
3307	2026-09-22 17:42	78.69	OK	3308	2026-09-22 17:43	79.32	OK
3309	2026-09-22 17:44	80.90	OK	3310	2026-09-22 17:45	84.74	OK
3311	2026-09-22 17:46	78.82	OK	3312	2026-09-22 17:47	82.37	OK
3313	2026-09-22 17:48	78.51	OK	3314	2026-09-22 17:49	80.60	OK
3315	2026-09-22 17:50	80.02	OK	3316	2026-09-22 17:51	84.44	OK
3317	2026-09-22 17:52	82.16	OK	3318	2026-09-22 17:53	81.11	OK
3319	2026-09-22 17:54	82.77	OK	3320	2026-09-22 17:55	80.33	OK
3321	2026-09-22 17:56	84.20	OK	3322	2026-09-22 17:57	80.27	OK
3323	2026-09-22 17:58	81.74	OK	3324	2026-09-22 17:59	81.40	OK
3325	2026-09-22 18:00	82.81	OK	3326	2026-09-22 18:01	79.93	OK
3327	2026-09-22 18:02	84.32	OK	3328	2026-09-22 18:03	81.34	OK
3329	2026-09-22 18:04	83.38	OK	3330	2026-09-22 18:05	82.43	OK
3331	2026-09-22 18:06	81.08	OK	3332	2026-09-22 18:07	83.20	OK
3333	2026-09-22 18:08	79.93	OK	3334	2026-09-22 18:09	82.69	OK
3335	2026-09-22 18:10	80.25	OK	3336	2026-09-22 18:11	82.39	OK
3337	2026-09-22 18:12	82.45	OK	3338	2026-09-22 18:13	79.12	OK
3339	2026-09-22 18:14	82.19	OK	3340	2026-09-22 18:15	78.72	OK
3341	2026-09-22 18:16	80.17	OK	3342	2026-09-22 18:17	80.83	OK
3343	2026-09-22 18:18	83.73	OK	3344	2026-09-22 18:19	80.55	OK
3345	2026-09-22 18:20	79.75	OK	3346	2026-09-22 18:21	83.14	OK
3347	2026-09-22 18:22	80.37	OK	3348	2026-09-22 18:23	82.80	OK
3349	2026-09-22 18:24	82.45	OK	3350	2026-09-22 18:25	80.44	OK
3351	2026-09-22 18:26	79.73	OK	3352	2026-09-22 18:27	83.13	OK
3353	2026-09-22 18:28	82.58	OK	3354	2026-09-22 18:29	80.47	OK
3355	2026-09-22 18:30	81.84	OK	3356	2026-09-22 18:31	85.18	OK
3357	2026-09-22 18:32	81.29	OK	3358	2026-09-22 18:33	82.62	OK
3359	2026-09-22 18:34	84.18	OK	3360	2026-09-22 18:35	85.42	OK
3361	2026-09-22 18:36	85.04	OK	3362	2026-09-22 18:37	83.10	OK
3363	2026-09-22 18:38	84.05	OK	3364	2026-09-22 18:39	83.62	OK
3365	2026-09-22 18:40	81.44	OK	3366	2026-09-22 18:41	81.06	OK
3367	2026-09-22 18:42	79.33	OK	3368	2026-09-22 18:43	84.49	OK
3369	2026-09-22 18:44	81.93	OK	3370	2026-09-22 18:45	79.09	OK
3371	2026-09-22 18:46	79.88	OK	3372	2026-09-22 18:47	80.07	OK
3373	2026-09-22 18:48	82.97	OK	3374	2026-09-22 18:49	81.27	OK
3375	2026-09-22 18:50	83.70	OK	3376	2026-09-22 18:51	81.09	OK
3377	2026-09-22 18:52	84.06	OK	3378	2026-09-22 18:53	80.11	OK
3379	2026-09-22 18:54	79.68	OK	3380	2026-09-22 18:55	83.85	OK
3381	2026-09-22 18:56	81.22	OK	3382	2026-09-22 18:57	80.52	OK
3383	2026-09-22 18:58	81.05	OK	3384	2026-09-22 18:59	83.47	OK
3385	2026-09-22 19:00	81.33	OK	3386	2026-09-22 19:01	86.23	OK
3387	2026-09-22 19:02	82.03	OK	3388	2026-09-22 19:03	80.02	OK
3389	2026-09-22 19:04	80.70	OK	3390	2026-09-22 19:05	81.98	OK
3391	2026-09-22 19:06	82.10	OK	3392	2026-09-22 19:07	82.66	OK
3393	2026-09-22 19:08	79.85	OK	3394	2026-09-22 19:09	82.18	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3395	2026-09-22 19:10	78.56	OK	3396	2026-09-22 19:11	82.64	OK
3397	2026-09-22 19:12	85.79	OK	3398	2026-09-22 19:13	81.25	OK
3399	2026-09-22 19:14	80.82	OK	3400	2026-09-22 19:15	84.51	OK
3401	2026-09-22 19:16	80.74	OK	3402	2026-09-22 19:17	80.13	OK
3403	2026-09-22 19:18	82.06	OK	3404	2026-09-22 19:19	81.29	OK
3405	2026-09-22 19:20	83.10	OK	3406	2026-09-22 19:21	83.33	OK
3407	2026-09-22 19:22	81.57	OK	3408	2026-09-22 19:23	81.61	OK
3409	2026-09-22 19:24	83.36	OK	3410	2026-09-22 19:25	82.10	OK
3411	2026-09-22 19:26	78.64	OK	3412	2026-09-22 19:27	82.80	OK
3413	2026-09-22 19:28	82.47	OK	3414	2026-09-22 19:29	83.39	OK
3415	2026-09-22 19:30	83.11	OK	3416	2026-09-22 19:31	83.82	OK
3417	2026-09-22 19:32	81.74	OK	3418	2026-09-22 19:33	81.79	OK
3419	2026-09-22 19:34	81.10	OK	3420	2026-09-22 19:35	79.02	OK
3421	2026-09-22 19:36	80.22	OK	3422	2026-09-22 19:37	81.00	OK
3423	2026-09-22 19:38	81.51	OK	3424	2026-09-22 19:39	82.12	OK
3425	2026-09-22 19:40	84.48	OK	3426	2026-09-22 19:41	78.59	OK
3427	2026-09-22 19:42	82.13	OK	3428	2026-09-22 19:43	80.94	OK
3429	2026-09-22 19:44	81.54	OK	3430	2026-09-22 19:45	79.51	OK
3431	2026-09-22 19:46	82.75	OK	3432	2026-09-22 19:47	82.46	OK
3433	2026-09-22 19:48	83.03	OK	3434	2026-09-22 19:49	81.87	OK
3435	2026-09-22 19:50	83.33	OK	3436	2026-09-22 19:51	80.74	OK
3437	2026-09-22 19:52	78.34	OK	3438	2026-09-22 19:53	79.96	OK
3439	2026-09-22 19:54	79.67	OK	3440	2026-09-22 19:55	80.32	OK
3441	2026-09-22 19:56	81.79	OK	3442	2026-09-22 19:57	79.47	OK
3443	2026-09-22 19:58	81.76	OK	3444	2026-09-22 19:59	78.74	OK
3445	2026-09-22 20:00	83.04	OK	3446	2026-09-22 20:01	82.69	OK
3447	2026-09-22 20:02	82.90	OK	3448	2026-09-22 20:03	80.88	OK
3449	2026-09-22 20:04	83.29	OK	3450	2026-09-22 20:05	78.40	OK
3451	2026-09-22 20:06	77.18	OK	3452	2026-09-22 20:07	80.91	OK
3453	2026-09-22 20:08	83.37	OK	3454	2026-09-22 20:09	78.97	OK
3455	2026-09-22 20:10	78.50	OK	3456	2026-09-22 20:11	78.81	OK
3457	2026-09-22 20:12	83.44	OK	3458	2026-09-22 20:13	81.51	OK
3459	2026-09-22 20:14	78.62	OK	3460	2026-09-22 20:15	79.90	OK
3461	2026-09-22 20:16	83.65	OK	3462	2026-09-22 20:17	80.84	OK
3463	2026-09-22 20:18	81.23	OK	3464	2026-09-22 20:19	81.99	OK
3465	2026-09-22 20:20	80.04	OK	3466	2026-09-22 20:21	82.44	OK
3467	2026-09-22 20:22	80.18	OK	3468	2026-09-22 20:23	78.40	OK
3469	2026-09-22 20:24	83.95	OK	3470	2026-09-22 20:25	81.25	OK
3471	2026-09-22 20:26	77.84	OK	3472	2026-09-22 20:27	79.13	OK
3473	2026-09-22 20:28	81.77	OK	3474	2026-09-22 20:29	81.40	OK
3475	2026-09-22 20:30	80.52	OK	3476	2026-09-22 20:31	78.88	OK
3477	2026-09-22 20:32	80.87	OK	3478	2026-09-22 20:33	79.02	OK
3479	2026-09-22 20:34	80.50	OK	3480	2026-09-22 20:35	76.54	OK
3481	2026-09-22 20:36	77.80	OK	3482	2026-09-22 20:37	81.36	OK
3483	2026-09-22 20:38	80.31	OK	3484	2026-09-22 20:39	81.75	OK
3485	2026-09-22 20:40	82.21	OK	3486	2026-09-22 20:41	83.60	OK
3487	2026-09-22 20:42	78.14	OK	3488	2026-09-22 20:43	82.14	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3489	2026-09-22 20:44	82.25	OK	3490	2026-09-22 20:45	79.73	OK
3491	2026-09-22 20:46	80.74	OK	3492	2026-09-22 20:47	79.81	OK
3493	2026-09-22 20:48	78.01	OK	3494	2026-09-22 20:49	82.78	OK
3495	2026-09-22 20:50	78.24	OK	3496	2026-09-22 20:51	78.17	OK
3497	2026-09-22 20:52	80.20	OK	3498	2026-09-22 20:53	76.64	OK
3499	2026-09-22 20:54	84.68	OK	3500	2026-09-22 20:55	77.29	OK
3501	2026-09-22 20:56	83.73	OK	3502	2026-09-22 20:57	81.73	OK
3503	2026-09-22 20:58	81.79	OK	3504	2026-09-22 20:59	77.83	OK
3505	2026-09-22 21:00	82.55	OK	3506	2026-09-22 21:01	79.48	OK
3507	2026-09-22 21:02	80.75	OK	3508	2026-09-22 21:03	80.23	OK
3509	2026-09-22 21:04	81.82	OK	3510	2026-09-22 21:05	82.09	OK
3511	2026-09-22 21:06	77.94	OK	3512	2026-09-22 21:07	78.13	OK
3513	2026-09-22 21:08	76.83	OK	3514	2026-09-22 21:09	82.52	OK
3515	2026-09-22 21:10	81.15	OK	3516	2026-09-22 21:11	81.95	OK
3517	2026-09-22 21:12	81.46	OK	3518	2026-09-22 21:13	83.23	OK
3519	2026-09-22 21:14	81.00	OK	3520	2026-09-22 21:15	82.62	OK
3521	2026-09-22 21:16	77.98	OK	3522	2026-09-22 21:17	79.58	OK
3523	2026-09-22 21:18	80.54	OK	3524	2026-09-22 21:19	77.41	OK
3525	2026-09-22 21:20	79.89	OK	3526	2026-09-22 21:21	81.69	OK
3527	2026-09-22 21:22	77.25	OK	3528	2026-09-22 21:23	82.64	OK
3529	2026-09-22 21:24	79.98	OK	3530	2026-09-22 21:25	79.70	OK
3531	2026-09-22 21:26	82.13	OK	3532	2026-09-22 21:27	78.81	OK
3533	2026-09-22 21:28	78.31	OK	3534	2026-09-22 21:29	81.03	OK
3535	2026-09-22 21:30	76.21	OK	3536	2026-09-22 21:31	79.92	OK
3537	2026-09-22 21:32	78.79	OK	3538	2026-09-22 21:33	80.86	OK
3539	2026-09-22 21:34	82.74	OK	3540	2026-09-22 21:35	83.38	OK
3541	2026-09-22 21:36	78.63	OK	3542	2026-09-22 21:37	80.24	OK
3543	2026-09-22 21:38	79.03	OK	3544	2026-09-22 21:39	82.09	OK
3545	2026-09-22 21:40	79.41	OK	3546	2026-09-22 21:41	79.20	OK
3547	2026-09-22 21:42	80.03	OK	3548	2026-09-22 21:43	81.76	OK
3549	2026-09-22 21:44	79.30	OK	3550	2026-09-22 21:45	82.77	OK
3551	2026-09-22 21:46	77.41	OK	3552	2026-09-22 21:47	78.58	OK
3553	2026-09-22 21:48	78.38	OK	3554	2026-09-22 21:49	77.85	OK
3555	2026-09-22 21:50	78.59	OK	3556	2026-09-22 21:51	79.18	OK
3557	2026-09-22 21:52	76.83	OK	3558	2026-09-22 21:53	78.58	OK
3559	2026-09-22 21:54	78.55	OK	3560	2026-09-22 21:55	77.07	OK
3561	2026-09-22 21:56	79.03	OK	3562	2026-09-22 21:57	76.38	OK
3563	2026-09-22 21:58	80.39	OK	3564	2026-09-22 21:59	81.42	OK
3565	2026-09-22 22:00	76.45	OK	3566	2026-09-22 22:01	77.86	OK
3567	2026-09-22 22:02	78.58	OK	3568	2026-09-22 22:03	78.57	OK
3569	2026-09-22 22:04	79.23	OK	3570	2026-09-22 22:05	77.60	OK
3571	2026-09-22 22:06	77.49	OK	3572	2026-09-22 22:07	82.94	OK
3573	2026-09-22 22:08	77.49	OK	3574	2026-09-22 22:09	76.29	OK
3575	2026-09-22 22:10	79.30	OK	3576	2026-09-22 22:11	80.35	OK
3577	2026-09-22 22:12	79.87	OK	3578	2026-09-22 22:13	77.79	OK
3579	2026-09-22 22:14	77.27	OK	3580	2026-09-22 22:15	78.82	OK
3581	2026-09-22 22:16	78.39	OK	3582	2026-09-22 22:17	74.48	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3583	2026-09-22 22:18	77.92	OK	3584	2026-09-22 22:19	78.64	OK
3585	2026-09-22 22:20	75.46	OK	3586	2026-09-22 22:21	79.01	OK
3587	2026-09-22 22:22	80.15	OK	3588	2026-09-22 22:23	79.67	OK
3589	2026-09-22 22:24	78.52	OK	3590	2026-09-22 22:25	78.01	OK
3591	2026-09-22 22:26	80.26	OK	3592	2026-09-22 22:27	77.44	OK
3593	2026-09-22 22:28	78.86	OK	3594	2026-09-22 22:29	78.85	OK
3595	2026-09-22 22:30	78.82	OK	3596	2026-09-22 22:31	78.37	OK
3597	2026-09-22 22:32	81.63	OK	3598	2026-09-22 22:33	80.48	OK
3599	2026-09-22 22:34	77.96	OK	3600	2026-09-22 22:35	76.40	OK
3601	2026-09-22 22:36	76.94	OK	3602	2026-09-22 22:37	79.82	OK
3603	2026-09-22 22:38	80.38	OK	3604	2026-09-22 22:39	80.47	OK
3605	2026-09-22 22:40	78.60	OK	3606	2026-09-22 22:41	79.52	OK
3607	2026-09-22 22:42	78.86	OK	3608	2026-09-22 22:43	78.75	OK
3609	2026-09-22 22:44	76.93	OK	3610	2026-09-22 22:45	79.03	OK
3611	2026-09-22 22:46	76.51	OK	3612	2026-09-22 22:47	81.12	OK
3613	2026-09-22 22:48	75.42	OK	3614	2026-09-22 22:49	80.43	OK
3615	2026-09-22 22:50	81.45	OK	3616	2026-09-22 22:51	81.03	OK
3617	2026-09-22 22:52	80.47	OK	3618	2026-09-22 22:53	77.91	OK
3619	2026-09-22 22:54	74.42	OK	3620	2026-09-22 22:55	80.69	OK
3621	2026-09-22 22:56	78.36	OK	3622	2026-09-22 22:57	78.22	OK
3623	2026-09-22 22:58	77.50	OK	3624	2026-09-22 22:59	78.22	OK
3625	2026-09-22 23:00	76.67	OK	3626	2026-09-22 23:01	78.68	OK
3627	2026-09-22 23:02	76.59	OK	3628	2026-09-22 23:03	77.44	OK
3629	2026-09-22 23:04	77.39	OK	3630	2026-09-22 23:05	77.17	OK
3631	2026-09-22 23:06	75.70	OK	3632	2026-09-22 23:07	77.87	OK
3633	2026-09-22 23:08	76.47	OK	3634	2026-09-22 23:09	79.04	OK
3635	2026-09-22 23:10	73.37	OK	3636	2026-09-22 23:11	81.03	OK
3637	2026-09-22 23:12	76.61	OK	3638	2026-09-22 23:13	73.66	OK
3639	2026-09-22 23:14	77.06	OK	3640	2026-09-22 23:15	75.28	OK
3641	2026-09-22 23:16	77.98	OK	3642	2026-09-22 23:17	79.11	OK
3643	2026-09-22 23:18	77.00	OK	3644	2026-09-22 23:19	74.42	OK
3645	2026-09-22 23:20	75.62	OK	3646	2026-09-22 23:21	77.84	OK
3647	2026-09-22 23:22	77.08	OK	3648	2026-09-22 23:23	77.74	OK
3649	2026-09-22 23:24	78.29	OK	3650	2026-09-22 23:25	73.85	OK
3651	2026-09-22 23:26	77.55	OK	3652	2026-09-22 23:27	74.56	OK
3653	2026-09-22 23:28	76.35	OK	3654	2026-09-22 23:29	76.70	OK
3655	2026-09-22 23:30	74.12	OK	3656	2026-09-22 23:31	77.83	OK
3657	2026-09-22 23:32	76.01	OK	3658	2026-09-22 23:33	77.01	OK
3659	2026-09-22 23:34	75.91	OK	3660	2026-09-22 23:35	75.97	OK
3661	2026-09-22 23:36	76.27	OK	3662	2026-09-22 23:37	76.60	OK
3663	2026-09-22 23:38	77.04	OK	3664	2026-09-22 23:39	76.76	OK
3665	2026-09-22 23:40	75.40	OK	3666	2026-09-22 23:41	76.80	OK
3667	2026-09-22 23:42	76.15	OK	3668	2026-09-22 23:43	74.51	OK
3669	2026-09-22 23:44	76.32	OK	3670	2026-09-22 23:45	75.76	OK
3671	2026-09-22 23:46	74.15	OK	3672	2026-09-22 23:47	77.51	OK
3673	2026-09-22 23:48	76.29	OK	3674	2026-09-22 23:49	74.30	OK
3675	2026-09-22 23:50	77.99	OK	3676	2026-09-22 23:51	77.55	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3677	2026-09-22 23:52	76.03	OK	3678	2026-09-22 23:53	76.83	OK
3679	2026-09-22 23:54	76.50	OK	3680	2026-09-22 23:55	74.40	OK
3681	2026-09-22 23:56	73.20	OK	3682	2026-09-22 23:57	78.72	OK
3683	2026-09-22 23:58	75.87	OK	3684	2026-09-22 23:59	73.67	OK
3685	2026-09-23 00:00	74.92	OK	3686	2026-09-23 00:01	74.37	OK
3687	2026-09-23 00:02	76.57	OK	3688	2026-09-23 00:03	73.72	OK
3689	2026-09-23 00:04	75.85	OK	3690	2026-09-23 00:05	77.97	OK
3691	2026-09-23 00:06	74.09	OK	3692	2026-09-23 00:07	76.10	OK
3693	2026-09-23 00:08	73.49	OK	3694	2026-09-23 00:09	73.23	OK
3695	2026-09-23 00:10	74.59	OK	3696	2026-09-23 00:11	74.88	OK
3697	2026-09-23 00:12	75.14	OK	3698	2026-09-23 00:13	73.90	OK
3699	2026-09-23 00:14	75.56	OK	3700	2026-09-23 00:15	72.94	OK
3701	2026-09-23 00:16	72.89	OK	3702	2026-09-23 00:17	76.82	OK
3703	2026-09-23 00:18	73.63	OK	3704	2026-09-23 00:19	73.92	OK
3705	2026-09-23 00:20	75.10	OK	3706	2026-09-23 00:21	73.86	OK
3707	2026-09-23 00:22	73.46	OK	3708	2026-09-23 00:23	75.21	OK
3709	2026-09-23 00:24	76.08	OK	3710	2026-09-23 00:25	75.04	OK
3711	2026-09-23 00:26	75.26	OK	3712	2026-09-23 00:27	74.21	OK
3713	2026-09-23 00:28	77.52	OK	3714	2026-09-23 00:29	75.04	OK
3715	2026-09-23 00:30	75.53	OK	3716	2026-09-23 00:31	76.51	OK
3717	2026-09-23 00:32	72.84	OK	3718	2026-09-23 00:33	74.84	OK
3719	2026-09-23 00:34	75.45	OK	3720	2026-09-23 00:35	73.05	OK
3721	2026-09-23 00:36	75.20	OK	3722	2026-09-23 00:37	72.35	OK
3723	2026-09-23 00:38	73.21	OK	3724	2026-09-23 00:39	74.87	OK
3725	2026-09-23 00:40	75.62	OK	3726	2026-09-23 00:41	72.89	OK
3727	2026-09-23 00:42	76.87	OK	3728	2026-09-23 00:43	71.99	OK
3729	2026-09-23 00:44	71.06	OK	3730	2026-09-23 00:45	72.41	OK
3731	2026-09-23 00:46	72.24	OK	3732	2026-09-23 00:47	76.32	OK
3733	2026-09-23 00:48	74.17	OK	3734	2026-09-23 00:49	73.20	OK
3735	2026-09-23 00:50	76.36	OK	3736	2026-09-23 00:51	72.76	OK
3737	2026-09-23 00:52	77.46	OK	3738	2026-09-23 00:53	71.46	OK
3739	2026-09-23 00:54	72.20	OK	3740	2026-09-23 00:55	74.36	OK
3741	2026-09-23 00:56	74.55	OK	3742	2026-09-23 00:57	75.75	OK
3743	2026-09-23 00:58	73.77	OK	3744	2026-09-23 00:59	72.83	OK
3745	2026-09-23 01:00	76.12	OK	3746	2026-09-23 01:01	72.46	OK
3747	2026-09-23 01:02	71.16	OK	3748	2026-09-23 01:03	71.30	OK
3749	2026-09-23 01:04	74.26	OK	3750	2026-09-23 01:05	72.79	OK
3751	2026-09-23 01:06	73.47	OK	3752	2026-09-23 01:07	74.79	OK
3753	2026-09-23 01:08	72.62	OK	3754	2026-09-23 01:09	72.05	OK
3755	2026-09-23 01:10	74.17	OK	3756	2026-09-23 01:11	70.56	OK
3757	2026-09-23 01:12	73.31	OK	3758	2026-09-23 01:13	73.98	OK
3759	2026-09-23 01:14	73.18	OK	3760	2026-09-23 01:15	70.19	OK
3761	2026-09-23 01:16	72.55	OK	3762	2026-09-23 01:17	71.06	OK
3763	2026-09-23 01:18	74.75	OK	3764	2026-09-23 01:19	71.45	OK
3765	2026-09-23 01:20	74.29	OK	3766	2026-09-23 01:21	73.63	OK
3767	2026-09-23 01:22	76.18	OK	3768	2026-09-23 01:23	72.15	OK
3769	2026-09-23 01:24	70.63	OK	3770	2026-09-23 01:25	74.94	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3771	2026-09-23 01:26	71.34	OK	3772	2026-09-23 01:27	71.76	OK
3773	2026-09-23 01:28	74.19	OK	3774	2026-09-23 01:29	76.16	OK
3775	2026-09-23 01:30	72.21	OK	3776	2026-09-23 01:31	71.95	OK
3777	2026-09-23 01:32	74.29	OK	3778	2026-09-23 01:33	73.82	OK
3779	2026-09-23 01:34	74.68	OK	3780	2026-09-23 01:35	75.54	OK
3781	2026-09-23 01:36	70.28	OK	3782	2026-09-23 01:37	72.44	OK
3783	2026-09-23 01:38	75.72	OK	3784	2026-09-23 01:39	73.50	OK
3785	2026-09-23 01:40	71.94	OK	3786	2026-09-23 01:41	75.11	OK
3787	2026-09-23 01:42	72.35	OK	3788	2026-09-23 01:43	71.42	OK
3789	2026-09-23 01:44	73.06	OK	3790	2026-09-23 01:45	71.41	OK
3791	2026-09-23 01:46	70.85	OK	3792	2026-09-23 01:47	70.50	OK
3793	2026-09-23 01:48	71.93	OK	3794	2026-09-23 01:49	71.57	OK
3795	2026-09-23 01:50	72.24	OK	3796	2026-09-23 01:51	70.01	OK
3797	2026-09-23 01:52	72.75	OK	3798	2026-09-23 01:53	69.94	OK
3799	2026-09-23 01:54	71.42	OK	3800	2026-09-23 01:55	73.15	OK
3801	2026-09-23 01:56	71.24	OK	3802	2026-09-23 01:57	75.83	OK
3803	2026-09-23 01:58	76.25	OK	3804	2026-09-23 01:59	75.77	OK
3805	2026-09-23 02:00	72.23	OK	3806	2026-09-23 02:01	70.43	OK
3807	2026-09-23 02:02	70.44	OK	3808	2026-09-23 02:03	72.57	OK
3809	2026-09-23 02:04	72.91	OK	3810	2026-09-23 02:05	72.27	OK
3811	2026-09-23 02:06	71.52	OK	3812	2026-09-23 02:07	70.93	OK
3813	2026-09-23 02:08	74.21	OK	3814	2026-09-23 02:09	70.14	OK
3815	2026-09-23 02:10	71.73	OK	3816	2026-09-23 02:11	72.38	OK
3817	2026-09-23 02:12	71.62	OK	3818	2026-09-23 02:13	70.78	OK
3819	2026-09-23 02:14	73.32	OK	3820	2026-09-23 02:15	71.70	OK
3821	2026-09-23 02:16	70.88	OK	3822	2026-09-23 02:17	70.36	OK
3823	2026-09-23 02:18	71.59	OK	3824	2026-09-23 02:19	71.95	OK
3825	2026-09-23 02:20	72.02	OK	3826	2026-09-23 02:21	74.92	OK
3827	2026-09-23 02:22	69.83	OK	3828	2026-09-23 02:23	70.24	OK
3829	2026-09-23 02:24	72.13	OK	3830	2026-09-23 02:25	69.39	OK
3831	2026-09-23 02:26	71.12	OK	3832	2026-09-23 02:27	73.44	OK
3833	2026-09-23 02:28	68.78	OK	3834	2026-09-23 02:29	73.37	OK
3835	2026-09-23 02:30	70.16	OK	3836	2026-09-23 02:31	70.37	OK
3837	2026-09-23 02:32	69.63	OK	3838	2026-09-23 02:33	72.08	OK
3839	2026-09-23 02:34	71.39	OK	3840	2026-09-23 02:35	71.19	OK
3841	2026-09-23 02:36	71.45	OK	3842	2026-09-23 02:37	72.80	OK
3843	2026-09-23 02:38	73.94	OK	3844	2026-09-23 02:39	70.94	OK
3845	2026-09-23 02:40	69.19	OK	3846	2026-09-23 02:41	69.54	OK
3847	2026-09-23 02:42	70.60	OK	3848	2026-09-23 02:43	73.15	OK
3849	2026-09-23 02:44	70.29	OK	3850	2026-09-23 02:45	68.68	OK
3851	2026-09-23 02:46	71.46	OK	3852	2026-09-23 02:47	71.78	OK
3853	2026-09-23 02:48	70.70	OK	3854	2026-09-23 02:49	74.17	OK
3855	2026-09-23 02:50	72.18	OK	3856	2026-09-23 02:51	68.88	OK
3857	2026-09-23 02:52	69.73	OK	3858	2026-09-23 02:53	72.20	OK
3859	2026-09-23 02:54	72.75	OK	3860	2026-09-23 02:55	69.21	OK
3861	2026-09-23 02:56	71.51	OK	3862	2026-09-23 02:57	70.79	OK
3863	2026-09-23 02:58	71.65	OK	3864	2026-09-23 02:59	72.53	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3865	2026-09-23 03:00	69.94	OK	3866	2026-09-23 03:01	71.96	OK
3867	2026-09-23 03:02	70.41	OK	3868	2026-09-23 03:03	71.05	OK
3869	2026-09-23 03:04	70.22	OK	3870	2026-09-23 03:05	69.64	OK
3871	2026-09-23 03:06	71.79	OK	3872	2026-09-23 03:07	69.06	OK
3873	2026-09-23 03:08	70.36	OK	3874	2026-09-23 03:09	70.26	OK
3875	2026-09-23 03:10	65.66	OK	3876	2026-09-23 03:11	69.72	OK
3877	2026-09-23 03:12	69.45	OK	3878	2026-09-23 03:13	71.72	OK
3879	2026-09-23 03:14	69.47	OK	3880	2026-09-23 03:15	70.17	OK
3881	2026-09-23 03:16	66.33	OK	3882	2026-09-23 03:17	68.63	OK
3883	2026-09-23 03:18	71.01	OK	3884	2026-09-23 03:19	70.28	OK
3885	2026-09-23 03:20	70.87	OK	3886	2026-09-23 03:21	67.79	OK
3887	2026-09-23 03:22	68.26	OK	3888	2026-09-23 03:23	71.21	OK
3889	2026-09-23 03:24	70.67	OK	3890	2026-09-23 03:25	71.01	OK
3891	2026-09-23 03:26	66.62	OK	3892	2026-09-23 03:27	68.22	OK
3893	2026-09-23 03:28	69.42	OK	3894	2026-09-23 03:29	70.53	OK
3895	2026-09-23 03:30	68.39	OK	3896	2026-09-23 03:31	68.79	OK
3897	2026-09-23 03:32	69.50	OK	3898	2026-09-23 03:33	67.53	OK
3899	2026-09-23 03:34	69.54	OK	3900	2026-09-23 03:35	68.51	OK
3901	2026-09-23 03:36	69.37	OK	3902	2026-09-23 03:37	69.61	OK
3903	2026-09-23 03:38	66.56	OK	3904	2026-09-23 03:39	69.02	OK
3905	2026-09-23 03:40	68.59	OK	3906	2026-09-23 03:41	67.32	OK
3907	2026-09-23 03:42	68.82	OK	3908	2026-09-23 03:43	69.93	OK
3909	2026-09-23 03:44	71.58	OK	3910	2026-09-23 03:45	68.61	OK
3911	2026-09-23 03:46	72.88	OK	3912	2026-09-23 03:47	66.99	OK
3913	2026-09-23 03:48	66.67	OK	3914	2026-09-23 03:49	67.77	OK
3915	2026-09-23 03:50	69.24	OK	3916	2026-09-23 03:51	69.66	OK
3917	2026-09-23 03:52	69.57	OK	3918	2026-09-23 03:53	68.60	OK
3919	2026-09-23 03:54	70.29	OK	3920	2026-09-23 03:55	68.92	OK
3921	2026-09-23 03:56	68.71	OK	3922	2026-09-23 03:57	66.98	OK
3923	2026-09-23 03:58	70.22	OK	3924	2026-09-23 03:59	66.79	OK
3925	2026-09-23 04:00	68.69	OK	3926	2026-09-23 04:01	69.78	OK
3927	2026-09-23 04:02	68.60	OK	3928	2026-09-23 04:03	69.99	OK
3929	2026-09-23 04:04	69.10	OK	3930	2026-09-23 04:05	67.37	OK
3931	2026-09-23 04:06	70.01	OK	3932	2026-09-23 04:07	68.55	OK
3933	2026-09-23 04:08	70.68	OK	3934	2026-09-23 04:09	66.81	OK
3935	2026-09-23 04:10	67.19	OK	3936	2026-09-23 04:11	68.27	OK
3937	2026-09-23 04:12	69.00	OK	3938	2026-09-23 04:13	69.49	OK
3939	2026-09-23 04:14	69.69	OK	3940	2026-09-23 04:15	65.94	OK
3941	2026-09-23 04:16	69.43	OK	3942	2026-09-23 04:17	68.33	OK
3943	2026-09-23 04:18	65.80	OK	3944	2026-09-23 04:19	71.89	OK
3945	2026-09-23 04:20	66.86	OK	3946	2026-09-23 04:21	68.44	OK
3947	2026-09-23 04:22	71.52	OK	3948	2026-09-23 04:23	67.91	OK
3949	2026-09-23 04:24	67.85	OK	3950	2026-09-23 04:25	69.08	OK
3951	2026-09-23 04:26	67.32	OK	3952	2026-09-23 04:27	66.05	OK
3953	2026-09-23 04:28	68.27	OK	3954	2026-09-23 04:29	65.88	OK
3955	2026-09-23 04:30	70.05	OK	3956	2026-09-23 04:31	68.16	OK
3957	2026-09-23 04:32	69.30	OK	3958	2026-09-23 04:33	68.09	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3959	2026-09-23 04:34	71.71	OK	3960	2026-09-23 04:35	64.36	OK
3961	2026-09-23 04:36	66.44	OK	3962	2026-09-23 04:37	68.61	OK
3963	2026-09-23 04:38	68.54	OK	3964	2026-09-23 04:39	65.31	OK
3965	2026-09-23 04:40	72.69	OK	3966	2026-09-23 04:41	69.37	OK
3967	2026-09-23 04:42	68.66	OK	3968	2026-09-23 04:43	67.01	OK
3969	2026-09-23 04:44	69.60	OK	3970	2026-09-23 04:45	69.13	OK
3971	2026-09-23 04:46	68.25	OK	3972	2026-09-23 04:47	69.29	OK
3973	2026-09-23 04:48	64.78	OK	3974	2026-09-23 04:49	68.09	OK
3975	2026-09-23 04:50	68.75	OK	3976	2026-09-23 04:51	70.23	OK
3977	2026-09-23 04:52	69.13	OK	3978	2026-09-23 04:53	70.39	OK
3979	2026-09-23 04:54	65.19	OK	3980	2026-09-23 04:55	69.29	OK
3981	2026-09-23 04:56	68.06	OK	3982	2026-09-23 04:57	68.88	OK
3983	2026-09-23 04:58	68.34	OK	3984	2026-09-23 04:59	69.07	OK
3985	2026-09-23 05:00	71.13	OK	3986	2026-09-23 05:01	65.95	OK
3987	2026-09-23 05:02	66.88	OK	3988	2026-09-23 05:03	67.31	OK
3989	2026-09-23 05:04	66.02	OK	3990	2026-09-23 05:05	68.52	OK
3991	2026-09-23 05:06	69.31	OK	3992	2026-09-23 05:07	69.70	OK
3993	2026-09-23 05:08	65.83	OK	3994	2026-09-23 05:09	70.08	OK
3995	2026-09-23 05:10	68.97	OK	3996	2026-09-23 05:11	65.28	OK
3997	2026-09-23 05:12	65.91	OK	3998	2026-09-23 05:13	70.52	OK
3999	2026-09-23 05:14	69.68	OK	4000	2026-09-23 05:15	66.65	OK
4001	2026-09-23 05:16	66.32	OK	4002	2026-09-23 05:17	68.46	OK
4003	2026-09-23 05:18	66.95	OK	4004	2026-09-23 05:19	68.24	OK
4005	2026-09-23 05:20	68.59	OK	4006	2026-09-23 05:21	67.10	OK
4007	2026-09-23 05:22	68.34	OK	4008	2026-09-23 05:23	71.69	OK
4009	2026-09-23 05:24	70.31	OK	4010	2026-09-23 05:25	69.72	OK
4011	2026-09-23 05:26	67.40	OK	4012	2026-09-23 05:27	68.69	OK
4013	2026-09-23 05:28	68.06	OK	4014	2026-09-23 05:29	68.52	OK
4015	2026-09-23 05:30	65.73	OK	4016	2026-09-23 05:31	71.17	OK
4017	2026-09-23 05:32	65.48	OK	4018	2026-09-23 05:33	67.61	OK
4019	2026-09-23 05:34	70.38	OK	4020	2026-09-23 05:35	67.33	OK
4021	2026-09-23 05:36	66.26	OK	4022	2026-09-23 05:37	67.75	OK
4023	2026-09-23 05:38	68.76	OK	4024	2026-09-23 05:39	69.39	OK
4025	2026-09-23 05:40	66.38	OK	4026	2026-09-23 05:41	69.25	OK
4027	2026-09-23 05:42	70.38	OK	4028	2026-09-23 05:43	70.18	OK
4029	2026-09-23 05:44	67.30	OK	4030	2026-09-23 05:45	67.79	OK
4031	2026-09-23 05:46	67.44	OK	4032	2026-09-23 05:47	66.91	OK
4033	2026-09-23 05:48	66.92	OK	4034	2026-09-23 05:49	66.18	OK
4035	2026-09-23 05:50	64.03	OK	4036	2026-09-23 05:51	66.91	OK
4037	2026-09-23 05:52	65.25	OK	4038	2026-09-23 05:53	65.19	OK
4039	2026-09-23 05:54	66.65	OK	4040	2026-09-23 05:55	70.90	OK
4041	2026-09-23 05:56	64.32	OK	4042	2026-09-23 05:57	65.98	OK
4043	2026-09-23 05:58	66.81	OK	4044	2026-09-23 05:59	67.04	OK
4045	2026-09-23 06:00	67.40	OK	4046	2026-09-23 06:01	65.25	OK
4047	2026-09-23 06:02	67.18	OK	4048	2026-09-23 06:03	65.55	OK
4049	2026-09-23 06:04	66.06	OK	4050	2026-09-23 06:05	66.24	OK
4051	2026-09-23 06:06	71.41	OK	4052	2026-09-23 06:07	66.98	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4053	2026-09-23 06:08	67.80	OK	4054	2026-09-23 06:09	68.20	OK
4055	2026-09-23 06:10	70.08	OK	4056	2026-09-23 06:11	66.81	OK
4057	2026-09-23 06:12	68.08	OK	4058	2026-09-23 06:13	63.89	OK
4059	2026-09-23 06:14	65.05	OK	4060	2026-09-23 06:15	69.01	OK
4061	2026-09-23 06:16	67.01	OK	4062	2026-09-23 06:17	66.82	OK
4063	2026-09-23 06:18	68.43	OK	4064	2026-09-23 06:19	67.11	OK
4065	2026-09-23 06:20	65.98	OK	4066	2026-09-23 06:21	66.17	OK
4067	2026-09-23 06:22	66.00	OK	4068	2026-09-23 06:23	67.25	OK
4069	2026-09-23 06:24	65.76	OK	4070	2026-09-23 06:25	69.33	OK
4071	2026-09-23 06:26	67.12	OK	4072	2026-09-23 06:27	69.32	OK
4073	2026-09-23 06:28	69.34	OK	4074	2026-09-23 06:29	67.93	OK
4075	2026-09-23 06:30	69.51	OK	4076	2026-09-23 06:31	67.03	OK
4077	2026-09-23 06:32	67.70	OK	4078	2026-09-23 06:33	65.48	OK
4079	2026-09-23 06:34	69.40	OK	4080	2026-09-23 06:35	66.26	OK
4081	2026-09-23 06:36	68.86	OK	4082	2026-09-23 06:37	65.77	OK
4083	2026-09-23 06:38	69.14	OK	4084	2026-09-23 06:39	66.85	OK
4085	2026-09-23 06:40	66.68	OK	4086	2026-09-23 06:41	66.93	OK
4087	2026-09-23 06:42	66.67	OK	4088	2026-09-23 06:43	66.58	OK
4089	2026-09-23 06:44	70.98	OK	4090	2026-09-23 06:45	69.30	OK
4091	2026-09-23 06:46	69.79	OK	4092	2026-09-23 06:47	67.97	OK
4093	2026-09-23 06:48	68.88	OK	4094	2026-09-23 06:49	67.27	OK
4095	2026-09-23 06:50	66.56	OK	4096	2026-09-23 06:51	67.83	OK
4097	2026-09-23 06:52	66.55	OK	4098	2026-09-23 06:53	66.91	OK
4099	2026-09-23 06:54	69.10	OK	4100	2026-09-23 06:55	70.12	OK
4101	2026-09-23 06:56	70.79	OK	4102	2026-09-23 06:57	69.56	OK
4103	2026-09-23 06:58	68.56	OK	4104	2026-09-23 06:59	68.46	OK
4105	2026-09-23 07:00	68.53	OK	4106	2026-09-23 07:01	67.84	OK
4107	2026-09-23 07:02	67.96	OK	4108	2026-09-23 07:03	68.49	OK
4109	2026-09-23 07:04	66.37	OK	4110	2026-09-23 07:05	69.74	OK
4111	2026-09-23 07:06	65.27	OK	4112	2026-09-23 07:07	67.98	OK
4113	2026-09-23 07:08	65.48	OK	4114	2026-09-23 07:09	67.84	OK
4115	2026-09-23 07:10	67.96	OK	4116	2026-09-23 07:11	68.33	OK
4117	2026-09-23 07:12	65.90	OK	4118	2026-09-23 07:13	66.40	OK
4119	2026-09-23 07:14	68.55	OK	4120	2026-09-23 07:15	67.60	OK
4121	2026-09-23 07:16	71.05	OK	4122	2026-09-23 07:17	67.47	OK
4123	2026-09-23 07:18	68.31	OK	4124	2026-09-23 07:19	68.17	OK
4125	2026-09-23 07:20	65.15	OK	4126	2026-09-23 07:21	71.26	OK
4127	2026-09-23 07:22	68.60	OK	4128	2026-09-23 07:23	67.62	OK
4129	2026-09-23 07:24	69.69	OK	4130	2026-09-23 07:25	69.78	OK
4131	2026-09-23 07:26	68.12	OK	4132	2026-09-23 07:27	66.69	OK
4133	2026-09-23 07:28	65.47	OK	4134	2026-09-23 07:29	68.74	OK
4135	2026-09-23 07:30	66.06	OK	4136	2026-09-23 07:31	67.03	OK
4137	2026-09-23 07:32	65.01	OK	4138	2026-09-23 07:33	67.82	OK
4139	2026-09-23 07:34	67.72	OK	4140	2026-09-23 07:35	70.31	OK
4141	2026-09-23 07:36	67.70	OK	4142	2026-09-23 07:37	70.38	OK
4143	2026-09-23 07:38	69.63	OK	4144	2026-09-23 07:39	70.29	OK
4145	2026-09-23 07:40	64.25	OK	4146	2026-09-23 07:41	70.03	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4147	2026-09-23 07:42	66.51	OK	4148	2026-09-23 07:43	67.77	OK
4149	2026-09-23 07:44	66.81	OK	4150	2026-09-23 07:45	69.65	OK
4151	2026-09-23 07:46	66.65	OK	4152	2026-09-23 07:47	67.36	OK
4153	2026-09-23 07:48	68.41	OK	4154	2026-09-23 07:49	70.97	OK
4155	2026-09-23 07:50	67.90	OK	4156	2026-09-23 07:51	70.59	OK
4157	2026-09-23 07:52	66.32	OK	4158	2026-09-23 07:53	70.03	OK
4159	2026-09-23 07:54	67.88	OK	4160	2026-09-23 07:55	66.38	OK
4161	2026-09-23 07:56	67.28	OK	4162	2026-09-23 07:57	68.95	OK
4163	2026-09-23 07:58	66.85	OK	4164	2026-09-23 07:59	69.11	OK
4165	2026-09-23 08:00	67.60	OK	4166	2026-09-23 08:01	70.61	OK
4167	2026-09-23 08:02	69.35	OK	4168	2026-09-23 08:03	70.74	OK
4169	2026-09-23 08:04	67.53	OK	4170	2026-09-23 08:05	66.03	OK
4171	2026-09-23 08:06	69.67	OK	4172	2026-09-23 08:07	69.68	OK
4173	2026-09-23 08:08	70.20	OK	4174	2026-09-23 08:09	68.31	OK
4175	2026-09-23 08:10	69.57	OK	4176	2026-09-23 08:11	69.12	OK
4177	2026-09-23 08:12	67.25	OK	4178	2026-09-23 08:13	65.52	OK
4179	2026-09-23 08:14	70.01	OK	4180	2026-09-23 08:15	69.13	OK
4181	2026-09-23 08:16	67.34	OK	4182	2026-09-23 08:17	66.55	OK
4183	2026-09-23 08:18	69.03	OK	4184	2026-09-23 08:19	67.00	OK
4185	2026-09-23 08:20	69.72	OK	4186	2026-09-23 08:21	64.99	OK
4187	2026-09-23 08:22	67.31	OK	4188	2026-09-23 08:23	72.29	OK
4189	2026-09-23 08:24	68.59	OK	4190	2026-09-23 08:25	69.25	OK
4191	2026-09-23 08:26	67.86	OK	4192	2026-09-23 08:27	71.20	OK
4193	2026-09-23 08:28	69.91	OK	4194	2026-09-23 08:29	69.84	OK
4195	2026-09-23 08:30	66.90	OK	4196	2026-09-23 08:31	71.13	OK
4197	2026-09-23 08:32	68.23	OK	4198	2026-09-23 08:33	71.29	OK
4199	2026-09-23 08:34	68.44	OK	4200	2026-09-23 08:35	67.58	OK
4201	2026-09-23 08:36	69.82	OK	4202	2026-09-23 08:37	67.39	OK
4203	2026-09-23 08:38	69.08	OK	4204	2026-09-23 08:39	68.47	OK
4205	2026-09-23 08:40	69.03	OK	4206	2026-09-23 08:41	68.41	OK
4207	2026-09-23 08:42	68.20	OK	4208	2026-09-23 08:43	66.59	OK
4209	2026-09-23 08:44	71.65	OK	4210	2026-09-23 08:45	65.81	OK
4211	2026-09-23 08:46	70.02	OK	4212	2026-09-23 08:47	66.98	OK
4213	2026-09-23 08:48	67.79	OK	4214	2026-09-23 08:49	66.24	OK
4215	2026-09-23 08:50	69.45	OK	4216	2026-09-23 08:51	71.12	OK
4217	2026-09-23 08:52	65.56	OK	4218	2026-09-23 08:53	71.12	OK
4219	2026-09-23 08:54	68.36	OK	4220	2026-09-23 08:55	73.76	OK
4221	2026-09-23 08:56	70.28	OK	4222	2026-09-23 08:57	69.31	OK
4223	2026-09-23 08:58	70.14	OK	4224	2026-09-23 08:59	66.35	OK
4225	2026-09-23 09:00	69.78	OK	4226	2026-09-23 09:01	69.65	OK
4227	2026-09-23 09:02	66.02	OK	4228	2026-09-23 09:03	66.86	OK
4229	2026-09-23 09:04	68.76	OK	4230	2026-09-23 09:05	66.53	OK
4231	2026-09-23 09:06	73.30	OK	4232	2026-09-23 09:07	71.40	OK
4233	2026-09-23 09:08	67.31	OK	4234	2026-09-23 09:09	70.81	OK
4235	2026-09-23 09:10	67.37	OK	4236	2026-09-23 09:11	69.55	OK
4237	2026-09-23 09:12	71.38	OK	4238	2026-09-23 09:13	69.21	OK
4239	2026-09-23 09:14	67.83	OK	4240	2026-09-23 09:15	70.10	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4241	2026-09-23 09:16	69.53	OK	4242	2026-09-23 09:17	68.72	OK
4243	2026-09-23 09:18	73.64	OK	4244	2026-09-23 09:19	65.53	OK
4245	2026-09-23 09:20	70.44	OK	4246	2026-09-23 09:21	67.66	OK
4247	2026-09-23 09:22	70.44	OK	4248	2026-09-23 09:23	70.04	OK
4249	2026-09-23 09:24	69.51	OK	4250	2026-09-23 09:25	72.31	OK
4251	2026-09-23 09:26	68.36	OK	4252	2026-09-23 09:27	69.84	OK
4253	2026-09-23 09:28	73.16	OK	4254	2026-09-23 09:29	71.55	OK
4255	2026-09-23 09:30	72.32	OK	4256	2026-09-23 09:31	72.02	OK
4257	2026-09-23 09:32	67.49	OK	4258	2026-09-23 09:33	67.13	OK
4259	2026-09-23 09:34	70.76	OK	4260	2026-09-23 09:35	69.98	OK
4261	2026-09-23 09:36	70.01	OK	4262	2026-09-23 09:37	68.20	OK
4263	2026-09-23 09:38	68.45	OK	4264	2026-09-23 09:39	71.60	OK
4265	2026-09-23 09:40	69.36	OK	4266	2026-09-23 09:41	66.40	OK
4267	2026-09-23 09:42	71.44	OK	4268	2026-09-23 09:43	70.48	OK
4269	2026-09-23 09:44	67.38	OK	4270	2026-09-23 09:45	69.04	OK
4271	2026-09-23 09:46	66.41	OK	4272	2026-09-23 09:47	71.73	OK
4273	2026-09-23 09:48	70.01	OK	4274	2026-09-23 09:49	71.84	OK
4275	2026-09-23 09:50	68.41	OK	4276	2026-09-23 09:51	68.82	OK
4277	2026-09-23 09:52	70.14	OK	4278	2026-09-23 09:53	69.78	OK
4279	2026-09-23 09:54	71.30	OK	4280	2026-09-23 09:55	68.15	OK
4281	2026-09-23 09:56	66.81	OK	4282	2026-09-23 09:57	69.42	OK
4283	2026-09-23 09:58	69.75	OK	4284	2026-09-23 09:59	70.49	OK
4285	2026-09-23 10:00	71.67	OK	4286	2026-09-23 10:01	72.17	OK
4287	2026-09-23 10:02	69.71	OK	4288	2026-09-23 10:03	67.93	OK
4289	2026-09-23 10:04	69.23	OK	4290	2026-09-23 10:05	72.45	OK
4291	2026-09-23 10:06	71.58	OK	4292	2026-09-23 10:07	72.35	OK
4293	2026-09-23 10:08	68.09	OK	4294	2026-09-23 10:09	72.75	OK
4295	2026-09-23 10:10	68.35	OK	4296	2026-09-23 10:11	71.73	OK
4297	2026-09-23 10:12	71.49	OK	4298	2026-09-23 10:13	70.24	OK
4299	2026-09-23 10:14	71.92	OK	4300	2026-09-23 10:15	70.28	OK
4301	2026-09-23 10:16	70.95	OK	4302	2026-09-23 10:17	71.24	OK
4303	2026-09-23 10:18	70.04	OK	4304	2026-09-23 10:19	70.41	OK
4305	2026-09-23 10:20	68.53	OK	4306	2026-09-23 10:21	69.49	OK
4307	2026-09-23 10:22	70.03	OK	4308	2026-09-23 10:23	72.59	OK
4309	2026-09-23 10:24	69.46	OK	4310	2026-09-23 10:25	69.57	OK
4311	2026-09-23 10:26	70.43	OK	4312	2026-09-23 10:27	71.51	OK
4313	2026-09-23 10:28	71.67	OK	4314	2026-09-23 10:29	68.36	OK
4315	2026-09-23 10:30	70.25	OK	4316	2026-09-23 10:31	70.87	OK
4317	2026-09-23 10:32	72.90	OK	4318	2026-09-23 10:33	68.01	OK
4319	2026-09-23 10:34	69.66	OK	4320	2026-09-23 10:35	72.61	OK
4321	2026-09-23 10:36	73.37	OK	4322	2026-09-23 10:37	70.82	OK
4323	2026-09-23 10:38	75.54	OK	4324	2026-09-23 10:39	69.52	OK
4325	2026-09-23 10:40	70.70	OK	4326	2026-09-23 10:41	71.36	OK
4327	2026-09-23 10:42	72.83	OK	4328	2026-09-23 10:43	69.40	OK
4329	2026-09-23 10:44	68.79	OK	4330	2026-09-23 10:45	70.33	OK
4331	2026-09-23 10:46	72.73	OK	4332	2026-09-23 10:47	72.57	OK
4333	2026-09-23 10:48	69.72	OK	4334	2026-09-23 10:49	70.17	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4335	2026-09-23 10:50	74.06	OK	4336	2026-09-23 10:51	68.89	OK
4337	2026-09-23 10:52	73.65	OK	4338	2026-09-23 10:53	71.48	OK
4339	2026-09-23 10:54	70.86	OK	4340	2026-09-23 10:55	73.19	OK
4341	2026-09-23 10:56	72.76	OK	4342	2026-09-23 10:57	70.99	OK
4343	2026-09-23 10:58	71.33	OK	4344	2026-09-23 10:59	70.90	OK
4345	2026-09-23 11:00	68.68	OK	4346	2026-09-23 11:01	72.15	OK
4347	2026-09-23 11:02	71.67	OK	4348	2026-09-23 11:03	69.54	OK
4349	2026-09-23 11:04	72.01	OK	4350	2026-09-23 11:05	73.86	OK
4351	2026-09-23 11:06	72.99	OK	4352	2026-09-23 11:07	72.97	OK
4353	2026-09-23 11:08	74.68	OK	4354	2026-09-23 11:09	74.63	OK
4355	2026-09-23 11:10	69.93	OK	4356	2026-09-23 11:11	73.51	OK
4357	2026-09-23 11:12	73.57	OK	4358	2026-09-23 11:13	70.29	OK
4359	2026-09-23 11:14	72.97	OK	4360	2026-09-23 11:15	73.62	OK
4361	2026-09-23 11:16	73.39	OK	4362	2026-09-23 11:17	75.29	OK
4363	2026-09-23 11:18	72.59	OK	4364	2026-09-23 11:19	70.70	OK
4365	2026-09-23 11:20	73.76	OK	4366	2026-09-23 11:21	73.52	OK
4367	2026-09-23 11:22	73.75	OK	4368	2026-09-23 11:23	74.52	OK
4369	2026-09-23 11:24	72.10	OK	4370	2026-09-23 11:25	71.91	OK
4371	2026-09-23 11:26	72.17	OK	4372	2026-09-23 11:27	72.37	OK
4373	2026-09-23 11:28	73.25	OK	4374	2026-09-23 11:29	73.18	OK
4375	2026-09-23 11:30	72.66	OK	4376	2026-09-23 11:31	72.74	OK
4377	2026-09-23 11:32	71.59	OK	4378	2026-09-23 11:33	72.53	OK
4379	2026-09-23 11:34	74.28	OK	4380	2026-09-23 11:35	72.20	OK
4381	2026-09-23 11:36	71.22	OK	4382	2026-09-23 11:37	72.40	OK
4383	2026-09-23 11:38	70.46	OK	4384	2026-09-23 11:39	69.99	OK
4385	2026-09-23 11:40	73.19	OK	4386	2026-09-23 11:41	75.82	OK
4387	2026-09-23 11:42	75.44	OK	4388	2026-09-23 11:43	76.95	OK
4389	2026-09-23 11:44	71.37	OK	4390	2026-09-23 11:45	72.31	OK
4391	2026-09-23 11:46	74.26	OK	4392	2026-09-23 11:47	74.91	OK
4393	2026-09-23 11:48	71.84	OK	4394	2026-09-23 11:49	70.58	OK
4395	2026-09-23 11:50	70.52	OK	4396	2026-09-23 11:51	74.18	OK
4397	2026-09-23 11:52	73.13	OK	4398	2026-09-23 11:53	72.80	OK
4399	2026-09-23 11:54	77.64	OK	4400	2026-09-23 11:55	74.33	OK
4401	2026-09-23 11:56	75.68	OK	4402	2026-09-23 11:57	72.34	OK
4403	2026-09-23 11:58	71.82	OK	4404	2026-09-23 11:59	73.87	OK
4405	2026-09-23 12:00	71.39	OK	4406	2026-09-23 12:01	74.47	OK
4407	2026-09-23 12:02	73.35	OK	4408	2026-09-23 12:03	72.19	OK
4409	2026-09-23 12:04	74.39	OK	4410	2026-09-23 12:05	77.48	OK
4411	2026-09-23 12:06	74.78	OK	4412	2026-09-23 12:07	73.43	OK
4413	2026-09-23 12:08	76.15	OK	4414	2026-09-23 12:09	76.41	OK
4415	2026-09-23 12:10	75.04	OK	4416	2026-09-23 12:11	74.52	OK
4417	2026-09-23 12:12	75.31	OK	4418	2026-09-23 12:13	74.22	OK
4419	2026-09-23 12:14	77.28	OK	4420	2026-09-23 12:15	75.37	OK
4421	2026-09-23 12:16	72.62	OK	4422	2026-09-23 12:17	71.84	OK
4423	2026-09-23 12:18	75.71	OK	4424	2026-09-23 12:19	74.09	OK
4425	2026-09-23 12:20	73.74	OK	4426	2026-09-23 12:21	75.78	OK
4427	2026-09-23 12:22	75.42	OK	4428	2026-09-23 12:23	74.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4429	2026-09-23 12:24	75.70	OK	4430	2026-09-23 12:25	76.36	OK
4431	2026-09-23 12:26	71.18	OK	4432	2026-09-23 12:27	76.40	OK
4433	2026-09-23 12:28	74.53	OK	4434	2026-09-23 12:29	77.36	OK
4435	2026-09-23 12:30	74.97	OK	4436	2026-09-23 12:31	78.65	OK
4437	2026-09-23 12:32	76.32	OK	4438	2026-09-23 12:33	76.73	OK
4439	2026-09-23 12:34	72.29	OK	4440	2026-09-23 12:35	74.83	OK
4441	2026-09-23 12:36	72.85	OK	4442	2026-09-23 12:37	74.98	OK
4443	2026-09-23 12:38	72.58	OK	4444	2026-09-23 12:39	78.89	OK
4445	2026-09-23 12:40	77.23	OK	4446	2026-09-23 12:41	73.25	OK
4447	2026-09-23 12:42	75.55	OK	4448	2026-09-23 12:43	75.45	OK
4449	2026-09-23 12:44	73.29	OK	4450	2026-09-23 12:45	73.91	OK
4451	2026-09-23 12:46	76.40	OK	4452	2026-09-23 12:47	74.36	OK
4453	2026-09-23 12:48	70.94	OK	4454	2026-09-23 12:49	76.07	OK
4455	2026-09-23 12:50	75.28	OK	4456	2026-09-23 12:51	72.51	OK
4457	2026-09-23 12:52	74.86	OK	4458	2026-09-23 12:53	75.18	OK
4459	2026-09-23 12:54	78.44	OK	4460	2026-09-23 12:55	77.40	OK
4461	2026-09-23 12:56	77.69	OK	4462	2026-09-23 12:57	75.67	OK
4463	2026-09-23 12:58	77.04	OK	4464	2026-09-23 12:59	77.12	OK
4465	2026-09-23 13:00	77.88	OK	4466	2026-09-23 13:01	75.78	OK
4467	2026-09-23 13:02	78.69	OK	4468	2026-09-23 13:03	78.18	OK
4469	2026-09-23 13:04	73.50	OK	4470	2026-09-23 13:05	77.49	OK
4471	2026-09-23 13:06	77.66	OK	4472	2026-09-23 13:07	74.69	OK
4473	2026-09-23 13:08	75.81	OK	4474	2026-09-23 13:09	75.71	OK
4475	2026-09-23 13:10	74.47	OK	4476	2026-09-23 13:11	77.20	OK
4477	2026-09-23 13:12	75.51	OK	4478	2026-09-23 13:13	79.81	OK
4479	2026-09-23 13:14	75.30	OK	4480	2026-09-23 13:15	76.04	OK
4481	2026-09-23 13:16	78.46	OK	4482	2026-09-23 13:17	75.42	OK
4483	2026-09-23 13:18	75.46	OK	4484	2026-09-23 13:19	75.51	OK
4485	2026-09-23 13:20	76.97	OK	4486	2026-09-23 13:21	76.40	OK
4487	2026-09-23 13:22	77.15	OK	4488	2026-09-23 13:23	78.71	OK
4489	2026-09-23 13:24	75.40	OK	4490	2026-09-23 13:25	78.50	OK
4491	2026-09-23 13:26	76.32	OK	4492	2026-09-23 13:27	76.10	OK
4493	2026-09-23 13:28	74.99	OK	4494	2026-09-23 13:29	76.70	OK
4495	2026-09-23 13:30	77.79	OK	4496	2026-09-23 13:31	76.52	OK
4497	2026-09-23 13:32	73.33	OK	4498	2026-09-23 13:33	77.89	OK
4499	2026-09-23 13:34	74.93	OK	4500	2026-09-23 13:35	76.38	OK
4501	2026-09-23 13:36	76.39	OK	4502	2026-09-23 13:37	75.54	OK
4503	2026-09-23 13:38	77.64	OK	4504	2026-09-23 13:39	74.57	OK
4505	2026-09-23 13:40	77.59	OK	4506	2026-09-23 13:41	78.67	OK
4507	2026-09-23 13:42	77.50	OK	4508	2026-09-23 13:43	77.74	OK
4509	2026-09-23 13:44	77.81	OK	4510	2026-09-23 13:45	77.95	OK
4511	2026-09-23 13:46	77.20	OK	4512	2026-09-23 13:47	75.25	OK
4513	2026-09-23 13:48	76.52	OK	4514	2026-09-23 13:49	80.06	OK
4515	2026-09-23 13:50	75.10	OK	4516	2026-09-23 13:51	78.91	OK
4517	2026-09-23 13:52	80.21	OK	4518	2026-09-23 13:53	76.86	OK
4519	2026-09-23 13:54	78.59	OK	4520	2026-09-23 13:55	78.00	OK
4521	2026-09-23 13:56	76.15	OK	4522	2026-09-23 13:57	75.14	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4523	2026-09-23 13:58	76.82	OK	4524	2026-09-23 13:59	77.02	OK
4525	2026-09-23 14:00	75.88	OK	4526	2026-09-23 14:01	78.66	OK
4527	2026-09-23 14:02	81.62	OK	4528	2026-09-23 14:03	76.86	OK
4529	2026-09-23 14:04	77.48	OK	4530	2026-09-23 14:05	78.76	OK
4531	2026-09-23 14:06	77.69	OK	4532	2026-09-23 14:07	78.17	OK
4533	2026-09-23 14:08	76.68	OK	4534	2026-09-23 14:09	75.75	OK
4535	2026-09-23 14:10	75.34	OK	4536	2026-09-23 14:11	81.07	OK
4537	2026-09-23 14:12	76.52	OK	4538	2026-09-23 14:13	79.63	OK
4539	2026-09-23 14:14	76.80	OK	4540	2026-09-23 14:15	79.43	OK
4541	2026-09-23 14:16	77.17	OK	4542	2026-09-23 14:17	75.88	OK
4543	2026-09-23 14:18	78.14	OK	4544	2026-09-23 14:19	77.17	OK
4545	2026-09-23 14:20	80.41	OK	4546	2026-09-23 14:21	76.66	OK
4547	2026-09-23 14:22	78.45	OK	4548	2026-09-23 14:23	77.36	OK
4549	2026-09-23 14:24	77.58	OK	4550	2026-09-23 14:25	82.35	OK
4551	2026-09-23 14:26	78.45	OK	4552	2026-09-23 14:27	79.13	OK
4553	2026-09-23 14:28	78.07	OK	4554	2026-09-23 14:29	78.41	OK
4555	2026-09-23 14:30	75.09	OK	4556	2026-09-23 14:31	76.11	OK
4557	2026-09-23 14:32	80.17	OK	4558	2026-09-23 14:33	76.93	OK
4559	2026-09-23 14:34	77.07	OK	4560	2026-09-23 14:35	77.59	OK
4561	2026-09-23 14:36	78.18	OK	4562	2026-09-23 14:37	79.78	OK
4563	2026-09-23 14:38	78.36	OK	4564	2026-09-23 14:39	79.16	OK
4565	2026-09-23 14:40	79.02	OK	4566	2026-09-23 14:41	76.35	OK
4567	2026-09-23 14:42	82.04	OK	4568	2026-09-23 14:43	78.80	OK
4569	2026-09-23 14:44	79.00	OK	4570	2026-09-23 14:45	80.46	OK
4571	2026-09-23 14:46	80.28	OK	4572	2026-09-23 14:47	78.96	OK
4573	2026-09-23 14:48	77.45	OK	4574	2026-09-23 14:49	80.18	OK
4575	2026-09-23 14:50	81.16	OK	4576	2026-09-23 14:51	78.37	OK
4577	2026-09-23 14:52	76.89	OK	4578	2026-09-23 14:53	76.92	OK
4579	2026-09-23 14:54	80.25	OK	4580	2026-09-23 14:55	78.21	OK
4581	2026-09-23 14:56	77.79	OK	4582	2026-09-23 14:57	76.60	OK
4583	2026-09-23 14:58	82.08	OK	4584	2026-09-23 14:59	79.73	OK
4585	2026-09-23 15:00	79.41	OK	4586	2026-09-23 15:01	78.70	OK
4587	2026-09-23 15:02	76.82	OK	4588	2026-09-23 15:03	78.58	OK
4589	2026-09-23 15:04	80.05	OK	4590	2026-09-23 15:05	77.39	OK
4591	2026-09-23 15:06	77.72	OK	4592	2026-09-23 15:07	78.94	OK
4593	2026-09-23 15:08	80.54	OK	4594	2026-09-23 15:09	80.25	OK
4595	2026-09-23 15:10	78.78	OK	4596	2026-09-23 15:11	79.26	OK
4597	2026-09-23 15:12	79.09	OK	4598	2026-09-23 15:13	77.64	OK
4599	2026-09-23 15:14	79.07	OK	4600	2026-09-23 15:15	76.21	OK
4601	2026-09-23 15:16	79.86	OK	4602	2026-09-23 15:17	78.54	OK
4603	2026-09-23 15:18	81.44	OK	4604	2026-09-23 15:19	76.91	OK
4605	2026-09-23 15:20	77.58	OK	4606	2026-09-23 15:21	78.99	OK
4607	2026-09-23 15:22	76.02	OK	4608	2026-09-23 15:23	81.58	OK
4609	2026-09-23 15:24	78.45	OK	4610	2026-09-23 15:25	80.12	OK
4611	2026-09-23 15:26	78.64	OK	4612	2026-09-23 15:27	78.16	OK
4613	2026-09-23 15:28	80.70	OK	4614	2026-09-23 15:29	78.26	OK
4615	2026-09-23 15:30	80.75	OK	4616	2026-09-23 15:31	79.38	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4617	2026-09-23 15:32	81.37	OK	4618	2026-09-23 15:33	78.22	OK
4619	2026-09-23 15:34	77.22	OK	4620	2026-09-23 15:35	77.55	OK
4621	2026-09-23 15:36	79.91	OK	4622	2026-09-23 15:37	79.23	OK
4623	2026-09-23 15:38	80.47	OK	4624	2026-09-23 15:39	81.13	OK
4625	2026-09-23 15:40	82.24	OK	4626	2026-09-23 15:41	77.33	OK
4627	2026-09-23 15:42	79.70	OK	4628	2026-09-23 15:43	79.40	OK
4629	2026-09-23 15:44	79.06	OK	4630	2026-09-23 15:45	80.99	OK
4631	2026-09-23 15:46	78.66	OK	4632	2026-09-23 15:47	79.74	OK
4633	2026-09-23 15:48	80.88	OK	4634	2026-09-23 15:49	80.94	OK
4635	2026-09-23 15:50	79.14	OK	4636	2026-09-23 15:51	78.86	OK
4637	2026-09-23 15:52	76.50	OK	4638	2026-09-23 15:53	79.14	OK
4639	2026-09-23 15:54	82.47	OK	4640	2026-09-23 15:55	82.20	OK
4641	2026-09-23 15:56	81.56	OK	4642	2026-09-23 15:57	81.75	OK
4643	2026-09-23 15:58	80.21	OK	4644	2026-09-23 15:59	77.78	OK
4645	2026-09-23 16:00	79.01	OK	4646	2026-09-23 16:01	79.40	OK
4647	2026-09-23 16:02	77.28	OK	4648	2026-09-23 16:03	79.91	OK
4649	2026-09-23 16:04	81.04	OK	4650	2026-09-23 16:05	80.55	OK
4651	2026-09-23 16:06	81.15	OK	4652	2026-09-23 16:07	82.48	OK
4653	2026-09-23 16:08	79.55	OK	4654	2026-09-23 16:09	80.13	OK
4655	2026-09-23 16:10	76.13	OK	4656	2026-09-23 16:11	80.94	OK
4657	2026-09-23 16:12	76.86	OK	4658	2026-09-23 16:13	80.32	OK
4659	2026-09-23 16:14	80.43	OK	4660	2026-09-23 16:15	80.58	OK
4661	2026-09-23 16:16	83.17	OK	4662	2026-09-23 16:17	81.80	OK
4663	2026-09-23 16:18	79.47	OK	4664	2026-09-23 16:19	78.67	OK
4665	2026-09-23 16:20	79.74	OK	4666	2026-09-23 16:21	81.00	OK
4667	2026-09-23 16:22	80.64	OK	4668	2026-09-23 16:23	80.36	OK
4669	2026-09-23 16:24	82.55	OK	4670	2026-09-23 16:25	81.14	OK
4671	2026-09-23 16:26	81.57	OK	4672	2026-09-23 16:27	81.50	OK
4673	2026-09-23 16:28	78.44	OK	4674	2026-09-23 16:29	79.14	OK
4675	2026-09-23 16:30	81.00	OK	4676	2026-09-23 16:31	79.37	OK
4677	2026-09-23 16:32	82.00	OK	4678	2026-09-23 16:33	80.68	OK
4679	2026-09-23 16:34	82.32	OK	4680	2026-09-23 16:35	82.13	OK
4681	2026-09-23 16:36	79.55	OK	4682	2026-09-23 16:37	77.46	OK
4683	2026-09-23 16:38	81.13	OK	4684	2026-09-23 16:39	79.33	OK
4685	2026-09-23 16:40	79.12	OK	4686	2026-09-23 16:41	81.40	OK
4687	2026-09-23 16:42	82.04	OK	4688	2026-09-23 16:43	81.45	OK
4689	2026-09-23 16:44	80.43	OK	4690	2026-09-23 16:45	82.39	OK
4691	2026-09-23 16:46	83.98	OK	4692	2026-09-23 16:47	80.41	OK
4693	2026-09-23 16:48	82.12	OK	4694	2026-09-23 16:49	84.24	OK
4695	2026-09-23 16:50	79.96	OK	4696	2026-09-23 16:51	82.96	OK
4697	2026-09-23 16:52	81.11	OK	4698	2026-09-23 16:53	77.10	OK
4699	2026-09-23 16:54	81.47	OK	4700	2026-09-23 16:55	81.78	OK
4701	2026-09-23 16:56	80.37	OK	4702	2026-09-23 16:57	82.01	OK
4703	2026-09-23 16:58	79.26	OK	4704	2026-09-23 16:59	79.01	OK
4705	2026-09-23 17:00	78.54	OK	4706	2026-09-23 17:01	82.36	OK
4707	2026-09-23 17:02	82.78	OK	4708	2026-09-23 17:03	80.50	OK
4709	2026-09-23 17:04	80.68	OK	4710	2026-09-23 17:05	81.50	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4711	2026-09-23 17:06	81.42	OK	4712	2026-09-23 17:07	80.27	OK
4713	2026-09-23 17:08	79.74	OK	4714	2026-09-23 17:09	80.66	OK
4715	2026-09-23 17:10	80.59	OK	4716	2026-09-23 17:11	81.80	OK
4717	2026-09-23 17:12	81.50	OK	4718	2026-09-23 17:13	79.88	OK
4719	2026-09-23 17:14	81.36	OK	4720	2026-09-23 17:15	77.45	OK
4721	2026-09-23 17:16	78.62	OK	4722	2026-09-23 17:17	80.77	OK
4723	2026-09-23 17:18	82.52	OK	4724	2026-09-23 17:19	78.65	OK
4725	2026-09-23 17:20	82.16	OK	4726	2026-09-23 17:21	81.17	OK
4727	2026-09-23 17:22	79.03	OK	4728	2026-09-23 17:23	80.72	OK
4729	2026-09-23 17:24	80.38	OK	4730	2026-09-23 17:25	77.89	OK
4731	2026-09-23 17:26	78.96	OK	4732	2026-09-23 17:27	81.69	OK
4733	2026-09-23 17:28	80.32	OK	4734	2026-09-23 17:29	81.47	OK
4735	2026-09-23 17:30	79.87	OK	4736	2026-09-23 17:31	80.93	OK
4737	2026-09-23 17:32	81.89	OK	4738	2026-09-23 17:33	80.82	OK
4739	2026-09-23 17:34	82.87	OK	4740	2026-09-23 17:35	83.66	OK
4741	2026-09-23 17:36	81.91	OK	4742	2026-09-23 17:37	79.87	OK
4743	2026-09-23 17:38	80.97	OK	4744	2026-09-23 17:39	81.96	OK
4745	2026-09-23 17:40	82.11	OK	4746	2026-09-23 17:41	81.17	OK
4747	2026-09-23 17:42	78.64	OK	4748	2026-09-23 17:43	85.07	OK
4749	2026-09-23 17:44	82.35	OK	4750	2026-09-23 17:45	82.34	OK
4751	2026-09-23 17:46	82.38	OK	4752	2026-09-23 17:47	81.01	OK
4753	2026-09-23 17:48	80.29	OK	4754	2026-09-23 17:49	82.30	OK
4755	2026-09-23 17:50	83.42	OK	4756	2026-09-23 17:51	82.31	OK
4757	2026-09-23 17:52	81.61	OK	4758	2026-09-23 17:53	77.17	OK
4759	2026-09-23 17:54	82.85	OK	4760	2026-09-23 17:55	80.77	OK
4761	2026-09-23 17:56	80.16	OK	4762	2026-09-23 17:57	80.41	OK
4763	2026-09-23 17:58	78.13	OK	4764	2026-09-23 17:59	83.34	OK
4765	2026-09-23 18:00	84.17	OK	4766	2026-09-23 18:01	80.53	OK
4767	2026-09-23 18:02	82.42	OK	4768	2026-09-23 18:03	81.98	OK
4769	2026-09-23 18:04	82.86	OK	4770	2026-09-23 18:05	83.64	OK
4771	2026-09-23 18:06	82.89	OK	4772	2026-09-23 18:07	79.40	OK
4773	2026-09-23 18:08	78.61	OK	4774	2026-09-23 18:09	80.71	OK
4775	2026-09-23 18:10	78.15	OK	4776	2026-09-23 18:11	81.42	OK
4777	2026-09-23 18:12	81.36	OK	4778	2026-09-23 18:13	81.43	OK
4779	2026-09-23 18:14	82.25	OK	4780	2026-09-23 18:15	82.39	OK
4781	2026-09-23 18:16	83.60	OK	4782	2026-09-23 18:17	80.00	OK
4783	2026-09-23 18:18	84.16	OK	4784	2026-09-23 18:19	85.66	OK
4785	2026-09-23 18:20	82.29	OK	4786	2026-09-23 18:21	78.73	OK
4787	2026-09-23 18:22	82.14	OK	4788	2026-09-23 18:23	80.14	OK
4789	2026-09-23 18:24	80.36	OK	4790	2026-09-23 18:25	78.97	OK
4791	2026-09-23 18:26	81.27	OK	4792	2026-09-23 18:27	80.66	OK
4793	2026-09-23 18:28	82.54	OK	4794	2026-09-23 18:29	80.82	OK
4795	2026-09-23 18:30	82.72	OK	4796	2026-09-23 18:31	82.18	OK
4797	2026-09-23 18:32	82.30	OK	4798	2026-09-23 18:33	77.98	OK
4799	2026-09-23 18:34	85.56	OK	4800	2026-09-23 18:35	81.51	OK
4801	2026-09-23 18:36	83.21	OK	4802	2026-09-23 18:37	82.81	OK
4803	2026-09-23 18:38	82.71	OK	4804	2026-09-23 18:39	81.85	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4805	2026-09-23 18:40	82.08	OK	4806	2026-09-23 18:41	83.07	OK
4807	2026-09-23 18:42	79.96	OK	4808	2026-09-23 18:43	80.33	OK
4809	2026-09-23 18:44	80.16	OK	4810	2026-09-23 18:45	79.43	OK
4811	2026-09-23 18:46	79.57	OK	4812	2026-09-23 18:47	81.55	OK
4813	2026-09-23 18:48	83.18	OK	4814	2026-09-23 18:49	81.78	OK
4815	2026-09-23 18:50	81.53	OK	4816	2026-09-23 18:51	82.81	OK
4817	2026-09-23 18:52	84.27	OK	4818	2026-09-23 18:53	80.90	OK
4819	2026-09-23 18:54	82.54	OK	4820	2026-09-23 18:55	86.08	OK
4821	2026-09-23 18:56	81.77	OK	4822	2026-09-23 18:57	81.80	OK
4823	2026-09-23 18:58	81.24	OK	4824	2026-09-23 18:59	78.96	OK
4825	2026-09-23 19:00	83.36	OK	4826	2026-09-23 19:01	81.29	OK
4827	2026-09-23 19:02	83.83	OK	4828	2026-09-23 19:03	85.97	OK
4829	2026-09-23 19:04	83.27	OK	4830	2026-09-23 19:05	85.25	OK
4831	2026-09-23 19:06	82.45	OK	4832	2026-09-23 19:07	82.31	OK
4833	2026-09-23 19:08	84.08	OK	4834	2026-09-23 19:09	83.40	OK
4835	2026-09-23 19:10	82.66	OK	4836	2026-09-23 19:11	82.00	OK
4837	2026-09-23 19:12	82.16	OK	4838	2026-09-23 19:13	80.29	OK
4839	2026-09-23 19:14	80.65	OK	4840	2026-09-23 19:15	80.66	OK
4841	2026-09-23 19:16	81.31	OK	4842	2026-09-23 19:17	81.79	OK
4843	2026-09-23 19:18	82.17	OK	4844	2026-09-23 19:19	80.81	OK
4845	2026-09-23 19:20	81.82	OK	4846	2026-09-23 19:21	81.85	OK
4847	2026-09-23 19:22	81.02	OK	4848	2026-09-23 19:23	79.86	OK
4849	2026-09-23 19:24	81.80	OK	4850	2026-09-23 19:25	81.13	OK
4851	2026-09-23 19:26	85.14	OK	4852	2026-09-23 19:27	81.63	OK
4853	2026-09-23 19:28	79.77	OK	4854	2026-09-23 19:29	82.36	OK
4855	2026-09-23 19:30	82.94	OK	4856	2026-09-23 19:31	85.51	OK
4857	2026-09-23 19:32	82.70	OK	4858	2026-09-23 19:33	82.26	OK
4859	2026-09-23 19:34	78.84	OK	4860	2026-09-23 19:35	82.90	OK
4861	2026-09-23 19:36	80.70	OK	4862	2026-09-23 19:37	80.09	OK
4863	2026-09-23 19:38	84.24	OK	4864	2026-09-23 19:39	83.11	OK
4865	2026-09-23 19:40	78.82	OK	4866	2026-09-23 19:41	81.97	OK
4867	2026-09-23 19:42	85.56	OK	4868	2026-09-23 19:43	83.09	OK
4869	2026-09-23 19:44	83.24	OK	4870	2026-09-23 19:45	78.81	OK
4871	2026-09-23 19:46	81.85	OK	4872	2026-09-23 19:47	82.60	OK
4873	2026-09-23 19:48	80.58	OK	4874	2026-09-23 19:49	83.30	OK
4875	2026-09-23 19:50	84.30	OK	4876	2026-09-23 19:51	78.33	OK
4877	2026-09-23 19:52	82.15	OK	4878	2026-09-23 19:53	80.24	OK
4879	2026-09-23 19:54	81.36	OK	4880	2026-09-23 19:55	81.84	OK
4881	2026-09-23 19:56	82.93	OK	4882	2026-09-23 19:57	81.53	OK
4883	2026-09-23 19:58	77.38	OK	4884	2026-09-23 19:59	81.54	OK
4885	2026-09-23 20:00	83.11	OK	4886	2026-09-23 20:01	80.97	OK
4887	2026-09-23 20:02	82.15	OK	4888	2026-09-23 20:03	82.32	OK
4889	2026-09-23 20:04	81.92	OK	4890	2026-09-23 20:05	80.93	OK
4891	2026-09-23 20:06	80.30	OK	4892	2026-09-23 20:07	79.33	OK
4893	2026-09-23 20:08	83.47	OK	4894	2026-09-23 20:09	81.42	OK
4895	2026-09-23 20:10	82.00	OK	4896	2026-09-23 20:11	82.30	OK
4897	2026-09-23 20:12	79.98	OK	4898	2026-09-23 20:13	79.29	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4899	2026-09-23 20:14	77.94	OK	4900	2026-09-23 20:15	82.96	OK
4901	2026-09-23 20:16	82.51	OK	4902	2026-09-23 20:17	81.40	OK
4903	2026-09-23 20:18	79.99	OK	4904	2026-09-23 20:19	79.33	OK
4905	2026-09-23 20:20	83.97	OK	4906	2026-09-23 20:21	82.58	OK
4907	2026-09-23 20:22	80.15	OK	4908	2026-09-23 20:23	80.55	OK
4909	2026-09-23 20:24	81.14	OK	4910	2026-09-23 20:25	80.61	OK
4911	2026-09-23 20:26	79.98	OK	4912	2026-09-23 20:27	78.02	OK
4913	2026-09-23 20:28	78.23	OK	4914	2026-09-23 20:29	81.95	OK
4915	2026-09-23 20:30	76.50	OK	4916	2026-09-23 20:31	84.01	OK
4917	2026-09-23 20:32	83.92	OK	4918	2026-09-23 20:33	79.01	OK
4919	2026-09-23 20:34	79.71	OK	4920	2026-09-23 20:35	79.39	OK
4921	2026-09-23 20:36	83.32	OK	4922	2026-09-23 20:37	78.04	OK
4923	2026-09-23 20:38	79.78	OK	4924	2026-09-23 20:39	80.04	OK
4925	2026-09-23 20:40	81.10	OK	4926	2026-09-23 20:41	78.13	OK
4927	2026-09-23 20:42	81.66	OK	4928	2026-09-23 20:43	80.64	OK
4929	2026-09-23 20:44	79.43	OK	4930	2026-09-23 20:45	81.02	OK
4931	2026-09-23 20:46	80.54	OK	4932	2026-09-23 20:47	82.44	OK
4933	2026-09-23 20:48	83.35	OK	4934	2026-09-23 20:49	82.31	OK
4935	2026-09-23 20:50	83.50	OK	4936	2026-09-23 20:51	80.44	OK
4937	2026-09-23 20:52	78.27	OK	4938	2026-09-23 20:53	82.67	OK
4939	2026-09-23 20:54	76.51	OK	4940	2026-09-23 20:55	82.28	OK
4941	2026-09-23 20:56	80.70	OK	4942	2026-09-23 20:57	79.61	OK
4943	2026-09-23 20:58	79.00	OK	4944	2026-09-23 20:59	82.79	OK
4945	2026-09-23 21:00	76.99	OK	4946	2026-09-23 21:01	75.85	OK
4947	2026-09-23 21:02	78.92	OK	4948	2026-09-23 21:03	82.71	OK
4949	2026-09-23 21:04	79.79	OK	4950	2026-09-23 21:05	78.02	OK
4951	2026-09-23 21:06	78.17	OK	4952	2026-09-23 21:07	79.50	OK
4953	2026-09-23 21:08	81.28	OK	4954	2026-09-23 21:09	81.02	OK
4955	2026-09-23 21:10	76.80	OK	4956	2026-09-23 21:11	83.75	OK
4957	2026-09-23 21:12	83.91	OK	4958	2026-09-23 21:13	79.49	OK
4959	2026-09-23 21:14	76.40	OK	4960	2026-09-23 21:15	79.13	OK
4961	2026-09-23 21:16	80.70	OK	4962	2026-09-23 21:17	81.90	OK
4963	2026-09-23 21:18	81.77	OK	4964	2026-09-23 21:19	76.91	OK
4965	2026-09-23 21:20	77.66	OK	4966	2026-09-23 21:21	82.02	OK
4967	2026-09-23 21:22	80.66	OK	4968	2026-09-23 21:23	80.27	OK
4969	2026-09-23 21:24	77.48	OK	4970	2026-09-23 21:25	78.16	OK
4971	2026-09-23 21:26	81.22	OK	4972	2026-09-23 21:27	79.74	OK
4973	2026-09-23 21:28	81.44	OK	4974	2026-09-23 21:29	79.30	OK
4975	2026-09-23 21:30	81.08	OK	4976	2026-09-23 21:31	77.19	OK
4977	2026-09-23 21:32	82.93	OK	4978	2026-09-23 21:33	81.56	OK
4979	2026-09-23 21:34	82.09	OK	4980	2026-09-23 21:35	77.99	OK
4981	2026-09-23 21:36	78.80	OK	4982	2026-09-23 21:37	79.49	OK
4983	2026-09-23 21:38	79.60	OK	4984	2026-09-23 21:39	81.97	OK
4985	2026-09-23 21:40	78.40	OK	4986	2026-09-23 21:41	81.47	OK
4987	2026-09-23 21:42	79.66	OK	4988	2026-09-23 21:43	79.83	OK
4989	2026-09-23 21:44	80.65	OK	4990	2026-09-23 21:45	79.44	OK
4991	2026-09-23 21:46	78.08	OK	4992	2026-09-23 21:47	78.51	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4993	2026-09-23 21:48	82.13	OK	4994	2026-09-23 21:49	76.67	OK
4995	2026-09-23 21:50	76.45	OK	4996	2026-09-23 21:51	81.28	OK
4997	2026-09-23 21:52	78.72	OK	4998	2026-09-23 21:53	79.75	OK
4999	2026-09-23 21:54	78.26	OK	5000	2026-09-23 21:55	75.70	OK
5001	2026-09-23 21:56	82.90	OK	5002	2026-09-23 21:57	79.03	OK
5003	2026-09-23 21:58	79.23	OK	5004	2026-09-23 21:59	78.14	OK
5005	2026-09-23 22:00	78.12	OK	5006	2026-09-23 22:01	81.02	OK
5007	2026-09-23 22:02	76.41	OK	5008	2026-09-23 22:03	81.43	OK
5009	2026-09-23 22:04	79.68	OK	5010	2026-09-23 22:05	77.79	OK
5011	2026-09-23 22:06	79.91	OK	5012	2026-09-23 22:07	79.70	OK
5013	2026-09-23 22:08	79.26	OK	5014	2026-09-23 22:09	77.09	OK
5015	2026-09-23 22:10	80.14	OK	5016	2026-09-23 22:11	78.02	OK
5017	2026-09-23 22:12	74.72	OK	5018	2026-09-23 22:13	80.28	OK
5019	2026-09-23 22:14	76.83	OK	5020	2026-09-23 22:15	77.22	OK
5021	2026-09-23 22:16	79.97	OK	5022	2026-09-23 22:17	77.83	OK
5023	2026-09-23 22:18	77.46	OK	5024	2026-09-23 22:19	78.71	OK
5025	2026-09-23 22:20	79.93	OK	5026	2026-09-23 22:21	79.84	OK
5027	2026-09-23 22:22	78.46	OK	5028	2026-09-23 22:23	79.93	OK
5029	2026-09-23 22:24	80.18	OK	5030	2026-09-23 22:25	76.04	OK
5031	2026-09-23 22:26	79.85	OK	5032	2026-09-23 22:27	80.14	OK
5033	2026-09-23 22:28	79.88	OK	5034	2026-09-23 22:29	80.49	OK
5035	2026-09-23 22:30	75.49	OK	5036	2026-09-23 22:31	78.36	OK
5037	2026-09-23 22:32	79.68	OK	5038	2026-09-23 22:33	76.79	OK
5039	2026-09-23 22:34	80.22	OK	5040	2026-09-23 22:35	78.36	OK
5041	2026-09-23 22:36	77.78	OK	5042	2026-09-23 22:37	81.24	OK
5043	2026-09-23 22:38	77.70	OK	5044	2026-09-23 22:39	75.85	OK
5045	2026-09-23 22:40	80.34	OK	5046	2026-09-23 22:41	81.67	OK
5047	2026-09-23 22:42	79.65	OK	5048	2026-09-23 22:43	80.45	OK
5049	2026-09-23 22:44	80.89	OK	5050	2026-09-23 22:45	77.99	OK
5051	2026-09-23 22:46	77.23	OK	5052	2026-09-23 22:47	76.38	OK
5053	2026-09-23 22:48	76.78	OK	5054	2026-09-23 22:49	79.97	OK
5055	2026-09-23 22:50	79.77	OK	5056	2026-09-23 22:51	75.63	OK
5057	2026-09-23 22:52	78.54	OK	5058	2026-09-23 22:53	77.05	OK
5059	2026-09-23 22:54	75.72	OK	5060	2026-09-23 22:55	77.44	OK
5061	2026-09-23 22:56	78.40	OK	5062	2026-09-23 22:57	76.89	OK
5063	2026-09-23 22:58	77.74	OK	5064	2026-09-23 22:59	76.36	OK
5065	2026-09-23 23:00	78.02	OK	5066	2026-09-23 23:01	79.74	OK
5067	2026-09-23 23:02	81.20	OK	5068	2026-09-23 23:03	74.84	OK
5069	2026-09-23 23:04	79.38	OK	5070	2026-09-23 23:05	75.51	OK
5071	2026-09-23 23:06	78.55	OK	5072	2026-09-23 23:07	72.68	OK
5073	2026-09-23 23:08	77.74	OK	5074	2026-09-23 23:09	75.94	OK
5075	2026-09-23 23:10	79.39	OK	5076	2026-09-23 23:11	79.57	OK
5077	2026-09-23 23:12	73.65	OK	5078	2026-09-23 23:13	75.20	OK
5079	2026-09-23 23:14	79.03	OK	5080	2026-09-23 23:15	78.53	OK
5081	2026-09-23 23:16	76.99	OK	5082	2026-09-23 23:17	78.93	OK
5083	2026-09-23 23:18	75.68	OK	5084	2026-09-23 23:19	75.91	OK
5085	2026-09-23 23:20	77.66	OK	5086	2026-09-23 23:21	78.89	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5087	2026-09-23 23:22	78.37	OK	5088	2026-09-23 23:23	78.33	OK
5089	2026-09-23 23:24	75.41	OK	5090	2026-09-23 23:25	75.72	OK
5091	2026-09-23 23:26	76.23	OK	5092	2026-09-23 23:27	78.88	OK
5093	2026-09-23 23:28	76.52	OK	5094	2026-09-23 23:29	75.63	OK
5095	2026-09-23 23:30	76.24	OK	5096	2026-09-23 23:31	73.06	OK
5097	2026-09-23 23:32	75.48	OK	5098	2026-09-23 23:33	79.50	OK
5099	2026-09-23 23:34	76.81	OK	5100	2026-09-23 23:35	77.47	OK
5101	2026-09-23 23:36	77.52	OK	5102	2026-09-23 23:37	73.76	OK
5103	2026-09-23 23:38	76.35	OK	5104	2026-09-23 23:39	74.50	OK
5105	2026-09-23 23:40	79.06	OK	5106	2026-09-23 23:41	76.33	OK
5107	2026-09-23 23:42	75.03	OK	5108	2026-09-23 23:43	76.20	OK
5109	2026-09-23 23:44	77.95	OK	5110	2026-09-23 23:45	77.22	OK
5111	2026-09-23 23:46	77.48	OK	5112	2026-09-23 23:47	73.34	OK
5113	2026-09-23 23:48	73.96	OK	5114	2026-09-23 23:49	80.33	OK
5115	2026-09-23 23:50	74.23	OK	5116	2026-09-23 23:51	77.25	OK
5117	2026-09-23 23:52	74.61	OK	5118	2026-09-23 23:53	75.20	OK
5119	2026-09-23 23:54	76.46	OK	5120	2026-09-23 23:55	75.71	OK
5121	2026-09-23 23:56	76.51	OK	5122	2026-09-23 23:57	74.35	OK
5123	2026-09-23 23:58	75.85	OK	5124	2026-09-23 23:59	74.35	OK
5125	2026-09-24 00:00	73.91	OK	5126	2026-09-24 00:01	76.16	OK
5127	2026-09-24 00:02	74.19	OK	5128	2026-09-24 00:03	74.44	OK
5129	2026-09-24 00:04	74.84	OK	5130	2026-09-24 00:05	76.89	OK
5131	2026-09-24 00:06	74.17	OK	5132	2026-09-24 00:07	72.20	OK
5133	2026-09-24 00:08	74.63	OK	5134	2026-09-24 00:09	73.67	OK
5135	2026-09-24 00:10	73.30	OK	5136	2026-09-24 00:11	79.23	OK
5137	2026-09-24 00:12	76.66	OK	5138	2026-09-24 00:13	74.19	OK
5139	2026-09-24 00:14	77.29	OK	5140	2026-09-24 00:15	75.10	OK
5141	2026-09-24 00:16	73.43	OK	5142	2026-09-24 00:17	73.56	OK
5143	2026-09-24 00:18	74.74	OK	5144	2026-09-24 00:19	73.60	OK
5145	2026-09-24 00:20	77.19	OK	5146	2026-09-24 00:21	77.58	OK
5147	2026-09-24 00:22	79.62	OK	5148	2026-09-24 00:23	72.70	OK
5149	2026-09-24 00:24	70.92	OK	5150	2026-09-24 00:25	74.08	OK
5151	2026-09-24 00:26	77.19	OK	5152	2026-09-24 00:27	76.64	OK
5153	2026-09-24 00:28	72.01	OK	5154	2026-09-24 00:29	74.81	OK
5155	2026-09-24 00:30	70.66	OK	5156	2026-09-24 00:31	73.16	OK
5157	2026-09-24 00:32	74.98	OK	5158	2026-09-24 00:33	73.95	OK
5159	2026-09-24 00:34	74.54	OK	5160	2026-09-24 00:35	75.01	OK
5161	2026-09-24 00:36	76.72	OK	5162	2026-09-24 00:37	73.39	OK
5163	2026-09-24 00:38	76.52	OK	5164	2026-09-24 00:39	77.28	OK
5165	2026-09-24 00:40	73.00	OK	5166	2026-09-24 00:41	76.75	OK
5167	2026-09-24 00:42	75.72	OK	5168	2026-09-24 00:43	74.11	OK
5169	2026-09-24 00:44	76.72	OK	5170	2026-09-24 00:45	71.09	OK
5171	2026-09-24 00:46	74.71	OK	5172	2026-09-24 00:47	74.80	OK
5173	2026-09-24 00:48	73.68	OK	5174	2026-09-24 00:49	72.10	OK
5175	2026-09-24 00:50	75.08	OK	5176	2026-09-24 00:51	75.87	OK
5177	2026-09-24 00:52	74.79	OK	5178	2026-09-24 00:53	73.82	OK
5179	2026-09-24 00:54	76.58	OK	5180	2026-09-24 00:55	73.00	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5181	2026-09-24 00:56	76.14	OK	5182	2026-09-24 00:57	73.55	OK
5183	2026-09-24 00:58	71.73	OK	5184	2026-09-24 00:59	73.24	OK
5185	2026-09-24 01:00	72.42	OK	5186	2026-09-24 01:01	74.53	OK
5187	2026-09-24 01:02	73.05	OK	5188	2026-09-24 01:03	75.42	OK
5189	2026-09-24 01:04	72.78	OK	5190	2026-09-24 01:05	73.18	OK
5191	2026-09-24 01:06	73.01	OK	5192	2026-09-24 01:07	69.81	OK
5193	2026-09-24 01:08	72.93	OK	5194	2026-09-24 01:09	74.96	OK
5195	2026-09-24 01:10	72.50	OK	5196	2026-09-24 01:11	71.66	OK
5197	2026-09-24 01:12	74.40	OK	5198	2026-09-24 01:13	71.48	OK
5199	2026-09-24 01:14	74.23	OK	5200	2026-09-24 01:15	70.89	OK
5201	2026-09-24 01:16	71.59	OK	5202	2026-09-24 01:17	75.34	OK
5203	2026-09-24 01:18	70.66	OK	5204	2026-09-24 01:19	74.31	OK
5205	2026-09-24 01:20	69.95	OK	5206	2026-09-24 01:21	72.12	OK
5207	2026-09-24 01:22	71.53	OK	5208	2026-09-24 01:23	69.87	OK
5209	2026-09-24 01:24	69.80	OK	5210	2026-09-24 01:25	74.91	OK
5211	2026-09-24 01:26	72.02	OK	5212	2026-09-24 01:27	76.51	OK
5213	2026-09-24 01:28	74.95	OK	5214	2026-09-24 01:29	74.70	OK
5215	2026-09-24 01:30	72.70	OK	5216	2026-09-24 01:31	71.94	OK
5217	2026-09-24 01:32	71.13	OK	5218	2026-09-24 01:33	72.64	OK
5219	2026-09-24 01:34	73.92	OK	5220	2026-09-24 01:35	73.70	OK
5221	2026-09-24 01:36	73.22	OK	5222	2026-09-24 01:37	72.79	OK
5223	2026-09-24 01:38	73.14	OK	5224	2026-09-24 01:39	68.81	OK
5225	2026-09-24 01:40	71.42	OK	5226	2026-09-24 01:41	71.90	OK
5227	2026-09-24 01:42	74.16	OK	5228	2026-09-24 01:43	73.53	OK
5229	2026-09-24 01:44	73.11	OK	5230	2026-09-24 01:45	72.25	OK
5231	2026-09-24 01:46	70.92	OK	5232	2026-09-24 01:47	73.64	OK
5233	2026-09-24 01:48	70.38	OK	5234	2026-09-24 01:49	74.29	OK
5235	2026-09-24 01:50	74.69	OK	5236	2026-09-24 01:51	70.41	OK
5237	2026-09-24 01:52	69.43	OK	5238	2026-09-24 01:53	70.24	OK
5239	2026-09-24 01:54	73.23	OK	5240	2026-09-24 01:55	72.69	OK
5241	2026-09-24 01:56	76.26	OK	5242	2026-09-24 01:57	72.27	OK
5243	2026-09-24 01:58	73.89	OK	5244	2026-09-24 01:59	72.51	OK
5245	2026-09-24 02:00	73.73	OK	5246	2026-09-24 02:01	70.59	OK
5247	2026-09-24 02:02	69.44	OK	5248	2026-09-24 02:03	72.09	OK
5249	2026-09-24 02:04	71.72	OK	5250	2026-09-24 02:05	71.87	OK
5251	2026-09-24 02:06	75.45	OK	5252	2026-09-24 02:07	68.58	OK
5253	2026-09-24 02:08	67.71	OK	5254	2026-09-24 02:09	72.79	OK
5255	2026-09-24 02:10	71.38	OK	5256	2026-09-24 02:11	72.10	OK
5257	2026-09-24 02:12	70.17	OK	5258	2026-09-24 02:13	71.60	OK
5259	2026-09-24 02:14	71.21	OK	5260	2026-09-24 02:15	69.66	OK
5261	2026-09-24 02:16	72.55	OK	5262	2026-09-24 02:17	69.27	OK
5263	2026-09-24 02:18	69.47	OK	5264	2026-09-24 02:19	75.87	OK
5265	2026-09-24 02:20	71.67	OK	5266	2026-09-24 02:21	72.05	OK
5267	2026-09-24 02:22	71.85	OK	5268	2026-09-24 02:23	72.93	OK
5269	2026-09-24 02:24	70.93	OK	5270	2026-09-24 02:25	72.16	OK
5271	2026-09-24 02:26	72.23	OK	5272	2026-09-24 02:27	71.92	OK
5273	2026-09-24 02:28	70.19	OK	5274	2026-09-24 02:29	72.38	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5275	2026-09-24 02:30	71.77	OK	5276	2026-09-24 02:31	70.41	OK
5277	2026-09-24 02:32	68.01	OK	5278	2026-09-24 02:33	69.29	OK
5279	2026-09-24 02:34	70.06	OK	5280	2026-09-24 02:35	73.08	OK
5281	2026-09-24 02:36	74.07	OK	5282	2026-09-24 02:37	72.07	OK
5283	2026-09-24 02:38	67.41	OK	5284	2026-09-24 02:39	75.51	OK
5285	2026-09-24 02:40	73.31	OK	5286	2026-09-24 02:41	71.89	OK
5287	2026-09-24 02:42	71.73	OK	5288	2026-09-24 02:43	69.14	OK
5289	2026-09-24 02:44	71.55	OK	5290	2026-09-24 02:45	70.94	OK
5291	2026-09-24 02:46	70.33	OK	5292	2026-09-24 02:47	69.46	OK
5293	2026-09-24 02:48	68.51	OK	5294	2026-09-24 02:49	68.25	OK
5295	2026-09-24 02:50	72.07	OK	5296	2026-09-24 02:51	73.73	OK
5297	2026-09-24 02:52	70.92	OK	5298	2026-09-24 02:53	69.90	OK
5299	2026-09-24 02:54	70.18	OK	5300	2026-09-24 02:55	73.66	OK
5301	2026-09-24 02:56	67.58	OK	5302	2026-09-24 02:57	73.10	OK
5303	2026-09-24 02:58	68.36	OK	5304	2026-09-24 02:59	70.89	OK
5305	2026-09-24 03:00	69.39	OK	5306	2026-09-24 03:01	69.61	OK
5307	2026-09-24 03:02	72.35	OK	5308	2026-09-24 03:03	68.53	OK
5309	2026-09-24 03:04	72.06	OK	5310	2026-09-24 03:05	69.52	OK
5311	2026-09-24 03:06	70.14	OK	5312	2026-09-24 03:07	70.06	OK
5313	2026-09-24 03:08	67.71	OK	5314	2026-09-24 03:09	69.51	OK
5315	2026-09-24 03:10	71.78	OK	5316	2026-09-24 03:11	68.67	OK
5317	2026-09-24 03:12	70.09	OK	5318	2026-09-24 03:13	69.02	OK
5319	2026-09-24 03:14	69.89	OK	5320	2026-09-24 03:15	67.39	OK
5321	2026-09-24 03:16	69.54	OK	5322	2026-09-24 03:17	71.92	OK
5323	2026-09-24 03:18	69.93	OK	5324	2026-09-24 03:19	72.76	OK
5325	2026-09-24 03:20	71.05	OK	5326	2026-09-24 03:21	69.40	OK
5327	2026-09-24 03:22	71.90	OK	5328	2026-09-24 03:23	67.82	OK
5329	2026-09-24 03:24	68.62	OK	5330	2026-09-24 03:25	72.70	OK
5331	2026-09-24 03:26	71.47	OK	5332	2026-09-24 03:27	71.19	OK
5333	2026-09-24 03:28	67.32	OK	5334	2026-09-24 03:29	70.45	OK
5335	2026-09-24 03:30	70.03	OK	5336	2026-09-24 03:31	69.90	OK
5337	2026-09-24 03:32	71.43	OK	5338	2026-09-24 03:33	70.68	OK
5339	2026-09-24 03:34	70.65	OK	5340	2026-09-24 03:35	68.10	OK
5341	2026-09-24 03:36	73.07	OK	5342	2026-09-24 03:37	69.29	OK
5343	2026-09-24 03:38	70.83	OK	5344	2026-09-24 03:39	71.73	OK
5345	2026-09-24 03:40	69.42	OK	5346	2026-09-24 03:41	71.38	OK
5347	2026-09-24 03:42	70.62	OK	5348	2026-09-24 03:43	70.38	OK
5349	2026-09-24 03:44	66.84	OK	5350	2026-09-24 03:45	71.09	OK
5351	2026-09-24 03:46	70.44	OK	5352	2026-09-24 03:47	70.72	OK
5353	2026-09-24 03:48	71.20	OK	5354	2026-09-24 03:49	70.47	OK
5355	2026-09-24 03:50	68.57	OK	5356	2026-09-24 03:51	67.65	OK
5357	2026-09-24 03:52	68.13	OK	5358	2026-09-24 03:53	70.07	OK
5359	2026-09-24 03:54	68.31	OK	5360	2026-09-24 03:55	66.59	OK
5361	2026-09-24 03:56	68.35	OK	5362	2026-09-24 03:57	69.30	OK
5363	2026-09-24 03:58	68.54	OK	5364	2026-09-24 03:59	68.64	OK
5365	2026-09-24 04:00	71.99	OK	5366	2026-09-24 04:01	71.45	OK
5367	2026-09-24 04:02	69.61	OK	5368	2026-09-24 04:03	68.22	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5369	2026-09-24 04:04	68.85	OK	5370	2026-09-24 04:05	67.60	OK
5371	2026-09-24 04:06	66.55	OK	5372	2026-09-24 04:07	67.24	OK
5373	2026-09-24 04:08	68.68	OK	5374	2026-09-24 04:09	68.31	OK
5375	2026-09-24 04:10	69.42	OK	5376	2026-09-24 04:11	68.83	OK
5377	2026-09-24 04:12	69.71	OK	5378	2026-09-24 04:13	70.09	OK
5379	2026-09-24 04:14	67.97	OK	5380	2026-09-24 04:15	70.01	OK
5381	2026-09-24 04:16	71.43	OK	5382	2026-09-24 04:17	69.36	OK
5383	2026-09-24 04:18	65.91	OK	5384	2026-09-24 04:19	65.91	OK
5385	2026-09-24 04:20	66.69	OK	5386	2026-09-24 04:21	67.05	OK
5387	2026-09-24 04:22	70.44	OK	5388	2026-09-24 04:23	68.58	OK
5389	2026-09-24 04:24	66.48	OK	5390	2026-09-24 04:25	69.05	OK
5391	2026-09-24 04:26	71.85	OK	5392	2026-09-24 04:27	65.04	OK
5393	2026-09-24 04:28	70.54	OK	5394	2026-09-24 04:29	71.44	OK
5395	2026-09-24 04:30	71.10	OK	5396	2026-09-24 04:31	68.90	OK
5397	2026-09-24 04:32	69.64	OK	5398	2026-09-24 04:33	68.84	OK
5399	2026-09-24 04:34	70.48	OK	5400	2026-09-24 04:35	66.89	OK
5401	2026-09-24 04:36	68.72	OK	5402	2026-09-24 04:37	70.83	OK
5403	2026-09-24 04:38	67.40	OK	5404	2026-09-24 04:39	67.37	OK
5405	2026-09-24 04:40	65.23	OK	5406	2026-09-24 04:41	67.03	OK
5407	2026-09-24 04:42	67.21	OK	5408	2026-09-24 04:43	65.68	OK
5409	2026-09-24 04:44	66.36	OK	5410	2026-09-24 04:45	65.41	OK
5411	2026-09-24 04:46	70.25	OK	5412	2026-09-24 04:47	68.86	OK
5413	2026-09-24 04:48	68.48	OK	5414	2026-09-24 04:49	68.15	OK
5415	2026-09-24 04:50	67.49	OK	5416	2026-09-24 04:51	67.57	OK
5417	2026-09-24 04:52	68.17	OK	5418	2026-09-24 04:53	65.59	OK
5419	2026-09-24 04:54	67.35	OK	5420	2026-09-24 04:55	70.04	OK
5421	2026-09-24 04:56	69.77	OK	5422	2026-09-24 04:57	65.16	OK
5423	2026-09-24 04:58	68.57	OK	5424	2026-09-24 04:59	66.63	OK
5425	2026-09-24 05:00	68.48	OK	5426	2026-09-24 05:01	67.90	OK
5427	2026-09-24 05:02	69.05	OK	5428	2026-09-24 05:03	66.66	OK
5429	2026-09-24 05:04	68.14	OK	5430	2026-09-24 05:05	69.98	OK
5431	2026-09-24 05:06	68.55	OK	5432	2026-09-24 05:07	69.56	OK
5433	2026-09-24 05:08	69.30	OK	5434	2026-09-24 05:09	69.73	OK
5435	2026-09-24 05:10	67.87	OK	5436	2026-09-24 05:11	68.14	OK
5437	2026-09-24 05:12	69.36	OK	5438	2026-09-24 05:13	68.07	OK
5439	2026-09-24 05:14	66.06	OK	5440	2026-09-24 05:15	68.12	OK
5441	2026-09-24 05:16	65.79	OK	5442	2026-09-24 05:17	67.50	OK
5443	2026-09-24 05:18	69.49	OK	5444	2026-09-24 05:19	69.56	OK
5445	2026-09-24 05:20	67.86	OK	5446	2026-09-24 05:21	67.86	OK
5447	2026-09-24 05:22	65.79	OK	5448	2026-09-24 05:23	66.74	OK
5449	2026-09-24 05:24	69.34	OK	5450	2026-09-24 05:25	67.64	OK
5451	2026-09-24 05:26	69.40	OK	5452	2026-09-24 05:27	66.01	OK
5453	2026-09-24 05:28	64.19	OK	5454	2026-09-24 05:29	66.99	OK
5455	2026-09-24 05:30	68.98	OK	5456	2026-09-24 05:31	67.67	OK
5457	2026-09-24 05:32	67.91	OK	5458	2026-09-24 05:33	66.38	OK
5459	2026-09-24 05:34	69.08	OK	5460	2026-09-24 05:35	71.35	OK
5461	2026-09-24 05:36	64.44	OK	5462	2026-09-24 05:37	66.55	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5463	2026-09-24 05:38	71.06	OK	5464	2026-09-24 05:39	68.96	OK
5465	2026-09-24 05:40	69.87	OK	5466	2026-09-24 05:41	67.17	OK
5467	2026-09-24 05:42	68.41	OK	5468	2026-09-24 05:43	68.47	OK
5469	2026-09-24 05:44	68.72	OK	5470	2026-09-24 05:45	67.04	OK
5471	2026-09-24 05:46	68.51	OK	5472	2026-09-24 05:47	64.38	OK
5473	2026-09-24 05:48	68.56	OK	5474	2026-09-24 05:49	67.99	OK
5475	2026-09-24 05:50	66.13	OK	5476	2026-09-24 05:51	66.82	OK
5477	2026-09-24 05:52	68.73	OK	5478	2026-09-24 05:53	65.33	OK
5479	2026-09-24 05:54	67.62	OK	5480	2026-09-24 05:55	70.99	OK
5481	2026-09-24 05:56	68.50	OK	5482	2026-09-24 05:57	68.43	OK
5483	2026-09-24 05:58	68.54	OK	5484	2026-09-24 05:59	68.67	OK
5485	2026-09-24 06:00	69.31	OK	5486	2026-09-24 06:01	66.47	OK
5487	2026-09-24 06:02	68.81	OK	5488	2026-09-24 06:03	65.26	OK
5489	2026-09-24 06:04	69.78	OK	5490	2026-09-24 06:05	66.94	OK
5491	2026-09-24 06:06	68.48	OK	5492	2026-09-24 06:07	68.19	OK
5493	2026-09-24 06:08	69.71	OK	5494	2026-09-24 06:09	68.59	OK
5495	2026-09-24 06:10	68.42	OK	5496	2026-09-24 06:11	69.33	OK
5497	2026-09-24 06:12	69.61	OK	5498	2026-09-24 06:13	68.95	OK
5499	2026-09-24 06:14	67.68	OK	5500	2026-09-24 06:15	68.92	OK
5501	2026-09-24 06:16	69.76	OK	5502	2026-09-24 06:17	64.87	OK
5503	2026-09-24 06:18	64.02	OK	5504	2026-09-24 06:19	68.22	OK
5505	2026-09-24 06:20	68.82	OK	5506	2026-09-24 06:21	71.69	OK
5507	2026-09-24 06:22	67.56	OK	5508	2026-09-24 06:23	67.45	OK
5509	2026-09-24 06:24	70.37	OK	5510	2026-09-24 06:25	66.17	OK
5511	2026-09-24 06:26	70.59	OK	5512	2026-09-24 06:27	67.05	OK
5513	2026-09-24 06:28	68.21	OK	5514	2026-09-24 06:29	67.62	OK
5515	2026-09-24 06:30	69.08	OK	5516	2026-09-24 06:31	67.08	OK
5517	2026-09-24 06:32	67.74	OK	5518	2026-09-24 06:33	65.85	OK
5519	2026-09-24 06:34	66.82	OK	5520	2026-09-24 06:35	67.21	OK
5521	2026-09-24 06:36	67.47	OK	5522	2026-09-24 06:37	68.51	OK
5523	2026-09-24 06:38	65.53	OK	5524	2026-09-24 06:39	68.75	OK
5525	2026-09-24 06:40	66.09	OK	5526	2026-09-24 06:41	68.73	OK
5527	2026-09-24 06:42	69.50	OK	5528	2026-09-24 06:43	70.19	OK
5529	2026-09-24 06:44	66.13	OK	5530	2026-09-24 06:45	67.45	OK
5531	2026-09-24 06:46	67.28	OK	5532	2026-09-24 06:47	65.86	OK
5533	2026-09-24 06:48	69.16	OK	5534	2026-09-24 06:49	68.31	OK
5535	2026-09-24 06:50	67.15	OK	5536	2026-09-24 06:51	66.84	OK
5537	2026-09-24 06:52	68.66	OK	5538	2026-09-24 06:53	70.32	OK
5539	2026-09-24 06:54	70.60	OK	5540	2026-09-24 06:55	65.58	OK
5541	2026-09-24 06:56	69.30	OK	5542	2026-09-24 06:57	69.75	OK
5543	2026-09-24 06:58	68.53	OK	5544	2026-09-24 06:59	70.91	OK
5545	2026-09-24 07:00	65.62	OK	5546	2026-09-24 07:01	67.18	OK
5547	2026-09-24 07:02	64.93	OK	5548	2026-09-24 07:03	69.92	OK
5549	2026-09-24 07:04	69.78	OK	5550	2026-09-24 07:05	69.00	OK
5551	2026-09-24 07:06	68.25	OK	5552	2026-09-24 07:07	67.87	OK
5553	2026-09-24 07:08	67.93	OK	5554	2026-09-24 07:09	69.60	OK
5555	2026-09-24 07:10	70.96	OK	5556	2026-09-24 07:11	66.65	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5557	2026-09-24 07:12	67.22	OK	5558	2026-09-24 07:13	67.71	OK
5559	2026-09-24 07:14	67.44	OK	5560	2026-09-24 07:15	66.64	OK
5561	2026-09-24 07:16	69.03	OK	5562	2026-09-24 07:17	69.37	OK
5563	2026-09-24 07:18	69.07	OK	5564	2026-09-24 07:19	67.48	OK
5565	2026-09-24 07:20	68.88	OK	5566	2026-09-24 07:21	67.42	OK
5567	2026-09-24 07:22	70.62	OK	5568	2026-09-24 07:23	67.73	OK
5569	2026-09-24 07:24	67.85	OK	5570	2026-09-24 07:25	70.62	OK
5571	2026-09-24 07:26	69.92	OK	5572	2026-09-24 07:27	68.38	OK
5573	2026-09-24 07:28	68.64	OK	5574	2026-09-24 07:29	68.11	OK
5575	2026-09-24 07:30	70.28	OK	5576	2026-09-24 07:31	68.02	OK
5577	2026-09-24 07:32	65.32	OK	5578	2026-09-24 07:33	65.13	OK
5579	2026-09-24 07:34	66.52	OK	5580	2026-09-24 07:35	68.02	OK
5581	2026-09-24 07:36	66.59	OK	5582	2026-09-24 07:37	65.34	OK
5583	2026-09-24 07:38	68.49	OK	5584	2026-09-24 07:39	67.23	OK
5585	2026-09-24 07:40	70.72	OK	5586	2026-09-24 07:41	65.79	OK
5587	2026-09-24 07:42	69.92	OK	5588	2026-09-24 07:43	67.04	OK
5589	2026-09-24 07:44	70.23	OK	5590	2026-09-24 07:45	71.35	OK
5591	2026-09-24 07:46	63.85	OK	5592	2026-09-24 07:47	67.17	OK
5593	2026-09-24 07:48	65.51	OK	5594	2026-09-24 07:49	67.66	OK
5595	2026-09-24 07:50	70.06	OK	5596	2026-09-24 07:51	66.17	OK
5597	2026-09-24 07:52	67.11	OK	5598	2026-09-24 07:53	68.89	OK
5599	2026-09-24 07:54	67.87	OK	5600	2026-09-24 07:55	69.81	OK
5601	2026-09-24 07:56	69.52	OK	5602	2026-09-24 07:57	66.52	OK
5603	2026-09-24 07:58	68.85	OK	5604	2026-09-24 07:59	66.71	OK
5605	2026-09-24 08:00	69.66	OK	5606	2026-09-24 08:01	66.38	OK
5607	2026-09-24 08:02	70.40	OK	5608	2026-09-24 08:03	68.91	OK
5609	2026-09-24 08:04	67.80	OK	5610	2026-09-24 08:05	69.36	OK
5611	2026-09-24 08:06	67.86	OK	5612	2026-09-24 08:07	69.52	OK
5613	2026-09-24 08:08	65.51	OK	5614	2026-09-24 08:09	69.54	OK
5615	2026-09-24 08:10	69.64	OK	5616	2026-09-24 08:11	69.10	OK
5617	2026-09-24 08:12	68.38	OK	5618	2026-09-24 08:13	69.60	OK
5619	2026-09-24 08:14	66.30	OK	5620	2026-09-24 08:15	66.19	OK
5621	2026-09-24 08:16	68.96	OK	5622	2026-09-24 08:17	68.89	OK
5623	2026-09-24 08:18	68.52	OK	5624	2026-09-24 08:19	66.54	OK
5625	2026-09-24 08:20	69.81	OK	5626	2026-09-24 08:21	68.03	OK
5627	2026-09-24 08:22	68.71	OK	5628	2026-09-24 08:23	66.75	OK
5629	2026-09-24 08:24	67.35	OK	5630	2026-09-24 08:25	69.59	OK
5631	2026-09-24 08:26	70.80	OK	5632	2026-09-24 08:27	70.07	OK
5633	2026-09-24 08:28	68.71	OK	5634	2026-09-24 08:29	70.01	OK
5635	2026-09-24 08:30	65.89	OK	5636	2026-09-24 08:31	69.27	OK
5637	2026-09-24 08:32	66.95	OK	5638	2026-09-24 08:33	67.48	OK
5639	2026-09-24 08:34	64.02	OK	5640	2026-09-24 08:35	70.40	OK
5641	2026-09-24 08:36	67.97	OK	5642	2026-09-24 08:37	69.75	OK
5643	2026-09-24 08:38	70.09	OK	5644	2026-09-24 08:39	66.89	OK
5645	2026-09-24 08:40	66.12	OK	5646	2026-09-24 08:41	67.67	OK
5647	2026-09-24 08:42	71.38	OK	5648	2026-09-24 08:43	67.83	OK
5649	2026-09-24 08:44	69.81	OK	5650	2026-09-24 08:45	69.31	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5651	2026-09-24 08:46	68.68	OK	5652	2026-09-24 08:47	70.30	OK
5653	2026-09-24 08:48	66.68	OK	5654	2026-09-24 08:49	65.97	OK
5655	2026-09-24 08:50	67.09	OK	5656	2026-09-24 08:51	67.22	OK
5657	2026-09-24 08:52	69.20	OK	5658	2026-09-24 08:53	67.72	OK
5659	2026-09-24 08:54	69.45	OK	5660	2026-09-24 08:55	70.38	OK
5661	2026-09-24 08:56	66.54	OK	5662	2026-09-24 08:57	68.62	OK
5663	2026-09-24 08:58	70.16	OK	5664	2026-09-24 08:59	69.31	OK
5665	2026-09-24 09:00	71.04	OK	5666	2026-09-24 09:01	67.21	OK
5667	2026-09-24 09:02	70.98	OK	5668	2026-09-24 09:03	68.56	OK
5669	2026-09-24 09:04	67.16	OK	5670	2026-09-24 09:05	72.04	OK
5671	2026-09-24 09:06	69.73	OK	5672	2026-09-24 09:07	67.90	OK
5673	2026-09-24 09:08	72.86	OK	5674	2026-09-24 09:09	66.02	OK
5675	2026-09-24 09:10	66.53	OK	5676	2026-09-24 09:11	69.31	OK
5677	2026-09-24 09:12	70.56	OK	5678	2026-09-24 09:13	67.70	OK
5679	2026-09-24 09:14	70.41	OK	5680	2026-09-24 09:15	66.74	OK
5681	2026-09-24 09:16	70.55	OK	5682	2026-09-24 09:17	68.96	OK
5683	2026-09-24 09:18	67.55	OK	5684	2026-09-24 09:19	67.53	OK
5685	2026-09-24 09:20	70.74	OK	5686	2026-09-24 09:21	70.35	OK
5687	2026-09-24 09:22	72.78	OK	5688	2026-09-24 09:23	68.58	OK
5689	2026-09-24 09:24	69.23	OK	5690	2026-09-24 09:25	71.53	OK
5691	2026-09-24 09:26	71.41	OK	5692	2026-09-24 09:27	71.07	OK
5693	2026-09-24 09:28	70.85	OK	5694	2026-09-24 09:29	68.68	OK
5695	2026-09-24 09:30	70.03	OK	5696	2026-09-24 09:31	69.24	OK
5697	2026-09-24 09:32	69.70	OK	5698	2026-09-24 09:33	65.90	OK
5699	2026-09-24 09:34	71.56	OK	5700	2026-09-24 09:35	68.06	OK
5701	2026-09-24 09:36	70.70	OK	5702	2026-09-24 09:37	71.26	OK
5703	2026-09-24 09:38	70.51	OK	5704	2026-09-24 09:39	69.02	OK
5705	2026-09-24 09:40	70.14	OK	5706	2026-09-24 09:41	70.78	OK
5707	2026-09-24 09:42	69.38	OK	5708	2026-09-24 09:43	70.81	OK
5709	2026-09-24 09:44	70.30	OK	5710	2026-09-24 09:45	71.70	OK
5711	2026-09-24 09:46	68.69	OK	5712	2026-09-24 09:47	70.89	OK
5713	2026-09-24 09:48	70.01	OK	5714	2026-09-24 09:49	70.85	OK
5715	2026-09-24 09:50	67.68	OK	5716	2026-09-24 09:51	70.92	OK
5717	2026-09-24 09:52	69.38	OK	5718	2026-09-24 09:53	73.03	OK
5719	2026-09-24 09:54	71.14	OK	5720	2026-09-24 09:55	69.99	OK
5721	2026-09-24 09:56	70.92	OK	5722	2026-09-24 09:57	69.14	OK
5723	2026-09-24 09:58	69.98	OK	5724	2026-09-24 09:59	68.75	OK
5725	2026-09-24 10:00	72.50	OK	5726	2026-09-24 10:01	67.94	OK
5727	2026-09-24 10:02	70.29	OK	5728	2026-09-24 10:03	71.22	OK
5729	2026-09-24 10:04	70.68	OK	5730	2026-09-24 10:05	70.55	OK
5731	2026-09-24 10:06	71.28	OK	5732	2026-09-24 10:07	70.57	OK
5733	2026-09-24 10:08	73.54	OK	5734	2026-09-24 10:09	71.77	OK
5735	2026-09-24 10:10	68.62	OK	5736	2026-09-24 10:11	70.57	OK
5737	2026-09-24 10:12	72.83	OK	5738	2026-09-24 10:13	68.66	OK
5739	2026-09-24 10:14	71.78	OK	5740	2026-09-24 10:15	70.11	OK
5741	2026-09-24 10:16	71.56	OK	5742	2026-09-24 10:17	70.16	OK
5743	2026-09-24 10:18	68.55	OK	5744	2026-09-24 10:19	69.90	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5745	2026-09-24 10:20	72.73	OK	5746	2026-09-24 10:21	71.72	OK
5747	2026-09-24 10:22	74.76	OK	5748	2026-09-24 10:23	72.83	OK
5749	2026-09-24 10:24	71.00	OK	5750	2026-09-24 10:25	71.44	OK
5751	2026-09-24 10:26	71.37	OK	5752	2026-09-24 10:27	72.14	OK
5753	2026-09-24 10:28	71.66	OK	5754	2026-09-24 10:29	72.11	OK
5755	2026-09-24 10:30	70.70	OK	5756	2026-09-24 10:31	68.84	OK
5757	2026-09-24 10:32	70.93	OK	5758	2026-09-24 10:33	72.39	OK
5759	2026-09-24 10:34	68.62	OK	5760	2026-09-24 10:35	71.09	OK

Signal: Bearing_Temp_DE (°C)

Operating Limits: [10.0 to 95.0] • Observed: Min 41.59, Max 54.98, Mean 48.34

All 5,760 Raw Readings

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1	2026-09-20 10:36	46.90	OK	2	2026-09-20 10:37	47.94	OK
3	2026-09-20 10:38	45.40	OK	4	2026-09-20 10:39	46.98	OK
5	2026-09-20 10:40	46.69	OK	6	2026-09-20 10:41	47.70	OK
7	2026-09-20 10:42	45.91	OK	8	2026-09-20 10:43	47.43	OK
9	2026-09-20 10:44	48.15	OK	10	2026-09-20 10:45	47.21	OK
11	2026-09-20 10:46	47.62	OK	12	2026-09-20 10:47	46.76	OK
13	2026-09-20 10:48	45.98	OK	14	2026-09-20 10:49	47.41	OK
15	2026-09-20 10:50	47.70	OK	16	2026-09-20 10:51	46.42	OK
17	2026-09-20 10:52	47.37	OK	18	2026-09-20 10:53	46.70	OK
19	2026-09-20 10:54	47.56	OK	20	2026-09-20 10:55	47.26	OK
21	2026-09-20 10:56	48.46	OK	22	2026-09-20 10:57	45.71	OK
23	2026-09-20 10:58	47.17	OK	24	2026-09-20 10:59	46.98	OK
25	2026-09-20 11:00	46.23	OK	26	2026-09-20 11:01	46.85	OK
27	2026-09-20 11:02	47.15	OK	28	2026-09-20 11:03	46.34	OK
29	2026-09-20 11:04	47.78	OK	30	2026-09-20 11:05	47.57	OK
31	2026-09-20 11:06	47.71	OK	32	2026-09-20 11:07	47.93	OK
33	2026-09-20 11:08	48.28	OK	34	2026-09-20 11:09	48.29	OK
35	2026-09-20 11:10	47.76	OK	36	2026-09-20 11:11	48.20	OK
37	2026-09-20 11:12	48.48	OK	38	2026-09-20 11:13	47.22	OK
39	2026-09-20 11:14	46.60	OK	40	2026-09-20 11:15	48.34	OK
41	2026-09-20 11:16	48.37	OK	42	2026-09-20 11:17	48.83	OK
43	2026-09-20 11:18	48.23	OK	44	2026-09-20 11:19	49.11	OK
45	2026-09-20 11:20	47.82	OK	46	2026-09-20 11:21	47.47	OK
47	2026-09-20 11:22	48.24	OK	48	2026-09-20 11:23	48.21	OK
49	2026-09-20 11:24	48.98	OK	50	2026-09-20 11:25	48.76	OK
51	2026-09-20 11:26	48.46	OK	52	2026-09-20 11:27	47.95	OK
53	2026-09-20 11:28	48.83	OK	54	2026-09-20 11:29	47.28	OK
55	2026-09-20 11:30	48.59	OK	56	2026-09-20 11:31	47.89	OK
57	2026-09-20 11:32	47.18	OK	58	2026-09-20 11:33	47.19	OK
59	2026-09-20 11:34	47.40	OK	60	2026-09-20 11:35	47.79	OK
61	2026-09-20 11:36	48.31	OK	62	2026-09-20 11:37	48.52	OK
63	2026-09-20 11:38	47.75	OK	64	2026-09-20 11:39	48.10	OK
65	2026-09-20 11:40	47.50	OK	66	2026-09-20 11:41	48.84	OK
67	2026-09-20 11:42	48.55	OK	68	2026-09-20 11:43	49.66	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
69	2026-09-20 11:44	47.68	OK	70	2026-09-20 11:45	48.23	OK
71	2026-09-20 11:46	47.98	OK	72	2026-09-20 11:47	47.69	OK
73	2026-09-20 11:48	48.47	OK	74	2026-09-20 11:49	46.80	OK
75	2026-09-20 11:50	47.67	OK	76	2026-09-20 11:51	47.91	OK
77	2026-09-20 11:52	47.94	OK	78	2026-09-20 11:53	48.40	OK
79	2026-09-20 11:54	48.76	OK	80	2026-09-20 11:55	48.53	OK
81	2026-09-20 11:56	48.29	OK	82	2026-09-20 11:57	48.76	OK
83	2026-09-20 11:58	49.23	OK	84	2026-09-20 11:59	49.24	OK
85	2026-09-20 12:00	48.76	OK	86	2026-09-20 12:01	48.12	OK
87	2026-09-20 12:02	48.67	OK	88	2026-09-20 12:03	49.90	OK
89	2026-09-20 12:04	48.93	OK	90	2026-09-20 12:05	49.06	OK
91	2026-09-20 12:06	49.59	OK	92	2026-09-20 12:07	49.20	OK
93	2026-09-20 12:08	49.33	OK	94	2026-09-20 12:09	47.50	OK
95	2026-09-20 12:10	49.60	OK	96	2026-09-20 12:11	50.75	OK
97	2026-09-20 12:12	49.40	OK	98	2026-09-20 12:13	49.42	OK
99	2026-09-20 12:14	47.63	OK	100	2026-09-20 12:15	49.56	OK
101	2026-09-20 12:16	50.42	OK	102	2026-09-20 12:17	48.97	OK
103	2026-09-20 12:18	50.09	OK	104	2026-09-20 12:19	48.87	OK
105	2026-09-20 12:20	50.10	OK	106	2026-09-20 12:21	49.13	OK
107	2026-09-20 12:22	48.62	OK	108	2026-09-20 12:23	50.46	OK
109	2026-09-20 12:24	48.82	OK	110	2026-09-20 12:25	49.67	OK
111	2026-09-20 12:26	50.35	OK	112	2026-09-20 12:27	49.71	OK
113	2026-09-20 12:28	49.09	OK	114	2026-09-20 12:29	48.56	OK
115	2026-09-20 12:30	48.98	OK	116	2026-09-20 12:31	49.73	OK
117	2026-09-20 12:32	49.70	OK	118	2026-09-20 12:33	48.72	OK
119	2026-09-20 12:34	49.69	OK	120	2026-09-20 12:35	50.32	OK
121	2026-09-20 12:36	48.86	OK	122	2026-09-20 12:37	48.67	OK
123	2026-09-20 12:38	50.39	OK	124	2026-09-20 12:39	49.65	OK
125	2026-09-20 12:40	49.21	OK	126	2026-09-20 12:41	50.54	OK
127	2026-09-20 12:42	49.23	OK	128	2026-09-20 12:43	50.44	OK
129	2026-09-20 12:44	50.14	OK	130	2026-09-20 12:45	48.27	OK
131	2026-09-20 12:46	49.69	OK	132	2026-09-20 12:47	49.63	OK
133	2026-09-20 12:48	50.54	OK	134	2026-09-20 12:49	50.03	OK
135	2026-09-20 12:50	50.19	OK	136	2026-09-20 12:51	49.30	OK
137	2026-09-20 12:52	49.39	OK	138	2026-09-20 12:53	48.37	OK
139	2026-09-20 12:54	51.31	OK	140	2026-09-20 12:55	50.21	OK
141	2026-09-20 12:56	50.89	OK	142	2026-09-20 12:57	50.45	OK
143	2026-09-20 12:58	49.74	OK	144	2026-09-20 12:59	49.20	OK
145	2026-09-20 13:00	50.33	OK	146	2026-09-20 13:01	49.52	OK
147	2026-09-20 13:02	50.29	OK	148	2026-09-20 13:03	51.19	OK
149	2026-09-20 13:04	49.90	OK	150	2026-09-20 13:05	49.28	OK
151	2026-09-20 13:06	50.77	OK	152	2026-09-20 13:07	49.96	OK
153	2026-09-20 13:08	51.07	OK	154	2026-09-20 13:09	50.32	OK
155	2026-09-20 13:10	50.10	OK	156	2026-09-20 13:11	50.77	OK
157	2026-09-20 13:12	50.03	OK	158	2026-09-20 13:13	50.37	OK
159	2026-09-20 13:14	52.09	OK	160	2026-09-20 13:15	51.52	OK
161	2026-09-20 13:16	50.26	OK	162	2026-09-20 13:17	50.20	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
163	2026-09-20 13:18	49.90	OK	164	2026-09-20 13:19	49.73	OK
165	2026-09-20 13:20	50.35	OK	166	2026-09-20 13:21	51.63	OK
167	2026-09-20 13:22	50.52	OK	168	2026-09-20 13:23	50.39	OK
169	2026-09-20 13:24	50.09	OK	170	2026-09-20 13:25	51.06	OK
171	2026-09-20 13:26	51.45	OK	172	2026-09-20 13:27	51.31	OK
173	2026-09-20 13:28	50.90	OK	174	2026-09-20 13:29	50.24	OK
175	2026-09-20 13:30	49.88	OK	176	2026-09-20 13:31	50.75	OK
177	2026-09-20 13:32	50.69	OK	178	2026-09-20 13:33	50.43	OK
179	2026-09-20 13:34	51.23	OK	180	2026-09-20 13:35	51.27	OK
181	2026-09-20 13:36	51.51	OK	182	2026-09-20 13:37	51.38	OK
183	2026-09-20 13:38	50.54	OK	184	2026-09-20 13:39	49.83	OK
185	2026-09-20 13:40	52.35	OK	186	2026-09-20 13:41	50.87	OK
187	2026-09-20 13:42	50.87	OK	188	2026-09-20 13:43	51.54	OK
189	2026-09-20 13:44	51.90	OK	190	2026-09-20 13:45	51.53	OK
191	2026-09-20 13:46	52.11	OK	192	2026-09-20 13:47	50.29	OK
193	2026-09-20 13:48	51.67	OK	194	2026-09-20 13:49	50.78	OK
195	2026-09-20 13:50	51.77	OK	196	2026-09-20 13:51	49.97	OK
197	2026-09-20 13:52	52.15	OK	198	2026-09-20 13:53	51.21	OK
199	2026-09-20 13:54	50.40	OK	200	2026-09-20 13:55	51.27	OK
201	2026-09-20 13:56	50.84	OK	202	2026-09-20 13:57	51.21	OK
203	2026-09-20 13:58	51.68	OK	204	2026-09-20 13:59	51.67	OK
205	2026-09-20 14:00	52.57	OK	206	2026-09-20 14:01	51.18	OK
207	2026-09-20 14:02	50.08	OK	208	2026-09-20 14:03	52.50	OK
209	2026-09-20 14:04	50.69	OK	210	2026-09-20 14:05	50.58	OK
211	2026-09-20 14:06	50.32	OK	212	2026-09-20 14:07	51.60	OK
213	2026-09-20 14:08	50.29	OK	214	2026-09-20 14:09	51.24	OK
215	2026-09-20 14:10	51.09	OK	216	2026-09-20 14:11	50.49	OK
217	2026-09-20 14:12	52.07	OK	218	2026-09-20 14:13	50.97	OK
219	2026-09-20 14:14	52.46	OK	220	2026-09-20 14:15	51.61	OK
221	2026-09-20 14:16	52.53	OK	222	2026-09-20 14:17	51.06	OK
223	2026-09-20 14:18	50.99	OK	224	2026-09-20 14:19	52.10	OK
225	2026-09-20 14:20	51.19	OK	226	2026-09-20 14:21	52.51	OK
227	2026-09-20 14:22	51.59	OK	228	2026-09-20 14:23	51.78	OK
229	2026-09-20 14:24	51.88	OK	230	2026-09-20 14:25	52.14	OK
231	2026-09-20 14:26	52.36	OK	232	2026-09-20 14:27	52.13	OK
233	2026-09-20 14:28	51.82	OK	234	2026-09-20 14:29	51.13	OK
235	2026-09-20 14:30	51.35	OK	236	2026-09-20 14:31	51.24	OK
237	2026-09-20 14:32	51.92	OK	238	2026-09-20 14:33	52.20	OK
239	2026-09-20 14:34	50.88	OK	240	2026-09-20 14:35	51.47	OK
241	2026-09-20 14:36	51.85	OK	242	2026-09-20 14:37	52.45	OK
243	2026-09-20 14:38	51.66	OK	244	2026-09-20 14:39	53.06	OK
245	2026-09-20 14:40	52.00	OK	246	2026-09-20 14:41	52.20	OK
247	2026-09-20 14:42	51.67	OK	248	2026-09-20 14:43	51.62	OK
249	2026-09-20 14:44	50.82	OK	250	2026-09-20 14:45	52.31	OK
251	2026-09-20 14:46	51.30	OK	252	2026-09-20 14:47	51.79	OK
253	2026-09-20 14:48	52.54	OK	254	2026-09-20 14:49	51.06	OK
255	2026-09-20 14:50	52.10	OK	256	2026-09-20 14:51	52.57	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
257	2026-09-20 14:52	51.25	OK	258	2026-09-20 14:53	52.37	OK
259	2026-09-20 14:54	51.42	OK	260	2026-09-20 14:55	51.63	OK
261	2026-09-20 14:56	51.94	OK	262	2026-09-20 14:57	51.60	OK
263	2026-09-20 14:58	53.41	OK	264	2026-09-20 14:59	52.57	OK
265	2026-09-20 15:00	52.86	OK	266	2026-09-20 15:01	51.83	OK
267	2026-09-20 15:02	51.77	OK	268	2026-09-20 15:03	52.89	OK
269	2026-09-20 15:04	53.27	OK	270	2026-09-20 15:05	53.50	OK
271	2026-09-20 15:06	52.18	OK	272	2026-09-20 15:07	51.42	OK
273	2026-09-20 15:08	52.38	OK	274	2026-09-20 15:09	53.65	OK
275	2026-09-20 15:10	52.52	OK	276	2026-09-20 15:11	53.96	OK
277	2026-09-20 15:12	52.51	OK	278	2026-09-20 15:13	51.99	OK
279	2026-09-20 15:14	52.52	OK	280	2026-09-20 15:15	51.59	OK
281	2026-09-20 15:16	52.27	OK	282	2026-09-20 15:17	53.87	OK
283	2026-09-20 15:18	53.07	OK	284	2026-09-20 15:19	52.01	OK
285	2026-09-20 15:20	51.45	OK	286	2026-09-20 15:21	53.05	OK
287	2026-09-20 15:22	52.45	OK	288	2026-09-20 15:23	52.12	OK
289	2026-09-20 15:24	52.03	OK	290	2026-09-20 15:25	51.34	OK
291	2026-09-20 15:26	52.42	OK	292	2026-09-20 15:27	52.54	OK
293	2026-09-20 15:28	53.11	OK	294	2026-09-20 15:29	52.60	OK
295	2026-09-20 15:30	51.62	OK	296	2026-09-20 15:31	53.19	OK
297	2026-09-20 15:32	51.87	OK	298	2026-09-20 15:33	52.11	OK
299	2026-09-20 15:34	51.88	OK	300	2026-09-20 15:35	53.56	OK
301	2026-09-20 15:36	53.24	OK	302	2026-09-20 15:37	52.01	OK
303	2026-09-20 15:38	53.25	OK	304	2026-09-20 15:39	52.31	OK
305	2026-09-20 15:40	53.58	OK	306	2026-09-20 15:41	53.49	OK
307	2026-09-20 15:42	51.27	OK	308	2026-09-20 15:43	53.20	OK
309	2026-09-20 15:44	53.23	OK	310	2026-09-20 15:45	53.50	OK
311	2026-09-20 15:46	52.28	OK	312	2026-09-20 15:47	52.67	OK
313	2026-09-20 15:48	52.93	OK	314	2026-09-20 15:49	51.82	OK
315	2026-09-20 15:50	51.36	OK	316	2026-09-20 15:51	53.96	OK
317	2026-09-20 15:52	52.99	OK	318	2026-09-20 15:53	53.61	OK
319	2026-09-20 15:54	52.35	OK	320	2026-09-20 15:55	53.27	OK
321	2026-09-20 15:56	53.22	OK	322	2026-09-20 15:57	52.13	OK
323	2026-09-20 15:58	52.85	OK	324	2026-09-20 15:59	52.30	OK
325	2026-09-20 16:00	51.99	OK	326	2026-09-20 16:01	52.55	OK
327	2026-09-20 16:02	53.44	OK	328	2026-09-20 16:03	52.68	OK
329	2026-09-20 16:04	53.27	OK	330	2026-09-20 16:05	52.07	OK
331	2026-09-20 16:06	51.64	OK	332	2026-09-20 16:07	53.96	OK
333	2026-09-20 16:08	53.28	OK	334	2026-09-20 16:09	52.64	OK
335	2026-09-20 16:10	52.56	OK	336	2026-09-20 16:11	53.69	OK
337	2026-09-20 16:12	53.47	OK	338	2026-09-20 16:13	52.16	OK
339	2026-09-20 16:14	53.62	OK	340	2026-09-20 16:15	53.75	OK
341	2026-09-20 16:16	54.60	OK	342	2026-09-20 16:17	53.26	OK
343	2026-09-20 16:18	53.70	OK	344	2026-09-20 16:19	53.22	OK
345	2026-09-20 16:20	53.40	OK	346	2026-09-20 16:21	51.79	OK
347	2026-09-20 16:22	52.38	OK	348	2026-09-20 16:23	53.56	OK
349	2026-09-20 16:24	53.25	OK	350	2026-09-20 16:25	52.82	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
351	2026-09-20 16:26	53.08	OK	352	2026-09-20 16:27	52.61	OK
353	2026-09-20 16:28	51.89	OK	354	2026-09-20 16:29	53.36	OK
355	2026-09-20 16:30	52.87	OK	356	2026-09-20 16:31	52.94	OK
357	2026-09-20 16:32	51.44	OK	358	2026-09-20 16:33	53.27	OK
359	2026-09-20 16:34	52.74	OK	360	2026-09-20 16:35	53.33	OK
361	2026-09-20 16:36	51.68	OK	362	2026-09-20 16:37	53.87	OK
363	2026-09-20 16:38	52.56	OK	364	2026-09-20 16:39	52.13	OK
365	2026-09-20 16:40	52.57	OK	366	2026-09-20 16:41	52.40	OK
367	2026-09-20 16:42	53.23	OK	368	2026-09-20 16:43	51.97	OK
369	2026-09-20 16:44	53.24	OK	370	2026-09-20 16:45	52.43	OK
371	2026-09-20 16:46	53.07	OK	372	2026-09-20 16:47	53.43	OK
373	2026-09-20 16:48	54.63	OK	374	2026-09-20 16:49	53.56	OK
375	2026-09-20 16:50	53.32	OK	376	2026-09-20 16:51	53.31	OK
377	2026-09-20 16:52	53.86	OK	378	2026-09-20 16:53	52.97	OK
379	2026-09-20 16:54	52.32	OK	380	2026-09-20 16:55	54.14	OK
381	2026-09-20 16:56	52.86	OK	382	2026-09-20 16:57	54.04	OK
383	2026-09-20 16:58	52.34	OK	384	2026-09-20 16:59	54.12	OK
385	2026-09-20 17:00	53.17	OK	386	2026-09-20 17:01	53.64	OK
387	2026-09-20 17:02	53.11	OK	388	2026-09-20 17:03	53.24	OK
389	2026-09-20 17:04	54.23	OK	390	2026-09-20 17:05	53.54	OK
391	2026-09-20 17:06	53.53	OK	392	2026-09-20 17:07	53.60	OK
393	2026-09-20 17:08	52.23	OK	394	2026-09-20 17:09	52.87	OK
395	2026-09-20 17:10	53.30	OK	396	2026-09-20 17:11	52.55	OK
397	2026-09-20 17:12	54.88	OK	398	2026-09-20 17:13	52.61	OK
399	2026-09-20 17:14	53.35	OK	400	2026-09-20 17:15	53.31	OK
401	2026-09-20 17:16	52.76	OK	402	2026-09-20 17:17	53.87	OK
403	2026-09-20 17:18	52.64	OK	404	2026-09-20 17:19	53.34	OK
405	2026-09-20 17:20	52.61	OK	406	2026-09-20 17:21	54.01	OK
407	2026-09-20 17:22	52.18	OK	408	2026-09-20 17:23	53.82	OK
409	2026-09-20 17:24	54.31	OK	410	2026-09-20 17:25	51.25	OK
411	2026-09-20 17:26	52.65	OK	412	2026-09-20 17:27	53.82	OK
413	2026-09-20 17:28	54.30	OK	414	2026-09-20 17:29	53.36	OK
415	2026-09-20 17:30	53.40	OK	416	2026-09-20 17:31	53.60	OK
417	2026-09-20 17:32	52.93	OK	418	2026-09-20 17:33	53.65	OK
419	2026-09-20 17:34	52.51	OK	420	2026-09-20 17:35	53.58	OK
421	2026-09-20 17:36	52.37	OK	422	2026-09-20 17:37	53.79	OK
423	2026-09-20 17:38	53.75	OK	424	2026-09-20 17:39	53.83	OK
425	2026-09-20 17:40	53.00	OK	426	2026-09-20 17:41	52.93	OK
427	2026-09-20 17:42	54.36	OK	428	2026-09-20 17:43	52.71	OK
429	2026-09-20 17:44	53.76	OK	430	2026-09-20 17:45	52.62	OK
431	2026-09-20 17:46	53.15	OK	432	2026-09-20 17:47	53.05	OK
433	2026-09-20 17:48	53.12	OK	434	2026-09-20 17:49	51.51	OK
435	2026-09-20 17:50	52.24	OK	436	2026-09-20 17:51	52.98	OK
437	2026-09-20 17:52	53.18	OK	438	2026-09-20 17:53	52.45	OK
439	2026-09-20 17:54	52.31	OK	440	2026-09-20 17:55	53.31	OK
441	2026-09-20 17:56	53.01	OK	442	2026-09-20 17:57	52.21	OK
443	2026-09-20 17:58	52.40	OK	444	2026-09-20 17:59	53.61	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
445	2026-09-20 18:00	53.61	OK	446	2026-09-20 18:01	53.56	OK
447	2026-09-20 18:02	52.25	OK	448	2026-09-20 18:03	53.35	OK
449	2026-09-20 18:04	51.83	OK	450	2026-09-20 18:05	53.25	OK
451	2026-09-20 18:06	53.12	OK	452	2026-09-20 18:07	52.73	OK
453	2026-09-20 18:08	53.32	OK	454	2026-09-20 18:09	52.59	OK
455	2026-09-20 18:10	52.23	OK	456	2026-09-20 18:11	54.07	OK
457	2026-09-20 18:12	54.13	OK	458	2026-09-20 18:13	54.51	OK
459	2026-09-20 18:14	52.77	OK	460	2026-09-20 18:15	54.29	OK
461	2026-09-20 18:16	53.63	OK	462	2026-09-20 18:17	54.39	OK
463	2026-09-20 18:18	52.80	OK	464	2026-09-20 18:19	53.33	OK
465	2026-09-20 18:20	52.64	OK	466	2026-09-20 18:21	52.28	OK
467	2026-09-20 18:22	53.51	OK	468	2026-09-20 18:23	53.96	OK
469	2026-09-20 18:24	53.12	OK	470	2026-09-20 18:25	53.61	OK
471	2026-09-20 18:26	54.05	OK	472	2026-09-20 18:27	52.60	OK
473	2026-09-20 18:28	52.76	OK	474	2026-09-20 18:29	53.06	OK
475	2026-09-20 18:30	53.44	OK	476	2026-09-20 18:31	52.91	OK
477	2026-09-20 18:32	52.43	OK	478	2026-09-20 18:33	52.94	OK
479	2026-09-20 18:34	54.91	OK	480	2026-09-20 18:35	53.69	OK
481	2026-09-20 18:36	53.25	OK	482	2026-09-20 18:37	52.34	OK
483	2026-09-20 18:38	53.41	OK	484	2026-09-20 18:39	53.55	OK
485	2026-09-20 18:40	53.81	OK	486	2026-09-20 18:41	54.50	OK
487	2026-09-20 18:42	53.56	OK	488	2026-09-20 18:43	53.24	OK
489	2026-09-20 18:44	51.68	OK	490	2026-09-20 18:45	52.71	OK
491	2026-09-20 18:46	52.30	OK	492	2026-09-20 18:47	52.87	OK
493	2026-09-20 18:48	53.18	OK	494	2026-09-20 18:49	54.52	OK
495	2026-09-20 18:50	53.36	OK	496	2026-09-20 18:51	52.24	OK
497	2026-09-20 18:52	52.93	OK	498	2026-09-20 18:53	53.02	OK
499	2026-09-20 18:54	53.97	OK	500	2026-09-20 18:55	51.69	OK
501	2026-09-20 18:56	53.40	OK	502	2026-09-20 18:57	53.24	OK
503	2026-09-20 18:58	52.08	OK	504	2026-09-20 18:59	51.60	OK
505	2026-09-20 19:00	53.20	OK	506	2026-09-20 19:01	52.42	OK
507	2026-09-20 19:02	53.33	OK	508	2026-09-20 19:03	53.10	OK
509	2026-09-20 19:04	52.15	OK	510	2026-09-20 19:05	53.77	OK
511	2026-09-20 19:06	53.14	OK	512	2026-09-20 19:07	52.67	OK
513	2026-09-20 19:08	53.89	OK	514	2026-09-20 19:09	52.28	OK
515	2026-09-20 19:10	53.06	OK	516	2026-09-20 19:11	52.25	OK
517	2026-09-20 19:12	52.20	OK	518	2026-09-20 19:13	53.26	OK
519	2026-09-20 19:14	54.22	OK	520	2026-09-20 19:15	53.89	OK
521	2026-09-20 19:16	52.64	OK	522	2026-09-20 19:17	52.90	OK
523	2026-09-20 19:18	53.99	OK	524	2026-09-20 19:19	53.65	OK
525	2026-09-20 19:20	52.10	OK	526	2026-09-20 19:21	53.38	OK
527	2026-09-20 19:22	53.63	OK	528	2026-09-20 19:23	53.17	OK
529	2026-09-20 19:24	52.83	OK	530	2026-09-20 19:25	53.68	OK
531	2026-09-20 19:26	53.61	OK	532	2026-09-20 19:27	52.71	OK
533	2026-09-20 19:28	52.78	OK	534	2026-09-20 19:29	52.27	OK
535	2026-09-20 19:30	51.48	OK	536	2026-09-20 19:31	51.91	OK
537	2026-09-20 19:32	52.41	OK	538	2026-09-20 19:33	53.04	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
539	2026-09-20 19:34	52.52	OK	540	2026-09-20 19:35	52.93	OK
541	2026-09-20 19:36	52.36	OK	542	2026-09-20 19:37	52.15	OK
543	2026-09-20 19:38	52.38	OK	544	2026-09-20 19:39	52.37	OK
545	2026-09-20 19:40	52.75	OK	546	2026-09-20 19:41	52.33	OK
547	2026-09-20 19:42	52.45	OK	548	2026-09-20 19:43	52.92	OK
549	2026-09-20 19:44	52.15	OK	550	2026-09-20 19:45	53.47	OK
551	2026-09-20 19:46	51.63	OK	552	2026-09-20 19:47	51.26	OK
553	2026-09-20 19:48	52.32	OK	554	2026-09-20 19:49	52.91	OK
555	2026-09-20 19:50	51.62	OK	556	2026-09-20 19:51	52.87	OK
557	2026-09-20 19:52	53.20	OK	558	2026-09-20 19:53	51.72	OK
559	2026-09-20 19:54	52.48	OK	560	2026-09-20 19:55	52.37	OK
561	2026-09-20 19:56	52.96	OK	562	2026-09-20 19:57	52.81	OK
563	2026-09-20 19:58	52.18	OK	564	2026-09-20 19:59	51.87	OK
565	2026-09-20 20:00	52.66	OK	566	2026-09-20 20:01	51.69	OK
567	2026-09-20 20:02	53.35	OK	568	2026-09-20 20:03	50.95	OK
569	2026-09-20 20:04	52.77	OK	570	2026-09-20 20:05	52.03	OK
571	2026-09-20 20:06	52.20	OK	572	2026-09-20 20:07	53.05	OK
573	2026-09-20 20:08	52.45	OK	574	2026-09-20 20:09	50.44	OK
575	2026-09-20 20:10	51.54	OK	576	2026-09-20 20:11	52.80	OK
577	2026-09-20 20:12	51.53	OK	578	2026-09-20 20:13	51.36	OK
579	2026-09-20 20:14	52.11	OK	580	2026-09-20 20:15	52.09	OK
581	2026-09-20 20:16	53.25	OK	582	2026-09-20 20:17	52.82	OK
583	2026-09-20 20:18	51.49	OK	584	2026-09-20 20:19	51.61	OK
585	2026-09-20 20:20	51.91	OK	586	2026-09-20 20:21	52.31	OK
587	2026-09-20 20:22	52.24	OK	588	2026-09-20 20:23	51.59	OK
589	2026-09-20 20:24	52.04	OK	590	2026-09-20 20:25	51.14	OK
591	2026-09-20 20:26	51.87	OK	592	2026-09-20 20:27	52.85	OK
593	2026-09-20 20:28	51.79	OK	594	2026-09-20 20:29	51.66	OK
595	2026-09-20 20:30	52.71	OK	596	2026-09-20 20:31	52.11	OK
597	2026-09-20 20:32	52.02	OK	598	2026-09-20 20:33	50.53	OK
599	2026-09-20 20:34	51.39	OK	600	2026-09-20 20:35	51.86	OK
601	2026-09-20 20:36	52.36	OK	602	2026-09-20 20:37	52.15	OK
603	2026-09-20 20:38	50.75	OK	604	2026-09-20 20:39	51.86	OK
605	2026-09-20 20:40	52.12	OK	606	2026-09-20 20:41	52.38	OK
607	2026-09-20 20:42	50.28	OK	608	2026-09-20 20:43	51.85	OK
609	2026-09-20 20:44	52.30	OK	610	2026-09-20 20:45	51.38	OK
611	2026-09-20 20:46	51.17	OK	612	2026-09-20 20:47	52.02	OK
613	2026-09-20 20:48	50.03	OK	614	2026-09-20 20:49	53.12	OK
615	2026-09-20 20:50	52.35	OK	616	2026-09-20 20:51	51.48	OK
617	2026-09-20 20:52	51.63	OK	618	2026-09-20 20:53	50.83	OK
619	2026-09-20 20:54	51.06	OK	620	2026-09-20 20:55	51.35	OK
621	2026-09-20 20:56	51.79	OK	622	2026-09-20 20:57	52.00	OK
623	2026-09-20 20:58	52.22	OK	624	2026-09-20 20:59	52.04	OK
625	2026-09-20 21:00	51.54	OK	626	2026-09-20 21:01	51.77	OK
627	2026-09-20 21:02	51.12	OK	628	2026-09-20 21:03	51.22	OK
629	2026-09-20 21:04	51.36	OK	630	2026-09-20 21:05	51.04	OK
631	2026-09-20 21:06	50.29	OK	632	2026-09-20 21:07	52.43	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
633	2026-09-20 21:08	50.92	OK	634	2026-09-20 21:09	52.20	OK
635	2026-09-20 21:10	51.37	OK	636	2026-09-20 21:11	51.98	OK
637	2026-09-20 21:12	50.91	OK	638	2026-09-20 21:13	51.26	OK
639	2026-09-20 21:14	51.80	OK	640	2026-09-20 21:15	51.74	OK
641	2026-09-20 21:16	50.52	OK	642	2026-09-20 21:17	51.05	OK
643	2026-09-20 21:18	52.29	OK	644	2026-09-20 21:19	50.16	OK
645	2026-09-20 21:20	50.94	OK	646	2026-09-20 21:21	50.02	OK
647	2026-09-20 21:22	52.21	OK	648	2026-09-20 21:23	50.45	OK
649	2026-09-20 21:24	50.60	OK	650	2026-09-20 21:25	51.26	OK
651	2026-09-20 21:26	50.89	OK	652	2026-09-20 21:27	51.35	OK
653	2026-09-20 21:28	50.59	OK	654	2026-09-20 21:29	49.67	OK
655	2026-09-20 21:30	50.70	OK	656	2026-09-20 21:31	50.79	OK
657	2026-09-20 21:32	50.99	OK	658	2026-09-20 21:33	50.73	OK
659	2026-09-20 21:34	50.13	OK	660	2026-09-20 21:35	50.76	OK
661	2026-09-20 21:36	50.43	OK	662	2026-09-20 21:37	51.43	OK
663	2026-09-20 21:38	50.06	OK	664	2026-09-20 21:39	51.28	OK
665	2026-09-20 21:40	48.87	OK	666	2026-09-20 21:41	50.62	OK
667	2026-09-20 21:42	51.39	OK	668	2026-09-20 21:43	50.21	OK
669	2026-09-20 21:44	51.85	OK	670	2026-09-20 21:45	50.53	OK
671	2026-09-20 21:46	50.63	OK	672	2026-09-20 21:47	50.80	OK
673	2026-09-20 21:48	50.76	OK	674	2026-09-20 21:49	50.66	OK
675	2026-09-20 21:50	50.77	OK	676	2026-09-20 21:51	49.41	OK
677	2026-09-20 21:52	49.94	OK	678	2026-09-20 21:53	51.26	OK
679	2026-09-20 21:54	49.42	OK	680	2026-09-20 21:55	50.66	OK
681	2026-09-20 21:56	51.20	OK	682	2026-09-20 21:57	49.07	OK
683	2026-09-20 21:58	49.38	OK	684	2026-09-20 21:59	50.02	OK
685	2026-09-20 22:00	51.20	OK	686	2026-09-20 22:01	50.16	OK
687	2026-09-20 22:02	51.46	OK	688	2026-09-20 22:03	50.04	OK
689	2026-09-20 22:04	49.35	OK	690	2026-09-20 22:05	51.15	OK
691	2026-09-20 22:06	49.70	OK	692	2026-09-20 22:07	50.04	OK
693	2026-09-20 22:08	49.29	OK	694	2026-09-20 22:09	49.90	OK
695	2026-09-20 22:10	49.27	OK	696	2026-09-20 22:11	50.43	OK
697	2026-09-20 22:12	50.61	OK	698	2026-09-20 22:13	50.32	OK
699	2026-09-20 22:14	49.23	OK	700	2026-09-20 22:15	51.26	OK
701	2026-09-20 22:16	49.31	OK	702	2026-09-20 22:17	49.00	OK
703	2026-09-20 22:18	50.14	OK	704	2026-09-20 22:19	49.86	OK
705	2026-09-20 22:20	51.22	OK	706	2026-09-20 22:21	48.78	OK
707	2026-09-20 22:22	50.91	OK	708	2026-09-20 22:23	50.10	OK
709	2026-09-20 22:24	51.05	OK	710	2026-09-20 22:25	50.26	OK
711	2026-09-20 22:26	49.49	OK	712	2026-09-20 22:27	49.91	OK
713	2026-09-20 22:28	49.41	OK	714	2026-09-20 22:29	50.07	OK
715	2026-09-20 22:30	48.16	OK	716	2026-09-20 22:31	50.05	OK
717	2026-09-20 22:32	50.18	OK	718	2026-09-20 22:33	49.56	OK
719	2026-09-20 22:34	50.48	OK	720	2026-09-20 22:35	49.33	OK
721	2026-09-20 22:36	49.90	OK	722	2026-09-20 22:37	50.59	OK
723	2026-09-20 22:38	49.19	OK	724	2026-09-20 22:39	50.24	OK
725	2026-09-20 22:40	49.88	OK	726	2026-09-20 22:41	49.00	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
727	2026-09-20 22:42	48.62	OK	728	2026-09-20 22:43	49.89	OK
729	2026-09-20 22:44	49.73	OK	730	2026-09-20 22:45	49.25	OK
731	2026-09-20 22:46	49.32	OK	732	2026-09-20 22:47	49.35	OK
733	2026-09-20 22:48	48.86	OK	734	2026-09-20 22:49	49.40	OK
735	2026-09-20 22:50	49.79	OK	736	2026-09-20 22:51	48.78	OK
737	2026-09-20 22:52	49.12	OK	738	2026-09-20 22:53	49.39	OK
739	2026-09-20 22:54	48.98	OK	740	2026-09-20 22:55	50.16	OK
741	2026-09-20 22:56	48.51	OK	742	2026-09-20 22:57	49.55	OK
743	2026-09-20 22:58	50.02	OK	744	2026-09-20 22:59	48.27	OK
745	2026-09-20 23:00	48.89	OK	746	2026-09-20 23:01	49.62	OK
747	2026-09-20 23:02	49.74	OK	748	2026-09-20 23:03	48.13	OK
749	2026-09-20 23:04	47.01	OK	750	2026-09-20 23:05	50.21	OK
751	2026-09-20 23:06	48.52	OK	752	2026-09-20 23:07	48.46	OK
753	2026-09-20 23:08	49.32	OK	754	2026-09-20 23:09	49.52	OK
755	2026-09-20 23:10	48.00	OK	756	2026-09-20 23:11	48.30	OK
757	2026-09-20 23:12	49.11	OK	758	2026-09-20 23:13	47.75	OK
759	2026-09-20 23:14	49.37	OK	760	2026-09-20 23:15	48.42	OK
761	2026-09-20 23:16	49.15	OK	762	2026-09-20 23:17	47.53	OK
763	2026-09-20 23:18	48.64	OK	764	2026-09-20 23:19	47.76	OK
765	2026-09-20 23:20	48.85	OK	766	2026-09-20 23:21	48.98	OK
767	2026-09-20 23:22	49.45	OK	768	2026-09-20 23:23	48.33	OK
769	2026-09-20 23:24	49.28	OK	770	2026-09-20 23:25	47.64	OK
771	2026-09-20 23:26	48.09	OK	772	2026-09-20 23:27	47.22	OK
773	2026-09-20 23:28	48.56	OK	774	2026-09-20 23:29	47.18	OK
775	2026-09-20 23:30	48.25	OK	776	2026-09-20 23:31	48.74	OK
777	2026-09-20 23:32	47.72	OK	778	2026-09-20 23:33	48.63	OK
779	2026-09-20 23:34	48.54	OK	780	2026-09-20 23:35	47.82	OK
781	2026-09-20 23:36	49.01	OK	782	2026-09-20 23:37	48.81	OK
783	2026-09-20 23:38	48.41	OK	784	2026-09-20 23:39	48.38	OK
785	2026-09-20 23:40	49.07	OK	786	2026-09-20 23:41	46.76	OK
787	2026-09-20 23:42	48.31	OK	788	2026-09-20 23:43	48.53	OK
789	2026-09-20 23:44	48.68	OK	790	2026-09-20 23:45	47.97	OK
791	2026-09-20 23:46	47.30	OK	792	2026-09-20 23:47	46.73	OK
793	2026-09-20 23:48	46.62	OK	794	2026-09-20 23:49	48.99	OK
795	2026-09-20 23:50	47.74	OK	796	2026-09-20 23:51	47.08	OK
797	2026-09-20 23:52	47.80	OK	798	2026-09-20 23:53	48.09	OK
799	2026-09-20 23:54	48.04	OK	800	2026-09-20 23:55	48.56	OK
801	2026-09-20 23:56	47.86	OK	802	2026-09-20 23:57	48.98	OK
803	2026-09-20 23:58	49.67	OK	804	2026-09-20 23:59	47.82	OK
805	2026-09-21 00:00	47.67	OK	806	2026-09-21 00:01	47.27	OK
807	2026-09-21 00:02	48.14	OK	808	2026-09-21 00:03	47.62	OK
809	2026-09-21 00:04	48.49	OK	810	2026-09-21 00:05	47.75	OK
811	2026-09-21 00:06	48.47	OK	812	2026-09-21 00:07	48.26	OK
813	2026-09-21 00:08	47.95	OK	814	2026-09-21 00:09	48.19	OK
815	2026-09-21 00:10	46.76	OK	816	2026-09-21 00:11	47.45	OK
817	2026-09-21 00:12	48.05	OK	818	2026-09-21 00:13	47.83	OK
819	2026-09-21 00:14	47.46	OK	820	2026-09-21 00:15	47.22	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
821	2026-09-21 00:16	47.64	OK	822	2026-09-21 00:17	47.63	OK
823	2026-09-21 00:18	48.81	OK	824	2026-09-21 00:19	47.22	OK
825	2026-09-21 00:20	47.94	OK	826	2026-09-21 00:21	47.59	OK
827	2026-09-21 00:22	48.03	OK	828	2026-09-21 00:23	46.93	OK
829	2026-09-21 00:24	46.18	OK	830	2026-09-21 00:25	48.58	OK
831	2026-09-21 00:26	48.49	OK	832	2026-09-21 00:27	48.15	OK
833	2026-09-21 00:28	47.62	OK	834	2026-09-21 00:29	46.76	OK
835	2026-09-21 00:30	47.06	OK	836	2026-09-21 00:31	47.20	OK
837	2026-09-21 00:32	45.49	OK	838	2026-09-21 00:33	46.30	OK
839	2026-09-21 00:34	45.96	OK	840	2026-09-21 00:35	47.16	OK
841	2026-09-21 00:36	47.40	OK	842	2026-09-21 00:37	46.25	OK
843	2026-09-21 00:38	47.86	OK	844	2026-09-21 00:39	47.41	OK
845	2026-09-21 00:40	45.86	OK	846	2026-09-21 00:41	46.75	OK
847	2026-09-21 00:42	46.36	OK	848	2026-09-21 00:43	47.73	OK
849	2026-09-21 00:44	46.57	OK	850	2026-09-21 00:45	47.76	OK
851	2026-09-21 00:46	48.17	OK	852	2026-09-21 00:47	47.85	OK
853	2026-09-21 00:48	47.45	OK	854	2026-09-21 00:49	47.22	OK
855	2026-09-21 00:50	45.93	OK	856	2026-09-21 00:51	46.61	OK
857	2026-09-21 00:52	47.17	OK	858	2026-09-21 00:53	46.79	OK
859	2026-09-21 00:54	47.58	OK	860	2026-09-21 00:55	46.33	OK
861	2026-09-21 00:56	46.57	OK	862	2026-09-21 00:57	46.30	OK
863	2026-09-21 00:58	45.79	OK	864	2026-09-21 00:59	47.81	OK
865	2026-09-21 01:00	46.26	OK	866	2026-09-21 01:01	47.15	OK
867	2026-09-21 01:02	46.06	OK	868	2026-09-21 01:03	48.27	OK
869	2026-09-21 01:04	45.89	OK	870	2026-09-21 01:05	47.13	OK
871	2026-09-21 01:06	46.17	OK	872	2026-09-21 01:07	45.84	OK
873	2026-09-21 01:08	46.48	OK	874	2026-09-21 01:09	46.24	OK
875	2026-09-21 01:10	47.41	OK	876	2026-09-21 01:11	45.56	OK
877	2026-09-21 01:12	46.71	OK	878	2026-09-21 01:13	46.95	OK
879	2026-09-21 01:14	46.14	OK	880	2026-09-21 01:15	46.80	OK
881	2026-09-21 01:16	45.08	OK	882	2026-09-21 01:17	47.03	OK
883	2026-09-21 01:18	46.12	OK	884	2026-09-21 01:19	46.37	OK
885	2026-09-21 01:20	46.14	OK	886	2026-09-21 01:21	46.75	OK
887	2026-09-21 01:22	46.53	OK	888	2026-09-21 01:23	45.47	OK
889	2026-09-21 01:24	45.99	OK	890	2026-09-21 01:25	46.18	OK
891	2026-09-21 01:26	46.11	OK	892	2026-09-21 01:27	45.05	OK
893	2026-09-21 01:28	45.19	OK	894	2026-09-21 01:29	45.75	OK
895	2026-09-21 01:30	47.09	OK	896	2026-09-21 01:31	46.10	OK
897	2026-09-21 01:32	47.16	OK	898	2026-09-21 01:33	46.48	OK
899	2026-09-21 01:34	46.03	OK	900	2026-09-21 01:35	46.03	OK
901	2026-09-21 01:36	45.26	OK	902	2026-09-21 01:37	46.44	OK
903	2026-09-21 01:38	46.04	OK	904	2026-09-21 01:39	45.69	OK
905	2026-09-21 01:40	45.21	OK	906	2026-09-21 01:41	44.88	OK
907	2026-09-21 01:42	46.78	OK	908	2026-09-21 01:43	44.77	OK
909	2026-09-21 01:44	45.99	OK	910	2026-09-21 01:45	45.25	OK
911	2026-09-21 01:46	46.57	OK	912	2026-09-21 01:47	46.06	OK
913	2026-09-21 01:48	44.56	OK	914	2026-09-21 01:49	46.05	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
915	2026-09-21 01:50	45.55	OK	916	2026-09-21 01:51	45.99	OK
917	2026-09-21 01:52	46.22	OK	918	2026-09-21 01:53	45.29	OK
919	2026-09-21 01:54	44.19	OK	920	2026-09-21 01:55	44.73	OK
921	2026-09-21 01:56	44.51	OK	922	2026-09-21 01:57	45.85	OK
923	2026-09-21 01:58	44.67	OK	924	2026-09-21 01:59	46.25	OK
925	2026-09-21 02:00	45.95	OK	926	2026-09-21 02:01	45.78	OK
927	2026-09-21 02:02	46.49	OK	928	2026-09-21 02:03	46.24	OK
929	2026-09-21 02:04	46.81	OK	930	2026-09-21 02:05	44.83	OK
931	2026-09-21 02:06	45.09	OK	932	2026-09-21 02:07	46.77	OK
933	2026-09-21 02:08	44.82	OK	934	2026-09-21 02:09	46.13	OK
935	2026-09-21 02:10	44.04	OK	936	2026-09-21 02:11	45.94	OK
937	2026-09-21 02:12	45.66	OK	938	2026-09-21 02:13	46.25	OK
939	2026-09-21 02:14	45.32	OK	940	2026-09-21 02:15	44.74	OK
941	2026-09-21 02:16	44.88	OK	942	2026-09-21 02:17	46.47	OK
943	2026-09-21 02:18	46.04	OK	944	2026-09-21 02:19	45.59	OK
945	2026-09-21 02:20	45.79	OK	946	2026-09-21 02:21	45.16	OK
947	2026-09-21 02:22	45.78	OK	948	2026-09-21 02:23	44.84	OK
949	2026-09-21 02:24	45.08	OK	950	2026-09-21 02:25	44.47	OK
951	2026-09-21 02:26	44.66	OK	952	2026-09-21 02:27	43.58	OK
953	2026-09-21 02:28	46.48	OK	954	2026-09-21 02:29	44.13	OK
955	2026-09-21 02:30	43.73	OK	956	2026-09-21 02:31	44.89	OK
957	2026-09-21 02:32	44.64	OK	958	2026-09-21 02:33	44.10	OK
959	2026-09-21 02:34	44.02	OK	960	2026-09-21 02:35	45.50	OK
961	2026-09-21 02:36	44.52	OK	962	2026-09-21 02:37	45.51	OK
963	2026-09-21 02:38	45.04	OK	964	2026-09-21 02:39	45.50	OK
965	2026-09-21 02:40	44.08	OK	966	2026-09-21 02:41	44.86	OK
967	2026-09-21 02:42	44.53	OK	968	2026-09-21 02:43	44.13	OK
969	2026-09-21 02:44	44.22	OK	970	2026-09-21 02:45	44.80	OK
971	2026-09-21 02:46	44.45	OK	972	2026-09-21 02:47	43.75	OK
973	2026-09-21 02:48	45.02	OK	974	2026-09-21 02:49	45.11	OK
975	2026-09-21 02:50	45.16	OK	976	2026-09-21 02:51	44.44	OK
977	2026-09-21 02:52	45.14	OK	978	2026-09-21 02:53	43.37	OK
979	2026-09-21 02:54	44.08	OK	980	2026-09-21 02:55	45.00	OK
981	2026-09-21 02:56	43.77	OK	982	2026-09-21 02:57	44.51	OK
983	2026-09-21 02:58	44.01	OK	984	2026-09-21 02:59	44.63	OK
985	2026-09-21 03:00	44.02	OK	986	2026-09-21 03:01	44.96	OK
987	2026-09-21 03:02	44.32	OK	988	2026-09-21 03:03	43.43	OK
989	2026-09-21 03:04	45.40	OK	990	2026-09-21 03:05	44.32	OK
991	2026-09-21 03:06	43.86	OK	992	2026-09-21 03:07	45.33	OK
993	2026-09-21 03:08	43.64	OK	994	2026-09-21 03:09	45.22	OK
995	2026-09-21 03:10	44.84	OK	996	2026-09-21 03:11	44.51	OK
997	2026-09-21 03:12	43.53	OK	998	2026-09-21 03:13	45.84	OK
999	2026-09-21 03:14	45.64	OK	1000	2026-09-21 03:15	44.95	OK
1001	2026-09-21 03:16	43.76	OK	1002	2026-09-21 03:17	45.95	OK
1003	2026-09-21 03:18	45.47	OK	1004	2026-09-21 03:19	46.08	OK
1005	2026-09-21 03:20	43.96	OK	1006	2026-09-21 03:21	44.54	OK
1007	2026-09-21 03:22	43.99	OK	1008	2026-09-21 03:23	45.05	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1009	2026-09-21 03:24	43.28	OK	1010	2026-09-21 03:25	44.43	OK
1011	2026-09-21 03:26	44.79	OK	1012	2026-09-21 03:27	44.03	OK
1013	2026-09-21 03:28	43.76	OK	1014	2026-09-21 03:29	44.17	OK
1015	2026-09-21 03:30	44.29	OK	1016	2026-09-21 03:31	45.16	OK
1017	2026-09-21 03:32	44.48	OK	1018	2026-09-21 03:33	43.72	OK
1019	2026-09-21 03:34	43.51	OK	1020	2026-09-21 03:35	43.63	OK
1021	2026-09-21 03:36	43.60	OK	1022	2026-09-21 03:37	43.50	OK
1023	2026-09-21 03:38	44.18	OK	1024	2026-09-21 03:39	45.17	OK
1025	2026-09-21 03:40	43.60	OK	1026	2026-09-21 03:41	43.18	OK
1027	2026-09-21 03:42	44.88	OK	1028	2026-09-21 03:43	43.43	OK
1029	2026-09-21 03:44	44.86	OK	1030	2026-09-21 03:45	44.34	OK
1031	2026-09-21 03:46	44.27	OK	1032	2026-09-21 03:47	44.03	OK
1033	2026-09-21 03:48	45.29	OK	1034	2026-09-21 03:49	44.51	OK
1035	2026-09-21 03:50	43.59	OK	1036	2026-09-21 03:51	43.01	OK
1037	2026-09-21 03:52	43.87	OK	1038	2026-09-21 03:53	45.33	OK
1039	2026-09-21 03:54	42.64	OK	1040	2026-09-21 03:55	43.57	OK
1041	2026-09-21 03:56	44.49	OK	1042	2026-09-21 03:57	44.50	OK
1043	2026-09-21 03:58	45.17	OK	1044	2026-09-21 03:59	43.94	OK
1045	2026-09-21 04:00	43.95	OK	1046	2026-09-21 04:01	43.86	OK
1047	2026-09-21 04:02	44.95	OK	1048	2026-09-21 04:03	43.83	OK
1049	2026-09-21 04:04	45.01	OK	1050	2026-09-21 04:05	42.90	OK
1051	2026-09-21 04:06	44.68	OK	1052	2026-09-21 04:07	44.22	OK
1053	2026-09-21 04:08	43.32	OK	1054	2026-09-21 04:09	43.47	OK
1055	2026-09-21 04:10	43.80	OK	1056	2026-09-21 04:11	44.97	OK
1057	2026-09-21 04:12	43.95	OK	1058	2026-09-21 04:13	44.42	OK
1059	2026-09-21 04:14	43.64	OK	1060	2026-09-21 04:15	43.90	OK
1061	2026-09-21 04:16	43.51	OK	1062	2026-09-21 04:17	43.69	OK
1063	2026-09-21 04:18	42.65	OK	1064	2026-09-21 04:19	43.04	OK
1065	2026-09-21 04:20	43.63	OK	1066	2026-09-21 04:21	43.91	OK
1067	2026-09-21 04:22	43.75	OK	1068	2026-09-21 04:23	43.91	OK
1069	2026-09-21 04:24	44.08	OK	1070	2026-09-21 04:25	44.66	OK
1071	2026-09-21 04:26	43.84	OK	1072	2026-09-21 04:27	43.05	OK
1073	2026-09-21 04:28	42.85	OK	1074	2026-09-21 04:29	43.21	OK
1075	2026-09-21 04:30	43.03	OK	1076	2026-09-21 04:31	43.00	OK
1077	2026-09-21 04:32	43.17	OK	1078	2026-09-21 04:33	43.83	OK
1079	2026-09-21 04:34	42.00	OK	1080	2026-09-21 04:35	43.62	OK
1081	2026-09-21 04:36	44.25	OK	1082	2026-09-21 04:37	42.89	OK
1083	2026-09-21 04:38	42.86	OK	1084	2026-09-21 04:39	42.79	OK
1085	2026-09-21 04:40	43.73	OK	1086	2026-09-21 04:41	44.46	OK
1087	2026-09-21 04:42	43.97	OK	1088	2026-09-21 04:43	42.61	OK
1089	2026-09-21 04:44	42.48	OK	1090	2026-09-21 04:45	44.57	OK
1091	2026-09-21 04:46	44.06	OK	1092	2026-09-21 04:47	43.32	OK
1093	2026-09-21 04:48	43.76	OK	1094	2026-09-21 04:49	43.57	OK
1095	2026-09-21 04:50	43.65	OK	1096	2026-09-21 04:51	43.18	OK
1097	2026-09-21 04:52	43.22	OK	1098	2026-09-21 04:53	43.44	OK
1099	2026-09-21 04:54	43.46	OK	1100	2026-09-21 04:55	43.30	OK
1101	2026-09-21 04:56	44.51	OK	1102	2026-09-21 04:57	43.19	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1103	2026-09-21 04:58	42.70	OK	1104	2026-09-21 04:59	42.81	OK
1105	2026-09-21 05:00	43.63	OK	1106	2026-09-21 05:01	42.74	OK
1107	2026-09-21 05:02	42.20	OK	1108	2026-09-21 05:03	44.44	OK
1109	2026-09-21 05:04	44.45	OK	1110	2026-09-21 05:05	43.95	OK
1111	2026-09-21 05:06	42.17	OK	1112	2026-09-21 05:07	42.64	OK
1113	2026-09-21 05:08	43.43	OK	1114	2026-09-21 05:09	43.09	OK
1115	2026-09-21 05:10	43.12	OK	1116	2026-09-21 05:11	42.92	OK
1117	2026-09-21 05:12	43.94	OK	1118	2026-09-21 05:13	43.05	OK
1119	2026-09-21 05:14	43.70	OK	1120	2026-09-21 05:15	44.13	OK
1121	2026-09-21 05:16	43.91	OK	1122	2026-09-21 05:17	42.58	OK
1123	2026-09-21 05:18	43.51	OK	1124	2026-09-21 05:19	43.23	OK
1125	2026-09-21 05:20	42.97	OK	1126	2026-09-21 05:21	43.75	OK
1127	2026-09-21 05:22	43.67	OK	1128	2026-09-21 05:23	43.34	OK
1129	2026-09-21 05:24	41.61	OK	1130	2026-09-21 05:25	42.90	OK
1131	2026-09-21 05:26	41.97	OK	1132	2026-09-21 05:27	42.94	OK
1133	2026-09-21 05:28	43.08	OK	1134	2026-09-21 05:29	42.51	OK
1135	2026-09-21 05:30	43.34	OK	1136	2026-09-21 05:31	42.79	OK
1137	2026-09-21 05:32	43.62	OK	1138	2026-09-21 05:33	43.35	OK
1139	2026-09-21 05:34	42.16	OK	1140	2026-09-21 05:35	42.98	OK
1141	2026-09-21 05:36	44.59	OK	1142	2026-09-21 05:37	44.03	OK
1143	2026-09-21 05:38	44.30	OK	1144	2026-09-21 05:39	44.06	OK
1145	2026-09-21 05:40	42.05	OK	1146	2026-09-21 05:41	42.47	OK
1147	2026-09-21 05:42	42.29	OK	1148	2026-09-21 05:43	43.18	OK
1149	2026-09-21 05:44	42.52	OK	1150	2026-09-21 05:45	42.59	OK
1151	2026-09-21 05:46	42.58	OK	1152	2026-09-21 05:47	42.32	OK
1153	2026-09-21 05:48	43.30	OK	1154	2026-09-21 05:49	42.82	OK
1155	2026-09-21 05:50	43.96	OK	1156	2026-09-21 05:51	44.29	OK
1157	2026-09-21 05:52	43.95	OK	1158	2026-09-21 05:53	44.16	OK
1159	2026-09-21 05:54	42.22	OK	1160	2026-09-21 05:55	43.68	OK
1161	2026-09-21 05:56	44.58	OK	1162	2026-09-21 05:57	42.40	OK
1163	2026-09-21 05:58	43.49	OK	1164	2026-09-21 05:59	42.71	OK
1165	2026-09-21 06:00	43.09	OK	1166	2026-09-21 06:01	43.35	OK
1167	2026-09-21 06:02	42.60	OK	1168	2026-09-21 06:03	41.67	OK
1169	2026-09-21 06:04	42.61	OK	1170	2026-09-21 06:05	43.66	OK
1171	2026-09-21 06:06	44.54	OK	1172	2026-09-21 06:07	43.66	OK
1173	2026-09-21 06:08	43.21	OK	1174	2026-09-21 06:09	43.20	OK
1175	2026-09-21 06:10	42.55	OK	1176	2026-09-21 06:11	42.94	OK
1177	2026-09-21 06:12	42.94	OK	1178	2026-09-21 06:13	43.95	OK
1179	2026-09-21 06:14	43.71	OK	1180	2026-09-21 06:15	43.87	OK
1181	2026-09-21 06:16	44.52	OK	1182	2026-09-21 06:17	43.05	OK
1183	2026-09-21 06:18	42.99	OK	1184	2026-09-21 06:19	42.68	OK
1185	2026-09-21 06:20	42.52	OK	1186	2026-09-21 06:21	42.11	OK
1187	2026-09-21 06:22	43.84	OK	1188	2026-09-21 06:23	43.31	OK
1189	2026-09-21 06:24	43.04	OK	1190	2026-09-21 06:25	44.43	OK
1191	2026-09-21 06:26	43.44	OK	1192	2026-09-21 06:27	44.49	OK
1193	2026-09-21 06:28	44.40	OK	1194	2026-09-21 06:29	43.04	OK
1195	2026-09-21 06:30	44.41	OK	1196	2026-09-21 06:31	42.48	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1197	2026-09-21 06:32	43.40	OK	1198	2026-09-21 06:33	43.88	OK
1199	2026-09-21 06:34	43.28	OK	1200	2026-09-21 06:35	43.58	OK
1201	2026-09-21 06:36	44.35	OK	1202	2026-09-21 06:37	45.07	OK
1203	2026-09-21 06:38	43.70	OK	1204	2026-09-21 06:39	42.28	OK
1205	2026-09-21 06:40	44.35	OK	1206	2026-09-21 06:41	43.86	OK
1207	2026-09-21 06:42	42.84	OK	1208	2026-09-21 06:43	44.05	OK
1209	2026-09-21 06:44	42.47	OK	1210	2026-09-21 06:45	41.70	OK
1211	2026-09-21 06:46	43.33	OK	1212	2026-09-21 06:47	43.24	OK
1213	2026-09-21 06:48	43.16	OK	1214	2026-09-21 06:49	43.25	OK
1215	2026-09-21 06:50	44.15	OK	1216	2026-09-21 06:51	43.22	OK
1217	2026-09-21 06:52	44.40	OK	1218	2026-09-21 06:53	43.76	OK
1219	2026-09-21 06:54	43.16	OK	1220	2026-09-21 06:55	45.05	OK
1221	2026-09-21 06:56	42.98	OK	1222	2026-09-21 06:57	44.23	OK
1223	2026-09-21 06:58	44.00	OK	1224	2026-09-21 06:59	43.94	OK
1225	2026-09-21 07:00	43.35	OK	1226	2026-09-21 07:01	43.33	OK
1227	2026-09-21 07:02	44.85	OK	1228	2026-09-21 07:03	44.75	OK
1229	2026-09-21 07:04	43.15	OK	1230	2026-09-21 07:05	43.58	OK
1231	2026-09-21 07:06	43.16	OK	1232	2026-09-21 07:07	44.28	OK
1233	2026-09-21 07:08	42.93	OK	1234	2026-09-21 07:09	42.85	OK
1235	2026-09-21 07:10	44.47	OK	1236	2026-09-21 07:11	43.66	OK
1237	2026-09-21 07:12	42.95	OK	1238	2026-09-21 07:13	44.59	OK
1239	2026-09-21 07:14	43.30	OK	1240	2026-09-21 07:15	44.27	OK
1241	2026-09-21 07:16	44.87	OK	1242	2026-09-21 07:17	44.50	OK
1243	2026-09-21 07:18	45.17	OK	1244	2026-09-21 07:19	43.17	OK
1245	2026-09-21 07:20	44.64	OK	1246	2026-09-21 07:21	44.67	OK
1247	2026-09-21 07:22	43.54	OK	1248	2026-09-21 07:23	43.20	OK
1249	2026-09-21 07:24	44.34	OK	1250	2026-09-21 07:25	43.12	OK
1251	2026-09-21 07:26	45.46	OK	1252	2026-09-21 07:27	43.32	OK
1253	2026-09-21 07:28	42.72	OK	1254	2026-09-21 07:29	43.46	OK
1255	2026-09-21 07:30	44.84	OK	1256	2026-09-21 07:31	45.26	OK
1257	2026-09-21 07:32	45.32	OK	1258	2026-09-21 07:33	42.84	OK
1259	2026-09-21 07:34	44.30	OK	1260	2026-09-21 07:35	45.05	OK
1261	2026-09-21 07:36	43.62	OK	1262	2026-09-21 07:37	43.60	OK
1263	2026-09-21 07:38	45.59	OK	1264	2026-09-21 07:39	44.91	OK
1265	2026-09-21 07:40	43.44	OK	1266	2026-09-21 07:41	43.96	OK
1267	2026-09-21 07:42	42.99	OK	1268	2026-09-21 07:43	43.71	OK
1269	2026-09-21 07:44	44.38	OK	1270	2026-09-21 07:45	43.70	OK
1271	2026-09-21 07:46	43.96	OK	1272	2026-09-21 07:47	44.55	OK
1273	2026-09-21 07:48	44.56	OK	1274	2026-09-21 07:49	43.65	OK
1275	2026-09-21 07:50	43.18	OK	1276	2026-09-21 07:51	44.16	OK
1277	2026-09-21 07:52	43.04	OK	1278	2026-09-21 07:53	43.81	OK
1279	2026-09-21 07:54	44.92	OK	1280	2026-09-21 07:55	43.83	OK
1281	2026-09-21 07:56	44.51	OK	1282	2026-09-21 07:57	45.21	OK
1283	2026-09-21 07:58	44.59	OK	1284	2026-09-21 07:59	43.59	OK
1285	2026-09-21 08:00	44.59	OK	1286	2026-09-21 08:01	44.93	OK
1287	2026-09-21 08:02	44.36	OK	1288	2026-09-21 08:03	43.07	OK
1289	2026-09-21 08:04	45.16	OK	1290	2026-09-21 08:05	44.20	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1291	2026-09-21 08:06	44.41	OK	1292	2026-09-21 08:07	44.88	OK
1293	2026-09-21 08:08	45.05	OK	1294	2026-09-21 08:09	45.90	OK
1295	2026-09-21 08:10	43.72	OK	1296	2026-09-21 08:11	44.39	OK
1297	2026-09-21 08:12	44.85	OK	1298	2026-09-21 08:13	43.29	OK
1299	2026-09-21 08:14	44.18	OK	1300	2026-09-21 08:15	44.26	OK
1301	2026-09-21 08:16	45.12	OK	1302	2026-09-21 08:17	44.82	OK
1303	2026-09-21 08:18	44.32	OK	1304	2026-09-21 08:19	44.50	OK
1305	2026-09-21 08:20	45.90	OK	1306	2026-09-21 08:21	44.99	OK
1307	2026-09-21 08:22	45.89	OK	1308	2026-09-21 08:23	43.21	OK
1309	2026-09-21 08:24	45.50	OK	1310	2026-09-21 08:25	44.99	OK
1311	2026-09-21 08:26	44.10	OK	1312	2026-09-21 08:27	45.24	OK
1313	2026-09-21 08:28	43.78	OK	1314	2026-09-21 08:29	44.52	OK
1315	2026-09-21 08:30	45.55	OK	1316	2026-09-21 08:31	44.00	OK
1317	2026-09-21 08:32	44.53	OK	1318	2026-09-21 08:33	44.58	OK
1319	2026-09-21 08:34	44.86	OK	1320	2026-09-21 08:35	44.25	OK
1321	2026-09-21 08:36	43.64	OK	1322	2026-09-21 08:37	45.31	OK
1323	2026-09-21 08:38	44.66	OK	1324	2026-09-21 08:39	45.28	OK
1325	2026-09-21 08:40	44.25	OK	1326	2026-09-21 08:41	46.39	OK
1327	2026-09-21 08:42	45.06	OK	1328	2026-09-21 08:43	45.29	OK
1329	2026-09-21 08:44	45.23	OK	1330	2026-09-21 08:45	44.25	OK
1331	2026-09-21 08:46	44.19	OK	1332	2026-09-21 08:47	46.09	OK
1333	2026-09-21 08:48	44.97	OK	1334	2026-09-21 08:49	45.36	OK
1335	2026-09-21 08:50	44.69	OK	1336	2026-09-21 08:51	45.26	OK
1337	2026-09-21 08:52	45.04	OK	1338	2026-09-21 08:53	44.15	OK
1339	2026-09-21 08:54	44.91	OK	1340	2026-09-21 08:55	45.61	OK
1341	2026-09-21 08:56	46.49	OK	1342	2026-09-21 08:57	45.01	OK
1343	2026-09-21 08:58	44.62	OK	1344	2026-09-21 08:59	45.61	OK
1345	2026-09-21 09:00	44.36	OK	1346	2026-09-21 09:01	45.54	OK
1347	2026-09-21 09:02	44.80	OK	1348	2026-09-21 09:03	45.53	OK
1349	2026-09-21 09:04	45.00	OK	1350	2026-09-21 09:05	45.00	OK
1351	2026-09-21 09:06	44.42	OK	1352	2026-09-21 09:07	46.99	OK
1353	2026-09-21 09:08	45.38	OK	1354	2026-09-21 09:09	46.31	OK
1355	2026-09-21 09:10	44.81	OK	1356	2026-09-21 09:11	45.93	OK
1357	2026-09-21 09:12	44.21	OK	1358	2026-09-21 09:13	44.26	OK
1359	2026-09-21 09:14	47.17	OK	1360	2026-09-21 09:15	44.98	OK
1361	2026-09-21 09:16	45.34	OK	1362	2026-09-21 09:17	45.30	OK
1363	2026-09-21 09:18	46.18	OK	1364	2026-09-21 09:19	45.09	OK
1365	2026-09-21 09:20	46.37	OK	1366	2026-09-21 09:21	45.60	OK
1367	2026-09-21 09:22	45.66	OK	1368	2026-09-21 09:23	46.02	OK
1369	2026-09-21 09:24	47.07	OK	1370	2026-09-21 09:25	45.25	OK
1371	2026-09-21 09:26	46.11	OK	1372	2026-09-21 09:27	45.86	OK
1373	2026-09-21 09:28	44.86	OK	1374	2026-09-21 09:29	46.39	OK
1375	2026-09-21 09:30	46.59	OK	1376	2026-09-21 09:31	45.98	OK
1377	2026-09-21 09:32	46.36	OK	1378	2026-09-21 09:33	45.46	OK
1379	2026-09-21 09:34	46.58	OK	1380	2026-09-21 09:35	45.59	OK
1381	2026-09-21 09:36	46.62	OK	1382	2026-09-21 09:37	46.17	OK
1383	2026-09-21 09:38	46.23	OK	1384	2026-09-21 09:39	46.77	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1385	2026-09-21 09:40	46.05	OK	1386	2026-09-21 09:41	44.23	OK
1387	2026-09-21 09:42	47.02	OK	1388	2026-09-21 09:43	45.69	OK
1389	2026-09-21 09:44	44.74	OK	1390	2026-09-21 09:45	46.90	OK
1391	2026-09-21 09:46	45.41	OK	1392	2026-09-21 09:47	45.85	OK
1393	2026-09-21 09:48	45.59	OK	1394	2026-09-21 09:49	46.01	OK
1395	2026-09-21 09:50	46.25	OK	1396	2026-09-21 09:51	46.18	OK
1397	2026-09-21 09:52	46.36	OK	1398	2026-09-21 09:53	45.96	OK
1399	2026-09-21 09:54	46.16	OK	1400	2026-09-21 09:55	45.90	OK
1401	2026-09-21 09:56	45.39	OK	1402	2026-09-21 09:57	46.66	OK
1403	2026-09-21 09:58	47.07	OK	1404	2026-09-21 09:59	45.91	OK
1405	2026-09-21 10:00	47.03	OK	1406	2026-09-21 10:01	46.60	OK
1407	2026-09-21 10:02	46.44	OK	1408	2026-09-21 10:03	46.10	OK
1409	2026-09-21 10:04	46.27	OK	1410	2026-09-21 10:05	45.94	OK
1411	2026-09-21 10:06	46.13	OK	1412	2026-09-21 10:07	46.88	OK
1413	2026-09-21 10:08	47.32	OK	1414	2026-09-21 10:09	47.03	OK
1415	2026-09-21 10:10	46.04	OK	1416	2026-09-21 10:11	47.12	OK
1417	2026-09-21 10:12	46.84	OK	1418	2026-09-21 10:13	45.38	OK
1419	2026-09-21 10:14	46.60	OK	1420	2026-09-21 10:15	46.77	OK
1421	2026-09-21 10:16	46.21	OK	1422	2026-09-21 10:17	47.41	OK
1423	2026-09-21 10:18	46.95	OK	1424	2026-09-21 10:19	46.30	OK
1425	2026-09-21 10:20	46.89	OK	1426	2026-09-21 10:21	47.71	OK
1427	2026-09-21 10:22	46.61	OK	1428	2026-09-21 10:23	47.06	OK
1429	2026-09-21 10:24	47.49	OK	1430	2026-09-21 10:25	48.06	OK
1431	2026-09-21 10:26	45.79	OK	1432	2026-09-21 10:27	47.28	OK
1433	2026-09-21 10:28	46.97	OK	1434	2026-09-21 10:29	47.46	OK
1435	2026-09-21 10:30	46.93	OK	1436	2026-09-21 10:31	45.26	OK
1437	2026-09-21 10:32	48.20	OK	1438	2026-09-21 10:33	47.27	OK
1439	2026-09-21 10:34	47.05	OK	1440	2026-09-21 10:35	47.70	OK
1441	2026-09-21 10:36	48.15	OK	1442	2026-09-21 10:37	47.24	OK
1443	2026-09-21 10:38	46.91	OK	1444	2026-09-21 10:39	46.94	OK
1445	2026-09-21 10:40	48.26	OK	1446	2026-09-21 10:41	46.54	OK
1447	2026-09-21 10:42	47.08	OK	1448	2026-09-21 10:43	46.20	OK
1449	2026-09-21 10:44	49.12	OK	1450	2026-09-21 10:45	46.99	OK
1451	2026-09-21 10:46	46.36	OK	1452	2026-09-21 10:47	47.86	OK
1453	2026-09-21 10:48	48.17	OK	1454	2026-09-21 10:49	45.82	OK
1455	2026-09-21 10:50	47.79	OK	1456	2026-09-21 10:51	46.88	OK
1457	2026-09-21 10:52	47.69	OK	1458	2026-09-21 10:53	47.66	OK
1459	2026-09-21 10:54	47.54	OK	1460	2026-09-21 10:55	47.27	OK
1461	2026-09-21 10:56	47.19	OK	1462	2026-09-21 10:57	48.43	OK
1463	2026-09-21 10:58	49.27	OK	1464	2026-09-21 10:59	48.02	OK
1465	2026-09-21 11:00	46.29	OK	1466	2026-09-21 11:01	46.80	OK
1467	2026-09-21 11:02	48.56	OK	1468	2026-09-21 11:03	47.46	OK
1469	2026-09-21 11:04	47.57	OK	1470	2026-09-21 11:05	46.69	OK
1471	2026-09-21 11:06	47.71	OK	1472	2026-09-21 11:07	47.74	OK
1473	2026-09-21 11:08	46.60	OK	1474	2026-09-21 11:09	46.11	OK
1475	2026-09-21 11:10	47.52	OK	1476	2026-09-21 11:11	48.82	OK
1477	2026-09-21 11:12	47.55	OK	1478	2026-09-21 11:13	47.47	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1479	2026-09-21 11:14	47.63	OK	1480	2026-09-21 11:15	47.84	OK
1481	2026-09-21 11:16	48.62	OK	1482	2026-09-21 11:17	47.58	OK
1483	2026-09-21 11:18	49.08	OK	1484	2026-09-21 11:19	47.67	OK
1485	2026-09-21 11:20	47.51	OK	1486	2026-09-21 11:21	48.84	OK
1487	2026-09-21 11:22	47.89	OK	1488	2026-09-21 11:23	47.31	OK
1489	2026-09-21 11:24	47.91	OK	1490	2026-09-21 11:25	48.61	OK
1491	2026-09-21 11:26	48.80	OK	1492	2026-09-21 11:27	48.75	OK
1493	2026-09-21 11:28	48.51	OK	1494	2026-09-21 11:29	47.21	OK
1495	2026-09-21 11:30	49.44	OK	1496	2026-09-21 11:31	48.61	OK
1497	2026-09-21 11:32	48.50	OK	1498	2026-09-21 11:33	46.87	OK
1499	2026-09-21 11:34	47.78	OK	1500	2026-09-21 11:35	47.07	OK
1501	2026-09-21 11:36	48.13	OK	1502	2026-09-21 11:37	48.02	OK
1503	2026-09-21 11:38	48.09	OK	1504	2026-09-21 11:39	48.76	OK
1505	2026-09-21 11:40	49.05	OK	1506	2026-09-21 11:41	49.10	OK
1507	2026-09-21 11:42	48.22	OK	1508	2026-09-21 11:43	49.33	OK
1509	2026-09-21 11:44	47.54	OK	1510	2026-09-21 11:45	49.33	OK
1511	2026-09-21 11:46	49.14	OK	1512	2026-09-21 11:47	49.82	OK
1513	2026-09-21 11:48	49.12	OK	1514	2026-09-21 11:49	48.19	OK
1515	2026-09-21 11:50	48.66	OK	1516	2026-09-21 11:51	48.70	OK
1517	2026-09-21 11:52	47.59	OK	1518	2026-09-21 11:53	47.49	OK
1519	2026-09-21 11:54	47.52	OK	1520	2026-09-21 11:55	48.45	OK
1521	2026-09-21 11:56	49.03	OK	1522	2026-09-21 11:57	47.67	OK
1523	2026-09-21 11:58	48.92	OK	1524	2026-09-21 11:59	49.40	OK
1525	2026-09-21 12:00	48.66	OK	1526	2026-09-21 12:01	49.53	OK
1527	2026-09-21 12:02	48.20	OK	1528	2026-09-21 12:03	49.03	OK
1529	2026-09-21 12:04	48.48	OK	1530	2026-09-21 12:05	49.43	OK
1531	2026-09-21 12:06	49.92	OK	1532	2026-09-21 12:07	48.43	OK
1533	2026-09-21 12:08	49.31	OK	1534	2026-09-21 12:09	49.16	OK
1535	2026-09-21 12:10	48.61	OK	1536	2026-09-21 12:11	49.24	OK
1537	2026-09-21 12:12	48.10	OK	1538	2026-09-21 12:13	49.24	OK
1539	2026-09-21 12:14	48.18	OK	1540	2026-09-21 12:15	47.77	OK
1541	2026-09-21 12:16	50.49	OK	1542	2026-09-21 12:17	49.22	OK
1543	2026-09-21 12:18	49.27	OK	1544	2026-09-21 12:19	49.03	OK
1545	2026-09-21 12:20	48.48	OK	1546	2026-09-21 12:21	49.59	OK
1547	2026-09-21 12:22	47.91	OK	1548	2026-09-21 12:23	50.09	OK
1549	2026-09-21 12:24	49.84	OK	1550	2026-09-21 12:25	49.39	OK
1551	2026-09-21 12:26	49.49	OK	1552	2026-09-21 12:27	48.78	OK
1553	2026-09-21 12:28	49.80	OK	1554	2026-09-21 12:29	49.16	OK
1555	2026-09-21 12:30	49.73	OK	1556	2026-09-21 12:31	49.47	OK
1557	2026-09-21 12:32	49.67	OK	1558	2026-09-21 12:33	49.49	OK
1559	2026-09-21 12:34	49.38	OK	1560	2026-09-21 12:35	49.80	OK
1561	2026-09-21 12:36	49.74	OK	1562	2026-09-21 12:37	50.85	OK
1563	2026-09-21 12:38	49.48	OK	1564	2026-09-21 12:39	48.89	OK
1565	2026-09-21 12:40	50.19	OK	1566	2026-09-21 12:41	49.71	OK
1567	2026-09-21 12:42	49.59	OK	1568	2026-09-21 12:43	50.49	OK
1569	2026-09-21 12:44	49.96	OK	1570	2026-09-21 12:45	49.74	OK
1571	2026-09-21 12:46	50.42	OK	1572	2026-09-21 12:47	49.64	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1573	2026-09-21 12:48	50.24	OK	1574	2026-09-21 12:49	50.00	OK
1575	2026-09-21 12:50	49.30	OK	1576	2026-09-21 12:51	50.07	OK
1577	2026-09-21 12:52	48.73	OK	1578	2026-09-21 12:53	49.26	OK
1579	2026-09-21 12:54	49.57	OK	1580	2026-09-21 12:55	50.73	OK
1581	2026-09-21 12:56	50.88	OK	1582	2026-09-21 12:57	49.69	OK
1583	2026-09-21 12:58	49.33	OK	1584	2026-09-21 12:59	50.83	OK
1585	2026-09-21 13:00	49.97	OK	1586	2026-09-21 13:01	48.96	OK
1587	2026-09-21 13:02	49.79	OK	1588	2026-09-21 13:03	50.79	OK
1589	2026-09-21 13:04	51.01	OK	1590	2026-09-21 13:05	49.36	OK
1591	2026-09-21 13:06	48.72	OK	1592	2026-09-21 13:07	50.52	OK
1593	2026-09-21 13:08	49.73	OK	1594	2026-09-21 13:09	50.91	OK
1595	2026-09-21 13:10	51.11	OK	1596	2026-09-21 13:11	49.57	OK
1597	2026-09-21 13:12	50.43	OK	1598	2026-09-21 13:13	51.91	OK
1599	2026-09-21 13:14	49.13	OK	1600	2026-09-21 13:15	48.76	OK
1601	2026-09-21 13:16	49.67	OK	1602	2026-09-21 13:17	51.20	OK
1603	2026-09-21 13:18	51.03	OK	1604	2026-09-21 13:19	50.38	OK
1605	2026-09-21 13:20	50.20	OK	1606	2026-09-21 13:21	49.48	OK
1607	2026-09-21 13:22	49.13	OK	1608	2026-09-21 13:23	49.44	OK
1609	2026-09-21 13:24	50.19	OK	1610	2026-09-21 13:25	50.85	OK
1611	2026-09-21 13:26	50.15	OK	1612	2026-09-21 13:27	49.74	OK
1613	2026-09-21 13:28	50.77	OK	1614	2026-09-21 13:29	50.40	OK
1615	2026-09-21 13:30	50.41	OK	1616	2026-09-21 13:31	51.28	OK
1617	2026-09-21 13:32	49.73	OK	1618	2026-09-21 13:33	50.64	OK
1619	2026-09-21 13:34	52.19	OK	1620	2026-09-21 13:35	50.94	OK
1621	2026-09-21 13:36	50.50	OK	1622	2026-09-21 13:37	49.85	OK
1623	2026-09-21 13:38	50.36	OK	1624	2026-09-21 13:39	50.43	OK
1625	2026-09-21 13:40	51.28	OK	1626	2026-09-21 13:41	52.66	OK
1627	2026-09-21 13:42	51.53	OK	1628	2026-09-21 13:43	50.45	OK
1629	2026-09-21 13:44	50.77	OK	1630	2026-09-21 13:45	51.13	OK
1631	2026-09-21 13:46	51.83	OK	1632	2026-09-21 13:47	50.44	OK
1633	2026-09-21 13:48	50.81	OK	1634	2026-09-21 13:49	50.85	OK
1635	2026-09-21 13:50	52.02	OK	1636	2026-09-21 13:51	51.66	OK
1637	2026-09-21 13:52	50.88	OK	1638	2026-09-21 13:53	50.22	OK
1639	2026-09-21 13:54	51.64	OK	1640	2026-09-21 13:55	51.94	OK
1641	2026-09-21 13:56	50.92	OK	1642	2026-09-21 13:57	49.39	OK
1643	2026-09-21 13:58	51.07	OK	1644	2026-09-21 13:59	50.51	OK
1645	2026-09-21 14:00	49.99	OK	1646	2026-09-21 14:01	50.96	OK
1647	2026-09-21 14:02	52.66	OK	1648	2026-09-21 14:03	50.77	OK
1649	2026-09-21 14:04	51.05	OK	1650	2026-09-21 14:05	51.03	OK
1651	2026-09-21 14:06	52.08	OK	1652	2026-09-21 14:07	51.65	OK
1653	2026-09-21 14:08	51.13	OK	1654	2026-09-21 14:09	50.72	OK
1655	2026-09-21 14:10	51.24	OK	1656	2026-09-21 14:11	50.53	OK
1657	2026-09-21 14:12	51.87	OK	1658	2026-09-21 14:13	52.23	OK
1659	2026-09-21 14:14	51.56	OK	1660	2026-09-21 14:15	51.46	OK
1661	2026-09-21 14:16	50.77	OK	1662	2026-09-21 14:17	52.01	OK
1663	2026-09-21 14:18	51.67	OK	1664	2026-09-21 14:19	51.29	OK
1665	2026-09-21 14:20	50.81	OK	1666	2026-09-21 14:21	52.45	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1667	2026-09-21 14:22	51.74	OK	1668	2026-09-21 14:23	50.60	OK
1669	2026-09-21 14:24	52.91	OK	1670	2026-09-21 14:25	51.41	OK
1671	2026-09-21 14:26	52.05	OK	1672	2026-09-21 14:27	52.03	OK
1673	2026-09-21 14:28	51.14	OK	1674	2026-09-21 14:29	52.12	OK
1675	2026-09-21 14:30	50.88	OK	1676	2026-09-21 14:31	52.55	OK
1677	2026-09-21 14:32	52.00	OK	1678	2026-09-21 14:33	51.80	OK
1679	2026-09-21 14:34	52.87	OK	1680	2026-09-21 14:35	52.08	OK
1681	2026-09-21 14:36	51.00	OK	1682	2026-09-21 14:37	53.15	OK
1683	2026-09-21 14:38	52.11	OK	1684	2026-09-21 14:39	51.09	OK
1685	2026-09-21 14:40	50.36	OK	1686	2026-09-21 14:41	52.17	OK
1687	2026-09-21 14:42	52.00	OK	1688	2026-09-21 14:43	51.98	OK
1689	2026-09-21 14:44	52.20	OK	1690	2026-09-21 14:45	52.19	OK
1691	2026-09-21 14:46	52.92	OK	1692	2026-09-21 14:47	53.07	OK
1693	2026-09-21 14:48	52.67	OK	1694	2026-09-21 14:49	52.79	OK
1695	2026-09-21 14:50	51.94	OK	1696	2026-09-21 14:51	51.30	OK
1697	2026-09-21 14:52	51.53	OK	1698	2026-09-21 14:53	52.86	OK
1699	2026-09-21 14:54	52.54	OK	1700	2026-09-21 14:55	51.33	OK
1701	2026-09-21 14:56	53.35	OK	1702	2026-09-21 14:57	52.57	OK
1703	2026-09-21 14:58	52.99	OK	1704	2026-09-21 14:59	53.17	OK
1705	2026-09-21 15:00	52.30	OK	1706	2026-09-21 15:01	52.78	OK
1707	2026-09-21 15:02	51.44	OK	1708	2026-09-21 15:03	52.31	OK
1709	2026-09-21 15:04	51.71	OK	1710	2026-09-21 15:05	51.66	OK
1711	2026-09-21 15:06	52.56	OK	1712	2026-09-21 15:07	51.60	OK
1713	2026-09-21 15:08	51.80	OK	1714	2026-09-21 15:09	52.73	OK
1715	2026-09-21 15:10	53.51	OK	1716	2026-09-21 15:11	52.15	OK
1717	2026-09-21 15:12	50.75	OK	1718	2026-09-21 15:13	51.05	OK
1719	2026-09-21 15:14	52.28	OK	1720	2026-09-21 15:15	53.24	OK
1721	2026-09-21 15:16	53.31	OK	1722	2026-09-21 15:17	52.51	OK
1723	2026-09-21 15:18	52.81	OK	1724	2026-09-21 15:19	52.44	OK
1725	2026-09-21 15:20	52.91	OK	1726	2026-09-21 15:21	53.38	OK
1727	2026-09-21 15:22	52.39	OK	1728	2026-09-21 15:23	53.39	OK
1729	2026-09-21 15:24	51.02	OK	1730	2026-09-21 15:25	52.41	OK
1731	2026-09-21 15:26	51.02	OK	1732	2026-09-21 15:27	50.91	OK
1733	2026-09-21 15:28	52.96	OK	1734	2026-09-21 15:29	51.93	OK
1735	2026-09-21 15:30	53.80	OK	1736	2026-09-21 15:31	53.50	OK
1737	2026-09-21 15:32	52.70	OK	1738	2026-09-21 15:33	51.92	OK
1739	2026-09-21 15:34	50.90	OK	1740	2026-09-21 15:35	53.44	OK
1741	2026-09-21 15:36	52.86	OK	1742	2026-09-21 15:37	52.55	OK
1743	2026-09-21 15:38	53.77	OK	1744	2026-09-21 15:39	53.53	OK
1745	2026-09-21 15:40	53.18	OK	1746	2026-09-21 15:41	53.08	OK
1747	2026-09-21 15:42	52.09	OK	1748	2026-09-21 15:43	53.36	OK
1749	2026-09-21 15:44	53.03	OK	1750	2026-09-21 15:45	51.96	OK
1751	2026-09-21 15:46	52.35	OK	1752	2026-09-21 15:47	53.03	OK
1753	2026-09-21 15:48	52.52	OK	1754	2026-09-21 15:49	52.27	OK
1755	2026-09-21 15:50	52.22	OK	1756	2026-09-21 15:51	52.56	OK
1757	2026-09-21 15:52	52.28	OK	1758	2026-09-21 15:53	51.91	OK
1759	2026-09-21 15:54	52.96	OK	1760	2026-09-21 15:55	52.60	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1761	2026-09-21 15:56	52.59	OK	1762	2026-09-21 15:57	53.37	OK
1763	2026-09-21 15:58	52.53	OK	1764	2026-09-21 15:59	53.32	OK
1765	2026-09-21 16:00	53.37	OK	1766	2026-09-21 16:01	52.22	OK
1767	2026-09-21 16:02	52.68	OK	1768	2026-09-21 16:03	51.28	OK
1769	2026-09-21 16:04	52.63	OK	1770	2026-09-21 16:05	52.98	OK
1771	2026-09-21 16:06	52.47	OK	1772	2026-09-21 16:07	52.74	OK
1773	2026-09-21 16:08	53.21	OK	1774	2026-09-21 16:09	51.02	OK
1775	2026-09-21 16:10	53.04	OK	1776	2026-09-21 16:11	54.39	OK
1777	2026-09-21 16:12	53.05	OK	1778	2026-09-21 16:13	52.19	OK
1779	2026-09-21 16:14	53.14	OK	1780	2026-09-21 16:15	52.94	OK
1781	2026-09-21 16:16	54.06	OK	1782	2026-09-21 16:17	52.97	OK
1783	2026-09-21 16:18	52.99	OK	1784	2026-09-21 16:19	53.28	OK
1785	2026-09-21 16:20	52.45	OK	1786	2026-09-21 16:21	53.11	OK
1787	2026-09-21 16:22	53.12	OK	1788	2026-09-21 16:23	52.32	OK
1789	2026-09-21 16:24	53.18	OK	1790	2026-09-21 16:25	51.45	OK
1791	2026-09-21 16:26	51.72	OK	1792	2026-09-21 16:27	52.89	OK
1793	2026-09-21 16:28	52.31	OK	1794	2026-09-21 16:29	53.97	OK
1795	2026-09-21 16:30	52.53	OK	1796	2026-09-21 16:31	52.65	OK
1797	2026-09-21 16:32	54.89	OK	1798	2026-09-21 16:33	51.71	OK
1799	2026-09-21 16:34	53.22	OK	1800	2026-09-21 16:35	54.23	OK
1801	2026-09-21 16:36	53.10	OK	1802	2026-09-21 16:37	54.04	OK
1803	2026-09-21 16:38	53.26	OK	1804	2026-09-21 16:39	52.15	OK
1805	2026-09-21 16:40	53.22	OK	1806	2026-09-21 16:41	52.72	OK
1807	2026-09-21 16:42	54.08	OK	1808	2026-09-21 16:43	51.82	OK
1809	2026-09-21 16:44	51.92	OK	1810	2026-09-21 16:45	54.06	OK
1811	2026-09-21 16:46	54.30	OK	1812	2026-09-21 16:47	52.89	OK
1813	2026-09-21 16:48	52.10	OK	1814	2026-09-21 16:49	53.55	OK
1815	2026-09-21 16:50	53.91	OK	1816	2026-09-21 16:51	52.66	OK
1817	2026-09-21 16:52	53.04	OK	1818	2026-09-21 16:53	52.44	OK
1819	2026-09-21 16:54	53.56	OK	1820	2026-09-21 16:55	53.33	OK
1821	2026-09-21 16:56	52.44	OK	1822	2026-09-21 16:57	54.13	OK
1823	2026-09-21 16:58	53.90	OK	1824	2026-09-21 16:59	52.91	OK
1825	2026-09-21 17:00	53.90	OK	1826	2026-09-21 17:01	53.45	OK
1827	2026-09-21 17:02	52.47	OK	1828	2026-09-21 17:03	53.35	OK
1829	2026-09-21 17:04	53.58	OK	1830	2026-09-21 17:05	53.14	OK
1831	2026-09-21 17:06	52.82	OK	1832	2026-09-21 17:07	53.21	OK
1833	2026-09-21 17:08	53.23	OK	1834	2026-09-21 17:09	52.41	OK
1835	2026-09-21 17:10	53.29	OK	1836	2026-09-21 17:11	53.13	OK
1837	2026-09-21 17:12	52.55	OK	1838	2026-09-21 17:13	54.01	OK
1839	2026-09-21 17:14	53.29	OK	1840	2026-09-21 17:15	52.68	OK
1841	2026-09-21 17:16	52.87	OK	1842	2026-09-21 17:17	52.49	OK
1843	2026-09-21 17:18	53.70	OK	1844	2026-09-21 17:19	54.84	OK
1845	2026-09-21 17:20	52.43	OK	1846	2026-09-21 17:21	53.77	OK
1847	2026-09-21 17:22	52.53	OK	1848	2026-09-21 17:23	52.51	OK
1849	2026-09-21 17:24	53.70	OK	1850	2026-09-21 17:25	52.79	OK
1851	2026-09-21 17:26	52.57	OK	1852	2026-09-21 17:27	53.07	OK
1853	2026-09-21 17:28	53.72	OK	1854	2026-09-21 17:29	53.24	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1855	2026-09-21 17:30	52.87	OK	1856	2026-09-21 17:31	54.70	OK
1857	2026-09-21 17:32	53.92	OK	1858	2026-09-21 17:33	53.02	OK
1859	2026-09-21 17:34	52.87	OK	1860	2026-09-21 17:35	53.72	OK
1861	2026-09-21 17:36	53.84	OK	1862	2026-09-21 17:37	52.81	OK
1863	2026-09-21 17:38	53.24	OK	1864	2026-09-21 17:39	52.21	OK
1865	2026-09-21 17:40	52.78	OK	1866	2026-09-21 17:41	53.38	OK
1867	2026-09-21 17:42	53.22	OK	1868	2026-09-21 17:43	53.56	OK
1869	2026-09-21 17:44	54.21	OK	1870	2026-09-21 17:45	53.65	OK
1871	2026-09-21 17:46	52.90	OK	1872	2026-09-21 17:47	53.67	OK
1873	2026-09-21 17:48	54.23	OK	1874	2026-09-21 17:49	52.66	OK
1875	2026-09-21 17:50	52.86	OK	1876	2026-09-21 17:51	51.52	OK
1877	2026-09-21 17:52	52.08	OK	1878	2026-09-21 17:53	52.34	OK
1879	2026-09-21 17:54	54.25	OK	1880	2026-09-21 17:55	53.85	OK
1881	2026-09-21 17:56	52.15	OK	1882	2026-09-21 17:57	53.65	OK
1883	2026-09-21 17:58	52.06	OK	1884	2026-09-21 17:59	53.56	OK
1885	2026-09-21 18:00	53.39	OK	1886	2026-09-21 18:01	53.18	OK
1887	2026-09-21 18:02	52.59	OK	1888	2026-09-21 18:03	54.00	OK
1889	2026-09-21 18:04	52.99	OK	1890	2026-09-21 18:05	53.26	OK
1891	2026-09-21 18:06	54.12	OK	1892	2026-09-21 18:07	54.47	OK
1893	2026-09-21 18:08	51.75	OK	1894	2026-09-21 18:09	53.63	OK
1895	2026-09-21 18:10	53.92	OK	1896	2026-09-21 18:11	53.95	OK
1897	2026-09-21 18:12	52.72	OK	1898	2026-09-21 18:13	53.08	OK
1899	2026-09-21 18:14	52.32	OK	1900	2026-09-21 18:15	52.38	OK
1901	2026-09-21 18:16	52.57	OK	1902	2026-09-21 18:17	53.22	OK
1903	2026-09-21 18:18	53.63	OK	1904	2026-09-21 18:19	53.14	OK
1905	2026-09-21 18:20	52.72	OK	1906	2026-09-21 18:21	53.38	OK
1907	2026-09-21 18:22	53.84	OK	1908	2026-09-21 18:23	52.68	OK
1909	2026-09-21 18:24	53.73	OK	1910	2026-09-21 18:25	52.98	OK
1911	2026-09-21 18:26	53.19	OK	1912	2026-09-21 18:27	51.89	OK
1913	2026-09-21 18:28	54.34	OK	1914	2026-09-21 18:29	53.39	OK
1915	2026-09-21 18:30	52.65	OK	1916	2026-09-21 18:31	52.70	OK
1917	2026-09-21 18:32	52.63	OK	1918	2026-09-21 18:33	53.61	OK
1919	2026-09-21 18:34	53.20	OK	1920	2026-09-21 18:35	52.21	OK
1921	2026-09-21 18:36	53.30	OK	1922	2026-09-21 18:37	54.33	OK
1923	2026-09-21 18:38	53.24	OK	1924	2026-09-21 18:39	53.41	OK
1925	2026-09-21 18:40	51.97	OK	1926	2026-09-21 18:41	52.20	OK
1927	2026-09-21 18:42	52.94	OK	1928	2026-09-21 18:43	51.50	OK
1929	2026-09-21 18:44	52.61	OK	1930	2026-09-21 18:45	52.49	OK
1931	2026-09-21 18:46	53.96	OK	1932	2026-09-21 18:47	54.69	OK
1933	2026-09-21 18:48	52.38	OK	1934	2026-09-21 18:49	52.39	OK
1935	2026-09-21 18:50	54.02	OK	1936	2026-09-21 18:51	52.31	OK
1937	2026-09-21 18:52	53.74	OK	1938	2026-09-21 18:53	52.87	OK
1939	2026-09-21 18:54	53.52	OK	1940	2026-09-21 18:55	52.96	OK
1941	2026-09-21 18:56	52.76	OK	1942	2026-09-21 18:57	52.56	OK
1943	2026-09-21 18:58	54.24	OK	1944	2026-09-21 18:59	53.28	OK
1945	2026-09-21 19:00	52.30	OK	1946	2026-09-21 19:01	52.84	OK
1947	2026-09-21 19:02	53.70	OK	1948	2026-09-21 19:03	53.62	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1949	2026-09-21 19:04	52.62	OK	1950	2026-09-21 19:05	53.60	OK
1951	2026-09-21 19:06	52.88	OK	1952	2026-09-21 19:07	52.97	OK
1953	2026-09-21 19:08	52.96	OK	1954	2026-09-21 19:09	51.98	OK
1955	2026-09-21 19:10	51.85	OK	1956	2026-09-21 19:11	51.70	OK
1957	2026-09-21 19:12	52.50	OK	1958	2026-09-21 19:13	52.42	OK
1959	2026-09-21 19:14	51.64	OK	1960	2026-09-21 19:15	52.16	OK
1961	2026-09-21 19:16	52.19	OK	1962	2026-09-21 19:17	52.57	OK
1963	2026-09-21 19:18	52.23	OK	1964	2026-09-21 19:19	52.26	OK
1965	2026-09-21 19:20	54.36	OK	1966	2026-09-21 19:21	51.88	OK
1967	2026-09-21 19:22	52.68	OK	1968	2026-09-21 19:23	53.92	OK
1969	2026-09-21 19:24	52.73	OK	1970	2026-09-21 19:25	52.27	OK
1971	2026-09-21 19:26	51.31	OK	1972	2026-09-21 19:27	52.29	OK
1973	2026-09-21 19:28	52.43	OK	1974	2026-09-21 19:29	52.50	OK
1975	2026-09-21 19:30	53.13	OK	1976	2026-09-21 19:31	51.91	OK
1977	2026-09-21 19:32	52.59	OK	1978	2026-09-21 19:33	50.95	OK
1979	2026-09-21 19:34	52.05	OK	1980	2026-09-21 19:35	52.37	OK
1981	2026-09-21 19:36	52.35	OK	1982	2026-09-21 19:37	52.05	OK
1983	2026-09-21 19:38	53.02	OK	1984	2026-09-21 19:39	53.50	OK
1985	2026-09-21 19:40	53.45	OK	1986	2026-09-21 19:41	52.11	OK
1987	2026-09-21 19:42	51.87	OK	1988	2026-09-21 19:43	50.92	OK
1989	2026-09-21 19:44	52.22	OK	1990	2026-09-21 19:45	52.39	OK
1991	2026-09-21 19:46	52.54	OK	1992	2026-09-21 19:47	51.59	OK
1993	2026-09-21 19:48	52.82	OK	1994	2026-09-21 19:49	52.20	OK
1995	2026-09-21 19:50	52.91	OK	1996	2026-09-21 19:51	53.69	OK
1997	2026-09-21 19:52	53.10	OK	1998	2026-09-21 19:53	52.92	OK
1999	2026-09-21 19:54	51.73	OK	2000	2026-09-21 19:55	53.08	OK
2001	2026-09-21 19:56	52.74	OK	2002	2026-09-21 19:57	51.86	OK
2003	2026-09-21 19:58	51.28	OK	2004	2026-09-21 19:59	52.46	OK
2005	2026-09-21 20:00	52.63	OK	2006	2026-09-21 20:01	51.65	OK
2007	2026-09-21 20:02	52.83	OK	2008	2026-09-21 20:03	51.01	OK
2009	2026-09-21 20:04	52.34	OK	2010	2026-09-21 20:05	52.26	OK
2011	2026-09-21 20:06	52.55	OK	2012	2026-09-21 20:07	52.02	OK
2013	2026-09-21 20:08	51.96	OK	2014	2026-09-21 20:09	51.91	OK
2015	2026-09-21 20:10	52.83	OK	2016	2026-09-21 20:11	51.96	OK
2017	2026-09-21 20:12	50.85	OK	2018	2026-09-21 20:13	51.90	OK
2019	2026-09-21 20:14	53.13	OK	2020	2026-09-21 20:15	53.43	OK
2021	2026-09-21 20:16	52.49	OK	2022	2026-09-21 20:17	52.87	OK
2023	2026-09-21 20:18	53.71	OK	2024	2026-09-21 20:19	51.78	OK
2025	2026-09-21 20:20	52.98	OK	2026	2026-09-21 20:21	53.06	OK
2027	2026-09-21 20:22	52.12	OK	2028	2026-09-21 20:23	52.11	OK
2029	2026-09-21 20:24	52.32	OK	2030	2026-09-21 20:25	52.70	OK
2031	2026-09-21 20:26	51.84	OK	2032	2026-09-21 20:27	53.96	OK
2033	2026-09-21 20:28	51.82	OK	2034	2026-09-21 20:29	51.93	OK
2035	2026-09-21 20:30	52.30	OK	2036	2026-09-21 20:31	52.73	OK
2037	2026-09-21 20:32	51.16	OK	2038	2026-09-21 20:33	51.36	OK
2039	2026-09-21 20:34	52.82	OK	2040	2026-09-21 20:35	52.01	OK
2041	2026-09-21 20:36	51.60	OK	2042	2026-09-21 20:37	51.15	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2043	2026-09-21 20:38	51.72	OK	2044	2026-09-21 20:39	51.71	OK
2045	2026-09-21 20:40	52.04	OK	2046	2026-09-21 20:41	52.91	OK
2047	2026-09-21 20:42	51.85	OK	2048	2026-09-21 20:43	52.69	OK
2049	2026-09-21 20:44	53.47	OK	2050	2026-09-21 20:45	52.36	OK
2051	2026-09-21 20:46	51.65	OK	2052	2026-09-21 20:47	52.34	OK
2053	2026-09-21 20:48	51.09	OK	2054	2026-09-21 20:49	53.03	OK
2055	2026-09-21 20:50	52.06	OK	2056	2026-09-21 20:51	51.87	OK
2057	2026-09-21 20:52	50.81	OK	2058	2026-09-21 20:53	50.43	OK
2059	2026-09-21 20:54	50.89	OK	2060	2026-09-21 20:55	51.09	OK
2061	2026-09-21 20:56	52.72	OK	2062	2026-09-21 20:57	50.62	OK
2063	2026-09-21 20:58	51.12	OK	2064	2026-09-21 20:59	51.41	OK
2065	2026-09-21 21:00	52.12	OK	2066	2026-09-21 21:01	53.03	OK
2067	2026-09-21 21:02	51.91	OK	2068	2026-09-21 21:03	51.25	OK
2069	2026-09-21 21:04	50.58	OK	2070	2026-09-21 21:05	51.35	OK
2071	2026-09-21 21:06	52.58	OK	2072	2026-09-21 21:07	51.21	OK
2073	2026-09-21 21:08	52.22	OK	2074	2026-09-21 21:09	52.42	OK
2075	2026-09-21 21:10	52.09	OK	2076	2026-09-21 21:11	50.70	OK
2077	2026-09-21 21:12	51.05	OK	2078	2026-09-21 21:13	50.63	OK
2079	2026-09-21 21:14	50.39	OK	2080	2026-09-21 21:15	49.73	OK
2081	2026-09-21 21:16	50.56	OK	2082	2026-09-21 21:17	51.88	OK
2083	2026-09-21 21:18	52.32	OK	2084	2026-09-21 21:19	50.71	OK
2085	2026-09-21 21:20	51.80	OK	2086	2026-09-21 21:21	51.11	OK
2087	2026-09-21 21:22	51.61	OK	2088	2026-09-21 21:23	51.54	OK
2089	2026-09-21 21:24	51.71	OK	2090	2026-09-21 21:25	51.16	OK
2091	2026-09-21 21:26	52.01	OK	2092	2026-09-21 21:27	50.86	OK
2093	2026-09-21 21:28	52.21	OK	2094	2026-09-21 21:29	50.83	OK
2095	2026-09-21 21:30	51.65	OK	2096	2026-09-21 21:31	51.29	OK
2097	2026-09-21 21:32	50.48	OK	2098	2026-09-21 21:33	51.43	OK
2099	2026-09-21 21:34	50.98	OK	2100	2026-09-21 21:35	51.61	OK
2101	2026-09-21 21:36	49.83	OK	2102	2026-09-21 21:37	50.60	OK
2103	2026-09-21 21:38	49.74	OK	2104	2026-09-21 21:39	50.73	OK
2105	2026-09-21 21:40	51.77	OK	2106	2026-09-21 21:41	50.64	OK
2107	2026-09-21 21:42	49.44	OK	2108	2026-09-21 21:43	51.81	OK
2109	2026-09-21 21:44	50.77	OK	2110	2026-09-21 21:45	50.10	OK
2111	2026-09-21 21:46	50.61	OK	2112	2026-09-21 21:47	51.86	OK
2113	2026-09-21 21:48	50.06	OK	2114	2026-09-21 21:49	52.63	OK
2115	2026-09-21 21:50	50.66	OK	2116	2026-09-21 21:51	49.95	OK
2117	2026-09-21 21:52	49.69	OK	2118	2026-09-21 21:53	50.98	OK
2119	2026-09-21 21:54	50.52	OK	2120	2026-09-21 21:55	50.84	OK
2121	2026-09-21 21:56	50.95	OK	2122	2026-09-21 21:57	50.29	OK
2123	2026-09-21 21:58	49.05	OK	2124	2026-09-21 21:59	49.90	OK
2125	2026-09-21 22:00	50.79	OK	2126	2026-09-21 22:01	49.80	OK
2127	2026-09-21 22:02	50.28	OK	2128	2026-09-21 22:03	50.62	OK
2129	2026-09-21 22:04	50.43	OK	2130	2026-09-21 22:05	49.87	OK
2131	2026-09-21 22:06	50.08	OK	2132	2026-09-21 22:07	50.27	OK
2133	2026-09-21 22:08	50.42	OK	2134	2026-09-21 22:09	49.30	OK
2135	2026-09-21 22:10	50.49	OK	2136	2026-09-21 22:11	48.96	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2137	2026-09-21 22:12	51.37	OK	2138	2026-09-21 22:13	48.62	OK
2139	2026-09-21 22:14	49.24	OK	2140	2026-09-21 22:15	50.29	OK
2141	2026-09-21 22:16	49.94	OK	2142	2026-09-21 22:17	51.61	OK
2143	2026-09-21 22:18	50.30	OK	2144	2026-09-21 22:19	49.01	OK
2145	2026-09-21 22:20	49.64	OK	2146	2026-09-21 22:21	50.23	OK
2147	2026-09-21 22:22	49.22	OK	2148	2026-09-21 22:23	50.73	OK
2149	2026-09-21 22:24	49.84	OK	2150	2026-09-21 22:25	49.84	OK
2151	2026-09-21 22:26	50.05	OK	2152	2026-09-21 22:27	49.43	OK
2153	2026-09-21 22:28	50.94	OK	2154	2026-09-21 22:29	50.45	OK
2155	2026-09-21 22:30	50.11	OK	2156	2026-09-21 22:31	49.22	OK
2157	2026-09-21 22:32	50.60	OK	2158	2026-09-21 22:33	48.67	OK
2159	2026-09-21 22:34	49.64	OK	2160	2026-09-21 22:35	49.73	OK
2161	2026-09-21 22:36	49.25	OK	2162	2026-09-21 22:37	48.94	OK
2163	2026-09-21 22:38	50.26	OK	2164	2026-09-21 22:39	50.48	OK
2165	2026-09-21 22:40	49.41	OK	2166	2026-09-21 22:41	50.24	OK
2167	2026-09-21 22:42	50.08	OK	2168	2026-09-21 22:43	49.50	OK
2169	2026-09-21 22:44	50.24	OK	2170	2026-09-21 22:45	48.86	OK
2171	2026-09-21 22:46	48.93	OK	2172	2026-09-21 22:47	50.09	OK
2173	2026-09-21 22:48	48.80	OK	2174	2026-09-21 22:49	50.06	OK
2175	2026-09-21 22:50	50.33	OK	2176	2026-09-21 22:51	48.75	OK
2177	2026-09-21 22:52	49.75	OK	2178	2026-09-21 22:53	49.15	OK
2179	2026-09-21 22:54	50.70	OK	2180	2026-09-21 22:55	49.42	OK
2181	2026-09-21 22:56	48.43	OK	2182	2026-09-21 22:57	49.16	OK
2183	2026-09-21 22:58	50.23	OK	2184	2026-09-21 22:59	49.23	OK
2185	2026-09-21 23:00	47.64	OK	2186	2026-09-21 23:01	48.64	OK
2187	2026-09-21 23:02	50.39	OK	2188	2026-09-21 23:03	49.32	OK
2189	2026-09-21 23:04	49.21	OK	2190	2026-09-21 23:05	49.07	OK
2191	2026-09-21 23:06	48.08	OK	2192	2026-09-21 23:07	48.79	OK
2193	2026-09-21 23:08	48.98	OK	2194	2026-09-21 23:09	48.65	OK
2195	2026-09-21 23:10	49.23	OK	2196	2026-09-21 23:11	48.95	OK
2197	2026-09-21 23:12	49.32	OK	2198	2026-09-21 23:13	48.32	OK
2199	2026-09-21 23:14	48.46	OK	2200	2026-09-21 23:15	49.77	OK
2201	2026-09-21 23:16	48.36	OK	2202	2026-09-21 23:17	47.85	OK
2203	2026-09-21 23:18	46.99	OK	2204	2026-09-21 23:19	48.77	OK
2205	2026-09-21 23:20	50.01	OK	2206	2026-09-21 23:21	47.06	OK
2207	2026-09-21 23:22	49.38	OK	2208	2026-09-21 23:23	49.36	OK
2209	2026-09-21 23:24	49.10	OK	2210	2026-09-21 23:25	48.30	OK
2211	2026-09-21 23:26	49.90	OK	2212	2026-09-21 23:27	50.04	OK
2213	2026-09-21 23:28	48.18	OK	2214	2026-09-21 23:29	47.38	OK
2215	2026-09-21 23:30	48.90	OK	2216	2026-09-21 23:31	48.85	OK
2217	2026-09-21 23:32	49.15	OK	2218	2026-09-21 23:33	48.67	OK
2219	2026-09-21 23:34	48.57	OK	2220	2026-09-21 23:35	47.68	OK
2221	2026-09-21 23:36	48.89	OK	2222	2026-09-21 23:37	48.78	OK
2223	2026-09-21 23:38	47.87	OK	2224	2026-09-21 23:39	48.97	OK
2225	2026-09-21 23:40	49.57	OK	2226	2026-09-21 23:41	47.23	OK
2227	2026-09-21 23:42	47.58	OK	2228	2026-09-21 23:43	48.04	OK
2229	2026-09-21 23:44	47.29	OK	2230	2026-09-21 23:45	48.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2231	2026-09-21 23:46	47.55	OK	2232	2026-09-21 23:47	47.77	OK
2233	2026-09-21 23:48	48.21	OK	2234	2026-09-21 23:49	48.67	OK
2235	2026-09-21 23:50	47.13	OK	2236	2026-09-21 23:51	47.77	OK
2237	2026-09-21 23:52	47.24	OK	2238	2026-09-21 23:53	48.83	OK
2239	2026-09-21 23:54	47.47	OK	2240	2026-09-21 23:55	47.15	OK
2241	2026-09-21 23:56	47.73	OK	2242	2026-09-21 23:57	48.45	OK
2243	2026-09-21 23:58	48.05	OK	2244	2026-09-21 23:59	48.40	OK
2245	2026-09-22 00:00	48.54	OK	2246	2026-09-22 00:01	47.32	OK
2247	2026-09-22 00:02	49.10	OK	2248	2026-09-22 00:03	48.27	OK
2249	2026-09-22 00:04	47.55	OK	2250	2026-09-22 00:05	46.33	OK
2251	2026-09-22 00:06	47.45	OK	2252	2026-09-22 00:07	48.34	OK
2253	2026-09-22 00:08	47.27	OK	2254	2026-09-22 00:09	48.28	OK
2255	2026-09-22 00:10	47.20	OK	2256	2026-09-22 00:11	47.46	OK
2257	2026-09-22 00:12	48.51	OK	2258	2026-09-22 00:13	47.53	OK
2259	2026-09-22 00:14	46.75	OK	2260	2026-09-22 00:15	46.77	OK
2261	2026-09-22 00:16	47.80	OK	2262	2026-09-22 00:17	47.39	OK
2263	2026-09-22 00:18	47.40	OK	2264	2026-09-22 00:19	46.60	OK
2265	2026-09-22 00:20	46.99	OK	2266	2026-09-22 00:21	47.13	OK
2267	2026-09-22 00:22	48.57	OK	2268	2026-09-22 00:23	48.59	OK
2269	2026-09-22 00:24	46.03	OK	2270	2026-09-22 00:25	47.41	OK
2271	2026-09-22 00:26	48.78	OK	2272	2026-09-22 00:27	47.34	OK
2273	2026-09-22 00:28	46.69	OK	2274	2026-09-22 00:29	47.62	OK
2275	2026-09-22 00:30	47.30	OK	2276	2026-09-22 00:31	46.61	OK
2277	2026-09-22 00:32	46.81	OK	2278	2026-09-22 00:33	46.94	OK
2279	2026-09-22 00:34	47.60	OK	2280	2026-09-22 00:35	47.46	OK
2281	2026-09-22 00:36	47.17	OK	2282	2026-09-22 00:37	48.33	OK
2283	2026-09-22 00:38	47.20	OK	2284	2026-09-22 00:39	46.73	OK
2285	2026-09-22 00:40	47.55	OK	2286	2026-09-22 00:41	48.36	OK
2287	2026-09-22 00:42	47.83	OK	2288	2026-09-22 00:43	47.03	OK
2289	2026-09-22 00:44	47.05	OK	2290	2026-09-22 00:45	46.75	OK
2291	2026-09-22 00:46	46.31	OK	2292	2026-09-22 00:47	47.53	OK
2293	2026-09-22 00:48	46.34	OK	2294	2026-09-22 00:49	47.49	OK
2295	2026-09-22 00:50	45.53	OK	2296	2026-09-22 00:51	47.56	OK
2297	2026-09-22 00:52	47.57	OK	2298	2026-09-22 00:53	45.92	OK
2299	2026-09-22 00:54	45.25	OK	2300	2026-09-22 00:55	46.87	OK
2301	2026-09-22 00:56	46.83	OK	2302	2026-09-22 00:57	47.61	OK
2303	2026-09-22 00:58	46.48	OK	2304	2026-09-22 00:59	46.61	OK
2305	2026-09-22 01:00	46.77	OK	2306	2026-09-22 01:01	46.05	OK
2307	2026-09-22 01:02	47.35	OK	2308	2026-09-22 01:03	46.27	OK
2309	2026-09-22 01:04	46.62	OK	2310	2026-09-22 01:05	46.98	OK
2311	2026-09-22 01:06	46.11	OK	2312	2026-09-22 01:07	46.57	OK
2313	2026-09-22 01:08	46.61	OK	2314	2026-09-22 01:09	46.71	OK
2315	2026-09-22 01:10	47.15	OK	2316	2026-09-22 01:11	45.43	OK
2317	2026-09-22 01:12	46.81	OK	2318	2026-09-22 01:13	47.33	OK
2319	2026-09-22 01:14	46.76	OK	2320	2026-09-22 01:15	47.43	OK
2321	2026-09-22 01:16	46.22	OK	2322	2026-09-22 01:17	46.70	OK
2323	2026-09-22 01:18	47.00	OK	2324	2026-09-22 01:19	47.38	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2325	2026-09-22 01:20	45.11	OK	2326	2026-09-22 01:21	45.86	OK
2327	2026-09-22 01:22	45.51	OK	2328	2026-09-22 01:23	46.19	OK
2329	2026-09-22 01:24	46.13	OK	2330	2026-09-22 01:25	45.26	OK
2331	2026-09-22 01:26	46.09	OK	2332	2026-09-22 01:27	46.31	OK
2333	2026-09-22 01:28	45.63	OK	2334	2026-09-22 01:29	45.60	OK
2335	2026-09-22 01:30	46.18	OK	2336	2026-09-22 01:31	46.03	OK
2337	2026-09-22 01:32	45.78	OK	2338	2026-09-22 01:33	46.42	OK
2339	2026-09-22 01:34	44.71	OK	2340	2026-09-22 01:35	46.00	OK
2341	2026-09-22 01:36	46.13	OK	2342	2026-09-22 01:37	45.98	OK
2343	2026-09-22 01:38	46.95	OK	2344	2026-09-22 01:39	46.05	OK
2345	2026-09-22 01:40	46.14	OK	2346	2026-09-22 01:41	45.20	OK
2347	2026-09-22 01:42	45.80	OK	2348	2026-09-22 01:43	45.64	OK
2349	2026-09-22 01:44	45.40	OK	2350	2026-09-22 01:45	45.43	OK
2351	2026-09-22 01:46	44.79	OK	2352	2026-09-22 01:47	45.06	OK
2353	2026-09-22 01:48	45.51	OK	2354	2026-09-22 01:49	45.15	OK
2355	2026-09-22 01:50	45.76	OK	2356	2026-09-22 01:51	45.47	OK
2357	2026-09-22 01:52	45.10	OK	2358	2026-09-22 01:53	46.36	OK
2359	2026-09-22 01:54	45.05	OK	2360	2026-09-22 01:55	46.10	OK
2361	2026-09-22 01:56	44.59	OK	2362	2026-09-22 01:57	45.87	OK
2363	2026-09-22 01:58	45.49	OK	2364	2026-09-22 01:59	44.17	OK
2365	2026-09-22 02:00	45.60	OK	2366	2026-09-22 02:01	45.51	OK
2367	2026-09-22 02:02	44.95	OK	2368	2026-09-22 02:03	44.77	OK
2369	2026-09-22 02:04	44.48	OK	2370	2026-09-22 02:05	45.70	OK
2371	2026-09-22 02:06	45.64	OK	2372	2026-09-22 02:07	45.35	OK
2373	2026-09-22 02:08	45.02	OK	2374	2026-09-22 02:09	46.93	OK
2375	2026-09-22 02:10	45.35	OK	2376	2026-09-22 02:11	45.02	OK
2377	2026-09-22 02:12	44.92	OK	2378	2026-09-22 02:13	45.77	OK
2379	2026-09-22 02:14	44.81	OK	2380	2026-09-22 02:15	45.80	OK
2381	2026-09-22 02:16	45.32	OK	2382	2026-09-22 02:17	43.88	OK
2383	2026-09-22 02:18	44.91	OK	2384	2026-09-22 02:19	45.29	OK
2385	2026-09-22 02:20	45.09	OK	2386	2026-09-22 02:21	45.88	OK
2387	2026-09-22 02:22	44.56	OK	2388	2026-09-22 02:23	44.77	OK
2389	2026-09-22 02:24	44.84	OK	2390	2026-09-22 02:25	44.39	OK
2391	2026-09-22 02:26	46.47	OK	2392	2026-09-22 02:27	45.17	OK
2393	2026-09-22 02:28	46.08	OK	2394	2026-09-22 02:29	44.88	OK
2395	2026-09-22 02:30	43.95	OK	2396	2026-09-22 02:31	46.35	OK
2397	2026-09-22 02:32	44.15	OK	2398	2026-09-22 02:33	46.09	OK
2399	2026-09-22 02:34	45.41	OK	2400	2026-09-22 02:35	45.83	OK
2401	2026-09-22 02:36	44.56	OK	2402	2026-09-22 02:37	45.59	OK
2403	2026-09-22 02:38	43.70	OK	2404	2026-09-22 02:39	44.35	OK
2405	2026-09-22 02:40	45.00	OK	2406	2026-09-22 02:41	44.56	OK
2407	2026-09-22 02:42	43.73	OK	2408	2026-09-22 02:43	44.51	OK
2409	2026-09-22 02:44	45.75	OK	2410	2026-09-22 02:45	42.86	OK
2411	2026-09-22 02:46	45.45	OK	2412	2026-09-22 02:47	44.13	OK
2413	2026-09-22 02:48	44.34	OK	2414	2026-09-22 02:49	44.90	OK
2415	2026-09-22 02:50	43.45	OK	2416	2026-09-22 02:51	46.04	OK
2417	2026-09-22 02:52	45.58	OK	2418	2026-09-22 02:53	44.19	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2419	2026-09-22 02:54	45.25	OK	2420	2026-09-22 02:55	43.22	OK
2421	2026-09-22 02:56	45.26	OK	2422	2026-09-22 02:57	45.14	OK
2423	2026-09-22 02:58	44.91	OK	2424	2026-09-22 02:59	44.31	OK
2425	2026-09-22 03:00	45.17	OK	2426	2026-09-22 03:01	45.34	OK
2427	2026-09-22 03:02	44.46	OK	2428	2026-09-22 03:03	44.16	OK
2429	2026-09-22 03:04	45.32	OK	2430	2026-09-22 03:05	43.31	OK
2431	2026-09-22 03:06	45.03	OK	2432	2026-09-22 03:07	43.01	OK
2433	2026-09-22 03:08	43.97	OK	2434	2026-09-22 03:09	43.62	OK
2435	2026-09-22 03:10	43.46	OK	2436	2026-09-22 03:11	45.19	OK
2437	2026-09-22 03:12	43.62	OK	2438	2026-09-22 03:13	44.15	OK
2439	2026-09-22 03:14	45.15	OK	2440	2026-09-22 03:15	45.83	OK
2441	2026-09-22 03:16	45.18	OK	2442	2026-09-22 03:17	43.50	OK
2443	2026-09-22 03:18	43.98	OK	2444	2026-09-22 03:19	44.51	OK
2445	2026-09-22 03:20	44.10	OK	2446	2026-09-22 03:21	43.96	OK
2447	2026-09-22 03:22	43.66	OK	2448	2026-09-22 03:23	45.04	OK
2449	2026-09-22 03:24	45.07	OK	2450	2026-09-22 03:25	44.35	OK
2451	2026-09-22 03:26	44.18	OK	2452	2026-09-22 03:27	44.04	OK
2453	2026-09-22 03:28	44.57	OK	2454	2026-09-22 03:29	43.58	OK
2455	2026-09-22 03:30	43.25	OK	2456	2026-09-22 03:31	44.37	OK
2457	2026-09-22 03:32	43.38	OK	2458	2026-09-22 03:33	42.98	OK
2459	2026-09-22 03:34	44.18	OK	2460	2026-09-22 03:35	44.95	OK
2461	2026-09-22 03:36	43.24	OK	2462	2026-09-22 03:37	44.36	OK
2463	2026-09-22 03:38	44.15	OK	2464	2026-09-22 03:39	45.09	OK
2465	2026-09-22 03:40	44.74	OK	2466	2026-09-22 03:41	44.08	OK
2467	2026-09-22 03:42	45.88	OK	2468	2026-09-22 03:43	44.29	OK
2469	2026-09-22 03:44	42.80	OK	2470	2026-09-22 03:45	44.44	OK
2471	2026-09-22 03:46	45.32	OK	2472	2026-09-22 03:47	43.81	OK
2473	2026-09-22 03:48	43.72	OK	2474	2026-09-22 03:49	43.16	OK
2475	2026-09-22 03:50	42.71	OK	2476	2026-09-22 03:51	44.39	OK
2477	2026-09-22 03:52	44.04	OK	2478	2026-09-22 03:53	42.64	OK
2479	2026-09-22 03:54	43.56	OK	2480	2026-09-22 03:55	43.75	OK
2481	2026-09-22 03:56	42.71	OK	2482	2026-09-22 03:57	43.29	OK
2483	2026-09-22 03:58	43.26	OK	2484	2026-09-22 03:59	43.95	OK
2485	2026-09-22 04:00	43.38	OK	2486	2026-09-22 04:01	43.90	OK
2487	2026-09-22 04:02	43.59	OK	2488	2026-09-22 04:03	43.31	OK
2489	2026-09-22 04:04	43.00	OK	2490	2026-09-22 04:05	44.30	OK
2491	2026-09-22 04:06	43.58	OK	2492	2026-09-22 04:07	44.23	OK
2493	2026-09-22 04:08	43.33	OK	2494	2026-09-22 04:09	43.68	OK
2495	2026-09-22 04:10	43.30	OK	2496	2026-09-22 04:11	44.20	OK
2497	2026-09-22 04:12	43.77	OK	2498	2026-09-22 04:13	42.94	OK
2499	2026-09-22 04:14	43.24	OK	2500	2026-09-22 04:15	44.80	OK
2501	2026-09-22 04:16	43.99	OK	2502	2026-09-22 04:17	43.68	OK
2503	2026-09-22 04:18	41.94	OK	2504	2026-09-22 04:19	44.15	OK
2505	2026-09-22 04:20	43.94	OK	2506	2026-09-22 04:21	44.33	OK
2507	2026-09-22 04:22	43.43	OK	2508	2026-09-22 04:23	43.55	OK
2509	2026-09-22 04:24	44.42	OK	2510	2026-09-22 04:25	43.96	OK
2511	2026-09-22 04:26	43.93	OK	2512	2026-09-22 04:27	42.59	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2513	2026-09-22 04:28	42.58	OK	2514	2026-09-22 04:29	42.45	OK
2515	2026-09-22 04:30	43.21	OK	2516	2026-09-22 04:31	44.07	OK
2517	2026-09-22 04:32	44.40	OK	2518	2026-09-22 04:33	43.12	OK
2519	2026-09-22 04:34	43.92	OK	2520	2026-09-22 04:35	44.66	OK
2521	2026-09-22 04:36	44.50	OK	2522	2026-09-22 04:37	43.55	OK
2523	2026-09-22 04:38	41.76	OK	2524	2026-09-22 04:39	43.79	OK
2525	2026-09-22 04:40	43.89	OK	2526	2026-09-22 04:41	43.72	OK
2527	2026-09-22 04:42	43.25	OK	2528	2026-09-22 04:43	42.74	OK
2529	2026-09-22 04:44	44.84	OK	2530	2026-09-22 04:45	44.27	OK
2531	2026-09-22 04:46	43.68	OK	2532	2026-09-22 04:47	44.28	OK
2533	2026-09-22 04:48	43.58	OK	2534	2026-09-22 04:49	42.91	OK
2535	2026-09-22 04:50	42.81	OK	2536	2026-09-22 04:51	44.22	OK
2537	2026-09-22 04:52	44.41	OK	2538	2026-09-22 04:53	43.47	OK
2539	2026-09-22 04:54	43.88	OK	2540	2026-09-22 04:55	43.61	OK
2541	2026-09-22 04:56	42.61	OK	2542	2026-09-22 04:57	43.36	OK
2543	2026-09-22 04:58	43.80	OK	2544	2026-09-22 04:59	42.44	OK
2545	2026-09-22 05:00	43.58	OK	2546	2026-09-22 05:01	43.60	OK
2547	2026-09-22 05:02	44.47	OK	2548	2026-09-22 05:03	43.29	OK
2549	2026-09-22 05:04	43.77	OK	2550	2026-09-22 05:05	43.19	OK
2551	2026-09-22 05:06	43.48	OK	2552	2026-09-22 05:07	42.64	OK
2553	2026-09-22 05:08	42.67	OK	2554	2026-09-22 05:09	42.54	OK
2555	2026-09-22 05:10	44.52	OK	2556	2026-09-22 05:11	42.71	OK
2557	2026-09-22 05:12	45.13	OK	2558	2026-09-22 05:13	44.33	OK
2559	2026-09-22 05:14	44.58	OK	2560	2026-09-22 05:15	43.51	OK
2561	2026-09-22 05:16	43.73	OK	2562	2026-09-22 05:17	42.23	OK
2563	2026-09-22 05:18	43.00	OK	2564	2026-09-22 05:19	43.87	OK
2565	2026-09-22 05:20	43.72	OK	2566	2026-09-22 05:21	42.92	OK
2567	2026-09-22 05:22	43.02	OK	2568	2026-09-22 05:23	44.32	OK
2569	2026-09-22 05:24	42.34	OK	2570	2026-09-22 05:25	43.11	OK
2571	2026-09-22 05:26	43.75	OK	2572	2026-09-22 05:27	43.31	OK
2573	2026-09-22 05:28	45.20	OK	2574	2026-09-22 05:29	44.50	OK
2575	2026-09-22 05:30	42.25	OK	2576	2026-09-22 05:31	43.55	OK
2577	2026-09-22 05:32	43.74	OK	2578	2026-09-22 05:33	43.94	OK
2579	2026-09-22 05:34	43.62	OK	2580	2026-09-22 05:35	43.24	OK
2581	2026-09-22 05:36	43.82	OK	2582	2026-09-22 05:37	44.72	OK
2583	2026-09-22 05:38	43.16	OK	2584	2026-09-22 05:39	42.48	OK
2585	2026-09-22 05:40	44.64	OK	2586	2026-09-22 05:41	43.44	OK
2587	2026-09-22 05:42	44.11	OK	2588	2026-09-22 05:43	43.18	OK
2589	2026-09-22 05:44	42.87	OK	2590	2026-09-22 05:45	43.04	OK
2591	2026-09-22 05:46	43.76	OK	2592	2026-09-22 05:47	44.29	OK
2593	2026-09-22 05:48	42.83	OK	2594	2026-09-22 05:49	44.89	OK
2595	2026-09-22 05:50	43.32	OK	2596	2026-09-22 05:51	42.49	OK
2597	2026-09-22 05:52	43.08	OK	2598	2026-09-22 05:53	41.97	OK
2599	2026-09-22 05:54	44.35	OK	2600	2026-09-22 05:55	43.20	OK
2601	2026-09-22 05:56	43.59	OK	2602	2026-09-22 05:57	42.10	OK
2603	2026-09-22 05:58	43.25	OK	2604	2026-09-22 05:59	43.55	OK
2605	2026-09-22 06:00	44.07	OK	2606	2026-09-22 06:01	44.01	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2607	2026-09-22 06:02	43.52	OK	2608	2026-09-22 06:03	43.33	OK
2609	2026-09-22 06:04	43.93	OK	2610	2026-09-22 06:05	43.19	OK
2611	2026-09-22 06:06	43.32	OK	2612	2026-09-22 06:07	43.55	OK
2613	2026-09-22 06:08	43.97	OK	2614	2026-09-22 06:09	42.72	OK
2615	2026-09-22 06:10	43.98	OK	2616	2026-09-22 06:11	43.70	OK
2617	2026-09-22 06:12	45.03	OK	2618	2026-09-22 06:13	43.66	OK
2619	2026-09-22 06:14	44.28	OK	2620	2026-09-22 06:15	43.78	OK
2621	2026-09-22 06:16	42.61	OK	2622	2026-09-22 06:17	44.22	OK
2623	2026-09-22 06:18	43.46	OK	2624	2026-09-22 06:19	43.88	OK
2625	2026-09-22 06:20	44.53	OK	2626	2026-09-22 06:21	44.16	OK
2627	2026-09-22 06:22	42.49	OK	2628	2026-09-22 06:23	43.45	OK
2629	2026-09-22 06:24	44.55	OK	2630	2026-09-22 06:25	43.88	OK
2631	2026-09-22 06:26	43.10	OK	2632	2026-09-22 06:27	44.33	OK
2633	2026-09-22 06:28	43.47	OK	2634	2026-09-22 06:29	43.08	OK
2635	2026-09-22 06:30	44.39	OK	2636	2026-09-22 06:31	42.91	OK
2637	2026-09-22 06:32	42.93	OK	2638	2026-09-22 06:33	43.53	OK
2639	2026-09-22 06:34	43.67	OK	2640	2026-09-22 06:35	44.55	OK
2641	2026-09-22 06:36	42.94	OK	2642	2026-09-22 06:37	42.59	OK
2643	2026-09-22 06:38	43.67	OK	2644	2026-09-22 06:39	44.12	OK
2645	2026-09-22 06:40	43.56	OK	2646	2026-09-22 06:41	43.98	OK
2647	2026-09-22 06:42	44.52	OK	2648	2026-09-22 06:43	44.83	OK
2649	2026-09-22 06:44	44.01	OK	2650	2026-09-22 06:45	43.55	OK
2651	2026-09-22 06:46	43.32	OK	2652	2026-09-22 06:47	43.61	OK
2653	2026-09-22 06:48	44.85	OK	2654	2026-09-22 06:49	44.63	OK
2655	2026-09-22 06:50	44.26	OK	2656	2026-09-22 06:51	43.12	OK
2657	2026-09-22 06:52	44.10	OK	2658	2026-09-22 06:53	43.17	OK
2659	2026-09-22 06:54	41.93	OK	2660	2026-09-22 06:55	44.41	OK
2661	2026-09-22 06:56	44.54	OK	2662	2026-09-22 06:57	44.42	OK
2663	2026-09-22 06:58	44.20	OK	2664	2026-09-22 06:59	44.32	OK
2665	2026-09-22 07:00	43.43	OK	2666	2026-09-22 07:01	44.03	OK
2667	2026-09-22 07:02	44.44	OK	2668	2026-09-22 07:03	43.89	OK
2669	2026-09-22 07:04	44.22	OK	2670	2026-09-22 07:05	44.42	OK
2671	2026-09-22 07:06	43.65	OK	2672	2026-09-22 07:07	43.36	OK
2673	2026-09-22 07:08	44.61	OK	2674	2026-09-22 07:09	43.72	OK
2675	2026-09-22 07:10	43.40	OK	2676	2026-09-22 07:11	43.98	OK
2677	2026-09-22 07:12	45.52	OK	2678	2026-09-22 07:13	43.69	OK
2679	2026-09-22 07:14	43.48	OK	2680	2026-09-22 07:15	42.85	OK
2681	2026-09-22 07:16	44.39	OK	2682	2026-09-22 07:17	44.07	OK
2683	2026-09-22 07:18	44.90	OK	2684	2026-09-22 07:19	44.95	OK
2685	2026-09-22 07:20	44.13	OK	2686	2026-09-22 07:21	43.35	OK
2687	2026-09-22 07:22	43.18	OK	2688	2026-09-22 07:23	44.64	OK
2689	2026-09-22 07:24	43.97	OK	2690	2026-09-22 07:25	44.47	OK
2691	2026-09-22 07:26	43.35	OK	2692	2026-09-22 07:27	43.69	OK
2693	2026-09-22 07:28	43.86	OK	2694	2026-09-22 07:29	44.43	OK
2695	2026-09-22 07:30	44.32	OK	2696	2026-09-22 07:31	44.48	OK
2697	2026-09-22 07:32	43.80	OK	2698	2026-09-22 07:33	44.01	OK
2699	2026-09-22 07:34	44.74	OK	2700	2026-09-22 07:35	44.37	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2701	2026-09-22 07:36	45.18	OK	2702	2026-09-22 07:37	43.03	OK
2703	2026-09-22 07:38	43.55	OK	2704	2026-09-22 07:39	44.05	OK
2705	2026-09-22 07:40	45.33	OK	2706	2026-09-22 07:41	43.63	OK
2707	2026-09-22 07:42	42.95	OK	2708	2026-09-22 07:43	45.00	OK
2709	2026-09-22 07:44	45.23	OK	2710	2026-09-22 07:45	44.95	OK
2711	2026-09-22 07:46	43.07	OK	2712	2026-09-22 07:47	45.47	OK
2713	2026-09-22 07:48	44.23	OK	2714	2026-09-22 07:49	44.71	OK
2715	2026-09-22 07:50	46.05	OK	2716	2026-09-22 07:51	44.04	OK
2717	2026-09-22 07:52	46.03	OK	2718	2026-09-22 07:53	44.74	OK
2719	2026-09-22 07:54	42.71	OK	2720	2026-09-22 07:55	45.22	OK
2721	2026-09-22 07:56	45.73	OK	2722	2026-09-22 07:57	43.90	OK
2723	2026-09-22 07:58	45.07	OK	2724	2026-09-22 07:59	44.32	OK
2725	2026-09-22 08:00	44.47	OK	2726	2026-09-22 08:01	44.73	OK
2727	2026-09-22 08:02	44.06	OK	2728	2026-09-22 08:03	43.48	OK
2729	2026-09-22 08:04	45.92	OK	2730	2026-09-22 08:05	45.73	OK
2731	2026-09-22 08:06	44.20	OK	2732	2026-09-22 08:07	44.25	OK
2733	2026-09-22 08:08	43.74	OK	2734	2026-09-22 08:09	44.76	OK
2735	2026-09-22 08:10	45.06	OK	2736	2026-09-22 08:11	44.79	OK
2737	2026-09-22 08:12	44.13	OK	2738	2026-09-22 08:13	45.25	OK
2739	2026-09-22 08:14	43.43	OK	2740	2026-09-22 08:15	44.67	OK
2741	2026-09-22 08:16	45.82	OK	2742	2026-09-22 08:17	44.51	OK
2743	2026-09-22 08:18	43.81	OK	2744	2026-09-22 08:19	43.92	OK
2745	2026-09-22 08:20	44.88	OK	2746	2026-09-22 08:21	44.46	OK
2747	2026-09-22 08:22	45.13	OK	2748	2026-09-22 08:23	43.52	OK
2749	2026-09-22 08:24	44.31	OK	2750	2026-09-22 08:25	44.84	OK
2751	2026-09-22 08:26	46.31	OK	2752	2026-09-22 08:27	45.92	OK
2753	2026-09-22 08:28	44.92	OK	2754	2026-09-22 08:29	45.51	OK
2755	2026-09-22 08:30	43.81	OK	2756	2026-09-22 08:31	43.95	OK
2757	2026-09-22 08:32	44.33	OK	2758	2026-09-22 08:33	45.07	OK
2759	2026-09-22 08:34	45.55	OK	2760	2026-09-22 08:35	44.92	OK
2761	2026-09-22 08:36	45.11	OK	2762	2026-09-22 08:37	43.97	OK
2763	2026-09-22 08:38	44.79	OK	2764	2026-09-22 08:39	43.62	OK
2765	2026-09-22 08:40	45.89	OK	2766	2026-09-22 08:41	43.98	OK
2767	2026-09-22 08:42	44.68	OK	2768	2026-09-22 08:43	44.87	OK
2769	2026-09-22 08:44	43.48	OK	2770	2026-09-22 08:45	45.65	OK
2771	2026-09-22 08:46	44.46	OK	2772	2026-09-22 08:47	44.52	OK
2773	2026-09-22 08:48	44.86	OK	2774	2026-09-22 08:49	44.95	OK
2775	2026-09-22 08:50	44.78	OK	2776	2026-09-22 08:51	44.84	OK
2777	2026-09-22 08:52	45.34	OK	2778	2026-09-22 08:53	45.37	OK
2779	2026-09-22 08:54	46.59	OK	2780	2026-09-22 08:55	45.76	OK
2781	2026-09-22 08:56	45.54	OK	2782	2026-09-22 08:57	44.14	OK
2783	2026-09-22 08:58	46.17	OK	2784	2026-09-22 08:59	45.15	OK
2785	2026-09-22 09:00	46.03	OK	2786	2026-09-22 09:01	46.32	OK
2787	2026-09-22 09:02	44.90	OK	2788	2026-09-22 09:03	45.38	OK
2789	2026-09-22 09:04	45.28	OK	2790	2026-09-22 09:05	45.58	OK
2791	2026-09-22 09:06	44.58	OK	2792	2026-09-22 09:07	44.66	OK
2793	2026-09-22 09:08	45.49	OK	2794	2026-09-22 09:09	45.73	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2795	2026-09-22 09:10	45.57	OK	2796	2026-09-22 09:11	45.46	OK
2797	2026-09-22 09:12	45.68	OK	2798	2026-09-22 09:13	46.76	OK
2799	2026-09-22 09:14	45.27	OK	2800	2026-09-22 09:15	45.43	OK
2801	2026-09-22 09:16	44.96	OK	2802	2026-09-22 09:17	45.24	OK
2803	2026-09-22 09:18	45.41	OK	2804	2026-09-22 09:19	45.05	OK
2805	2026-09-22 09:20	45.93	OK	2806	2026-09-22 09:21	46.02	OK
2807	2026-09-22 09:22	44.96	OK	2808	2026-09-22 09:23	46.62	OK
2809	2026-09-22 09:24	45.43	OK	2810	2026-09-22 09:25	45.20	OK
2811	2026-09-22 09:26	45.28	OK	2812	2026-09-22 09:27	45.37	OK
2813	2026-09-22 09:28	45.17	OK	2814	2026-09-22 09:29	45.47	OK
2815	2026-09-22 09:30	44.29	OK	2816	2026-09-22 09:31	45.29	OK
2817	2026-09-22 09:32	45.84	OK	2818	2026-09-22 09:33	47.44	OK
2819	2026-09-22 09:34	46.39	OK	2820	2026-09-22 09:35	46.62	OK
2821	2026-09-22 09:36	46.86	OK	2822	2026-09-22 09:37	46.12	OK
2823	2026-09-22 09:38	46.96	OK	2824	2026-09-22 09:39	45.13	OK
2825	2026-09-22 09:40	46.02	OK	2826	2026-09-22 09:41	46.74	OK
2827	2026-09-22 09:42	45.86	OK	2828	2026-09-22 09:43	47.16	OK
2829	2026-09-22 09:44	45.55	OK	2830	2026-09-22 09:45	44.86	OK
2831	2026-09-22 09:46	46.04	OK	2832	2026-09-22 09:47	45.29	OK
2833	2026-09-22 09:48	46.95	OK	2834	2026-09-22 09:49	47.62	OK
2835	2026-09-22 09:50	46.25	OK	2836	2026-09-22 09:51	46.54	OK
2837	2026-09-22 09:52	45.53	OK	2838	2026-09-22 09:53	46.67	OK
2839	2026-09-22 09:54	46.15	OK	2840	2026-09-22 09:55	45.24	OK
2841	2026-09-22 09:56	46.45	OK	2842	2026-09-22 09:57	45.26	OK
2843	2026-09-22 09:58	46.31	OK	2844	2026-09-22 09:59	45.81	OK
2845	2026-09-22 10:00	47.65	OK	2846	2026-09-22 10:01	47.58	OK
2847	2026-09-22 10:02	46.05	OK	2848	2026-09-22 10:03	46.16	OK
2849	2026-09-22 10:04	46.09	OK	2850	2026-09-22 10:05	46.33	OK
2851	2026-09-22 10:06	46.56	OK	2852	2026-09-22 10:07	47.57	OK
2853	2026-09-22 10:08	46.48	OK	2854	2026-09-22 10:09	44.79	OK
2855	2026-09-22 10:10	47.24	OK	2856	2026-09-22 10:11	46.42	OK
2857	2026-09-22 10:12	46.46	OK	2858	2026-09-22 10:13	47.91	OK
2859	2026-09-22 10:14	47.30	OK	2860	2026-09-22 10:15	45.97	OK
2861	2026-09-22 10:16	46.70	OK	2862	2026-09-22 10:17	46.50	OK
2863	2026-09-22 10:18	46.71	OK	2864	2026-09-22 10:19	46.11	OK
2865	2026-09-22 10:20	46.24	OK	2866	2026-09-22 10:21	46.65	OK
2867	2026-09-22 10:22	47.26	OK	2868	2026-09-22 10:23	46.52	OK
2869	2026-09-22 10:24	46.83	OK	2870	2026-09-22 10:25	47.20	OK
2871	2026-09-22 10:26	45.96	OK	2872	2026-09-22 10:27	45.74	OK
2873	2026-09-22 10:28	46.37	OK	2874	2026-09-22 10:29	47.27	OK
2875	2026-09-22 10:30	47.73	OK	2876	2026-09-22 10:31	46.13	OK
2877	2026-09-22 10:32	46.53	OK	2878	2026-09-22 10:33	46.22	OK
2879	2026-09-22 10:34	48.60	OK	2880	2026-09-22 10:35	47.55	OK
2881	2026-09-22 10:36	48.01	OK	2882	2026-09-22 10:37	46.70	OK
2883	2026-09-22 10:38	47.56	OK	2884	2026-09-22 10:39	46.80	OK
2885	2026-09-22 10:40	47.38	OK	2886	2026-09-22 10:41	47.29	OK
2887	2026-09-22 10:42	47.24	OK	2888	2026-09-22 10:43	47.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2889	2026-09-22 10:44	47.07	OK	2890	2026-09-22 10:45	47.82	OK
2891	2026-09-22 10:46	46.58	OK	2892	2026-09-22 10:47	48.36	OK
2893	2026-09-22 10:48	48.01	OK	2894	2026-09-22 10:49	47.28	OK
2895	2026-09-22 10:50	47.64	OK	2896	2026-09-22 10:51	47.82	OK
2897	2026-09-22 10:52	46.84	OK	2898	2026-09-22 10:53	47.64	OK
2899	2026-09-22 10:54	46.48	OK	2900	2026-09-22 10:55	47.50	OK
2901	2026-09-22 10:56	48.01	OK	2902	2026-09-22 10:57	48.58	OK
2903	2026-09-22 10:58	48.24	OK	2904	2026-09-22 10:59	47.34	OK
2905	2026-09-22 11:00	47.94	OK	2906	2026-09-22 11:01	48.15	OK
2907	2026-09-22 11:02	47.68	OK	2908	2026-09-22 11:03	48.26	OK
2909	2026-09-22 11:04	48.11	OK	2910	2026-09-22 11:05	46.97	OK
2911	2026-09-22 11:06	47.48	OK	2912	2026-09-22 11:07	48.33	OK
2913	2026-09-22 11:08	47.41	OK	2914	2026-09-22 11:09	47.63	OK
2915	2026-09-22 11:10	47.46	OK	2916	2026-09-22 11:11	48.02	OK
2917	2026-09-22 11:12	47.23	OK	2918	2026-09-22 11:13	47.91	OK
2919	2026-09-22 11:14	47.57	OK	2920	2026-09-22 11:15	47.93	OK
2921	2026-09-22 11:16	48.52	OK	2922	2026-09-22 11:17	47.67	OK
2923	2026-09-22 11:18	47.45	OK	2924	2026-09-22 11:19	46.78	OK
2925	2026-09-22 11:20	47.66	OK	2926	2026-09-22 11:21	47.72	OK
2927	2026-09-22 11:22	48.76	OK	2928	2026-09-22 11:23	47.55	OK
2929	2026-09-22 11:24	47.26	OK	2930	2026-09-22 11:25	47.74	OK
2931	2026-09-22 11:26	48.82	OK	2932	2026-09-22 11:27	48.32	OK
2933	2026-09-22 11:28	48.00	OK	2934	2026-09-22 11:29	47.31	OK
2935	2026-09-22 11:30	49.07	OK	2936	2026-09-22 11:31	47.60	OK
2937	2026-09-22 11:32	47.93	OK	2938	2026-09-22 11:33	47.14	OK
2939	2026-09-22 11:34	48.19	OK	2940	2026-09-22 11:35	48.22	OK
2941	2026-09-22 11:36	49.22	OK	2942	2026-09-22 11:37	48.08	OK
2943	2026-09-22 11:38	48.00	OK	2944	2026-09-22 11:39	47.36	OK
2945	2026-09-22 11:40	48.89	OK	2946	2026-09-22 11:41	48.44	OK
2947	2026-09-22 11:42	48.01	OK	2948	2026-09-22 11:43	47.41	OK
2949	2026-09-22 11:44	48.75	OK	2950	2026-09-22 11:45	47.87	OK
2951	2026-09-22 11:46	48.47	OK	2952	2026-09-22 11:47	47.45	OK
2953	2026-09-22 11:48	49.45	OK	2954	2026-09-22 11:49	46.99	OK
2955	2026-09-22 11:50	48.85	OK	2956	2026-09-22 11:51	48.27	OK
2957	2026-09-22 11:52	49.24	OK	2958	2026-09-22 11:53	49.08	OK
2959	2026-09-22 11:54	48.93	OK	2960	2026-09-22 11:55	49.26	OK
2961	2026-09-22 11:56	49.95	OK	2962	2026-09-22 11:57	49.07	OK
2963	2026-09-22 11:58	49.97	OK	2964	2026-09-22 11:59	48.29	OK
2965	2026-09-22 12:00	48.66	OK	2966	2026-09-22 12:01	48.03	OK
2967	2026-09-22 12:02	49.48	OK	2968	2026-09-22 12:03	49.59	OK
2969	2026-09-22 12:04	47.61	OK	2970	2026-09-22 12:05	49.23	OK
2971	2026-09-22 12:06	48.51	OK	2972	2026-09-22 12:07	49.93	OK
2973	2026-09-22 12:08	48.63	OK	2974	2026-09-22 12:09	49.31	OK
2975	2026-09-22 12:10	48.77	OK	2976	2026-09-22 12:11	48.99	OK
2977	2026-09-22 12:12	48.75	OK	2978	2026-09-22 12:13	49.40	OK
2979	2026-09-22 12:14	49.60	OK	2980	2026-09-22 12:15	49.74	OK
2981	2026-09-22 12:16	49.51	OK	2982	2026-09-22 12:17	49.71	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2983	2026-09-22 12:18	50.10	OK	2984	2026-09-22 12:19	49.46	OK
2985	2026-09-22 12:20	49.58	OK	2986	2026-09-22 12:21	48.66	OK
2987	2026-09-22 12:22	48.65	OK	2988	2026-09-22 12:23	49.18	OK
2989	2026-09-22 12:24	50.39	OK	2990	2026-09-22 12:25	49.98	OK
2991	2026-09-22 12:26	48.51	OK	2992	2026-09-22 12:27	49.21	OK
2993	2026-09-22 12:28	48.24	OK	2994	2026-09-22 12:29	49.15	OK
2995	2026-09-22 12:30	48.54	OK	2996	2026-09-22 12:31	49.47	OK
2997	2026-09-22 12:32	49.32	OK	2998	2026-09-22 12:33	50.63	OK
2999	2026-09-22 12:34	50.21	OK	3000	2026-09-22 12:35	49.92	OK
3001	2026-09-22 12:36	48.62	OK	3002	2026-09-22 12:37	48.90	OK
3003	2026-09-22 12:38	49.23	OK	3004	2026-09-22 12:39	50.43	OK
3005	2026-09-22 12:40	48.85	OK	3006	2026-09-22 12:41	49.76	OK
3007	2026-09-22 12:42	48.40	OK	3008	2026-09-22 12:43	49.52	OK
3009	2026-09-22 12:44	49.32	OK	3010	2026-09-22 12:45	49.96	OK
3011	2026-09-22 12:46	49.24	OK	3012	2026-09-22 12:47	49.60	OK
3013	2026-09-22 12:48	49.52	OK	3014	2026-09-22 12:49	49.94	OK
3015	2026-09-22 12:50	50.70	OK	3016	2026-09-22 12:51	50.29	OK
3017	2026-09-22 12:52	48.90	OK	3018	2026-09-22 12:53	49.16	OK
3019	2026-09-22 12:54	48.97	OK	3020	2026-09-22 12:55	49.96	OK
3021	2026-09-22 12:56	49.68	OK	3022	2026-09-22 12:57	50.43	OK
3023	2026-09-22 12:58	49.38	OK	3024	2026-09-22 12:59	49.03	OK
3025	2026-09-22 13:00	50.13	OK	3026	2026-09-22 13:01	50.10	OK
3027	2026-09-22 13:02	50.54	OK	3028	2026-09-22 13:03	49.77	OK
3029	2026-09-22 13:04	49.94	OK	3030	2026-09-22 13:05	50.67	OK
3031	2026-09-22 13:06	50.98	OK	3032	2026-09-22 13:07	48.62	OK
3033	2026-09-22 13:08	49.79	OK	3034	2026-09-22 13:09	50.98	OK
3035	2026-09-22 13:10	51.31	OK	3036	2026-09-22 13:11	50.23	OK
3037	2026-09-22 13:12	50.44	OK	3038	2026-09-22 13:13	49.87	OK
3039	2026-09-22 13:14	50.63	OK	3040	2026-09-22 13:15	49.39	OK
3041	2026-09-22 13:16	50.81	OK	3042	2026-09-22 13:17	51.40	OK
3043	2026-09-22 13:18	49.75	OK	3044	2026-09-22 13:19	50.08	OK
3045	2026-09-22 13:20	51.06	OK	3046	2026-09-22 13:21	50.60	OK
3047	2026-09-22 13:22	51.49	OK	3048	2026-09-22 13:23	49.77	OK
3049	2026-09-22 13:24	52.09	OK	3050	2026-09-22 13:25	50.43	OK
3051	2026-09-22 13:26	51.07	OK	3052	2026-09-22 13:27	50.11	OK
3053	2026-09-22 13:28	50.91	OK	3054	2026-09-22 13:29	50.06	OK
3055	2026-09-22 13:30	50.49	OK	3056	2026-09-22 13:31	49.75	OK
3057	2026-09-22 13:32	51.10	OK	3058	2026-09-22 13:33	51.85	OK
3059	2026-09-22 13:34	50.39	OK	3060	2026-09-22 13:35	51.15	OK
3061	2026-09-22 13:36	51.17	OK	3062	2026-09-22 13:37	52.27	OK
3063	2026-09-22 13:38	51.53	OK	3064	2026-09-22 13:39	50.38	OK
3065	2026-09-22 13:40	50.04	OK	3066	2026-09-22 13:41	51.09	OK
3067	2026-09-22 13:42	50.85	OK	3068	2026-09-22 13:43	50.50	OK
3069	2026-09-22 13:44	50.05	OK	3070	2026-09-22 13:45	50.95	OK
3071	2026-09-22 13:46	51.95	OK	3072	2026-09-22 13:47	50.72	OK
3073	2026-09-22 13:48	51.09	OK	3074	2026-09-22 13:49	50.87	OK
3075	2026-09-22 13:50	49.68	OK	3076	2026-09-22 13:51	51.69	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3077	2026-09-22 13:52	50.96	OK	3078	2026-09-22 13:53	50.01	OK
3079	2026-09-22 13:54	50.60	OK	3080	2026-09-22 13:55	51.00	OK
3081	2026-09-22 13:56	50.89	OK	3082	2026-09-22 13:57	50.87	OK
3083	2026-09-22 13:58	50.28	OK	3084	2026-09-22 13:59	50.73	OK
3085	2026-09-22 14:00	51.50	OK	3086	2026-09-22 14:01	51.36	OK
3087	2026-09-22 14:02	50.53	OK	3088	2026-09-22 14:03	50.90	OK
3089	2026-09-22 14:04	51.33	OK	3090	2026-09-22 14:05	50.40	OK
3091	2026-09-22 14:06	52.24	OK	3092	2026-09-22 14:07	50.13	OK
3093	2026-09-22 14:08	50.90	OK	3094	2026-09-22 14:09	51.71	OK
3095	2026-09-22 14:10	51.18	OK	3096	2026-09-22 14:11	51.76	OK
3097	2026-09-22 14:12	51.69	OK	3098	2026-09-22 14:13	50.39	OK
3099	2026-09-22 14:14	51.16	OK	3100	2026-09-22 14:15	51.66	OK
3101	2026-09-22 14:16	52.08	OK	3102	2026-09-22 14:17	52.96	OK
3103	2026-09-22 14:18	51.46	OK	3104	2026-09-22 14:19	50.45	OK
3105	2026-09-22 14:20	51.53	OK	3106	2026-09-22 14:21	50.15	OK
3107	2026-09-22 14:22	51.97	OK	3108	2026-09-22 14:23	52.76	OK
3109	2026-09-22 14:24	52.03	OK	3110	2026-09-22 14:25	51.41	OK
3111	2026-09-22 14:26	50.53	OK	3112	2026-09-22 14:27	51.19	OK
3113	2026-09-22 14:28	52.23	OK	3114	2026-09-22 14:29	51.24	OK
3115	2026-09-22 14:30	51.60	OK	3116	2026-09-22 14:31	52.00	OK
3117	2026-09-22 14:32	51.95	OK	3118	2026-09-22 14:33	52.18	OK
3119	2026-09-22 14:34	53.01	OK	3120	2026-09-22 14:35	53.44	OK
3121	2026-09-22 14:36	52.53	OK	3122	2026-09-22 14:37	51.95	OK
3123	2026-09-22 14:38	52.79	OK	3124	2026-09-22 14:39	51.54	OK
3125	2026-09-22 14:40	53.04	OK	3126	2026-09-22 14:41	52.10	OK
3127	2026-09-22 14:42	52.63	OK	3128	2026-09-22 14:43	51.44	OK
3129	2026-09-22 14:44	52.21	OK	3130	2026-09-22 14:45	52.70	OK
3131	2026-09-22 14:46	52.28	OK	3132	2026-09-22 14:47	50.93	OK
3133	2026-09-22 14:48	51.61	OK	3134	2026-09-22 14:49	52.39	OK
3135	2026-09-22 14:50	52.87	OK	3136	2026-09-22 14:51	51.44	OK
3137	2026-09-22 14:52	51.74	OK	3138	2026-09-22 14:53	51.70	OK
3139	2026-09-22 14:54	53.33	OK	3140	2026-09-22 14:55	53.05	OK
3141	2026-09-22 14:56	51.61	OK	3142	2026-09-22 14:57	52.43	OK
3143	2026-09-22 14:58	52.06	OK	3144	2026-09-22 14:59	52.29	OK
3145	2026-09-22 15:00	52.56	OK	3146	2026-09-22 15:01	51.17	OK
3147	2026-09-22 15:02	50.85	OK	3148	2026-09-22 15:03	52.62	OK
3149	2026-09-22 15:04	53.05	OK	3150	2026-09-22 15:05	51.74	OK
3151	2026-09-22 15:06	51.52	OK	3152	2026-09-22 15:07	51.93	OK
3153	2026-09-22 15:08	51.83	OK	3154	2026-09-22 15:09	52.70	OK
3155	2026-09-22 15:10	52.29	OK	3156	2026-09-22 15:11	51.89	OK
3157	2026-09-22 15:12	52.09	OK	3158	2026-09-22 15:13	51.56	OK
3159	2026-09-22 15:14	52.01	OK	3160	2026-09-22 15:15	51.72	OK
3161	2026-09-22 15:16	53.67	OK	3162	2026-09-22 15:17	53.03	OK
3163	2026-09-22 15:18	52.65	OK	3164	2026-09-22 15:19	51.68	OK
3165	2026-09-22 15:20	53.84	OK	3166	2026-09-22 15:21	53.31	OK
3167	2026-09-22 15:22	52.56	OK	3168	2026-09-22 15:23	52.66	OK
3169	2026-09-22 15:24	51.99	OK	3170	2026-09-22 15:25	52.41	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3171	2026-09-22 15:26	52.31	OK	3172	2026-09-22 15:27	51.40	OK
3173	2026-09-22 15:28	51.92	OK	3174	2026-09-22 15:29	52.02	OK
3175	2026-09-22 15:30	52.66	OK	3176	2026-09-22 15:31	52.77	OK
3177	2026-09-22 15:32	51.16	OK	3178	2026-09-22 15:33	52.45	OK
3179	2026-09-22 15:34	52.77	OK	3180	2026-09-22 15:35	52.27	OK
3181	2026-09-22 15:36	53.16	OK	3182	2026-09-22 15:37	52.99	OK
3183	2026-09-22 15:38	52.25	OK	3184	2026-09-22 15:39	52.68	OK
3185	2026-09-22 15:40	51.57	OK	3186	2026-09-22 15:41	52.10	OK
3187	2026-09-22 15:42	52.29	OK	3188	2026-09-22 15:43	52.88	OK
3189	2026-09-22 15:44	51.67	OK	3190	2026-09-22 15:45	51.08	OK
3191	2026-09-22 15:46	51.92	OK	3192	2026-09-22 15:47	51.79	OK
3193	2026-09-22 15:48	52.00	OK	3194	2026-09-22 15:49	51.68	OK
3195	2026-09-22 15:50	52.40	OK	3196	2026-09-22 15:51	52.95	OK
3197	2026-09-22 15:52	53.20	OK	3198	2026-09-22 15:53	52.51	OK
3199	2026-09-22 15:54	53.02	OK	3200	2026-09-22 15:55	52.12	OK
3201	2026-09-22 15:56	52.86	OK	3202	2026-09-22 15:57	51.46	OK
3203	2026-09-22 15:58	52.23	OK	3204	2026-09-22 15:59	52.14	OK
3205	2026-09-22 16:00	51.87	OK	3206	2026-09-22 16:01	52.08	OK
3207	2026-09-22 16:02	51.49	OK	3208	2026-09-22 16:03	54.19	OK
3209	2026-09-22 16:04	53.76	OK	3210	2026-09-22 16:05	52.69	OK
3211	2026-09-22 16:06	52.99	OK	3212	2026-09-22 16:07	52.70	OK
3213	2026-09-22 16:08	52.95	OK	3214	2026-09-22 16:09	53.01	OK
3215	2026-09-22 16:10	53.43	OK	3216	2026-09-22 16:11	52.37	OK
3217	2026-09-22 16:12	53.52	OK	3218	2026-09-22 16:13	51.67	OK
3219	2026-09-22 16:14	51.86	OK	3220	2026-09-22 16:15	53.69	OK
3221	2026-09-22 16:16	52.42	OK	3222	2026-09-22 16:17	53.75	OK
3223	2026-09-22 16:18	53.47	OK	3224	2026-09-22 16:19	52.20	OK
3225	2026-09-22 16:20	52.50	OK	3226	2026-09-22 16:21	53.65	OK
3227	2026-09-22 16:22	53.34	OK	3228	2026-09-22 16:23	52.52	OK
3229	2026-09-22 16:24	53.06	OK	3230	2026-09-22 16:25	53.09	OK
3231	2026-09-22 16:26	52.55	OK	3232	2026-09-22 16:27	52.20	OK
3233	2026-09-22 16:28	53.36	OK	3234	2026-09-22 16:29	53.54	OK
3235	2026-09-22 16:30	52.35	OK	3236	2026-09-22 16:31	52.38	OK
3237	2026-09-22 16:32	52.00	OK	3238	2026-09-22 16:33	52.74	OK
3239	2026-09-22 16:34	52.61	OK	3240	2026-09-22 16:35	52.97	OK
3241	2026-09-22 16:36	52.57	OK	3242	2026-09-22 16:37	52.16	OK
3243	2026-09-22 16:38	53.20	OK	3244	2026-09-22 16:39	54.14	OK
3245	2026-09-22 16:40	53.87	OK	3246	2026-09-22 16:41	54.33	OK
3247	2026-09-22 16:42	54.10	OK	3248	2026-09-22 16:43	53.11	OK
3249	2026-09-22 16:44	53.54	OK	3250	2026-09-22 16:45	53.77	OK
3251	2026-09-22 16:46	53.40	OK	3252	2026-09-22 16:47	51.70	OK
3253	2026-09-22 16:48	51.80	OK	3254	2026-09-22 16:49	51.56	OK
3255	2026-09-22 16:50	53.64	OK	3256	2026-09-22 16:51	53.89	OK
3257	2026-09-22 16:52	52.18	OK	3258	2026-09-22 16:53	54.37	OK
3259	2026-09-22 16:54	53.60	OK	3260	2026-09-22 16:55	53.81	OK
3261	2026-09-22 16:56	54.66	OK	3262	2026-09-22 16:57	53.73	OK
3263	2026-09-22 16:58	53.49	OK	3264	2026-09-22 16:59	52.88	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3265	2026-09-22 17:00	52.96	OK	3266	2026-09-22 17:01	54.34	OK
3267	2026-09-22 17:02	53.88	OK	3268	2026-09-22 17:03	52.37	OK
3269	2026-09-22 17:04	53.81	OK	3270	2026-09-22 17:05	53.79	OK
3271	2026-09-22 17:06	54.98	OK	3272	2026-09-22 17:07	52.59	OK
3273	2026-09-22 17:08	53.42	OK	3274	2026-09-22 17:09	53.72	OK
3275	2026-09-22 17:10	53.41	OK	3276	2026-09-22 17:11	53.15	OK
3277	2026-09-22 17:12	52.74	OK	3278	2026-09-22 17:13	53.69	OK
3279	2026-09-22 17:14	52.67	OK	3280	2026-09-22 17:15	52.83	OK
3281	2026-09-22 17:16	52.99	OK	3282	2026-09-22 17:17	52.37	OK
3283	2026-09-22 17:18	53.81	OK	3284	2026-09-22 17:19	53.33	OK
3285	2026-09-22 17:20	51.46	OK	3286	2026-09-22 17:21	53.65	OK
3287	2026-09-22 17:22	52.62	OK	3288	2026-09-22 17:23	52.71	OK
3289	2026-09-22 17:24	52.25	OK	3290	2026-09-22 17:25	52.49	OK
3291	2026-09-22 17:26	53.02	OK	3292	2026-09-22 17:27	53.43	OK
3293	2026-09-22 17:28	52.05	OK	3294	2026-09-22 17:29	52.63	OK
3295	2026-09-22 17:30	52.81	OK	3296	2026-09-22 17:31	52.77	OK
3297	2026-09-22 17:32	51.98	OK	3298	2026-09-22 17:33	51.43	OK
3299	2026-09-22 17:34	52.34	OK	3300	2026-09-22 17:35	53.08	OK
3301	2026-09-22 17:36	52.19	OK	3302	2026-09-22 17:37	54.13	OK
3303	2026-09-22 17:38	53.45	OK	3304	2026-09-22 17:39	52.54	OK
3305	2026-09-22 17:40	52.96	OK	3306	2026-09-22 17:41	52.71	OK
3307	2026-09-22 17:42	52.42	OK	3308	2026-09-22 17:43	53.53	OK
3309	2026-09-22 17:44	53.06	OK	3310	2026-09-22 17:45	52.87	OK
3311	2026-09-22 17:46	53.08	OK	3312	2026-09-22 17:47	53.43	OK
3313	2026-09-22 17:48	53.79	OK	3314	2026-09-22 17:49	53.90	OK
3315	2026-09-22 17:50	53.28	OK	3316	2026-09-22 17:51	52.10	OK
3317	2026-09-22 17:52	53.80	OK	3318	2026-09-22 17:53	52.67	OK
3319	2026-09-22 17:54	54.03	OK	3320	2026-09-22 17:55	52.66	OK
3321	2026-09-22 17:56	53.82	OK	3322	2026-09-22 17:57	52.21	OK
3323	2026-09-22 17:58	51.94	OK	3324	2026-09-22 17:59	52.78	OK
3325	2026-09-22 18:00	53.34	OK	3326	2026-09-22 18:01	53.19	OK
3327	2026-09-22 18:02	54.69	OK	3328	2026-09-22 18:03	52.68	OK
3329	2026-09-22 18:04	53.76	OK	3330	2026-09-22 18:05	52.55	OK
3331	2026-09-22 18:06	53.12	OK	3332	2026-09-22 18:07	52.77	OK
3333	2026-09-22 18:08	52.91	OK	3334	2026-09-22 18:09	52.95	OK
3335	2026-09-22 18:10	51.92	OK	3336	2026-09-22 18:11	53.49	OK
3337	2026-09-22 18:12	51.69	OK	3338	2026-09-22 18:13	52.62	OK
3339	2026-09-22 18:14	53.30	OK	3340	2026-09-22 18:15	53.15	OK
3341	2026-09-22 18:16	54.45	OK	3342	2026-09-22 18:17	52.04	OK
3343	2026-09-22 18:18	54.28	OK	3344	2026-09-22 18:19	53.59	OK
3345	2026-09-22 18:20	54.46	OK	3346	2026-09-22 18:21	51.55	OK
3347	2026-09-22 18:22	52.66	OK	3348	2026-09-22 18:23	53.44	OK
3349	2026-09-22 18:24	52.82	OK	3350	2026-09-22 18:25	52.51	OK
3351	2026-09-22 18:26	53.24	OK	3352	2026-09-22 18:27	53.16	OK
3353	2026-09-22 18:28	52.39	OK	3354	2026-09-22 18:29	53.35	OK
3355	2026-09-22 18:30	53.73	OK	3356	2026-09-22 18:31	52.75	OK
3357	2026-09-22 18:32	51.22	OK	3358	2026-09-22 18:33	54.37	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3359	2026-09-22 18:34	53.61	OK	3360	2026-09-22 18:35	54.66	OK
3361	2026-09-22 18:36	52.80	OK	3362	2026-09-22 18:37	52.35	OK
3363	2026-09-22 18:38	51.27	OK	3364	2026-09-22 18:39	52.65	OK
3365	2026-09-22 18:40	52.74	OK	3366	2026-09-22 18:41	52.46	OK
3367	2026-09-22 18:42	52.97	OK	3368	2026-09-22 18:43	52.43	OK
3369	2026-09-22 18:44	53.81	OK	3370	2026-09-22 18:45	53.51	OK
3371	2026-09-22 18:46	52.14	OK	3372	2026-09-22 18:47	52.37	OK
3373	2026-09-22 18:48	53.73	OK	3374	2026-09-22 18:49	53.22	OK
3375	2026-09-22 18:50	53.22	OK	3376	2026-09-22 18:51	53.70	OK
3377	2026-09-22 18:52	54.02	OK	3378	2026-09-22 18:53	52.44	OK
3379	2026-09-22 18:54	54.20	OK	3380	2026-09-22 18:55	53.35	OK
3381	2026-09-22 18:56	52.56	OK	3382	2026-09-22 18:57	52.20	OK
3383	2026-09-22 18:58	54.24	OK	3384	2026-09-22 18:59	52.32	OK
3385	2026-09-22 19:00	52.44	OK	3386	2026-09-22 19:01	52.56	OK
3387	2026-09-22 19:02	53.64	OK	3388	2026-09-22 19:03	53.20	OK
3389	2026-09-22 19:04	52.32	OK	3390	2026-09-22 19:05	53.23	OK
3391	2026-09-22 19:06	52.90	OK	3392	2026-09-22 19:07	52.12	OK
3393	2026-09-22 19:08	52.62	OK	3394	2026-09-22 19:09	53.25	OK
3395	2026-09-22 19:10	52.25	OK	3396	2026-09-22 19:11	52.77	OK
3397	2026-09-22 19:12	53.22	OK	3398	2026-09-22 19:13	51.66	OK
3399	2026-09-22 19:14	53.06	OK	3400	2026-09-22 19:15	51.87	OK
3401	2026-09-22 19:16	54.05	OK	3402	2026-09-22 19:17	53.65	OK
3403	2026-09-22 19:18	52.61	OK	3404	2026-09-22 19:19	52.42	OK
3405	2026-09-22 19:20	53.88	OK	3406	2026-09-22 19:21	51.50	OK
3407	2026-09-22 19:22	52.34	OK	3408	2026-09-22 19:23	54.13	OK
3409	2026-09-22 19:24	52.81	OK	3410	2026-09-22 19:25	53.55	OK
3411	2026-09-22 19:26	52.68	OK	3412	2026-09-22 19:27	51.65	OK
3413	2026-09-22 19:28	51.05	OK	3414	2026-09-22 19:29	53.07	OK
3415	2026-09-22 19:30	52.36	OK	3416	2026-09-22 19:31	53.01	OK
3417	2026-09-22 19:32	52.29	OK	3418	2026-09-22 19:33	51.13	OK
3419	2026-09-22 19:34	52.35	OK	3420	2026-09-22 19:35	52.64	OK
3421	2026-09-22 19:36	52.22	OK	3422	2026-09-22 19:37	53.17	OK
3423	2026-09-22 19:38	53.91	OK	3424	2026-09-22 19:39	52.75	OK
3425	2026-09-22 19:40	52.73	OK	3426	2026-09-22 19:41	52.54	OK
3427	2026-09-22 19:42	52.78	OK	3428	2026-09-22 19:43	53.00	OK
3429	2026-09-22 19:44	52.17	OK	3430	2026-09-22 19:45	53.35	OK
3431	2026-09-22 19:46	51.77	OK	3432	2026-09-22 19:47	52.75	OK
3433	2026-09-22 19:48	53.36	OK	3434	2026-09-22 19:49	51.34	OK
3435	2026-09-22 19:50	51.76	OK	3436	2026-09-22 19:51	52.92	OK
3437	2026-09-22 19:52	51.44	OK	3438	2026-09-22 19:53	52.71	OK
3439	2026-09-22 19:54	53.03	OK	3440	2026-09-22 19:55	52.08	OK
3441	2026-09-22 19:56	53.87	OK	3442	2026-09-22 19:57	53.58	OK
3443	2026-09-22 19:58	51.95	OK	3444	2026-09-22 19:59	53.80	OK
3445	2026-09-22 20:00	52.39	OK	3446	2026-09-22 20:01	52.08	OK
3447	2026-09-22 20:02	51.55	OK	3448	2026-09-22 20:03	52.50	OK
3449	2026-09-22 20:04	52.39	OK	3450	2026-09-22 20:05	52.30	OK
3451	2026-09-22 20:06	53.27	OK	3452	2026-09-22 20:07	53.13	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3453	2026-09-22 20:08	52.67	OK	3454	2026-09-22 20:09	51.45	OK
3455	2026-09-22 20:10	50.93	OK	3456	2026-09-22 20:11	52.05	OK
3457	2026-09-22 20:12	53.12	OK	3458	2026-09-22 20:13	52.56	OK
3459	2026-09-22 20:14	51.01	OK	3460	2026-09-22 20:15	51.33	OK
3461	2026-09-22 20:16	52.62	OK	3462	2026-09-22 20:17	52.91	OK
3463	2026-09-22 20:18	50.91	OK	3464	2026-09-22 20:19	52.77	OK
3465	2026-09-22 20:20	52.01	OK	3466	2026-09-22 20:21	52.31	OK
3467	2026-09-22 20:22	52.06	OK	3468	2026-09-22 20:23	51.96	OK
3469	2026-09-22 20:24	51.90	OK	3470	2026-09-22 20:25	50.53	OK
3471	2026-09-22 20:26	52.04	OK	3472	2026-09-22 20:27	52.58	OK
3473	2026-09-22 20:28	50.70	OK	3474	2026-09-22 20:29	50.92	OK
3475	2026-09-22 20:30	51.75	OK	3476	2026-09-22 20:31	52.11	OK
3477	2026-09-22 20:32	51.24	OK	3478	2026-09-22 20:33	51.77	OK
3479	2026-09-22 20:34	52.24	OK	3480	2026-09-22 20:35	51.82	OK
3481	2026-09-22 20:36	51.97	OK	3482	2026-09-22 20:37	52.34	OK
3483	2026-09-22 20:38	51.53	OK	3484	2026-09-22 20:39	51.06	OK
3485	2026-09-22 20:40	50.41	OK	3486	2026-09-22 20:41	51.80	OK
3487	2026-09-22 20:42	51.57	OK	3488	2026-09-22 20:43	52.76	OK
3489	2026-09-22 20:44	51.22	OK	3490	2026-09-22 20:45	52.96	OK
3491	2026-09-22 20:46	52.61	OK	3492	2026-09-22 20:47	50.80	OK
3493	2026-09-22 20:48	51.65	OK	3494	2026-09-22 20:49	52.14	OK
3495	2026-09-22 20:50	52.42	OK	3496	2026-09-22 20:51	50.95	OK
3497	2026-09-22 20:52	51.96	OK	3498	2026-09-22 20:53	51.31	OK
3499	2026-09-22 20:54	51.93	OK	3500	2026-09-22 20:55	52.00	OK
3501	2026-09-22 20:56	52.63	OK	3502	2026-09-22 20:57	53.20	OK
3503	2026-09-22 20:58	50.51	OK	3504	2026-09-22 20:59	52.53	OK
3505	2026-09-22 21:00	51.28	OK	3506	2026-09-22 21:01	51.83	OK
3507	2026-09-22 21:02	50.81	OK	3508	2026-09-22 21:03	50.29	OK
3509	2026-09-22 21:04	50.77	OK	3510	2026-09-22 21:05	52.04	OK
3511	2026-09-22 21:06	52.07	OK	3512	2026-09-22 21:07	51.33	OK
3513	2026-09-22 21:08	51.15	OK	3514	2026-09-22 21:09	51.12	OK
3515	2026-09-22 21:10	50.79	OK	3516	2026-09-22 21:11	52.00	OK
3517	2026-09-22 21:12	50.48	OK	3518	2026-09-22 21:13	52.81	OK
3519	2026-09-22 21:14	50.94	OK	3520	2026-09-22 21:15	52.28	OK
3521	2026-09-22 21:16	51.67	OK	3522	2026-09-22 21:17	52.71	OK
3523	2026-09-22 21:18	51.86	OK	3524	2026-09-22 21:19	50.63	OK
3525	2026-09-22 21:20	51.52	OK	3526	2026-09-22 21:21	50.48	OK
3527	2026-09-22 21:22	50.96	OK	3528	2026-09-22 21:23	51.36	OK
3529	2026-09-22 21:24	51.28	OK	3530	2026-09-22 21:25	52.01	OK
3531	2026-09-22 21:26	51.58	OK	3532	2026-09-22 21:27	50.58	OK
3533	2026-09-22 21:28	51.24	OK	3534	2026-09-22 21:29	50.67	OK
3535	2026-09-22 21:30	50.84	OK	3536	2026-09-22 21:31	51.24	OK
3537	2026-09-22 21:32	51.24	OK	3538	2026-09-22 21:33	51.01	OK
3539	2026-09-22 21:34	51.22	OK	3540	2026-09-22 21:35	51.70	OK
3541	2026-09-22 21:36	50.62	OK	3542	2026-09-22 21:37	49.90	OK
3543	2026-09-22 21:38	51.27	OK	3544	2026-09-22 21:39	50.27	OK
3545	2026-09-22 21:40	49.50	OK	3546	2026-09-22 21:41	50.12	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3547	2026-09-22 21:42	50.32	OK	3548	2026-09-22 21:43	51.46	OK
3549	2026-09-22 21:44	49.94	OK	3550	2026-09-22 21:45	50.00	OK
3551	2026-09-22 21:46	51.32	OK	3552	2026-09-22 21:47	51.03	OK
3553	2026-09-22 21:48	51.67	OK	3554	2026-09-22 21:49	50.67	OK
3555	2026-09-22 21:50	51.90	OK	3556	2026-09-22 21:51	50.39	OK
3557	2026-09-22 21:52	49.88	OK	3558	2026-09-22 21:53	50.66	OK
3559	2026-09-22 21:54	50.15	OK	3560	2026-09-22 21:55	49.76	OK
3561	2026-09-22 21:56	49.28	OK	3562	2026-09-22 21:57	50.96	OK
3563	2026-09-22 21:58	50.58	OK	3564	2026-09-22 21:59	51.43	OK
3565	2026-09-22 22:00	51.09	OK	3566	2026-09-22 22:01	49.30	OK
3567	2026-09-22 22:02	49.46	OK	3568	2026-09-22 22:03	49.86	OK
3569	2026-09-22 22:04	51.77	OK	3570	2026-09-22 22:05	49.40	OK
3571	2026-09-22 22:06	49.94	OK	3572	2026-09-22 22:07	49.58	OK
3573	2026-09-22 22:08	50.28	OK	3574	2026-09-22 22:09	50.11	OK
3575	2026-09-22 22:10	49.54	OK	3576	2026-09-22 22:11	50.14	OK
3577	2026-09-22 22:12	49.35	OK	3578	2026-09-22 22:13	50.78	OK
3579	2026-09-22 22:14	49.95	OK	3580	2026-09-22 22:15	50.42	OK
3581	2026-09-22 22:16	49.80	OK	3582	2026-09-22 22:17	49.67	OK
3583	2026-09-22 22:18	49.47	OK	3584	2026-09-22 22:19	50.16	OK
3585	2026-09-22 22:20	49.89	OK	3586	2026-09-22 22:21	49.76	OK
3587	2026-09-22 22:22	50.09	OK	3588	2026-09-22 22:23	49.88	OK
3589	2026-09-22 22:24	49.44	OK	3590	2026-09-22 22:25	49.81	OK
3591	2026-09-22 22:26	49.70	OK	3592	2026-09-22 22:27	49.35	OK
3593	2026-09-22 22:28	49.88	OK	3594	2026-09-22 22:29	51.40	OK
3595	2026-09-22 22:30	49.97	OK	3596	2026-09-22 22:31	49.77	OK
3597	2026-09-22 22:32	49.55	OK	3598	2026-09-22 22:33	49.51	OK
3599	2026-09-22 22:34	49.19	OK	3600	2026-09-22 22:35	48.43	OK
3601	2026-09-22 22:36	48.38	OK	3602	2026-09-22 22:37	50.72	OK
3603	2026-09-22 22:38	49.88	OK	3604	2026-09-22 22:39	48.42	OK
3605	2026-09-22 22:40	50.08	OK	3606	2026-09-22 22:41	49.34	OK
3607	2026-09-22 22:42	49.96	OK	3608	2026-09-22 22:43	48.27	OK
3609	2026-09-22 22:44	49.14	OK	3610	2026-09-22 22:45	48.19	OK
3611	2026-09-22 22:46	49.83	OK	3612	2026-09-22 22:47	51.00	OK
3613	2026-09-22 22:48	50.05	OK	3614	2026-09-22 22:49	49.38	OK
3615	2026-09-22 22:50	48.16	OK	3616	2026-09-22 22:51	50.19	OK
3617	2026-09-22 22:52	49.91	OK	3618	2026-09-22 22:53	49.44	OK
3619	2026-09-22 22:54	49.21	OK	3620	2026-09-22 22:55	49.63	OK
3621	2026-09-22 22:56	48.11	OK	3622	2026-09-22 22:57	47.74	OK
3623	2026-09-22 22:58	50.30	OK	3624	2026-09-22 22:59	49.73	OK
3625	2026-09-22 23:00	50.28	OK	3626	2026-09-22 23:01	49.39	OK
3627	2026-09-22 23:02	48.82	OK	3628	2026-09-22 23:03	49.65	OK
3629	2026-09-22 23:04	48.88	OK	3630	2026-09-22 23:05	49.06	OK
3631	2026-09-22 23:06	48.57	OK	3632	2026-09-22 23:07	47.02	OK
3633	2026-09-22 23:08	47.78	OK	3634	2026-09-22 23:09	48.43	OK
3635	2026-09-22 23:10	48.56	OK	3636	2026-09-22 23:11	47.91	OK
3637	2026-09-22 23:12	49.07	OK	3638	2026-09-22 23:13	49.24	OK
3639	2026-09-22 23:14	48.77	OK	3640	2026-09-22 23:15	49.51	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3641	2026-09-22 23:16	48.07	OK	3642	2026-09-22 23:17	48.34	OK
3643	2026-09-22 23:18	48.89	OK	3644	2026-09-22 23:19	49.01	OK
3645	2026-09-22 23:20	50.10	OK	3646	2026-09-22 23:21	47.94	OK
3647	2026-09-22 23:22	49.63	OK	3648	2026-09-22 23:23	47.44	OK
3649	2026-09-22 23:24	49.85	OK	3650	2026-09-22 23:25	50.09	OK
3651	2026-09-22 23:26	47.60	OK	3652	2026-09-22 23:27	49.37	OK
3653	2026-09-22 23:28	49.36	OK	3654	2026-09-22 23:29	48.92	OK
3655	2026-09-22 23:30	48.12	OK	3656	2026-09-22 23:31	48.32	OK
3657	2026-09-22 23:32	48.53	OK	3658	2026-09-22 23:33	48.03	OK
3659	2026-09-22 23:34	49.44	OK	3660	2026-09-22 23:35	48.76	OK
3661	2026-09-22 23:36	49.27	OK	3662	2026-09-22 23:37	49.42	OK
3663	2026-09-22 23:38	49.47	OK	3664	2026-09-22 23:39	48.89	OK
3665	2026-09-22 23:40	48.61	OK	3666	2026-09-22 23:41	48.04	OK
3667	2026-09-22 23:42	48.84	OK	3668	2026-09-22 23:43	49.60	OK
3669	2026-09-22 23:44	47.84	OK	3670	2026-09-22 23:45	48.85	OK
3671	2026-09-22 23:46	48.75	OK	3672	2026-09-22 23:47	47.40	OK
3673	2026-09-22 23:48	48.45	OK	3674	2026-09-22 23:49	48.93	OK
3675	2026-09-22 23:50	47.18	OK	3676	2026-09-22 23:51	48.17	OK
3677	2026-09-22 23:52	46.68	OK	3678	2026-09-22 23:53	47.90	OK
3679	2026-09-22 23:54	48.85	OK	3680	2026-09-22 23:55	47.08	OK
3681	2026-09-22 23:56	48.07	OK	3682	2026-09-22 23:57	47.85	OK
3683	2026-09-22 23:58	48.75	OK	3684	2026-09-22 23:59	48.13	OK
3685	2026-09-23 00:00	47.33	OK	3686	2026-09-23 00:01	47.66	OK
3687	2026-09-23 00:02	47.60	OK	3688	2026-09-23 00:03	48.32	OK
3689	2026-09-23 00:04	48.89	OK	3690	2026-09-23 00:05	46.77	OK
3691	2026-09-23 00:06	46.77	OK	3692	2026-09-23 00:07	46.22	OK
3693	2026-09-23 00:08	47.43	OK	3694	2026-09-23 00:09	48.46	OK
3695	2026-09-23 00:10	46.55	OK	3696	2026-09-23 00:11	47.89	OK
3697	2026-09-23 00:12	48.79	OK	3698	2026-09-23 00:13	48.91	OK
3699	2026-09-23 00:14	48.96	OK	3700	2026-09-23 00:15	47.24	OK
3701	2026-09-23 00:16	46.17	OK	3702	2026-09-23 00:17	46.79	OK
3703	2026-09-23 00:18	47.11	OK	3704	2026-09-23 00:19	46.64	OK
3705	2026-09-23 00:20	47.13	OK	3706	2026-09-23 00:21	46.88	OK
3707	2026-09-23 00:22	47.63	OK	3708	2026-09-23 00:23	46.74	OK
3709	2026-09-23 00:24	47.12	OK	3710	2026-09-23 00:25	46.52	OK
3711	2026-09-23 00:26	47.78	OK	3712	2026-09-23 00:27	47.50	OK
3713	2026-09-23 00:28	45.70	OK	3714	2026-09-23 00:29	48.83	OK
3715	2026-09-23 00:30	48.48	OK	3716	2026-09-23 00:31	45.51	OK
3717	2026-09-23 00:32	45.56	OK	3718	2026-09-23 00:33	46.00	OK
3719	2026-09-23 00:34	48.44	OK	3720	2026-09-23 00:35	46.14	OK
3721	2026-09-23 00:36	47.02	OK	3722	2026-09-23 00:37	45.96	OK
3723	2026-09-23 00:38	47.67	OK	3724	2026-09-23 00:39	47.39	OK
3725	2026-09-23 00:40	46.38	OK	3726	2026-09-23 00:41	47.81	OK
3727	2026-09-23 00:42	46.49	OK	3728	2026-09-23 00:43	47.32	OK
3729	2026-09-23 00:44	46.63	OK	3730	2026-09-23 00:45	47.57	OK
3731	2026-09-23 00:46	46.52	OK	3732	2026-09-23 00:47	46.31	OK
3733	2026-09-23 00:48	47.66	OK	3734	2026-09-23 00:49	46.82	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3735	2026-09-23 00:50	46.27	OK	3736	2026-09-23 00:51	45.93	OK
3737	2026-09-23 00:52	47.27	OK	3738	2026-09-23 00:53	47.27	OK
3739	2026-09-23 00:54	46.93	OK	3740	2026-09-23 00:55	47.24	OK
3741	2026-09-23 00:56	45.75	OK	3742	2026-09-23 00:57	46.51	OK
3743	2026-09-23 00:58	45.73	OK	3744	2026-09-23 00:59	46.72	OK
3745	2026-09-23 01:00	47.03	OK	3746	2026-09-23 01:01	47.47	OK
3747	2026-09-23 01:02	46.48	OK	3748	2026-09-23 01:03	47.47	OK
3749	2026-09-23 01:04	47.24	OK	3750	2026-09-23 01:05	46.55	OK
3751	2026-09-23 01:06	46.27	OK	3752	2026-09-23 01:07	46.73	OK
3753	2026-09-23 01:08	46.54	OK	3754	2026-09-23 01:09	46.33	OK
3755	2026-09-23 01:10	46.56	OK	3756	2026-09-23 01:11	46.26	OK
3757	2026-09-23 01:12	46.08	OK	3758	2026-09-23 01:13	46.73	OK
3759	2026-09-23 01:14	46.30	OK	3760	2026-09-23 01:15	45.59	OK
3761	2026-09-23 01:16	47.04	OK	3762	2026-09-23 01:17	44.68	OK
3763	2026-09-23 01:18	46.25	OK	3764	2026-09-23 01:19	45.89	OK
3765	2026-09-23 01:20	46.20	OK	3766	2026-09-23 01:21	47.43	OK
3767	2026-09-23 01:22	45.77	OK	3768	2026-09-23 01:23	47.56	OK
3769	2026-09-23 01:24	47.17	OK	3770	2026-09-23 01:25	44.94	OK
3771	2026-09-23 01:26	46.76	OK	3772	2026-09-23 01:27	46.91	OK
3773	2026-09-23 01:28	45.45	OK	3774	2026-09-23 01:29	46.56	OK
3775	2026-09-23 01:30	46.03	OK	3776	2026-09-23 01:31	45.81	OK
3777	2026-09-23 01:32	46.00	OK	3778	2026-09-23 01:33	47.00	OK
3779	2026-09-23 01:34	45.12	OK	3780	2026-09-23 01:35	45.66	OK
3781	2026-09-23 01:36	45.94	OK	3782	2026-09-23 01:37	47.04	OK
3783	2026-09-23 01:38	46.23	OK	3784	2026-09-23 01:39	45.13	OK
3785	2026-09-23 01:40	46.49	OK	3786	2026-09-23 01:41	45.75	OK
3787	2026-09-23 01:42	45.54	OK	3788	2026-09-23 01:43	44.48	OK
3789	2026-09-23 01:44	45.94	OK	3790	2026-09-23 01:45	44.45	OK
3791	2026-09-23 01:46	44.57	OK	3792	2026-09-23 01:47	44.60	OK
3793	2026-09-23 01:48	45.82	OK	3794	2026-09-23 01:49	45.03	OK
3795	2026-09-23 01:50	47.02	OK	3796	2026-09-23 01:51	45.41	OK
3797	2026-09-23 01:52	45.30	OK	3798	2026-09-23 01:53	44.87	OK
3799	2026-09-23 01:54	44.79	OK	3800	2026-09-23 01:55	46.55	OK
3801	2026-09-23 01:56	46.05	OK	3802	2026-09-23 01:57	45.91	OK
3803	2026-09-23 01:58	44.40	OK	3804	2026-09-23 01:59	46.46	OK
3805	2026-09-23 02:00	46.17	OK	3806	2026-09-23 02:01	46.37	OK
3807	2026-09-23 02:02	45.99	OK	3808	2026-09-23 02:03	46.41	OK
3809	2026-09-23 02:04	46.25	OK	3810	2026-09-23 02:05	44.68	OK
3811	2026-09-23 02:06	44.76	OK	3812	2026-09-23 02:07	47.00	OK
3813	2026-09-23 02:08	45.95	OK	3814	2026-09-23 02:09	44.61	OK
3815	2026-09-23 02:10	46.58	OK	3816	2026-09-23 02:11	45.21	OK
3817	2026-09-23 02:12	45.44	OK	3818	2026-09-23 02:13	45.48	OK
3819	2026-09-23 02:14	45.27	OK	3820	2026-09-23 02:15	45.99	OK
3821	2026-09-23 02:16	45.56	OK	3822	2026-09-23 02:17	45.62	OK
3823	2026-09-23 02:18	45.07	OK	3824	2026-09-23 02:19	44.54	OK
3825	2026-09-23 02:20	44.80	OK	3826	2026-09-23 02:21	44.96	OK
3827	2026-09-23 02:22	45.36	OK	3828	2026-09-23 02:23	45.00	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3829	2026-09-23 02:24	45.25	OK	3830	2026-09-23 02:25	44.84	OK
3831	2026-09-23 02:26	44.60	OK	3832	2026-09-23 02:27	44.97	OK
3833	2026-09-23 02:28	46.33	OK	3834	2026-09-23 02:29	44.97	OK
3835	2026-09-23 02:30	44.76	OK	3836	2026-09-23 02:31	45.05	OK
3837	2026-09-23 02:32	44.54	OK	3838	2026-09-23 02:33	44.75	OK
3839	2026-09-23 02:34	44.99	OK	3840	2026-09-23 02:35	45.07	OK
3841	2026-09-23 02:36	45.12	OK	3842	2026-09-23 02:37	44.89	OK
3843	2026-09-23 02:38	44.93	OK	3844	2026-09-23 02:39	45.01	OK
3845	2026-09-23 02:40	45.32	OK	3846	2026-09-23 02:41	45.53	OK
3847	2026-09-23 02:42	45.86	OK	3848	2026-09-23 02:43	44.11	OK
3849	2026-09-23 02:44	44.31	OK	3850	2026-09-23 02:45	45.45	OK
3851	2026-09-23 02:46	44.91	OK	3852	2026-09-23 02:47	44.82	OK
3853	2026-09-23 02:48	44.95	OK	3854	2026-09-23 02:49	45.89	OK
3855	2026-09-23 02:50	45.43	OK	3856	2026-09-23 02:51	44.88	OK
3857	2026-09-23 02:52	43.15	OK	3858	2026-09-23 02:53	45.88	OK
3859	2026-09-23 02:54	44.26	OK	3860	2026-09-23 02:55	45.00	OK
3861	2026-09-23 02:56	44.77	OK	3862	2026-09-23 02:57	43.63	OK
3863	2026-09-23 02:58	45.71	OK	3864	2026-09-23 02:59	45.15	OK
3865	2026-09-23 03:00	45.40	OK	3866	2026-09-23 03:01	44.84	OK
3867	2026-09-23 03:02	44.80	OK	3868	2026-09-23 03:03	45.44	OK
3869	2026-09-23 03:04	43.23	OK	3870	2026-09-23 03:05	45.42	OK
3871	2026-09-23 03:06	44.91	OK	3872	2026-09-23 03:07	43.64	OK
3873	2026-09-23 03:08	43.63	OK	3874	2026-09-23 03:09	43.21	OK
3875	2026-09-23 03:10	44.03	OK	3876	2026-09-23 03:11	44.19	OK
3877	2026-09-23 03:12	44.80	OK	3878	2026-09-23 03:13	43.12	OK
3879	2026-09-23 03:14	44.03	OK	3880	2026-09-23 03:15	44.73	OK
3881	2026-09-23 03:16	44.69	OK	3882	2026-09-23 03:17	44.18	OK
3883	2026-09-23 03:18	44.01	OK	3884	2026-09-23 03:19	44.86	OK
3885	2026-09-23 03:20	43.46	OK	3886	2026-09-23 03:21	43.80	OK
3887	2026-09-23 03:22	44.70	OK	3888	2026-09-23 03:23	43.84	OK
3889	2026-09-23 03:24	43.57	OK	3890	2026-09-23 03:25	44.98	OK
3891	2026-09-23 03:26	44.43	OK	3892	2026-09-23 03:27	43.26	OK
3893	2026-09-23 03:28	44.73	OK	3894	2026-09-23 03:29	43.97	OK
3895	2026-09-23 03:30	43.14	OK	3896	2026-09-23 03:31	45.88	OK
3897	2026-09-23 03:32	45.25	OK	3898	2026-09-23 03:33	44.74	OK
3899	2026-09-23 03:34	43.31	OK	3900	2026-09-23 03:35	44.72	OK
3901	2026-09-23 03:36	42.54	OK	3902	2026-09-23 03:37	43.98	OK
3903	2026-09-23 03:38	43.70	OK	3904	2026-09-23 03:39	44.03	OK
3905	2026-09-23 03:40	44.31	OK	3906	2026-09-23 03:41	44.23	OK
3907	2026-09-23 03:42	45.04	OK	3908	2026-09-23 03:43	43.14	OK
3909	2026-09-23 03:44	43.61	OK	3910	2026-09-23 03:45	43.41	OK
3911	2026-09-23 03:46	43.45	OK	3912	2026-09-23 03:47	44.15	OK
3913	2026-09-23 03:48	43.01	OK	3914	2026-09-23 03:49	43.93	OK
3915	2026-09-23 03:50	43.90	OK	3916	2026-09-23 03:51	44.57	OK
3917	2026-09-23 03:52	43.61	OK	3918	2026-09-23 03:53	42.61	OK
3919	2026-09-23 03:54	43.19	OK	3920	2026-09-23 03:55	43.55	OK
3921	2026-09-23 03:56	43.66	OK	3922	2026-09-23 03:57	43.39	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3923	2026-09-23 03:58	43.82	OK	3924	2026-09-23 03:59	45.63	OK
3925	2026-09-23 04:00	43.95	OK	3926	2026-09-23 04:01	43.73	OK
3927	2026-09-23 04:02	44.72	OK	3928	2026-09-23 04:03	42.97	OK
3929	2026-09-23 04:04	43.45	OK	3930	2026-09-23 04:05	44.08	OK
3931	2026-09-23 04:06	44.70	OK	3932	2026-09-23 04:07	42.63	OK
3933	2026-09-23 04:08	42.62	OK	3934	2026-09-23 04:09	43.35	OK
3935	2026-09-23 04:10	43.80	OK	3936	2026-09-23 04:11	43.06	OK
3937	2026-09-23 04:12	44.97	OK	3938	2026-09-23 04:13	43.14	OK
3939	2026-09-23 04:14	44.42	OK	3940	2026-09-23 04:15	43.88	OK
3941	2026-09-23 04:16	44.18	OK	3942	2026-09-23 04:17	43.16	OK
3943	2026-09-23 04:18	44.01	OK	3944	2026-09-23 04:19	42.82	OK
3945	2026-09-23 04:20	42.58	OK	3946	2026-09-23 04:21	44.49	OK
3947	2026-09-23 04:22	42.69	OK	3948	2026-09-23 04:23	43.69	OK
3949	2026-09-23 04:24	43.73	OK	3950	2026-09-23 04:25	43.58	OK
3951	2026-09-23 04:26	42.97	OK	3952	2026-09-23 04:27	43.45	OK
3953	2026-09-23 04:28	43.30	OK	3954	2026-09-23 04:29	43.04	OK
3955	2026-09-23 04:30	42.80	OK	3956	2026-09-23 04:31	43.39	OK
3957	2026-09-23 04:32	44.18	OK	3958	2026-09-23 04:33	42.01	OK
3959	2026-09-23 04:34	45.27	OK	3960	2026-09-23 04:35	43.04	OK
3961	2026-09-23 04:36	44.85	OK	3962	2026-09-23 04:37	43.17	OK
3963	2026-09-23 04:38	42.89	OK	3964	2026-09-23 04:39	42.81	OK
3965	2026-09-23 04:40	43.17	OK	3966	2026-09-23 04:41	43.57	OK
3967	2026-09-23 04:42	42.93	OK	3968	2026-09-23 04:43	43.48	OK
3969	2026-09-23 04:44	43.66	OK	3970	2026-09-23 04:45	43.44	OK
3971	2026-09-23 04:46	44.26	OK	3972	2026-09-23 04:47	44.66	OK
3973	2026-09-23 04:48	43.82	OK	3974	2026-09-23 04:49	43.31	OK
3975	2026-09-23 04:50	42.99	OK	3976	2026-09-23 04:51	44.62	OK
3977	2026-09-23 04:52	43.94	OK	3978	2026-09-23 04:53	43.25	OK
3979	2026-09-23 04:54	43.89	OK	3980	2026-09-23 04:55	42.46	OK
3981	2026-09-23 04:56	43.92	OK	3982	2026-09-23 04:57	43.97	OK
3983	2026-09-23 04:58	42.73	OK	3984	2026-09-23 04:59	43.06	OK
3985	2026-09-23 05:00	43.66	OK	3986	2026-09-23 05:01	42.73	OK
3987	2026-09-23 05:02	42.83	OK	3988	2026-09-23 05:03	43.95	OK
3989	2026-09-23 05:04	44.51	OK	3990	2026-09-23 05:05	44.28	OK
3991	2026-09-23 05:06	43.84	OK	3992	2026-09-23 05:07	43.84	OK
3993	2026-09-23 05:08	43.49	OK	3994	2026-09-23 05:09	43.07	OK
3995	2026-09-23 05:10	42.84	OK	3996	2026-09-23 05:11	42.91	OK
3997	2026-09-23 05:12	43.37	OK	3998	2026-09-23 05:13	42.60	OK
3999	2026-09-23 05:14	44.44	OK	4000	2026-09-23 05:15	44.00	OK
4001	2026-09-23 05:16	44.57	OK	4002	2026-09-23 05:17	42.50	OK
4003	2026-09-23 05:18	42.96	OK	4004	2026-09-23 05:19	43.99	OK
4005	2026-09-23 05:20	44.25	OK	4006	2026-09-23 05:21	43.26	OK
4007	2026-09-23 05:22	44.06	OK	4008	2026-09-23 05:23	42.91	OK
4009	2026-09-23 05:24	43.99	OK	4010	2026-09-23 05:25	44.12	OK
4011	2026-09-23 05:26	42.75	OK	4012	2026-09-23 05:27	42.88	OK
4013	2026-09-23 05:28	42.85	OK	4014	2026-09-23 05:29	42.85	OK
4015	2026-09-23 05:30	43.62	OK	4016	2026-09-23 05:31	43.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4017	2026-09-23 05:32	43.03	OK	4018	2026-09-23 05:33	43.71	OK
4019	2026-09-23 05:34	42.94	OK	4020	2026-09-23 05:35	42.89	OK
4021	2026-09-23 05:36	44.07	OK	4022	2026-09-23 05:37	43.42	OK
4023	2026-09-23 05:38	43.89	OK	4024	2026-09-23 05:39	43.74	OK
4025	2026-09-23 05:40	43.24	OK	4026	2026-09-23 05:41	43.16	OK
4027	2026-09-23 05:42	43.60	OK	4028	2026-09-23 05:43	43.99	OK
4029	2026-09-23 05:44	42.14	OK	4030	2026-09-23 05:45	41.82	OK
4031	2026-09-23 05:46	43.90	OK	4032	2026-09-23 05:47	43.42	OK
4033	2026-09-23 05:48	43.29	OK	4034	2026-09-23 05:49	42.50	OK
4035	2026-09-23 05:50	44.56	OK	4036	2026-09-23 05:51	44.52	OK
4037	2026-09-23 05:52	43.23	OK	4038	2026-09-23 05:53	42.94	OK
4039	2026-09-23 05:54	42.86	OK	4040	2026-09-23 05:55	42.15	OK
4041	2026-09-23 05:56	43.75	OK	4042	2026-09-23 05:57	43.56	OK
4043	2026-09-23 05:58	43.15	OK	4044	2026-09-23 05:59	42.58	OK
4045	2026-09-23 06:00	43.86	OK	4046	2026-09-23 06:01	44.19	OK
4047	2026-09-23 06:02	43.90	OK	4048	2026-09-23 06:03	42.92	OK
4049	2026-09-23 06:04	43.70	OK	4050	2026-09-23 06:05	43.95	OK
4051	2026-09-23 06:06	43.27	OK	4052	2026-09-23 06:07	45.27	OK
4053	2026-09-23 06:08	42.08	OK	4054	2026-09-23 06:09	44.66	OK
4055	2026-09-23 06:10	43.96	OK	4056	2026-09-23 06:11	43.73	OK
4057	2026-09-23 06:12	42.76	OK	4058	2026-09-23 06:13	44.08	OK
4059	2026-09-23 06:14	43.08	OK	4060	2026-09-23 06:15	44.22	OK
4061	2026-09-23 06:16	43.76	OK	4062	2026-09-23 06:17	44.22	OK
4063	2026-09-23 06:18	43.39	OK	4064	2026-09-23 06:19	41.59	OK
4065	2026-09-23 06:20	42.87	OK	4066	2026-09-23 06:21	43.16	OK
4067	2026-09-23 06:22	43.55	OK	4068	2026-09-23 06:23	43.75	OK
4069	2026-09-23 06:24	42.08	OK	4070	2026-09-23 06:25	44.23	OK
4071	2026-09-23 06:26	43.13	OK	4072	2026-09-23 06:27	43.97	OK
4073	2026-09-23 06:28	43.23	OK	4074	2026-09-23 06:29	43.30	OK
4075	2026-09-23 06:30	44.15	OK	4076	2026-09-23 06:31	42.36	OK
4077	2026-09-23 06:32	44.22	OK	4078	2026-09-23 06:33	44.48	OK
4079	2026-09-23 06:34	43.72	OK	4080	2026-09-23 06:35	43.91	OK
4081	2026-09-23 06:36	43.45	OK	4082	2026-09-23 06:37	41.89	OK
4083	2026-09-23 06:38	43.30	OK	4084	2026-09-23 06:39	43.67	OK
4085	2026-09-23 06:40	43.16	OK	4086	2026-09-23 06:41	43.16	OK
4087	2026-09-23 06:42	43.31	OK	4088	2026-09-23 06:43	44.82	OK
4089	2026-09-23 06:44	43.28	OK	4090	2026-09-23 06:45	43.51	OK
4091	2026-09-23 06:46	44.68	OK	4092	2026-09-23 06:47	43.01	OK
4093	2026-09-23 06:48	43.65	OK	4094	2026-09-23 06:49	43.90	OK
4095	2026-09-23 06:50	43.30	OK	4096	2026-09-23 06:51	43.36	OK
4097	2026-09-23 06:52	43.20	OK	4098	2026-09-23 06:53	43.87	OK
4099	2026-09-23 06:54	42.72	OK	4100	2026-09-23 06:55	42.92	OK
4101	2026-09-23 06:56	43.76	OK	4102	2026-09-23 06:57	43.80	OK
4103	2026-09-23 06:58	43.23	OK	4104	2026-09-23 06:59	42.67	OK
4105	2026-09-23 07:00	43.03	OK	4106	2026-09-23 07:01	43.87	OK
4107	2026-09-23 07:02	43.56	OK	4108	2026-09-23 07:03	44.63	OK
4109	2026-09-23 07:04	43.10	OK	4110	2026-09-23 07:05	44.17	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4111	2026-09-23 07:06	43.91	OK	4112	2026-09-23 07:07	43.26	OK
4113	2026-09-23 07:08	44.45	OK	4114	2026-09-23 07:09	43.37	OK
4115	2026-09-23 07:10	43.19	OK	4116	2026-09-23 07:11	43.30	OK
4117	2026-09-23 07:12	43.59	OK	4118	2026-09-23 07:13	44.78	OK
4119	2026-09-23 07:14	43.01	OK	4120	2026-09-23 07:15	44.38	OK
4121	2026-09-23 07:16	45.56	OK	4122	2026-09-23 07:17	44.22	OK
4123	2026-09-23 07:18	44.91	OK	4124	2026-09-23 07:19	44.18	OK
4125	2026-09-23 07:20	44.58	OK	4126	2026-09-23 07:21	44.91	OK
4127	2026-09-23 07:22	44.17	OK	4128	2026-09-23 07:23	44.62	OK
4129	2026-09-23 07:24	43.83	OK	4130	2026-09-23 07:25	44.16	OK
4131	2026-09-23 07:26	45.18	OK	4132	2026-09-23 07:27	43.46	OK
4133	2026-09-23 07:28	44.13	OK	4134	2026-09-23 07:29	44.07	OK
4135	2026-09-23 07:30	44.30	OK	4136	2026-09-23 07:31	44.76	OK
4137	2026-09-23 07:32	43.01	OK	4138	2026-09-23 07:33	44.54	OK
4139	2026-09-23 07:34	44.28	OK	4140	2026-09-23 07:35	44.05	OK
4141	2026-09-23 07:36	44.05	OK	4142	2026-09-23 07:37	44.21	OK
4143	2026-09-23 07:38	44.24	OK	4144	2026-09-23 07:39	44.99	OK
4145	2026-09-23 07:40	45.39	OK	4146	2026-09-23 07:41	44.37	OK
4147	2026-09-23 07:42	43.28	OK	4148	2026-09-23 07:43	43.56	OK
4149	2026-09-23 07:44	42.79	OK	4150	2026-09-23 07:45	43.76	OK
4151	2026-09-23 07:46	44.49	OK	4152	2026-09-23 07:47	43.62	OK
4153	2026-09-23 07:48	44.38	OK	4154	2026-09-23 07:49	42.89	OK
4155	2026-09-23 07:50	44.48	OK	4156	2026-09-23 07:51	44.93	OK
4157	2026-09-23 07:52	45.03	OK	4158	2026-09-23 07:53	43.77	OK
4159	2026-09-23 07:54	43.56	OK	4160	2026-09-23 07:55	44.15	OK
4161	2026-09-23 07:56	44.37	OK	4162	2026-09-23 07:57	44.27	OK
4163	2026-09-23 07:58	45.17	OK	4164	2026-09-23 07:59	44.03	OK
4165	2026-09-23 08:00	43.66	OK	4166	2026-09-23 08:01	44.76	OK
4167	2026-09-23 08:02	45.10	OK	4168	2026-09-23 08:03	44.91	OK
4169	2026-09-23 08:04	44.85	OK	4170	2026-09-23 08:05	43.85	OK
4171	2026-09-23 08:06	43.55	OK	4172	2026-09-23 08:07	46.11	OK
4173	2026-09-23 08:08	44.56	OK	4174	2026-09-23 08:09	45.56	OK
4175	2026-09-23 08:10	44.92	OK	4176	2026-09-23 08:11	45.07	OK
4177	2026-09-23 08:12	44.37	OK	4178	2026-09-23 08:13	44.94	OK
4179	2026-09-23 08:14	45.01	OK	4180	2026-09-23 08:15	44.00	OK
4181	2026-09-23 08:16	45.35	OK	4182	2026-09-23 08:17	43.86	OK
4183	2026-09-23 08:18	45.48	OK	4184	2026-09-23 08:19	44.43	OK
4185	2026-09-23 08:20	45.13	OK	4186	2026-09-23 08:21	44.41	OK
4187	2026-09-23 08:22	44.51	OK	4188	2026-09-23 08:23	45.46	OK
4189	2026-09-23 08:24	44.02	OK	4190	2026-09-23 08:25	44.15	OK
4191	2026-09-23 08:26	45.27	OK	4192	2026-09-23 08:27	44.75	OK
4193	2026-09-23 08:28	45.01	OK	4194	2026-09-23 08:29	45.56	OK
4195	2026-09-23 08:30	44.60	OK	4196	2026-09-23 08:31	44.77	OK
4197	2026-09-23 08:32	46.29	OK	4198	2026-09-23 08:33	44.04	OK
4199	2026-09-23 08:34	44.81	OK	4200	2026-09-23 08:35	44.95	OK
4201	2026-09-23 08:36	44.36	OK	4202	2026-09-23 08:37	44.02	OK
4203	2026-09-23 08:38	44.21	OK	4204	2026-09-23 08:39	44.38	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4205	2026-09-23 08:40	43.74	OK	4206	2026-09-23 08:41	45.31	OK
4207	2026-09-23 08:42	45.66	OK	4208	2026-09-23 08:43	44.30	OK
4209	2026-09-23 08:44	45.30	OK	4210	2026-09-23 08:45	44.56	OK
4211	2026-09-23 08:46	45.18	OK	4212	2026-09-23 08:47	44.88	OK
4213	2026-09-23 08:48	45.21	OK	4214	2026-09-23 08:49	44.23	OK
4215	2026-09-23 08:50	46.12	OK	4216	2026-09-23 08:51	45.55	OK
4217	2026-09-23 08:52	43.49	OK	4218	2026-09-23 08:53	45.57	OK
4219	2026-09-23 08:54	45.86	OK	4220	2026-09-23 08:55	45.21	OK
4221	2026-09-23 08:56	45.16	OK	4222	2026-09-23 08:57	45.37	OK
4223	2026-09-23 08:58	46.82	OK	4224	2026-09-23 08:59	44.40	OK
4225	2026-09-23 09:00	44.64	OK	4226	2026-09-23 09:01	44.96	OK
4227	2026-09-23 09:02	44.95	OK	4228	2026-09-23 09:03	45.76	OK
4229	2026-09-23 09:04	45.89	OK	4230	2026-09-23 09:05	45.56	OK
4231	2026-09-23 09:06	45.87	OK	4232	2026-09-23 09:07	44.25	OK
4233	2026-09-23 09:08	44.51	OK	4234	2026-09-23 09:09	45.30	OK
4235	2026-09-23 09:10	44.79	OK	4236	2026-09-23 09:11	45.09	OK
4237	2026-09-23 09:12	46.61	OK	4238	2026-09-23 09:13	45.65	OK
4239	2026-09-23 09:14	44.49	OK	4240	2026-09-23 09:15	45.22	OK
4241	2026-09-23 09:16	45.53	OK	4242	2026-09-23 09:17	46.24	OK
4243	2026-09-23 09:18	45.51	OK	4244	2026-09-23 09:19	46.05	OK
4245	2026-09-23 09:20	45.78	OK	4246	2026-09-23 09:21	45.55	OK
4247	2026-09-23 09:22	44.08	OK	4248	2026-09-23 09:23	45.04	OK
4249	2026-09-23 09:24	47.43	OK	4250	2026-09-23 09:25	44.37	OK
4251	2026-09-23 09:26	45.33	OK	4252	2026-09-23 09:27	45.37	OK
4253	2026-09-23 09:28	45.51	OK	4254	2026-09-23 09:29	45.04	OK
4255	2026-09-23 09:30	44.88	OK	4256	2026-09-23 09:31	44.85	OK
4257	2026-09-23 09:32	46.44	OK	4258	2026-09-23 09:33	45.51	OK
4259	2026-09-23 09:34	44.95	OK	4260	2026-09-23 09:35	46.02	OK
4261	2026-09-23 09:36	45.65	OK	4262	2026-09-23 09:37	47.81	OK
4263	2026-09-23 09:38	47.30	OK	4264	2026-09-23 09:39	45.27	OK
4265	2026-09-23 09:40	46.87	OK	4266	2026-09-23 09:41	45.43	OK
4267	2026-09-23 09:42	46.61	OK	4268	2026-09-23 09:43	45.93	OK
4269	2026-09-23 09:44	47.27	OK	4270	2026-09-23 09:45	45.54	OK
4271	2026-09-23 09:46	47.21	OK	4272	2026-09-23 09:47	46.29	OK
4273	2026-09-23 09:48	46.18	OK	4274	2026-09-23 09:49	47.06	OK
4275	2026-09-23 09:50	46.59	OK	4276	2026-09-23 09:51	46.08	OK
4277	2026-09-23 09:52	45.95	OK	4278	2026-09-23 09:53	45.31	OK
4279	2026-09-23 09:54	47.66	OK	4280	2026-09-23 09:55	45.70	OK
4281	2026-09-23 09:56	46.47	OK	4282	2026-09-23 09:57	46.10	OK
4283	2026-09-23 09:58	46.40	OK	4284	2026-09-23 09:59	45.43	OK
4285	2026-09-23 10:00	47.98	OK	4286	2026-09-23 10:01	47.46	OK
4287	2026-09-23 10:02	46.91	OK	4288	2026-09-23 10:03	46.45	OK
4289	2026-09-23 10:04	45.09	OK	4290	2026-09-23 10:05	47.95	OK
4291	2026-09-23 10:06	45.40	OK	4292	2026-09-23 10:07	46.68	OK
4293	2026-09-23 10:08	46.08	OK	4294	2026-09-23 10:09	46.22	OK
4295	2026-09-23 10:10	46.92	OK	4296	2026-09-23 10:11	47.34	OK
4297	2026-09-23 10:12	45.65	OK	4298	2026-09-23 10:13	47.40	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4299	2026-09-23 10:14	46.57	OK	4300	2026-09-23 10:15	48.38	OK
4301	2026-09-23 10:16	46.69	OK	4302	2026-09-23 10:17	46.09	OK
4303	2026-09-23 10:18	47.58	OK	4304	2026-09-23 10:19	46.06	OK
4305	2026-09-23 10:20	46.63	OK	4306	2026-09-23 10:21	46.21	OK
4307	2026-09-23 10:22	47.63	OK	4308	2026-09-23 10:23	45.70	OK
4309	2026-09-23 10:24	46.71	OK	4310	2026-09-23 10:25	46.99	OK
4311	2026-09-23 10:26	46.50	OK	4312	2026-09-23 10:27	47.90	OK
4313	2026-09-23 10:28	46.93	OK	4314	2026-09-23 10:29	47.00	OK
4315	2026-09-23 10:30	47.79	OK	4316	2026-09-23 10:31	47.41	OK
4317	2026-09-23 10:32	47.75	OK	4318	2026-09-23 10:33	46.91	OK
4319	2026-09-23 10:34	47.40	OK	4320	2026-09-23 10:35	47.70	OK
4321	2026-09-23 10:36	46.38	OK	4322	2026-09-23 10:37	48.87	OK
4323	2026-09-23 10:38	47.04	OK	4324	2026-09-23 10:39	46.53	OK
4325	2026-09-23 10:40	47.65	OK	4326	2026-09-23 10:41	47.38	OK
4327	2026-09-23 10:42	47.56	OK	4328	2026-09-23 10:43	47.50	OK
4329	2026-09-23 10:44	47.39	OK	4330	2026-09-23 10:45	47.43	OK
4331	2026-09-23 10:46	47.83	OK	4332	2026-09-23 10:47	46.06	OK
4333	2026-09-23 10:48	46.68	OK	4334	2026-09-23 10:49	48.79	OK
4335	2026-09-23 10:50	48.10	OK	4336	2026-09-23 10:51	47.11	OK
4337	2026-09-23 10:52	46.60	OK	4338	2026-09-23 10:53	47.74	OK
4339	2026-09-23 10:54	47.02	OK	4340	2026-09-23 10:55	48.58	OK
4341	2026-09-23 10:56	46.32	OK	4342	2026-09-23 10:57	47.69	OK
4343	2026-09-23 10:58	47.18	OK	4344	2026-09-23 10:59	46.55	OK
4345	2026-09-23 11:00	48.83	OK	4346	2026-09-23 11:01	48.18	OK
4347	2026-09-23 11:02	48.80	OK	4348	2026-09-23 11:03	47.38	OK
4349	2026-09-23 11:04	46.51	OK	4350	2026-09-23 11:05	47.25	OK
4351	2026-09-23 11:06	47.30	OK	4352	2026-09-23 11:07	46.79	OK
4353	2026-09-23 11:08	48.09	OK	4354	2026-09-23 11:09	48.10	OK
4355	2026-09-23 11:10	48.05	OK	4356	2026-09-23 11:11	47.69	OK
4357	2026-09-23 11:12	47.62	OK	4358	2026-09-23 11:13	48.42	OK
4359	2026-09-23 11:14	47.39	OK	4360	2026-09-23 11:15	49.18	OK
4361	2026-09-23 11:16	48.05	OK	4362	2026-09-23 11:17	47.38	OK
4363	2026-09-23 11:18	48.09	OK	4364	2026-09-23 11:19	49.24	OK
4365	2026-09-23 11:20	48.67	OK	4366	2026-09-23 11:21	48.60	OK
4367	2026-09-23 11:22	48.68	OK	4368	2026-09-23 11:23	47.71	OK
4369	2026-09-23 11:24	48.11	OK	4370	2026-09-23 11:25	48.63	OK
4371	2026-09-23 11:26	47.27	OK	4372	2026-09-23 11:27	46.61	OK
4373	2026-09-23 11:28	47.79	OK	4374	2026-09-23 11:29	48.13	OK
4375	2026-09-23 11:30	47.94	OK	4376	2026-09-23 11:31	46.52	OK
4377	2026-09-23 11:32	48.87	OK	4378	2026-09-23 11:33	47.23	OK
4379	2026-09-23 11:34	48.61	OK	4380	2026-09-23 11:35	47.31	OK
4381	2026-09-23 11:36	49.23	OK	4382	2026-09-23 11:37	48.29	OK
4383	2026-09-23 11:38	47.96	OK	4384	2026-09-23 11:39	48.24	OK
4385	2026-09-23 11:40	48.67	OK	4386	2026-09-23 11:41	48.31	OK
4387	2026-09-23 11:42	47.82	OK	4388	2026-09-23 11:43	47.95	OK
4389	2026-09-23 11:44	48.13	OK	4390	2026-09-23 11:45	48.92	OK
4391	2026-09-23 11:46	47.58	OK	4392	2026-09-23 11:47	48.91	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4393	2026-09-23 11:48	47.34	OK	4394	2026-09-23 11:49	48.55	OK
4395	2026-09-23 11:50	47.77	OK	4396	2026-09-23 11:51	48.93	OK
4397	2026-09-23 11:52	47.73	OK	4398	2026-09-23 11:53	48.94	OK
4399	2026-09-23 11:54	48.59	OK	4400	2026-09-23 11:55	49.38	OK
4401	2026-09-23 11:56	48.13	OK	4402	2026-09-23 11:57	48.88	OK
4403	2026-09-23 11:58	47.84	OK	4404	2026-09-23 11:59	48.53	OK
4405	2026-09-23 12:00	49.00	OK	4406	2026-09-23 12:01	49.69	OK
4407	2026-09-23 12:02	48.72	OK	4408	2026-09-23 12:03	48.23	OK
4409	2026-09-23 12:04	47.65	OK	4410	2026-09-23 12:05	48.32	OK
4411	2026-09-23 12:06	49.16	OK	4412	2026-09-23 12:07	48.31	OK
4413	2026-09-23 12:08	47.84	OK	4414	2026-09-23 12:09	47.51	OK
4415	2026-09-23 12:10	49.93	OK	4416	2026-09-23 12:11	48.54	OK
4417	2026-09-23 12:12	48.88	OK	4418	2026-09-23 12:13	48.61	OK
4419	2026-09-23 12:14	49.44	OK	4420	2026-09-23 12:15	48.39	OK
4421	2026-09-23 12:16	49.94	OK	4422	2026-09-23 12:17	49.87	OK
4423	2026-09-23 12:18	48.53	OK	4424	2026-09-23 12:19	49.67	OK
4425	2026-09-23 12:20	48.77	OK	4426	2026-09-23 12:21	48.67	OK
4427	2026-09-23 12:22	48.97	OK	4428	2026-09-23 12:23	49.31	OK
4429	2026-09-23 12:24	49.10	OK	4430	2026-09-23 12:25	48.34	OK
4431	2026-09-23 12:26	49.75	OK	4432	2026-09-23 12:27	49.33	OK
4433	2026-09-23 12:28	48.96	OK	4434	2026-09-23 12:29	49.65	OK
4435	2026-09-23 12:30	49.50	OK	4436	2026-09-23 12:31	50.22	OK
4437	2026-09-23 12:32	50.71	OK	4438	2026-09-23 12:33	51.25	OK
4439	2026-09-23 12:34	49.28	OK	4440	2026-09-23 12:35	47.90	OK
4441	2026-09-23 12:36	49.38	OK	4442	2026-09-23 12:37	49.07	OK
4443	2026-09-23 12:38	49.64	OK	4444	2026-09-23 12:39	49.94	OK
4445	2026-09-23 12:40	48.87	OK	4446	2026-09-23 12:41	48.41	OK
4447	2026-09-23 12:42	50.25	OK	4448	2026-09-23 12:43	49.25	OK
4449	2026-09-23 12:44	50.32	OK	4450	2026-09-23 12:45	49.84	OK
4451	2026-09-23 12:46	49.08	OK	4452	2026-09-23 12:47	50.09	OK
4453	2026-09-23 12:48	48.50	OK	4454	2026-09-23 12:49	49.30	OK
4455	2026-09-23 12:50	50.17	OK	4456	2026-09-23 12:51	49.62	OK
4457	2026-09-23 12:52	48.53	OK	4458	2026-09-23 12:53	50.03	OK
4459	2026-09-23 12:54	48.86	OK	4460	2026-09-23 12:55	48.85	OK
4461	2026-09-23 12:56	48.84	OK	4462	2026-09-23 12:57	50.02	OK
4463	2026-09-23 12:58	49.59	OK	4464	2026-09-23 12:59	49.45	OK
4465	2026-09-23 13:00	50.66	OK	4466	2026-09-23 13:01	49.65	OK
4467	2026-09-23 13:02	50.11	OK	4468	2026-09-23 13:03	48.72	OK
4469	2026-09-23 13:04	49.92	OK	4470	2026-09-23 13:05	50.00	OK
4471	2026-09-23 13:06	50.45	OK	4472	2026-09-23 13:07	51.18	OK
4473	2026-09-23 13:08	49.31	OK	4474	2026-09-23 13:09	50.87	OK
4475	2026-09-23 13:10	51.56	OK	4476	2026-09-23 13:11	50.69	OK
4477	2026-09-23 13:12	50.15	OK	4478	2026-09-23 13:13	50.15	OK
4479	2026-09-23 13:14	49.98	OK	4480	2026-09-23 13:15	50.15	OK
4481	2026-09-23 13:16	51.47	OK	4482	2026-09-23 13:17	49.25	OK
4483	2026-09-23 13:18	50.58	OK	4484	2026-09-23 13:19	50.45	OK
4485	2026-09-23 13:20	50.86	OK	4486	2026-09-23 13:21	50.24	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4487	2026-09-23 13:22	49.59	OK	4488	2026-09-23 13:23	51.65	OK
4489	2026-09-23 13:24	51.41	OK	4490	2026-09-23 13:25	50.76	OK
4491	2026-09-23 13:26	50.50	OK	4492	2026-09-23 13:27	51.01	OK
4493	2026-09-23 13:28	50.87	OK	4494	2026-09-23 13:29	49.99	OK
4495	2026-09-23 13:30	50.95	OK	4496	2026-09-23 13:31	50.85	OK
4497	2026-09-23 13:32	51.18	OK	4498	2026-09-23 13:33	50.65	OK
4499	2026-09-23 13:34	51.78	OK	4500	2026-09-23 13:35	50.39	OK
4501	2026-09-23 13:36	51.73	OK	4502	2026-09-23 13:37	50.51	OK
4503	2026-09-23 13:38	52.13	OK	4504	2026-09-23 13:39	52.29	OK
4505	2026-09-23 13:40	51.65	OK	4506	2026-09-23 13:41	51.91	OK
4507	2026-09-23 13:42	50.33	OK	4508	2026-09-23 13:43	50.57	OK
4509	2026-09-23 13:44	50.76	OK	4510	2026-09-23 13:45	50.60	OK
4511	2026-09-23 13:46	49.75	OK	4512	2026-09-23 13:47	49.45	OK
4513	2026-09-23 13:48	50.58	OK	4514	2026-09-23 13:49	51.82	OK
4515	2026-09-23 13:50	49.96	OK	4516	2026-09-23 13:51	51.02	OK
4517	2026-09-23 13:52	50.87	OK	4518	2026-09-23 13:53	52.28	OK
4519	2026-09-23 13:54	52.32	OK	4520	2026-09-23 13:55	50.69	OK
4521	2026-09-23 13:56	51.18	OK	4522	2026-09-23 13:57	51.42	OK
4523	2026-09-23 13:58	50.98	OK	4524	2026-09-23 13:59	50.63	OK
4525	2026-09-23 14:00	50.82	OK	4526	2026-09-23 14:01	51.64	OK
4527	2026-09-23 14:02	50.52	OK	4528	2026-09-23 14:03	52.14	OK
4529	2026-09-23 14:04	52.98	OK	4530	2026-09-23 14:05	53.17	OK
4531	2026-09-23 14:06	51.63	OK	4532	2026-09-23 14:07	51.24	OK
4533	2026-09-23 14:08	51.05	OK	4534	2026-09-23 14:09	51.73	OK
4535	2026-09-23 14:10	51.87	OK	4536	2026-09-23 14:11	50.29	OK
4537	2026-09-23 14:12	50.92	OK	4538	2026-09-23 14:13	50.11	OK
4539	2026-09-23 14:14	52.28	OK	4540	2026-09-23 14:15	50.78	OK
4541	2026-09-23 14:16	51.47	OK	4542	2026-09-23 14:17	52.51	OK
4543	2026-09-23 14:18	50.98	OK	4544	2026-09-23 14:19	51.20	OK
4545	2026-09-23 14:20	51.99	OK	4546	2026-09-23 14:21	50.87	OK
4547	2026-09-23 14:22	52.34	OK	4548	2026-09-23 14:23	51.75	OK
4549	2026-09-23 14:24	51.62	OK	4550	2026-09-23 14:25	52.34	OK
4551	2026-09-23 14:26	52.97	OK	4552	2026-09-23 14:27	52.36	OK
4553	2026-09-23 14:28	52.69	OK	4554	2026-09-23 14:29	51.66	OK
4555	2026-09-23 14:30	52.39	OK	4556	2026-09-23 14:31	52.01	OK
4557	2026-09-23 14:32	51.06	OK	4558	2026-09-23 14:33	51.37	OK
4559	2026-09-23 14:34	51.58	OK	4560	2026-09-23 14:35	51.18	OK
4561	2026-09-23 14:36	50.38	OK	4562	2026-09-23 14:37	52.20	OK
4563	2026-09-23 14:38	52.60	OK	4564	2026-09-23 14:39	52.01	OK
4565	2026-09-23 14:40	52.40	OK	4566	2026-09-23 14:41	51.28	OK
4567	2026-09-23 14:42	51.59	OK	4568	2026-09-23 14:43	51.44	OK
4569	2026-09-23 14:44	53.12	OK	4570	2026-09-23 14:45	51.96	OK
4571	2026-09-23 14:46	50.35	OK	4572	2026-09-23 14:47	50.72	OK
4573	2026-09-23 14:48	51.61	OK	4574	2026-09-23 14:49	52.40	OK
4575	2026-09-23 14:50	52.12	OK	4576	2026-09-23 14:51	50.52	OK
4577	2026-09-23 14:52	50.96	OK	4578	2026-09-23 14:53	52.10	OK
4579	2026-09-23 14:54	52.08	OK	4580	2026-09-23 14:55	52.26	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4581	2026-09-23 14:56	53.27	OK	4582	2026-09-23 14:57	52.00	OK
4583	2026-09-23 14:58	51.91	OK	4584	2026-09-23 14:59	51.45	OK
4585	2026-09-23 15:00	52.60	OK	4586	2026-09-23 15:01	51.29	OK
4587	2026-09-23 15:02	52.21	OK	4588	2026-09-23 15:03	52.21	OK
4589	2026-09-23 15:04	51.84	OK	4590	2026-09-23 15:05	51.93	OK
4591	2026-09-23 15:06	52.47	OK	4592	2026-09-23 15:07	51.66	OK
4593	2026-09-23 15:08	50.70	OK	4594	2026-09-23 15:09	51.57	OK
4595	2026-09-23 15:10	53.42	OK	4596	2026-09-23 15:11	52.81	OK
4597	2026-09-23 15:12	51.85	OK	4598	2026-09-23 15:13	53.46	OK
4599	2026-09-23 15:14	52.49	OK	4600	2026-09-23 15:15	52.13	OK
4601	2026-09-23 15:16	53.25	OK	4602	2026-09-23 15:17	50.99	OK
4603	2026-09-23 15:18	52.65	OK	4604	2026-09-23 15:19	52.23	OK
4605	2026-09-23 15:20	52.49	OK	4606	2026-09-23 15:21	52.88	OK
4607	2026-09-23 15:22	52.45	OK	4608	2026-09-23 15:23	52.53	OK
4609	2026-09-23 15:24	52.22	OK	4610	2026-09-23 15:25	52.20	OK
4611	2026-09-23 15:26	52.25	OK	4612	2026-09-23 15:27	51.71	OK
4613	2026-09-23 15:28	53.43	OK	4614	2026-09-23 15:29	52.50	OK
4615	2026-09-23 15:30	53.26	OK	4616	2026-09-23 15:31	51.98	OK
4617	2026-09-23 15:32	53.25	OK	4618	2026-09-23 15:33	51.62	OK
4619	2026-09-23 15:34	53.94	OK	4620	2026-09-23 15:35	52.18	OK
4621	2026-09-23 15:36	52.46	OK	4622	2026-09-23 15:37	51.86	OK
4623	2026-09-23 15:38	52.67	OK	4624	2026-09-23 15:39	52.59	OK
4625	2026-09-23 15:40	52.97	OK	4626	2026-09-23 15:41	52.31	OK
4627	2026-09-23 15:42	51.49	OK	4628	2026-09-23 15:43	52.88	OK
4629	2026-09-23 15:44	52.31	OK	4630	2026-09-23 15:45	51.82	OK
4631	2026-09-23 15:46	51.30	OK	4632	2026-09-23 15:47	53.49	OK
4633	2026-09-23 15:48	52.75	OK	4634	2026-09-23 15:49	53.94	OK
4635	2026-09-23 15:50	52.55	OK	4636	2026-09-23 15:51	53.49	OK
4637	2026-09-23 15:52	51.18	OK	4638	2026-09-23 15:53	52.88	OK
4639	2026-09-23 15:54	52.54	OK	4640	2026-09-23 15:55	53.33	OK
4641	2026-09-23 15:56	52.70	OK	4642	2026-09-23 15:57	54.62	OK
4643	2026-09-23 15:58	52.07	OK	4644	2026-09-23 15:59	53.37	OK
4645	2026-09-23 16:00	54.19	OK	4646	2026-09-23 16:01	51.64	OK
4647	2026-09-23 16:02	52.26	OK	4648	2026-09-23 16:03	53.10	OK
4649	2026-09-23 16:04	53.12	OK	4650	2026-09-23 16:05	53.79	OK
4651	2026-09-23 16:06	52.43	OK	4652	2026-09-23 16:07	52.19	OK
4653	2026-09-23 16:08	53.03	OK	4654	2026-09-23 16:09	53.51	OK
4655	2026-09-23 16:10	52.61	OK	4656	2026-09-23 16:11	52.61	OK
4657	2026-09-23 16:12	51.43	OK	4658	2026-09-23 16:13	53.69	OK
4659	2026-09-23 16:14	52.43	OK	4660	2026-09-23 16:15	53.35	OK
4661	2026-09-23 16:16	53.00	OK	4662	2026-09-23 16:17	52.16	OK
4663	2026-09-23 16:18	54.20	OK	4664	2026-09-23 16:19	52.03	OK
4665	2026-09-23 16:20	52.58	OK	4666	2026-09-23 16:21	52.89	OK
4667	2026-09-23 16:22	52.41	OK	4668	2026-09-23 16:23	53.35	OK
4669	2026-09-23 16:24	53.07	OK	4670	2026-09-23 16:25	52.02	OK
4671	2026-09-23 16:26	53.74	OK	4672	2026-09-23 16:27	53.21	OK
4673	2026-09-23 16:28	51.72	OK	4674	2026-09-23 16:29	52.90	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4675	2026-09-23 16:30	53.78	OK	4676	2026-09-23 16:31	53.46	OK
4677	2026-09-23 16:32	52.61	OK	4678	2026-09-23 16:33	51.63	OK
4679	2026-09-23 16:34	53.21	OK	4680	2026-09-23 16:35	53.53	OK
4681	2026-09-23 16:36	54.13	OK	4682	2026-09-23 16:37	53.04	OK
4683	2026-09-23 16:38	54.17	OK	4684	2026-09-23 16:39	52.48	OK
4685	2026-09-23 16:40	53.45	OK	4686	2026-09-23 16:41	52.87	OK
4687	2026-09-23 16:42	52.52	OK	4688	2026-09-23 16:43	51.88	OK
4689	2026-09-23 16:44	52.16	OK	4690	2026-09-23 16:45	53.64	OK
4691	2026-09-23 16:46	54.13	OK	4692	2026-09-23 16:47	52.36	OK
4693	2026-09-23 16:48	52.45	OK	4694	2026-09-23 16:49	53.14	OK
4695	2026-09-23 16:50	53.29	OK	4696	2026-09-23 16:51	53.00	OK
4697	2026-09-23 16:52	52.98	OK	4698	2026-09-23 16:53	52.83	OK
4699	2026-09-23 16:54	53.02	OK	4700	2026-09-23 16:55	53.37	OK
4701	2026-09-23 16:56	52.23	OK	4702	2026-09-23 16:57	53.55	OK
4703	2026-09-23 16:58	53.54	OK	4704	2026-09-23 16:59	52.94	OK
4705	2026-09-23 17:00	53.89	OK	4706	2026-09-23 17:01	53.22	OK
4707	2026-09-23 17:02	53.00	OK	4708	2026-09-23 17:03	51.39	OK
4709	2026-09-23 17:04	54.12	OK	4710	2026-09-23 17:05	52.51	OK
4711	2026-09-23 17:06	53.45	OK	4712	2026-09-23 17:07	53.31	OK
4713	2026-09-23 17:08	52.41	OK	4714	2026-09-23 17:09	52.60	OK
4715	2026-09-23 17:10	52.15	OK	4716	2026-09-23 17:11	53.39	OK
4717	2026-09-23 17:12	52.83	OK	4718	2026-09-23 17:13	51.80	OK
4719	2026-09-23 17:14	52.56	OK	4720	2026-09-23 17:15	51.26	OK
4721	2026-09-23 17:16	54.62	OK	4722	2026-09-23 17:17	52.70	OK
4723	2026-09-23 17:18	53.31	OK	4724	2026-09-23 17:19	53.53	OK
4725	2026-09-23 17:20	54.24	OK	4726	2026-09-23 17:21	53.49	OK
4727	2026-09-23 17:22	52.85	OK	4728	2026-09-23 17:23	53.79	OK
4729	2026-09-23 17:24	53.78	OK	4730	2026-09-23 17:25	53.46	OK
4731	2026-09-23 17:26	53.07	OK	4732	2026-09-23 17:27	52.11	OK
4733	2026-09-23 17:28	54.51	OK	4734	2026-09-23 17:29	54.53	OK
4735	2026-09-23 17:30	53.72	OK	4736	2026-09-23 17:31	52.33	OK
4737	2026-09-23 17:32	54.54	OK	4738	2026-09-23 17:33	53.36	OK
4739	2026-09-23 17:34	51.90	OK	4740	2026-09-23 17:35	52.71	OK
4741	2026-09-23 17:36	53.92	OK	4742	2026-09-23 17:37	53.41	OK
4743	2026-09-23 17:38	52.69	OK	4744	2026-09-23 17:39	52.95	OK
4745	2026-09-23 17:40	52.23	OK	4746	2026-09-23 17:41	53.03	OK
4747	2026-09-23 17:42	52.97	OK	4748	2026-09-23 17:43	53.51	OK
4749	2026-09-23 17:44	53.96	OK	4750	2026-09-23 17:45	53.24	OK
4751	2026-09-23 17:46	54.57	OK	4752	2026-09-23 17:47	53.06	OK
4753	2026-09-23 17:48	52.21	OK	4754	2026-09-23 17:49	53.02	OK
4755	2026-09-23 17:50	54.03	OK	4756	2026-09-23 17:51	51.93	OK
4757	2026-09-23 17:52	51.46	OK	4758	2026-09-23 17:53	52.60	OK
4759	2026-09-23 17:54	53.09	OK	4760	2026-09-23 17:55	53.10	OK
4761	2026-09-23 17:56	53.17	OK	4762	2026-09-23 17:57	53.13	OK
4763	2026-09-23 17:58	53.45	OK	4764	2026-09-23 17:59	54.40	OK
4765	2026-09-23 18:00	52.05	OK	4766	2026-09-23 18:01	54.58	OK
4767	2026-09-23 18:02	52.75	OK	4768	2026-09-23 18:03	51.70	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4769	2026-09-23 18:04	53.80	OK	4770	2026-09-23 18:05	53.68	OK
4771	2026-09-23 18:06	53.38	OK	4772	2026-09-23 18:07	53.58	OK
4773	2026-09-23 18:08	52.21	OK	4774	2026-09-23 18:09	54.82	OK
4775	2026-09-23 18:10	53.02	OK	4776	2026-09-23 18:11	53.21	OK
4777	2026-09-23 18:12	53.08	OK	4778	2026-09-23 18:13	52.78	OK
4779	2026-09-23 18:14	52.85	OK	4780	2026-09-23 18:15	52.76	OK
4781	2026-09-23 18:16	54.54	OK	4782	2026-09-23 18:17	53.04	OK
4783	2026-09-23 18:18	54.10	OK	4784	2026-09-23 18:19	53.27	OK
4785	2026-09-23 18:20	53.73	OK	4786	2026-09-23 18:21	53.60	OK
4787	2026-09-23 18:22	53.79	OK	4788	2026-09-23 18:23	54.26	OK
4789	2026-09-23 18:24	53.05	OK	4790	2026-09-23 18:25	54.50	OK
4791	2026-09-23 18:26	52.48	OK	4792	2026-09-23 18:27	54.02	OK
4793	2026-09-23 18:28	52.20	OK	4794	2026-09-23 18:29	51.82	OK
4795	2026-09-23 18:30	53.99	OK	4796	2026-09-23 18:31	52.89	OK
4797	2026-09-23 18:32	52.25	OK	4798	2026-09-23 18:33	53.66	OK
4799	2026-09-23 18:34	54.37	OK	4800	2026-09-23 18:35	52.99	OK
4801	2026-09-23 18:36	52.55	OK	4802	2026-09-23 18:37	51.79	OK
4803	2026-09-23 18:38	52.78	OK	4804	2026-09-23 18:39	52.61	OK
4805	2026-09-23 18:40	53.14	OK	4806	2026-09-23 18:41	52.71	OK
4807	2026-09-23 18:42	52.77	OK	4808	2026-09-23 18:43	52.23	OK
4809	2026-09-23 18:44	52.97	OK	4810	2026-09-23 18:45	52.93	OK
4811	2026-09-23 18:46	53.35	OK	4812	2026-09-23 18:47	52.77	OK
4813	2026-09-23 18:48	54.06	OK	4814	2026-09-23 18:49	53.29	OK
4815	2026-09-23 18:50	53.91	OK	4816	2026-09-23 18:51	53.70	OK
4817	2026-09-23 18:52	53.66	OK	4818	2026-09-23 18:53	53.63	OK
4819	2026-09-23 18:54	52.27	OK	4820	2026-09-23 18:55	53.28	OK
4821	2026-09-23 18:56	51.27	OK	4822	2026-09-23 18:57	53.42	OK
4823	2026-09-23 18:58	53.72	OK	4824	2026-09-23 18:59	53.45	OK
4825	2026-09-23 19:00	52.68	OK	4826	2026-09-23 19:01	52.46	OK
4827	2026-09-23 19:02	53.37	OK	4828	2026-09-23 19:03	53.70	OK
4829	2026-09-23 19:04	53.16	OK	4830	2026-09-23 19:05	52.37	OK
4831	2026-09-23 19:06	52.74	OK	4832	2026-09-23 19:07	52.79	OK
4833	2026-09-23 19:08	52.75	OK	4834	2026-09-23 19:09	51.78	OK
4835	2026-09-23 19:10	52.39	OK	4836	2026-09-23 19:11	53.79	OK
4837	2026-09-23 19:12	52.91	OK	4838	2026-09-23 19:13	52.95	OK
4839	2026-09-23 19:14	53.17	OK	4840	2026-09-23 19:15	52.80	OK
4841	2026-09-23 19:16	52.73	OK	4842	2026-09-23 19:17	52.81	OK
4843	2026-09-23 19:18	54.08	OK	4844	2026-09-23 19:19	52.27	OK
4845	2026-09-23 19:20	51.29	OK	4846	2026-09-23 19:21	53.57	OK
4847	2026-09-23 19:22	52.32	OK	4848	2026-09-23 19:23	52.24	OK
4849	2026-09-23 19:24	51.71	OK	4850	2026-09-23 19:25	53.46	OK
4851	2026-09-23 19:26	51.96	OK	4852	2026-09-23 19:27	52.03	OK
4853	2026-09-23 19:28	51.52	OK	4854	2026-09-23 19:29	53.31	OK
4855	2026-09-23 19:30	52.93	OK	4856	2026-09-23 19:31	52.06	OK
4857	2026-09-23 19:32	52.71	OK	4858	2026-09-23 19:33	50.85	OK
4859	2026-09-23 19:34	52.92	OK	4860	2026-09-23 19:35	53.24	OK
4861	2026-09-23 19:36	53.04	OK	4862	2026-09-23 19:37	52.08	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4863	2026-09-23 19:38	52.11	OK	4864	2026-09-23 19:39	51.69	OK
4865	2026-09-23 19:40	53.00	OK	4866	2026-09-23 19:41	52.46	OK
4867	2026-09-23 19:42	53.06	OK	4868	2026-09-23 19:43	51.62	OK
4869	2026-09-23 19:44	53.26	OK	4870	2026-09-23 19:45	52.30	OK
4871	2026-09-23 19:46	53.28	OK	4872	2026-09-23 19:47	53.37	OK
4873	2026-09-23 19:48	50.95	OK	4874	2026-09-23 19:49	52.75	OK
4875	2026-09-23 19:50	52.70	OK	4876	2026-09-23 19:51	51.71	OK
4877	2026-09-23 19:52	51.54	OK	4878	2026-09-23 19:53	53.72	OK
4879	2026-09-23 19:54	52.63	OK	4880	2026-09-23 19:55	53.19	OK
4881	2026-09-23 19:56	50.68	OK	4882	2026-09-23 19:57	51.45	OK
4883	2026-09-23 19:58	52.57	OK	4884	2026-09-23 19:59	52.75	OK
4885	2026-09-23 20:00	52.12	OK	4886	2026-09-23 20:01	51.22	OK
4887	2026-09-23 20:02	51.73	OK	4888	2026-09-23 20:03	51.98	OK
4889	2026-09-23 20:04	51.37	OK	4890	2026-09-23 20:05	52.05	OK
4891	2026-09-23 20:06	51.77	OK	4892	2026-09-23 20:07	51.48	OK
4893	2026-09-23 20:08	51.79	OK	4894	2026-09-23 20:09	53.47	OK
4895	2026-09-23 20:10	51.83	OK	4896	2026-09-23 20:11	53.37	OK
4897	2026-09-23 20:12	51.57	OK	4898	2026-09-23 20:13	51.38	OK
4899	2026-09-23 20:14	52.35	OK	4900	2026-09-23 20:15	51.51	OK
4901	2026-09-23 20:16	53.67	OK	4902	2026-09-23 20:17	52.35	OK
4903	2026-09-23 20:18	51.18	OK	4904	2026-09-23 20:19	51.44	OK
4905	2026-09-23 20:20	53.33	OK	4906	2026-09-23 20:21	51.88	OK
4907	2026-09-23 20:22	52.32	OK	4908	2026-09-23 20:23	51.81	OK
4909	2026-09-23 20:24	51.63	OK	4910	2026-09-23 20:25	52.60	OK
4911	2026-09-23 20:26	51.04	OK	4912	2026-09-23 20:27	51.62	OK
4913	2026-09-23 20:28	52.37	OK	4914	2026-09-23 20:29	53.46	OK
4915	2026-09-23 20:30	52.31	OK	4916	2026-09-23 20:31	52.41	OK
4917	2026-09-23 20:32	52.12	OK	4918	2026-09-23 20:33	52.69	OK
4919	2026-09-23 20:34	53.18	OK	4920	2026-09-23 20:35	50.32	OK
4921	2026-09-23 20:36	51.24	OK	4922	2026-09-23 20:37	52.45	OK
4923	2026-09-23 20:38	51.68	OK	4924	2026-09-23 20:39	52.32	OK
4925	2026-09-23 20:40	52.30	OK	4926	2026-09-23 20:41	51.59	OK
4927	2026-09-23 20:42	51.56	OK	4928	2026-09-23 20:43	52.67	OK
4929	2026-09-23 20:44	51.42	OK	4930	2026-09-23 20:45	52.75	OK
4931	2026-09-23 20:46	50.37	OK	4932	2026-09-23 20:47	52.31	OK
4933	2026-09-23 20:48	51.09	OK	4934	2026-09-23 20:49	52.48	OK
4935	2026-09-23 20:50	50.69	OK	4936	2026-09-23 20:51	50.90	OK
4937	2026-09-23 20:52	50.77	OK	4938	2026-09-23 20:53	52.10	OK
4939	2026-09-23 20:54	51.71	OK	4940	2026-09-23 20:55	51.30	OK
4941	2026-09-23 20:56	50.93	OK	4942	2026-09-23 20:57	51.01	OK
4943	2026-09-23 20:58	52.89	OK	4944	2026-09-23 20:59	50.89	OK
4945	2026-09-23 21:00	52.31	OK	4946	2026-09-23 21:01	51.64	OK
4947	2026-09-23 21:02	51.63	OK	4948	2026-09-23 21:03	53.12	OK
4949	2026-09-23 21:04	50.84	OK	4950	2026-09-23 21:05	53.26	OK
4951	2026-09-23 21:06	51.33	OK	4952	2026-09-23 21:07	51.33	OK
4953	2026-09-23 21:08	51.63	OK	4954	2026-09-23 21:09	52.44	OK
4955	2026-09-23 21:10	51.22	OK	4956	2026-09-23 21:11	50.70	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4957	2026-09-23 21:12	51.98	OK	4958	2026-09-23 21:13	51.12	OK
4959	2026-09-23 21:14	50.14	OK	4960	2026-09-23 21:15	51.33	OK
4961	2026-09-23 21:16	50.99	OK	4962	2026-09-23 21:17	51.77	OK
4963	2026-09-23 21:18	51.18	OK	4964	2026-09-23 21:19	51.50	OK
4965	2026-09-23 21:20	50.23	OK	4966	2026-09-23 21:21	50.53	OK
4967	2026-09-23 21:22	52.29	OK	4968	2026-09-23 21:23	50.93	OK
4969	2026-09-23 21:24	50.23	OK	4970	2026-09-23 21:25	50.52	OK
4971	2026-09-23 21:26	50.60	OK	4972	2026-09-23 21:27	51.98	OK
4973	2026-09-23 21:28	50.60	OK	4974	2026-09-23 21:29	49.89	OK
4975	2026-09-23 21:30	52.06	OK	4976	2026-09-23 21:31	50.35	OK
4977	2026-09-23 21:32	50.01	OK	4978	2026-09-23 21:33	50.11	OK
4979	2026-09-23 21:34	51.17	OK	4980	2026-09-23 21:35	50.70	OK
4981	2026-09-23 21:36	50.36	OK	4982	2026-09-23 21:37	51.57	OK
4983	2026-09-23 21:38	51.25	OK	4984	2026-09-23 21:39	49.57	OK
4985	2026-09-23 21:40	50.62	OK	4986	2026-09-23 21:41	51.54	OK
4987	2026-09-23 21:42	50.47	OK	4988	2026-09-23 21:43	51.98	OK
4989	2026-09-23 21:44	50.67	OK	4990	2026-09-23 21:45	50.65	OK
4991	2026-09-23 21:46	51.10	OK	4992	2026-09-23 21:47	50.26	OK
4993	2026-09-23 21:48	50.87	OK	4994	2026-09-23 21:49	50.21	OK
4995	2026-09-23 21:50	50.01	OK	4996	2026-09-23 21:51	51.25	OK
4997	2026-09-23 21:52	50.07	OK	4998	2026-09-23 21:53	50.51	OK
4999	2026-09-23 21:54	51.33	OK	5000	2026-09-23 21:55	51.37	OK
5001	2026-09-23 21:56	49.06	OK	5002	2026-09-23 21:57	50.54	OK
5003	2026-09-23 21:58	51.50	OK	5004	2026-09-23 21:59	50.77	OK
5005	2026-09-23 22:00	49.83	OK	5006	2026-09-23 22:01	50.58	OK
5007	2026-09-23 22:02	51.13	OK	5008	2026-09-23 22:03	49.84	OK
5009	2026-09-23 22:04	50.45	OK	5010	2026-09-23 22:05	50.40	OK
5011	2026-09-23 22:06	50.80	OK	5012	2026-09-23 22:07	50.61	OK
5013	2026-09-23 22:08	50.10	OK	5014	2026-09-23 22:09	50.41	OK
5015	2026-09-23 22:10	50.00	OK	5016	2026-09-23 22:11	49.48	OK
5017	2026-09-23 22:12	51.05	OK	5018	2026-09-23 22:13	50.02	OK
5019	2026-09-23 22:14	50.17	OK	5020	2026-09-23 22:15	49.43	OK
5021	2026-09-23 22:16	49.60	OK	5022	2026-09-23 22:17	49.01	OK
5023	2026-09-23 22:18	50.24	OK	5024	2026-09-23 22:19	49.90	OK
5025	2026-09-23 22:20	50.22	OK	5026	2026-09-23 22:21	49.21	OK
5027	2026-09-23 22:22	50.15	OK	5028	2026-09-23 22:23	50.58	OK
5029	2026-09-23 22:24	49.22	OK	5030	2026-09-23 22:25	50.02	OK
5031	2026-09-23 22:26	49.85	OK	5032	2026-09-23 22:27	51.09	OK
5033	2026-09-23 22:28	49.41	OK	5034	2026-09-23 22:29	49.69	OK
5035	2026-09-23 22:30	49.09	OK	5036	2026-09-23 22:31	50.19	OK
5037	2026-09-23 22:32	49.89	OK	5038	2026-09-23 22:33	48.96	OK
5039	2026-09-23 22:34	49.17	OK	5040	2026-09-23 22:35	50.43	OK
5041	2026-09-23 22:36	48.31	OK	5042	2026-09-23 22:37	49.99	OK
5043	2026-09-23 22:38	48.37	OK	5044	2026-09-23 22:39	48.69	OK
5045	2026-09-23 22:40	51.23	OK	5046	2026-09-23 22:41	51.05	OK
5047	2026-09-23 22:42	49.23	OK	5048	2026-09-23 22:43	48.22	OK
5049	2026-09-23 22:44	50.79	OK	5050	2026-09-23 22:45	50.08	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5051	2026-09-23 22:46	48.78	OK	5052	2026-09-23 22:47	50.58	OK
5053	2026-09-23 22:48	49.41	OK	5054	2026-09-23 22:49	48.84	OK
5055	2026-09-23 22:50	47.69	OK	5056	2026-09-23 22:51	49.93	OK
5057	2026-09-23 22:52	49.56	OK	5058	2026-09-23 22:53	49.58	OK
5059	2026-09-23 22:54	50.01	OK	5060	2026-09-23 22:55	48.83	OK
5061	2026-09-23 22:56	49.26	OK	5062	2026-09-23 22:57	48.57	OK
5063	2026-09-23 22:58	49.19	OK	5064	2026-09-23 22:59	48.79	OK
5065	2026-09-23 23:00	49.57	OK	5066	2026-09-23 23:01	49.06	OK
5067	2026-09-23 23:02	49.81	OK	5068	2026-09-23 23:03	49.15	OK
5069	2026-09-23 23:04	48.11	OK	5070	2026-09-23 23:05	49.51	OK
5071	2026-09-23 23:06	50.37	OK	5072	2026-09-23 23:07	49.63	OK
5073	2026-09-23 23:08	48.96	OK	5074	2026-09-23 23:09	49.29	OK
5075	2026-09-23 23:10	48.47	OK	5076	2026-09-23 23:11	50.30	OK
5077	2026-09-23 23:12	48.96	OK	5078	2026-09-23 23:13	48.82	OK
5079	2026-09-23 23:14	47.77	OK	5080	2026-09-23 23:15	48.44	OK
5081	2026-09-23 23:16	48.20	OK	5082	2026-09-23 23:17	47.33	OK
5083	2026-09-23 23:18	48.73	OK	5084	2026-09-23 23:19	49.43	OK
5085	2026-09-23 23:20	50.08	OK	5086	2026-09-23 23:21	47.76	OK
5087	2026-09-23 23:22	48.83	OK	5088	2026-09-23 23:23	48.08	OK
5089	2026-09-23 23:24	49.22	OK	5090	2026-09-23 23:25	48.62	OK
5091	2026-09-23 23:26	48.73	OK	5092	2026-09-23 23:27	49.14	OK
5093	2026-09-23 23:28	47.78	OK	5094	2026-09-23 23:29	48.44	OK
5095	2026-09-23 23:30	48.80	OK	5096	2026-09-23 23:31	49.11	OK
5097	2026-09-23 23:32	48.51	OK	5098	2026-09-23 23:33	48.31	OK
5099	2026-09-23 23:34	48.26	OK	5100	2026-09-23 23:35	48.89	OK
5101	2026-09-23 23:36	50.12	OK	5102	2026-09-23 23:37	49.32	OK
5103	2026-09-23 23:38	47.95	OK	5104	2026-09-23 23:39	47.80	OK
5105	2026-09-23 23:40	48.41	OK	5106	2026-09-23 23:41	48.62	OK
5107	2026-09-23 23:42	47.84	OK	5108	2026-09-23 23:43	49.43	OK
5109	2026-09-23 23:44	49.48	OK	5110	2026-09-23 23:45	48.02	OK
5111	2026-09-23 23:46	47.37	OK	5112	2026-09-23 23:47	47.80	OK
5113	2026-09-23 23:48	48.72	OK	5114	2026-09-23 23:49	48.22	OK
5115	2026-09-23 23:50	48.61	OK	5116	2026-09-23 23:51	48.27	OK
5117	2026-09-23 23:52	48.77	OK	5118	2026-09-23 23:53	48.76	OK
5119	2026-09-23 23:54	48.84	OK	5120	2026-09-23 23:55	47.27	OK
5121	2026-09-23 23:56	46.78	OK	5122	2026-09-23 23:57	48.11	OK
5123	2026-09-23 23:58	49.25	OK	5124	2026-09-23 23:59	48.58	OK
5125	2026-09-24 00:00	47.76	OK	5126	2026-09-24 00:01	48.06	OK
5127	2026-09-24 00:02	47.65	OK	5128	2026-09-24 00:03	47.05	OK
5129	2026-09-24 00:04	47.37	OK	5130	2026-09-24 00:05	48.49	OK
5131	2026-09-24 00:06	46.93	OK	5132	2026-09-24 00:07	49.45	OK
5133	2026-09-24 00:08	47.62	OK	5134	2026-09-24 00:09	47.38	OK
5135	2026-09-24 00:10	48.10	OK	5136	2026-09-24 00:11	48.21	OK
5137	2026-09-24 00:12	48.74	OK	5138	2026-09-24 00:13	47.85	OK
5139	2026-09-24 00:14	46.74	OK	5140	2026-09-24 00:15	46.93	OK
5141	2026-09-24 00:16	48.37	OK	5142	2026-09-24 00:17	46.56	OK
5143	2026-09-24 00:18	48.06	OK	5144	2026-09-24 00:19	48.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5145	2026-09-24 00:20	47.25	OK	5146	2026-09-24 00:21	47.25	OK
5147	2026-09-24 00:22	46.25	OK	5148	2026-09-24 00:23	47.53	OK
5149	2026-09-24 00:24	46.61	OK	5150	2026-09-24 00:25	46.70	OK
5151	2026-09-24 00:26	47.58	OK	5152	2026-09-24 00:27	48.00	OK
5153	2026-09-24 00:28	48.22	OK	5154	2026-09-24 00:29	48.36	OK
5155	2026-09-24 00:30	46.87	OK	5156	2026-09-24 00:31	46.35	OK
5157	2026-09-24 00:32	47.79	OK	5158	2026-09-24 00:33	47.10	OK
5159	2026-09-24 00:34	46.95	OK	5160	2026-09-24 00:35	47.37	OK
5161	2026-09-24 00:36	47.62	OK	5162	2026-09-24 00:37	46.77	OK
5163	2026-09-24 00:38	45.31	OK	5164	2026-09-24 00:39	46.70	OK
5165	2026-09-24 00:40	47.69	OK	5166	2026-09-24 00:41	46.98	OK
5167	2026-09-24 00:42	46.85	OK	5168	2026-09-24 00:43	46.07	OK
5169	2026-09-24 00:44	48.24	OK	5170	2026-09-24 00:45	46.57	OK
5171	2026-09-24 00:46	45.97	OK	5172	2026-09-24 00:47	48.60	OK
5173	2026-09-24 00:48	47.60	OK	5174	2026-09-24 00:49	47.53	OK
5175	2026-09-24 00:50	46.83	OK	5176	2026-09-24 00:51	47.63	OK
5177	2026-09-24 00:52	45.51	OK	5178	2026-09-24 00:53	47.22	OK
5179	2026-09-24 00:54	46.60	OK	5180	2026-09-24 00:55	46.82	OK
5181	2026-09-24 00:56	47.26	OK	5182	2026-09-24 00:57	45.38	OK
5183	2026-09-24 00:58	47.24	OK	5184	2026-09-24 00:59	45.98	OK
5185	2026-09-24 01:00	46.98	OK	5186	2026-09-24 01:01	46.50	OK
5187	2026-09-24 01:02	45.95	OK	5188	2026-09-24 01:03	46.66	OK
5189	2026-09-24 01:04	46.07	OK	5190	2026-09-24 01:05	46.93	OK
5191	2026-09-24 01:06	46.27	OK	5192	2026-09-24 01:07	47.30	OK
5193	2026-09-24 01:08	45.33	OK	5194	2026-09-24 01:09	45.72	OK
5195	2026-09-24 01:10	46.69	OK	5196	2026-09-24 01:11	46.70	OK
5197	2026-09-24 01:12	46.47	OK	5198	2026-09-24 01:13	46.88	OK
5199	2026-09-24 01:14	46.47	OK	5200	2026-09-24 01:15	47.67	OK
5201	2026-09-24 01:16	45.56	OK	5202	2026-09-24 01:17	47.51	OK
5203	2026-09-24 01:18	46.53	OK	5204	2026-09-24 01:19	46.57	OK
5205	2026-09-24 01:20	45.52	OK	5206	2026-09-24 01:21	46.72	OK
5207	2026-09-24 01:22	45.30	OK	5208	2026-09-24 01:23	46.36	OK
5209	2026-09-24 01:24	45.74	OK	5210	2026-09-24 01:25	47.01	OK
5211	2026-09-24 01:26	46.73	OK	5212	2026-09-24 01:27	46.07	OK
5213	2026-09-24 01:28	45.49	OK	5214	2026-09-24 01:29	45.17	OK
5215	2026-09-24 01:30	45.51	OK	5216	2026-09-24 01:31	46.06	OK
5217	2026-09-24 01:32	47.15	OK	5218	2026-09-24 01:33	45.59	OK
5219	2026-09-24 01:34	45.59	OK	5220	2026-09-24 01:35	45.77	OK
5221	2026-09-24 01:36	45.59	OK	5222	2026-09-24 01:37	45.30	OK
5223	2026-09-24 01:38	46.39	OK	5224	2026-09-24 01:39	46.64	OK
5225	2026-09-24 01:40	45.27	OK	5226	2026-09-24 01:41	46.26	OK
5227	2026-09-24 01:42	46.96	OK	5228	2026-09-24 01:43	44.52	OK
5229	2026-09-24 01:44	45.72	OK	5230	2026-09-24 01:45	46.13	OK
5231	2026-09-24 01:46	45.46	OK	5232	2026-09-24 01:47	46.49	OK
5233	2026-09-24 01:48	45.66	OK	5234	2026-09-24 01:49	45.35	OK
5235	2026-09-24 01:50	45.98	OK	5236	2026-09-24 01:51	45.90	OK
5237	2026-09-24 01:52	45.89	OK	5238	2026-09-24 01:53	46.62	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5239	2026-09-24 01:54	46.76	OK	5240	2026-09-24 01:55	46.16	OK
5241	2026-09-24 01:56	45.62	OK	5242	2026-09-24 01:57	46.66	OK
5243	2026-09-24 01:58	44.52	OK	5244	2026-09-24 01:59	46.54	OK
5245	2026-09-24 02:00	45.76	OK	5246	2026-09-24 02:01	44.63	OK
5247	2026-09-24 02:02	45.01	OK	5248	2026-09-24 02:03	46.13	OK
5249	2026-09-24 02:04	46.73	OK	5250	2026-09-24 02:05	45.39	OK
5251	2026-09-24 02:06	46.88	OK	5252	2026-09-24 02:07	44.15	OK
5253	2026-09-24 02:08	44.55	OK	5254	2026-09-24 02:09	46.40	OK
5255	2026-09-24 02:10	45.66	OK	5256	2026-09-24 02:11	47.17	OK
5257	2026-09-24 02:12	44.49	OK	5258	2026-09-24 02:13	44.58	OK
5259	2026-09-24 02:14	44.82	OK	5260	2026-09-24 02:15	45.09	OK
5261	2026-09-24 02:16	45.24	OK	5262	2026-09-24 02:17	45.55	OK
5263	2026-09-24 02:18	45.56	OK	5264	2026-09-24 02:19	44.99	OK
5265	2026-09-24 02:20	44.48	OK	5266	2026-09-24 02:21	45.43	OK
5267	2026-09-24 02:22	44.00	OK	5268	2026-09-24 02:23	45.56	OK
5269	2026-09-24 02:24	44.51	OK	5270	2026-09-24 02:25	46.47	OK
5271	2026-09-24 02:26	46.48	OK	5272	2026-09-24 02:27	44.07	OK
5273	2026-09-24 02:28	45.55	OK	5274	2026-09-24 02:29	46.05	OK
5275	2026-09-24 02:30	44.93	OK	5276	2026-09-24 02:31	45.63	OK
5277	2026-09-24 02:32	45.16	OK	5278	2026-09-24 02:33	45.47	OK
5279	2026-09-24 02:34	45.17	OK	5280	2026-09-24 02:35	44.72	OK
5281	2026-09-24 02:36	44.13	OK	5282	2026-09-24 02:37	45.80	OK
5283	2026-09-24 02:38	44.48	OK	5284	2026-09-24 02:39	44.99	OK
5285	2026-09-24 02:40	44.95	OK	5286	2026-09-24 02:41	45.35	OK
5287	2026-09-24 02:42	45.26	OK	5288	2026-09-24 02:43	44.84	OK
5289	2026-09-24 02:44	45.19	OK	5290	2026-09-24 02:45	44.94	OK
5291	2026-09-24 02:46	45.70	OK	5292	2026-09-24 02:47	44.33	OK
5293	2026-09-24 02:48	44.87	OK	5294	2026-09-24 02:49	44.22	OK
5295	2026-09-24 02:50	44.93	OK	5296	2026-09-24 02:51	44.39	OK
5297	2026-09-24 02:52	44.68	OK	5298	2026-09-24 02:53	44.51	OK
5299	2026-09-24 02:54	43.35	OK	5300	2026-09-24 02:55	43.93	OK
5301	2026-09-24 02:56	45.39	OK	5302	2026-09-24 02:57	44.43	OK
5303	2026-09-24 02:58	45.14	OK	5304	2026-09-24 02:59	44.53	OK
5305	2026-09-24 03:00	44.04	OK	5306	2026-09-24 03:01	43.77	OK
5307	2026-09-24 03:02	44.48	OK	5308	2026-09-24 03:03	44.09	OK
5309	2026-09-24 03:04	44.58	OK	5310	2026-09-24 03:05	45.03	OK
5311	2026-09-24 03:06	44.37	OK	5312	2026-09-24 03:07	45.15	OK
5313	2026-09-24 03:08	44.74	OK	5314	2026-09-24 03:09	44.64	OK
5315	2026-09-24 03:10	43.96	OK	5316	2026-09-24 03:11	44.78	OK
5317	2026-09-24 03:12	45.37	OK	5318	2026-09-24 03:13	44.52	OK
5319	2026-09-24 03:14	43.78	OK	5320	2026-09-24 03:15	45.29	OK
5321	2026-09-24 03:16	45.01	OK	5322	2026-09-24 03:17	45.04	OK
5323	2026-09-24 03:18	44.09	OK	5324	2026-09-24 03:19	43.73	OK
5325	2026-09-24 03:20	44.17	OK	5326	2026-09-24 03:21	44.23	OK
5327	2026-09-24 03:22	43.95	OK	5328	2026-09-24 03:23	44.63	OK
5329	2026-09-24 03:24	43.60	OK	5330	2026-09-24 03:25	44.62	OK
5331	2026-09-24 03:26	44.27	OK	5332	2026-09-24 03:27	43.76	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5333	2026-09-24 03:28	44.44	OK	5334	2026-09-24 03:29	43.95	OK
5335	2026-09-24 03:30	44.60	OK	5336	2026-09-24 03:31	44.53	OK
5337	2026-09-24 03:32	43.22	OK	5338	2026-09-24 03:33	45.14	OK
5339	2026-09-24 03:34	43.21	OK	5340	2026-09-24 03:35	44.19	OK
5341	2026-09-24 03:36	43.62	OK	5342	2026-09-24 03:37	44.04	OK
5343	2026-09-24 03:38	44.41	OK	5344	2026-09-24 03:39	43.10	OK
5345	2026-09-24 03:40	44.55	OK	5346	2026-09-24 03:41	44.73	OK
5347	2026-09-24 03:42	44.88	OK	5348	2026-09-24 03:43	43.90	OK
5349	2026-09-24 03:44	45.02	OK	5350	2026-09-24 03:45	44.49	OK
5351	2026-09-24 03:46	44.12	OK	5352	2026-09-24 03:47	44.76	OK
5353	2026-09-24 03:48	44.37	OK	5354	2026-09-24 03:49	43.95	OK
5355	2026-09-24 03:50	43.84	OK	5356	2026-09-24 03:51	44.74	OK
5357	2026-09-24 03:52	44.73	OK	5358	2026-09-24 03:53	43.28	OK
5359	2026-09-24 03:54	44.50	OK	5360	2026-09-24 03:55	42.87	OK
5361	2026-09-24 03:56	42.96	OK	5362	2026-09-24 03:57	44.54	OK
5363	2026-09-24 03:58	44.31	OK	5364	2026-09-24 03:59	44.10	OK
5365	2026-09-24 04:00	42.77	OK	5366	2026-09-24 04:01	44.75	OK
5367	2026-09-24 04:02	45.25	OK	5368	2026-09-24 04:03	43.40	OK
5369	2026-09-24 04:04	44.06	OK	5370	2026-09-24 04:05	43.21	OK
5371	2026-09-24 04:06	43.60	OK	5372	2026-09-24 04:07	44.37	OK
5373	2026-09-24 04:08	44.40	OK	5374	2026-09-24 04:09	42.71	OK
5375	2026-09-24 04:10	44.50	OK	5376	2026-09-24 04:11	44.21	OK
5377	2026-09-24 04:12	43.95	OK	5378	2026-09-24 04:13	43.27	OK
5379	2026-09-24 04:14	43.76	OK	5380	2026-09-24 04:15	44.84	OK
5381	2026-09-24 04:16	44.81	OK	5382	2026-09-24 04:17	45.23	OK
5383	2026-09-24 04:18	44.77	OK	5384	2026-09-24 04:19	44.03	OK
5385	2026-09-24 04:20	44.37	OK	5386	2026-09-24 04:21	45.12	OK
5387	2026-09-24 04:22	42.50	OK	5388	2026-09-24 04:23	43.01	OK
5389	2026-09-24 04:24	43.23	OK	5390	2026-09-24 04:25	44.17	OK
5391	2026-09-24 04:26	43.03	OK	5392	2026-09-24 04:27	45.18	OK
5393	2026-09-24 04:28	43.49	OK	5394	2026-09-24 04:29	43.81	OK
5395	2026-09-24 04:30	44.72	OK	5396	2026-09-24 04:31	44.38	OK
5397	2026-09-24 04:32	43.82	OK	5398	2026-09-24 04:33	43.89	OK
5399	2026-09-24 04:34	43.56	OK	5400	2026-09-24 04:35	42.78	OK
5401	2026-09-24 04:36	43.96	OK	5402	2026-09-24 04:37	43.21	OK
5403	2026-09-24 04:38	44.08	OK	5404	2026-09-24 04:39	42.66	OK
5405	2026-09-24 04:40	43.45	OK	5406	2026-09-24 04:41	43.26	OK
5407	2026-09-24 04:42	44.10	OK	5408	2026-09-24 04:43	43.41	OK
5409	2026-09-24 04:44	43.23	OK	5410	2026-09-24 04:45	45.24	OK
5411	2026-09-24 04:46	44.47	OK	5412	2026-09-24 04:47	43.21	OK
5413	2026-09-24 04:48	43.19	OK	5414	2026-09-24 04:49	42.70	OK
5415	2026-09-24 04:50	44.25	OK	5416	2026-09-24 04:51	43.26	OK
5417	2026-09-24 04:52	42.65	OK	5418	2026-09-24 04:53	43.33	OK
5419	2026-09-24 04:54	43.11	OK	5420	2026-09-24 04:55	42.59	OK
5421	2026-09-24 04:56	43.47	OK	5422	2026-09-24 04:57	44.24	OK
5423	2026-09-24 04:58	43.55	OK	5424	2026-09-24 04:59	43.16	OK
5425	2026-09-24 05:00	42.63	OK	5426	2026-09-24 05:01	43.37	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5427	2026-09-24 05:02	42.10	OK	5428	2026-09-24 05:03	43.34	OK
5429	2026-09-24 05:04	43.29	OK	5430	2026-09-24 05:05	44.38	OK
5431	2026-09-24 05:06	43.79	OK	5432	2026-09-24 05:07	43.45	OK
5433	2026-09-24 05:08	43.91	OK	5434	2026-09-24 05:09	43.91	OK
5435	2026-09-24 05:10	45.20	OK	5436	2026-09-24 05:11	43.95	OK
5437	2026-09-24 05:12	43.43	OK	5438	2026-09-24 05:13	43.23	OK
5439	2026-09-24 05:14	43.71	OK	5440	2026-09-24 05:15	43.02	OK
5441	2026-09-24 05:16	43.33	OK	5442	2026-09-24 05:17	42.94	OK
5443	2026-09-24 05:18	43.85	OK	5444	2026-09-24 05:19	44.31	OK
5445	2026-09-24 05:20	43.86	OK	5446	2026-09-24 05:21	43.04	OK
5447	2026-09-24 05:22	42.71	OK	5448	2026-09-24 05:23	44.17	OK
5449	2026-09-24 05:24	44.42	OK	5450	2026-09-24 05:25	44.56	OK
5451	2026-09-24 05:26	44.14	OK	5452	2026-09-24 05:27	45.31	OK
5453	2026-09-24 05:28	42.03	OK	5454	2026-09-24 05:29	42.54	OK
5455	2026-09-24 05:30	43.13	OK	5456	2026-09-24 05:31	43.41	OK
5457	2026-09-24 05:32	43.57	OK	5458	2026-09-24 05:33	42.58	OK
5459	2026-09-24 05:34	44.15	OK	5460	2026-09-24 05:35	43.78	OK
5461	2026-09-24 05:36	43.87	OK	5462	2026-09-24 05:37	45.35	OK
5463	2026-09-24 05:38	42.17	OK	5464	2026-09-24 05:39	42.66	OK
5465	2026-09-24 05:40	43.07	OK	5466	2026-09-24 05:41	44.14	OK
5467	2026-09-24 05:42	43.36	OK	5468	2026-09-24 05:43	41.88	OK
5469	2026-09-24 05:44	44.35	OK	5470	2026-09-24 05:45	43.26	OK
5471	2026-09-24 05:46	42.78	OK	5472	2026-09-24 05:47	43.66	OK
5473	2026-09-24 05:48	42.48	OK	5474	2026-09-24 05:49	43.41	OK
5475	2026-09-24 05:50	42.72	OK	5476	2026-09-24 05:51	43.00	OK
5477	2026-09-24 05:52	43.41	OK	5478	2026-09-24 05:53	43.65	OK
5479	2026-09-24 05:54	43.85	OK	5480	2026-09-24 05:55	43.77	OK
5481	2026-09-24 05:56	42.44	OK	5482	2026-09-24 05:57	42.41	OK
5483	2026-09-24 05:58	44.34	OK	5484	2026-09-24 05:59	43.38	OK
5485	2026-09-24 06:00	43.33	OK	5486	2026-09-24 06:01	43.55	OK
5487	2026-09-24 06:02	44.18	OK	5488	2026-09-24 06:03	44.20	OK
5489	2026-09-24 06:04	43.78	OK	5490	2026-09-24 06:05	44.41	OK
5491	2026-09-24 06:06	44.20	OK	5492	2026-09-24 06:07	42.71	OK
5493	2026-09-24 06:08	41.74	OK	5494	2026-09-24 06:09	43.43	OK
5495	2026-09-24 06:10	42.88	OK	5496	2026-09-24 06:11	43.58	OK
5497	2026-09-24 06:12	43.77	OK	5498	2026-09-24 06:13	42.78	OK
5499	2026-09-24 06:14	42.90	OK	5500	2026-09-24 06:15	42.67	OK
5501	2026-09-24 06:16	44.13	OK	5502	2026-09-24 06:17	44.23	OK
5503	2026-09-24 06:18	44.49	OK	5504	2026-09-24 06:19	42.60	OK
5505	2026-09-24 06:20	43.03	OK	5506	2026-09-24 06:21	43.16	OK
5507	2026-09-24 06:22	43.33	OK	5508	2026-09-24 06:23	44.91	OK
5509	2026-09-24 06:24	42.35	OK	5510	2026-09-24 06:25	44.62	OK
5511	2026-09-24 06:26	43.80	OK	5512	2026-09-24 06:27	45.16	OK
5513	2026-09-24 06:28	43.22	OK	5514	2026-09-24 06:29	44.75	OK
5515	2026-09-24 06:30	43.65	OK	5516	2026-09-24 06:31	45.04	OK
5517	2026-09-24 06:32	43.34	OK	5518	2026-09-24 06:33	43.06	OK
5519	2026-09-24 06:34	44.61	OK	5520	2026-09-24 06:35	42.79	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5521	2026-09-24 06:36	43.42	OK	5522	2026-09-24 06:37	43.79	OK
5523	2026-09-24 06:38	43.07	OK	5524	2026-09-24 06:39	42.56	OK
5525	2026-09-24 06:40	44.12	OK	5526	2026-09-24 06:41	44.78	OK
5527	2026-09-24 06:42	44.11	OK	5528	2026-09-24 06:43	43.91	OK
5529	2026-09-24 06:44	43.37	OK	5530	2026-09-24 06:45	43.42	OK
5531	2026-09-24 06:46	43.28	OK	5532	2026-09-24 06:47	43.99	OK
5533	2026-09-24 06:48	42.96	OK	5534	2026-09-24 06:49	44.96	OK
5535	2026-09-24 06:50	43.61	OK	5536	2026-09-24 06:51	44.28	OK
5537	2026-09-24 06:52	43.32	OK	5538	2026-09-24 06:53	43.42	OK
5539	2026-09-24 06:54	44.24	OK	5540	2026-09-24 06:55	43.78	OK
5541	2026-09-24 06:56	43.75	OK	5542	2026-09-24 06:57	43.89	OK
5543	2026-09-24 06:58	44.90	OK	5544	2026-09-24 06:59	43.00	OK
5545	2026-09-24 07:00	43.42	OK	5546	2026-09-24 07:01	42.92	OK
5547	2026-09-24 07:02	43.23	OK	5548	2026-09-24 07:03	43.28	OK
5549	2026-09-24 07:04	42.86	OK	5550	2026-09-24 07:05	43.72	OK
5551	2026-09-24 07:06	43.08	OK	5552	2026-09-24 07:07	42.69	OK
5553	2026-09-24 07:08	43.95	OK	5554	2026-09-24 07:09	42.55	OK
5555	2026-09-24 07:10	44.18	OK	5556	2026-09-24 07:11	43.30	OK
5557	2026-09-24 07:12	44.66	OK	5558	2026-09-24 07:13	44.44	OK
5559	2026-09-24 07:14	44.91	OK	5560	2026-09-24 07:15	42.84	OK
5561	2026-09-24 07:16	44.58	OK	5562	2026-09-24 07:17	42.59	OK
5563	2026-09-24 07:18	42.48	OK	5564	2026-09-24 07:19	43.88	OK
5565	2026-09-24 07:20	44.55	OK	5566	2026-09-24 07:21	44.74	OK
5567	2026-09-24 07:22	42.95	OK	5568	2026-09-24 07:23	44.16	OK
5569	2026-09-24 07:24	43.76	OK	5570	2026-09-24 07:25	42.80	OK
5571	2026-09-24 07:26	43.01	OK	5572	2026-09-24 07:27	44.23	OK
5573	2026-09-24 07:28	43.37	OK	5574	2026-09-24 07:29	42.63	OK
5575	2026-09-24 07:30	43.78	OK	5576	2026-09-24 07:31	44.11	OK
5577	2026-09-24 07:32	43.35	OK	5578	2026-09-24 07:33	44.36	OK
5579	2026-09-24 07:34	44.44	OK	5580	2026-09-24 07:35	44.43	OK
5581	2026-09-24 07:36	44.88	OK	5582	2026-09-24 07:37	43.61	OK
5583	2026-09-24 07:38	43.91	OK	5584	2026-09-24 07:39	43.36	OK
5585	2026-09-24 07:40	43.73	OK	5586	2026-09-24 07:41	44.65	OK
5587	2026-09-24 07:42	44.40	OK	5588	2026-09-24 07:43	44.42	OK
5589	2026-09-24 07:44	44.39	OK	5590	2026-09-24 07:45	43.09	OK
5591	2026-09-24 07:46	43.25	OK	5592	2026-09-24 07:47	45.52	OK
5593	2026-09-24 07:48	43.74	OK	5594	2026-09-24 07:49	43.37	OK
5595	2026-09-24 07:50	44.69	OK	5596	2026-09-24 07:51	43.08	OK
5597	2026-09-24 07:52	44.27	OK	5598	2026-09-24 07:53	43.89	OK
5599	2026-09-24 07:54	44.71	OK	5600	2026-09-24 07:55	45.15	OK
5601	2026-09-24 07:56	44.13	OK	5602	2026-09-24 07:57	43.78	OK
5603	2026-09-24 07:58	45.60	OK	5604	2026-09-24 07:59	44.56	OK
5605	2026-09-24 08:00	44.17	OK	5606	2026-09-24 08:01	44.78	OK
5607	2026-09-24 08:02	43.35	OK	5608	2026-09-24 08:03	45.17	OK
5609	2026-09-24 08:04	43.79	OK	5610	2026-09-24 08:05	44.57	OK
5611	2026-09-24 08:06	45.83	OK	5612	2026-09-24 08:07	45.36	OK
5613	2026-09-24 08:08	44.83	OK	5614	2026-09-24 08:09	44.74	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5615	2026-09-24 08:10	44.83	OK	5616	2026-09-24 08:11	45.09	OK
5617	2026-09-24 08:12	43.74	OK	5618	2026-09-24 08:13	45.71	OK
5619	2026-09-24 08:14	44.70	OK	5620	2026-09-24 08:15	45.06	OK
5621	2026-09-24 08:16	45.37	OK	5622	2026-09-24 08:17	44.34	OK
5623	2026-09-24 08:18	43.56	OK	5624	2026-09-24 08:19	46.05	OK
5625	2026-09-24 08:20	44.79	OK	5626	2026-09-24 08:21	44.15	OK
5627	2026-09-24 08:22	44.98	OK	5628	2026-09-24 08:23	44.77	OK
5629	2026-09-24 08:24	43.05	OK	5630	2026-09-24 08:25	43.77	OK
5631	2026-09-24 08:26	44.26	OK	5632	2026-09-24 08:27	45.67	OK
5633	2026-09-24 08:28	45.36	OK	5634	2026-09-24 08:29	46.13	OK
5635	2026-09-24 08:30	44.88	OK	5636	2026-09-24 08:31	45.17	OK
5637	2026-09-24 08:32	43.60	OK	5638	2026-09-24 08:33	46.54	OK
5639	2026-09-24 08:34	44.60	OK	5640	2026-09-24 08:35	43.36	OK
5641	2026-09-24 08:36	44.27	OK	5642	2026-09-24 08:37	43.98	OK
5643	2026-09-24 08:38	45.43	OK	5644	2026-09-24 08:39	44.63	OK
5645	2026-09-24 08:40	44.34	OK	5646	2026-09-24 08:41	45.77	OK
5647	2026-09-24 08:42	44.86	OK	5648	2026-09-24 08:43	45.38	OK
5649	2026-09-24 08:44	46.20	OK	5650	2026-09-24 08:45	43.77	OK
5651	2026-09-24 08:46	46.43	OK	5652	2026-09-24 08:47	45.99	OK
5653	2026-09-24 08:48	44.45	OK	5654	2026-09-24 08:49	44.95	OK
5655	2026-09-24 08:50	45.85	OK	5656	2026-09-24 08:51	44.29	OK
5657	2026-09-24 08:52	44.26	OK	5658	2026-09-24 08:53	45.40	OK
5659	2026-09-24 08:54	44.42	OK	5660	2026-09-24 08:55	46.17	OK
5661	2026-09-24 08:56	45.35	OK	5662	2026-09-24 08:57	45.19	OK
5663	2026-09-24 08:58	44.14	OK	5664	2026-09-24 08:59	44.36	OK
5665	2026-09-24 09:00	44.70	OK	5666	2026-09-24 09:01	44.65	OK
5667	2026-09-24 09:02	45.58	OK	5668	2026-09-24 09:03	45.02	OK
5669	2026-09-24 09:04	44.63	OK	5670	2026-09-24 09:05	44.18	OK
5671	2026-09-24 09:06	45.91	OK	5672	2026-09-24 09:07	44.60	OK
5673	2026-09-24 09:08	45.76	OK	5674	2026-09-24 09:09	44.75	OK
5675	2026-09-24 09:10	44.63	OK	5676	2026-09-24 09:11	44.53	OK
5677	2026-09-24 09:12	44.99	OK	5678	2026-09-24 09:13	45.60	OK
5679	2026-09-24 09:14	45.33	OK	5680	2026-09-24 09:15	46.08	OK
5681	2026-09-24 09:16	44.94	OK	5682	2026-09-24 09:17	44.90	OK
5683	2026-09-24 09:18	44.24	OK	5684	2026-09-24 09:19	45.45	OK
5685	2026-09-24 09:20	44.97	OK	5686	2026-09-24 09:21	47.20	OK
5687	2026-09-24 09:22	44.36	OK	5688	2026-09-24 09:23	47.04	OK
5689	2026-09-24 09:24	45.45	OK	5690	2026-09-24 09:25	44.94	OK
5691	2026-09-24 09:26	46.08	OK	5692	2026-09-24 09:27	45.33	OK
5693	2026-09-24 09:28	46.35	OK	5694	2026-09-24 09:29	45.87	OK
5695	2026-09-24 09:30	46.82	OK	5696	2026-09-24 09:31	46.24	OK
5697	2026-09-24 09:32	46.07	OK	5698	2026-09-24 09:33	45.84	OK
5699	2026-09-24 09:34	46.86	OK	5700	2026-09-24 09:35	46.16	OK
5701	2026-09-24 09:36	46.56	OK	5702	2026-09-24 09:37	45.52	OK
5703	2026-09-24 09:38	46.60	OK	5704	2026-09-24 09:39	46.72	OK
5705	2026-09-24 09:40	46.85	OK	5706	2026-09-24 09:41	44.88	OK
5707	2026-09-24 09:42	46.19	OK	5708	2026-09-24 09:43	45.54	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5709	2026-09-24 09:44	46.49	OK	5710	2026-09-24 09:45	46.75	OK
5711	2026-09-24 09:46	47.10	OK	5712	2026-09-24 09:47	46.71	OK
5713	2026-09-24 09:48	46.60	OK	5714	2026-09-24 09:49	47.80	OK
5715	2026-09-24 09:50	46.09	OK	5716	2026-09-24 09:51	46.05	OK
5717	2026-09-24 09:52	46.02	OK	5718	2026-09-24 09:53	45.77	OK
5719	2026-09-24 09:54	46.61	OK	5720	2026-09-24 09:55	45.17	OK
5721	2026-09-24 09:56	46.55	OK	5722	2026-09-24 09:57	45.98	OK
5723	2026-09-24 09:58	46.24	OK	5724	2026-09-24 09:59	46.59	OK
5725	2026-09-24 10:00	47.21	OK	5726	2026-09-24 10:01	45.73	OK
5727	2026-09-24 10:02	46.59	OK	5728	2026-09-24 10:03	47.38	OK
5729	2026-09-24 10:04	45.55	OK	5730	2026-09-24 10:05	45.44	OK
5731	2026-09-24 10:06	46.88	OK	5732	2026-09-24 10:07	46.28	OK
5733	2026-09-24 10:08	46.83	OK	5734	2026-09-24 10:09	46.64	OK
5735	2026-09-24 10:10	46.25	OK	5736	2026-09-24 10:11	47.12	OK
5737	2026-09-24 10:12	45.47	OK	5738	2026-09-24 10:13	46.36	OK
5739	2026-09-24 10:14	46.04	OK	5740	2026-09-24 10:15	47.17	OK
5741	2026-09-24 10:16	47.08	OK	5742	2026-09-24 10:17	44.92	OK
5743	2026-09-24 10:18	46.06	OK	5744	2026-09-24 10:19	46.18	OK
5745	2026-09-24 10:20	46.18	OK	5746	2026-09-24 10:21	47.55	OK
5747	2026-09-24 10:22	46.31	OK	5748	2026-09-24 10:23	46.93	OK
5749	2026-09-24 10:24	46.60	OK	5750	2026-09-24 10:25	45.37	OK
5751	2026-09-24 10:26	47.38	OK	5752	2026-09-24 10:27	47.01	OK
5753	2026-09-24 10:28	47.75	OK	5754	2026-09-24 10:29	47.25	OK
5755	2026-09-24 10:30	46.86	OK	5756	2026-09-24 10:31	46.14	OK
5757	2026-09-24 10:32	47.26	OK	5758	2026-09-24 10:33	47.98	OK
5759	2026-09-24 10:34	46.92	OK	5760	2026-09-24 10:35	47.15	OK

Signal: Bearing_Temp_NDE (°C)

Operating Limits: [10.0 to 95.0] • Observed: Min 47.56, Max 61.58, Mean 54.47

All 5,760 Raw Readings

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1	2026-09-20 10:36	56.17	OK	2	2026-09-20 10:37	57.00	OK
3	2026-09-20 10:38	56.17	OK	4	2026-09-20 10:39	56.34	OK
5	2026-09-20 10:40	57.26	OK	6	2026-09-20 10:41	55.78	OK
7	2026-09-20 10:42	56.56	OK	8	2026-09-20 10:43	55.43	OK
9	2026-09-20 10:44	55.61	OK	10	2026-09-20 10:45	55.16	OK
11	2026-09-20 10:46	54.86	OK	12	2026-09-20 10:47	56.13	OK
13	2026-09-20 10:48	57.32	OK	14	2026-09-20 10:49	55.88	OK
15	2026-09-20 10:50	56.00	OK	16	2026-09-20 10:51	55.61	OK
17	2026-09-20 10:52	54.68	OK	18	2026-09-20 10:53	55.27	OK
19	2026-09-20 10:54	58.22	OK	20	2026-09-20 10:55	57.75	OK
21	2026-09-20 10:56	56.67	OK	22	2026-09-20 10:57	56.23	OK
23	2026-09-20 10:58	54.91	OK	24	2026-09-20 10:59	56.24	OK
25	2026-09-20 11:00	58.44	OK	26	2026-09-20 11:01	56.92	OK
27	2026-09-20 11:02	58.90	OK	28	2026-09-20 11:03	53.85	OK
29	2026-09-20 11:04	56.80	OK	30	2026-09-20 11:05	54.98	OK
31	2026-09-20 11:06	56.26	OK	32	2026-09-20 11:07	55.93	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
33	2026-09-20 11:08	55.17	OK	34	2026-09-20 11:09	56.19	OK
35	2026-09-20 11:10	56.61	OK	36	2026-09-20 11:11	57.16	OK
37	2026-09-20 11:12	56.45	OK	38	2026-09-20 11:13	58.18	OK
39	2026-09-20 11:14	55.36	OK	40	2026-09-20 11:15	56.54	OK
41	2026-09-20 11:16	54.89	OK	42	2026-09-20 11:17	55.58	OK
43	2026-09-20 11:18	57.24	OK	44	2026-09-20 11:19	56.10	OK
45	2026-09-20 11:20	59.08	OK	46	2026-09-20 11:21	56.71	OK
47	2026-09-20 11:22	56.06	OK	48	2026-09-20 11:23	59.23	OK
49	2026-09-20 11:24	57.38	OK	50	2026-09-20 11:25	55.72	OK
51	2026-09-20 11:26	57.17	OK	52	2026-09-20 11:27	58.57	OK
53	2026-09-20 11:28	57.89	OK	54	2026-09-20 11:29	56.15	OK
55	2026-09-20 11:30	55.15	OK	56	2026-09-20 11:31	58.05	OK
57	2026-09-20 11:32	55.07	OK	58	2026-09-20 11:33	57.17	OK
59	2026-09-20 11:34	58.02	OK	60	2026-09-20 11:35	56.95	OK
61	2026-09-20 11:36	55.84	OK	62	2026-09-20 11:37	56.91	OK
63	2026-09-20 11:38	56.31	OK	64	2026-09-20 11:39	56.84	OK
65	2026-09-20 11:40	55.16	OK	66	2026-09-20 11:41	58.64	OK
67	2026-09-20 11:42	57.13	OK	68	2026-09-20 11:43	56.15	OK
69	2026-09-20 11:44	55.83	OK	70	2026-09-20 11:45	58.12	OK
71	2026-09-20 11:46	57.79	OK	72	2026-09-20 11:47	56.08	OK
73	2026-09-20 11:48	55.80	OK	74	2026-09-20 11:49	57.15	OK
75	2026-09-20 11:50	56.02	OK	76	2026-09-20 11:51	59.56	OK
77	2026-09-20 11:52	56.74	OK	78	2026-09-20 11:53	56.90	OK
79	2026-09-20 11:54	57.77	OK	80	2026-09-20 11:55	59.29	OK
81	2026-09-20 11:56	57.09	OK	82	2026-09-20 11:57	58.00	OK
83	2026-09-20 11:58	57.14	OK	84	2026-09-20 11:59	57.64	OK
85	2026-09-20 12:00	55.86	OK	86	2026-09-20 12:01	55.23	OK
87	2026-09-20 12:02	57.70	OK	88	2026-09-20 12:03	58.31	OK
89	2026-09-20 12:04	56.96	OK	90	2026-09-20 12:05	55.87	OK
91	2026-09-20 12:06	57.50	OK	92	2026-09-20 12:07	56.39	OK
93	2026-09-20 12:08	57.22	OK	94	2026-09-20 12:09	57.67	OK
95	2026-09-20 12:10	56.77	OK	96	2026-09-20 12:11	57.44	OK
97	2026-09-20 12:12	58.61	OK	98	2026-09-20 12:13	58.56	OK
99	2026-09-20 12:14	56.51	OK	100	2026-09-20 12:15	58.20	OK
101	2026-09-20 12:16	58.42	OK	102	2026-09-20 12:17	56.16	OK
103	2026-09-20 12:18	56.33	OK	104	2026-09-20 12:19	55.44	OK
105	2026-09-20 12:20	56.89	OK	106	2026-09-20 12:21	57.11	OK
107	2026-09-20 12:22	56.05	OK	108	2026-09-20 12:23	56.56	OK
109	2026-09-20 12:24	55.80	OK	110	2026-09-20 12:25	58.36	OK
111	2026-09-20 12:26	56.68	OK	112	2026-09-20 12:27	58.21	OK
113	2026-09-20 12:28	60.04	OK	114	2026-09-20 12:29	56.34	OK
115	2026-09-20 12:30	59.42	OK	116	2026-09-20 12:31	57.91	OK
117	2026-09-20 12:32	57.54	OK	118	2026-09-20 12:33	57.54	OK
119	2026-09-20 12:34	58.46	OK	120	2026-09-20 12:35	58.16	OK
121	2026-09-20 12:36	56.08	OK	122	2026-09-20 12:37	57.33	OK
123	2026-09-20 12:38	55.98	OK	124	2026-09-20 12:39	58.06	OK
125	2026-09-20 12:40	59.55	OK	126	2026-09-20 12:41	58.26	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
127	2026-09-20 12:42	57.93	OK	128	2026-09-20 12:43	58.45	OK
129	2026-09-20 12:44	57.91	OK	130	2026-09-20 12:45	57.87	OK
131	2026-09-20 12:46	57.92	OK	132	2026-09-20 12:47	58.47	OK
133	2026-09-20 12:48	56.22	OK	134	2026-09-20 12:49	57.09	OK
135	2026-09-20 12:50	57.94	OK	136	2026-09-20 12:51	57.93	OK
137	2026-09-20 12:52	57.54	OK	138	2026-09-20 12:53	59.12	OK
139	2026-09-20 12:54	58.69	OK	140	2026-09-20 12:55	59.66	OK
141	2026-09-20 12:56	58.08	OK	142	2026-09-20 12:57	56.81	OK
143	2026-09-20 12:58	56.30	OK	144	2026-09-20 12:59	57.88	OK
145	2026-09-20 13:00	58.27	OK	146	2026-09-20 13:01	57.83	OK
147	2026-09-20 13:02	58.01	OK	148	2026-09-20 13:03	58.41	OK
149	2026-09-20 13:04	58.42	OK	150	2026-09-20 13:05	59.40	OK
151	2026-09-20 13:06	57.60	OK	152	2026-09-20 13:07	57.96	OK
153	2026-09-20 13:08	56.40	OK	154	2026-09-20 13:09	59.79	OK
155	2026-09-20 13:10	57.68	OK	156	2026-09-20 13:11	58.65	OK
157	2026-09-20 13:12	59.37	OK	158	2026-09-20 13:13	59.89	OK
159	2026-09-20 13:14	59.69	OK	160	2026-09-20 13:15	57.77	OK
161	2026-09-20 13:16	56.57	OK	162	2026-09-20 13:17	57.99	OK
163	2026-09-20 13:18	59.68	OK	164	2026-09-20 13:19	58.14	OK
165	2026-09-20 13:20	58.76	OK	166	2026-09-20 13:21	58.24	OK
167	2026-09-20 13:22	57.87	OK	168	2026-09-20 13:23	57.79	OK
169	2026-09-20 13:24	58.37	OK	170	2026-09-20 13:25	56.23	OK
171	2026-09-20 13:26	58.47	OK	172	2026-09-20 13:27	60.06	OK
173	2026-09-20 13:28	57.75	OK	174	2026-09-20 13:29	58.11	OK
175	2026-09-20 13:30	57.57	OK	176	2026-09-20 13:31	60.18	OK
177	2026-09-20 13:32	57.36	OK	178	2026-09-20 13:33	58.25	OK
179	2026-09-20 13:34	58.06	OK	180	2026-09-20 13:35	59.70	OK
181	2026-09-20 13:36	55.68	OK	182	2026-09-20 13:37	58.61	OK
183	2026-09-20 13:38	58.06	OK	184	2026-09-20 13:39	57.51	OK
185	2026-09-20 13:40	59.13	OK	186	2026-09-20 13:41	59.05	OK
187	2026-09-20 13:42	59.67	OK	188	2026-09-20 13:43	57.55	OK
189	2026-09-20 13:44	58.32	OK	190	2026-09-20 13:45	58.13	OK
191	2026-09-20 13:46	59.41	OK	192	2026-09-20 13:47	57.86	OK
193	2026-09-20 13:48	58.52	OK	194	2026-09-20 13:49	57.96	OK
195	2026-09-20 13:50	59.29	OK	196	2026-09-20 13:51	59.45	OK
197	2026-09-20 13:52	58.19	OK	198	2026-09-20 13:53	57.90	OK
199	2026-09-20 13:54	60.52	OK	200	2026-09-20 13:55	57.88	OK
201	2026-09-20 13:56	58.13	OK	202	2026-09-20 13:57	58.24	OK
203	2026-09-20 13:58	56.87	OK	204	2026-09-20 13:59	58.22	OK
205	2026-09-20 14:00	59.46	OK	206	2026-09-20 14:01	61.13	OK
207	2026-09-20 14:02	57.22	OK	208	2026-09-20 14:03	59.50	OK
209	2026-09-20 14:04	60.48	OK	210	2026-09-20 14:05	58.77	OK
211	2026-09-20 14:06	58.25	OK	212	2026-09-20 14:07	59.11	OK
213	2026-09-20 14:08	57.62	OK	214	2026-09-20 14:09	56.79	OK
215	2026-09-20 14:10	59.27	OK	216	2026-09-20 14:11	59.82	OK
217	2026-09-20 14:12	59.72	OK	218	2026-09-20 14:13	59.17	OK
219	2026-09-20 14:14	58.25	OK	220	2026-09-20 14:15	58.81	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
221	2026-09-20 14:16	57.87	OK	222	2026-09-20 14:17	59.67	OK
223	2026-09-20 14:18	58.21	OK	224	2026-09-20 14:19	59.21	OK
225	2026-09-20 14:20	57.33	OK	226	2026-09-20 14:21	60.10	OK
227	2026-09-20 14:22	57.95	OK	228	2026-09-20 14:23	59.36	OK
229	2026-09-20 14:24	59.09	OK	230	2026-09-20 14:25	58.41	OK
231	2026-09-20 14:26	58.57	OK	232	2026-09-20 14:27	58.17	OK
233	2026-09-20 14:28	59.24	OK	234	2026-09-20 14:29	56.31	OK
235	2026-09-20 14:30	58.60	OK	236	2026-09-20 14:31	58.72	OK
237	2026-09-20 14:32	60.85	OK	238	2026-09-20 14:33	60.05	OK
239	2026-09-20 14:34	58.62	OK	240	2026-09-20 14:35	60.01	OK
241	2026-09-20 14:36	59.32	OK	242	2026-09-20 14:37	60.48	OK
243	2026-09-20 14:38	59.59	OK	244	2026-09-20 14:39	59.31	OK
245	2026-09-20 14:40	57.92	OK	246	2026-09-20 14:41	59.22	OK
247	2026-09-20 14:42	59.42	OK	248	2026-09-20 14:43	59.20	OK
249	2026-09-20 14:44	60.80	OK	250	2026-09-20 14:45	57.59	OK
251	2026-09-20 14:46	59.81	OK	252	2026-09-20 14:47	56.98	OK
253	2026-09-20 14:48	58.78	OK	254	2026-09-20 14:49	58.46	OK
255	2026-09-20 14:50	56.77	OK	256	2026-09-20 14:51	59.68	OK
257	2026-09-20 14:52	61.58	OK	258	2026-09-20 14:53	58.16	OK
259	2026-09-20 14:54	57.96	OK	260	2026-09-20 14:55	58.83	OK
261	2026-09-20 14:56	58.30	OK	262	2026-09-20 14:57	59.28	OK
263	2026-09-20 14:58	58.86	OK	264	2026-09-20 14:59	60.21	OK
265	2026-09-20 15:00	59.92	OK	266	2026-09-20 15:01	56.87	OK
267	2026-09-20 15:02	59.21	OK	268	2026-09-20 15:03	58.76	OK
269	2026-09-20 15:04	58.21	OK	270	2026-09-20 15:05	57.16	OK
271	2026-09-20 15:06	58.70	OK	272	2026-09-20 15:07	57.92	OK
273	2026-09-20 15:08	60.51	OK	274	2026-09-20 15:09	59.39	OK
275	2026-09-20 15:10	57.77	OK	276	2026-09-20 15:11	58.32	OK
277	2026-09-20 15:12	59.42	OK	278	2026-09-20 15:13	57.48	OK
279	2026-09-20 15:14	60.26	OK	280	2026-09-20 15:15	60.04	OK
281	2026-09-20 15:16	57.66	OK	282	2026-09-20 15:17	58.35	OK
283	2026-09-20 15:18	58.16	OK	284	2026-09-20 15:19	61.22	OK
285	2026-09-20 15:20	57.63	OK	286	2026-09-20 15:21	59.04	OK
287	2026-09-20 15:22	60.04	OK	288	2026-09-20 15:23	58.94	OK
289	2026-09-20 15:24	58.69	OK	290	2026-09-20 15:25	59.19	OK
291	2026-09-20 15:26	59.26	OK	292	2026-09-20 15:27	59.08	OK
293	2026-09-20 15:28	57.38	OK	294	2026-09-20 15:29	59.86	OK
295	2026-09-20 15:30	57.55	OK	296	2026-09-20 15:31	58.01	OK
297	2026-09-20 15:32	58.52	OK	298	2026-09-20 15:33	60.25	OK
299	2026-09-20 15:34	58.29	OK	300	2026-09-20 15:35	58.28	OK
301	2026-09-20 15:36	59.15	OK	302	2026-09-20 15:37	57.98	OK
303	2026-09-20 15:38	60.43	OK	304	2026-09-20 15:39	60.02	OK
305	2026-09-20 15:40	58.45	OK	306	2026-09-20 15:41	59.52	OK
307	2026-09-20 15:42	57.94	OK	308	2026-09-20 15:43	56.84	OK
309	2026-09-20 15:44	59.06	OK	310	2026-09-20 15:45	58.61	OK
311	2026-09-20 15:46	56.34	OK	312	2026-09-20 15:47	57.78	OK
313	2026-09-20 15:48	58.64	OK	314	2026-09-20 15:49	59.92	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
315	2026-09-20 15:50	58.93	OK	316	2026-09-20 15:51	60.35	OK
317	2026-09-20 15:52	57.49	OK	318	2026-09-20 15:53	60.55	OK
319	2026-09-20 15:54	58.40	OK	320	2026-09-20 15:55	59.23	OK
321	2026-09-20 15:56	59.22	OK	322	2026-09-20 15:57	57.41	OK
323	2026-09-20 15:58	59.14	OK	324	2026-09-20 15:59	56.56	OK
325	2026-09-20 16:00	59.00	OK	326	2026-09-20 16:01	58.13	OK
327	2026-09-20 16:02	59.29	OK	328	2026-09-20 16:03	57.69	OK
329	2026-09-20 16:04	57.31	OK	330	2026-09-20 16:05	57.78	OK
331	2026-09-20 16:06	58.44	OK	332	2026-09-20 16:07	56.78	OK
333	2026-09-20 16:08	56.35	OK	334	2026-09-20 16:09	59.01	OK
335	2026-09-20 16:10	58.16	OK	336	2026-09-20 16:11	58.59	OK
337	2026-09-20 16:12	57.92	OK	338	2026-09-20 16:13	56.90	OK
339	2026-09-20 16:14	58.15	OK	340	2026-09-20 16:15	58.74	OK
341	2026-09-20 16:16	58.27	OK	342	2026-09-20 16:17	60.13	OK
343	2026-09-20 16:18	58.20	OK	344	2026-09-20 16:19	59.22	OK
345	2026-09-20 16:20	59.10	OK	346	2026-09-20 16:21	57.61	OK
347	2026-09-20 16:22	56.77	OK	348	2026-09-20 16:23	60.51	OK
349	2026-09-20 16:24	59.29	OK	350	2026-09-20 16:25	57.05	OK
351	2026-09-20 16:26	59.89	OK	352	2026-09-20 16:27	57.70	OK
353	2026-09-20 16:28	58.65	OK	354	2026-09-20 16:29	57.95	OK
355	2026-09-20 16:30	60.08	OK	356	2026-09-20 16:31	56.50	OK
357	2026-09-20 16:32	57.86	OK	358	2026-09-20 16:33	58.39	OK
359	2026-09-20 16:34	58.06	OK	360	2026-09-20 16:35	59.41	OK
361	2026-09-20 16:36	58.42	OK	362	2026-09-20 16:37	57.73	OK
363	2026-09-20 16:38	57.12	OK	364	2026-09-20 16:39	58.91	OK
365	2026-09-20 16:40	60.30	OK	366	2026-09-20 16:41	56.74	OK
367	2026-09-20 16:42	57.31	OK	368	2026-09-20 16:43	60.08	OK
369	2026-09-20 16:44	58.87	OK	370	2026-09-20 16:45	59.75	OK
371	2026-09-20 16:46	58.79	OK	372	2026-09-20 16:47	60.20	OK
373	2026-09-20 16:48	59.75	OK	374	2026-09-20 16:49	58.15	OK
375	2026-09-20 16:50	59.46	OK	376	2026-09-20 16:51	59.96	OK
377	2026-09-20 16:52	59.33	OK	378	2026-09-20 16:53	57.57	OK
379	2026-09-20 16:54	57.67	OK	380	2026-09-20 16:55	58.25	OK
381	2026-09-20 16:56	58.97	OK	382	2026-09-20 16:57	58.98	OK
383	2026-09-20 16:58	59.57	OK	384	2026-09-20 16:59	57.82	OK
385	2026-09-20 17:00	57.44	OK	386	2026-09-20 17:01	57.02	OK
387	2026-09-20 17:02	59.11	OK	388	2026-09-20 17:03	57.26	OK
389	2026-09-20 17:04	59.95	OK	390	2026-09-20 17:05	56.09	OK
391	2026-09-20 17:06	59.62	OK	392	2026-09-20 17:07	57.77	OK
393	2026-09-20 17:08	55.86	OK	394	2026-09-20 17:09	55.81	OK
395	2026-09-20 17:10	57.69	OK	396	2026-09-20 17:11	59.96	OK
397	2026-09-20 17:12	57.29	OK	398	2026-09-20 17:13	58.60	OK
399	2026-09-20 17:14	57.63	OK	400	2026-09-20 17:15	58.17	OK
401	2026-09-20 17:16	58.08	OK	402	2026-09-20 17:17	60.27	OK
403	2026-09-20 17:18	59.49	OK	404	2026-09-20 17:19	57.56	OK
405	2026-09-20 17:20	59.92	OK	406	2026-09-20 17:21	58.66	OK
407	2026-09-20 17:22	57.93	OK	408	2026-09-20 17:23	56.86	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
409	2026-09-20 17:24	58.14	OK	410	2026-09-20 17:25	57.03	OK
411	2026-09-20 17:26	58.60	OK	412	2026-09-20 17:27	57.25	OK
413	2026-09-20 17:28	58.46	OK	414	2026-09-20 17:29	59.85	OK
415	2026-09-20 17:30	58.14	OK	416	2026-09-20 17:31	57.35	OK
417	2026-09-20 17:32	56.54	OK	418	2026-09-20 17:33	58.99	OK
419	2026-09-20 17:34	58.69	OK	420	2026-09-20 17:35	57.64	OK
421	2026-09-20 17:36	58.07	OK	422	2026-09-20 17:37	59.08	OK
423	2026-09-20 17:38	59.05	OK	424	2026-09-20 17:39	57.62	OK
425	2026-09-20 17:40	59.00	OK	426	2026-09-20 17:41	59.07	OK
427	2026-09-20 17:42	56.80	OK	428	2026-09-20 17:43	57.80	OK
429	2026-09-20 17:44	56.12	OK	430	2026-09-20 17:45	57.42	OK
431	2026-09-20 17:46	58.23	OK	432	2026-09-20 17:47	56.97	OK
433	2026-09-20 17:48	57.40	OK	434	2026-09-20 17:49	57.40	OK
435	2026-09-20 17:50	58.82	OK	436	2026-09-20 17:51	58.09	OK
437	2026-09-20 17:52	58.82	OK	438	2026-09-20 17:53	58.98	OK
439	2026-09-20 17:54	58.29	OK	440	2026-09-20 17:55	56.81	OK
441	2026-09-20 17:56	58.15	OK	442	2026-09-20 17:57	57.07	OK
443	2026-09-20 17:58	59.58	OK	444	2026-09-20 17:59	56.02	OK
445	2026-09-20 18:00	57.60	OK	446	2026-09-20 18:01	55.33	OK
447	2026-09-20 18:02	58.03	OK	448	2026-09-20 18:03	57.74	OK
449	2026-09-20 18:04	56.57	OK	450	2026-09-20 18:05	57.83	OK
451	2026-09-20 18:06	57.56	OK	452	2026-09-20 18:07	57.73	OK
453	2026-09-20 18:08	57.92	OK	454	2026-09-20 18:09	59.43	OK
455	2026-09-20 18:10	58.29	OK	456	2026-09-20 18:11	59.50	OK
457	2026-09-20 18:12	57.38	OK	458	2026-09-20 18:13	57.83	OK
459	2026-09-20 18:14	56.27	OK	460	2026-09-20 18:15	58.27	OK
461	2026-09-20 18:16	58.50	OK	462	2026-09-20 18:17	56.28	OK
463	2026-09-20 18:18	56.37	OK	464	2026-09-20 18:19	57.58	OK
465	2026-09-20 18:20	57.80	OK	466	2026-09-20 18:21	56.83	OK
467	2026-09-20 18:22	58.10	OK	468	2026-09-20 18:23	59.21	OK
469	2026-09-20 18:24	58.02	OK	470	2026-09-20 18:25	58.21	OK
471	2026-09-20 18:26	57.28	OK	472	2026-09-20 18:27	58.24	OK
473	2026-09-20 18:28	55.86	OK	474	2026-09-20 18:29	56.95	OK
475	2026-09-20 18:30	58.79	OK	476	2026-09-20 18:31	57.56	OK
477	2026-09-20 18:32	56.80	OK	478	2026-09-20 18:33	59.26	OK
479	2026-09-20 18:34	58.37	OK	480	2026-09-20 18:35	57.26	OK
481	2026-09-20 18:36	56.04	OK	482	2026-09-20 18:37	56.79	OK
483	2026-09-20 18:38	57.76	OK	484	2026-09-20 18:39	57.63	OK
485	2026-09-20 18:40	57.04	OK	486	2026-09-20 18:41	56.88	OK
487	2026-09-20 18:42	58.15	OK	488	2026-09-20 18:43	56.96	OK
489	2026-09-20 18:44	58.78	OK	490	2026-09-20 18:45	57.38	OK
491	2026-09-20 18:46	57.38	OK	492	2026-09-20 18:47	57.37	OK
493	2026-09-20 18:48	55.64	OK	494	2026-09-20 18:49	58.15	OK
495	2026-09-20 18:50	57.04	OK	496	2026-09-20 18:51	56.93	OK
497	2026-09-20 18:52	57.87	OK	498	2026-09-20 18:53	57.03	OK
499	2026-09-20 18:54	56.52	OK	500	2026-09-20 18:55	58.90	OK
501	2026-09-20 18:56	57.09	OK	502	2026-09-20 18:57	56.04	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
503	2026-09-20 18:58	56.42	OK	504	2026-09-20 18:59	57.12	OK
505	2026-09-20 19:00	58.42	OK	506	2026-09-20 19:01	57.42	OK
507	2026-09-20 19:02	58.11	OK	508	2026-09-20 19:03	56.09	OK
509	2026-09-20 19:04	57.79	OK	510	2026-09-20 19:05	54.62	OK
511	2026-09-20 19:06	57.22	OK	512	2026-09-20 19:07	58.42	OK
513	2026-09-20 19:08	56.70	OK	514	2026-09-20 19:09	57.67	OK
515	2026-09-20 19:10	56.33	OK	516	2026-09-20 19:11	56.02	OK
517	2026-09-20 19:12	55.88	OK	518	2026-09-20 19:13	56.61	OK
519	2026-09-20 19:14	55.45	OK	520	2026-09-20 19:15	55.80	OK
521	2026-09-20 19:16	56.59	OK	522	2026-09-20 19:17	56.16	OK
523	2026-09-20 19:18	55.43	OK	524	2026-09-20 19:19	55.63	OK
525	2026-09-20 19:20	56.17	OK	526	2026-09-20 19:21	57.39	OK
527	2026-09-20 19:22	55.67	OK	528	2026-09-20 19:23	55.48	OK
529	2026-09-20 19:24	57.97	OK	530	2026-09-20 19:25	57.66	OK
531	2026-09-20 19:26	56.90	OK	532	2026-09-20 19:27	57.10	OK
533	2026-09-20 19:28	56.54	OK	534	2026-09-20 19:29	57.80	OK
535	2026-09-20 19:30	56.33	OK	536	2026-09-20 19:31	56.84	OK
537	2026-09-20 19:32	55.96	OK	538	2026-09-20 19:33	56.34	OK
539	2026-09-20 19:34	57.02	OK	540	2026-09-20 19:35	54.74	OK
541	2026-09-20 19:36	54.20	OK	542	2026-09-20 19:37	56.05	OK
543	2026-09-20 19:38	56.17	OK	544	2026-09-20 19:39	56.61	OK
545	2026-09-20 19:40	56.85	OK	546	2026-09-20 19:41	55.08	OK
547	2026-09-20 19:42	56.28	OK	548	2026-09-20 19:43	56.75	OK
549	2026-09-20 19:44	55.95	OK	550	2026-09-20 19:45	56.95	OK
551	2026-09-20 19:46	57.75	OK	552	2026-09-20 19:47	56.69	OK
553	2026-09-20 19:48	56.43	OK	554	2026-09-20 19:49	54.75	OK
555	2026-09-20 19:50	56.29	OK	556	2026-09-20 19:51	56.40	OK
557	2026-09-20 19:52	56.75	OK	558	2026-09-20 19:53	54.06	OK
559	2026-09-20 19:54	57.27	OK	560	2026-09-20 19:55	56.80	OK
561	2026-09-20 19:56	55.30	OK	562	2026-09-20 19:57	56.09	OK
563	2026-09-20 19:58	56.31	OK	564	2026-09-20 19:59	56.08	OK
565	2026-09-20 20:00	56.42	OK	566	2026-09-20 20:01	55.32	OK
567	2026-09-20 20:02	56.00	OK	568	2026-09-20 20:03	56.83	OK
569	2026-09-20 20:04	56.90	OK	570	2026-09-20 20:05	56.41	OK
571	2026-09-20 20:06	55.36	OK	572	2026-09-20 20:07	55.57	OK
573	2026-09-20 20:08	54.95	OK	574	2026-09-20 20:09	53.40	OK
575	2026-09-20 20:10	55.35	OK	576	2026-09-20 20:11	56.49	OK
577	2026-09-20 20:12	54.76	OK	578	2026-09-20 20:13	57.03	OK
579	2026-09-20 20:14	55.88	OK	580	2026-09-20 20:15	54.15	OK
581	2026-09-20 20:16	53.66	OK	582	2026-09-20 20:17	57.14	OK
583	2026-09-20 20:18	55.31	OK	584	2026-09-20 20:19	55.34	OK
585	2026-09-20 20:20	57.47	OK	586	2026-09-20 20:21	54.25	OK
587	2026-09-20 20:22	54.97	OK	588	2026-09-20 20:23	56.39	OK
589	2026-09-20 20:24	55.86	OK	590	2026-09-20 20:25	54.29	OK
591	2026-09-20 20:26	54.30	OK	592	2026-09-20 20:27	54.85	OK
593	2026-09-20 20:28	55.62	OK	594	2026-09-20 20:29	54.44	OK
595	2026-09-20 20:30	53.96	OK	596	2026-09-20 20:31	53.21	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
597	2026-09-20 20:32	56.05	OK	598	2026-09-20 20:33	54.75	OK
599	2026-09-20 20:34	55.12	OK	600	2026-09-20 20:35	54.36	OK
601	2026-09-20 20:36	54.89	OK	602	2026-09-20 20:37	56.54	OK
603	2026-09-20 20:38	56.99	OK	604	2026-09-20 20:39	56.05	OK
605	2026-09-20 20:40	54.44	OK	606	2026-09-20 20:41	53.53	OK
607	2026-09-20 20:42	58.03	OK	608	2026-09-20 20:43	57.35	OK
609	2026-09-20 20:44	56.88	OK	610	2026-09-20 20:45	57.79	OK
611	2026-09-20 20:46	54.58	OK	612	2026-09-20 20:47	53.92	OK
613	2026-09-20 20:48	56.39	OK	614	2026-09-20 20:49	56.64	OK
615	2026-09-20 20:50	56.03	OK	616	2026-09-20 20:51	53.52	OK
617	2026-09-20 20:52	54.41	OK	618	2026-09-20 20:53	55.68	OK
619	2026-09-20 20:54	55.75	OK	620	2026-09-20 20:55	56.47	OK
621	2026-09-20 20:56	57.04	OK	622	2026-09-20 20:57	56.15	OK
623	2026-09-20 20:58	54.76	OK	624	2026-09-20 20:59	57.04	OK
625	2026-09-20 21:00	54.45	OK	626	2026-09-20 21:01	56.05	OK
627	2026-09-20 21:02	56.55	OK	628	2026-09-20 21:03	52.39	OK
629	2026-09-20 21:04	54.42	OK	630	2026-09-20 21:05	53.43	OK
631	2026-09-20 21:06	56.02	OK	632	2026-09-20 21:07	53.77	OK
633	2026-09-20 21:08	52.91	OK	634	2026-09-20 21:09	55.15	OK
635	2026-09-20 21:10	54.71	OK	636	2026-09-20 21:11	53.37	OK
637	2026-09-20 21:12	55.00	OK	638	2026-09-20 21:13	52.40	OK
639	2026-09-20 21:14	53.92	OK	640	2026-09-20 21:15	56.15	OK
641	2026-09-20 21:16	56.26	OK	642	2026-09-20 21:17	56.43	OK
643	2026-09-20 21:18	55.54	OK	644	2026-09-20 21:19	55.62	OK
645	2026-09-20 21:20	55.31	OK	646	2026-09-20 21:21	55.13	OK
647	2026-09-20 21:22	54.19	OK	648	2026-09-20 21:23	55.83	OK
649	2026-09-20 21:24	55.85	OK	650	2026-09-20 21:25	53.20	OK
651	2026-09-20 21:26	55.41	OK	652	2026-09-20 21:27	55.60	OK
653	2026-09-20 21:28	53.82	OK	654	2026-09-20 21:29	54.65	OK
655	2026-09-20 21:30	53.34	OK	656	2026-09-20 21:31	52.22	OK
657	2026-09-20 21:32	54.05	OK	658	2026-09-20 21:33	55.40	OK
659	2026-09-20 21:34	55.32	OK	660	2026-09-20 21:35	54.73	OK
661	2026-09-20 21:36	53.19	OK	662	2026-09-20 21:37	55.24	OK
663	2026-09-20 21:38	52.93	OK	664	2026-09-20 21:39	54.71	OK
665	2026-09-20 21:40	53.03	OK	666	2026-09-20 21:41	52.84	OK
667	2026-09-20 21:42	54.37	OK	668	2026-09-20 21:43	53.40	OK
669	2026-09-20 21:44	52.20	OK	670	2026-09-20 21:45	55.89	OK
671	2026-09-20 21:46	51.66	OK	672	2026-09-20 21:47	54.25	OK
673	2026-09-20 21:48	53.00	OK	674	2026-09-20 21:49	55.89	OK
675	2026-09-20 21:50	52.46	OK	676	2026-09-20 21:51	54.86	OK
677	2026-09-20 21:52	53.75	OK	678	2026-09-20 21:53	53.91	OK
679	2026-09-20 21:54	53.15	OK	680	2026-09-20 21:55	52.98	OK
681	2026-09-20 21:56	52.94	OK	682	2026-09-20 21:57	54.96	OK
683	2026-09-20 21:58	55.65	OK	684	2026-09-20 21:59	52.61	OK
685	2026-09-20 22:00	54.55	OK	686	2026-09-20 22:01	54.77	OK
687	2026-09-20 22:02	52.67	OK	688	2026-09-20 22:03	53.25	OK
689	2026-09-20 22:04	54.80	OK	690	2026-09-20 22:05	52.60	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
691	2026-09-20 22:06	53.76	OK	692	2026-09-20 22:07	55.82	OK
693	2026-09-20 22:08	52.67	OK	694	2026-09-20 22:09	53.70	OK
695	2026-09-20 22:10	52.53	OK	696	2026-09-20 22:11	52.53	OK
697	2026-09-20 22:12	52.30	OK	698	2026-09-20 22:13	52.45	OK
699	2026-09-20 22:14	55.35	OK	700	2026-09-20 22:15	54.80	OK
701	2026-09-20 22:16	53.85	OK	702	2026-09-20 22:17	52.54	OK
703	2026-09-20 22:18	54.38	OK	704	2026-09-20 22:19	53.36	OK
705	2026-09-20 22:20	52.74	OK	706	2026-09-20 22:21	53.79	OK
707	2026-09-20 22:22	55.18	OK	708	2026-09-20 22:23	51.93	OK
709	2026-09-20 22:24	55.80	OK	710	2026-09-20 22:25	52.22	OK
711	2026-09-20 22:26	53.26	OK	712	2026-09-20 22:27	54.75	OK
713	2026-09-20 22:28	54.37	OK	714	2026-09-20 22:29	52.42	OK
715	2026-09-20 22:30	53.22	OK	716	2026-09-20 22:31	51.92	OK
717	2026-09-20 22:32	54.66	OK	718	2026-09-20 22:33	53.24	OK
719	2026-09-20 22:34	53.45	OK	720	2026-09-20 22:35	54.44	OK
721	2026-09-20 22:36	52.59	OK	722	2026-09-20 22:37	52.69	OK
723	2026-09-20 22:38	53.45	OK	724	2026-09-20 22:39	52.14	OK
725	2026-09-20 22:40	54.07	OK	726	2026-09-20 22:41	52.46	OK
727	2026-09-20 22:42	52.57	OK	728	2026-09-20 22:43	53.62	OK
729	2026-09-20 22:44	52.32	OK	730	2026-09-20 22:45	51.52	OK
731	2026-09-20 22:46	52.25	OK	732	2026-09-20 22:47	54.24	OK
733	2026-09-20 22:48	52.73	OK	734	2026-09-20 22:49	52.22	OK
735	2026-09-20 22:50	51.52	OK	736	2026-09-20 22:51	52.00	OK
737	2026-09-20 22:52	51.73	OK	738	2026-09-20 22:53	52.85	OK
739	2026-09-20 22:54	51.96	OK	740	2026-09-20 22:55	53.44	OK
741	2026-09-20 22:56	53.37	OK	742	2026-09-20 22:57	50.48	OK
743	2026-09-20 22:58	55.10	OK	744	2026-09-20 22:59	52.95	OK
745	2026-09-20 23:00	52.10	OK	746	2026-09-20 23:01	52.47	OK
747	2026-09-20 23:02	52.20	OK	748	2026-09-20 23:03	50.91	OK
749	2026-09-20 23:04	52.29	OK	750	2026-09-20 23:05	54.72	OK
751	2026-09-20 23:06	51.14	OK	752	2026-09-20 23:07	50.38	OK
753	2026-09-20 23:08	51.95	OK	754	2026-09-20 23:09	51.71	OK
755	2026-09-20 23:10	54.50	OK	756	2026-09-20 23:11	53.36	OK
757	2026-09-20 23:12	51.90	OK	758	2026-09-20 23:13	50.64	OK
759	2026-09-20 23:14	51.66	OK	760	2026-09-20 23:15	51.98	OK
761	2026-09-20 23:16	52.11	OK	762	2026-09-20 23:17	50.90	OK
763	2026-09-20 23:18	52.93	OK	764	2026-09-20 23:19	52.90	OK
765	2026-09-20 23:20	50.94	OK	766	2026-09-20 23:21	51.57	OK
767	2026-09-20 23:22	51.73	OK	768	2026-09-20 23:23	53.42	OK
769	2026-09-20 23:24	51.84	OK	770	2026-09-20 23:25	52.02	OK
771	2026-09-20 23:26	51.17	OK	772	2026-09-20 23:27	53.28	OK
773	2026-09-20 23:28	51.91	OK	774	2026-09-20 23:29	52.50	OK
775	2026-09-20 23:30	51.74	OK	776	2026-09-20 23:31	51.73	OK
777	2026-09-20 23:32	52.68	OK	778	2026-09-20 23:33	51.63	OK
779	2026-09-20 23:34	51.57	OK	780	2026-09-20 23:35	51.48	OK
781	2026-09-20 23:36	53.08	OK	782	2026-09-20 23:37	51.87	OK
783	2026-09-20 23:38	51.50	OK	784	2026-09-20 23:39	51.90	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
785	2026-09-20 23:40	50.03	OK	786	2026-09-20 23:41	53.26	OK
787	2026-09-20 23:42	51.44	OK	788	2026-09-20 23:43	52.78	OK
789	2026-09-20 23:44	51.73	OK	790	2026-09-20 23:45	50.72	OK
791	2026-09-20 23:46	50.86	OK	792	2026-09-20 23:47	52.86	OK
793	2026-09-20 23:48	49.08	OK	794	2026-09-20 23:49	53.21	OK
795	2026-09-20 23:50	53.79	OK	796	2026-09-20 23:51	51.54	OK
797	2026-09-20 23:52	51.62	OK	798	2026-09-20 23:53	51.65	OK
799	2026-09-20 23:54	53.32	OK	800	2026-09-20 23:55	51.27	OK
801	2026-09-20 23:56	50.79	OK	802	2026-09-20 23:57	50.55	OK
803	2026-09-20 23:58	51.36	OK	804	2026-09-20 23:59	50.65	OK
805	2026-09-21 00:00	49.61	OK	806	2026-09-21 00:01	50.92	OK
807	2026-09-21 00:02	54.16	OK	808	2026-09-21 00:03	51.23	OK
809	2026-09-21 00:04	52.07	OK	810	2026-09-21 00:05	53.30	OK
811	2026-09-21 00:06	50.76	OK	812	2026-09-21 00:07	52.32	OK
813	2026-09-21 00:08	52.63	OK	814	2026-09-21 00:09	53.39	OK
815	2026-09-21 00:10	52.91	OK	816	2026-09-21 00:11	52.44	OK
817	2026-09-21 00:12	52.45	OK	818	2026-09-21 00:13	52.60	OK
819	2026-09-21 00:14	52.76	OK	820	2026-09-21 00:15	52.78	OK
821	2026-09-21 00:16	50.52	OK	822	2026-09-21 00:17	51.07	OK
823	2026-09-21 00:18	51.29	OK	824	2026-09-21 00:19	51.79	OK
825	2026-09-21 00:20	52.58	OK	826	2026-09-21 00:21	52.36	OK
827	2026-09-21 00:22	51.65	OK	828	2026-09-21 00:23	52.11	OK
829	2026-09-21 00:24	51.76	OK	830	2026-09-21 00:25	50.34	OK
831	2026-09-21 00:26	51.48	OK	832	2026-09-21 00:27	51.64	OK
833	2026-09-21 00:28	50.77	OK	834	2026-09-21 00:29	50.89	OK
835	2026-09-21 00:30	50.95	OK	836	2026-09-21 00:31	52.70	OK
837	2026-09-21 00:32	50.61	OK	838	2026-09-21 00:33	51.92	OK
839	2026-09-21 00:34	52.72	OK	840	2026-09-21 00:35	50.54	OK
841	2026-09-21 00:36	53.42	OK	842	2026-09-21 00:37	53.07	OK
843	2026-09-21 00:38	50.10	OK	844	2026-09-21 00:39	52.78	OK
845	2026-09-21 00:40	51.25	OK	846	2026-09-21 00:41	51.17	OK
847	2026-09-21 00:42	50.34	OK	848	2026-09-21 00:43	52.22	OK
849	2026-09-21 00:44	51.97	OK	850	2026-09-21 00:45	50.92	OK
851	2026-09-21 00:46	51.92	OK	852	2026-09-21 00:47	49.69	OK
853	2026-09-21 00:48	51.21	OK	854	2026-09-21 00:49	50.73	OK
855	2026-09-21 00:50	49.84	OK	856	2026-09-21 00:51	50.96	OK
857	2026-09-21 00:52	50.39	OK	858	2026-09-21 00:53	51.42	OK
859	2026-09-21 00:54	52.47	OK	860	2026-09-21 00:55	52.35	OK
861	2026-09-21 00:56	51.88	OK	862	2026-09-21 00:57	51.70	OK
863	2026-09-21 00:58	50.66	OK	864	2026-09-21 00:59	50.37	OK
865	2026-09-21 01:00	50.83	OK	866	2026-09-21 01:01	49.32	OK
867	2026-09-21 01:02	53.23	OK	868	2026-09-21 01:03	51.51	OK
869	2026-09-21 01:04	51.40	OK	870	2026-09-21 01:05	51.10	OK
871	2026-09-21 01:06	51.07	OK	872	2026-09-21 01:07	50.12	OK
873	2026-09-21 01:08	49.06	OK	874	2026-09-21 01:09	50.77	OK
875	2026-09-21 01:10	50.04	OK	876	2026-09-21 01:11	50.47	OK
877	2026-09-21 01:12	50.01	OK	878	2026-09-21 01:13	51.75	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
879	2026-09-21 01:14	50.83	OK	880	2026-09-21 01:15	50.90	OK
881	2026-09-21 01:16	50.22	OK	882	2026-09-21 01:17	51.89	OK
883	2026-09-21 01:18	49.90	OK	884	2026-09-21 01:19	53.03	OK
885	2026-09-21 01:20	50.66	OK	886	2026-09-21 01:21	51.52	OK
887	2026-09-21 01:22	49.50	OK	888	2026-09-21 01:23	49.96	OK
889	2026-09-21 01:24	51.11	OK	890	2026-09-21 01:25	49.20	OK
891	2026-09-21 01:26	51.55	OK	892	2026-09-21 01:27	52.82	OK
893	2026-09-21 01:28	49.72	OK	894	2026-09-21 01:29	50.14	OK
895	2026-09-21 01:30	49.54	OK	896	2026-09-21 01:31	52.65	OK
897	2026-09-21 01:32	52.06	OK	898	2026-09-21 01:33	52.88	OK
899	2026-09-21 01:34	49.95	OK	900	2026-09-21 01:35	51.59	OK
901	2026-09-21 01:36	50.06	OK	902	2026-09-21 01:37	50.74	OK
903	2026-09-21 01:38	49.44	OK	904	2026-09-21 01:39	50.20	OK
905	2026-09-21 01:40	50.42	OK	906	2026-09-21 01:41	50.48	OK
907	2026-09-21 01:42	49.48	OK	908	2026-09-21 01:43	49.47	OK
909	2026-09-21 01:44	49.42	OK	910	2026-09-21 01:45	49.28	OK
911	2026-09-21 01:46	49.43	OK	912	2026-09-21 01:47	50.25	OK
913	2026-09-21 01:48	48.78	OK	914	2026-09-21 01:49	49.48	OK
915	2026-09-21 01:50	51.93	OK	916	2026-09-21 01:51	51.67	OK
917	2026-09-21 01:52	50.36	OK	918	2026-09-21 01:53	51.40	OK
919	2026-09-21 01:54	49.15	OK	920	2026-09-21 01:55	49.60	OK
921	2026-09-21 01:56	50.86	OK	922	2026-09-21 01:57	49.47	OK
923	2026-09-21 01:58	49.37	OK	924	2026-09-21 01:59	51.27	OK
925	2026-09-21 02:00	48.50	OK	926	2026-09-21 02:01	50.14	OK
927	2026-09-21 02:02	49.41	OK	928	2026-09-21 02:03	49.98	OK
929	2026-09-21 02:04	50.18	OK	930	2026-09-21 02:05	50.69	OK
931	2026-09-21 02:06	50.37	OK	932	2026-09-21 02:07	50.23	OK
933	2026-09-21 02:08	51.80	OK	934	2026-09-21 02:09	50.01	OK
935	2026-09-21 02:10	50.32	OK	936	2026-09-21 02:11	50.88	OK
937	2026-09-21 02:12	49.97	OK	938	2026-09-21 02:13	50.60	OK
939	2026-09-21 02:14	49.55	OK	940	2026-09-21 02:15	48.35	OK
941	2026-09-21 02:16	50.52	OK	942	2026-09-21 02:17	50.10	OK
943	2026-09-21 02:18	49.12	OK	944	2026-09-21 02:19	51.37	OK
945	2026-09-21 02:20	50.30	OK	946	2026-09-21 02:21	49.63	OK
947	2026-09-21 02:22	49.61	OK	948	2026-09-21 02:23	51.19	OK
949	2026-09-21 02:24	49.92	OK	950	2026-09-21 02:25	49.50	OK
951	2026-09-21 02:26	50.03	OK	952	2026-09-21 02:27	51.37	OK
953	2026-09-21 02:28	51.29	OK	954	2026-09-21 02:29	50.38	OK
955	2026-09-21 02:30	49.58	OK	956	2026-09-21 02:31	50.56	OK
957	2026-09-21 02:32	51.15	OK	958	2026-09-21 02:33	51.60	OK
959	2026-09-21 02:34	50.68	OK	960	2026-09-21 02:35	50.35	OK
961	2026-09-21 02:36	51.61	OK	962	2026-09-21 02:37	50.78	OK
963	2026-09-21 02:38	47.87	OK	964	2026-09-21 02:39	51.21	OK
965	2026-09-21 02:40	49.86	OK	966	2026-09-21 02:41	49.55	OK
967	2026-09-21 02:42	50.01	OK	968	2026-09-21 02:43	49.30	OK
969	2026-09-21 02:44	48.44	OK	970	2026-09-21 02:45	49.26	OK
971	2026-09-21 02:46	51.37	OK	972	2026-09-21 02:47	51.28	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
973	2026-09-21 02:48	50.29	OK	974	2026-09-21 02:49	49.33	OK
975	2026-09-21 02:50	48.37	OK	976	2026-09-21 02:51	49.29	OK
977	2026-09-21 02:52	49.35	OK	978	2026-09-21 02:53	50.83	OK
979	2026-09-21 02:54	50.42	OK	980	2026-09-21 02:55	51.12	OK
981	2026-09-21 02:56	50.26	OK	982	2026-09-21 02:57	50.38	OK
983	2026-09-21 02:58	49.23	OK	984	2026-09-21 02:59	50.37	OK
985	2026-09-21 03:00	50.23	OK	986	2026-09-21 03:01	48.30	OK
987	2026-09-21 03:02	52.28	OK	988	2026-09-21 03:03	49.66	OK
989	2026-09-21 03:04	48.71	OK	990	2026-09-21 03:05	51.67	OK
991	2026-09-21 03:06	47.86	OK	992	2026-09-21 03:07	49.49	OK
993	2026-09-21 03:08	51.36	OK	994	2026-09-21 03:09	49.78	OK
995	2026-09-21 03:10	50.80	OK	996	2026-09-21 03:11	50.75	OK
997	2026-09-21 03:12	49.13	OK	998	2026-09-21 03:13	49.57	OK
999	2026-09-21 03:14	49.58	OK	1000	2026-09-21 03:15	50.49	OK
1001	2026-09-21 03:16	50.91	OK	1002	2026-09-21 03:17	49.29	OK
1003	2026-09-21 03:18	50.53	OK	1004	2026-09-21 03:19	49.56	OK
1005	2026-09-21 03:20	49.74	OK	1006	2026-09-21 03:21	52.23	OK
1007	2026-09-21 03:22	50.40	OK	1008	2026-09-21 03:23	52.17	OK
1009	2026-09-21 03:24	50.53	OK	1010	2026-09-21 03:25	48.90	OK
1011	2026-09-21 03:26	49.76	OK	1012	2026-09-21 03:27	50.43	OK
1013	2026-09-21 03:28	50.02	OK	1014	2026-09-21 03:29	48.23	OK
1015	2026-09-21 03:30	51.70	OK	1016	2026-09-21 03:31	49.90	OK
1017	2026-09-21 03:32	49.27	OK	1018	2026-09-21 03:33	50.64	OK
1019	2026-09-21 03:34	50.71	OK	1020	2026-09-21 03:35	49.87	OK
1021	2026-09-21 03:36	49.62	OK	1022	2026-09-21 03:37	50.88	OK
1023	2026-09-21 03:38	50.60	OK	1024	2026-09-21 03:39	49.11	OK
1025	2026-09-21 03:40	48.72	OK	1026	2026-09-21 03:41	52.20	OK
1027	2026-09-21 03:42	49.80	OK	1028	2026-09-21 03:43	51.82	OK
1029	2026-09-21 03:44	50.20	OK	1030	2026-09-21 03:45	49.78	OK
1031	2026-09-21 03:46	49.43	OK	1032	2026-09-21 03:47	49.48	OK
1033	2026-09-21 03:48	48.26	OK	1034	2026-09-21 03:49	49.64	OK
1035	2026-09-21 03:50	48.63	OK	1036	2026-09-21 03:51	50.04	OK
1037	2026-09-21 03:52	48.71	OK	1038	2026-09-21 03:53	49.78	OK
1039	2026-09-21 03:54	50.76	OK	1040	2026-09-21 03:55	49.41	OK
1041	2026-09-21 03:56	50.89	OK	1042	2026-09-21 03:57	52.00	OK
1043	2026-09-21 03:58	50.16	OK	1044	2026-09-21 03:59	49.50	OK
1045	2026-09-21 04:00	49.21	OK	1046	2026-09-21 04:01	51.13	OK
1047	2026-09-21 04:02	50.12	OK	1048	2026-09-21 04:03	51.52	OK
1049	2026-09-21 04:04	50.14	OK	1050	2026-09-21 04:05	50.63	OK
1051	2026-09-21 04:06	51.24	OK	1052	2026-09-21 04:07	49.98	OK
1053	2026-09-21 04:08	49.96	OK	1054	2026-09-21 04:09	49.71	OK
1055	2026-09-21 04:10	50.14	OK	1056	2026-09-21 04:11	50.89	OK
1057	2026-09-21 04:12	51.53	OK	1058	2026-09-21 04:13	49.36	OK
1059	2026-09-21 04:14	49.40	OK	1060	2026-09-21 04:15	50.25	OK
1061	2026-09-21 04:16	49.72	OK	1062	2026-09-21 04:17	51.30	OK
1063	2026-09-21 04:18	48.61	OK	1064	2026-09-21 04:19	49.85	OK
1065	2026-09-21 04:20	51.68	OK	1066	2026-09-21 04:21	51.08	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1067	2026-09-21 04:22	50.42	OK	1068	2026-09-21 04:23	50.29	OK
1069	2026-09-21 04:24	48.11	OK	1070	2026-09-21 04:25	50.71	OK
1071	2026-09-21 04:26	50.08	OK	1072	2026-09-21 04:27	51.70	OK
1073	2026-09-21 04:28	50.55	OK	1074	2026-09-21 04:29	51.02	OK
1075	2026-09-21 04:30	49.40	OK	1076	2026-09-21 04:31	49.77	OK
1077	2026-09-21 04:32	51.23	OK	1078	2026-09-21 04:33	51.15	OK
1079	2026-09-21 04:34	48.49	OK	1080	2026-09-21 04:35	48.14	OK
1081	2026-09-21 04:36	50.22	OK	1082	2026-09-21 04:37	51.55	OK
1083	2026-09-21 04:38	50.49	OK	1084	2026-09-21 04:39	50.54	OK
1085	2026-09-21 04:40	52.26	OK	1086	2026-09-21 04:41	50.70	OK
1087	2026-09-21 04:42	51.37	OK	1088	2026-09-21 04:43	50.63	OK
1089	2026-09-21 04:44	49.93	OK	1090	2026-09-21 04:45	50.74	OK
1091	2026-09-21 04:46	51.45	OK	1092	2026-09-21 04:47	49.92	OK
1093	2026-09-21 04:48	52.13	OK	1094	2026-09-21 04:49	51.09	OK
1095	2026-09-21 04:50	50.69	OK	1096	2026-09-21 04:51	50.27	OK
1097	2026-09-21 04:52	52.11	OK	1098	2026-09-21 04:53	49.61	OK
1099	2026-09-21 04:54	50.70	OK	1100	2026-09-21 04:55	50.51	OK
1101	2026-09-21 04:56	50.39	OK	1102	2026-09-21 04:57	50.68	OK
1103	2026-09-21 04:58	51.71	OK	1104	2026-09-21 04:59	50.09	OK
1105	2026-09-21 05:00	51.49	OK	1106	2026-09-21 05:01	50.68	OK
1107	2026-09-21 05:02	50.09	OK	1108	2026-09-21 05:03	50.82	OK
1109	2026-09-21 05:04	52.01	OK	1110	2026-09-21 05:05	50.93	OK
1111	2026-09-21 05:06	51.07	OK	1112	2026-09-21 05:07	50.12	OK
1113	2026-09-21 05:08	50.85	OK	1114	2026-09-21 05:09	50.44	OK
1115	2026-09-21 05:10	49.52	OK	1116	2026-09-21 05:11	50.41	OK
1117	2026-09-21 05:12	50.33	OK	1118	2026-09-21 05:13	51.17	OK
1119	2026-09-21 05:14	50.02	OK	1120	2026-09-21 05:15	51.56	OK
1121	2026-09-21 05:16	50.85	OK	1122	2026-09-21 05:17	49.86	OK
1123	2026-09-21 05:18	49.09	OK	1124	2026-09-21 05:19	50.14	OK
1125	2026-09-21 05:20	50.62	OK	1126	2026-09-21 05:21	50.91	OK
1127	2026-09-21 05:22	49.51	OK	1128	2026-09-21 05:23	50.06	OK
1129	2026-09-21 05:24	50.12	OK	1130	2026-09-21 05:25	51.75	OK
1131	2026-09-21 05:26	50.54	OK	1132	2026-09-21 05:27	50.74	OK
1133	2026-09-21 05:28	50.21	OK	1134	2026-09-21 05:29	50.46	OK
1135	2026-09-21 05:30	50.92	OK	1136	2026-09-21 05:31	50.12	OK
1137	2026-09-21 05:32	51.56	OK	1138	2026-09-21 05:33	51.14	OK
1139	2026-09-21 05:34	49.61	OK	1140	2026-09-21 05:35	51.14	OK
1141	2026-09-21 05:36	50.64	OK	1142	2026-09-21 05:37	49.38	OK
1143	2026-09-21 05:38	51.18	OK	1144	2026-09-21 05:39	49.74	OK
1145	2026-09-21 05:40	48.54	OK	1146	2026-09-21 05:41	51.85	OK
1147	2026-09-21 05:42	52.10	OK	1148	2026-09-21 05:43	52.89	OK
1149	2026-09-21 05:44	50.18	OK	1150	2026-09-21 05:45	50.14	OK
1151	2026-09-21 05:46	51.97	OK	1152	2026-09-21 05:47	51.21	OK
1153	2026-09-21 05:48	51.07	OK	1154	2026-09-21 05:49	50.27	OK
1155	2026-09-21 05:50	51.20	OK	1156	2026-09-21 05:51	51.94	OK
1157	2026-09-21 05:52	52.42	OK	1158	2026-09-21 05:53	49.34	OK
1159	2026-09-21 05:54	49.74	OK	1160	2026-09-21 05:55	50.74	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1161	2026-09-21 05:56	51.97	OK	1162	2026-09-21 05:57	50.32	OK
1163	2026-09-21 05:58	51.37	OK	1164	2026-09-21 05:59	51.39	OK
1165	2026-09-21 06:00	50.96	OK	1166	2026-09-21 06:01	52.51	OK
1167	2026-09-21 06:02	50.73	OK	1168	2026-09-21 06:03	50.99	OK
1169	2026-09-21 06:04	50.28	OK	1170	2026-09-21 06:05	53.85	OK
1171	2026-09-21 06:06	49.85	OK	1172	2026-09-21 06:07	52.37	OK
1173	2026-09-21 06:08	52.17	OK	1174	2026-09-21 06:09	50.81	OK
1175	2026-09-21 06:10	51.36	OK	1176	2026-09-21 06:11	53.05	OK
1177	2026-09-21 06:12	52.06	OK	1178	2026-09-21 06:13	52.58	OK
1179	2026-09-21 06:14	52.47	OK	1180	2026-09-21 06:15	52.11	OK
1181	2026-09-21 06:16	51.50	OK	1182	2026-09-21 06:17	50.64	OK
1183	2026-09-21 06:18	51.83	OK	1184	2026-09-21 06:19	50.78	OK
1185	2026-09-21 06:20	51.78	OK	1186	2026-09-21 06:21	52.21	OK
1187	2026-09-21 06:22	50.99	OK	1188	2026-09-21 06:23	50.65	OK
1189	2026-09-21 06:24	50.54	OK	1190	2026-09-21 06:25	53.49	OK
1191	2026-09-21 06:26	51.40	OK	1192	2026-09-21 06:27	50.06	OK
1193	2026-09-21 06:28	50.32	OK	1194	2026-09-21 06:29	52.97	OK
1195	2026-09-21 06:30	51.26	OK	1196	2026-09-21 06:31	51.61	OK
1197	2026-09-21 06:32	54.04	OK	1198	2026-09-21 06:33	52.11	OK
1199	2026-09-21 06:34	51.90	OK	1200	2026-09-21 06:35	51.95	OK
1201	2026-09-21 06:36	51.85	OK	1202	2026-09-21 06:37	51.12	OK
1203	2026-09-21 06:38	52.51	OK	1204	2026-09-21 06:39	51.54	OK
1205	2026-09-21 06:40	52.79	OK	1206	2026-09-21 06:41	53.09	OK
1207	2026-09-21 06:42	51.24	OK	1208	2026-09-21 06:43	52.75	OK
1209	2026-09-21 06:44	52.19	OK	1210	2026-09-21 06:45	51.12	OK
1211	2026-09-21 06:46	52.33	OK	1212	2026-09-21 06:47	50.91	OK
1213	2026-09-21 06:48	52.65	OK	1214	2026-09-21 06:49	50.68	OK
1215	2026-09-21 06:50	53.03	OK	1216	2026-09-21 06:51	52.94	OK
1217	2026-09-21 06:52	51.78	OK	1218	2026-09-21 06:53	51.44	OK
1219	2026-09-21 06:54	51.93	OK	1220	2026-09-21 06:55	50.96	OK
1221	2026-09-21 06:56	51.01	OK	1222	2026-09-21 06:57	51.50	OK
1223	2026-09-21 06:58	52.02	OK	1224	2026-09-21 06:59	51.70	OK
1225	2026-09-21 07:00	52.37	OK	1226	2026-09-21 07:01	52.09	OK
1227	2026-09-21 07:02	51.38	OK	1228	2026-09-21 07:03	53.33	OK
1229	2026-09-21 07:04	52.08	OK	1230	2026-09-21 07:05	53.15	OK
1231	2026-09-21 07:06	53.50	OK	1232	2026-09-21 07:07	52.11	OK
1233	2026-09-21 07:08	51.63	OK	1234	2026-09-21 07:09	51.75	OK
1235	2026-09-21 07:10	53.30	OK	1236	2026-09-21 07:11	52.28	OK
1237	2026-09-21 07:12	51.22	OK	1238	2026-09-21 07:13	53.19	OK
1239	2026-09-21 07:14	51.33	OK	1240	2026-09-21 07:15	52.88	OK
1241	2026-09-21 07:16	52.11	OK	1242	2026-09-21 07:17	54.54	OK
1243	2026-09-21 07:18	51.23	OK	1244	2026-09-21 07:19	50.50	OK
1245	2026-09-21 07:20	53.17	OK	1246	2026-09-21 07:21	54.25	OK
1247	2026-09-21 07:22	51.29	OK	1248	2026-09-21 07:23	51.41	OK
1249	2026-09-21 07:24	54.59	OK	1250	2026-09-21 07:25	54.82	OK
1251	2026-09-21 07:26	51.39	OK	1252	2026-09-21 07:27	54.14	OK
1253	2026-09-21 07:28	50.54	OK	1254	2026-09-21 07:29	52.03	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1255	2026-09-21 07:30	52.01	OK	1256	2026-09-21 07:31	51.60	OK
1257	2026-09-21 07:32	51.44	OK	1258	2026-09-21 07:33	53.30	OK
1259	2026-09-21 07:34	52.33	OK	1260	2026-09-21 07:35	52.99	OK
1261	2026-09-21 07:36	52.72	OK	1262	2026-09-21 07:37	53.22	OK
1263	2026-09-21 07:38	52.10	OK	1264	2026-09-21 07:39	53.09	OK
1265	2026-09-21 07:40	53.16	OK	1266	2026-09-21 07:41	53.86	OK
1267	2026-09-21 07:42	52.55	OK	1268	2026-09-21 07:43	52.93	OK
1269	2026-09-21 07:44	53.18	OK	1270	2026-09-21 07:45	53.69	OK
1271	2026-09-21 07:46	51.52	OK	1272	2026-09-21 07:47	52.80	OK
1273	2026-09-21 07:48	54.31	OK	1274	2026-09-21 07:49	53.23	OK
1275	2026-09-21 07:50	52.72	OK	1276	2026-09-21 07:51	53.59	OK
1277	2026-09-21 07:52	53.75	OK	1278	2026-09-21 07:53	52.12	OK
1279	2026-09-21 07:54	52.26	OK	1280	2026-09-21 07:55	52.60	OK
1281	2026-09-21 07:56	54.49	OK	1282	2026-09-21 07:57	52.89	OK
1283	2026-09-21 07:58	53.94	OK	1284	2026-09-21 07:59	53.90	OK
1285	2026-09-21 08:00	52.80	OK	1286	2026-09-21 08:01	53.17	OK
1287	2026-09-21 08:02	54.09	OK	1288	2026-09-21 08:03	52.37	OK
1289	2026-09-21 08:04	53.72	OK	1290	2026-09-21 08:05	53.62	OK
1291	2026-09-21 08:06	54.47	OK	1292	2026-09-21 08:07	53.71	OK
1293	2026-09-21 08:08	51.89	OK	1294	2026-09-21 08:09	53.04	OK
1295	2026-09-21 08:10	54.15	OK	1296	2026-09-21 08:11	54.32	OK
1297	2026-09-21 08:12	54.31	OK	1298	2026-09-21 08:13	54.51	OK
1299	2026-09-21 08:14	53.84	OK	1300	2026-09-21 08:15	53.42	OK
1301	2026-09-21 08:16	54.14	OK	1302	2026-09-21 08:17	52.76	OK
1303	2026-09-21 08:18	54.29	OK	1304	2026-09-21 08:19	53.44	OK
1305	2026-09-21 08:20	54.66	OK	1306	2026-09-21 08:21	52.09	OK
1307	2026-09-21 08:22	52.23	OK	1308	2026-09-21 08:23	54.22	OK
1309	2026-09-21 08:24	54.47	OK	1310	2026-09-21 08:25	53.30	OK
1311	2026-09-21 08:26	54.17	OK	1312	2026-09-21 08:27	52.14	OK
1313	2026-09-21 08:28	54.57	OK	1314	2026-09-21 08:29	52.90	OK
1315	2026-09-21 08:30	52.32	OK	1316	2026-09-21 08:31	51.42	OK
1317	2026-09-21 08:32	52.75	OK	1318	2026-09-21 08:33	53.70	OK
1319	2026-09-21 08:34	52.64	OK	1320	2026-09-21 08:35	54.04	OK
1321	2026-09-21 08:36	54.35	OK	1322	2026-09-21 08:37	52.36	OK
1323	2026-09-21 08:38	53.93	OK	1324	2026-09-21 08:39	54.72	OK
1325	2026-09-21 08:40	53.54	OK	1326	2026-09-21 08:41	53.91	OK
1327	2026-09-21 08:42	53.49	OK	1328	2026-09-21 08:43	54.97	OK
1329	2026-09-21 08:44	53.36	OK	1330	2026-09-21 08:45	52.45	OK
1331	2026-09-21 08:46	53.95	OK	1332	2026-09-21 08:47	55.37	OK
1333	2026-09-21 08:48	53.43	OK	1334	2026-09-21 08:49	53.10	OK
1335	2026-09-21 08:50	53.70	OK	1336	2026-09-21 08:51	52.26	OK
1337	2026-09-21 08:52	54.05	OK	1338	2026-09-21 08:53	53.38	OK
1339	2026-09-21 08:54	54.09	OK	1340	2026-09-21 08:55	54.01	OK
1341	2026-09-21 08:56	51.07	OK	1342	2026-09-21 08:57	54.81	OK
1343	2026-09-21 08:58	54.76	OK	1344	2026-09-21 08:59	54.78	OK
1345	2026-09-21 09:00	54.39	OK	1346	2026-09-21 09:01	55.13	OK
1347	2026-09-21 09:02	53.61	OK	1348	2026-09-21 09:03	55.32	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1349	2026-09-21 09:04	54.04	OK	1350	2026-09-21 09:05	54.68	OK
1351	2026-09-21 09:06	53.69	OK	1352	2026-09-21 09:07	55.20	OK
1353	2026-09-21 09:08	52.82	OK	1354	2026-09-21 09:09	56.20	OK
1355	2026-09-21 09:10	54.49	OK	1356	2026-09-21 09:11	54.87	OK
1357	2026-09-21 09:12	53.99	OK	1358	2026-09-21 09:13	52.52	OK
1359	2026-09-21 09:14	56.88	OK	1360	2026-09-21 09:15	53.32	OK
1361	2026-09-21 09:16	53.98	OK	1362	2026-09-21 09:17	52.52	OK
1363	2026-09-21 09:18	52.11	OK	1364	2026-09-21 09:19	54.72	OK
1365	2026-09-21 09:20	55.29	OK	1366	2026-09-21 09:21	54.71	OK
1367	2026-09-21 09:22	55.97	OK	1368	2026-09-21 09:23	54.01	OK
1369	2026-09-21 09:24	53.07	OK	1370	2026-09-21 09:25	53.90	OK
1371	2026-09-21 09:26	53.89	OK	1372	2026-09-21 09:27	54.05	OK
1373	2026-09-21 09:28	54.28	OK	1374	2026-09-21 09:29	54.86	OK
1375	2026-09-21 09:30	55.91	OK	1376	2026-09-21 09:31	54.85	OK
1377	2026-09-21 09:32	54.00	OK	1378	2026-09-21 09:33	54.42	OK
1379	2026-09-21 09:34	54.33	OK	1380	2026-09-21 09:35	55.74	OK
1381	2026-09-21 09:36	53.23	OK	1382	2026-09-21 09:37	55.15	OK
1383	2026-09-21 09:38	55.04	OK	1384	2026-09-21 09:39	53.49	OK
1385	2026-09-21 09:40	56.07	OK	1386	2026-09-21 09:41	54.89	OK
1387	2026-09-21 09:42	54.44	OK	1388	2026-09-21 09:43	54.47	OK
1389	2026-09-21 09:44	54.12	OK	1390	2026-09-21 09:45	52.74	OK
1391	2026-09-21 09:46	55.91	OK	1392	2026-09-21 09:47	56.55	OK
1393	2026-09-21 09:48	54.17	OK	1394	2026-09-21 09:49	55.37	OK
1395	2026-09-21 09:50	54.68	OK	1396	2026-09-21 09:51	55.39	OK
1397	2026-09-21 09:52	55.35	OK	1398	2026-09-21 09:53	55.76	OK
1399	2026-09-21 09:54	55.14	OK	1400	2026-09-21 09:55	53.26	OK
1401	2026-09-21 09:56	56.23	OK	1402	2026-09-21 09:57	56.35	OK
1403	2026-09-21 09:58	54.88	OK	1404	2026-09-21 09:59	55.65	OK
1405	2026-09-21 10:00	54.60	OK	1406	2026-09-21 10:01	53.82	OK
1407	2026-09-21 10:02	54.62	OK	1408	2026-09-21 10:03	55.04	OK
1409	2026-09-21 10:04	54.77	OK	1410	2026-09-21 10:05	56.38	OK
1411	2026-09-21 10:06	55.17	OK	1412	2026-09-21 10:07	56.26	OK
1413	2026-09-21 10:08	54.46	OK	1414	2026-09-21 10:09	55.79	OK
1415	2026-09-21 10:10	56.36	OK	1416	2026-09-21 10:11	54.80	OK
1417	2026-09-21 10:12	56.07	OK	1418	2026-09-21 10:13	55.31	OK
1419	2026-09-21 10:14	54.26	OK	1420	2026-09-21 10:15	56.61	OK
1421	2026-09-21 10:16	55.23	OK	1422	2026-09-21 10:17	55.78	OK
1423	2026-09-21 10:18	55.32	OK	1424	2026-09-21 10:19	54.74	OK
1425	2026-09-21 10:20	56.65	OK	1426	2026-09-21 10:21	56.12	OK
1427	2026-09-21 10:22	55.43	OK	1428	2026-09-21 10:23	55.81	OK
1429	2026-09-21 10:24	55.16	OK	1430	2026-09-21 10:25	55.69	OK
1431	2026-09-21 10:26	54.73	OK	1432	2026-09-21 10:27	56.71	OK
1433	2026-09-21 10:28	54.26	OK	1434	2026-09-21 10:29	55.58	OK
1435	2026-09-21 10:30	56.15	OK	1436	2026-09-21 10:31	56.03	OK
1437	2026-09-21 10:32	55.79	OK	1438	2026-09-21 10:33	55.54	OK
1439	2026-09-21 10:34	55.21	OK	1440	2026-09-21 10:35	55.66	OK
1441	2026-09-21 10:36	55.44	OK	1442	2026-09-21 10:37	56.13	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1443	2026-09-21 10:38	54.96	OK	1444	2026-09-21 10:39	56.26	OK
1445	2026-09-21 10:40	56.22	OK	1446	2026-09-21 10:41	56.60	OK
1447	2026-09-21 10:42	57.24	OK	1448	2026-09-21 10:43	57.11	OK
1449	2026-09-21 10:44	57.38	OK	1450	2026-09-21 10:45	54.11	OK
1451	2026-09-21 10:46	54.69	OK	1452	2026-09-21 10:47	55.10	OK
1453	2026-09-21 10:48	57.14	OK	1454	2026-09-21 10:49	56.01	OK
1455	2026-09-21 10:50	58.12	OK	1456	2026-09-21 10:51	55.89	OK
1457	2026-09-21 10:52	54.65	OK	1458	2026-09-21 10:53	54.50	OK
1459	2026-09-21 10:54	58.02	OK	1460	2026-09-21 10:55	54.98	OK
1461	2026-09-21 10:56	56.68	OK	1462	2026-09-21 10:57	56.06	OK
1463	2026-09-21 10:58	57.85	OK	1464	2026-09-21 10:59	55.30	OK
1465	2026-09-21 11:00	55.36	OK	1466	2026-09-21 11:01	55.33	OK
1467	2026-09-21 11:02	58.00	OK	1468	2026-09-21 11:03	57.50	OK
1469	2026-09-21 11:04	56.49	OK	1470	2026-09-21 11:05	55.81	OK
1471	2026-09-21 11:06	54.89	OK	1472	2026-09-21 11:07	56.13	OK
1473	2026-09-21 11:08	56.97	OK	1474	2026-09-21 11:09	54.91	OK
1475	2026-09-21 11:10	56.59	OK	1476	2026-09-21 11:11	55.87	OK
1477	2026-09-21 11:12	55.70	OK	1478	2026-09-21 11:13	55.31	OK
1479	2026-09-21 11:14	57.71	OK	1480	2026-09-21 11:15	56.36	OK
1481	2026-09-21 11:16	54.66	OK	1482	2026-09-21 11:17	56.79	OK
1483	2026-09-21 11:18	55.41	OK	1484	2026-09-21 11:19	55.91	OK
1485	2026-09-21 11:20	57.25	OK	1486	2026-09-21 11:21	57.29	OK
1487	2026-09-21 11:22	58.21	OK	1488	2026-09-21 11:23	56.29	OK
1489	2026-09-21 11:24	56.86	OK	1490	2026-09-21 11:25	55.76	OK
1491	2026-09-21 11:26	58.74	OK	1492	2026-09-21 11:27	57.48	OK
1493	2026-09-21 11:28	56.56	OK	1494	2026-09-21 11:29	55.23	OK
1495	2026-09-21 11:30	56.13	OK	1496	2026-09-21 11:31	57.15	OK
1497	2026-09-21 11:32	57.54	OK	1498	2026-09-21 11:33	57.05	OK
1499	2026-09-21 11:34	57.91	OK	1500	2026-09-21 11:35	55.53	OK
1501	2026-09-21 11:36	56.76	OK	1502	2026-09-21 11:37	57.07	OK
1503	2026-09-21 11:38	57.09	OK	1504	2026-09-21 11:39	55.91	OK
1505	2026-09-21 11:40	57.20	OK	1506	2026-09-21 11:41	55.35	OK
1507	2026-09-21 11:42	59.19	OK	1508	2026-09-21 11:43	56.08	OK
1509	2026-09-21 11:44	54.86	OK	1510	2026-09-21 11:45	57.40	OK
1511	2026-09-21 11:46	54.90	OK	1512	2026-09-21 11:47	55.16	OK
1513	2026-09-21 11:48	55.04	OK	1514	2026-09-21 11:49	55.98	OK
1515	2026-09-21 11:50	56.85	OK	1516	2026-09-21 11:51	57.43	OK
1517	2026-09-21 11:52	56.23	OK	1518	2026-09-21 11:53	55.95	OK
1519	2026-09-21 11:54	56.24	OK	1520	2026-09-21 11:55	56.87	OK
1521	2026-09-21 11:56	56.17	OK	1522	2026-09-21 11:57	55.82	OK
1523	2026-09-21 11:58	56.72	OK	1524	2026-09-21 11:59	58.10	OK
1525	2026-09-21 12:00	57.08	OK	1526	2026-09-21 12:01	57.32	OK
1527	2026-09-21 12:02	57.38	OK	1528	2026-09-21 12:03	56.46	OK
1529	2026-09-21 12:04	56.01	OK	1530	2026-09-21 12:05	57.81	OK
1531	2026-09-21 12:06	57.61	OK	1532	2026-09-21 12:07	56.88	OK
1533	2026-09-21 12:08	56.77	OK	1534	2026-09-21 12:09	59.93	OK
1535	2026-09-21 12:10	57.80	OK	1536	2026-09-21 12:11	57.94	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1537	2026-09-21 12:12	57.46	OK	1538	2026-09-21 12:13	59.08	OK
1539	2026-09-21 12:14	57.12	OK	1540	2026-09-21 12:15	58.25	OK
1541	2026-09-21 12:16	57.27	OK	1542	2026-09-21 12:17	57.90	OK
1543	2026-09-21 12:18	58.28	OK	1544	2026-09-21 12:19	58.87	OK
1545	2026-09-21 12:20	58.11	OK	1546	2026-09-21 12:21	57.67	OK
1547	2026-09-21 12:22	58.15	OK	1548	2026-09-21 12:23	57.38	OK
1549	2026-09-21 12:24	58.59	OK	1550	2026-09-21 12:25	58.01	OK
1551	2026-09-21 12:26	56.42	OK	1552	2026-09-21 12:27	60.20	OK
1553	2026-09-21 12:28	59.24	OK	1554	2026-09-21 12:29	58.65	OK
1555	2026-09-21 12:30	58.76	OK	1556	2026-09-21 12:31	57.25	OK
1557	2026-09-21 12:32	57.15	OK	1558	2026-09-21 12:33	57.70	OK
1559	2026-09-21 12:34	58.89	OK	1560	2026-09-21 12:35	59.49	OK
1561	2026-09-21 12:36	56.93	OK	1562	2026-09-21 12:37	57.22	OK
1563	2026-09-21 12:38	58.98	OK	1564	2026-09-21 12:39	59.29	OK
1565	2026-09-21 12:40	56.54	OK	1566	2026-09-21 12:41	57.88	OK
1567	2026-09-21 12:42	56.32	OK	1568	2026-09-21 12:43	56.47	OK
1569	2026-09-21 12:44	58.15	OK	1570	2026-09-21 12:45	59.76	OK
1571	2026-09-21 12:46	58.42	OK	1572	2026-09-21 12:47	57.87	OK
1573	2026-09-21 12:48	55.44	OK	1574	2026-09-21 12:49	55.77	OK
1575	2026-09-21 12:50	57.33	OK	1576	2026-09-21 12:51	57.28	OK
1577	2026-09-21 12:52	57.46	OK	1578	2026-09-21 12:53	57.37	OK
1579	2026-09-21 12:54	56.96	OK	1580	2026-09-21 12:55	58.83	OK
1581	2026-09-21 12:56	58.66	OK	1582	2026-09-21 12:57	56.75	OK
1583	2026-09-21 12:58	57.56	OK	1584	2026-09-21 12:59	58.24	OK
1585	2026-09-21 13:00	57.64	OK	1586	2026-09-21 13:01	58.91	OK
1587	2026-09-21 13:02	56.79	OK	1588	2026-09-21 13:03	56.14	OK
1589	2026-09-21 13:04	57.23	OK	1590	2026-09-21 13:05	56.34	OK
1591	2026-09-21 13:06	57.35	OK	1592	2026-09-21 13:07	57.42	OK
1593	2026-09-21 13:08	58.41	OK	1594	2026-09-21 13:09	57.23	OK
1595	2026-09-21 13:10	59.36	OK	1596	2026-09-21 13:11	56.70	OK
1597	2026-09-21 13:12	55.41	OK	1598	2026-09-21 13:13	57.74	OK
1599	2026-09-21 13:14	59.44	OK	1600	2026-09-21 13:15	58.80	OK
1601	2026-09-21 13:16	58.60	OK	1602	2026-09-21 13:17	57.83	OK
1603	2026-09-21 13:18	57.48	OK	1604	2026-09-21 13:19	59.16	OK
1605	2026-09-21 13:20	59.08	OK	1606	2026-09-21 13:21	58.33	OK
1607	2026-09-21 13:22	57.82	OK	1608	2026-09-21 13:23	60.27	OK
1609	2026-09-21 13:24	58.44	OK	1610	2026-09-21 13:25	59.00	OK
1611	2026-09-21 13:26	56.36	OK	1612	2026-09-21 13:27	57.41	OK
1613	2026-09-21 13:28	58.73	OK	1614	2026-09-21 13:29	58.27	OK
1615	2026-09-21 13:30	57.63	OK	1616	2026-09-21 13:31	57.04	OK
1617	2026-09-21 13:32	57.26	OK	1618	2026-09-21 13:33	58.43	OK
1619	2026-09-21 13:34	57.68	OK	1620	2026-09-21 13:35	57.78	OK
1621	2026-09-21 13:36	58.07	OK	1622	2026-09-21 13:37	59.10	OK
1623	2026-09-21 13:38	59.35	OK	1624	2026-09-21 13:39	58.07	OK
1625	2026-09-21 13:40	56.57	OK	1626	2026-09-21 13:41	59.16	OK
1627	2026-09-21 13:42	59.43	OK	1628	2026-09-21 13:43	60.28	OK
1629	2026-09-21 13:44	59.01	OK	1630	2026-09-21 13:45	59.05	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1631	2026-09-21 13:46	57.35	OK	1632	2026-09-21 13:47	59.72	OK
1633	2026-09-21 13:48	59.57	OK	1634	2026-09-21 13:49	59.01	OK
1635	2026-09-21 13:50	59.61	OK	1636	2026-09-21 13:51	58.04	OK
1637	2026-09-21 13:52	59.63	OK	1638	2026-09-21 13:53	56.30	OK
1639	2026-09-21 13:54	58.67	OK	1640	2026-09-21 13:55	58.89	OK
1641	2026-09-21 13:56	58.09	OK	1642	2026-09-21 13:57	57.88	OK
1643	2026-09-21 13:58	58.71	OK	1644	2026-09-21 13:59	58.27	OK
1645	2026-09-21 14:00	58.93	OK	1646	2026-09-21 14:01	55.78	OK
1647	2026-09-21 14:02	58.40	OK	1648	2026-09-21 14:03	58.08	OK
1649	2026-09-21 14:04	58.48	OK	1650	2026-09-21 14:05	56.74	OK
1651	2026-09-21 14:06	58.73	OK	1652	2026-09-21 14:07	56.89	OK
1653	2026-09-21 14:08	59.27	OK	1654	2026-09-21 14:09	57.89	OK
1655	2026-09-21 14:10	58.07	OK	1656	2026-09-21 14:11	58.78	OK
1657	2026-09-21 14:12	59.28	OK	1658	2026-09-21 14:13	58.64	OK
1659	2026-09-21 14:14	58.80	OK	1660	2026-09-21 14:15	57.24	OK
1661	2026-09-21 14:16	58.34	OK	1662	2026-09-21 14:17	58.16	OK
1663	2026-09-21 14:18	58.02	OK	1664	2026-09-21 14:19	57.69	OK
1665	2026-09-21 14:20	59.29	OK	1666	2026-09-21 14:21	60.41	OK
1667	2026-09-21 14:22	59.36	OK	1668	2026-09-21 14:23	56.99	OK
1669	2026-09-21 14:24	57.98	OK	1670	2026-09-21 14:25	58.30	OK
1671	2026-09-21 14:26	60.51	OK	1672	2026-09-21 14:27	59.81	OK
1673	2026-09-21 14:28	57.83	OK	1674	2026-09-21 14:29	59.15	OK
1675	2026-09-21 14:30	57.86	OK	1676	2026-09-21 14:31	57.64	OK
1677	2026-09-21 14:32	57.08	OK	1678	2026-09-21 14:33	58.36	OK
1679	2026-09-21 14:34	59.78	OK	1680	2026-09-21 14:35	58.37	OK
1681	2026-09-21 14:36	60.29	OK	1682	2026-09-21 14:37	58.29	OK
1683	2026-09-21 14:38	58.99	OK	1684	2026-09-21 14:39	58.98	OK
1685	2026-09-21 14:40	59.33	OK	1686	2026-09-21 14:41	59.16	OK
1687	2026-09-21 14:42	57.38	OK	1688	2026-09-21 14:43	58.43	OK
1689	2026-09-21 14:44	58.98	OK	1690	2026-09-21 14:45	59.75	OK
1691	2026-09-21 14:46	59.68	OK	1692	2026-09-21 14:47	60.60	OK
1693	2026-09-21 14:48	59.56	OK	1694	2026-09-21 14:49	58.38	OK
1695	2026-09-21 14:50	59.09	OK	1696	2026-09-21 14:51	59.24	OK
1697	2026-09-21 14:52	56.36	OK	1698	2026-09-21 14:53	60.07	OK
1699	2026-09-21 14:54	59.83	OK	1700	2026-09-21 14:55	58.08	OK
1701	2026-09-21 14:56	57.60	OK	1702	2026-09-21 14:57	58.82	OK
1703	2026-09-21 14:58	58.76	OK	1704	2026-09-21 14:59	58.06	OK
1705	2026-09-21 15:00	57.21	OK	1706	2026-09-21 15:01	59.69	OK
1707	2026-09-21 15:02	59.19	OK	1708	2026-09-21 15:03	59.66	OK
1709	2026-09-21 15:04	59.70	OK	1710	2026-09-21 15:05	57.84	OK
1711	2026-09-21 15:06	59.67	OK	1712	2026-09-21 15:07	57.34	OK
1713	2026-09-21 15:08	57.91	OK	1714	2026-09-21 15:09	58.24	OK
1715	2026-09-21 15:10	59.09	OK	1716	2026-09-21 15:11	59.57	OK
1717	2026-09-21 15:12	57.78	OK	1718	2026-09-21 15:13	58.38	OK
1719	2026-09-21 15:14	57.00	OK	1720	2026-09-21 15:15	57.53	OK
1721	2026-09-21 15:16	57.05	OK	1722	2026-09-21 15:17	56.63	OK
1723	2026-09-21 15:18	59.72	OK	1724	2026-09-21 15:19	59.51	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1725	2026-09-21 15:20	57.63	OK	1726	2026-09-21 15:21	60.71	OK
1727	2026-09-21 15:22	60.27	OK	1728	2026-09-21 15:23	59.19	OK
1729	2026-09-21 15:24	58.45	OK	1730	2026-09-21 15:25	58.30	OK
1731	2026-09-21 15:26	59.11	OK	1732	2026-09-21 15:27	58.89	OK
1733	2026-09-21 15:28	58.48	OK	1734	2026-09-21 15:29	58.95	OK
1735	2026-09-21 15:30	59.85	OK	1736	2026-09-21 15:31	58.64	OK
1737	2026-09-21 15:32	58.94	OK	1738	2026-09-21 15:33	59.40	OK
1739	2026-09-21 15:34	59.14	OK	1740	2026-09-21 15:35	59.52	OK
1741	2026-09-21 15:36	57.90	OK	1742	2026-09-21 15:37	58.00	OK
1743	2026-09-21 15:38	57.70	OK	1744	2026-09-21 15:39	59.11	OK
1745	2026-09-21 15:40	57.47	OK	1746	2026-09-21 15:41	59.09	OK
1747	2026-09-21 15:42	58.52	OK	1748	2026-09-21 15:43	60.06	OK
1749	2026-09-21 15:44	60.08	OK	1750	2026-09-21 15:45	58.75	OK
1751	2026-09-21 15:46	59.32	OK	1752	2026-09-21 15:47	59.16	OK
1753	2026-09-21 15:48	58.52	OK	1754	2026-09-21 15:49	59.73	OK
1755	2026-09-21 15:50	58.02	OK	1756	2026-09-21 15:51	59.10	OK
1757	2026-09-21 15:52	58.03	OK	1758	2026-09-21 15:53	57.28	OK
1759	2026-09-21 15:54	58.76	OK	1760	2026-09-21 15:55	58.42	OK
1761	2026-09-21 15:56	60.54	OK	1762	2026-09-21 15:57	59.03	OK
1763	2026-09-21 15:58	59.05	OK	1764	2026-09-21 15:59	58.20	OK
1765	2026-09-21 16:00	58.95	OK	1766	2026-09-21 16:01	58.32	OK
1767	2026-09-21 16:02	57.87	OK	1768	2026-09-21 16:03	59.45	OK
1769	2026-09-21 16:04	58.85	OK	1770	2026-09-21 16:05	59.54	OK
1771	2026-09-21 16:06	59.06	OK	1772	2026-09-21 16:07	58.27	OK
1773	2026-09-21 16:08	58.93	OK	1774	2026-09-21 16:09	58.00	OK
1775	2026-09-21 16:10	58.48	OK	1776	2026-09-21 16:11	57.88	OK
1777	2026-09-21 16:12	58.63	OK	1778	2026-09-21 16:13	58.39	OK
1779	2026-09-21 16:14	57.98	OK	1780	2026-09-21 16:15	59.34	OK
1781	2026-09-21 16:16	60.63	OK	1782	2026-09-21 16:17	58.78	OK
1783	2026-09-21 16:18	59.22	OK	1784	2026-09-21 16:19	56.87	OK
1785	2026-09-21 16:20	59.27	OK	1786	2026-09-21 16:21	58.02	OK
1787	2026-09-21 16:22	58.53	OK	1788	2026-09-21 16:23	58.88	OK
1789	2026-09-21 16:24	57.37	OK	1790	2026-09-21 16:25	59.34	OK
1791	2026-09-21 16:26	58.45	OK	1792	2026-09-21 16:27	58.40	OK
1793	2026-09-21 16:28	59.19	OK	1794	2026-09-21 16:29	57.69	OK
1795	2026-09-21 16:30	57.96	OK	1796	2026-09-21 16:31	59.05	OK
1797	2026-09-21 16:32	59.03	OK	1798	2026-09-21 16:33	58.00	OK
1799	2026-09-21 16:34	58.06	OK	1800	2026-09-21 16:35	58.44	OK
1801	2026-09-21 16:36	58.21	OK	1802	2026-09-21 16:37	58.40	OK
1803	2026-09-21 16:38	60.05	OK	1804	2026-09-21 16:39	59.07	OK
1805	2026-09-21 16:40	59.65	OK	1806	2026-09-21 16:41	58.92	OK
1807	2026-09-21 16:42	58.66	OK	1808	2026-09-21 16:43	58.87	OK
1809	2026-09-21 16:44	59.11	OK	1810	2026-09-21 16:45	57.65	OK
1811	2026-09-21 16:46	58.96	OK	1812	2026-09-21 16:47	58.47	OK
1813	2026-09-21 16:48	59.63	OK	1814	2026-09-21 16:49	58.20	OK
1815	2026-09-21 16:50	58.20	OK	1816	2026-09-21 16:51	60.03	OK
1817	2026-09-21 16:52	56.71	OK	1818	2026-09-21 16:53	56.99	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1819	2026-09-21 16:54	58.62	OK	1820	2026-09-21 16:55	59.41	OK
1821	2026-09-21 16:56	58.06	OK	1822	2026-09-21 16:57	59.72	OK
1823	2026-09-21 16:58	59.62	OK	1824	2026-09-21 16:59	57.06	OK
1825	2026-09-21 17:00	58.97	OK	1826	2026-09-21 17:01	59.67	OK
1827	2026-09-21 17:02	59.20	OK	1828	2026-09-21 17:03	58.67	OK
1829	2026-09-21 17:04	59.30	OK	1830	2026-09-21 17:05	60.01	OK
1831	2026-09-21 17:06	58.99	OK	1832	2026-09-21 17:07	59.02	OK
1833	2026-09-21 17:08	58.92	OK	1834	2026-09-21 17:09	59.17	OK
1835	2026-09-21 17:10	58.35	OK	1836	2026-09-21 17:11	59.07	OK
1837	2026-09-21 17:12	57.76	OK	1838	2026-09-21 17:13	56.47	OK
1839	2026-09-21 17:14	57.71	OK	1840	2026-09-21 17:15	57.13	OK
1841	2026-09-21 17:16	56.92	OK	1842	2026-09-21 17:17	55.95	OK
1843	2026-09-21 17:18	58.88	OK	1844	2026-09-21 17:19	58.92	OK
1845	2026-09-21 17:20	58.38	OK	1846	2026-09-21 17:21	58.01	OK
1847	2026-09-21 17:22	58.46	OK	1848	2026-09-21 17:23	58.23	OK
1849	2026-09-21 17:24	56.90	OK	1850	2026-09-21 17:25	58.94	OK
1851	2026-09-21 17:26	56.86	OK	1852	2026-09-21 17:27	57.92	OK
1853	2026-09-21 17:28	58.07	OK	1854	2026-09-21 17:29	57.48	OK
1855	2026-09-21 17:30	57.31	OK	1856	2026-09-21 17:31	59.41	OK
1857	2026-09-21 17:32	56.05	OK	1858	2026-09-21 17:33	56.91	OK
1859	2026-09-21 17:34	57.78	OK	1860	2026-09-21 17:35	57.64	OK
1861	2026-09-21 17:36	58.74	OK	1862	2026-09-21 17:37	56.08	OK
1863	2026-09-21 17:38	58.79	OK	1864	2026-09-21 17:39	57.52	OK
1865	2026-09-21 17:40	58.23	OK	1866	2026-09-21 17:41	57.99	OK
1867	2026-09-21 17:42	58.44	OK	1868	2026-09-21 17:43	57.40	OK
1869	2026-09-21 17:44	58.41	OK	1870	2026-09-21 17:45	56.12	OK
1871	2026-09-21 17:46	57.15	OK	1872	2026-09-21 17:47	58.80	OK
1873	2026-09-21 17:48	59.37	OK	1874	2026-09-21 17:49	56.89	OK
1875	2026-09-21 17:50	56.69	OK	1876	2026-09-21 17:51	57.81	OK
1877	2026-09-21 17:52	57.60	OK	1878	2026-09-21 17:53	60.08	OK
1879	2026-09-21 17:54	55.81	OK	1880	2026-09-21 17:55	57.01	OK
1881	2026-09-21 17:56	56.77	OK	1882	2026-09-21 17:57	56.75	OK
1883	2026-09-21 17:58	57.83	OK	1884	2026-09-21 17:59	58.29	OK
1885	2026-09-21 18:00	58.87	OK	1886	2026-09-21 18:01	56.31	OK
1887	2026-09-21 18:02	55.40	OK	1888	2026-09-21 18:03	56.89	OK
1889	2026-09-21 18:04	58.12	OK	1890	2026-09-21 18:05	55.96	OK
1891	2026-09-21 18:06	58.96	OK	1892	2026-09-21 18:07	58.26	OK
1893	2026-09-21 18:08	56.86	OK	1894	2026-09-21 18:09	56.86	OK
1895	2026-09-21 18:10	59.34	OK	1896	2026-09-21 18:11	56.61	OK
1897	2026-09-21 18:12	57.29	OK	1898	2026-09-21 18:13	58.77	OK
1899	2026-09-21 18:14	59.33	OK	1900	2026-09-21 18:15	56.59	OK
1901	2026-09-21 18:16	56.98	OK	1902	2026-09-21 18:17	57.22	OK
1903	2026-09-21 18:18	57.99	OK	1904	2026-09-21 18:19	57.20	OK
1905	2026-09-21 18:20	57.04	OK	1906	2026-09-21 18:21	57.04	OK
1907	2026-09-21 18:22	56.40	OK	1908	2026-09-21 18:23	56.32	OK
1909	2026-09-21 18:24	58.14	OK	1910	2026-09-21 18:25	58.34	OK
1911	2026-09-21 18:26	57.88	OK	1912	2026-09-21 18:27	56.19	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1913	2026-09-21 18:28	57.29	OK	1914	2026-09-21 18:29	56.72	OK
1915	2026-09-21 18:30	59.63	OK	1916	2026-09-21 18:31	59.34	OK
1917	2026-09-21 18:32	57.72	OK	1918	2026-09-21 18:33	56.05	OK
1919	2026-09-21 18:34	57.64	OK	1920	2026-09-21 18:35	57.07	OK
1921	2026-09-21 18:36	56.79	OK	1922	2026-09-21 18:37	58.41	OK
1923	2026-09-21 18:38	57.58	OK	1924	2026-09-21 18:39	55.83	OK
1925	2026-09-21 18:40	57.93	OK	1926	2026-09-21 18:41	59.31	OK
1927	2026-09-21 18:42	56.64	OK	1928	2026-09-21 18:43	58.67	OK
1929	2026-09-21 18:44	56.41	OK	1930	2026-09-21 18:45	58.58	OK
1931	2026-09-21 18:46	59.21	OK	1932	2026-09-21 18:47	58.59	OK
1933	2026-09-21 18:48	56.75	OK	1934	2026-09-21 18:49	56.26	OK
1935	2026-09-21 18:50	57.12	OK	1936	2026-09-21 18:51	57.43	OK
1937	2026-09-21 18:52	58.05	OK	1938	2026-09-21 18:53	55.69	OK
1939	2026-09-21 18:54	55.85	OK	1940	2026-09-21 18:55	57.08	OK
1941	2026-09-21 18:56	55.29	OK	1942	2026-09-21 18:57	55.42	OK
1943	2026-09-21 18:58	57.84	OK	1944	2026-09-21 18:59	57.29	OK
1945	2026-09-21 19:00	55.50	OK	1946	2026-09-21 19:01	56.43	OK
1947	2026-09-21 19:02	56.22	OK	1948	2026-09-21 19:03	56.30	OK
1949	2026-09-21 19:04	57.83	OK	1950	2026-09-21 19:05	55.32	OK
1951	2026-09-21 19:06	54.43	OK	1952	2026-09-21 19:07	57.36	OK
1953	2026-09-21 19:08	56.89	OK	1954	2026-09-21 19:09	55.52	OK
1955	2026-09-21 19:10	56.81	OK	1956	2026-09-21 19:11	55.17	OK
1957	2026-09-21 19:12	55.44	OK	1958	2026-09-21 19:13	55.05	OK
1959	2026-09-21 19:14	56.75	OK	1960	2026-09-21 19:15	56.93	OK
1961	2026-09-21 19:16	57.77	OK	1962	2026-09-21 19:17	57.83	OK
1963	2026-09-21 19:18	56.12	OK	1964	2026-09-21 19:19	57.38	OK
1965	2026-09-21 19:20	58.11	OK	1966	2026-09-21 19:21	57.03	OK
1967	2026-09-21 19:22	57.04	OK	1968	2026-09-21 19:23	58.58	OK
1969	2026-09-21 19:24	57.11	OK	1970	2026-09-21 19:25	57.32	OK
1971	2026-09-21 19:26	57.47	OK	1972	2026-09-21 19:27	56.85	OK
1973	2026-09-21 19:28	55.88	OK	1974	2026-09-21 19:29	56.60	OK
1975	2026-09-21 19:30	55.16	OK	1976	2026-09-21 19:31	56.49	OK
1977	2026-09-21 19:32	56.58	OK	1978	2026-09-21 19:33	55.64	OK
1979	2026-09-21 19:34	56.41	OK	1980	2026-09-21 19:35	55.20	OK
1981	2026-09-21 19:36	55.30	OK	1982	2026-09-21 19:37	58.38	OK
1983	2026-09-21 19:38	54.80	OK	1984	2026-09-21 19:39	56.50	OK
1985	2026-09-21 19:40	56.54	OK	1986	2026-09-21 19:41	55.85	OK
1987	2026-09-21 19:42	57.55	OK	1988	2026-09-21 19:43	57.28	OK
1989	2026-09-21 19:44	56.62	OK	1990	2026-09-21 19:45	57.41	OK
1991	2026-09-21 19:46	55.61	OK	1992	2026-09-21 19:47	55.80	OK
1993	2026-09-21 19:48	54.77	OK	1994	2026-09-21 19:49	56.45	OK
1995	2026-09-21 19:50	55.60	OK	1996	2026-09-21 19:51	56.15	OK
1997	2026-09-21 19:52	56.18	OK	1998	2026-09-21 19:53	56.78	OK
1999	2026-09-21 19:54	57.47	OK	2000	2026-09-21 19:55	56.39	OK
2001	2026-09-21 19:56	55.14	OK	2002	2026-09-21 19:57	55.78	OK
2003	2026-09-21 19:58	56.86	OK	2004	2026-09-21 19:59	56.72	OK
2005	2026-09-21 20:00	55.80	OK	2006	2026-09-21 20:01	55.63	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2007	2026-09-21 20:02	56.25	OK	2008	2026-09-21 20:03	56.17	OK
2009	2026-09-21 20:04	54.65	OK	2010	2026-09-21 20:05	55.68	OK
2011	2026-09-21 20:06	55.02	OK	2012	2026-09-21 20:07	55.08	OK
2013	2026-09-21 20:08	56.63	OK	2014	2026-09-21 20:09	55.27	OK
2015	2026-09-21 20:10	55.78	OK	2016	2026-09-21 20:11	54.48	OK
2017	2026-09-21 20:12	56.35	OK	2018	2026-09-21 20:13	56.42	OK
2019	2026-09-21 20:14	53.06	OK	2020	2026-09-21 20:15	56.00	OK
2021	2026-09-21 20:16	57.08	OK	2022	2026-09-21 20:17	55.09	OK
2023	2026-09-21 20:18	55.01	OK	2024	2026-09-21 20:19	55.58	OK
2025	2026-09-21 20:20	56.16	OK	2026	2026-09-21 20:21	56.33	OK
2027	2026-09-21 20:22	56.43	OK	2028	2026-09-21 20:23	54.68	OK
2029	2026-09-21 20:24	57.25	OK	2030	2026-09-21 20:25	54.93	OK
2031	2026-09-21 20:26	54.16	OK	2032	2026-09-21 20:27	56.02	OK
2033	2026-09-21 20:28	54.91	OK	2034	2026-09-21 20:29	53.81	OK
2035	2026-09-21 20:30	54.08	OK	2036	2026-09-21 20:31	55.52	OK
2037	2026-09-21 20:32	54.73	OK	2038	2026-09-21 20:33	53.28	OK
2039	2026-09-21 20:34	53.98	OK	2040	2026-09-21 20:35	55.95	OK
2041	2026-09-21 20:36	53.49	OK	2042	2026-09-21 20:37	56.17	OK
2043	2026-09-21 20:38	55.78	OK	2044	2026-09-21 20:39	53.67	OK
2045	2026-09-21 20:40	54.86	OK	2046	2026-09-21 20:41	56.97	OK
2047	2026-09-21 20:42	55.12	OK	2048	2026-09-21 20:43	55.44	OK
2049	2026-09-21 20:44	54.87	OK	2050	2026-09-21 20:45	55.50	OK
2051	2026-09-21 20:46	54.39	OK	2052	2026-09-21 20:47	53.98	OK
2053	2026-09-21 20:48	55.48	OK	2054	2026-09-21 20:49	56.83	OK
2055	2026-09-21 20:50	55.35	OK	2056	2026-09-21 20:51	55.34	OK
2057	2026-09-21 20:52	56.24	OK	2058	2026-09-21 20:53	54.61	OK
2059	2026-09-21 20:54	52.67	OK	2060	2026-09-21 20:55	53.93	OK
2061	2026-09-21 20:56	54.18	OK	2062	2026-09-21 20:57	55.57	OK
2063	2026-09-21 20:58	54.60	OK	2064	2026-09-21 20:59	56.38	OK
2065	2026-09-21 21:00	57.11	OK	2066	2026-09-21 21:01	52.37	OK
2067	2026-09-21 21:02	53.56	OK	2068	2026-09-21 21:03	54.06	OK
2069	2026-09-21 21:04	53.79	OK	2070	2026-09-21 21:05	53.73	OK
2071	2026-09-21 21:06	55.38	OK	2072	2026-09-21 21:07	55.28	OK
2073	2026-09-21 21:08	55.98	OK	2074	2026-09-21 21:09	53.58	OK
2075	2026-09-21 21:10	53.76	OK	2076	2026-09-21 21:11	55.22	OK
2077	2026-09-21 21:12	52.42	OK	2078	2026-09-21 21:13	55.86	OK
2079	2026-09-21 21:14	54.77	OK	2080	2026-09-21 21:15	54.07	OK
2081	2026-09-21 21:16	54.91	OK	2082	2026-09-21 21:17	54.88	OK
2083	2026-09-21 21:18	53.42	OK	2084	2026-09-21 21:19	56.02	OK
2085	2026-09-21 21:20	53.58	OK	2086	2026-09-21 21:21	52.40	OK
2087	2026-09-21 21:22	55.63	OK	2088	2026-09-21 21:23	56.83	OK
2089	2026-09-21 21:24	54.55	OK	2090	2026-09-21 21:25	53.17	OK
2091	2026-09-21 21:26	53.61	OK	2092	2026-09-21 21:27	55.01	OK
2093	2026-09-21 21:28	53.78	OK	2094	2026-09-21 21:29	53.46	OK
2095	2026-09-21 21:30	52.95	OK	2096	2026-09-21 21:31	54.78	OK
2097	2026-09-21 21:32	56.65	OK	2098	2026-09-21 21:33	53.25	OK
2099	2026-09-21 21:34	54.03	OK	2100	2026-09-21 21:35	52.83	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2101	2026-09-21 21:36	53.94	OK	2102	2026-09-21 21:37	53.64	OK
2103	2026-09-21 21:38	55.54	OK	2104	2026-09-21 21:39	53.83	OK
2105	2026-09-21 21:40	53.93	OK	2106	2026-09-21 21:41	53.57	OK
2107	2026-09-21 21:42	56.79	OK	2108	2026-09-21 21:43	53.09	OK
2109	2026-09-21 21:44	55.24	OK	2110	2026-09-21 21:45	53.25	OK
2111	2026-09-21 21:46	54.38	OK	2112	2026-09-21 21:47	54.32	OK
2113	2026-09-21 21:48	53.67	OK	2114	2026-09-21 21:49	55.46	OK
2115	2026-09-21 21:50	52.48	OK	2116	2026-09-21 21:51	55.56	OK
2117	2026-09-21 21:52	53.93	OK	2118	2026-09-21 21:53	53.40	OK
2119	2026-09-21 21:54	54.22	OK	2120	2026-09-21 21:55	54.21	OK
2121	2026-09-21 21:56	52.92	OK	2122	2026-09-21 21:57	53.66	OK
2123	2026-09-21 21:58	54.43	OK	2124	2026-09-21 21:59	54.96	OK
2125	2026-09-21 22:00	55.34	OK	2126	2026-09-21 22:01	55.26	OK
2127	2026-09-21 22:02	52.23	OK	2128	2026-09-21 22:03	53.66	OK
2129	2026-09-21 22:04	51.92	OK	2130	2026-09-21 22:05	53.76	OK
2131	2026-09-21 22:06	53.00	OK	2132	2026-09-21 22:07	54.74	OK
2133	2026-09-21 22:08	54.27	OK	2134	2026-09-21 22:09	51.79	OK
2135	2026-09-21 22:10	54.40	OK	2136	2026-09-21 22:11	54.31	OK
2137	2026-09-21 22:12	54.98	OK	2138	2026-09-21 22:13	53.96	OK
2139	2026-09-21 22:14	53.04	OK	2140	2026-09-21 22:15	51.74	OK
2141	2026-09-21 22:16	51.86	OK	2142	2026-09-21 22:17	52.83	OK
2143	2026-09-21 22:18	53.59	OK	2144	2026-09-21 22:19	52.40	OK
2145	2026-09-21 22:20	52.67	OK	2146	2026-09-21 22:21	53.16	OK
2147	2026-09-21 22:22	52.53	OK	2148	2026-09-21 22:23	53.63	OK
2149	2026-09-21 22:24	54.87	OK	2150	2026-09-21 22:25	52.69	OK
2151	2026-09-21 22:26	53.29	OK	2152	2026-09-21 22:27	53.38	OK
2153	2026-09-21 22:28	54.21	OK	2154	2026-09-21 22:29	52.82	OK
2155	2026-09-21 22:30	54.31	OK	2156	2026-09-21 22:31	53.40	OK
2157	2026-09-21 22:32	52.05	OK	2158	2026-09-21 22:33	53.67	OK
2159	2026-09-21 22:34	53.24	OK	2160	2026-09-21 22:35	51.98	OK
2161	2026-09-21 22:36	53.40	OK	2162	2026-09-21 22:37	52.91	OK
2163	2026-09-21 22:38	52.23	OK	2164	2026-09-21 22:39	52.65	OK
2165	2026-09-21 22:40	53.79	OK	2166	2026-09-21 22:41	53.35	OK
2167	2026-09-21 22:42	54.96	OK	2168	2026-09-21 22:43	52.36	OK
2169	2026-09-21 22:44	52.85	OK	2170	2026-09-21 22:45	54.35	OK
2171	2026-09-21 22:46	54.00	OK	2172	2026-09-21 22:47	51.40	OK
2173	2026-09-21 22:48	53.80	OK	2174	2026-09-21 22:49	53.78	OK
2175	2026-09-21 22:50	53.51	OK	2176	2026-09-21 22:51	51.98	OK
2177	2026-09-21 22:52	52.58	OK	2178	2026-09-21 22:53	52.32	OK
2179	2026-09-21 22:54	51.89	OK	2180	2026-09-21 22:55	51.72	OK
2181	2026-09-21 22:56	53.07	OK	2182	2026-09-21 22:57	54.39	OK
2183	2026-09-21 22:58	55.22	OK	2184	2026-09-21 22:59	54.68	OK
2185	2026-09-21 23:00	52.55	OK	2186	2026-09-21 23:01	51.34	OK
2187	2026-09-21 23:02	50.50	OK	2188	2026-09-21 23:03	53.62	OK
2189	2026-09-21 23:04	54.26	OK	2190	2026-09-21 23:05	52.40	OK
2191	2026-09-21 23:06	52.99	OK	2192	2026-09-21 23:07	53.63	OK
2193	2026-09-21 23:08	50.91	OK	2194	2026-09-21 23:09	51.39	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2195	2026-09-21 23:10	51.64	OK	2196	2026-09-21 23:11	52.53	OK
2197	2026-09-21 23:12	52.10	OK	2198	2026-09-21 23:13	52.26	OK
2199	2026-09-21 23:14	53.16	OK	2200	2026-09-21 23:15	50.52	OK
2201	2026-09-21 23:16	52.89	OK	2202	2026-09-21 23:17	50.70	OK
2203	2026-09-21 23:18	54.44	OK	2204	2026-09-21 23:19	50.99	OK
2205	2026-09-21 23:20	54.48	OK	2206	2026-09-21 23:21	51.58	OK
2207	2026-09-21 23:22	52.57	OK	2208	2026-09-21 23:23	52.63	OK
2209	2026-09-21 23:24	53.42	OK	2210	2026-09-21 23:25	52.00	OK
2211	2026-09-21 23:26	52.35	OK	2212	2026-09-21 23:27	52.72	OK
2213	2026-09-21 23:28	51.64	OK	2214	2026-09-21 23:29	51.85	OK
2215	2026-09-21 23:30	51.78	OK	2216	2026-09-21 23:31	52.55	OK
2217	2026-09-21 23:32	51.32	OK	2218	2026-09-21 23:33	51.09	OK
2219	2026-09-21 23:34	53.28	OK	2220	2026-09-21 23:35	52.47	OK
2221	2026-09-21 23:36	50.85	OK	2222	2026-09-21 23:37	52.37	OK
2223	2026-09-21 23:38	49.31	OK	2224	2026-09-21 23:39	50.83	OK
2225	2026-09-21 23:40	53.19	OK	2226	2026-09-21 23:41	53.19	OK
2227	2026-09-21 23:42	52.08	OK	2228	2026-09-21 23:43	50.86	OK
2229	2026-09-21 23:44	50.73	OK	2230	2026-09-21 23:45	51.75	OK
2231	2026-09-21 23:46	49.54	OK	2232	2026-09-21 23:47	51.74	OK
2233	2026-09-21 23:48	52.79	OK	2234	2026-09-21 23:49	51.73	OK
2235	2026-09-21 23:50	52.74	OK	2236	2026-09-21 23:51	51.92	OK
2237	2026-09-21 23:52	52.81	OK	2238	2026-09-21 23:53	52.56	OK
2239	2026-09-21 23:54	51.46	OK	2240	2026-09-21 23:55	50.83	OK
2241	2026-09-21 23:56	51.16	OK	2242	2026-09-21 23:57	49.31	OK
2243	2026-09-21 23:58	52.69	OK	2244	2026-09-21 23:59	51.69	OK
2245	2026-09-22 00:00	52.04	OK	2246	2026-09-22 00:01	51.79	OK
2247	2026-09-22 00:02	51.15	OK	2248	2026-09-22 00:03	51.09	OK
2249	2026-09-22 00:04	51.64	OK	2250	2026-09-22 00:05	52.28	OK
2251	2026-09-22 00:06	51.03	OK	2252	2026-09-22 00:07	51.74	OK
2253	2026-09-22 00:08	52.41	OK	2254	2026-09-22 00:09	50.20	OK
2255	2026-09-22 00:10	51.83	OK	2256	2026-09-22 00:11	50.92	OK
2257	2026-09-22 00:12	52.12	OK	2258	2026-09-22 00:13	51.78	OK
2259	2026-09-22 00:14	52.08	OK	2260	2026-09-22 00:15	50.76	OK
2261	2026-09-22 00:16	52.41	OK	2262	2026-09-22 00:17	49.91	OK
2263	2026-09-22 00:18	50.55	OK	2264	2026-09-22 00:19	52.43	OK
2265	2026-09-22 00:20	50.37	OK	2266	2026-09-22 00:21	51.64	OK
2267	2026-09-22 00:22	51.27	OK	2268	2026-09-22 00:23	51.71	OK
2269	2026-09-22 00:24	52.29	OK	2270	2026-09-22 00:25	51.76	OK
2271	2026-09-22 00:26	53.01	OK	2272	2026-09-22 00:27	52.20	OK
2273	2026-09-22 00:28	50.75	OK	2274	2026-09-22 00:29	49.29	OK
2275	2026-09-22 00:30	52.52	OK	2276	2026-09-22 00:31	52.95	OK
2277	2026-09-22 00:32	50.55	OK	2278	2026-09-22 00:33	50.86	OK
2279	2026-09-22 00:34	52.03	OK	2280	2026-09-22 00:35	50.26	OK
2281	2026-09-22 00:36	51.65	OK	2282	2026-09-22 00:37	49.44	OK
2283	2026-09-22 00:38	51.37	OK	2284	2026-09-22 00:39	51.12	OK
2285	2026-09-22 00:40	48.91	OK	2286	2026-09-22 00:41	51.20	OK
2287	2026-09-22 00:42	51.06	OK	2288	2026-09-22 00:43	50.96	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2289	2026-09-22 00:44	51.96	OK	2290	2026-09-22 00:45	50.79	OK
2291	2026-09-22 00:46	49.93	OK	2292	2026-09-22 00:47	50.94	OK
2293	2026-09-22 00:48	52.77	OK	2294	2026-09-22 00:49	51.11	OK
2295	2026-09-22 00:50	51.36	OK	2296	2026-09-22 00:51	50.80	OK
2297	2026-09-22 00:52	52.01	OK	2298	2026-09-22 00:53	52.67	OK
2299	2026-09-22 00:54	50.64	OK	2300	2026-09-22 00:55	51.00	OK
2301	2026-09-22 00:56	49.89	OK	2302	2026-09-22 00:57	52.55	OK
2303	2026-09-22 00:58	48.85	OK	2304	2026-09-22 00:59	50.00	OK
2305	2026-09-22 01:00	49.42	OK	2306	2026-09-22 01:01	51.33	OK
2307	2026-09-22 01:02	51.26	OK	2308	2026-09-22 01:03	51.23	OK
2309	2026-09-22 01:04	50.31	OK	2310	2026-09-22 01:05	53.25	OK
2311	2026-09-22 01:06	52.76	OK	2312	2026-09-22 01:07	50.10	OK
2313	2026-09-22 01:08	50.63	OK	2314	2026-09-22 01:09	50.58	OK
2315	2026-09-22 01:10	50.54	OK	2316	2026-09-22 01:11	50.58	OK
2317	2026-09-22 01:12	50.25	OK	2318	2026-09-22 01:13	52.72	OK
2319	2026-09-22 01:14	49.62	OK	2320	2026-09-22 01:15	50.54	OK
2321	2026-09-22 01:16	52.00	OK	2322	2026-09-22 01:17	50.69	OK
2323	2026-09-22 01:18	50.60	OK	2324	2026-09-22 01:19	51.31	OK
2325	2026-09-22 01:20	52.17	OK	2326	2026-09-22 01:21	53.05	OK
2327	2026-09-22 01:22	50.73	OK	2328	2026-09-22 01:23	51.29	OK
2329	2026-09-22 01:24	51.56	OK	2330	2026-09-22 01:25	52.71	OK
2331	2026-09-22 01:26	50.71	OK	2332	2026-09-22 01:27	49.62	OK
2333	2026-09-22 01:28	50.09	OK	2334	2026-09-22 01:29	49.47	OK
2335	2026-09-22 01:30	52.04	OK	2336	2026-09-22 01:31	49.97	OK
2337	2026-09-22 01:32	49.89	OK	2338	2026-09-22 01:33	49.22	OK
2339	2026-09-22 01:34	51.74	OK	2340	2026-09-22 01:35	50.51	OK
2341	2026-09-22 01:36	49.26	OK	2342	2026-09-22 01:37	51.27	OK
2343	2026-09-22 01:38	50.69	OK	2344	2026-09-22 01:39	49.66	OK
2345	2026-09-22 01:40	47.96	OK	2346	2026-09-22 01:41	51.51	OK
2347	2026-09-22 01:42	50.42	OK	2348	2026-09-22 01:43	49.79	OK
2349	2026-09-22 01:44	51.72	OK	2350	2026-09-22 01:45	48.78	OK
2351	2026-09-22 01:46	51.06	OK	2352	2026-09-22 01:47	49.93	OK
2353	2026-09-22 01:48	51.60	OK	2354	2026-09-22 01:49	49.11	OK
2355	2026-09-22 01:50	48.92	OK	2356	2026-09-22 01:51	50.13	OK
2357	2026-09-22 01:52	49.92	OK	2358	2026-09-22 01:53	50.81	OK
2359	2026-09-22 01:54	48.81	OK	2360	2026-09-22 01:55	50.79	OK
2361	2026-09-22 01:56	50.54	OK	2362	2026-09-22 01:57	51.12	OK
2363	2026-09-22 01:58	50.26	OK	2364	2026-09-22 01:59	49.45	OK
2365	2026-09-22 02:00	49.02	OK	2366	2026-09-22 02:01	50.32	OK
2367	2026-09-22 02:02	49.95	OK	2368	2026-09-22 02:03	50.62	OK
2369	2026-09-22 02:04	50.37	OK	2370	2026-09-22 02:05	51.67	OK
2371	2026-09-22 02:06	51.73	OK	2372	2026-09-22 02:07	48.10	OK
2373	2026-09-22 02:08	51.04	OK	2374	2026-09-22 02:09	50.66	OK
2375	2026-09-22 02:10	49.23	OK	2376	2026-09-22 02:11	51.09	OK
2377	2026-09-22 02:12	50.09	OK	2378	2026-09-22 02:13	51.80	OK
2379	2026-09-22 02:14	51.01	OK	2380	2026-09-22 02:15	51.93	OK
2381	2026-09-22 02:16	49.75	OK	2382	2026-09-22 02:17	50.62	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2383	2026-09-22 02:18	48.94	OK	2384	2026-09-22 02:19	51.88	OK
2385	2026-09-22 02:20	49.00	OK	2386	2026-09-22 02:21	49.76	OK
2387	2026-09-22 02:22	50.65	OK	2388	2026-09-22 02:23	48.51	OK
2389	2026-09-22 02:24	48.67	OK	2390	2026-09-22 02:25	49.92	OK
2391	2026-09-22 02:26	52.76	OK	2392	2026-09-22 02:27	49.20	OK
2393	2026-09-22 02:28	50.22	OK	2394	2026-09-22 02:29	49.27	OK
2395	2026-09-22 02:30	49.95	OK	2396	2026-09-22 02:31	51.83	OK
2397	2026-09-22 02:32	50.94	OK	2398	2026-09-22 02:33	49.98	OK
2399	2026-09-22 02:34	48.84	OK	2400	2026-09-22 02:35	50.23	OK
2401	2026-09-22 02:36	50.81	OK	2402	2026-09-22 02:37	49.80	OK
2403	2026-09-22 02:38	50.95	OK	2404	2026-09-22 02:39	51.70	OK
2405	2026-09-22 02:40	50.96	OK	2406	2026-09-22 02:41	50.48	OK
2407	2026-09-22 02:42	51.65	OK	2408	2026-09-22 02:43	50.99	OK
2409	2026-09-22 02:44	49.25	OK	2410	2026-09-22 02:45	48.82	OK
2411	2026-09-22 02:46	50.00	OK	2412	2026-09-22 02:47	49.56	OK
2413	2026-09-22 02:48	50.26	OK	2414	2026-09-22 02:49	50.02	OK
2415	2026-09-22 02:50	48.51	OK	2416	2026-09-22 02:51	51.19	OK
2417	2026-09-22 02:52	51.29	OK	2418	2026-09-22 02:53	50.72	OK
2419	2026-09-22 02:54	51.27	OK	2420	2026-09-22 02:55	51.72	OK
2421	2026-09-22 02:56	50.24	OK	2422	2026-09-22 02:57	51.16	OK
2423	2026-09-22 02:58	50.79	OK	2424	2026-09-22 02:59	50.90	OK
2425	2026-09-22 03:00	50.16	OK	2426	2026-09-22 03:01	52.42	OK
2427	2026-09-22 03:02	52.08	OK	2428	2026-09-22 03:03	47.56	OK
2429	2026-09-22 03:04	49.34	OK	2430	2026-09-22 03:05	48.54	OK
2431	2026-09-22 03:06	50.33	OK	2432	2026-09-22 03:07	49.64	OK
2433	2026-09-22 03:08	50.42	OK	2434	2026-09-22 03:09	50.38	OK
2435	2026-09-22 03:10	50.79	OK	2436	2026-09-22 03:11	50.88	OK
2437	2026-09-22 03:12	49.67	OK	2438	2026-09-22 03:13	52.88	OK
2439	2026-09-22 03:14	50.31	OK	2440	2026-09-22 03:15	48.53	OK
2441	2026-09-22 03:16	50.52	OK	2442	2026-09-22 03:17	49.78	OK
2443	2026-09-22 03:18	49.21	OK	2444	2026-09-22 03:19	50.63	OK
2445	2026-09-22 03:20	50.92	OK	2446	2026-09-22 03:21	50.86	OK
2447	2026-09-22 03:22	51.75	OK	2448	2026-09-22 03:23	50.15	OK
2449	2026-09-22 03:24	50.31	OK	2450	2026-09-22 03:25	50.24	OK
2451	2026-09-22 03:26	48.18	OK	2452	2026-09-22 03:27	49.86	OK
2453	2026-09-22 03:28	52.41	OK	2454	2026-09-22 03:29	50.97	OK
2455	2026-09-22 03:30	51.68	OK	2456	2026-09-22 03:31	52.65	OK
2457	2026-09-22 03:32	49.40	OK	2458	2026-09-22 03:33	50.27	OK
2459	2026-09-22 03:34	49.55	OK	2460	2026-09-22 03:35	50.80	OK
2461	2026-09-22 03:36	50.22	OK	2462	2026-09-22 03:37	47.91	OK
2463	2026-09-22 03:38	49.49	OK	2464	2026-09-22 03:39	49.53	OK
2465	2026-09-22 03:40	49.12	OK	2466	2026-09-22 03:41	49.13	OK
2467	2026-09-22 03:42	47.86	OK	2468	2026-09-22 03:43	48.31	OK
2469	2026-09-22 03:44	49.91	OK	2470	2026-09-22 03:45	50.42	OK
2471	2026-09-22 03:46	52.17	OK	2472	2026-09-22 03:47	50.13	OK
2473	2026-09-22 03:48	50.34	OK	2474	2026-09-22 03:49	51.59	OK
2475	2026-09-22 03:50	51.77	OK	2476	2026-09-22 03:51	51.06	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2477	2026-09-22 03:52	50.97	OK	2478	2026-09-22 03:53	48.34	OK
2479	2026-09-22 03:54	50.01	OK	2480	2026-09-22 03:55	50.92	OK
2481	2026-09-22 03:56	50.04	OK	2482	2026-09-22 03:57	51.57	OK
2483	2026-09-22 03:58	49.63	OK	2484	2026-09-22 03:59	49.00	OK
2485	2026-09-22 04:00	51.11	OK	2486	2026-09-22 04:01	50.98	OK
2487	2026-09-22 04:02	51.00	OK	2488	2026-09-22 04:03	49.22	OK
2489	2026-09-22 04:04	48.88	OK	2490	2026-09-22 04:05	49.77	OK
2491	2026-09-22 04:06	51.63	OK	2492	2026-09-22 04:07	49.89	OK
2493	2026-09-22 04:08	50.67	OK	2494	2026-09-22 04:09	50.68	OK
2495	2026-09-22 04:10	50.51	OK	2496	2026-09-22 04:11	51.00	OK
2497	2026-09-22 04:12	50.55	OK	2498	2026-09-22 04:13	48.97	OK
2499	2026-09-22 04:14	49.67	OK	2500	2026-09-22 04:15	50.87	OK
2501	2026-09-22 04:16	49.88	OK	2502	2026-09-22 04:17	50.33	OK
2503	2026-09-22 04:18	50.36	OK	2504	2026-09-22 04:19	48.83	OK
2505	2026-09-22 04:20	49.35	OK	2506	2026-09-22 04:21	51.20	OK
2507	2026-09-22 04:22	49.58	OK	2508	2026-09-22 04:23	50.63	OK
2509	2026-09-22 04:24	49.41	OK	2510	2026-09-22 04:25	49.29	OK
2511	2026-09-22 04:26	49.30	OK	2512	2026-09-22 04:27	50.20	OK
2513	2026-09-22 04:28	51.59	OK	2514	2026-09-22 04:29	48.84	OK
2515	2026-09-22 04:30	52.26	OK	2516	2026-09-22 04:31	49.62	OK
2517	2026-09-22 04:32	48.82	OK	2518	2026-09-22 04:33	50.28	OK
2519	2026-09-22 04:34	50.98	OK	2520	2026-09-22 04:35	50.11	OK
2521	2026-09-22 04:36	51.09	OK	2522	2026-09-22 04:37	50.10	OK
2523	2026-09-22 04:38	49.14	OK	2524	2026-09-22 04:39	50.24	OK
2525	2026-09-22 04:40	48.79	OK	2526	2026-09-22 04:41	50.07	OK
2527	2026-09-22 04:42	50.12	OK	2528	2026-09-22 04:43	51.07	OK
2529	2026-09-22 04:44	50.94	OK	2530	2026-09-22 04:45	50.50	OK
2531	2026-09-22 04:46	49.75	OK	2532	2026-09-22 04:47	51.42	OK
2533	2026-09-22 04:48	50.37	OK	2534	2026-09-22 04:49	51.68	OK
2535	2026-09-22 04:50	49.76	OK	2536	2026-09-22 04:51	50.84	OK
2537	2026-09-22 04:52	52.54	OK	2538	2026-09-22 04:53	50.25	OK
2539	2026-09-22 04:54	51.20	OK	2540	2026-09-22 04:55	49.44	OK
2541	2026-09-22 04:56	50.61	OK	2542	2026-09-22 04:57	49.32	OK
2543	2026-09-22 04:58	49.75	OK	2544	2026-09-22 04:59	49.34	OK
2545	2026-09-22 05:00	52.42	OK	2546	2026-09-22 05:01	50.81	OK
2547	2026-09-22 05:02	52.09	OK	2548	2026-09-22 05:03	50.83	OK
2549	2026-09-22 05:04	50.64	OK	2550	2026-09-22 05:05	51.02	OK
2551	2026-09-22 05:06	52.61	OK	2552	2026-09-22 05:07	51.54	OK
2553	2026-09-22 05:08	50.10	OK	2554	2026-09-22 05:09	50.39	OK
2555	2026-09-22 05:10	52.89	OK	2556	2026-09-22 05:11	52.31	OK
2557	2026-09-22 05:12	49.63	OK	2558	2026-09-22 05:13	51.08	OK
2559	2026-09-22 05:14	50.60	OK	2560	2026-09-22 05:15	50.82	OK
2561	2026-09-22 05:16	49.53	OK	2562	2026-09-22 05:17	49.18	OK
2563	2026-09-22 05:18	51.04	OK	2564	2026-09-22 05:19	52.20	OK
2565	2026-09-22 05:20	49.22	OK	2566	2026-09-22 05:21	50.50	OK
2567	2026-09-22 05:22	50.75	OK	2568	2026-09-22 05:23	51.89	OK
2569	2026-09-22 05:24	51.89	OK	2570	2026-09-22 05:25	50.85	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2571	2026-09-22 05:26	51.47	OK	2572	2026-09-22 05:27	50.68	OK
2573	2026-09-22 05:28	51.20	OK	2574	2026-09-22 05:29	48.29	OK
2575	2026-09-22 05:30	50.30	OK	2576	2026-09-22 05:31	50.89	OK
2577	2026-09-22 05:32	51.80	OK	2578	2026-09-22 05:33	52.24	OK
2579	2026-09-22 05:34	51.66	OK	2580	2026-09-22 05:35	51.99	OK
2581	2026-09-22 05:36	51.63	OK	2582	2026-09-22 05:37	51.09	OK
2583	2026-09-22 05:38	49.34	OK	2584	2026-09-22 05:39	51.81	OK
2585	2026-09-22 05:40	51.94	OK	2586	2026-09-22 05:41	50.27	OK
2587	2026-09-22 05:42	52.73	OK	2588	2026-09-22 05:43	49.79	OK
2589	2026-09-22 05:44	49.63	OK	2590	2026-09-22 05:45	51.40	OK
2591	2026-09-22 05:46	49.49	OK	2592	2026-09-22 05:47	49.37	OK
2593	2026-09-22 05:48	52.03	OK	2594	2026-09-22 05:49	49.03	OK
2595	2026-09-22 05:50	52.84	OK	2596	2026-09-22 05:51	50.43	OK
2597	2026-09-22 05:52	52.07	OK	2598	2026-09-22 05:53	51.26	OK
2599	2026-09-22 05:54	51.57	OK	2600	2026-09-22 05:55	49.40	OK
2601	2026-09-22 05:56	51.25	OK	2602	2026-09-22 05:57	51.51	OK
2603	2026-09-22 05:58	51.14	OK	2604	2026-09-22 05:59	51.65	OK
2605	2026-09-22 06:00	52.38	OK	2606	2026-09-22 06:01	51.35	OK
2607	2026-09-22 06:02	50.44	OK	2608	2026-09-22 06:03	51.99	OK
2609	2026-09-22 06:04	52.36	OK	2610	2026-09-22 06:05	51.92	OK
2611	2026-09-22 06:06	53.35	OK	2612	2026-09-22 06:07	49.39	OK
2613	2026-09-22 06:08	51.44	OK	2614	2026-09-22 06:09	53.41	OK
2615	2026-09-22 06:10	52.49	OK	2616	2026-09-22 06:11	49.76	OK
2617	2026-09-22 06:12	50.05	OK	2618	2026-09-22 06:13	50.07	OK
2619	2026-09-22 06:14	52.98	OK	2620	2026-09-22 06:15	50.98	OK
2621	2026-09-22 06:16	51.46	OK	2622	2026-09-22 06:17	50.26	OK
2623	2026-09-22 06:18	51.07	OK	2624	2026-09-22 06:19	51.56	OK
2625	2026-09-22 06:20	51.92	OK	2626	2026-09-22 06:21	51.18	OK
2627	2026-09-22 06:22	51.26	OK	2628	2026-09-22 06:23	50.12	OK
2629	2026-09-22 06:24	51.56	OK	2630	2026-09-22 06:25	52.40	OK
2631	2026-09-22 06:26	51.31	OK	2632	2026-09-22 06:27	51.98	OK
2633	2026-09-22 06:28	51.68	OK	2634	2026-09-22 06:29	51.56	OK
2635	2026-09-22 06:30	54.01	OK	2636	2026-09-22 06:31	50.86	OK
2637	2026-09-22 06:32	52.40	OK	2638	2026-09-22 06:33	51.85	OK
2639	2026-09-22 06:34	53.44	OK	2640	2026-09-22 06:35	50.79	OK
2641	2026-09-22 06:36	51.07	OK	2642	2026-09-22 06:37	49.44	OK
2643	2026-09-22 06:38	52.55	OK	2644	2026-09-22 06:39	52.19	OK
2645	2026-09-22 06:40	51.41	OK	2646	2026-09-22 06:41	52.02	OK
2647	2026-09-22 06:42	50.43	OK	2648	2026-09-22 06:43	51.35	OK
2649	2026-09-22 06:44	50.63	OK	2650	2026-09-22 06:45	51.98	OK
2651	2026-09-22 06:46	50.71	OK	2652	2026-09-22 06:47	52.88	OK
2653	2026-09-22 06:48	51.96	OK	2654	2026-09-22 06:49	53.34	OK
2655	2026-09-22 06:50	51.69	OK	2656	2026-09-22 06:51	51.42	OK
2657	2026-09-22 06:52	52.35	OK	2658	2026-09-22 06:53	51.46	OK
2659	2026-09-22 06:54	53.44	OK	2660	2026-09-22 06:55	51.69	OK
2661	2026-09-22 06:56	50.91	OK	2662	2026-09-22 06:57	53.59	OK
2663	2026-09-22 06:58	50.77	OK	2664	2026-09-22 06:59	51.08	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2665	2026-09-22 07:00	52.64	OK	2666	2026-09-22 07:01	53.48	OK
2667	2026-09-22 07:02	51.69	OK	2668	2026-09-22 07:03	52.77	OK
2669	2026-09-22 07:04	53.68	OK	2670	2026-09-22 07:05	53.49	OK
2671	2026-09-22 07:06	52.55	OK	2672	2026-09-22 07:07	52.96	OK
2673	2026-09-22 07:08	52.19	OK	2674	2026-09-22 07:09	52.87	OK
2675	2026-09-22 07:10	52.09	OK	2676	2026-09-22 07:11	50.61	OK
2677	2026-09-22 07:12	49.50	OK	2678	2026-09-22 07:13	50.85	OK
2679	2026-09-22 07:14	53.73	OK	2680	2026-09-22 07:15	51.80	OK
2681	2026-09-22 07:16	51.70	OK	2682	2026-09-22 07:17	52.30	OK
2683	2026-09-22 07:18	51.60	OK	2684	2026-09-22 07:19	51.67	OK
2685	2026-09-22 07:20	51.93	OK	2686	2026-09-22 07:21	52.23	OK
2687	2026-09-22 07:22	52.67	OK	2688	2026-09-22 07:23	54.03	OK
2689	2026-09-22 07:24	52.12	OK	2690	2026-09-22 07:25	52.78	OK
2691	2026-09-22 07:26	52.98	OK	2692	2026-09-22 07:27	53.39	OK
2693	2026-09-22 07:28	51.78	OK	2694	2026-09-22 07:29	51.78	OK
2695	2026-09-22 07:30	52.30	OK	2696	2026-09-22 07:31	53.21	OK
2697	2026-09-22 07:32	52.74	OK	2698	2026-09-22 07:33	51.96	OK
2699	2026-09-22 07:34	52.10	OK	2700	2026-09-22 07:35	53.01	OK
2701	2026-09-22 07:36	51.63	OK	2702	2026-09-22 07:37	53.30	OK
2703	2026-09-22 07:38	53.63	OK	2704	2026-09-22 07:39	50.05	OK
2705	2026-09-22 07:40	51.87	OK	2706	2026-09-22 07:41	54.35	OK
2707	2026-09-22 07:42	51.53	OK	2708	2026-09-22 07:43	51.34	OK
2709	2026-09-22 07:44	53.26	OK	2710	2026-09-22 07:45	51.97	OK
2711	2026-09-22 07:46	52.21	OK	2712	2026-09-22 07:47	53.78	OK
2713	2026-09-22 07:48	53.06	OK	2714	2026-09-22 07:49	52.91	OK
2715	2026-09-22 07:50	51.53	OK	2716	2026-09-22 07:51	54.19	OK
2717	2026-09-22 07:52	52.35	OK	2718	2026-09-22 07:53	54.39	OK
2719	2026-09-22 07:54	54.25	OK	2720	2026-09-22 07:55	51.88	OK
2721	2026-09-22 07:56	54.37	OK	2722	2026-09-22 07:57	51.60	OK
2723	2026-09-22 07:58	53.75	OK	2724	2026-09-22 07:59	53.05	OK
2725	2026-09-22 08:00	52.68	OK	2726	2026-09-22 08:01	52.78	OK
2727	2026-09-22 08:02	53.01	OK	2728	2026-09-22 08:03	52.73	OK
2729	2026-09-22 08:04	51.61	OK	2730	2026-09-22 08:05	52.22	OK
2731	2026-09-22 08:06	53.76	OK	2732	2026-09-22 08:07	54.00	OK
2733	2026-09-22 08:08	54.13	OK	2734	2026-09-22 08:09	54.98	OK
2735	2026-09-22 08:10	52.03	OK	2736	2026-09-22 08:11	52.67	OK
2737	2026-09-22 08:12	54.53	OK	2738	2026-09-22 08:13	53.91	OK
2739	2026-09-22 08:14	52.71	OK	2740	2026-09-22 08:15	52.85	OK
2741	2026-09-22 08:16	53.15	OK	2742	2026-09-22 08:17	53.82	OK
2743	2026-09-22 08:18	53.41	OK	2744	2026-09-22 08:19	52.81	OK
2745	2026-09-22 08:20	52.31	OK	2746	2026-09-22 08:21	51.58	OK
2747	2026-09-22 08:22	54.04	OK	2748	2026-09-22 08:23	53.47	OK
2749	2026-09-22 08:24	50.94	OK	2750	2026-09-22 08:25	53.64	OK
2751	2026-09-22 08:26	53.76	OK	2752	2026-09-22 08:27	53.67	OK
2753	2026-09-22 08:28	53.85	OK	2754	2026-09-22 08:29	52.72	OK
2755	2026-09-22 08:30	53.22	OK	2756	2026-09-22 08:31	54.82	OK
2757	2026-09-22 08:32	51.75	OK	2758	2026-09-22 08:33	54.46	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2759	2026-09-22 08:34	54.10	OK	2760	2026-09-22 08:35	52.77	OK
2761	2026-09-22 08:36	53.17	OK	2762	2026-09-22 08:37	52.55	OK
2763	2026-09-22 08:38	55.08	OK	2764	2026-09-22 08:39	52.66	OK
2765	2026-09-22 08:40	54.47	OK	2766	2026-09-22 08:41	52.43	OK
2767	2026-09-22 08:42	54.18	OK	2768	2026-09-22 08:43	54.70	OK
2769	2026-09-22 08:44	52.17	OK	2770	2026-09-22 08:45	54.78	OK
2771	2026-09-22 08:46	52.26	OK	2772	2026-09-22 08:47	54.38	OK
2773	2026-09-22 08:48	54.13	OK	2774	2026-09-22 08:49	52.69	OK
2775	2026-09-22 08:50	53.57	OK	2776	2026-09-22 08:51	53.12	OK
2777	2026-09-22 08:52	54.36	OK	2778	2026-09-22 08:53	53.11	OK
2779	2026-09-22 08:54	52.53	OK	2780	2026-09-22 08:55	55.10	OK
2781	2026-09-22 08:56	53.08	OK	2782	2026-09-22 08:57	53.28	OK
2783	2026-09-22 08:58	54.82	OK	2784	2026-09-22 08:59	53.67	OK
2785	2026-09-22 09:00	54.05	OK	2786	2026-09-22 09:01	53.60	OK
2787	2026-09-22 09:02	54.72	OK	2788	2026-09-22 09:03	53.08	OK
2789	2026-09-22 09:04	53.94	OK	2790	2026-09-22 09:05	53.54	OK
2791	2026-09-22 09:06	53.30	OK	2792	2026-09-22 09:07	54.58	OK
2793	2026-09-22 09:08	54.15	OK	2794	2026-09-22 09:09	54.85	OK
2795	2026-09-22 09:10	53.87	OK	2796	2026-09-22 09:11	55.33	OK
2797	2026-09-22 09:12	55.10	OK	2798	2026-09-22 09:13	54.98	OK
2799	2026-09-22 09:14	51.90	OK	2800	2026-09-22 09:15	52.54	OK
2801	2026-09-22 09:16	53.05	OK	2802	2026-09-22 09:17	54.58	OK
2803	2026-09-22 09:18	53.78	OK	2804	2026-09-22 09:19	55.03	OK
2805	2026-09-22 09:20	54.60	OK	2806	2026-09-22 09:21	55.27	OK
2807	2026-09-22 09:22	55.46	OK	2808	2026-09-22 09:23	55.37	OK
2809	2026-09-22 09:24	54.61	OK	2810	2026-09-22 09:25	53.93	OK
2811	2026-09-22 09:26	53.67	OK	2812	2026-09-22 09:27	57.14	OK
2813	2026-09-22 09:28	54.94	OK	2814	2026-09-22 09:29	53.99	OK
2815	2026-09-22 09:30	54.93	OK	2816	2026-09-22 09:31	54.30	OK
2817	2026-09-22 09:32	52.78	OK	2818	2026-09-22 09:33	55.24	OK
2819	2026-09-22 09:34	56.25	OK	2820	2026-09-22 09:35	53.90	OK
2821	2026-09-22 09:36	55.00	OK	2822	2026-09-22 09:37	53.44	OK
2823	2026-09-22 09:38	54.25	OK	2824	2026-09-22 09:39	53.99	OK
2825	2026-09-22 09:40	55.07	OK	2826	2026-09-22 09:41	54.47	OK
2827	2026-09-22 09:42	56.26	OK	2828	2026-09-22 09:43	54.80	OK
2829	2026-09-22 09:44	53.71	OK	2830	2026-09-22 09:45	54.88	OK
2831	2026-09-22 09:46	53.79	OK	2832	2026-09-22 09:47	54.33	OK
2833	2026-09-22 09:48	54.65	OK	2834	2026-09-22 09:49	54.00	OK
2835	2026-09-22 09:50	55.34	OK	2836	2026-09-22 09:51	53.94	OK
2837	2026-09-22 09:52	54.09	OK	2838	2026-09-22 09:53	54.17	OK
2839	2026-09-22 09:54	57.06	OK	2840	2026-09-22 09:55	54.86	OK
2841	2026-09-22 09:56	55.75	OK	2842	2026-09-22 09:57	54.00	OK
2843	2026-09-22 09:58	54.80	OK	2844	2026-09-22 09:59	54.30	OK
2845	2026-09-22 10:00	54.50	OK	2846	2026-09-22 10:01	54.46	OK
2847	2026-09-22 10:02	56.91	OK	2848	2026-09-22 10:03	55.32	OK
2849	2026-09-22 10:04	55.51	OK	2850	2026-09-22 10:05	55.42	OK
2851	2026-09-22 10:06	55.43	OK	2852	2026-09-22 10:07	57.10	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2853	2026-09-22 10:08	56.49	OK	2854	2026-09-22 10:09	54.45	OK
2855	2026-09-22 10:10	54.11	OK	2856	2026-09-22 10:11	54.94	OK
2857	2026-09-22 10:12	57.13	OK	2858	2026-09-22 10:13	54.92	OK
2859	2026-09-22 10:14	55.91	OK	2860	2026-09-22 10:15	55.68	OK
2861	2026-09-22 10:16	55.82	OK	2862	2026-09-22 10:17	56.22	OK
2863	2026-09-22 10:18	56.03	OK	2864	2026-09-22 10:19	55.32	OK
2865	2026-09-22 10:20	55.43	OK	2866	2026-09-22 10:21	56.86	OK
2867	2026-09-22 10:22	54.87	OK	2868	2026-09-22 10:23	57.17	OK
2869	2026-09-22 10:24	57.06	OK	2870	2026-09-22 10:25	55.94	OK
2871	2026-09-22 10:26	55.67	OK	2872	2026-09-22 10:27	55.20	OK
2873	2026-09-22 10:28	55.88	OK	2874	2026-09-22 10:29	55.97	OK
2875	2026-09-22 10:30	57.08	OK	2876	2026-09-22 10:31	56.17	OK
2877	2026-09-22 10:32	55.30	OK	2878	2026-09-22 10:33	54.97	OK
2879	2026-09-22 10:34	55.16	OK	2880	2026-09-22 10:35	57.56	OK
2881	2026-09-22 10:36	54.78	OK	2882	2026-09-22 10:37	55.15	OK
2883	2026-09-22 10:38	56.33	OK	2884	2026-09-22 10:39	54.84	OK
2885	2026-09-22 10:40	57.29	OK	2886	2026-09-22 10:41	56.12	OK
2887	2026-09-22 10:42	57.39	OK	2888	2026-09-22 10:43	54.88	OK
2889	2026-09-22 10:44	55.85	OK	2890	2026-09-22 10:45	56.75	OK
2891	2026-09-22 10:46	57.10	OK	2892	2026-09-22 10:47	56.07	OK
2893	2026-09-22 10:48	58.34	OK	2894	2026-09-22 10:49	55.66	OK
2895	2026-09-22 10:50	56.23	OK	2896	2026-09-22 10:51	57.09	OK
2897	2026-09-22 10:52	55.60	OK	2898	2026-09-22 10:53	56.74	OK
2899	2026-09-22 10:54	56.77	OK	2900	2026-09-22 10:55	55.72	OK
2901	2026-09-22 10:56	55.01	OK	2902	2026-09-22 10:57	55.97	OK
2903	2026-09-22 10:58	56.61	OK	2904	2026-09-22 10:59	57.04	OK
2905	2026-09-22 11:00	54.62	OK	2906	2026-09-22 11:01	56.84	OK
2907	2026-09-22 11:02	55.82	OK	2908	2026-09-22 11:03	57.24	OK
2909	2026-09-22 11:04	56.34	OK	2910	2026-09-22 11:05	55.24	OK
2911	2026-09-22 11:06	54.86	OK	2912	2026-09-22 11:07	55.00	OK
2913	2026-09-22 11:08	56.91	OK	2914	2026-09-22 11:09	57.91	OK
2915	2026-09-22 11:10	55.74	OK	2916	2026-09-22 11:11	56.76	OK
2917	2026-09-22 11:12	57.05	OK	2918	2026-09-22 11:13	56.07	OK
2919	2026-09-22 11:14	57.75	OK	2920	2026-09-22 11:15	55.60	OK
2921	2026-09-22 11:16	57.32	OK	2922	2026-09-22 11:17	56.29	OK
2923	2026-09-22 11:18	56.61	OK	2924	2026-09-22 11:19	57.19	OK
2925	2026-09-22 11:20	56.88	OK	2926	2026-09-22 11:21	57.03	OK
2927	2026-09-22 11:22	55.95	OK	2928	2026-09-22 11:23	56.51	OK
2929	2026-09-22 11:24	54.05	OK	2930	2026-09-22 11:25	56.63	OK
2931	2026-09-22 11:26	57.48	OK	2932	2026-09-22 11:27	57.34	OK
2933	2026-09-22 11:28	56.67	OK	2934	2026-09-22 11:29	57.09	OK
2935	2026-09-22 11:30	56.65	OK	2936	2026-09-22 11:31	56.31	OK
2937	2026-09-22 11:32	58.57	OK	2938	2026-09-22 11:33	56.80	OK
2939	2026-09-22 11:34	56.62	OK	2940	2026-09-22 11:35	56.37	OK
2941	2026-09-22 11:36	56.90	OK	2942	2026-09-22 11:37	57.30	OK
2943	2026-09-22 11:38	56.42	OK	2944	2026-09-22 11:39	57.18	OK
2945	2026-09-22 11:40	56.75	OK	2946	2026-09-22 11:41	57.46	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2947	2026-09-22 11:42	57.64	OK	2948	2026-09-22 11:43	57.95	OK
2949	2026-09-22 11:44	58.38	OK	2950	2026-09-22 11:45	56.45	OK
2951	2026-09-22 11:46	58.25	OK	2952	2026-09-22 11:47	56.66	OK
2953	2026-09-22 11:48	54.57	OK	2954	2026-09-22 11:49	54.78	OK
2955	2026-09-22 11:50	56.44	OK	2956	2026-09-22 11:51	56.93	OK
2957	2026-09-22 11:52	57.68	OK	2958	2026-09-22 11:53	57.96	OK
2959	2026-09-22 11:54	56.98	OK	2960	2026-09-22 11:55	58.61	OK
2961	2026-09-22 11:56	57.04	OK	2962	2026-09-22 11:57	57.66	OK
2963	2026-09-22 11:58	57.01	OK	2964	2026-09-22 11:59	57.34	OK
2965	2026-09-22 12:00	56.92	OK	2966	2026-09-22 12:01	56.41	OK
2967	2026-09-22 12:02	56.72	OK	2968	2026-09-22 12:03	55.57	OK
2969	2026-09-22 12:04	57.20	OK	2970	2026-09-22 12:05	56.96	OK
2971	2026-09-22 12:06	58.04	OK	2972	2026-09-22 12:07	58.02	OK
2973	2026-09-22 12:08	57.31	OK	2974	2026-09-22 12:09	57.32	OK
2975	2026-09-22 12:10	56.18	OK	2976	2026-09-22 12:11	57.59	OK
2977	2026-09-22 12:12	56.91	OK	2978	2026-09-22 12:13	57.41	OK
2979	2026-09-22 12:14	55.68	OK	2980	2026-09-22 12:15	55.40	OK
2981	2026-09-22 12:16	57.56	OK	2982	2026-09-22 12:17	55.86	OK
2983	2026-09-22 12:18	57.32	OK	2984	2026-09-22 12:19	57.06	OK
2985	2026-09-22 12:20	58.53	OK	2986	2026-09-22 12:21	57.53	OK
2987	2026-09-22 12:22	56.10	OK	2988	2026-09-22 12:23	57.75	OK
2989	2026-09-22 12:24	57.07	OK	2990	2026-09-22 12:25	57.79	OK
2991	2026-09-22 12:26	58.46	OK	2992	2026-09-22 12:27	58.79	OK
2993	2026-09-22 12:28	55.03	OK	2994	2026-09-22 12:29	56.03	OK
2995	2026-09-22 12:30	59.39	OK	2996	2026-09-22 12:31	56.93	OK
2997	2026-09-22 12:32	58.32	OK	2998	2026-09-22 12:33	58.23	OK
2999	2026-09-22 12:34	57.74	OK	3000	2026-09-22 12:35	56.50	OK
3001	2026-09-22 12:36	56.77	OK	3002	2026-09-22 12:37	57.48	OK
3003	2026-09-22 12:38	57.15	OK	3004	2026-09-22 12:39	55.18	OK
3005	2026-09-22 12:40	58.04	OK	3006	2026-09-22 12:41	57.96	OK
3007	2026-09-22 12:42	60.10	OK	3008	2026-09-22 12:43	57.38	OK
3009	2026-09-22 12:44	55.72	OK	3010	2026-09-22 12:45	54.96	OK
3011	2026-09-22 12:46	58.63	OK	3012	2026-09-22 12:47	56.24	OK
3013	2026-09-22 12:48	56.81	OK	3014	2026-09-22 12:49	59.21	OK
3015	2026-09-22 12:50	57.30	OK	3016	2026-09-22 12:51	57.73	OK
3017	2026-09-22 12:52	58.01	OK	3018	2026-09-22 12:53	57.57	OK
3019	2026-09-22 12:54	58.06	OK	3020	2026-09-22 12:55	57.08	OK
3021	2026-09-22 12:56	58.43	OK	3022	2026-09-22 12:57	57.15	OK
3023	2026-09-22 12:58	55.04	OK	3024	2026-09-22 12:59	56.24	OK
3025	2026-09-22 13:00	56.70	OK	3026	2026-09-22 13:01	59.05	OK
3027	2026-09-22 13:02	55.90	OK	3028	2026-09-22 13:03	58.77	OK
3029	2026-09-22 13:04	58.43	OK	3030	2026-09-22 13:05	58.61	OK
3031	2026-09-22 13:06	58.88	OK	3032	2026-09-22 13:07	58.72	OK
3033	2026-09-22 13:08	57.87	OK	3034	2026-09-22 13:09	56.74	OK
3035	2026-09-22 13:10	60.14	OK	3036	2026-09-22 13:11	59.50	OK
3037	2026-09-22 13:12	57.97	OK	3038	2026-09-22 13:13	56.79	OK
3039	2026-09-22 13:14	60.77	OK	3040	2026-09-22 13:15	57.56	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3041	2026-09-22 13:16	56.85	OK	3042	2026-09-22 13:17	57.34	OK
3043	2026-09-22 13:18	58.27	OK	3044	2026-09-22 13:19	59.00	OK
3045	2026-09-22 13:20	58.93	OK	3046	2026-09-22 13:21	58.94	OK
3047	2026-09-22 13:22	59.53	OK	3048	2026-09-22 13:23	59.93	OK
3049	2026-09-22 13:24	60.49	OK	3050	2026-09-22 13:25	59.45	OK
3051	2026-09-22 13:26	58.31	OK	3052	2026-09-22 13:27	57.76	OK
3053	2026-09-22 13:28	57.40	OK	3054	2026-09-22 13:29	58.78	OK
3055	2026-09-22 13:30	58.59	OK	3056	2026-09-22 13:31	57.16	OK
3057	2026-09-22 13:32	59.37	OK	3058	2026-09-22 13:33	58.86	OK
3059	2026-09-22 13:34	56.24	OK	3060	2026-09-22 13:35	58.09	OK
3061	2026-09-22 13:36	56.56	OK	3062	2026-09-22 13:37	57.99	OK
3063	2026-09-22 13:38	59.67	OK	3064	2026-09-22 13:39	57.53	OK
3065	2026-09-22 13:40	58.32	OK	3066	2026-09-22 13:41	59.01	OK
3067	2026-09-22 13:42	59.40	OK	3068	2026-09-22 13:43	58.84	OK
3069	2026-09-22 13:44	57.97	OK	3070	2026-09-22 13:45	57.93	OK
3071	2026-09-22 13:46	57.82	OK	3072	2026-09-22 13:47	57.73	OK
3073	2026-09-22 13:48	59.94	OK	3074	2026-09-22 13:49	58.81	OK
3075	2026-09-22 13:50	57.74	OK	3076	2026-09-22 13:51	60.39	OK
3077	2026-09-22 13:52	57.38	OK	3078	2026-09-22 13:53	55.74	OK
3079	2026-09-22 13:54	60.26	OK	3080	2026-09-22 13:55	61.08	OK
3081	2026-09-22 13:56	56.63	OK	3082	2026-09-22 13:57	59.39	OK
3083	2026-09-22 13:58	59.38	OK	3084	2026-09-22 13:59	57.29	OK
3085	2026-09-22 14:00	59.64	OK	3086	2026-09-22 14:01	59.88	OK
3087	2026-09-22 14:02	57.98	OK	3088	2026-09-22 14:03	56.34	OK
3089	2026-09-22 14:04	57.14	OK	3090	2026-09-22 14:05	58.23	OK
3091	2026-09-22 14:06	58.84	OK	3092	2026-09-22 14:07	57.18	OK
3093	2026-09-22 14:08	58.57	OK	3094	2026-09-22 14:09	59.89	OK
3095	2026-09-22 14:10	60.54	OK	3096	2026-09-22 14:11	58.51	OK
3097	2026-09-22 14:12	58.04	OK	3098	2026-09-22 14:13	57.10	OK
3099	2026-09-22 14:14	59.75	OK	3100	2026-09-22 14:15	56.96	OK
3101	2026-09-22 14:16	59.16	OK	3102	2026-09-22 14:17	58.78	OK
3103	2026-09-22 14:18	58.92	OK	3104	2026-09-22 14:19	58.64	OK
3105	2026-09-22 14:20	60.43	OK	3106	2026-09-22 14:21	58.89	OK
3107	2026-09-22 14:22	57.93	OK	3108	2026-09-22 14:23	59.85	OK
3109	2026-09-22 14:24	58.22	OK	3110	2026-09-22 14:25	60.07	OK
3111	2026-09-22 14:26	57.07	OK	3112	2026-09-22 14:27	58.26	OK
3113	2026-09-22 14:28	57.67	OK	3114	2026-09-22 14:29	59.94	OK
3115	2026-09-22 14:30	59.70	OK	3116	2026-09-22 14:31	60.48	OK
3117	2026-09-22 14:32	58.50	OK	3118	2026-09-22 14:33	58.93	OK
3119	2026-09-22 14:34	58.82	OK	3120	2026-09-22 14:35	57.29	OK
3121	2026-09-22 14:36	59.19	OK	3122	2026-09-22 14:37	58.97	OK
3123	2026-09-22 14:38	58.05	OK	3124	2026-09-22 14:39	58.40	OK
3125	2026-09-22 14:40	58.25	OK	3126	2026-09-22 14:41	60.46	OK
3127	2026-09-22 14:42	58.18	OK	3128	2026-09-22 14:43	56.67	OK
3129	2026-09-22 14:44	60.14	OK	3130	2026-09-22 14:45	60.14	OK
3131	2026-09-22 14:46	58.69	OK	3132	2026-09-22 14:47	59.56	OK
3133	2026-09-22 14:48	61.04	OK	3134	2026-09-22 14:49	58.25	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3135	2026-09-22 14:50	59.53	OK	3136	2026-09-22 14:51	57.85	OK
3137	2026-09-22 14:52	58.18	OK	3138	2026-09-22 14:53	60.34	OK
3139	2026-09-22 14:54	56.93	OK	3140	2026-09-22 14:55	58.18	OK
3141	2026-09-22 14:56	59.01	OK	3142	2026-09-22 14:57	59.12	OK
3143	2026-09-22 14:58	58.28	OK	3144	2026-09-22 14:59	58.57	OK
3145	2026-09-22 15:00	57.27	OK	3146	2026-09-22 15:01	60.88	OK
3147	2026-09-22 15:02	58.98	OK	3148	2026-09-22 15:03	59.49	OK
3149	2026-09-22 15:04	59.93	OK	3150	2026-09-22 15:05	56.41	OK
3151	2026-09-22 15:06	58.94	OK	3152	2026-09-22 15:07	57.73	OK
3153	2026-09-22 15:08	60.91	OK	3154	2026-09-22 15:09	59.13	OK
3155	2026-09-22 15:10	57.85	OK	3156	2026-09-22 15:11	57.84	OK
3157	2026-09-22 15:12	58.96	OK	3158	2026-09-22 15:13	57.77	OK
3159	2026-09-22 15:14	58.79	OK	3160	2026-09-22 15:15	59.38	OK
3161	2026-09-22 15:16	57.81	OK	3162	2026-09-22 15:17	58.08	OK
3163	2026-09-22 15:18	58.52	OK	3164	2026-09-22 15:19	59.09	OK
3165	2026-09-22 15:20	57.92	OK	3166	2026-09-22 15:21	58.33	OK
3167	2026-09-22 15:22	58.04	OK	3168	2026-09-22 15:23	57.27	OK
3169	2026-09-22 15:24	57.77	OK	3170	2026-09-22 15:25	57.62	OK
3171	2026-09-22 15:26	57.81	OK	3172	2026-09-22 15:27	59.63	OK
3173	2026-09-22 15:28	60.19	OK	3174	2026-09-22 15:29	58.62	OK
3175	2026-09-22 15:30	60.82	OK	3176	2026-09-22 15:31	57.71	OK
3177	2026-09-22 15:32	55.95	OK	3178	2026-09-22 15:33	58.56	OK
3179	2026-09-22 15:34	56.81	OK	3180	2026-09-22 15:35	59.81	OK
3181	2026-09-22 15:36	57.20	OK	3182	2026-09-22 15:37	58.19	OK
3183	2026-09-22 15:38	59.30	OK	3184	2026-09-22 15:39	59.17	OK
3185	2026-09-22 15:40	58.17	OK	3186	2026-09-22 15:41	58.08	OK
3187	2026-09-22 15:42	57.23	OK	3188	2026-09-22 15:43	59.46	OK
3189	2026-09-22 15:44	58.74	OK	3190	2026-09-22 15:45	59.53	OK
3191	2026-09-22 15:46	57.41	OK	3192	2026-09-22 15:47	58.73	OK
3193	2026-09-22 15:48	60.40	OK	3194	2026-09-22 15:49	59.86	OK
3195	2026-09-22 15:50	57.11	OK	3196	2026-09-22 15:51	60.21	OK
3197	2026-09-22 15:52	58.59	OK	3198	2026-09-22 15:53	56.44	OK
3199	2026-09-22 15:54	58.02	OK	3200	2026-09-22 15:55	59.69	OK
3201	2026-09-22 15:56	58.52	OK	3202	2026-09-22 15:57	58.41	OK
3203	2026-09-22 15:58	57.29	OK	3204	2026-09-22 15:59	57.41	OK
3205	2026-09-22 16:00	58.93	OK	3206	2026-09-22 16:01	56.56	OK
3207	2026-09-22 16:02	57.60	OK	3208	2026-09-22 16:03	59.27	OK
3209	2026-09-22 16:04	59.11	OK	3210	2026-09-22 16:05	58.23	OK
3211	2026-09-22 16:06	59.87	OK	3212	2026-09-22 16:07	59.25	OK
3213	2026-09-22 16:08	61.00	OK	3214	2026-09-22 16:09	57.75	OK
3215	2026-09-22 16:10	57.81	OK	3216	2026-09-22 16:11	58.26	OK
3217	2026-09-22 16:12	58.34	OK	3218	2026-09-22 16:13	58.23	OK
3219	2026-09-22 16:14	61.07	OK	3220	2026-09-22 16:15	57.51	OK
3221	2026-09-22 16:16	58.29	OK	3222	2026-09-22 16:17	59.52	OK
3223	2026-09-22 16:18	59.55	OK	3224	2026-09-22 16:19	58.79	OK
3225	2026-09-22 16:20	58.40	OK	3226	2026-09-22 16:21	58.46	OK
3227	2026-09-22 16:22	57.99	OK	3228	2026-09-22 16:23	57.78	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3229	2026-09-22 16:24	58.20	OK	3230	2026-09-22 16:25	57.74	OK
3231	2026-09-22 16:26	57.14	OK	3232	2026-09-22 16:27	58.61	OK
3233	2026-09-22 16:28	60.42	OK	3234	2026-09-22 16:29	55.68	OK
3235	2026-09-22 16:30	58.43	OK	3236	2026-09-22 16:31	56.95	OK
3237	2026-09-22 16:32	58.34	OK	3238	2026-09-22 16:33	60.21	OK
3239	2026-09-22 16:34	58.34	OK	3240	2026-09-22 16:35	57.09	OK
3241	2026-09-22 16:36	58.75	OK	3242	2026-09-22 16:37	56.80	OK
3243	2026-09-22 16:38	57.14	OK	3244	2026-09-22 16:39	60.63	OK
3245	2026-09-22 16:40	58.52	OK	3246	2026-09-22 16:41	58.84	OK
3247	2026-09-22 16:42	58.39	OK	3248	2026-09-22 16:43	59.15	OK
3249	2026-09-22 16:44	57.07	OK	3250	2026-09-22 16:45	57.50	OK
3251	2026-09-22 16:46	60.03	OK	3252	2026-09-22 16:47	58.14	OK
3253	2026-09-22 16:48	60.15	OK	3254	2026-09-22 16:49	58.73	OK
3255	2026-09-22 16:50	59.14	OK	3256	2026-09-22 16:51	58.59	OK
3257	2026-09-22 16:52	57.65	OK	3258	2026-09-22 16:53	59.02	OK
3259	2026-09-22 16:54	57.54	OK	3260	2026-09-22 16:55	58.75	OK
3261	2026-09-22 16:56	59.87	OK	3262	2026-09-22 16:57	58.57	OK
3263	2026-09-22 16:58	56.97	OK	3264	2026-09-22 16:59	57.05	OK
3265	2026-09-22 17:00	57.10	OK	3266	2026-09-22 17:01	57.96	OK
3267	2026-09-22 17:02	58.22	OK	3268	2026-09-22 17:03	57.14	OK
3269	2026-09-22 17:04	58.76	OK	3270	2026-09-22 17:05	60.74	OK
3271	2026-09-22 17:06	58.35	OK	3272	2026-09-22 17:07	57.89	OK
3273	2026-09-22 17:08	58.07	OK	3274	2026-09-22 17:09	58.27	OK
3275	2026-09-22 17:10	59.40	OK	3276	2026-09-22 17:11	57.07	OK
3277	2026-09-22 17:12	57.28	OK	3278	2026-09-22 17:13	58.52	OK
3279	2026-09-22 17:14	59.69	OK	3280	2026-09-22 17:15	58.38	OK
3281	2026-09-22 17:16	59.20	OK	3282	2026-09-22 17:17	57.24	OK
3283	2026-09-22 17:18	58.06	OK	3284	2026-09-22 17:19	57.03	OK
3285	2026-09-22 17:20	58.22	OK	3286	2026-09-22 17:21	57.68	OK
3287	2026-09-22 17:22	58.64	OK	3288	2026-09-22 17:23	58.53	OK
3289	2026-09-22 17:24	55.83	OK	3290	2026-09-22 17:25	56.55	OK
3291	2026-09-22 17:26	57.30	OK	3292	2026-09-22 17:27	60.66	OK
3293	2026-09-22 17:28	57.39	OK	3294	2026-09-22 17:29	59.10	OK
3295	2026-09-22 17:30	58.88	OK	3296	2026-09-22 17:31	58.18	OK
3297	2026-09-22 17:32	57.19	OK	3298	2026-09-22 17:33	59.22	OK
3299	2026-09-22 17:34	58.84	OK	3300	2026-09-22 17:35	58.27	OK
3301	2026-09-22 17:36	58.23	OK	3302	2026-09-22 17:37	56.81	OK
3303	2026-09-22 17:38	59.14	OK	3304	2026-09-22 17:39	59.91	OK
3305	2026-09-22 17:40	58.16	OK	3306	2026-09-22 17:41	59.72	OK
3307	2026-09-22 17:42	57.01	OK	3308	2026-09-22 17:43	56.95	OK
3309	2026-09-22 17:44	58.98	OK	3310	2026-09-22 17:45	59.48	OK
3311	2026-09-22 17:46	59.78	OK	3312	2026-09-22 17:47	59.69	OK
3313	2026-09-22 17:48	56.60	OK	3314	2026-09-22 17:49	59.70	OK
3315	2026-09-22 17:50	59.19	OK	3316	2026-09-22 17:51	58.98	OK
3317	2026-09-22 17:52	57.79	OK	3318	2026-09-22 17:53	56.22	OK
3319	2026-09-22 17:54	57.10	OK	3320	2026-09-22 17:55	56.57	OK
3321	2026-09-22 17:56	57.80	OK	3322	2026-09-22 17:57	57.03	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3323	2026-09-22 17:58	56.23	OK	3324	2026-09-22 17:59	59.34	OK
3325	2026-09-22 18:00	58.48	OK	3326	2026-09-22 18:01	57.34	OK
3327	2026-09-22 18:02	57.44	OK	3328	2026-09-22 18:03	59.37	OK
3329	2026-09-22 18:04	58.24	OK	3330	2026-09-22 18:05	58.38	OK
3331	2026-09-22 18:06	60.25	OK	3332	2026-09-22 18:07	56.66	OK
3333	2026-09-22 18:08	57.07	OK	3334	2026-09-22 18:09	55.51	OK
3335	2026-09-22 18:10	59.85	OK	3336	2026-09-22 18:11	55.48	OK
3337	2026-09-22 18:12	57.65	OK	3338	2026-09-22 18:13	56.60	OK
3339	2026-09-22 18:14	58.22	OK	3340	2026-09-22 18:15	58.67	OK
3341	2026-09-22 18:16	58.43	OK	3342	2026-09-22 18:17	58.22	OK
3343	2026-09-22 18:18	58.11	OK	3344	2026-09-22 18:19	55.44	OK
3345	2026-09-22 18:20	56.23	OK	3346	2026-09-22 18:21	58.11	OK
3347	2026-09-22 18:22	56.66	OK	3348	2026-09-22 18:23	59.40	OK
3349	2026-09-22 18:24	56.35	OK	3350	2026-09-22 18:25	56.43	OK
3351	2026-09-22 18:26	58.52	OK	3352	2026-09-22 18:27	56.27	OK
3353	2026-09-22 18:28	59.36	OK	3354	2026-09-22 18:29	56.97	OK
3355	2026-09-22 18:30	57.30	OK	3356	2026-09-22 18:31	58.60	OK
3357	2026-09-22 18:32	57.57	OK	3358	2026-09-22 18:33	57.17	OK
3359	2026-09-22 18:34	58.13	OK	3360	2026-09-22 18:35	57.17	OK
3361	2026-09-22 18:36	58.44	OK	3362	2026-09-22 18:37	57.28	OK
3363	2026-09-22 18:38	56.46	OK	3364	2026-09-22 18:39	56.44	OK
3365	2026-09-22 18:40	57.03	OK	3366	2026-09-22 18:41	56.25	OK
3367	2026-09-22 18:42	57.70	OK	3368	2026-09-22 18:43	56.45	OK
3369	2026-09-22 18:44	58.32	OK	3370	2026-09-22 18:45	58.33	OK
3371	2026-09-22 18:46	57.88	OK	3372	2026-09-22 18:47	59.33	OK
3373	2026-09-22 18:48	57.02	OK	3374	2026-09-22 18:49	55.81	OK
3375	2026-09-22 18:50	56.58	OK	3376	2026-09-22 18:51	57.20	OK
3377	2026-09-22 18:52	55.79	OK	3378	2026-09-22 18:53	57.97	OK
3379	2026-09-22 18:54	55.91	OK	3380	2026-09-22 18:55	56.71	OK
3381	2026-09-22 18:56	57.13	OK	3382	2026-09-22 18:57	57.77	OK
3383	2026-09-22 18:58	57.08	OK	3384	2026-09-22 18:59	56.60	OK
3385	2026-09-22 19:00	55.86	OK	3386	2026-09-22 19:01	55.19	OK
3387	2026-09-22 19:02	55.72	OK	3388	2026-09-22 19:03	55.71	OK
3389	2026-09-22 19:04	59.06	OK	3390	2026-09-22 19:05	56.63	OK
3391	2026-09-22 19:06	58.43	OK	3392	2026-09-22 19:07	56.72	OK
3393	2026-09-22 19:08	56.56	OK	3394	2026-09-22 19:09	56.08	OK
3395	2026-09-22 19:10	57.60	OK	3396	2026-09-22 19:11	56.17	OK
3397	2026-09-22 19:12	56.60	OK	3398	2026-09-22 19:13	57.66	OK
3399	2026-09-22 19:14	57.37	OK	3400	2026-09-22 19:15	57.23	OK
3401	2026-09-22 19:16	56.38	OK	3402	2026-09-22 19:17	55.59	OK
3403	2026-09-22 19:18	57.71	OK	3404	2026-09-22 19:19	56.33	OK
3405	2026-09-22 19:20	55.58	OK	3406	2026-09-22 19:21	54.76	OK
3407	2026-09-22 19:22	56.80	OK	3408	2026-09-22 19:23	57.83	OK
3409	2026-09-22 19:24	55.46	OK	3410	2026-09-22 19:25	57.51	OK
3411	2026-09-22 19:26	57.14	OK	3412	2026-09-22 19:27	57.61	OK
3413	2026-09-22 19:28	56.68	OK	3414	2026-09-22 19:29	53.94	OK
3415	2026-09-22 19:30	57.41	OK	3416	2026-09-22 19:31	56.31	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3417	2026-09-22 19:32	55.96	OK	3418	2026-09-22 19:33	56.13	OK
3419	2026-09-22 19:34	54.98	OK	3420	2026-09-22 19:35	57.13	OK
3421	2026-09-22 19:36	55.42	OK	3422	2026-09-22 19:37	56.33	OK
3423	2026-09-22 19:38	57.49	OK	3424	2026-09-22 19:39	56.81	OK
3425	2026-09-22 19:40	56.45	OK	3426	2026-09-22 19:41	57.35	OK
3427	2026-09-22 19:42	57.38	OK	3428	2026-09-22 19:43	57.70	OK
3429	2026-09-22 19:44	57.76	OK	3430	2026-09-22 19:45	55.64	OK
3431	2026-09-22 19:46	55.49	OK	3432	2026-09-22 19:47	57.19	OK
3433	2026-09-22 19:48	56.77	OK	3434	2026-09-22 19:49	57.24	OK
3435	2026-09-22 19:50	55.42	OK	3436	2026-09-22 19:51	56.37	OK
3437	2026-09-22 19:52	56.25	OK	3438	2026-09-22 19:53	57.08	OK
3439	2026-09-22 19:54	57.46	OK	3440	2026-09-22 19:55	56.29	OK
3441	2026-09-22 19:56	56.96	OK	3442	2026-09-22 19:57	56.07	OK
3443	2026-09-22 19:58	55.74	OK	3444	2026-09-22 19:59	56.04	OK
3445	2026-09-22 20:00	53.70	OK	3446	2026-09-22 20:01	55.69	OK
3447	2026-09-22 20:02	55.57	OK	3448	2026-09-22 20:03	54.27	OK
3449	2026-09-22 20:04	58.06	OK	3450	2026-09-22 20:05	54.55	OK
3451	2026-09-22 20:06	56.63	OK	3452	2026-09-22 20:07	54.11	OK
3453	2026-09-22 20:08	55.14	OK	3454	2026-09-22 20:09	55.67	OK
3455	2026-09-22 20:10	56.08	OK	3456	2026-09-22 20:11	55.98	OK
3457	2026-09-22 20:12	56.75	OK	3458	2026-09-22 20:13	54.86	OK
3459	2026-09-22 20:14	55.28	OK	3460	2026-09-22 20:15	55.52	OK
3461	2026-09-22 20:16	56.50	OK	3462	2026-09-22 20:17	55.97	OK
3463	2026-09-22 20:18	56.14	OK	3464	2026-09-22 20:19	55.22	OK
3465	2026-09-22 20:20	56.58	OK	3466	2026-09-22 20:21	56.47	OK
3467	2026-09-22 20:22	54.88	OK	3468	2026-09-22 20:23	54.38	OK
3469	2026-09-22 20:24	54.58	OK	3470	2026-09-22 20:25	55.84	OK
3471	2026-09-22 20:26	53.57	OK	3472	2026-09-22 20:27	54.69	OK
3473	2026-09-22 20:28	54.69	OK	3474	2026-09-22 20:29	55.86	OK
3475	2026-09-22 20:30	53.72	OK	3476	2026-09-22 20:31	54.51	OK
3477	2026-09-22 20:32	55.97	OK	3478	2026-09-22 20:33	56.13	OK
3479	2026-09-22 20:34	56.23	OK	3480	2026-09-22 20:35	54.22	OK
3481	2026-09-22 20:36	56.33	OK	3482	2026-09-22 20:37	54.13	OK
3483	2026-09-22 20:38	55.56	OK	3484	2026-09-22 20:39	54.59	OK
3485	2026-09-22 20:40	56.02	OK	3486	2026-09-22 20:41	53.82	OK
3487	2026-09-22 20:42	56.66	OK	3488	2026-09-22 20:43	53.66	OK
3489	2026-09-22 20:44	55.80	OK	3490	2026-09-22 20:45	55.42	OK
3491	2026-09-22 20:46	55.32	OK	3492	2026-09-22 20:47	54.84	OK
3493	2026-09-22 20:48	57.80	OK	3494	2026-09-22 20:49	54.21	OK
3495	2026-09-22 20:50	54.30	OK	3496	2026-09-22 20:51	53.87	OK
3497	2026-09-22 20:52	54.97	OK	3498	2026-09-22 20:53	55.72	OK
3499	2026-09-22 20:54	54.77	OK	3500	2026-09-22 20:55	54.99	OK
3501	2026-09-22 20:56	55.37	OK	3502	2026-09-22 20:57	55.00	OK
3503	2026-09-22 20:58	54.77	OK	3504	2026-09-22 20:59	54.47	OK
3505	2026-09-22 21:00	54.13	OK	3506	2026-09-22 21:01	54.35	OK
3507	2026-09-22 21:02	53.89	OK	3508	2026-09-22 21:03	53.52	OK
3509	2026-09-22 21:04	56.57	OK	3510	2026-09-22 21:05	55.96	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3511	2026-09-22 21:06	54.27	OK	3512	2026-09-22 21:07	53.81	OK
3513	2026-09-22 21:08	56.72	OK	3514	2026-09-22 21:09	52.93	OK
3515	2026-09-22 21:10	55.15	OK	3516	2026-09-22 21:11	53.11	OK
3517	2026-09-22 21:12	54.03	OK	3518	2026-09-22 21:13	56.23	OK
3519	2026-09-22 21:14	54.40	OK	3520	2026-09-22 21:15	54.16	OK
3521	2026-09-22 21:16	54.65	OK	3522	2026-09-22 21:17	52.61	OK
3523	2026-09-22 21:18	54.34	OK	3524	2026-09-22 21:19	53.65	OK
3525	2026-09-22 21:20	52.73	OK	3526	2026-09-22 21:21	52.51	OK
3527	2026-09-22 21:22	52.62	OK	3528	2026-09-22 21:23	54.73	OK
3529	2026-09-22 21:24	54.50	OK	3530	2026-09-22 21:25	53.68	OK
3531	2026-09-22 21:26	54.80	OK	3532	2026-09-22 21:27	54.84	OK
3533	2026-09-22 21:28	54.32	OK	3534	2026-09-22 21:29	54.63	OK
3535	2026-09-22 21:30	55.41	OK	3536	2026-09-22 21:31	53.43	OK
3537	2026-09-22 21:32	55.17	OK	3538	2026-09-22 21:33	53.14	OK
3539	2026-09-22 21:34	54.29	OK	3540	2026-09-22 21:35	53.61	OK
3541	2026-09-22 21:36	53.90	OK	3542	2026-09-22 21:37	56.11	OK
3543	2026-09-22 21:38	53.30	OK	3544	2026-09-22 21:39	53.30	OK
3545	2026-09-22 21:40	53.85	OK	3546	2026-09-22 21:41	52.19	OK
3547	2026-09-22 21:42	54.02	OK	3548	2026-09-22 21:43	54.91	OK
3549	2026-09-22 21:44	54.90	OK	3550	2026-09-22 21:45	52.49	OK
3551	2026-09-22 21:46	54.29	OK	3552	2026-09-22 21:47	53.80	OK
3553	2026-09-22 21:48	54.44	OK	3554	2026-09-22 21:49	52.81	OK
3555	2026-09-22 21:50	52.87	OK	3556	2026-09-22 21:51	54.18	OK
3557	2026-09-22 21:52	55.28	OK	3558	2026-09-22 21:53	53.66	OK
3559	2026-09-22 21:54	54.30	OK	3560	2026-09-22 21:55	53.96	OK
3561	2026-09-22 21:56	54.54	OK	3562	2026-09-22 21:57	52.10	OK
3563	2026-09-22 21:58	54.38	OK	3564	2026-09-22 21:59	52.09	OK
3565	2026-09-22 22:00	54.02	OK	3566	2026-09-22 22:01	54.43	OK
3567	2026-09-22 22:02	52.00	OK	3568	2026-09-22 22:03	54.57	OK
3569	2026-09-22 22:04	52.09	OK	3570	2026-09-22 22:05	52.64	OK
3571	2026-09-22 22:06	53.38	OK	3572	2026-09-22 22:07	52.37	OK
3573	2026-09-22 22:08	54.80	OK	3574	2026-09-22 22:09	54.18	OK
3575	2026-09-22 22:10	54.35	OK	3576	2026-09-22 22:11	54.48	OK
3577	2026-09-22 22:12	52.04	OK	3578	2026-09-22 22:13	52.89	OK
3579	2026-09-22 22:14	54.44	OK	3580	2026-09-22 22:15	53.57	OK
3581	2026-09-22 22:16	52.94	OK	3582	2026-09-22 22:17	52.41	OK
3583	2026-09-22 22:18	52.84	OK	3584	2026-09-22 22:19	55.18	OK
3585	2026-09-22 22:20	50.95	OK	3586	2026-09-22 22:21	53.02	OK
3587	2026-09-22 22:22	53.48	OK	3588	2026-09-22 22:23	54.08	OK
3589	2026-09-22 22:24	52.91	OK	3590	2026-09-22 22:25	52.18	OK
3591	2026-09-22 22:26	54.60	OK	3592	2026-09-22 22:27	53.56	OK
3593	2026-09-22 22:28	53.78	OK	3594	2026-09-22 22:29	52.52	OK
3595	2026-09-22 22:30	53.24	OK	3596	2026-09-22 22:31	52.38	OK
3597	2026-09-22 22:32	52.02	OK	3598	2026-09-22 22:33	52.99	OK
3599	2026-09-22 22:34	54.98	OK	3600	2026-09-22 22:35	52.89	OK
3601	2026-09-22 22:36	53.38	OK	3602	2026-09-22 22:37	54.49	OK
3603	2026-09-22 22:38	52.04	OK	3604	2026-09-22 22:39	52.43	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3605	2026-09-22 22:40	51.32	OK	3606	2026-09-22 22:41	52.41	OK
3607	2026-09-22 22:42	52.46	OK	3608	2026-09-22 22:43	53.48	OK
3609	2026-09-22 22:44	53.45	OK	3610	2026-09-22 22:45	51.41	OK
3611	2026-09-22 22:46	52.80	OK	3612	2026-09-22 22:47	53.36	OK
3613	2026-09-22 22:48	51.61	OK	3614	2026-09-22 22:49	53.12	OK
3615	2026-09-22 22:50	52.66	OK	3616	2026-09-22 22:51	54.54	OK
3617	2026-09-22 22:52	50.44	OK	3618	2026-09-22 22:53	53.29	OK
3619	2026-09-22 22:54	53.93	OK	3620	2026-09-22 22:55	52.03	OK
3621	2026-09-22 22:56	53.74	OK	3622	2026-09-22 22:57	51.70	OK
3623	2026-09-22 22:58	52.84	OK	3624	2026-09-22 22:59	51.81	OK
3625	2026-09-22 23:00	53.06	OK	3626	2026-09-22 23:01	53.58	OK
3627	2026-09-22 23:02	52.56	OK	3628	2026-09-22 23:03	53.50	OK
3629	2026-09-22 23:04	53.06	OK	3630	2026-09-22 23:05	51.29	OK
3631	2026-09-22 23:06	52.36	OK	3632	2026-09-22 23:07	51.65	OK
3633	2026-09-22 23:08	51.87	OK	3634	2026-09-22 23:09	54.34	OK
3635	2026-09-22 23:10	53.44	OK	3636	2026-09-22 23:11	51.59	OK
3637	2026-09-22 23:12	51.68	OK	3638	2026-09-22 23:13	50.83	OK
3639	2026-09-22 23:14	54.51	OK	3640	2026-09-22 23:15	50.86	OK
3641	2026-09-22 23:16	51.80	OK	3642	2026-09-22 23:17	51.40	OK
3643	2026-09-22 23:18	54.01	OK	3644	2026-09-22 23:19	53.47	OK
3645	2026-09-22 23:20	51.73	OK	3646	2026-09-22 23:21	51.48	OK
3647	2026-09-22 23:22	50.91	OK	3648	2026-09-22 23:23	51.76	OK
3649	2026-09-22 23:24	52.76	OK	3650	2026-09-22 23:25	52.83	OK
3651	2026-09-22 23:26	51.82	OK	3652	2026-09-22 23:27	50.77	OK
3653	2026-09-22 23:28	52.51	OK	3654	2026-09-22 23:29	53.79	OK
3655	2026-09-22 23:30	52.54	OK	3656	2026-09-22 23:31	51.81	OK
3657	2026-09-22 23:32	53.10	OK	3658	2026-09-22 23:33	51.66	OK
3659	2026-09-22 23:34	51.47	OK	3660	2026-09-22 23:35	53.16	OK
3661	2026-09-22 23:36	50.67	OK	3662	2026-09-22 23:37	51.99	OK
3663	2026-09-22 23:38	53.55	OK	3664	2026-09-22 23:39	52.43	OK
3665	2026-09-22 23:40	51.26	OK	3666	2026-09-22 23:41	50.54	OK
3667	2026-09-22 23:42	53.80	OK	3668	2026-09-22 23:43	50.13	OK
3669	2026-09-22 23:44	51.20	OK	3670	2026-09-22 23:45	52.88	OK
3671	2026-09-22 23:46	53.32	OK	3672	2026-09-22 23:47	52.16	OK
3673	2026-09-22 23:48	51.51	OK	3674	2026-09-22 23:49	52.00	OK
3675	2026-09-22 23:50	50.43	OK	3676	2026-09-22 23:51	51.52	OK
3677	2026-09-22 23:52	50.00	OK	3678	2026-09-22 23:53	50.63	OK
3679	2026-09-22 23:54	53.62	OK	3680	2026-09-22 23:55	51.21	OK
3681	2026-09-22 23:56	51.71	OK	3682	2026-09-22 23:57	50.33	OK
3683	2026-09-22 23:58	50.66	OK	3684	2026-09-22 23:59	52.16	OK
3685	2026-09-23 00:00	52.69	OK	3686	2026-09-23 00:01	52.14	OK
3687	2026-09-23 00:02	52.81	OK	3688	2026-09-23 00:03	51.15	OK
3689	2026-09-23 00:04	52.04	OK	3690	2026-09-23 00:05	51.53	OK
3691	2026-09-23 00:06	51.12	OK	3692	2026-09-23 00:07	52.94	OK
3693	2026-09-23 00:08	51.66	OK	3694	2026-09-23 00:09	51.09	OK
3695	2026-09-23 00:10	51.10	OK	3696	2026-09-23 00:11	52.03	OK
3697	2026-09-23 00:12	51.98	OK	3698	2026-09-23 00:13	51.67	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3699	2026-09-23 00:14	50.57	OK	3700	2026-09-23 00:15	51.47	OK
3701	2026-09-23 00:16	51.09	OK	3702	2026-09-23 00:17	52.04	OK
3703	2026-09-23 00:18	52.39	OK	3704	2026-09-23 00:19	50.70	OK
3705	2026-09-23 00:20	52.01	OK	3706	2026-09-23 00:21	50.98	OK
3707	2026-09-23 00:22	51.33	OK	3708	2026-09-23 00:23	51.51	OK
3709	2026-09-23 00:24	50.32	OK	3710	2026-09-23 00:25	51.34	OK
3711	2026-09-23 00:26	53.51	OK	3712	2026-09-23 00:27	50.94	OK
3713	2026-09-23 00:28	51.04	OK	3714	2026-09-23 00:29	52.51	OK
3715	2026-09-23 00:30	49.63	OK	3716	2026-09-23 00:31	51.87	OK
3717	2026-09-23 00:32	50.50	OK	3718	2026-09-23 00:33	51.05	OK
3719	2026-09-23 00:34	50.99	OK	3720	2026-09-23 00:35	52.04	OK
3721	2026-09-23 00:36	50.48	OK	3722	2026-09-23 00:37	51.03	OK
3723	2026-09-23 00:38	48.64	OK	3724	2026-09-23 00:39	50.87	OK
3725	2026-09-23 00:40	48.89	OK	3726	2026-09-23 00:41	50.40	OK
3727	2026-09-23 00:42	49.91	OK	3728	2026-09-23 00:43	50.56	OK
3729	2026-09-23 00:44	51.71	OK	3730	2026-09-23 00:45	52.17	OK
3731	2026-09-23 00:46	50.85	OK	3732	2026-09-23 00:47	50.42	OK
3733	2026-09-23 00:48	51.32	OK	3734	2026-09-23 00:49	51.13	OK
3735	2026-09-23 00:50	52.38	OK	3736	2026-09-23 00:51	51.36	OK
3737	2026-09-23 00:52	52.25	OK	3738	2026-09-23 00:53	52.82	OK
3739	2026-09-23 00:54	51.98	OK	3740	2026-09-23 00:55	52.75	OK
3741	2026-09-23 00:56	50.13	OK	3742	2026-09-23 00:57	51.01	OK
3743	2026-09-23 00:58	51.60	OK	3744	2026-09-23 00:59	51.90	OK
3745	2026-09-23 01:00	49.45	OK	3746	2026-09-23 01:01	49.03	OK
3747	2026-09-23 01:02	49.47	OK	3748	2026-09-23 01:03	51.51	OK
3749	2026-09-23 01:04	50.98	OK	3750	2026-09-23 01:05	51.39	OK
3751	2026-09-23 01:06	51.23	OK	3752	2026-09-23 01:07	51.22	OK
3753	2026-09-23 01:08	51.90	OK	3754	2026-09-23 01:09	51.01	OK
3755	2026-09-23 01:10	51.78	OK	3756	2026-09-23 01:11	52.21	OK
3757	2026-09-23 01:12	51.33	OK	3758	2026-09-23 01:13	52.06	OK
3759	2026-09-23 01:14	49.46	OK	3760	2026-09-23 01:15	49.99	OK
3761	2026-09-23 01:16	48.00	OK	3762	2026-09-23 01:17	49.77	OK
3763	2026-09-23 01:18	51.76	OK	3764	2026-09-23 01:19	50.14	OK
3765	2026-09-23 01:20	51.00	OK	3766	2026-09-23 01:21	50.38	OK
3767	2026-09-23 01:22	50.28	OK	3768	2026-09-23 01:23	52.10	OK
3769	2026-09-23 01:24	53.00	OK	3770	2026-09-23 01:25	51.53	OK
3771	2026-09-23 01:26	51.91	OK	3772	2026-09-23 01:27	49.08	OK
3773	2026-09-23 01:28	51.47	OK	3774	2026-09-23 01:29	49.72	OK
3775	2026-09-23 01:30	52.00	OK	3776	2026-09-23 01:31	50.18	OK
3777	2026-09-23 01:32	51.72	OK	3778	2026-09-23 01:33	49.47	OK
3779	2026-09-23 01:34	49.56	OK	3780	2026-09-23 01:35	51.37	OK
3781	2026-09-23 01:36	50.97	OK	3782	2026-09-23 01:37	49.78	OK
3783	2026-09-23 01:38	51.79	OK	3784	2026-09-23 01:39	51.03	OK
3785	2026-09-23 01:40	50.90	OK	3786	2026-09-23 01:41	51.36	OK
3787	2026-09-23 01:42	50.15	OK	3788	2026-09-23 01:43	51.90	OK
3789	2026-09-23 01:44	49.83	OK	3790	2026-09-23 01:45	50.05	OK
3791	2026-09-23 01:46	50.13	OK	3792	2026-09-23 01:47	49.98	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3793	2026-09-23 01:48	49.85	OK	3794	2026-09-23 01:49	51.44	OK
3795	2026-09-23 01:50	49.62	OK	3796	2026-09-23 01:51	49.22	OK
3797	2026-09-23 01:52	50.27	OK	3798	2026-09-23 01:53	49.99	OK
3799	2026-09-23 01:54	50.89	OK	3800	2026-09-23 01:55	50.53	OK
3801	2026-09-23 01:56	50.14	OK	3802	2026-09-23 01:57	51.47	OK
3803	2026-09-23 01:58	50.68	OK	3804	2026-09-23 01:59	49.39	OK
3805	2026-09-23 02:00	49.90	OK	3806	2026-09-23 02:01	49.79	OK
3807	2026-09-23 02:02	49.69	OK	3808	2026-09-23 02:03	50.20	OK
3809	2026-09-23 02:04	50.65	OK	3810	2026-09-23 02:05	51.02	OK
3811	2026-09-23 02:06	51.41	OK	3812	2026-09-23 02:07	48.89	OK
3813	2026-09-23 02:08	49.41	OK	3814	2026-09-23 02:09	52.85	OK
3815	2026-09-23 02:10	49.64	OK	3816	2026-09-23 02:11	49.18	OK
3817	2026-09-23 02:12	51.46	OK	3818	2026-09-23 02:13	49.95	OK
3819	2026-09-23 02:14	51.14	OK	3820	2026-09-23 02:15	49.68	OK
3821	2026-09-23 02:16	51.22	OK	3822	2026-09-23 02:17	48.35	OK
3823	2026-09-23 02:18	50.21	OK	3824	2026-09-23 02:19	52.18	OK
3825	2026-09-23 02:20	51.22	OK	3826	2026-09-23 02:21	50.86	OK
3827	2026-09-23 02:22	50.56	OK	3828	2026-09-23 02:23	50.89	OK
3829	2026-09-23 02:24	50.64	OK	3830	2026-09-23 02:25	50.86	OK
3831	2026-09-23 02:26	50.74	OK	3832	2026-09-23 02:27	50.92	OK
3833	2026-09-23 02:28	48.67	OK	3834	2026-09-23 02:29	51.05	OK
3835	2026-09-23 02:30	49.29	OK	3836	2026-09-23 02:31	51.28	OK
3837	2026-09-23 02:32	48.89	OK	3838	2026-09-23 02:33	50.98	OK
3839	2026-09-23 02:34	52.81	OK	3840	2026-09-23 02:35	50.45	OK
3841	2026-09-23 02:36	51.29	OK	3842	2026-09-23 02:37	50.64	OK
3843	2026-09-23 02:38	48.75	OK	3844	2026-09-23 02:39	50.40	OK
3845	2026-09-23 02:40	49.79	OK	3846	2026-09-23 02:41	50.17	OK
3847	2026-09-23 02:42	50.54	OK	3848	2026-09-23 02:43	49.13	OK
3849	2026-09-23 02:44	49.94	OK	3850	2026-09-23 02:45	50.57	OK
3851	2026-09-23 02:46	50.50	OK	3852	2026-09-23 02:47	51.57	OK
3853	2026-09-23 02:48	51.16	OK	3854	2026-09-23 02:49	51.21	OK
3855	2026-09-23 02:50	52.12	OK	3856	2026-09-23 02:51	50.88	OK
3857	2026-09-23 02:52	49.88	OK	3858	2026-09-23 02:53	50.31	OK
3859	2026-09-23 02:54	49.61	OK	3860	2026-09-23 02:55	50.89	OK
3861	2026-09-23 02:56	50.22	OK	3862	2026-09-23 02:57	48.92	OK
3863	2026-09-23 02:58	51.44	OK	3864	2026-09-23 02:59	49.20	OK
3865	2026-09-23 03:00	49.61	OK	3866	2026-09-23 03:01	49.54	OK
3867	2026-09-23 03:02	50.80	OK	3868	2026-09-23 03:03	51.83	OK
3869	2026-09-23 03:04	50.82	OK	3870	2026-09-23 03:05	49.79	OK
3871	2026-09-23 03:06	50.82	OK	3872	2026-09-23 03:07	49.84	OK
3873	2026-09-23 03:08	50.12	OK	3874	2026-09-23 03:09	49.48	OK
3875	2026-09-23 03:10	49.55	OK	3876	2026-09-23 03:11	51.74	OK
3877	2026-09-23 03:12	49.66	OK	3878	2026-09-23 03:13	49.28	OK
3879	2026-09-23 03:14	50.16	OK	3880	2026-09-23 03:15	50.82	OK
3881	2026-09-23 03:16	49.14	OK	3882	2026-09-23 03:17	49.13	OK
3883	2026-09-23 03:18	51.08	OK	3884	2026-09-23 03:19	51.73	OK
3885	2026-09-23 03:20	50.16	OK	3886	2026-09-23 03:21	49.07	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3887	2026-09-23 03:22	49.61	OK	3888	2026-09-23 03:23	50.77	OK
3889	2026-09-23 03:24	50.53	OK	3890	2026-09-23 03:25	48.83	OK
3891	2026-09-23 03:26	49.39	OK	3892	2026-09-23 03:27	50.93	OK
3893	2026-09-23 03:28	51.74	OK	3894	2026-09-23 03:29	50.70	OK
3895	2026-09-23 03:30	50.18	OK	3896	2026-09-23 03:31	48.80	OK
3897	2026-09-23 03:32	51.00	OK	3898	2026-09-23 03:33	51.24	OK
3899	2026-09-23 03:34	48.68	OK	3900	2026-09-23 03:35	50.78	OK
3901	2026-09-23 03:36	51.20	OK	3902	2026-09-23 03:37	49.51	OK
3903	2026-09-23 03:38	50.26	OK	3904	2026-09-23 03:39	49.82	OK
3905	2026-09-23 03:40	48.75	OK	3906	2026-09-23 03:41	49.34	OK
3907	2026-09-23 03:42	50.42	OK	3908	2026-09-23 03:43	50.98	OK
3909	2026-09-23 03:44	48.12	OK	3910	2026-09-23 03:45	50.01	OK
3911	2026-09-23 03:46	49.56	OK	3912	2026-09-23 03:47	50.26	OK
3913	2026-09-23 03:48	49.93	OK	3914	2026-09-23 03:49	49.70	OK
3915	2026-09-23 03:50	51.35	OK	3916	2026-09-23 03:51	50.91	OK
3917	2026-09-23 03:52	49.10	OK	3918	2026-09-23 03:53	50.59	OK
3919	2026-09-23 03:54	49.26	OK	3920	2026-09-23 03:55	50.18	OK
3921	2026-09-23 03:56	49.91	OK	3922	2026-09-23 03:57	50.40	OK
3923	2026-09-23 03:58	52.10	OK	3924	2026-09-23 03:59	50.31	OK
3925	2026-09-23 04:00	48.11	OK	3926	2026-09-23 04:01	49.78	OK
3927	2026-09-23 04:02	52.59	OK	3928	2026-09-23 04:03	51.16	OK
3929	2026-09-23 04:04	48.86	OK	3930	2026-09-23 04:05	50.25	OK
3931	2026-09-23 04:06	49.34	OK	3932	2026-09-23 04:07	49.74	OK
3933	2026-09-23 04:08	51.87	OK	3934	2026-09-23 04:09	50.50	OK
3935	2026-09-23 04:10	51.12	OK	3936	2026-09-23 04:11	50.62	OK
3937	2026-09-23 04:12	51.47	OK	3938	2026-09-23 04:13	48.98	OK
3939	2026-09-23 04:14	49.72	OK	3940	2026-09-23 04:15	51.06	OK
3941	2026-09-23 04:16	51.51	OK	3942	2026-09-23 04:17	50.35	OK
3943	2026-09-23 04:18	50.18	OK	3944	2026-09-23 04:19	49.85	OK
3945	2026-09-23 04:20	51.97	OK	3946	2026-09-23 04:21	50.06	OK
3947	2026-09-23 04:22	49.94	OK	3948	2026-09-23 04:23	50.12	OK
3949	2026-09-23 04:24	49.82	OK	3950	2026-09-23 04:25	49.77	OK
3951	2026-09-23 04:26	49.69	OK	3952	2026-09-23 04:27	51.76	OK
3953	2026-09-23 04:28	49.61	OK	3954	2026-09-23 04:29	49.72	OK
3955	2026-09-23 04:30	51.38	OK	3956	2026-09-23 04:31	52.23	OK
3957	2026-09-23 04:32	49.78	OK	3958	2026-09-23 04:33	49.38	OK
3959	2026-09-23 04:34	50.23	OK	3960	2026-09-23 04:35	49.77	OK
3961	2026-09-23 04:36	47.81	OK	3962	2026-09-23 04:37	49.63	OK
3963	2026-09-23 04:38	49.12	OK	3964	2026-09-23 04:39	52.76	OK
3965	2026-09-23 04:40	50.93	OK	3966	2026-09-23 04:41	51.38	OK
3967	2026-09-23 04:42	50.75	OK	3968	2026-09-23 04:43	51.58	OK
3969	2026-09-23 04:44	48.02	OK	3970	2026-09-23 04:45	50.27	OK
3971	2026-09-23 04:46	49.51	OK	3972	2026-09-23 04:47	48.81	OK
3973	2026-09-23 04:48	49.60	OK	3974	2026-09-23 04:49	51.45	OK
3975	2026-09-23 04:50	48.94	OK	3976	2026-09-23 04:51	49.58	OK
3977	2026-09-23 04:52	50.30	OK	3978	2026-09-23 04:53	50.12	OK
3979	2026-09-23 04:54	49.95	OK	3980	2026-09-23 04:55	49.73	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3981	2026-09-23 04:56	51.86	OK	3982	2026-09-23 04:57	51.56	OK
3983	2026-09-23 04:58	49.74	OK	3984	2026-09-23 04:59	50.98	OK
3985	2026-09-23 05:00	51.08	OK	3986	2026-09-23 05:01	52.25	OK
3987	2026-09-23 05:02	49.45	OK	3988	2026-09-23 05:03	49.97	OK
3989	2026-09-23 05:04	50.22	OK	3990	2026-09-23 05:05	52.17	OK
3991	2026-09-23 05:06	48.59	OK	3992	2026-09-23 05:07	50.00	OK
3993	2026-09-23 05:08	50.67	OK	3994	2026-09-23 05:09	51.20	OK
3995	2026-09-23 05:10	52.42	OK	3996	2026-09-23 05:11	51.20	OK
3997	2026-09-23 05:12	49.33	OK	3998	2026-09-23 05:13	49.31	OK
3999	2026-09-23 05:14	48.65	OK	4000	2026-09-23 05:15	50.35	OK
4001	2026-09-23 05:16	50.48	OK	4002	2026-09-23 05:17	51.19	OK
4003	2026-09-23 05:18	50.48	OK	4004	2026-09-23 05:19	48.99	OK
4005	2026-09-23 05:20	52.60	OK	4006	2026-09-23 05:21	50.00	OK
4007	2026-09-23 05:22	51.20	OK	4008	2026-09-23 05:23	51.88	OK
4009	2026-09-23 05:24	51.52	OK	4010	2026-09-23 05:25	51.81	OK
4011	2026-09-23 05:26	51.56	OK	4012	2026-09-23 05:27	50.17	OK
4013	2026-09-23 05:28	48.74	OK	4014	2026-09-23 05:29	50.64	OK
4015	2026-09-23 05:30	49.25	OK	4016	2026-09-23 05:31	50.60	OK
4017	2026-09-23 05:32	49.59	OK	4018	2026-09-23 05:33	51.06	OK
4019	2026-09-23 05:34	50.47	OK	4020	2026-09-23 05:35	50.84	OK
4021	2026-09-23 05:36	49.21	OK	4022	2026-09-23 05:37	51.34	OK
4023	2026-09-23 05:38	53.48	OK	4024	2026-09-23 05:39	49.94	OK
4025	2026-09-23 05:40	50.67	OK	4026	2026-09-23 05:41	51.04	OK
4027	2026-09-23 05:42	51.07	OK	4028	2026-09-23 05:43	50.28	OK
4029	2026-09-23 05:44	50.19	OK	4030	2026-09-23 05:45	53.25	OK
4031	2026-09-23 05:46	50.50	OK	4032	2026-09-23 05:47	50.89	OK
4033	2026-09-23 05:48	52.40	OK	4034	2026-09-23 05:49	51.91	OK
4035	2026-09-23 05:50	49.57	OK	4036	2026-09-23 05:51	51.37	OK
4037	2026-09-23 05:52	51.18	OK	4038	2026-09-23 05:53	50.86	OK
4039	2026-09-23 05:54	51.50	OK	4040	2026-09-23 05:55	51.23	OK
4041	2026-09-23 05:56	49.83	OK	4042	2026-09-23 05:57	51.29	OK
4043	2026-09-23 05:58	51.38	OK	4044	2026-09-23 05:59	50.39	OK
4045	2026-09-23 06:00	51.56	OK	4046	2026-09-23 06:01	50.18	OK
4047	2026-09-23 06:02	50.20	OK	4048	2026-09-23 06:03	50.51	OK
4049	2026-09-23 06:04	51.27	OK	4050	2026-09-23 06:05	51.52	OK
4051	2026-09-23 06:06	51.54	OK	4052	2026-09-23 06:07	52.33	OK
4053	2026-09-23 06:08	51.03	OK	4054	2026-09-23 06:09	50.60	OK
4055	2026-09-23 06:10	52.32	OK	4056	2026-09-23 06:11	51.30	OK
4057	2026-09-23 06:12	49.76	OK	4058	2026-09-23 06:13	51.28	OK
4059	2026-09-23 06:14	50.36	OK	4060	2026-09-23 06:15	51.63	OK
4061	2026-09-23 06:16	50.87	OK	4062	2026-09-23 06:17	53.09	OK
4063	2026-09-23 06:18	52.94	OK	4064	2026-09-23 06:19	49.74	OK
4065	2026-09-23 06:20	51.00	OK	4066	2026-09-23 06:21	51.30	OK
4067	2026-09-23 06:22	49.49	OK	4068	2026-09-23 06:23	49.33	OK
4069	2026-09-23 06:24	51.53	OK	4070	2026-09-23 06:25	50.07	OK
4071	2026-09-23 06:26	52.68	OK	4072	2026-09-23 06:27	52.49	OK
4073	2026-09-23 06:28	50.14	OK	4074	2026-09-23 06:29	53.01	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4075	2026-09-23 06:30	51.05	OK	4076	2026-09-23 06:31	50.87	OK
4077	2026-09-23 06:32	51.69	OK	4078	2026-09-23 06:33	51.47	OK
4079	2026-09-23 06:34	50.80	OK	4080	2026-09-23 06:35	52.07	OK
4081	2026-09-23 06:36	52.10	OK	4082	2026-09-23 06:37	50.46	OK
4083	2026-09-23 06:38	51.10	OK	4084	2026-09-23 06:39	51.40	OK
4085	2026-09-23 06:40	51.50	OK	4086	2026-09-23 06:41	52.59	OK
4087	2026-09-23 06:42	51.73	OK	4088	2026-09-23 06:43	51.92	OK
4089	2026-09-23 06:44	51.99	OK	4090	2026-09-23 06:45	53.04	OK
4091	2026-09-23 06:46	49.43	OK	4092	2026-09-23 06:47	50.21	OK
4093	2026-09-23 06:48	50.12	OK	4094	2026-09-23 06:49	50.36	OK
4095	2026-09-23 06:50	51.51	OK	4096	2026-09-23 06:51	51.44	OK
4097	2026-09-23 06:52	50.86	OK	4098	2026-09-23 06:53	51.04	OK
4099	2026-09-23 06:54	52.46	OK	4100	2026-09-23 06:55	53.66	OK
4101	2026-09-23 06:56	52.46	OK	4102	2026-09-23 06:57	50.82	OK
4103	2026-09-23 06:58	50.64	OK	4104	2026-09-23 06:59	51.39	OK
4105	2026-09-23 07:00	51.89	OK	4106	2026-09-23 07:01	54.31	OK
4107	2026-09-23 07:02	51.47	OK	4108	2026-09-23 07:03	50.43	OK
4109	2026-09-23 07:04	50.32	OK	4110	2026-09-23 07:05	51.03	OK
4111	2026-09-23 07:06	51.88	OK	4112	2026-09-23 07:07	52.38	OK
4113	2026-09-23 07:08	52.32	OK	4114	2026-09-23 07:09	52.91	OK
4115	2026-09-23 07:10	51.83	OK	4116	2026-09-23 07:11	51.79	OK
4117	2026-09-23 07:12	51.32	OK	4118	2026-09-23 07:13	52.65	OK
4119	2026-09-23 07:14	52.32	OK	4120	2026-09-23 07:15	53.78	OK
4121	2026-09-23 07:16	52.84	OK	4122	2026-09-23 07:17	53.27	OK
4123	2026-09-23 07:18	52.41	OK	4124	2026-09-23 07:19	52.47	OK
4125	2026-09-23 07:20	49.90	OK	4126	2026-09-23 07:21	51.19	OK
4127	2026-09-23 07:22	53.31	OK	4128	2026-09-23 07:23	51.34	OK
4129	2026-09-23 07:24	53.74	OK	4130	2026-09-23 07:25	52.26	OK
4131	2026-09-23 07:26	52.90	OK	4132	2026-09-23 07:27	53.52	OK
4133	2026-09-23 07:28	51.32	OK	4134	2026-09-23 07:29	52.53	OK
4135	2026-09-23 07:30	52.42	OK	4136	2026-09-23 07:31	52.16	OK
4137	2026-09-23 07:32	53.97	OK	4138	2026-09-23 07:33	52.10	OK
4139	2026-09-23 07:34	51.88	OK	4140	2026-09-23 07:35	52.23	OK
4141	2026-09-23 07:36	51.71	OK	4142	2026-09-23 07:37	54.63	OK
4143	2026-09-23 07:38	52.69	OK	4144	2026-09-23 07:39	53.23	OK
4145	2026-09-23 07:40	54.22	OK	4146	2026-09-23 07:41	51.07	OK
4147	2026-09-23 07:42	52.43	OK	4148	2026-09-23 07:43	53.67	OK
4149	2026-09-23 07:44	50.29	OK	4150	2026-09-23 07:45	52.68	OK
4151	2026-09-23 07:46	54.33	OK	4152	2026-09-23 07:47	54.19	OK
4153	2026-09-23 07:48	53.52	OK	4154	2026-09-23 07:49	50.71	OK
4155	2026-09-23 07:50	52.76	OK	4156	2026-09-23 07:51	53.11	OK
4157	2026-09-23 07:52	52.75	OK	4158	2026-09-23 07:53	53.81	OK
4159	2026-09-23 07:54	52.63	OK	4160	2026-09-23 07:55	52.31	OK
4161	2026-09-23 07:56	55.72	OK	4162	2026-09-23 07:57	54.29	OK
4163	2026-09-23 07:58	51.62	OK	4164	2026-09-23 07:59	54.00	OK
4165	2026-09-23 08:00	51.04	OK	4166	2026-09-23 08:01	52.27	OK
4167	2026-09-23 08:02	52.53	OK	4168	2026-09-23 08:03	52.65	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4169	2026-09-23 08:04	52.64	OK	4170	2026-09-23 08:05	52.27	OK
4171	2026-09-23 08:06	50.69	OK	4172	2026-09-23 08:07	53.41	OK
4173	2026-09-23 08:08	52.58	OK	4174	2026-09-23 08:09	54.13	OK
4175	2026-09-23 08:10	53.37	OK	4176	2026-09-23 08:11	54.26	OK
4177	2026-09-23 08:12	54.85	OK	4178	2026-09-23 08:13	53.98	OK
4179	2026-09-23 08:14	53.88	OK	4180	2026-09-23 08:15	51.94	OK
4181	2026-09-23 08:16	53.03	OK	4182	2026-09-23 08:17	53.00	OK
4183	2026-09-23 08:18	53.60	OK	4184	2026-09-23 08:19	52.05	OK
4185	2026-09-23 08:20	53.87	OK	4186	2026-09-23 08:21	53.10	OK
4187	2026-09-23 08:22	53.28	OK	4188	2026-09-23 08:23	52.49	OK
4189	2026-09-23 08:24	54.42	OK	4190	2026-09-23 08:25	50.91	OK
4191	2026-09-23 08:26	51.15	OK	4192	2026-09-23 08:27	54.16	OK
4193	2026-09-23 08:28	52.98	OK	4194	2026-09-23 08:29	54.01	OK
4195	2026-09-23 08:30	54.12	OK	4196	2026-09-23 08:31	53.35	OK
4197	2026-09-23 08:32	54.27	OK	4198	2026-09-23 08:33	52.77	OK
4199	2026-09-23 08:34	53.82	OK	4200	2026-09-23 08:35	53.78	OK
4201	2026-09-23 08:36	53.89	OK	4202	2026-09-23 08:37	52.56	OK
4203	2026-09-23 08:38	53.58	OK	4204	2026-09-23 08:39	53.04	OK
4205	2026-09-23 08:40	53.35	OK	4206	2026-09-23 08:41	55.67	OK
4207	2026-09-23 08:42	53.91	OK	4208	2026-09-23 08:43	55.76	OK
4209	2026-09-23 08:44	52.67	OK	4210	2026-09-23 08:45	55.14	OK
4211	2026-09-23 08:46	53.96	OK	4212	2026-09-23 08:47	53.62	OK
4213	2026-09-23 08:48	51.44	OK	4214	2026-09-23 08:49	53.56	OK
4215	2026-09-23 08:50	51.74	OK	4216	2026-09-23 08:51	52.66	OK
4217	2026-09-23 08:52	54.83	OK	4218	2026-09-23 08:53	52.81	OK
4219	2026-09-23 08:54	53.73	OK	4220	2026-09-23 08:55	53.38	OK
4221	2026-09-23 08:56	55.09	OK	4222	2026-09-23 08:57	54.34	OK
4223	2026-09-23 08:58	53.33	OK	4224	2026-09-23 08:59	53.72	OK
4225	2026-09-23 09:00	55.15	OK	4226	2026-09-23 09:01	55.01	OK
4227	2026-09-23 09:02	55.54	OK	4228	2026-09-23 09:03	53.74	OK
4229	2026-09-23 09:04	55.34	OK	4230	2026-09-23 09:05	54.11	OK
4231	2026-09-23 09:06	54.88	OK	4232	2026-09-23 09:07	54.01	OK
4233	2026-09-23 09:08	54.54	OK	4234	2026-09-23 09:09	55.99	OK
4235	2026-09-23 09:10	53.80	OK	4236	2026-09-23 09:11	53.98	OK
4237	2026-09-23 09:12	54.09	OK	4238	2026-09-23 09:13	53.67	OK
4239	2026-09-23 09:14	52.42	OK	4240	2026-09-23 09:15	53.07	OK
4241	2026-09-23 09:16	53.89	OK	4242	2026-09-23 09:17	54.18	OK
4243	2026-09-23 09:18	52.68	OK	4244	2026-09-23 09:19	56.23	OK
4245	2026-09-23 09:20	53.81	OK	4246	2026-09-23 09:21	56.22	OK
4247	2026-09-23 09:22	55.67	OK	4248	2026-09-23 09:23	52.72	OK
4249	2026-09-23 09:24	53.30	OK	4250	2026-09-23 09:25	56.37	OK
4251	2026-09-23 09:26	56.25	OK	4252	2026-09-23 09:27	55.32	OK
4253	2026-09-23 09:28	55.00	OK	4254	2026-09-23 09:29	54.71	OK
4255	2026-09-23 09:30	54.73	OK	4256	2026-09-23 09:31	53.86	OK
4257	2026-09-23 09:32	55.32	OK	4258	2026-09-23 09:33	54.81	OK
4259	2026-09-23 09:34	56.62	OK	4260	2026-09-23 09:35	54.67	OK
4261	2026-09-23 09:36	55.84	OK	4262	2026-09-23 09:37	56.62	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4263	2026-09-23 09:38	54.72	OK	4264	2026-09-23 09:39	55.31	OK
4265	2026-09-23 09:40	53.95	OK	4266	2026-09-23 09:41	53.20	OK
4267	2026-09-23 09:42	54.92	OK	4268	2026-09-23 09:43	55.47	OK
4269	2026-09-23 09:44	55.05	OK	4270	2026-09-23 09:45	55.46	OK
4271	2026-09-23 09:46	56.97	OK	4272	2026-09-23 09:47	55.22	OK
4273	2026-09-23 09:48	53.99	OK	4274	2026-09-23 09:49	56.40	OK
4275	2026-09-23 09:50	55.73	OK	4276	2026-09-23 09:51	53.84	OK
4277	2026-09-23 09:52	52.71	OK	4278	2026-09-23 09:53	55.80	OK
4279	2026-09-23 09:54	55.70	OK	4280	2026-09-23 09:55	57.46	OK
4281	2026-09-23 09:56	54.39	OK	4282	2026-09-23 09:57	57.51	OK
4283	2026-09-23 09:58	55.90	OK	4284	2026-09-23 09:59	54.75	OK
4285	2026-09-23 10:00	55.53	OK	4286	2026-09-23 10:01	54.23	OK
4287	2026-09-23 10:02	54.90	OK	4288	2026-09-23 10:03	55.97	OK
4289	2026-09-23 10:04	55.01	OK	4290	2026-09-23 10:05	55.61	OK
4291	2026-09-23 10:06	54.08	OK	4292	2026-09-23 10:07	56.35	OK
4293	2026-09-23 10:08	56.80	OK	4294	2026-09-23 10:09	55.87	OK
4295	2026-09-23 10:10	54.65	OK	4296	2026-09-23 10:11	56.91	OK
4297	2026-09-23 10:12	56.35	OK	4298	2026-09-23 10:13	54.61	OK
4299	2026-09-23 10:14	56.17	OK	4300	2026-09-23 10:15	56.86	OK
4301	2026-09-23 10:16	55.56	OK	4302	2026-09-23 10:17	56.47	OK
4303	2026-09-23 10:18	54.74	OK	4304	2026-09-23 10:19	54.77	OK
4305	2026-09-23 10:20	55.99	OK	4306	2026-09-23 10:21	56.41	OK
4307	2026-09-23 10:22	56.16	OK	4308	2026-09-23 10:23	55.97	OK
4309	2026-09-23 10:24	55.09	OK	4310	2026-09-23 10:25	56.90	OK
4311	2026-09-23 10:26	56.72	OK	4312	2026-09-23 10:27	56.29	OK
4313	2026-09-23 10:28	54.92	OK	4314	2026-09-23 10:29	55.97	OK
4315	2026-09-23 10:30	56.85	OK	4316	2026-09-23 10:31	54.82	OK
4317	2026-09-23 10:32	55.81	OK	4318	2026-09-23 10:33	55.76	OK
4319	2026-09-23 10:34	55.07	OK	4320	2026-09-23 10:35	55.33	OK
4321	2026-09-23 10:36	57.09	OK	4322	2026-09-23 10:37	55.45	OK
4323	2026-09-23 10:38	55.55	OK	4324	2026-09-23 10:39	57.71	OK
4325	2026-09-23 10:40	57.02	OK	4326	2026-09-23 10:41	56.29	OK
4327	2026-09-23 10:42	56.05	OK	4328	2026-09-23 10:43	55.95	OK
4329	2026-09-23 10:44	54.38	OK	4330	2026-09-23 10:45	56.65	OK
4331	2026-09-23 10:46	55.62	OK	4332	2026-09-23 10:47	55.91	OK
4333	2026-09-23 10:48	58.20	OK	4334	2026-09-23 10:49	57.82	OK
4335	2026-09-23 10:50	54.17	OK	4336	2026-09-23 10:51	57.29	OK
4337	2026-09-23 10:52	56.47	OK	4338	2026-09-23 10:53	56.34	OK
4339	2026-09-23 10:54	56.76	OK	4340	2026-09-23 10:55	56.56	OK
4341	2026-09-23 10:56	56.48	OK	4342	2026-09-23 10:57	55.86	OK
4343	2026-09-23 10:58	55.16	OK	4344	2026-09-23 10:59	56.48	OK
4345	2026-09-23 11:00	55.42	OK	4346	2026-09-23 11:01	56.02	OK
4347	2026-09-23 11:02	55.30	OK	4348	2026-09-23 11:03	55.98	OK
4349	2026-09-23 11:04	57.15	OK	4350	2026-09-23 11:05	58.22	OK
4351	2026-09-23 11:06	54.68	OK	4352	2026-09-23 11:07	55.76	OK
4353	2026-09-23 11:08	56.98	OK	4354	2026-09-23 11:09	56.54	OK
4355	2026-09-23 11:10	54.66	OK	4356	2026-09-23 11:11	55.79	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4357	2026-09-23 11:12	53.96	OK	4358	2026-09-23 11:13	57.62	OK
4359	2026-09-23 11:14	56.62	OK	4360	2026-09-23 11:15	55.03	OK
4361	2026-09-23 11:16	54.89	OK	4362	2026-09-23 11:17	54.15	OK
4363	2026-09-23 11:18	57.57	OK	4364	2026-09-23 11:19	54.91	OK
4365	2026-09-23 11:20	55.46	OK	4366	2026-09-23 11:21	56.59	OK
4367	2026-09-23 11:22	57.56	OK	4368	2026-09-23 11:23	56.44	OK
4369	2026-09-23 11:24	56.94	OK	4370	2026-09-23 11:25	54.94	OK
4371	2026-09-23 11:26	56.67	OK	4372	2026-09-23 11:27	56.48	OK
4373	2026-09-23 11:28	58.02	OK	4374	2026-09-23 11:29	57.20	OK
4375	2026-09-23 11:30	54.39	OK	4376	2026-09-23 11:31	58.31	OK
4377	2026-09-23 11:32	55.56	OK	4378	2026-09-23 11:33	58.04	OK
4379	2026-09-23 11:34	54.71	OK	4380	2026-09-23 11:35	58.48	OK
4381	2026-09-23 11:36	58.38	OK	4382	2026-09-23 11:37	58.68	OK
4383	2026-09-23 11:38	56.76	OK	4384	2026-09-23 11:39	56.51	OK
4385	2026-09-23 11:40	56.08	OK	4386	2026-09-23 11:41	55.79	OK
4387	2026-09-23 11:42	56.23	OK	4388	2026-09-23 11:43	56.94	OK
4389	2026-09-23 11:44	57.07	OK	4390	2026-09-23 11:45	58.56	OK
4391	2026-09-23 11:46	56.45	OK	4392	2026-09-23 11:47	58.68	OK
4393	2026-09-23 11:48	58.07	OK	4394	2026-09-23 11:49	56.79	OK
4395	2026-09-23 11:50	57.24	OK	4396	2026-09-23 11:51	56.53	OK
4397	2026-09-23 11:52	57.60	OK	4398	2026-09-23 11:53	55.88	OK
4399	2026-09-23 11:54	58.27	OK	4400	2026-09-23 11:55	58.97	OK
4401	2026-09-23 11:56	57.63	OK	4402	2026-09-23 11:57	58.20	OK
4403	2026-09-23 11:58	57.70	OK	4404	2026-09-23 11:59	57.22	OK
4405	2026-09-23 12:00	57.60	OK	4406	2026-09-23 12:01	58.11	OK
4407	2026-09-23 12:02	59.62	OK	4408	2026-09-23 12:03	56.13	OK
4409	2026-09-23 12:04	57.94	OK	4410	2026-09-23 12:05	59.24	OK
4411	2026-09-23 12:06	58.17	OK	4412	2026-09-23 12:07	57.81	OK
4413	2026-09-23 12:08	57.01	OK	4414	2026-09-23 12:09	57.18	OK
4415	2026-09-23 12:10	56.49	OK	4416	2026-09-23 12:11	57.57	OK
4417	2026-09-23 12:12	57.36	OK	4418	2026-09-23 12:13	58.29	OK
4419	2026-09-23 12:14	57.43	OK	4420	2026-09-23 12:15	58.26	OK
4421	2026-09-23 12:16	57.41	OK	4422	2026-09-23 12:17	57.92	OK
4423	2026-09-23 12:18	55.94	OK	4424	2026-09-23 12:19	58.83	OK
4425	2026-09-23 12:20	58.66	OK	4426	2026-09-23 12:21	56.57	OK
4427	2026-09-23 12:22	57.41	OK	4428	2026-09-23 12:23	58.23	OK
4429	2026-09-23 12:24	56.85	OK	4430	2026-09-23 12:25	57.38	OK
4431	2026-09-23 12:26	58.60	OK	4432	2026-09-23 12:27	57.76	OK
4433	2026-09-23 12:28	57.83	OK	4434	2026-09-23 12:29	55.94	OK
4435	2026-09-23 12:30	56.73	OK	4436	2026-09-23 12:31	56.22	OK
4437	2026-09-23 12:32	57.36	OK	4438	2026-09-23 12:33	56.69	OK
4439	2026-09-23 12:34	58.80	OK	4440	2026-09-23 12:35	58.18	OK
4441	2026-09-23 12:36	59.39	OK	4442	2026-09-23 12:37	57.98	OK
4443	2026-09-23 12:38	55.97	OK	4444	2026-09-23 12:39	59.12	OK
4445	2026-09-23 12:40	57.37	OK	4446	2026-09-23 12:41	58.29	OK
4447	2026-09-23 12:42	58.51	OK	4448	2026-09-23 12:43	59.17	OK
4449	2026-09-23 12:44	58.18	OK	4450	2026-09-23 12:45	56.27	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4451	2026-09-23 12:46	60.63	OK	4452	2026-09-23 12:47	58.46	OK
4453	2026-09-23 12:48	60.07	OK	4454	2026-09-23 12:49	55.71	OK
4455	2026-09-23 12:50	57.97	OK	4456	2026-09-23 12:51	57.81	OK
4457	2026-09-23 12:52	58.96	OK	4458	2026-09-23 12:53	56.58	OK
4459	2026-09-23 12:54	59.50	OK	4460	2026-09-23 12:55	59.03	OK
4461	2026-09-23 12:56	57.42	OK	4462	2026-09-23 12:57	57.68	OK
4463	2026-09-23 12:58	58.54	OK	4464	2026-09-23 12:59	57.41	OK
4465	2026-09-23 13:00	58.62	OK	4466	2026-09-23 13:01	56.61	OK
4467	2026-09-23 13:02	59.52	OK	4468	2026-09-23 13:03	57.70	OK
4469	2026-09-23 13:04	58.55	OK	4470	2026-09-23 13:05	57.95	OK
4471	2026-09-23 13:06	58.14	OK	4472	2026-09-23 13:07	58.37	OK
4473	2026-09-23 13:08	56.31	OK	4474	2026-09-23 13:09	56.00	OK
4475	2026-09-23 13:10	59.29	OK	4476	2026-09-23 13:11	57.15	OK
4477	2026-09-23 13:12	57.93	OK	4478	2026-09-23 13:13	59.12	OK
4479	2026-09-23 13:14	57.44	OK	4480	2026-09-23 13:15	60.14	OK
4481	2026-09-23 13:16	60.24	OK	4482	2026-09-23 13:17	57.67	OK
4483	2026-09-23 13:18	57.06	OK	4484	2026-09-23 13:19	58.89	OK
4485	2026-09-23 13:20	57.87	OK	4486	2026-09-23 13:21	56.71	OK
4487	2026-09-23 13:22	60.47	OK	4488	2026-09-23 13:23	58.38	OK
4489	2026-09-23 13:24	58.94	OK	4490	2026-09-23 13:25	58.56	OK
4491	2026-09-23 13:26	59.74	OK	4492	2026-09-23 13:27	57.43	OK
4493	2026-09-23 13:28	57.10	OK	4494	2026-09-23 13:29	59.50	OK
4495	2026-09-23 13:30	58.61	OK	4496	2026-09-23 13:31	58.91	OK
4497	2026-09-23 13:32	55.89	OK	4498	2026-09-23 13:33	59.60	OK
4499	2026-09-23 13:34	58.65	OK	4500	2026-09-23 13:35	60.23	OK
4501	2026-09-23 13:36	58.28	OK	4502	2026-09-23 13:37	58.86	OK
4503	2026-09-23 13:38	58.23	OK	4504	2026-09-23 13:39	57.59	OK
4505	2026-09-23 13:40	59.80	OK	4506	2026-09-23 13:41	57.62	OK
4507	2026-09-23 13:42	59.14	OK	4508	2026-09-23 13:43	57.45	OK
4509	2026-09-23 13:44	57.42	OK	4510	2026-09-23 13:45	57.94	OK
4511	2026-09-23 13:46	58.36	OK	4512	2026-09-23 13:47	58.73	OK
4513	2026-09-23 13:48	57.19	OK	4514	2026-09-23 13:49	56.39	OK
4515	2026-09-23 13:50	59.77	OK	4516	2026-09-23 13:51	57.72	OK
4517	2026-09-23 13:52	58.42	OK	4518	2026-09-23 13:53	58.74	OK
4519	2026-09-23 13:54	59.44	OK	4520	2026-09-23 13:55	57.06	OK
4521	2026-09-23 13:56	59.36	OK	4522	2026-09-23 13:57	57.34	OK
4523	2026-09-23 13:58	59.24	OK	4524	2026-09-23 13:59	57.64	OK
4525	2026-09-23 14:00	59.83	OK	4526	2026-09-23 14:01	57.84	OK
4527	2026-09-23 14:02	56.89	OK	4528	2026-09-23 14:03	59.20	OK
4529	2026-09-23 14:04	58.53	OK	4530	2026-09-23 14:05	59.74	OK
4531	2026-09-23 14:06	58.08	OK	4532	2026-09-23 14:07	56.74	OK
4533	2026-09-23 14:08	58.30	OK	4534	2026-09-23 14:09	59.51	OK
4535	2026-09-23 14:10	57.36	OK	4536	2026-09-23 14:11	58.82	OK
4537	2026-09-23 14:12	58.67	OK	4538	2026-09-23 14:13	59.35	OK
4539	2026-09-23 14:14	60.50	OK	4540	2026-09-23 14:15	59.71	OK
4541	2026-09-23 14:16	56.65	OK	4542	2026-09-23 14:17	58.22	OK
4543	2026-09-23 14:18	57.79	OK	4544	2026-09-23 14:19	58.92	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4545	2026-09-23 14:20	57.54	OK	4546	2026-09-23 14:21	57.63	OK
4547	2026-09-23 14:22	60.85	OK	4548	2026-09-23 14:23	57.16	OK
4549	2026-09-23 14:24	57.38	OK	4550	2026-09-23 14:25	60.03	OK
4551	2026-09-23 14:26	57.98	OK	4552	2026-09-23 14:27	57.99	OK
4553	2026-09-23 14:28	57.47	OK	4554	2026-09-23 14:29	60.32	OK
4555	2026-09-23 14:30	59.25	OK	4556	2026-09-23 14:31	60.75	OK
4557	2026-09-23 14:32	58.81	OK	4558	2026-09-23 14:33	57.51	OK
4559	2026-09-23 14:34	60.06	OK	4560	2026-09-23 14:35	58.59	OK
4561	2026-09-23 14:36	58.24	OK	4562	2026-09-23 14:37	57.27	OK
4563	2026-09-23 14:38	59.87	OK	4564	2026-09-23 14:39	59.33	OK
4565	2026-09-23 14:40	59.89	OK	4566	2026-09-23 14:41	58.15	OK
4567	2026-09-23 14:42	56.73	OK	4568	2026-09-23 14:43	58.48	OK
4569	2026-09-23 14:44	57.81	OK	4570	2026-09-23 14:45	57.22	OK
4571	2026-09-23 14:46	59.61	OK	4572	2026-09-23 14:47	59.65	OK
4573	2026-09-23 14:48	58.06	OK	4574	2026-09-23 14:49	58.11	OK
4575	2026-09-23 14:50	59.71	OK	4576	2026-09-23 14:51	58.37	OK
4577	2026-09-23 14:52	58.72	OK	4578	2026-09-23 14:53	60.30	OK
4579	2026-09-23 14:54	58.86	OK	4580	2026-09-23 14:55	59.86	OK
4581	2026-09-23 14:56	58.08	OK	4582	2026-09-23 14:57	57.72	OK
4583	2026-09-23 14:58	60.13	OK	4584	2026-09-23 14:59	57.88	OK
4585	2026-09-23 15:00	59.45	OK	4586	2026-09-23 15:01	60.80	OK
4587	2026-09-23 15:02	58.23	OK	4588	2026-09-23 15:03	59.06	OK
4589	2026-09-23 15:04	59.97	OK	4590	2026-09-23 15:05	57.48	OK
4591	2026-09-23 15:06	57.48	OK	4592	2026-09-23 15:07	56.94	OK
4593	2026-09-23 15:08	58.94	OK	4594	2026-09-23 15:09	58.32	OK
4595	2026-09-23 15:10	58.31	OK	4596	2026-09-23 15:11	56.68	OK
4597	2026-09-23 15:12	57.43	OK	4598	2026-09-23 15:13	56.69	OK
4599	2026-09-23 15:14	59.94	OK	4600	2026-09-23 15:15	57.47	OK
4601	2026-09-23 15:16	58.78	OK	4602	2026-09-23 15:17	58.33	OK
4603	2026-09-23 15:18	60.54	OK	4604	2026-09-23 15:19	58.58	OK
4605	2026-09-23 15:20	60.15	OK	4606	2026-09-23 15:21	60.60	OK
4607	2026-09-23 15:22	57.75	OK	4608	2026-09-23 15:23	58.58	OK
4609	2026-09-23 15:24	58.56	OK	4610	2026-09-23 15:25	59.26	OK
4611	2026-09-23 15:26	60.73	OK	4612	2026-09-23 15:27	60.24	OK
4613	2026-09-23 15:28	60.04	OK	4614	2026-09-23 15:29	56.46	OK
4615	2026-09-23 15:30	57.12	OK	4616	2026-09-23 15:31	57.79	OK
4617	2026-09-23 15:32	58.14	OK	4618	2026-09-23 15:33	60.41	OK
4619	2026-09-23 15:34	57.91	OK	4620	2026-09-23 15:35	58.68	OK
4621	2026-09-23 15:36	60.11	OK	4622	2026-09-23 15:37	59.26	OK
4623	2026-09-23 15:38	58.69	OK	4624	2026-09-23 15:39	57.16	OK
4625	2026-09-23 15:40	56.87	OK	4626	2026-09-23 15:41	58.09	OK
4627	2026-09-23 15:42	57.62	OK	4628	2026-09-23 15:43	60.26	OK
4629	2026-09-23 15:44	57.37	OK	4630	2026-09-23 15:45	57.35	OK
4631	2026-09-23 15:46	60.04	OK	4632	2026-09-23 15:47	59.53	OK
4633	2026-09-23 15:48	60.25	OK	4634	2026-09-23 15:49	57.12	OK
4635	2026-09-23 15:50	59.60	OK	4636	2026-09-23 15:51	58.93	OK
4637	2026-09-23 15:52	57.54	OK	4638	2026-09-23 15:53	58.39	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4639	2026-09-23 15:54	60.74	OK	4640	2026-09-23 15:55	57.69	OK
4641	2026-09-23 15:56	59.58	OK	4642	2026-09-23 15:57	58.24	OK
4643	2026-09-23 15:58	57.61	OK	4644	2026-09-23 15:59	59.11	OK
4645	2026-09-23 16:00	58.39	OK	4646	2026-09-23 16:01	58.88	OK
4647	2026-09-23 16:02	59.69	OK	4648	2026-09-23 16:03	59.00	OK
4649	2026-09-23 16:04	57.35	OK	4650	2026-09-23 16:05	60.74	OK
4651	2026-09-23 16:06	58.50	OK	4652	2026-09-23 16:07	58.52	OK
4653	2026-09-23 16:08	57.57	OK	4654	2026-09-23 16:09	59.28	OK
4655	2026-09-23 16:10	59.39	OK	4656	2026-09-23 16:11	60.32	OK
4657	2026-09-23 16:12	57.47	OK	4658	2026-09-23 16:13	58.91	OK
4659	2026-09-23 16:14	59.17	OK	4660	2026-09-23 16:15	57.66	OK
4661	2026-09-23 16:16	60.77	OK	4662	2026-09-23 16:17	56.77	OK
4663	2026-09-23 16:18	56.79	OK	4664	2026-09-23 16:19	59.15	OK
4665	2026-09-23 16:20	59.87	OK	4666	2026-09-23 16:21	59.50	OK
4667	2026-09-23 16:22	58.67	OK	4668	2026-09-23 16:23	59.52	OK
4669	2026-09-23 16:24	57.58	OK	4670	2026-09-23 16:25	58.05	OK
4671	2026-09-23 16:26	58.95	OK	4672	2026-09-23 16:27	58.20	OK
4673	2026-09-23 16:28	59.18	OK	4674	2026-09-23 16:29	57.30	OK
4675	2026-09-23 16:30	56.60	OK	4676	2026-09-23 16:31	58.49	OK
4677	2026-09-23 16:32	60.26	OK	4678	2026-09-23 16:33	58.29	OK
4679	2026-09-23 16:34	57.53	OK	4680	2026-09-23 16:35	60.69	OK
4681	2026-09-23 16:36	59.14	OK	4682	2026-09-23 16:37	59.11	OK
4683	2026-09-23 16:38	57.94	OK	4684	2026-09-23 16:39	56.91	OK
4685	2026-09-23 16:40	57.88	OK	4686	2026-09-23 16:41	59.29	OK
4687	2026-09-23 16:42	59.68	OK	4688	2026-09-23 16:43	61.09	OK
4689	2026-09-23 16:44	56.12	OK	4690	2026-09-23 16:45	58.72	OK
4691	2026-09-23 16:46	59.66	OK	4692	2026-09-23 16:47	57.69	OK
4693	2026-09-23 16:48	58.01	OK	4694	2026-09-23 16:49	60.89	OK
4695	2026-09-23 16:50	58.98	OK	4696	2026-09-23 16:51	59.06	OK
4697	2026-09-23 16:52	58.69	OK	4698	2026-09-23 16:53	59.14	OK
4699	2026-09-23 16:54	59.66	OK	4700	2026-09-23 16:55	57.94	OK
4701	2026-09-23 16:56	59.20	OK	4702	2026-09-23 16:57	59.75	OK
4703	2026-09-23 16:58	57.85	OK	4704	2026-09-23 16:59	59.39	OK
4705	2026-09-23 17:00	59.49	OK	4706	2026-09-23 17:01	58.58	OK
4707	2026-09-23 17:02	56.25	OK	4708	2026-09-23 17:03	60.03	OK
4709	2026-09-23 17:04	59.44	OK	4710	2026-09-23 17:05	59.04	OK
4711	2026-09-23 17:06	59.88	OK	4712	2026-09-23 17:07	59.15	OK
4713	2026-09-23 17:08	59.79	OK	4714	2026-09-23 17:09	57.78	OK
4715	2026-09-23 17:10	58.70	OK	4716	2026-09-23 17:11	59.42	OK
4717	2026-09-23 17:12	59.00	OK	4718	2026-09-23 17:13	58.16	OK
4719	2026-09-23 17:14	57.63	OK	4720	2026-09-23 17:15	58.68	OK
4721	2026-09-23 17:16	55.98	OK	4722	2026-09-23 17:17	57.70	OK
4723	2026-09-23 17:18	56.72	OK	4724	2026-09-23 17:19	58.20	OK
4725	2026-09-23 17:20	55.59	OK	4726	2026-09-23 17:21	59.17	OK
4727	2026-09-23 17:22	57.01	OK	4728	2026-09-23 17:23	57.35	OK
4729	2026-09-23 17:24	56.81	OK	4730	2026-09-23 17:25	57.00	OK
4731	2026-09-23 17:26	58.30	OK	4732	2026-09-23 17:27	58.12	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4733	2026-09-23 17:28	59.57	OK	4734	2026-09-23 17:29	57.24	OK
4735	2026-09-23 17:30	59.41	OK	4736	2026-09-23 17:31	57.85	OK
4737	2026-09-23 17:32	58.50	OK	4738	2026-09-23 17:33	57.52	OK
4739	2026-09-23 17:34	59.51	OK	4740	2026-09-23 17:35	58.50	OK
4741	2026-09-23 17:36	59.40	OK	4742	2026-09-23 17:37	60.30	OK
4743	2026-09-23 17:38	58.37	OK	4744	2026-09-23 17:39	60.78	OK
4745	2026-09-23 17:40	57.79	OK	4746	2026-09-23 17:41	56.41	OK
4747	2026-09-23 17:42	57.79	OK	4748	2026-09-23 17:43	59.11	OK
4749	2026-09-23 17:44	57.53	OK	4750	2026-09-23 17:45	57.96	OK
4751	2026-09-23 17:46	56.62	OK	4752	2026-09-23 17:47	58.29	OK
4753	2026-09-23 17:48	58.94	OK	4754	2026-09-23 17:49	57.95	OK
4755	2026-09-23 17:50	59.17	OK	4756	2026-09-23 17:51	56.05	OK
4757	2026-09-23 17:52	57.90	OK	4758	2026-09-23 17:53	56.64	OK
4759	2026-09-23 17:54	58.01	OK	4760	2026-09-23 17:55	58.71	OK
4761	2026-09-23 17:56	57.14	OK	4762	2026-09-23 17:57	58.02	OK
4763	2026-09-23 17:58	56.61	OK	4764	2026-09-23 17:59	56.86	OK
4765	2026-09-23 18:00	58.05	OK	4766	2026-09-23 18:01	58.38	OK
4767	2026-09-23 18:02	58.13	OK	4768	2026-09-23 18:03	59.33	OK
4769	2026-09-23 18:04	57.96	OK	4770	2026-09-23 18:05	56.46	OK
4771	2026-09-23 18:06	59.94	OK	4772	2026-09-23 18:07	57.87	OK
4773	2026-09-23 18:08	56.48	OK	4774	2026-09-23 18:09	58.51	OK
4775	2026-09-23 18:10	56.32	OK	4776	2026-09-23 18:11	59.35	OK
4777	2026-09-23 18:12	58.12	OK	4778	2026-09-23 18:13	55.50	OK
4779	2026-09-23 18:14	57.33	OK	4780	2026-09-23 18:15	58.12	OK
4781	2026-09-23 18:16	54.96	OK	4782	2026-09-23 18:17	59.17	OK
4783	2026-09-23 18:18	58.73	OK	4784	2026-09-23 18:19	57.82	OK
4785	2026-09-23 18:20	58.63	OK	4786	2026-09-23 18:21	58.65	OK
4787	2026-09-23 18:22	59.56	OK	4788	2026-09-23 18:23	58.78	OK
4789	2026-09-23 18:24	59.64	OK	4790	2026-09-23 18:25	58.15	OK
4791	2026-09-23 18:26	58.31	OK	4792	2026-09-23 18:27	58.16	OK
4793	2026-09-23 18:28	55.51	OK	4794	2026-09-23 18:29	56.64	OK
4795	2026-09-23 18:30	56.82	OK	4796	2026-09-23 18:31	55.57	OK
4797	2026-09-23 18:32	57.25	OK	4798	2026-09-23 18:33	56.48	OK
4799	2026-09-23 18:34	55.90	OK	4800	2026-09-23 18:35	57.66	OK
4801	2026-09-23 18:36	57.20	OK	4802	2026-09-23 18:37	58.58	OK
4803	2026-09-23 18:38	56.26	OK	4804	2026-09-23 18:39	55.94	OK
4805	2026-09-23 18:40	56.82	OK	4806	2026-09-23 18:41	57.17	OK
4807	2026-09-23 18:42	54.96	OK	4808	2026-09-23 18:43	57.22	OK
4809	2026-09-23 18:44	56.72	OK	4810	2026-09-23 18:45	58.92	OK
4811	2026-09-23 18:46	55.87	OK	4812	2026-09-23 18:47	58.20	OK
4813	2026-09-23 18:48	55.06	OK	4814	2026-09-23 18:49	58.65	OK
4815	2026-09-23 18:50	57.85	OK	4816	2026-09-23 18:51	58.28	OK
4817	2026-09-23 18:52	55.89	OK	4818	2026-09-23 18:53	57.58	OK
4819	2026-09-23 18:54	57.33	OK	4820	2026-09-23 18:55	55.73	OK
4821	2026-09-23 18:56	55.74	OK	4822	2026-09-23 18:57	56.11	OK
4823	2026-09-23 18:58	54.31	OK	4824	2026-09-23 18:59	57.54	OK
4825	2026-09-23 19:00	58.08	OK	4826	2026-09-23 19:01	55.72	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4827	2026-09-23 19:02	57.91	OK	4828	2026-09-23 19:03	58.48	OK
4829	2026-09-23 19:04	55.62	OK	4830	2026-09-23 19:05	57.07	OK
4831	2026-09-23 19:06	58.96	OK	4832	2026-09-23 19:07	56.99	OK
4833	2026-09-23 19:08	57.29	OK	4834	2026-09-23 19:09	57.55	OK
4835	2026-09-23 19:10	56.89	OK	4836	2026-09-23 19:11	56.54	OK
4837	2026-09-23 19:12	56.36	OK	4838	2026-09-23 19:13	57.08	OK
4839	2026-09-23 19:14	58.79	OK	4840	2026-09-23 19:15	57.73	OK
4841	2026-09-23 19:16	56.22	OK	4842	2026-09-23 19:17	58.46	OK
4843	2026-09-23 19:18	57.98	OK	4844	2026-09-23 19:19	57.90	OK
4845	2026-09-23 19:20	55.37	OK	4846	2026-09-23 19:21	58.05	OK
4847	2026-09-23 19:22	57.03	OK	4848	2026-09-23 19:23	54.85	OK
4849	2026-09-23 19:24	57.35	OK	4850	2026-09-23 19:25	58.15	OK
4851	2026-09-23 19:26	55.75	OK	4852	2026-09-23 19:27	55.99	OK
4853	2026-09-23 19:28	59.20	OK	4854	2026-09-23 19:29	54.18	OK
4855	2026-09-23 19:30	57.01	OK	4856	2026-09-23 19:31	54.15	OK
4857	2026-09-23 19:32	55.23	OK	4858	2026-09-23 19:33	57.22	OK
4859	2026-09-23 19:34	55.79	OK	4860	2026-09-23 19:35	55.58	OK
4861	2026-09-23 19:36	56.70	OK	4862	2026-09-23 19:37	56.50	OK
4863	2026-09-23 19:38	54.80	OK	4864	2026-09-23 19:39	55.38	OK
4865	2026-09-23 19:40	54.98	OK	4866	2026-09-23 19:41	58.27	OK
4867	2026-09-23 19:42	56.21	OK	4868	2026-09-23 19:43	55.99	OK
4869	2026-09-23 19:44	56.97	OK	4870	2026-09-23 19:45	56.96	OK
4871	2026-09-23 19:46	57.76	OK	4872	2026-09-23 19:47	56.03	OK
4873	2026-09-23 19:48	56.33	OK	4874	2026-09-23 19:49	53.83	OK
4875	2026-09-23 19:50	57.28	OK	4876	2026-09-23 19:51	56.81	OK
4877	2026-09-23 19:52	55.99	OK	4878	2026-09-23 19:53	56.57	OK
4879	2026-09-23 19:54	56.08	OK	4880	2026-09-23 19:55	56.01	OK
4881	2026-09-23 19:56	55.99	OK	4882	2026-09-23 19:57	54.97	OK
4883	2026-09-23 19:58	56.53	OK	4884	2026-09-23 19:59	54.56	OK
4885	2026-09-23 20:00	56.02	OK	4886	2026-09-23 20:01	56.16	OK
4887	2026-09-23 20:02	54.85	OK	4888	2026-09-23 20:03	57.01	OK
4889	2026-09-23 20:04	57.03	OK	4890	2026-09-23 20:05	55.05	OK
4891	2026-09-23 20:06	55.15	OK	4892	2026-09-23 20:07	55.84	OK
4893	2026-09-23 20:08	56.62	OK	4894	2026-09-23 20:09	57.92	OK
4895	2026-09-23 20:10	56.68	OK	4896	2026-09-23 20:11	56.17	OK
4897	2026-09-23 20:12	55.93	OK	4898	2026-09-23 20:13	56.11	OK
4899	2026-09-23 20:14	55.26	OK	4900	2026-09-23 20:15	55.57	OK
4901	2026-09-23 20:16	56.05	OK	4902	2026-09-23 20:17	56.06	OK
4903	2026-09-23 20:18	57.92	OK	4904	2026-09-23 20:19	55.42	OK
4905	2026-09-23 20:20	56.05	OK	4906	2026-09-23 20:21	57.20	OK
4907	2026-09-23 20:22	55.01	OK	4908	2026-09-23 20:23	53.44	OK
4909	2026-09-23 20:24	53.85	OK	4910	2026-09-23 20:25	55.79	OK
4911	2026-09-23 20:26	54.93	OK	4912	2026-09-23 20:27	56.39	OK
4913	2026-09-23 20:28	55.66	OK	4914	2026-09-23 20:29	55.80	OK
4915	2026-09-23 20:30	53.58	OK	4916	2026-09-23 20:31	53.18	OK
4917	2026-09-23 20:32	54.54	OK	4918	2026-09-23 20:33	55.58	OK
4919	2026-09-23 20:34	56.36	OK	4920	2026-09-23 20:35	55.95	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4921	2026-09-23 20:36	56.13	OK	4922	2026-09-23 20:37	55.79	OK
4923	2026-09-23 20:38	54.87	OK	4924	2026-09-23 20:39	55.51	OK
4925	2026-09-23 20:40	54.29	OK	4926	2026-09-23 20:41	55.91	OK
4927	2026-09-23 20:42	55.19	OK	4928	2026-09-23 20:43	54.52	OK
4929	2026-09-23 20:44	55.02	OK	4930	2026-09-23 20:45	54.85	OK
4931	2026-09-23 20:46	55.72	OK	4932	2026-09-23 20:47	53.45	OK
4933	2026-09-23 20:48	53.42	OK	4934	2026-09-23 20:49	53.95	OK
4935	2026-09-23 20:50	55.55	OK	4936	2026-09-23 20:51	54.16	OK
4937	2026-09-23 20:52	56.02	OK	4938	2026-09-23 20:53	55.14	OK
4939	2026-09-23 20:54	53.45	OK	4940	2026-09-23 20:55	52.64	OK
4941	2026-09-23 20:56	55.43	OK	4942	2026-09-23 20:57	56.63	OK
4943	2026-09-23 20:58	53.37	OK	4944	2026-09-23 20:59	55.51	OK
4945	2026-09-23 21:00	54.95	OK	4946	2026-09-23 21:01	54.85	OK
4947	2026-09-23 21:02	55.75	OK	4948	2026-09-23 21:03	54.82	OK
4949	2026-09-23 21:04	54.37	OK	4950	2026-09-23 21:05	53.31	OK
4951	2026-09-23 21:06	53.77	OK	4952	2026-09-23 21:07	55.99	OK
4953	2026-09-23 21:08	54.92	OK	4954	2026-09-23 21:09	56.51	OK
4955	2026-09-23 21:10	53.76	OK	4956	2026-09-23 21:11	56.25	OK
4957	2026-09-23 21:12	54.17	OK	4958	2026-09-23 21:13	56.25	OK
4959	2026-09-23 21:14	53.06	OK	4960	2026-09-23 21:15	54.09	OK
4961	2026-09-23 21:16	52.63	OK	4962	2026-09-23 21:17	53.29	OK
4963	2026-09-23 21:18	54.42	OK	4964	2026-09-23 21:19	54.09	OK
4965	2026-09-23 21:20	52.16	OK	4966	2026-09-23 21:21	53.64	OK
4967	2026-09-23 21:22	55.44	OK	4968	2026-09-23 21:23	53.31	OK
4969	2026-09-23 21:24	54.24	OK	4970	2026-09-23 21:25	54.98	OK
4971	2026-09-23 21:26	53.90	OK	4972	2026-09-23 21:27	55.24	OK
4973	2026-09-23 21:28	55.02	OK	4974	2026-09-23 21:29	54.28	OK
4975	2026-09-23 21:30	54.67	OK	4976	2026-09-23 21:31	53.87	OK
4977	2026-09-23 21:32	53.11	OK	4978	2026-09-23 21:33	54.46	OK
4979	2026-09-23 21:34	53.65	OK	4980	2026-09-23 21:35	54.59	OK
4981	2026-09-23 21:36	54.70	OK	4982	2026-09-23 21:37	54.22	OK
4983	2026-09-23 21:38	52.90	OK	4984	2026-09-23 21:39	53.88	OK
4985	2026-09-23 21:40	55.01	OK	4986	2026-09-23 21:41	54.09	OK
4987	2026-09-23 21:42	55.15	OK	4988	2026-09-23 21:43	54.72	OK
4989	2026-09-23 21:44	55.40	OK	4990	2026-09-23 21:45	54.37	OK
4991	2026-09-23 21:46	54.05	OK	4992	2026-09-23 21:47	53.96	OK
4993	2026-09-23 21:48	54.61	OK	4994	2026-09-23 21:49	53.43	OK
4995	2026-09-23 21:50	54.96	OK	4996	2026-09-23 21:51	55.29	OK
4997	2026-09-23 21:52	53.69	OK	4998	2026-09-23 21:53	52.24	OK
4999	2026-09-23 21:54	52.98	OK	5000	2026-09-23 21:55	54.63	OK
5001	2026-09-23 21:56	53.93	OK	5002	2026-09-23 21:57	55.08	OK
5003	2026-09-23 21:58	53.77	OK	5004	2026-09-23 21:59	52.93	OK
5005	2026-09-23 22:00	55.96	OK	5006	2026-09-23 22:01	52.56	OK
5007	2026-09-23 22:02	53.42	OK	5008	2026-09-23 22:03	53.48	OK
5009	2026-09-23 22:04	52.35	OK	5010	2026-09-23 22:05	52.81	OK
5011	2026-09-23 22:06	53.36	OK	5012	2026-09-23 22:07	54.58	OK
5013	2026-09-23 22:08	55.28	OK	5014	2026-09-23 22:09	54.11	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5015	2026-09-23 22:10	53.30	OK	5016	2026-09-23 22:11	52.80	OK
5017	2026-09-23 22:12	53.97	OK	5018	2026-09-23 22:13	51.81	OK
5019	2026-09-23 22:14	54.52	OK	5020	2026-09-23 22:15	54.26	OK
5021	2026-09-23 22:16	52.86	OK	5022	2026-09-23 22:17	53.41	OK
5023	2026-09-23 22:18	53.64	OK	5024	2026-09-23 22:19	53.44	OK
5025	2026-09-23 22:20	53.71	OK	5026	2026-09-23 22:21	53.26	OK
5027	2026-09-23 22:22	52.85	OK	5028	2026-09-23 22:23	54.09	OK
5029	2026-09-23 22:24	53.76	OK	5030	2026-09-23 22:25	54.93	OK
5031	2026-09-23 22:26	53.29	OK	5032	2026-09-23 22:27	53.96	OK
5033	2026-09-23 22:28	53.39	OK	5034	2026-09-23 22:29	53.00	OK
5035	2026-09-23 22:30	54.77	OK	5036	2026-09-23 22:31	53.35	OK
5037	2026-09-23 22:32	53.12	OK	5038	2026-09-23 22:33	52.85	OK
5039	2026-09-23 22:34	51.60	OK	5040	2026-09-23 22:35	50.80	OK
5041	2026-09-23 22:36	52.95	OK	5042	2026-09-23 22:37	52.80	OK
5043	2026-09-23 22:38	53.33	OK	5044	2026-09-23 22:39	53.56	OK
5045	2026-09-23 22:40	52.53	OK	5046	2026-09-23 22:41	51.56	OK
5047	2026-09-23 22:42	53.30	OK	5048	2026-09-23 22:43	53.64	OK
5049	2026-09-23 22:44	52.34	OK	5050	2026-09-23 22:45	51.33	OK
5051	2026-09-23 22:46	51.71	OK	5052	2026-09-23 22:47	51.67	OK
5053	2026-09-23 22:48	50.84	OK	5054	2026-09-23 22:49	53.34	OK
5055	2026-09-23 22:50	52.61	OK	5056	2026-09-23 22:51	51.79	OK
5057	2026-09-23 22:52	54.13	OK	5058	2026-09-23 22:53	52.58	OK
5059	2026-09-23 22:54	52.84	OK	5060	2026-09-23 22:55	51.97	OK
5061	2026-09-23 22:56	51.98	OK	5062	2026-09-23 22:57	53.68	OK
5063	2026-09-23 22:58	50.87	OK	5064	2026-09-23 22:59	51.91	OK
5065	2026-09-23 23:00	51.02	OK	5066	2026-09-23 23:01	54.91	OK
5067	2026-09-23 23:02	52.39	OK	5068	2026-09-23 23:03	52.05	OK
5069	2026-09-23 23:04	54.20	OK	5070	2026-09-23 23:05	52.03	OK
5071	2026-09-23 23:06	52.61	OK	5072	2026-09-23 23:07	51.24	OK
5073	2026-09-23 23:08	53.22	OK	5074	2026-09-23 23:09	51.94	OK
5075	2026-09-23 23:10	52.31	OK	5076	2026-09-23 23:11	52.48	OK
5077	2026-09-23 23:12	53.11	OK	5078	2026-09-23 23:13	52.56	OK
5079	2026-09-23 23:14	52.51	OK	5080	2026-09-23 23:15	51.54	OK
5081	2026-09-23 23:16	52.01	OK	5082	2026-09-23 23:17	52.72	OK
5083	2026-09-23 23:18	53.19	OK	5084	2026-09-23 23:19	53.78	OK
5085	2026-09-23 23:20	50.41	OK	5086	2026-09-23 23:21	53.71	OK
5087	2026-09-23 23:22	52.36	OK	5088	2026-09-23 23:23	52.52	OK
5089	2026-09-23 23:24	53.41	OK	5090	2026-09-23 23:25	52.49	OK
5091	2026-09-23 23:26	51.81	OK	5092	2026-09-23 23:27	52.57	OK
5093	2026-09-23 23:28	52.60	OK	5094	2026-09-23 23:29	52.96	OK
5095	2026-09-23 23:30	52.36	OK	5096	2026-09-23 23:31	54.08	OK
5097	2026-09-23 23:32	52.01	OK	5098	2026-09-23 23:33	53.12	OK
5099	2026-09-23 23:34	50.72	OK	5100	2026-09-23 23:35	51.75	OK
5101	2026-09-23 23:36	53.81	OK	5102	2026-09-23 23:37	54.98	OK
5103	2026-09-23 23:38	51.96	OK	5104	2026-09-23 23:39	50.59	OK
5105	2026-09-23 23:40	52.21	OK	5106	2026-09-23 23:41	52.13	OK
5107	2026-09-23 23:42	53.29	OK	5108	2026-09-23 23:43	51.58	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5109	2026-09-23 23:44	51.93	OK	5110	2026-09-23 23:45	51.03	OK
5111	2026-09-23 23:46	49.55	OK	5112	2026-09-23 23:47	50.93	OK
5113	2026-09-23 23:48	51.94	OK	5114	2026-09-23 23:49	51.41	OK
5115	2026-09-23 23:50	51.10	OK	5116	2026-09-23 23:51	53.49	OK
5117	2026-09-23 23:52	51.07	OK	5118	2026-09-23 23:53	52.10	OK
5119	2026-09-23 23:54	51.26	OK	5120	2026-09-23 23:55	50.78	OK
5121	2026-09-23 23:56	51.10	OK	5122	2026-09-23 23:57	51.09	OK
5123	2026-09-23 23:58	50.85	OK	5124	2026-09-23 23:59	49.57	OK
5125	2026-09-24 00:00	52.30	OK	5126	2026-09-24 00:01	53.61	OK
5127	2026-09-24 00:02	51.14	OK	5128	2026-09-24 00:03	51.80	OK
5129	2026-09-24 00:04	50.61	OK	5130	2026-09-24 00:05	49.75	OK
5131	2026-09-24 00:06	54.25	OK	5132	2026-09-24 00:07	50.52	OK
5133	2026-09-24 00:08	50.87	OK	5134	2026-09-24 00:09	51.53	OK
5135	2026-09-24 00:10	52.36	OK	5136	2026-09-24 00:11	51.44	OK
5137	2026-09-24 00:12	54.00	OK	5138	2026-09-24 00:13	49.27	OK
5139	2026-09-24 00:14	52.10	OK	5140	2026-09-24 00:15	51.42	OK
5141	2026-09-24 00:16	50.07	OK	5142	2026-09-24 00:17	51.58	OK
5143	2026-09-24 00:18	52.39	OK	5144	2026-09-24 00:19	50.51	OK
5145	2026-09-24 00:20	53.05	OK	5146	2026-09-24 00:21	52.48	OK
5147	2026-09-24 00:22	51.52	OK	5148	2026-09-24 00:23	52.65	OK
5149	2026-09-24 00:24	51.54	OK	5150	2026-09-24 00:25	53.13	OK
5151	2026-09-24 00:26	50.77	OK	5152	2026-09-24 00:27	49.93	OK
5153	2026-09-24 00:28	50.52	OK	5154	2026-09-24 00:29	52.58	OK
5155	2026-09-24 00:30	51.09	OK	5156	2026-09-24 00:31	52.20	OK
5157	2026-09-24 00:32	51.48	OK	5158	2026-09-24 00:33	51.83	OK
5159	2026-09-24 00:34	50.24	OK	5160	2026-09-24 00:35	50.93	OK
5161	2026-09-24 00:36	49.83	OK	5162	2026-09-24 00:37	50.74	OK
5163	2026-09-24 00:38	50.47	OK	5164	2026-09-24 00:39	52.07	OK
5165	2026-09-24 00:40	52.04	OK	5166	2026-09-24 00:41	49.94	OK
5167	2026-09-24 00:42	51.53	OK	5168	2026-09-24 00:43	50.67	OK
5169	2026-09-24 00:44	51.48	OK	5170	2026-09-24 00:45	50.50	OK
5171	2026-09-24 00:46	50.23	OK	5172	2026-09-24 00:47	50.29	OK
5173	2026-09-24 00:48	50.64	OK	5174	2026-09-24 00:49	51.68	OK
5175	2026-09-24 00:50	50.39	OK	5176	2026-09-24 00:51	51.11	OK
5177	2026-09-24 00:52	50.63	OK	5178	2026-09-24 00:53	52.56	OK
5179	2026-09-24 00:54	52.05	OK	5180	2026-09-24 00:55	50.98	OK
5181	2026-09-24 00:56	50.65	OK	5182	2026-09-24 00:57	51.93	OK
5183	2026-09-24 00:58	51.19	OK	5184	2026-09-24 00:59	52.52	OK
5185	2026-09-24 01:00	51.81	OK	5186	2026-09-24 01:01	49.23	OK
5187	2026-09-24 01:02	51.90	OK	5188	2026-09-24 01:03	51.77	OK
5189	2026-09-24 01:04	50.56	OK	5190	2026-09-24 01:05	50.71	OK
5191	2026-09-24 01:06	51.03	OK	5192	2026-09-24 01:07	48.87	OK
5193	2026-09-24 01:08	50.75	OK	5194	2026-09-24 01:09	50.74	OK
5195	2026-09-24 01:10	50.12	OK	5196	2026-09-24 01:11	49.97	OK
5197	2026-09-24 01:12	52.51	OK	5198	2026-09-24 01:13	51.36	OK
5199	2026-09-24 01:14	51.57	OK	5200	2026-09-24 01:15	50.31	OK
5201	2026-09-24 01:16	50.06	OK	5202	2026-09-24 01:17	52.15	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5203	2026-09-24 01:18	50.06	OK	5204	2026-09-24 01:19	52.27	OK
5205	2026-09-24 01:20	50.11	OK	5206	2026-09-24 01:21	51.63	OK
5207	2026-09-24 01:22	51.62	OK	5208	2026-09-24 01:23	50.81	OK
5209	2026-09-24 01:24	50.73	OK	5210	2026-09-24 01:25	51.07	OK
5211	2026-09-24 01:26	50.08	OK	5212	2026-09-24 01:27	49.36	OK
5213	2026-09-24 01:28	50.93	OK	5214	2026-09-24 01:29	51.03	OK
5215	2026-09-24 01:30	50.01	OK	5216	2026-09-24 01:31	52.06	OK
5217	2026-09-24 01:32	50.92	OK	5218	2026-09-24 01:33	50.47	OK
5219	2026-09-24 01:34	50.91	OK	5220	2026-09-24 01:35	51.98	OK
5221	2026-09-24 01:36	50.13	OK	5222	2026-09-24 01:37	50.35	OK
5223	2026-09-24 01:38	51.05	OK	5224	2026-09-24 01:39	50.96	OK
5225	2026-09-24 01:40	52.13	OK	5226	2026-09-24 01:41	51.27	OK
5227	2026-09-24 01:42	51.23	OK	5228	2026-09-24 01:43	50.06	OK
5229	2026-09-24 01:44	51.51	OK	5230	2026-09-24 01:45	49.65	OK
5231	2026-09-24 01:46	50.25	OK	5232	2026-09-24 01:47	51.41	OK
5233	2026-09-24 01:48	50.45	OK	5234	2026-09-24 01:49	50.77	OK
5235	2026-09-24 01:50	49.65	OK	5236	2026-09-24 01:51	50.79	OK
5237	2026-09-24 01:52	48.51	OK	5238	2026-09-24 01:53	51.14	OK
5239	2026-09-24 01:54	51.55	OK	5240	2026-09-24 01:55	50.84	OK
5241	2026-09-24 01:56	51.86	OK	5242	2026-09-24 01:57	50.26	OK
5243	2026-09-24 01:58	51.36	OK	5244	2026-09-24 01:59	50.03	OK
5245	2026-09-24 02:00	51.66	OK	5246	2026-09-24 02:01	50.74	OK
5247	2026-09-24 02:02	50.73	OK	5248	2026-09-24 02:03	50.00	OK
5249	2026-09-24 02:04	50.59	OK	5250	2026-09-24 02:05	48.97	OK
5251	2026-09-24 02:06	50.70	OK	5252	2026-09-24 02:07	52.10	OK
5253	2026-09-24 02:08	50.70	OK	5254	2026-09-24 02:09	51.13	OK
5255	2026-09-24 02:10	50.41	OK	5256	2026-09-24 02:11	51.53	OK
5257	2026-09-24 02:12	49.78	OK	5258	2026-09-24 02:13	50.06	OK
5259	2026-09-24 02:14	50.40	OK	5260	2026-09-24 02:15	49.88	OK
5261	2026-09-24 02:16	52.26	OK	5262	2026-09-24 02:17	49.22	OK
5263	2026-09-24 02:18	51.39	OK	5264	2026-09-24 02:19	50.90	OK
5265	2026-09-24 02:20	49.32	OK	5266	2026-09-24 02:21	50.23	OK
5267	2026-09-24 02:22	51.08	OK	5268	2026-09-24 02:23	49.89	OK
5269	2026-09-24 02:24	49.99	OK	5270	2026-09-24 02:25	50.57	OK
5271	2026-09-24 02:26	50.44	OK	5272	2026-09-24 02:27	49.01	OK
5273	2026-09-24 02:28	50.47	OK	5274	2026-09-24 02:29	50.46	OK
5275	2026-09-24 02:30	51.58	OK	5276	2026-09-24 02:31	48.95	OK
5277	2026-09-24 02:32	48.58	OK	5278	2026-09-24 02:33	50.87	OK
5279	2026-09-24 02:34	51.35	OK	5280	2026-09-24 02:35	52.33	OK
5281	2026-09-24 02:36	52.26	OK	5282	2026-09-24 02:37	50.01	OK
5283	2026-09-24 02:38	52.31	OK	5284	2026-09-24 02:39	51.74	OK
5285	2026-09-24 02:40	50.79	OK	5286	2026-09-24 02:41	48.98	OK
5287	2026-09-24 02:42	51.02	OK	5288	2026-09-24 02:43	50.58	OK
5289	2026-09-24 02:44	50.08	OK	5290	2026-09-24 02:45	50.06	OK
5291	2026-09-24 02:46	52.15	OK	5292	2026-09-24 02:47	50.09	OK
5293	2026-09-24 02:48	48.41	OK	5294	2026-09-24 02:49	50.63	OK
5295	2026-09-24 02:50	48.84	OK	5296	2026-09-24 02:51	48.21	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5297	2026-09-24 02:52	49.57	OK	5298	2026-09-24 02:53	50.44	OK
5299	2026-09-24 02:54	49.08	OK	5300	2026-09-24 02:55	49.63	OK
5301	2026-09-24 02:56	48.29	OK	5302	2026-09-24 02:57	49.49	OK
5303	2026-09-24 02:58	48.59	OK	5304	2026-09-24 02:59	47.80	OK
5305	2026-09-24 03:00	50.19	OK	5306	2026-09-24 03:01	50.30	OK
5307	2026-09-24 03:02	50.44	OK	5308	2026-09-24 03:03	49.37	OK
5309	2026-09-24 03:04	51.87	OK	5310	2026-09-24 03:05	50.51	OK
5311	2026-09-24 03:06	51.72	OK	5312	2026-09-24 03:07	48.30	OK
5313	2026-09-24 03:08	49.27	OK	5314	2026-09-24 03:09	50.44	OK
5315	2026-09-24 03:10	50.33	OK	5316	2026-09-24 03:11	50.30	OK
5317	2026-09-24 03:12	48.17	OK	5318	2026-09-24 03:13	48.40	OK
5319	2026-09-24 03:14	51.00	OK	5320	2026-09-24 03:15	50.23	OK
5321	2026-09-24 03:16	51.42	OK	5322	2026-09-24 03:17	50.71	OK
5323	2026-09-24 03:18	48.32	OK	5324	2026-09-24 03:19	48.29	OK
5325	2026-09-24 03:20	50.87	OK	5326	2026-09-24 03:21	49.22	OK
5327	2026-09-24 03:22	50.34	OK	5328	2026-09-24 03:23	51.46	OK
5329	2026-09-24 03:24	50.69	OK	5330	2026-09-24 03:25	49.26	OK
5331	2026-09-24 03:26	49.93	OK	5332	2026-09-24 03:27	49.79	OK
5333	2026-09-24 03:28	50.14	OK	5334	2026-09-24 03:29	50.74	OK
5335	2026-09-24 03:30	49.14	OK	5336	2026-09-24 03:31	49.02	OK
5337	2026-09-24 03:32	49.66	OK	5338	2026-09-24 03:33	48.82	OK
5339	2026-09-24 03:34	49.74	OK	5340	2026-09-24 03:35	50.14	OK
5341	2026-09-24 03:36	48.67	OK	5342	2026-09-24 03:37	48.92	OK
5343	2026-09-24 03:38	50.06	OK	5344	2026-09-24 03:39	49.74	OK
5345	2026-09-24 03:40	50.20	OK	5346	2026-09-24 03:41	50.97	OK
5347	2026-09-24 03:42	48.67	OK	5348	2026-09-24 03:43	50.08	OK
5349	2026-09-24 03:44	50.18	OK	5350	2026-09-24 03:45	49.20	OK
5351	2026-09-24 03:46	49.00	OK	5352	2026-09-24 03:47	50.94	OK
5353	2026-09-24 03:48	51.30	OK	5354	2026-09-24 03:49	51.24	OK
5355	2026-09-24 03:50	50.70	OK	5356	2026-09-24 03:51	51.61	OK
5357	2026-09-24 03:52	50.13	OK	5358	2026-09-24 03:53	50.58	OK
5359	2026-09-24 03:54	50.89	OK	5360	2026-09-24 03:55	52.43	OK
5361	2026-09-24 03:56	50.27	OK	5362	2026-09-24 03:57	50.92	OK
5363	2026-09-24 03:58	50.61	OK	5364	2026-09-24 03:59	50.19	OK
5365	2026-09-24 04:00	48.86	OK	5366	2026-09-24 04:01	50.02	OK
5367	2026-09-24 04:02	51.24	OK	5368	2026-09-24 04:03	50.89	OK
5369	2026-09-24 04:04	51.43	OK	5370	2026-09-24 04:05	48.91	OK
5371	2026-09-24 04:06	51.15	OK	5372	2026-09-24 04:07	51.17	OK
5373	2026-09-24 04:08	50.61	OK	5374	2026-09-24 04:09	48.45	OK
5375	2026-09-24 04:10	50.56	OK	5376	2026-09-24 04:11	49.75	OK
5377	2026-09-24 04:12	51.27	OK	5378	2026-09-24 04:13	50.45	OK
5379	2026-09-24 04:14	51.58	OK	5380	2026-09-24 04:15	49.19	OK
5381	2026-09-24 04:16	48.99	OK	5382	2026-09-24 04:17	52.66	OK
5383	2026-09-24 04:18	49.60	OK	5384	2026-09-24 04:19	50.93	OK
5385	2026-09-24 04:20	51.33	OK	5386	2026-09-24 04:21	51.49	OK
5387	2026-09-24 04:22	49.01	OK	5388	2026-09-24 04:23	51.33	OK
5389	2026-09-24 04:24	49.58	OK	5390	2026-09-24 04:25	51.83	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5391	2026-09-24 04:26	49.48	OK	5392	2026-09-24 04:27	51.09	OK
5393	2026-09-24 04:28	50.14	OK	5394	2026-09-24 04:29	51.17	OK
5395	2026-09-24 04:30	51.23	OK	5396	2026-09-24 04:31	49.37	OK
5397	2026-09-24 04:32	52.81	OK	5398	2026-09-24 04:33	51.50	OK
5399	2026-09-24 04:34	49.22	OK	5400	2026-09-24 04:35	52.33	OK
5401	2026-09-24 04:36	49.06	OK	5402	2026-09-24 04:37	52.73	OK
5403	2026-09-24 04:38	49.50	OK	5404	2026-09-24 04:39	51.29	OK
5405	2026-09-24 04:40	50.03	OK	5406	2026-09-24 04:41	49.23	OK
5407	2026-09-24 04:42	49.55	OK	5408	2026-09-24 04:43	52.93	OK
5409	2026-09-24 04:44	52.80	OK	5410	2026-09-24 04:45	50.45	OK
5411	2026-09-24 04:46	49.51	OK	5412	2026-09-24 04:47	50.43	OK
5413	2026-09-24 04:48	50.44	OK	5414	2026-09-24 04:49	50.45	OK
5415	2026-09-24 04:50	49.76	OK	5416	2026-09-24 04:51	52.36	OK
5417	2026-09-24 04:52	50.39	OK	5418	2026-09-24 04:53	51.82	OK
5419	2026-09-24 04:54	48.89	OK	5420	2026-09-24 04:55	53.03	OK
5421	2026-09-24 04:56	50.14	OK	5422	2026-09-24 04:57	50.01	OK
5423	2026-09-24 04:58	49.53	OK	5424	2026-09-24 04:59	49.62	OK
5425	2026-09-24 05:00	51.02	OK	5426	2026-09-24 05:01	51.27	OK
5427	2026-09-24 05:02	51.04	OK	5428	2026-09-24 05:03	51.28	OK
5429	2026-09-24 05:04	52.45	OK	5430	2026-09-24 05:05	51.62	OK
5431	2026-09-24 05:06	49.27	OK	5432	2026-09-24 05:07	51.25	OK
5433	2026-09-24 05:08	50.64	OK	5434	2026-09-24 05:09	50.16	OK
5435	2026-09-24 05:10	51.09	OK	5436	2026-09-24 05:11	51.07	OK
5437	2026-09-24 05:12	50.99	OK	5438	2026-09-24 05:13	49.63	OK
5439	2026-09-24 05:14	50.71	OK	5440	2026-09-24 05:15	52.18	OK
5441	2026-09-24 05:16	51.34	OK	5442	2026-09-24 05:17	51.48	OK
5443	2026-09-24 05:18	52.62	OK	5444	2026-09-24 05:19	49.64	OK
5445	2026-09-24 05:20	51.43	OK	5446	2026-09-24 05:21	49.90	OK
5447	2026-09-24 05:22	51.87	OK	5448	2026-09-24 05:23	51.84	OK
5449	2026-09-24 05:24	52.33	OK	5450	2026-09-24 05:25	50.32	OK
5451	2026-09-24 05:26	52.78	OK	5452	2026-09-24 05:27	51.49	OK
5453	2026-09-24 05:28	48.28	OK	5454	2026-09-24 05:29	51.91	OK
5455	2026-09-24 05:30	50.63	OK	5456	2026-09-24 05:31	52.19	OK
5457	2026-09-24 05:32	52.04	OK	5458	2026-09-24 05:33	48.96	OK
5459	2026-09-24 05:34	49.99	OK	5460	2026-09-24 05:35	50.25	OK
5461	2026-09-24 05:36	50.21	OK	5462	2026-09-24 05:37	50.53	OK
5463	2026-09-24 05:38	49.84	OK	5464	2026-09-24 05:39	49.83	OK
5465	2026-09-24 05:40	51.64	OK	5466	2026-09-24 05:41	50.07	OK
5467	2026-09-24 05:42	51.29	OK	5468	2026-09-24 05:43	50.88	OK
5469	2026-09-24 05:44	50.71	OK	5470	2026-09-24 05:45	51.37	OK
5471	2026-09-24 05:46	51.43	OK	5472	2026-09-24 05:47	50.36	OK
5473	2026-09-24 05:48	51.75	OK	5474	2026-09-24 05:49	49.85	OK
5475	2026-09-24 05:50	51.27	OK	5476	2026-09-24 05:51	54.03	OK
5477	2026-09-24 05:52	49.04	OK	5478	2026-09-24 05:53	51.30	OK
5479	2026-09-24 05:54	50.62	OK	5480	2026-09-24 05:55	52.70	OK
5481	2026-09-24 05:56	52.26	OK	5482	2026-09-24 05:57	50.59	OK
5483	2026-09-24 05:58	51.31	OK	5484	2026-09-24 05:59	49.88	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5485	2026-09-24 06:00	51.15	OK	5486	2026-09-24 06:01	50.66	OK
5487	2026-09-24 06:02	50.01	OK	5488	2026-09-24 06:03	50.15	OK
5489	2026-09-24 06:04	50.28	OK	5490	2026-09-24 06:05	52.87	OK
5491	2026-09-24 06:06	52.66	OK	5492	2026-09-24 06:07	51.54	OK
5493	2026-09-24 06:08	51.01	OK	5494	2026-09-24 06:09	51.64	OK
5495	2026-09-24 06:10	51.72	OK	5496	2026-09-24 06:11	50.78	OK
5497	2026-09-24 06:12	51.35	OK	5498	2026-09-24 06:13	50.29	OK
5499	2026-09-24 06:14	51.92	OK	5500	2026-09-24 06:15	51.10	OK
5501	2026-09-24 06:16	52.27	OK	5502	2026-09-24 06:17	50.61	OK
5503	2026-09-24 06:18	50.01	OK	5504	2026-09-24 06:19	52.72	OK
5505	2026-09-24 06:20	51.84	OK	5506	2026-09-24 06:21	52.33	OK
5507	2026-09-24 06:22	50.80	OK	5508	2026-09-24 06:23	51.01	OK
5509	2026-09-24 06:24	51.48	OK	5510	2026-09-24 06:25	52.31	OK
5511	2026-09-24 06:26	52.88	OK	5512	2026-09-24 06:27	53.19	OK
5513	2026-09-24 06:28	52.34	OK	5514	2026-09-24 06:29	49.67	OK
5515	2026-09-24 06:30	51.56	OK	5516	2026-09-24 06:31	49.49	OK
5517	2026-09-24 06:32	50.91	OK	5518	2026-09-24 06:33	52.53	OK
5519	2026-09-24 06:34	50.03	OK	5520	2026-09-24 06:35	49.85	OK
5521	2026-09-24 06:36	51.84	OK	5522	2026-09-24 06:37	52.05	OK
5523	2026-09-24 06:38	50.45	OK	5524	2026-09-24 06:39	50.86	OK
5525	2026-09-24 06:40	50.50	OK	5526	2026-09-24 06:41	52.13	OK
5527	2026-09-24 06:42	50.27	OK	5528	2026-09-24 06:43	50.82	OK
5529	2026-09-24 06:44	51.67	OK	5530	2026-09-24 06:45	54.16	OK
5531	2026-09-24 06:46	52.01	OK	5532	2026-09-24 06:47	51.58	OK
5533	2026-09-24 06:48	51.94	OK	5534	2026-09-24 06:49	50.61	OK
5535	2026-09-24 06:50	51.91	OK	5536	2026-09-24 06:51	50.09	OK
5537	2026-09-24 06:52	52.66	OK	5538	2026-09-24 06:53	51.04	OK
5539	2026-09-24 06:54	50.09	OK	5540	2026-09-24 06:55	52.75	OK
5541	2026-09-24 06:56	49.76	OK	5542	2026-09-24 06:57	52.08	OK
5543	2026-09-24 06:58	52.49	OK	5544	2026-09-24 06:59	52.61	OK
5545	2026-09-24 07:00	50.81	OK	5546	2026-09-24 07:01	50.76	OK
5547	2026-09-24 07:02	51.29	OK	5548	2026-09-24 07:03	51.47	OK
5549	2026-09-24 07:04	52.52	OK	5550	2026-09-24 07:05	52.39	OK
5551	2026-09-24 07:06	53.64	OK	5552	2026-09-24 07:07	51.20	OK
5553	2026-09-24 07:08	54.01	OK	5554	2026-09-24 07:09	52.49	OK
5555	2026-09-24 07:10	51.68	OK	5556	2026-09-24 07:11	52.62	OK
5557	2026-09-24 07:12	52.53	OK	5558	2026-09-24 07:13	49.93	OK
5559	2026-09-24 07:14	52.44	OK	5560	2026-09-24 07:15	52.01	OK
5561	2026-09-24 07:16	51.21	OK	5562	2026-09-24 07:17	54.53	OK
5563	2026-09-24 07:18	52.61	OK	5564	2026-09-24 07:19	52.55	OK
5565	2026-09-24 07:20	51.98	OK	5566	2026-09-24 07:21	52.65	OK
5567	2026-09-24 07:22	52.92	OK	5568	2026-09-24 07:23	52.06	OK
5569	2026-09-24 07:24	52.49	OK	5570	2026-09-24 07:25	51.19	OK
5571	2026-09-24 07:26	54.31	OK	5572	2026-09-24 07:27	51.06	OK
5573	2026-09-24 07:28	53.35	OK	5574	2026-09-24 07:29	52.10	OK
5575	2026-09-24 07:30	50.50	OK	5576	2026-09-24 07:31	54.11	OK
5577	2026-09-24 07:32	54.31	OK	5578	2026-09-24 07:33	54.30	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5579	2026-09-24 07:34	52.68	OK	5580	2026-09-24 07:35	52.39	OK
5581	2026-09-24 07:36	49.69	OK	5582	2026-09-24 07:37	52.08	OK
5583	2026-09-24 07:38	52.56	OK	5584	2026-09-24 07:39	52.08	OK
5585	2026-09-24 07:40	53.61	OK	5586	2026-09-24 07:41	53.50	OK
5587	2026-09-24 07:42	50.10	OK	5588	2026-09-24 07:43	53.09	OK
5589	2026-09-24 07:44	53.52	OK	5590	2026-09-24 07:45	52.40	OK
5591	2026-09-24 07:46	53.18	OK	5592	2026-09-24 07:47	52.79	OK
5593	2026-09-24 07:48	52.75	OK	5594	2026-09-24 07:49	52.22	OK
5595	2026-09-24 07:50	54.67	OK	5596	2026-09-24 07:51	53.85	OK
5597	2026-09-24 07:52	53.90	OK	5598	2026-09-24 07:53	51.96	OK
5599	2026-09-24 07:54	53.79	OK	5600	2026-09-24 07:55	53.92	OK
5601	2026-09-24 07:56	53.48	OK	5602	2026-09-24 07:57	53.61	OK
5603	2026-09-24 07:58	51.86	OK	5604	2026-09-24 07:59	51.71	OK
5605	2026-09-24 08:00	55.50	OK	5606	2026-09-24 08:01	54.59	OK
5607	2026-09-24 08:02	53.43	OK	5608	2026-09-24 08:03	51.37	OK
5609	2026-09-24 08:04	53.91	OK	5610	2026-09-24 08:05	54.47	OK
5611	2026-09-24 08:06	51.24	OK	5612	2026-09-24 08:07	53.15	OK
5613	2026-09-24 08:08	53.13	OK	5614	2026-09-24 08:09	53.45	OK
5615	2026-09-24 08:10	53.97	OK	5616	2026-09-24 08:11	52.28	OK
5617	2026-09-24 08:12	54.92	OK	5618	2026-09-24 08:13	51.69	OK
5619	2026-09-24 08:14	53.55	OK	5620	2026-09-24 08:15	52.47	OK
5621	2026-09-24 08:16	52.59	OK	5622	2026-09-24 08:17	52.98	OK
5623	2026-09-24 08:18	53.62	OK	5624	2026-09-24 08:19	52.51	OK
5625	2026-09-24 08:20	53.48	OK	5626	2026-09-24 08:21	52.99	OK
5627	2026-09-24 08:22	54.11	OK	5628	2026-09-24 08:23	53.60	OK
5629	2026-09-24 08:24	54.33	OK	5630	2026-09-24 08:25	53.87	OK
5631	2026-09-24 08:26	52.74	OK	5632	2026-09-24 08:27	54.93	OK
5633	2026-09-24 08:28	54.69	OK	5634	2026-09-24 08:29	53.21	OK
5635	2026-09-24 08:30	53.15	OK	5636	2026-09-24 08:31	55.50	OK
5637	2026-09-24 08:32	52.86	OK	5638	2026-09-24 08:33	53.17	OK
5639	2026-09-24 08:34	53.72	OK	5640	2026-09-24 08:35	54.05	OK
5641	2026-09-24 08:36	52.82	OK	5642	2026-09-24 08:37	54.16	OK
5643	2026-09-24 08:38	53.98	OK	5644	2026-09-24 08:39	52.25	OK
5645	2026-09-24 08:40	53.44	OK	5646	2026-09-24 08:41	52.96	OK
5647	2026-09-24 08:42	53.39	OK	5648	2026-09-24 08:43	53.00	OK
5649	2026-09-24 08:44	53.57	OK	5650	2026-09-24 08:45	53.36	OK
5651	2026-09-24 08:46	53.01	OK	5652	2026-09-24 08:47	52.71	OK
5653	2026-09-24 08:48	52.34	OK	5654	2026-09-24 08:49	55.21	OK
5655	2026-09-24 08:50	53.86	OK	5656	2026-09-24 08:51	52.36	OK
5657	2026-09-24 08:52	54.78	OK	5658	2026-09-24 08:53	52.47	OK
5659	2026-09-24 08:54	55.32	OK	5660	2026-09-24 08:55	55.19	OK
5661	2026-09-24 08:56	56.03	OK	5662	2026-09-24 08:57	54.74	OK
5663	2026-09-24 08:58	54.25	OK	5664	2026-09-24 08:59	54.42	OK
5665	2026-09-24 09:00	53.48	OK	5666	2026-09-24 09:01	54.57	OK
5667	2026-09-24 09:02	55.27	OK	5668	2026-09-24 09:03	55.25	OK
5669	2026-09-24 09:04	55.41	OK	5670	2026-09-24 09:05	55.23	OK
5671	2026-09-24 09:06	54.01	OK	5672	2026-09-24 09:07	54.64	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5673	2026-09-24 09:08	54.94	OK	5674	2026-09-24 09:09	53.72	OK
5675	2026-09-24 09:10	55.74	OK	5676	2026-09-24 09:11	56.16	OK
5677	2026-09-24 09:12	53.03	OK	5678	2026-09-24 09:13	53.05	OK
5679	2026-09-24 09:14	54.43	OK	5680	2026-09-24 09:15	55.62	OK
5681	2026-09-24 09:16	56.06	OK	5682	2026-09-24 09:17	53.33	OK
5683	2026-09-24 09:18	53.62	OK	5684	2026-09-24 09:19	54.78	OK
5685	2026-09-24 09:20	53.75	OK	5686	2026-09-24 09:21	52.33	OK
5687	2026-09-24 09:22	54.10	OK	5688	2026-09-24 09:23	55.43	OK
5689	2026-09-24 09:24	56.76	OK	5690	2026-09-24 09:25	54.37	OK
5691	2026-09-24 09:26	53.47	OK	5692	2026-09-24 09:27	54.22	OK
5693	2026-09-24 09:28	55.48	OK	5694	2026-09-24 09:29	53.42	OK
5695	2026-09-24 09:30	54.14	OK	5696	2026-09-24 09:31	54.47	OK
5697	2026-09-24 09:32	54.28	OK	5698	2026-09-24 09:33	53.57	OK
5699	2026-09-24 09:34	53.88	OK	5700	2026-09-24 09:35	55.50	OK
5701	2026-09-24 09:36	54.06	OK	5702	2026-09-24 09:37	56.18	OK
5703	2026-09-24 09:38	54.73	OK	5704	2026-09-24 09:39	53.85	OK
5705	2026-09-24 09:40	53.67	OK	5706	2026-09-24 09:41	54.91	OK
5707	2026-09-24 09:42	54.39	OK	5708	2026-09-24 09:43	56.05	OK
5709	2026-09-24 09:44	54.68	OK	5710	2026-09-24 09:45	56.12	OK
5711	2026-09-24 09:46	53.35	OK	5712	2026-09-24 09:47	52.23	OK
5713	2026-09-24 09:48	57.32	OK	5714	2026-09-24 09:49	53.53	OK
5715	2026-09-24 09:50	57.13	OK	5716	2026-09-24 09:51	54.57	OK
5717	2026-09-24 09:52	54.99	OK	5718	2026-09-24 09:53	54.12	OK
5719	2026-09-24 09:54	55.14	OK	5720	2026-09-24 09:55	55.14	OK
5721	2026-09-24 09:56	53.82	OK	5722	2026-09-24 09:57	57.05	OK
5723	2026-09-24 09:58	56.33	OK	5724	2026-09-24 09:59	55.51	OK
5725	2026-09-24 10:00	56.19	OK	5726	2026-09-24 10:01	55.71	OK
5727	2026-09-24 10:02	56.17	OK	5728	2026-09-24 10:03	54.44	OK
5729	2026-09-24 10:04	54.74	OK	5730	2026-09-24 10:05	55.03	OK
5731	2026-09-24 10:06	53.91	OK	5732	2026-09-24 10:07	55.46	OK
5733	2026-09-24 10:08	55.36	OK	5734	2026-09-24 10:09	57.50	OK
5735	2026-09-24 10:10	55.08	OK	5736	2026-09-24 10:11	56.18	OK
5737	2026-09-24 10:12	54.07	OK	5738	2026-09-24 10:13	55.59	OK
5739	2026-09-24 10:14	55.77	OK	5740	2026-09-24 10:15	54.80	OK
5741	2026-09-24 10:16	55.65	OK	5742	2026-09-24 10:17	55.43	OK
5743	2026-09-24 10:18	54.82	OK	5744	2026-09-24 10:19	55.39	OK
5745	2026-09-24 10:20	54.72	OK	5746	2026-09-24 10:21	56.28	OK
5747	2026-09-24 10:22	55.42	OK	5748	2026-09-24 10:23	56.63	OK
5749	2026-09-24 10:24	58.12	OK	5750	2026-09-24 10:25	55.73	OK
5751	2026-09-24 10:26	54.45	OK	5752	2026-09-24 10:27	56.49	OK
5753	2026-09-24 10:28	56.29	OK	5754	2026-09-24 10:29	56.08	OK
5755	2026-09-24 10:30	56.15	OK	5756	2026-09-24 10:31	55.59	OK
5757	2026-09-24 10:32	57.81	OK	5758	2026-09-24 10:33	55.99	OK
5759	2026-09-24 10:34	56.56	OK	5760	2026-09-24 10:35	55.67	OK

Signal: Ambient_Temp (°C)

Operating Limits: [0.0 to 50.0] • Observed: Min 24.61, Max 33.98, Mean 29.26

All 5,760 Raw Readings

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1	2026-09-20 10:36	30.60	OK	2	2026-09-20 10:37	29.89	OK
3	2026-09-20 10:38	30.19	OK	4	2026-09-20 10:39	31.10	OK
5	2026-09-20 10:40	30.48	OK	6	2026-09-20 10:41	30.46	OK
7	2026-09-20 10:42	29.82	OK	8	2026-09-20 10:43	31.23	OK
9	2026-09-20 10:44	30.59	OK	10	2026-09-20 10:45	31.06	OK
11	2026-09-20 10:46	30.14	OK	12	2026-09-20 10:47	30.73	OK
13	2026-09-20 10:48	28.90	OK	14	2026-09-20 10:49	30.61	OK
15	2026-09-20 10:50	28.58	OK	16	2026-09-20 10:51	30.33	OK
17	2026-09-20 10:52	29.19	OK	18	2026-09-20 10:53	29.41	OK
19	2026-09-20 10:54	30.68	OK	20	2026-09-20 10:55	29.01	OK
21	2026-09-20 10:56	30.57	OK	22	2026-09-20 10:57	31.36	OK
23	2026-09-20 10:58	29.52	OK	24	2026-09-20 10:59	32.32	OK
25	2026-09-20 11:00	31.29	OK	26	2026-09-20 11:01	30.62	OK
27	2026-09-20 11:02	30.05	OK	28	2026-09-20 11:03	30.90	OK
29	2026-09-20 11:04	29.61	OK	30	2026-09-20 11:05	30.10	OK
31	2026-09-20 11:06	31.64	OK	32	2026-09-20 11:07	29.82	OK
33	2026-09-20 11:08	30.37	OK	34	2026-09-20 11:09	29.22	OK
35	2026-09-20 11:10	30.93	OK	36	2026-09-20 11:11	31.03	OK
37	2026-09-20 11:12	29.80	OK	38	2026-09-20 11:13	30.38	OK
39	2026-09-20 11:14	29.12	OK	40	2026-09-20 11:15	29.63	OK
41	2026-09-20 11:16	30.13	OK	42	2026-09-20 11:17	29.84	OK
43	2026-09-20 11:18	30.81	OK	44	2026-09-20 11:19	29.31	OK
45	2026-09-20 11:20	30.39	OK	46	2026-09-20 11:21	29.34	OK
47	2026-09-20 11:22	30.38	OK	48	2026-09-20 11:23	29.70	OK
49	2026-09-20 11:24	29.40	OK	50	2026-09-20 11:25	30.50	OK
51	2026-09-20 11:26	30.84	OK	52	2026-09-20 11:27	31.02	OK
53	2026-09-20 11:28	30.33	OK	54	2026-09-20 11:29	29.69	OK
55	2026-09-20 11:30	28.74	OK	56	2026-09-20 11:31	28.74	OK
57	2026-09-20 11:32	28.47	OK	58	2026-09-20 11:33	30.48	OK
59	2026-09-20 11:34	29.58	OK	60	2026-09-20 11:35	30.69	OK
61	2026-09-20 11:36	29.39	OK	62	2026-09-20 11:37	29.07	OK
63	2026-09-20 11:38	29.48	OK	64	2026-09-20 11:39	30.09	OK
65	2026-09-20 11:40	30.96	OK	66	2026-09-20 11:41	30.26	OK
67	2026-09-20 11:42	31.09	OK	68	2026-09-20 11:43	29.00	OK
69	2026-09-20 11:44	30.12	OK	70	2026-09-20 11:45	28.53	OK
71	2026-09-20 11:46	30.80	OK	72	2026-09-20 11:47	29.46	OK
73	2026-09-20 11:48	30.45	OK	74	2026-09-20 11:49	30.89	OK
75	2026-09-20 11:50	29.47	OK	76	2026-09-20 11:51	29.88	OK
77	2026-09-20 11:52	28.67	OK	78	2026-09-20 11:53	30.17	OK
79	2026-09-20 11:54	29.63	OK	80	2026-09-20 11:55	29.67	OK
81	2026-09-20 11:56	29.55	OK	82	2026-09-20 11:57	29.38	OK
83	2026-09-20 11:58	30.58	OK	84	2026-09-20 11:59	29.12	OK
85	2026-09-20 12:00	28.97	OK	86	2026-09-20 12:01	29.49	OK
87	2026-09-20 12:02	30.69	OK	88	2026-09-20 12:03	30.64	OK
89	2026-09-20 12:04	29.76	OK	90	2026-09-20 12:05	29.32	OK
91	2026-09-20 12:06	29.31	OK	92	2026-09-20 12:07	29.81	OK
93	2026-09-20 12:08	28.22	OK	94	2026-09-20 12:09	28.89	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
95	2026-09-20 12:10	30.51	OK	96	2026-09-20 12:11	29.79	OK
97	2026-09-20 12:12	29.01	OK	98	2026-09-20 12:13	28.42	OK
99	2026-09-20 12:14	28.65	OK	100	2026-09-20 12:15	28.80	OK
101	2026-09-20 12:16	28.38	OK	102	2026-09-20 12:17	28.48	OK
103	2026-09-20 12:18	28.61	OK	104	2026-09-20 12:19	30.76	OK
105	2026-09-20 12:20	28.68	OK	106	2026-09-20 12:21	28.14	OK
107	2026-09-20 12:22	29.63	OK	108	2026-09-20 12:23	30.65	OK
109	2026-09-20 12:24	28.38	OK	110	2026-09-20 12:25	28.74	OK
111	2026-09-20 12:26	29.20	OK	112	2026-09-20 12:27	29.64	OK
113	2026-09-20 12:28	28.65	OK	114	2026-09-20 12:29	29.04	OK
115	2026-09-20 12:30	29.84	OK	116	2026-09-20 12:31	29.72	OK
117	2026-09-20 12:32	28.49	OK	118	2026-09-20 12:33	29.21	OK
119	2026-09-20 12:34	29.27	OK	120	2026-09-20 12:35	29.25	OK
121	2026-09-20 12:36	30.00	OK	122	2026-09-20 12:37	29.06	OK
123	2026-09-20 12:38	30.56	OK	124	2026-09-20 12:39	29.34	OK
125	2026-09-20 12:40	28.79	OK	126	2026-09-20 12:41	28.45	OK
127	2026-09-20 12:42	28.44	OK	128	2026-09-20 12:43	28.88	OK
129	2026-09-20 12:44	27.73	OK	130	2026-09-20 12:45	30.00	OK
131	2026-09-20 12:46	28.25	OK	132	2026-09-20 12:47	27.70	OK
133	2026-09-20 12:48	29.12	OK	134	2026-09-20 12:49	29.60	OK
135	2026-09-20 12:50	27.61	OK	136	2026-09-20 12:51	30.22	OK
137	2026-09-20 12:52	29.33	OK	138	2026-09-20 12:53	28.47	OK
139	2026-09-20 12:54	28.55	OK	140	2026-09-20 12:55	30.24	OK
141	2026-09-20 12:56	29.19	OK	142	2026-09-20 12:57	27.97	OK
143	2026-09-20 12:58	29.64	OK	144	2026-09-20 12:59	29.47	OK
145	2026-09-20 13:00	29.71	OK	146	2026-09-20 13:01	29.03	OK
147	2026-09-20 13:02	28.83	OK	148	2026-09-20 13:03	29.02	OK
149	2026-09-20 13:04	28.29	OK	150	2026-09-20 13:05	28.90	OK
151	2026-09-20 13:06	29.78	OK	152	2026-09-20 13:07	28.17	OK
153	2026-09-20 13:08	29.02	OK	154	2026-09-20 13:09	28.46	OK
155	2026-09-20 13:10	28.93	OK	156	2026-09-20 13:11	29.42	OK
157	2026-09-20 13:12	28.48	OK	158	2026-09-20 13:13	28.85	OK
159	2026-09-20 13:14	27.82	OK	160	2026-09-20 13:15	27.92	OK
161	2026-09-20 13:16	30.14	OK	162	2026-09-20 13:17	29.01	OK
163	2026-09-20 13:18	28.49	OK	164	2026-09-20 13:19	29.46	OK
165	2026-09-20 13:20	29.42	OK	166	2026-09-20 13:21	29.92	OK
167	2026-09-20 13:22	28.50	OK	168	2026-09-20 13:23	28.08	OK
169	2026-09-20 13:24	27.67	OK	170	2026-09-20 13:25	28.44	OK
171	2026-09-20 13:26	28.75	OK	172	2026-09-20 13:27	28.43	OK
173	2026-09-20 13:28	29.25	OK	174	2026-09-20 13:29	27.82	OK
175	2026-09-20 13:30	27.94	OK	176	2026-09-20 13:31	27.66	OK
177	2026-09-20 13:32	27.58	OK	178	2026-09-20 13:33	29.42	OK
179	2026-09-20 13:34	28.46	OK	180	2026-09-20 13:35	29.38	OK
181	2026-09-20 13:36	28.71	OK	182	2026-09-20 13:37	28.10	OK
183	2026-09-20 13:38	28.56	OK	184	2026-09-20 13:39	29.99	OK
185	2026-09-20 13:40	28.29	OK	186	2026-09-20 13:41	28.68	OK
187	2026-09-20 13:42	28.18	OK	188	2026-09-20 13:43	28.84	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
189	2026-09-20 13:44	28.51	OK	190	2026-09-20 13:45	28.04	OK
191	2026-09-20 13:46	29.23	OK	192	2026-09-20 13:47	27.23	OK
193	2026-09-20 13:48	28.18	OK	194	2026-09-20 13:49	27.34	OK
195	2026-09-20 13:50	28.15	OK	196	2026-09-20 13:51	28.27	OK
197	2026-09-20 13:52	28.46	OK	198	2026-09-20 13:53	27.27	OK
199	2026-09-20 13:54	28.93	OK	200	2026-09-20 13:55	28.17	OK
201	2026-09-20 13:56	29.91	OK	202	2026-09-20 13:57	26.83	OK
203	2026-09-20 13:58	29.98	OK	204	2026-09-20 13:59	29.01	OK
205	2026-09-20 14:00	28.07	OK	206	2026-09-20 14:01	28.22	OK
207	2026-09-20 14:02	27.22	OK	208	2026-09-20 14:03	27.53	OK
209	2026-09-20 14:04	27.80	OK	210	2026-09-20 14:05	27.98	OK
211	2026-09-20 14:06	29.03	OK	212	2026-09-20 14:07	27.23	OK
213	2026-09-20 14:08	29.08	OK	214	2026-09-20 14:09	29.18	OK
215	2026-09-20 14:10	28.95	OK	216	2026-09-20 14:11	29.77	OK
217	2026-09-20 14:12	28.67	OK	218	2026-09-20 14:13	28.53	OK
219	2026-09-20 14:14	27.93	OK	220	2026-09-20 14:15	28.70	OK
221	2026-09-20 14:16	27.64	OK	222	2026-09-20 14:17	28.20	OK
223	2026-09-20 14:18	28.15	OK	224	2026-09-20 14:19	27.84	OK
225	2026-09-20 14:20	29.10	OK	226	2026-09-20 14:21	28.08	OK
227	2026-09-20 14:22	29.24	OK	228	2026-09-20 14:23	28.54	OK
229	2026-09-20 14:24	28.38	OK	230	2026-09-20 14:25	28.63	OK
231	2026-09-20 14:26	28.67	OK	232	2026-09-20 14:27	28.64	OK
233	2026-09-20 14:28	27.44	OK	234	2026-09-20 14:29	28.38	OK
235	2026-09-20 14:30	28.95	OK	236	2026-09-20 14:31	29.03	OK
237	2026-09-20 14:32	28.22	OK	238	2026-09-20 14:33	27.13	OK
239	2026-09-20 14:34	28.40	OK	240	2026-09-20 14:35	27.79	OK
241	2026-09-20 14:36	27.28	OK	242	2026-09-20 14:37	28.22	OK
243	2026-09-20 14:38	26.57	OK	244	2026-09-20 14:39	29.55	OK
245	2026-09-20 14:40	26.91	OK	246	2026-09-20 14:41	28.59	OK
247	2026-09-20 14:42	28.86	OK	248	2026-09-20 14:43	27.83	OK
249	2026-09-20 14:44	29.48	OK	250	2026-09-20 14:45	28.66	OK
251	2026-09-20 14:46	26.45	OK	252	2026-09-20 14:47	28.38	OK
253	2026-09-20 14:48	27.31	OK	254	2026-09-20 14:49	26.92	OK
255	2026-09-20 14:50	28.02	OK	256	2026-09-20 14:51	27.39	OK
257	2026-09-20 14:52	26.94	OK	258	2026-09-20 14:53	28.82	OK
259	2026-09-20 14:54	26.54	OK	260	2026-09-20 14:55	27.35	OK
261	2026-09-20 14:56	27.78	OK	262	2026-09-20 14:57	27.58	OK
263	2026-09-20 14:58	27.49	OK	264	2026-09-20 14:59	28.38	OK
265	2026-09-20 15:00	28.40	OK	266	2026-09-20 15:01	27.87	OK
267	2026-09-20 15:02	27.47	OK	268	2026-09-20 15:03	27.05	OK
269	2026-09-20 15:04	27.42	OK	270	2026-09-20 15:05	28.39	OK
271	2026-09-20 15:06	27.19	OK	272	2026-09-20 15:07	27.89	OK
273	2026-09-20 15:08	28.48	OK	274	2026-09-20 15:09	27.02	OK
275	2026-09-20 15:10	27.26	OK	276	2026-09-20 15:11	26.87	OK
277	2026-09-20 15:12	27.06	OK	278	2026-09-20 15:13	28.06	OK
279	2026-09-20 15:14	27.92	OK	280	2026-09-20 15:15	27.93	OK
281	2026-09-20 15:16	28.59	OK	282	2026-09-20 15:17	27.74	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
283	2026-09-20 15:18	28.22	OK	284	2026-09-20 15:19	27.09	OK
285	2026-09-20 15:20	28.04	OK	286	2026-09-20 15:21	28.03	OK
287	2026-09-20 15:22	27.85	OK	288	2026-09-20 15:23	29.09	OK
289	2026-09-20 15:24	28.65	OK	290	2026-09-20 15:25	27.23	OK
291	2026-09-20 15:26	27.37	OK	292	2026-09-20 15:27	27.15	OK
293	2026-09-20 15:28	28.30	OK	294	2026-09-20 15:29	27.94	OK
295	2026-09-20 15:30	28.17	OK	296	2026-09-20 15:31	28.32	OK
297	2026-09-20 15:32	27.77	OK	298	2026-09-20 15:33	26.48	OK
299	2026-09-20 15:34	27.81	OK	300	2026-09-20 15:35	27.78	OK
301	2026-09-20 15:36	27.97	OK	302	2026-09-20 15:37	27.31	OK
303	2026-09-20 15:38	27.55	OK	304	2026-09-20 15:39	28.28	OK
305	2026-09-20 15:40	28.15	OK	306	2026-09-20 15:41	26.53	OK
307	2026-09-20 15:42	27.77	OK	308	2026-09-20 15:43	27.22	OK
309	2026-09-20 15:44	27.08	OK	310	2026-09-20 15:45	27.98	OK
311	2026-09-20 15:46	26.83	OK	312	2026-09-20 15:47	27.48	OK
313	2026-09-20 15:48	26.39	OK	314	2026-09-20 15:49	28.01	OK
315	2026-09-20 15:50	27.29	OK	316	2026-09-20 15:51	26.56	OK
317	2026-09-20 15:52	26.82	OK	318	2026-09-20 15:53	27.70	OK
319	2026-09-20 15:54	28.03	OK	320	2026-09-20 15:55	27.29	OK
321	2026-09-20 15:56	27.78	OK	322	2026-09-20 15:57	27.08	OK
323	2026-09-20 15:58	26.37	OK	324	2026-09-20 15:59	27.37	OK
325	2026-09-20 16:00	26.31	OK	326	2026-09-20 16:01	27.49	OK
327	2026-09-20 16:02	26.37	OK	328	2026-09-20 16:03	28.55	OK
329	2026-09-20 16:04	28.14	OK	330	2026-09-20 16:05	26.00	OK
331	2026-09-20 16:06	28.56	OK	332	2026-09-20 16:07	27.10	OK
333	2026-09-20 16:08	27.19	OK	334	2026-09-20 16:09	26.83	OK
335	2026-09-20 16:10	28.22	OK	336	2026-09-20 16:11	26.77	OK
337	2026-09-20 16:12	27.22	OK	338	2026-09-20 16:13	26.38	OK
339	2026-09-20 16:14	27.03	OK	340	2026-09-20 16:15	25.31	OK
341	2026-09-20 16:16	26.82	OK	342	2026-09-20 16:17	28.65	OK
343	2026-09-20 16:18	27.90	OK	344	2026-09-20 16:19	25.95	OK
345	2026-09-20 16:20	28.66	OK	346	2026-09-20 16:21	26.79	OK
347	2026-09-20 16:22	25.76	OK	348	2026-09-20 16:23	27.19	OK
349	2026-09-20 16:24	26.98	OK	350	2026-09-20 16:25	26.69	OK
351	2026-09-20 16:26	28.05	OK	352	2026-09-20 16:27	25.87	OK
353	2026-09-20 16:28	28.89	OK	354	2026-09-20 16:29	27.02	OK
355	2026-09-20 16:30	26.62	OK	356	2026-09-20 16:31	27.57	OK
357	2026-09-20 16:32	28.07	OK	358	2026-09-20 16:33	27.90	OK
359	2026-09-20 16:34	27.61	OK	360	2026-09-20 16:35	25.59	OK
361	2026-09-20 16:36	27.42	OK	362	2026-09-20 16:37	25.84	OK
363	2026-09-20 16:38	27.36	OK	364	2026-09-20 16:39	26.38	OK
365	2026-09-20 16:40	27.71	OK	366	2026-09-20 16:41	27.71	OK
367	2026-09-20 16:42	26.14	OK	368	2026-09-20 16:43	27.10	OK
369	2026-09-20 16:44	27.86	OK	370	2026-09-20 16:45	26.27	OK
371	2026-09-20 16:46	26.46	OK	372	2026-09-20 16:47	27.05	OK
373	2026-09-20 16:48	27.29	OK	374	2026-09-20 16:49	26.73	OK
375	2026-09-20 16:50	26.23	OK	376	2026-09-20 16:51	27.37	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
377	2026-09-20 16:52	27.98	OK	378	2026-09-20 16:53	26.12	OK
379	2026-09-20 16:54	26.92	OK	380	2026-09-20 16:55	27.32	OK
381	2026-09-20 16:56	27.29	OK	382	2026-09-20 16:57	28.05	OK
383	2026-09-20 16:58	26.88	OK	384	2026-09-20 16:59	27.31	OK
385	2026-09-20 17:00	27.93	OK	386	2026-09-20 17:01	26.77	OK
387	2026-09-20 17:02	26.89	OK	388	2026-09-20 17:03	25.79	OK
389	2026-09-20 17:04	27.09	OK	390	2026-09-20 17:05	27.62	OK
391	2026-09-20 17:06	27.70	OK	392	2026-09-20 17:07	26.27	OK
393	2026-09-20 17:08	27.87	OK	394	2026-09-20 17:09	27.42	OK
395	2026-09-20 17:10	28.00	OK	396	2026-09-20 17:11	27.38	OK
397	2026-09-20 17:12	26.08	OK	398	2026-09-20 17:13	25.62	OK
399	2026-09-20 17:14	28.56	OK	400	2026-09-20 17:15	26.41	OK
401	2026-09-20 17:16	26.98	OK	402	2026-09-20 17:17	26.68	OK
403	2026-09-20 17:18	26.16	OK	404	2026-09-20 17:19	26.77	OK
405	2026-09-20 17:20	25.36	OK	406	2026-09-20 17:21	28.29	OK
407	2026-09-20 17:22	27.01	OK	408	2026-09-20 17:23	25.50	OK
409	2026-09-20 17:24	25.98	OK	410	2026-09-20 17:25	25.19	OK
411	2026-09-20 17:26	26.24	OK	412	2026-09-20 17:27	27.01	OK
413	2026-09-20 17:28	26.77	OK	414	2026-09-20 17:29	25.81	OK
415	2026-09-20 17:30	26.86	OK	416	2026-09-20 17:31	28.22	OK
417	2026-09-20 17:32	26.49	OK	418	2026-09-20 17:33	25.73	OK
419	2026-09-20 17:34	25.36	OK	420	2026-09-20 17:35	27.72	OK
421	2026-09-20 17:36	25.82	OK	422	2026-09-20 17:37	27.03	OK
423	2026-09-20 17:38	27.95	OK	424	2026-09-20 17:39	26.41	OK
425	2026-09-20 17:40	25.70	OK	426	2026-09-20 17:41	26.35	OK
427	2026-09-20 17:42	28.03	OK	428	2026-09-20 17:43	27.12	OK
429	2026-09-20 17:44	27.21	OK	430	2026-09-20 17:45	27.65	OK
431	2026-09-20 17:46	26.40	OK	432	2026-09-20 17:47	27.37	OK
433	2026-09-20 17:48	26.76	OK	434	2026-09-20 17:49	28.32	OK
435	2026-09-20 17:50	26.85	OK	436	2026-09-20 17:51	27.69	OK
437	2026-09-20 17:52	26.02	OK	438	2026-09-20 17:53	25.97	OK
439	2026-09-20 17:54	25.30	OK	440	2026-09-20 17:55	26.41	OK
441	2026-09-20 17:56	27.07	OK	442	2026-09-20 17:57	27.92	OK
443	2026-09-20 17:58	26.79	OK	444	2026-09-20 17:59	25.98	OK
445	2026-09-20 18:00	27.48	OK	446	2026-09-20 18:01	25.48	OK
447	2026-09-20 18:02	26.21	OK	448	2026-09-20 18:03	28.20	OK
449	2026-09-20 18:04	26.37	OK	450	2026-09-20 18:05	26.71	OK
451	2026-09-20 18:06	26.76	OK	452	2026-09-20 18:07	27.46	OK
453	2026-09-20 18:08	26.01	OK	454	2026-09-20 18:09	26.70	OK
455	2026-09-20 18:10	26.61	OK	456	2026-09-20 18:11	27.23	OK
457	2026-09-20 18:12	25.36	OK	458	2026-09-20 18:13	26.97	OK
459	2026-09-20 18:14	26.26	OK	460	2026-09-20 18:15	26.63	OK
461	2026-09-20 18:16	26.77	OK	462	2026-09-20 18:17	28.36	OK
463	2026-09-20 18:18	27.05	OK	464	2026-09-20 18:19	26.66	OK
465	2026-09-20 18:20	26.73	OK	466	2026-09-20 18:21	26.35	OK
467	2026-09-20 18:22	27.91	OK	468	2026-09-20 18:23	26.19	OK
469	2026-09-20 18:24	27.55	OK	470	2026-09-20 18:25	26.57	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
471	2026-09-20 18:26	28.02	OK	472	2026-09-20 18:27	26.93	OK
473	2026-09-20 18:28	27.42	OK	474	2026-09-20 18:29	26.05	OK
475	2026-09-20 18:30	26.31	OK	476	2026-09-20 18:31	27.63	OK
477	2026-09-20 18:32	28.17	OK	478	2026-09-20 18:33	26.41	OK
479	2026-09-20 18:34	26.20	OK	480	2026-09-20 18:35	26.32	OK
481	2026-09-20 18:36	26.54	OK	482	2026-09-20 18:37	26.94	OK
483	2026-09-20 18:38	26.65	OK	484	2026-09-20 18:39	26.90	OK
485	2026-09-20 18:40	26.57	OK	486	2026-09-20 18:41	26.64	OK
487	2026-09-20 18:42	26.96	OK	488	2026-09-20 18:43	27.24	OK
489	2026-09-20 18:44	26.17	OK	490	2026-09-20 18:45	27.39	OK
491	2026-09-20 18:46	26.94	OK	492	2026-09-20 18:47	26.38	OK
493	2026-09-20 18:48	27.25	OK	494	2026-09-20 18:49	26.27	OK
495	2026-09-20 18:50	26.76	OK	496	2026-09-20 18:51	27.30	OK
497	2026-09-20 18:52	25.58	OK	498	2026-09-20 18:53	26.87	OK
499	2026-09-20 18:54	27.49	OK	500	2026-09-20 18:55	26.24	OK
501	2026-09-20 18:56	25.95	OK	502	2026-09-20 18:57	26.89	OK
503	2026-09-20 18:58	26.74	OK	504	2026-09-20 18:59	28.10	OK
505	2026-09-20 19:00	26.33	OK	506	2026-09-20 19:01	27.82	OK
507	2026-09-20 19:02	26.48	OK	508	2026-09-20 19:03	26.88	OK
509	2026-09-20 19:04	26.50	OK	510	2026-09-20 19:05	25.58	OK
511	2026-09-20 19:06	28.01	OK	512	2026-09-20 19:07	26.92	OK
513	2026-09-20 19:08	26.21	OK	514	2026-09-20 19:09	27.01	OK
515	2026-09-20 19:10	26.67	OK	516	2026-09-20 19:11	26.22	OK
517	2026-09-20 19:12	25.70	OK	518	2026-09-20 19:13	26.37	OK
519	2026-09-20 19:14	26.77	OK	520	2026-09-20 19:15	27.32	OK
521	2026-09-20 19:16	26.73	OK	522	2026-09-20 19:17	25.52	OK
523	2026-09-20 19:18	25.95	OK	524	2026-09-20 19:19	26.28	OK
525	2026-09-20 19:20	26.53	OK	526	2026-09-20 19:21	27.85	OK
527	2026-09-20 19:22	26.85	OK	528	2026-09-20 19:23	28.03	OK
529	2026-09-20 19:24	27.63	OK	530	2026-09-20 19:25	28.03	OK
531	2026-09-20 19:26	26.80	OK	532	2026-09-20 19:27	25.62	OK
533	2026-09-20 19:28	25.65	OK	534	2026-09-20 19:29	26.44	OK
535	2026-09-20 19:30	27.63	OK	536	2026-09-20 19:31	27.32	OK
537	2026-09-20 19:32	25.24	OK	538	2026-09-20 19:33	28.06	OK
539	2026-09-20 19:34	27.09	OK	540	2026-09-20 19:35	25.84	OK
541	2026-09-20 19:36	25.99	OK	542	2026-09-20 19:37	25.57	OK
543	2026-09-20 19:38	27.95	OK	544	2026-09-20 19:39	26.73	OK
545	2026-09-20 19:40	27.36	OK	546	2026-09-20 19:41	27.80	OK
547	2026-09-20 19:42	27.07	OK	548	2026-09-20 19:43	28.59	OK
549	2026-09-20 19:44	25.72	OK	550	2026-09-20 19:45	26.89	OK
551	2026-09-20 19:46	25.51	OK	552	2026-09-20 19:47	25.28	OK
553	2026-09-20 19:48	27.26	OK	554	2026-09-20 19:49	27.83	OK
555	2026-09-20 19:50	27.12	OK	556	2026-09-20 19:51	26.69	OK
557	2026-09-20 19:52	26.75	OK	558	2026-09-20 19:53	26.94	OK
559	2026-09-20 19:54	25.92	OK	560	2026-09-20 19:55	27.38	OK
561	2026-09-20 19:56	26.46	OK	562	2026-09-20 19:57	26.54	OK
563	2026-09-20 19:58	26.12	OK	564	2026-09-20 19:59	25.77	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
565	2026-09-20 20:00	27.71	OK	566	2026-09-20 20:01	27.22	OK
567	2026-09-20 20:02	28.04	OK	568	2026-09-20 20:03	27.03	OK
569	2026-09-20 20:04	25.42	OK	570	2026-09-20 20:05	27.64	OK
571	2026-09-20 20:06	27.81	OK	572	2026-09-20 20:07	26.71	OK
573	2026-09-20 20:08	25.84	OK	574	2026-09-20 20:09	26.63	OK
575	2026-09-20 20:10	27.11	OK	576	2026-09-20 20:11	26.28	OK
577	2026-09-20 20:12	26.46	OK	578	2026-09-20 20:13	27.10	OK
579	2026-09-20 20:14	27.07	OK	580	2026-09-20 20:15	27.13	OK
581	2026-09-20 20:16	26.68	OK	582	2026-09-20 20:17	26.68	OK
583	2026-09-20 20:18	26.53	OK	584	2026-09-20 20:19	26.20	OK
585	2026-09-20 20:20	28.75	OK	586	2026-09-20 20:21	26.20	OK
587	2026-09-20 20:22	26.22	OK	588	2026-09-20 20:23	26.10	OK
589	2026-09-20 20:24	28.79	OK	590	2026-09-20 20:25	25.56	OK
591	2026-09-20 20:26	26.64	OK	592	2026-09-20 20:27	27.37	OK
593	2026-09-20 20:28	26.18	OK	594	2026-09-20 20:29	27.57	OK
595	2026-09-20 20:30	28.95	OK	596	2026-09-20 20:31	26.54	OK
597	2026-09-20 20:32	26.37	OK	598	2026-09-20 20:33	27.69	OK
599	2026-09-20 20:34	27.83	OK	600	2026-09-20 20:35	26.08	OK
601	2026-09-20 20:36	27.17	OK	602	2026-09-20 20:37	26.12	OK
603	2026-09-20 20:38	26.99	OK	604	2026-09-20 20:39	27.50	OK
605	2026-09-20 20:40	26.87	OK	606	2026-09-20 20:41	27.17	OK
607	2026-09-20 20:42	28.38	OK	608	2026-09-20 20:43	28.13	OK
609	2026-09-20 20:44	28.59	OK	610	2026-09-20 20:45	27.82	OK
611	2026-09-20 20:46	27.82	OK	612	2026-09-20 20:47	27.25	OK
613	2026-09-20 20:48	26.72	OK	614	2026-09-20 20:49	28.37	OK
615	2026-09-20 20:50	27.62	OK	616	2026-09-20 20:51	26.73	OK
617	2026-09-20 20:52	27.15	OK	618	2026-09-20 20:53	26.18	OK
619	2026-09-20 20:54	28.65	OK	620	2026-09-20 20:55	27.16	OK
621	2026-09-20 20:56	27.54	OK	622	2026-09-20 20:57	27.07	OK
623	2026-09-20 20:58	26.31	OK	624	2026-09-20 20:59	25.56	OK
625	2026-09-20 21:00	26.58	OK	626	2026-09-20 21:01	27.20	OK
627	2026-09-20 21:02	26.64	OK	628	2026-09-20 21:03	27.32	OK
629	2026-09-20 21:04	26.67	OK	630	2026-09-20 21:05	28.33	OK
631	2026-09-20 21:06	26.57	OK	632	2026-09-20 21:07	27.08	OK
633	2026-09-20 21:08	27.22	OK	634	2026-09-20 21:09	26.24	OK
635	2026-09-20 21:10	27.67	OK	636	2026-09-20 21:11	26.46	OK
637	2026-09-20 21:12	28.06	OK	638	2026-09-20 21:13	28.00	OK
639	2026-09-20 21:14	27.86	OK	640	2026-09-20 21:15	25.93	OK
641	2026-09-20 21:16	26.81	OK	642	2026-09-20 21:17	27.55	OK
643	2026-09-20 21:18	27.46	OK	644	2026-09-20 21:19	27.50	OK
645	2026-09-20 21:20	27.29	OK	646	2026-09-20 21:21	28.11	OK
647	2026-09-20 21:22	28.22	OK	648	2026-09-20 21:23	26.76	OK
649	2026-09-20 21:24	28.11	OK	650	2026-09-20 21:25	26.84	OK
651	2026-09-20 21:26	27.35	OK	652	2026-09-20 21:27	25.75	OK
653	2026-09-20 21:28	28.15	OK	654	2026-09-20 21:29	26.97	OK
655	2026-09-20 21:30	25.46	OK	656	2026-09-20 21:31	27.92	OK
657	2026-09-20 21:32	27.62	OK	658	2026-09-20 21:33	27.53	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
659	2026-09-20 21:34	27.50	OK	660	2026-09-20 21:35	27.13	OK
661	2026-09-20 21:36	26.02	OK	662	2026-09-20 21:37	27.03	OK
663	2026-09-20 21:38	27.77	OK	664	2026-09-20 21:39	28.13	OK
665	2026-09-20 21:40	28.85	OK	666	2026-09-20 21:41	26.94	OK
667	2026-09-20 21:42	26.71	OK	668	2026-09-20 21:43	28.60	OK
669	2026-09-20 21:44	27.58	OK	670	2026-09-20 21:45	28.06	OK
671	2026-09-20 21:46	29.50	OK	672	2026-09-20 21:47	27.85	OK
673	2026-09-20 21:48	27.72	OK	674	2026-09-20 21:49	25.86	OK
675	2026-09-20 21:50	27.78	OK	676	2026-09-20 21:51	27.37	OK
677	2026-09-20 21:52	28.18	OK	678	2026-09-20 21:53	26.00	OK
679	2026-09-20 21:54	26.73	OK	680	2026-09-20 21:55	26.54	OK
681	2026-09-20 21:56	25.79	OK	682	2026-09-20 21:57	28.06	OK
683	2026-09-20 21:58	28.17	OK	684	2026-09-20 21:59	26.70	OK
685	2026-09-20 22:00	27.15	OK	686	2026-09-20 22:01	27.53	OK
687	2026-09-20 22:02	28.74	OK	688	2026-09-20 22:03	28.12	OK
689	2026-09-20 22:04	26.42	OK	690	2026-09-20 22:05	26.69	OK
691	2026-09-20 22:06	27.43	OK	692	2026-09-20 22:07	27.63	OK
693	2026-09-20 22:08	28.30	OK	694	2026-09-20 22:09	28.51	OK
695	2026-09-20 22:10	27.27	OK	696	2026-09-20 22:11	26.86	OK
697	2026-09-20 22:12	27.82	OK	698	2026-09-20 22:13	27.85	OK
699	2026-09-20 22:14	28.83	OK	700	2026-09-20 22:15	27.63	OK
701	2026-09-20 22:16	27.68	OK	702	2026-09-20 22:17	27.66	OK
703	2026-09-20 22:18	26.46	OK	704	2026-09-20 22:19	27.52	OK
705	2026-09-20 22:20	29.39	OK	706	2026-09-20 22:21	28.34	OK
707	2026-09-20 22:22	28.97	OK	708	2026-09-20 22:23	27.08	OK
709	2026-09-20 22:24	27.63	OK	710	2026-09-20 22:25	28.66	OK
711	2026-09-20 22:26	27.17	OK	712	2026-09-20 22:27	26.42	OK
713	2026-09-20 22:28	27.11	OK	714	2026-09-20 22:29	27.92	OK
715	2026-09-20 22:30	29.10	OK	716	2026-09-20 22:31	29.38	OK
717	2026-09-20 22:32	28.71	OK	718	2026-09-20 22:33	27.07	OK
719	2026-09-20 22:34	27.82	OK	720	2026-09-20 22:35	28.17	OK
721	2026-09-20 22:36	28.15	OK	722	2026-09-20 22:37	27.28	OK
723	2026-09-20 22:38	29.14	OK	724	2026-09-20 22:39	28.88	OK
725	2026-09-20 22:40	26.58	OK	726	2026-09-20 22:41	28.47	OK
727	2026-09-20 22:42	27.18	OK	728	2026-09-20 22:43	29.39	OK
729	2026-09-20 22:44	27.16	OK	730	2026-09-20 22:45	27.23	OK
731	2026-09-20 22:46	29.02	OK	732	2026-09-20 22:47	28.87	OK
733	2026-09-20 22:48	29.00	OK	734	2026-09-20 22:49	28.93	OK
735	2026-09-20 22:50	27.36	OK	736	2026-09-20 22:51	26.82	OK
737	2026-09-20 22:52	27.16	OK	738	2026-09-20 22:53	26.79	OK
739	2026-09-20 22:54	27.38	OK	740	2026-09-20 22:55	29.19	OK
741	2026-09-20 22:56	27.37	OK	742	2026-09-20 22:57	29.40	OK
743	2026-09-20 22:58	26.80	OK	744	2026-09-20 22:59	29.40	OK
745	2026-09-20 23:00	27.25	OK	746	2026-09-20 23:01	28.93	OK
747	2026-09-20 23:02	28.72	OK	748	2026-09-20 23:03	28.41	OK
749	2026-09-20 23:04	28.04	OK	750	2026-09-20 23:05	27.93	OK
751	2026-09-20 23:06	28.89	OK	752	2026-09-20 23:07	28.23	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
753	2026-09-20 23:08	27.78	OK	754	2026-09-20 23:09	28.49	OK
755	2026-09-20 23:10	29.55	OK	756	2026-09-20 23:11	28.26	OK
757	2026-09-20 23:12	29.15	OK	758	2026-09-20 23:13	27.77	OK
759	2026-09-20 23:14	28.02	OK	760	2026-09-20 23:15	28.16	OK
761	2026-09-20 23:16	27.99	OK	762	2026-09-20 23:17	28.72	OK
763	2026-09-20 23:18	27.92	OK	764	2026-09-20 23:19	27.71	OK
765	2026-09-20 23:20	29.20	OK	766	2026-09-20 23:21	28.00	OK
767	2026-09-20 23:22	29.48	OK	768	2026-09-20 23:23	27.62	OK
769	2026-09-20 23:24	28.14	OK	770	2026-09-20 23:25	28.17	OK
771	2026-09-20 23:26	28.44	OK	772	2026-09-20 23:27	28.78	OK
773	2026-09-20 23:28	28.84	OK	774	2026-09-20 23:29	27.94	OK
775	2026-09-20 23:30	28.10	OK	776	2026-09-20 23:31	26.60	OK
777	2026-09-20 23:32	30.24	OK	778	2026-09-20 23:33	29.32	OK
779	2026-09-20 23:34	29.33	OK	780	2026-09-20 23:35	29.48	OK
781	2026-09-20 23:36	28.12	OK	782	2026-09-20 23:37	29.52	OK
783	2026-09-20 23:38	28.40	OK	784	2026-09-20 23:39	28.28	OK
785	2026-09-20 23:40	28.77	OK	786	2026-09-20 23:41	27.75	OK
787	2026-09-20 23:42	27.87	OK	788	2026-09-20 23:43	28.22	OK
789	2026-09-20 23:44	29.25	OK	790	2026-09-20 23:45	29.17	OK
791	2026-09-20 23:46	28.71	OK	792	2026-09-20 23:47	29.00	OK
793	2026-09-20 23:48	28.89	OK	794	2026-09-20 23:49	27.52	OK
795	2026-09-20 23:50	27.72	OK	796	2026-09-20 23:51	28.32	OK
797	2026-09-20 23:52	27.16	OK	798	2026-09-20 23:53	27.97	OK
799	2026-09-20 23:54	28.45	OK	800	2026-09-20 23:55	30.14	OK
801	2026-09-20 23:56	28.90	OK	802	2026-09-20 23:57	30.88	OK
803	2026-09-20 23:58	28.06	OK	804	2026-09-20 23:59	28.94	OK
805	2026-09-21 00:00	30.23	OK	806	2026-09-21 00:01	28.04	OK
807	2026-09-21 00:02	29.49	OK	808	2026-09-21 00:03	29.01	OK
809	2026-09-21 00:04	29.02	OK	810	2026-09-21 00:05	28.62	OK
811	2026-09-21 00:06	29.77	OK	812	2026-09-21 00:07	28.52	OK
813	2026-09-21 00:08	27.97	OK	814	2026-09-21 00:09	27.17	OK
815	2026-09-21 00:10	29.15	OK	816	2026-09-21 00:11	29.55	OK
817	2026-09-21 00:12	28.52	OK	818	2026-09-21 00:13	29.24	OK
819	2026-09-21 00:14	30.26	OK	820	2026-09-21 00:15	29.12	OK
821	2026-09-21 00:16	29.86	OK	822	2026-09-21 00:17	29.97	OK
823	2026-09-21 00:18	29.76	OK	824	2026-09-21 00:19	28.70	OK
825	2026-09-21 00:20	29.98	OK	826	2026-09-21 00:21	30.49	OK
827	2026-09-21 00:22	30.08	OK	828	2026-09-21 00:23	30.02	OK
829	2026-09-21 00:24	28.53	OK	830	2026-09-21 00:25	28.85	OK
831	2026-09-21 00:26	28.07	OK	832	2026-09-21 00:27	28.83	OK
833	2026-09-21 00:28	28.17	OK	834	2026-09-21 00:29	29.50	OK
835	2026-09-21 00:30	28.78	OK	836	2026-09-21 00:31	29.79	OK
837	2026-09-21 00:32	31.14	OK	838	2026-09-21 00:33	30.07	OK
839	2026-09-21 00:34	29.08	OK	840	2026-09-21 00:35	27.79	OK
841	2026-09-21 00:36	29.12	OK	842	2026-09-21 00:37	29.47	OK
843	2026-09-21 00:38	29.07	OK	844	2026-09-21 00:39	30.69	OK
845	2026-09-21 00:40	28.34	OK	846	2026-09-21 00:41	30.61	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
847	2026-09-21 00:42	30.39	OK	848	2026-09-21 00:43	30.72	OK
849	2026-09-21 00:44	30.16	OK	850	2026-09-21 00:45	30.30	OK
851	2026-09-21 00:46	29.54	OK	852	2026-09-21 00:47	28.99	OK
853	2026-09-21 00:48	28.71	OK	854	2026-09-21 00:49	29.28	OK
855	2026-09-21 00:50	28.65	OK	856	2026-09-21 00:51	29.11	OK
857	2026-09-21 00:52	30.28	OK	858	2026-09-21 00:53	29.66	OK
859	2026-09-21 00:54	29.97	OK	860	2026-09-21 00:55	28.23	OK
861	2026-09-21 00:56	28.81	OK	862	2026-09-21 00:57	30.45	OK
863	2026-09-21 00:58	28.39	OK	864	2026-09-21 00:59	29.91	OK
865	2026-09-21 01:00	29.69	OK	866	2026-09-21 01:01	29.83	OK
867	2026-09-21 01:02	28.68	OK	868	2026-09-21 01:03	29.92	OK
869	2026-09-21 01:04	29.88	OK	870	2026-09-21 01:05	28.61	OK
871	2026-09-21 01:06	29.71	OK	872	2026-09-21 01:07	29.95	OK
873	2026-09-21 01:08	29.93	OK	874	2026-09-21 01:09	30.85	OK
875	2026-09-21 01:10	30.88	OK	876	2026-09-21 01:11	29.84	OK
877	2026-09-21 01:12	29.90	OK	878	2026-09-21 01:13	28.57	OK
879	2026-09-21 01:14	28.19	OK	880	2026-09-21 01:15	28.62	OK
881	2026-09-21 01:16	28.47	OK	882	2026-09-21 01:17	29.83	OK
883	2026-09-21 01:18	29.13	OK	884	2026-09-21 01:19	30.83	OK
885	2026-09-21 01:20	31.81	OK	886	2026-09-21 01:21	29.87	OK
887	2026-09-21 01:22	29.98	OK	888	2026-09-21 01:23	28.19	OK
889	2026-09-21 01:24	28.41	OK	890	2026-09-21 01:25	30.87	OK
891	2026-09-21 01:26	29.43	OK	892	2026-09-21 01:27	29.89	OK
893	2026-09-21 01:28	30.46	OK	894	2026-09-21 01:29	28.63	OK
895	2026-09-21 01:30	28.66	OK	896	2026-09-21 01:31	29.84	OK
897	2026-09-21 01:32	31.63	OK	898	2026-09-21 01:33	30.98	OK
899	2026-09-21 01:34	30.28	OK	900	2026-09-21 01:35	28.11	OK
901	2026-09-21 01:36	28.27	OK	902	2026-09-21 01:37	30.36	OK
903	2026-09-21 01:38	27.95	OK	904	2026-09-21 01:39	29.37	OK
905	2026-09-21 01:40	29.61	OK	906	2026-09-21 01:41	30.35	OK
907	2026-09-21 01:42	29.79	OK	908	2026-09-21 01:43	30.68	OK
909	2026-09-21 01:44	29.77	OK	910	2026-09-21 01:45	31.13	OK
911	2026-09-21 01:46	31.98	OK	912	2026-09-21 01:47	29.38	OK
913	2026-09-21 01:48	29.04	OK	914	2026-09-21 01:49	30.05	OK
915	2026-09-21 01:50	30.93	OK	916	2026-09-21 01:51	30.08	OK
917	2026-09-21 01:52	31.05	OK	918	2026-09-21 01:53	31.33	OK
919	2026-09-21 01:54	29.62	OK	920	2026-09-21 01:55	31.14	OK
921	2026-09-21 01:56	28.94	OK	922	2026-09-21 01:57	30.74	OK
923	2026-09-21 01:58	28.71	OK	924	2026-09-21 01:59	31.62	OK
925	2026-09-21 02:00	30.28	OK	926	2026-09-21 02:01	29.12	OK
927	2026-09-21 02:02	31.65	OK	928	2026-09-21 02:03	30.43	OK
929	2026-09-21 02:04	30.26	OK	930	2026-09-21 02:05	29.50	OK
931	2026-09-21 02:06	30.89	OK	932	2026-09-21 02:07	30.61	OK
933	2026-09-21 02:08	30.44	OK	934	2026-09-21 02:09	30.35	OK
935	2026-09-21 02:10	30.67	OK	936	2026-09-21 02:11	30.23	OK
937	2026-09-21 02:12	29.77	OK	938	2026-09-21 02:13	30.28	OK
939	2026-09-21 02:14	31.54	OK	940	2026-09-21 02:15	29.69	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
941	2026-09-21 02:16	30.32	OK	942	2026-09-21 02:17	30.94	OK
943	2026-09-21 02:18	31.12	OK	944	2026-09-21 02:19	30.06	OK
945	2026-09-21 02:20	31.71	OK	946	2026-09-21 02:21	31.97	OK
947	2026-09-21 02:22	29.39	OK	948	2026-09-21 02:23	31.84	OK
949	2026-09-21 02:24	31.13	OK	950	2026-09-21 02:25	30.61	OK
951	2026-09-21 02:26	30.85	OK	952	2026-09-21 02:27	30.53	OK
953	2026-09-21 02:28	31.49	OK	954	2026-09-21 02:29	29.77	OK
955	2026-09-21 02:30	29.01	OK	956	2026-09-21 02:31	30.82	OK
957	2026-09-21 02:32	30.66	OK	958	2026-09-21 02:33	31.52	OK
959	2026-09-21 02:34	30.38	OK	960	2026-09-21 02:35	31.06	OK
961	2026-09-21 02:36	30.60	OK	962	2026-09-21 02:37	30.71	OK
963	2026-09-21 02:38	31.08	OK	964	2026-09-21 02:39	29.66	OK
965	2026-09-21 02:40	32.11	OK	966	2026-09-21 02:41	29.90	OK
967	2026-09-21 02:42	32.40	OK	968	2026-09-21 02:43	30.85	OK
969	2026-09-21 02:44	32.11	OK	970	2026-09-21 02:45	31.38	OK
971	2026-09-21 02:46	29.93	OK	972	2026-09-21 02:47	31.40	OK
973	2026-09-21 02:48	30.99	OK	974	2026-09-21 02:49	30.51	OK
975	2026-09-21 02:50	29.56	OK	976	2026-09-21 02:51	30.61	OK
977	2026-09-21 02:52	31.94	OK	978	2026-09-21 02:53	29.35	OK
979	2026-09-21 02:54	30.34	OK	980	2026-09-21 02:55	32.07	OK
981	2026-09-21 02:56	30.72	OK	982	2026-09-21 02:57	31.58	OK
983	2026-09-21 02:58	31.08	OK	984	2026-09-21 02:59	31.17	OK
985	2026-09-21 03:00	29.82	OK	986	2026-09-21 03:01	30.25	OK
987	2026-09-21 03:02	30.21	OK	988	2026-09-21 03:03	31.06	OK
989	2026-09-21 03:04	31.12	OK	990	2026-09-21 03:05	29.52	OK
991	2026-09-21 03:06	29.62	OK	992	2026-09-21 03:07	30.92	OK
993	2026-09-21 03:08	31.36	OK	994	2026-09-21 03:09	31.28	OK
995	2026-09-21 03:10	29.60	OK	996	2026-09-21 03:11	31.13	OK
997	2026-09-21 03:12	31.26	OK	998	2026-09-21 03:13	29.97	OK
999	2026-09-21 03:14	30.38	OK	1000	2026-09-21 03:15	31.03	OK
1001	2026-09-21 03:16	30.89	OK	1002	2026-09-21 03:17	30.50	OK
1003	2026-09-21 03:18	31.04	OK	1004	2026-09-21 03:19	30.91	OK
1005	2026-09-21 03:20	30.71	OK	1006	2026-09-21 03:21	30.38	OK
1007	2026-09-21 03:22	30.32	OK	1008	2026-09-21 03:23	31.82	OK
1009	2026-09-21 03:24	30.93	OK	1010	2026-09-21 03:25	30.22	OK
1011	2026-09-21 03:26	31.32	OK	1012	2026-09-21 03:27	29.24	OK
1013	2026-09-21 03:28	31.71	OK	1014	2026-09-21 03:29	30.59	OK
1015	2026-09-21 03:30	31.39	OK	1016	2026-09-21 03:31	31.22	OK
1017	2026-09-21 03:32	30.90	OK	1018	2026-09-21 03:33	30.75	OK
1019	2026-09-21 03:34	30.24	OK	1020	2026-09-21 03:35	31.63	OK
1021	2026-09-21 03:36	30.90	OK	1022	2026-09-21 03:37	31.49	OK
1023	2026-09-21 03:38	31.12	OK	1024	2026-09-21 03:39	30.67	OK
1025	2026-09-21 03:40	31.90	OK	1026	2026-09-21 03:41	30.54	OK
1027	2026-09-21 03:42	31.55	OK	1028	2026-09-21 03:43	32.85	OK
1029	2026-09-21 03:44	31.40	OK	1030	2026-09-21 03:45	31.65	OK
1031	2026-09-21 03:46	30.88	OK	1032	2026-09-21 03:47	30.52	OK
1033	2026-09-21 03:48	31.93	OK	1034	2026-09-21 03:49	31.02	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1035	2026-09-21 03:50	32.01	OK	1036	2026-09-21 03:51	30.63	OK
1037	2026-09-21 03:52	32.54	OK	1038	2026-09-21 03:53	32.00	OK
1039	2026-09-21 03:54	30.56	OK	1040	2026-09-21 03:55	32.33	OK
1041	2026-09-21 03:56	30.97	OK	1042	2026-09-21 03:57	31.60	OK
1043	2026-09-21 03:58	30.28	OK	1044	2026-09-21 03:59	31.43	OK
1045	2026-09-21 04:00	30.49	OK	1046	2026-09-21 04:01	29.79	OK
1047	2026-09-21 04:02	30.50	OK	1048	2026-09-21 04:03	32.68	OK
1049	2026-09-21 04:04	31.35	OK	1050	2026-09-21 04:05	31.92	OK
1051	2026-09-21 04:06	31.26	OK	1052	2026-09-21 04:07	32.17	OK
1053	2026-09-21 04:08	31.86	OK	1054	2026-09-21 04:09	32.45	OK
1055	2026-09-21 04:10	30.64	OK	1056	2026-09-21 04:11	30.95	OK
1057	2026-09-21 04:12	32.49	OK	1058	2026-09-21 04:13	31.77	OK
1059	2026-09-21 04:14	31.90	OK	1060	2026-09-21 04:15	31.54	OK
1061	2026-09-21 04:16	31.25	OK	1062	2026-09-21 04:17	30.59	OK
1063	2026-09-21 04:18	30.97	OK	1064	2026-09-21 04:19	31.57	OK
1065	2026-09-21 04:20	31.15	OK	1066	2026-09-21 04:21	31.25	OK
1067	2026-09-21 04:22	30.86	OK	1068	2026-09-21 04:23	30.99	OK
1069	2026-09-21 04:24	32.26	OK	1070	2026-09-21 04:25	30.63	OK
1071	2026-09-21 04:26	32.91	OK	1072	2026-09-21 04:27	31.05	OK
1073	2026-09-21 04:28	32.22	OK	1074	2026-09-21 04:29	32.38	OK
1075	2026-09-21 04:30	30.08	OK	1076	2026-09-21 04:31	29.88	OK
1077	2026-09-21 04:32	32.57	OK	1078	2026-09-21 04:33	31.52	OK
1079	2026-09-21 04:34	32.50	OK	1080	2026-09-21 04:35	31.34	OK
1081	2026-09-21 04:36	30.65	OK	1082	2026-09-21 04:37	30.37	OK
1083	2026-09-21 04:38	33.34	OK	1084	2026-09-21 04:39	31.58	OK
1085	2026-09-21 04:40	32.42	OK	1086	2026-09-21 04:41	31.20	OK
1087	2026-09-21 04:42	32.22	OK	1088	2026-09-21 04:43	32.45	OK
1089	2026-09-21 04:44	31.08	OK	1090	2026-09-21 04:45	32.16	OK
1091	2026-09-21 04:46	32.72	OK	1092	2026-09-21 04:47	31.33	OK
1093	2026-09-21 04:48	32.06	OK	1094	2026-09-21 04:49	31.94	OK
1095	2026-09-21 04:50	32.15	OK	1096	2026-09-21 04:51	33.39	OK
1097	2026-09-21 04:52	30.05	OK	1098	2026-09-21 04:53	32.01	OK
1099	2026-09-21 04:54	31.97	OK	1100	2026-09-21 04:55	32.33	OK
1101	2026-09-21 04:56	32.45	OK	1102	2026-09-21 04:57	32.54	OK
1103	2026-09-21 04:58	31.23	OK	1104	2026-09-21 04:59	32.33	OK
1105	2026-09-21 05:00	32.20	OK	1106	2026-09-21 05:01	31.42	OK
1107	2026-09-21 05:02	32.30	OK	1108	2026-09-21 05:03	30.89	OK
1109	2026-09-21 05:04	32.18	OK	1110	2026-09-21 05:05	32.37	OK
1111	2026-09-21 05:06	33.17	OK	1112	2026-09-21 05:07	30.61	OK
1113	2026-09-21 05:08	31.11	OK	1114	2026-09-21 05:09	30.83	OK
1115	2026-09-21 05:10	30.11	OK	1116	2026-09-21 05:11	30.54	OK
1117	2026-09-21 05:12	32.27	OK	1118	2026-09-21 05:13	31.34	OK
1119	2026-09-21 05:14	30.08	OK	1120	2026-09-21 05:15	31.29	OK
1121	2026-09-21 05:16	31.46	OK	1122	2026-09-21 05:17	30.92	OK
1123	2026-09-21 05:18	31.72	OK	1124	2026-09-21 05:19	32.05	OK
1125	2026-09-21 05:20	32.18	OK	1126	2026-09-21 05:21	32.63	OK
1127	2026-09-21 05:22	32.17	OK	1128	2026-09-21 05:23	31.68	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1129	2026-09-21 05:24	31.96	OK	1130	2026-09-21 05:25	31.80	OK
1131	2026-09-21 05:26	31.40	OK	1132	2026-09-21 05:27	30.80	OK
1133	2026-09-21 05:28	31.96	OK	1134	2026-09-21 05:29	31.37	OK
1135	2026-09-21 05:30	32.14	OK	1136	2026-09-21 05:31	31.96	OK
1137	2026-09-21 05:32	30.70	OK	1138	2026-09-21 05:33	31.98	OK
1139	2026-09-21 05:34	32.01	OK	1140	2026-09-21 05:35	31.79	OK
1141	2026-09-21 05:36	32.88	OK	1142	2026-09-21 05:37	32.42	OK
1143	2026-09-21 05:38	31.45	OK	1144	2026-09-21 05:39	31.72	OK
1145	2026-09-21 05:40	32.36	OK	1146	2026-09-21 05:41	31.14	OK
1147	2026-09-21 05:42	31.97	OK	1148	2026-09-21 05:43	32.51	OK
1149	2026-09-21 05:44	32.12	OK	1150	2026-09-21 05:45	33.30	OK
1151	2026-09-21 05:46	30.45	OK	1152	2026-09-21 05:47	31.66	OK
1153	2026-09-21 05:48	31.60	OK	1154	2026-09-21 05:49	31.87	OK
1155	2026-09-21 05:50	31.18	OK	1156	2026-09-21 05:51	31.51	OK
1157	2026-09-21 05:52	31.13	OK	1158	2026-09-21 05:53	31.94	OK
1159	2026-09-21 05:54	31.57	OK	1160	2026-09-21 05:55	30.12	OK
1161	2026-09-21 05:56	30.53	OK	1162	2026-09-21 05:57	30.48	OK
1163	2026-09-21 05:58	30.85	OK	1164	2026-09-21 05:59	32.14	OK
1165	2026-09-21 06:00	32.14	OK	1166	2026-09-21 06:01	30.66	OK
1167	2026-09-21 06:02	32.89	OK	1168	2026-09-21 06:03	32.50	OK
1169	2026-09-21 06:04	31.82	OK	1170	2026-09-21 06:05	31.11	OK
1171	2026-09-21 06:06	31.95	OK	1172	2026-09-21 06:07	29.90	OK
1173	2026-09-21 06:08	31.29	OK	1174	2026-09-21 06:09	32.87	OK
1175	2026-09-21 06:10	32.14	OK	1176	2026-09-21 06:11	30.78	OK
1177	2026-09-21 06:12	32.58	OK	1178	2026-09-21 06:13	32.89	OK
1179	2026-09-21 06:14	32.51	OK	1180	2026-09-21 06:15	30.47	OK
1181	2026-09-21 06:16	33.74	OK	1182	2026-09-21 06:17	33.10	OK
1183	2026-09-21 06:18	29.99	OK	1184	2026-09-21 06:19	31.72	OK
1185	2026-09-21 06:20	32.40	OK	1186	2026-09-21 06:21	31.06	OK
1187	2026-09-21 06:22	31.26	OK	1188	2026-09-21 06:23	33.52	OK
1189	2026-09-21 06:24	31.78	OK	1190	2026-09-21 06:25	30.14	OK
1191	2026-09-21 06:26	32.32	OK	1192	2026-09-21 06:27	31.14	OK
1193	2026-09-21 06:28	32.12	OK	1194	2026-09-21 06:29	31.59	OK
1195	2026-09-21 06:30	32.49	OK	1196	2026-09-21 06:31	30.65	OK
1197	2026-09-21 06:32	31.25	OK	1198	2026-09-21 06:33	32.40	OK
1199	2026-09-21 06:34	31.18	OK	1200	2026-09-21 06:35	31.19	OK
1201	2026-09-21 06:36	32.22	OK	1202	2026-09-21 06:37	32.47	OK
1203	2026-09-21 06:38	32.01	OK	1204	2026-09-21 06:39	31.15	OK
1205	2026-09-21 06:40	32.31	OK	1206	2026-09-21 06:41	32.40	OK
1207	2026-09-21 06:42	31.87	OK	1208	2026-09-21 06:43	30.95	OK
1209	2026-09-21 06:44	32.33	OK	1210	2026-09-21 06:45	32.21	OK
1211	2026-09-21 06:46	31.55	OK	1212	2026-09-21 06:47	31.84	OK
1213	2026-09-21 06:48	30.82	OK	1214	2026-09-21 06:49	31.28	OK
1215	2026-09-21 06:50	31.76	OK	1216	2026-09-21 06:51	32.53	OK
1217	2026-09-21 06:52	32.02	OK	1218	2026-09-21 06:53	32.79	OK
1219	2026-09-21 06:54	32.33	OK	1220	2026-09-21 06:55	32.27	OK
1221	2026-09-21 06:56	32.37	OK	1222	2026-09-21 06:57	30.76	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1223	2026-09-21 06:58	31.55	OK	1224	2026-09-21 06:59	31.45	OK
1225	2026-09-21 07:00	31.68	OK	1226	2026-09-21 07:01	31.03	OK
1227	2026-09-21 07:02	31.14	OK	1228	2026-09-21 07:03	31.37	OK
1229	2026-09-21 07:04	32.87	OK	1230	2026-09-21 07:05	32.39	OK
1231	2026-09-21 07:06	31.79	OK	1232	2026-09-21 07:07	31.80	OK
1233	2026-09-21 07:08	30.35	OK	1234	2026-09-21 07:09	31.10	OK
1235	2026-09-21 07:10	32.19	OK	1236	2026-09-21 07:11	33.38	OK
1237	2026-09-21 07:12	31.45	OK	1238	2026-09-21 07:13	31.77	OK
1239	2026-09-21 07:14	30.31	OK	1240	2026-09-21 07:15	30.86	OK
1241	2026-09-21 07:16	32.96	OK	1242	2026-09-21 07:17	31.83	OK
1243	2026-09-21 07:18	30.97	OK	1244	2026-09-21 07:19	32.45	OK
1245	2026-09-21 07:20	31.64	OK	1246	2026-09-21 07:21	31.20	OK
1247	2026-09-21 07:22	30.32	OK	1248	2026-09-21 07:23	31.35	OK
1249	2026-09-21 07:24	30.96	OK	1250	2026-09-21 07:25	32.57	OK
1251	2026-09-21 07:26	32.16	OK	1252	2026-09-21 07:27	31.01	OK
1253	2026-09-21 07:28	30.33	OK	1254	2026-09-21 07:29	31.18	OK
1255	2026-09-21 07:30	31.58	OK	1256	2026-09-21 07:31	32.45	OK
1257	2026-09-21 07:32	31.56	OK	1258	2026-09-21 07:33	31.95	OK
1259	2026-09-21 07:34	31.82	OK	1260	2026-09-21 07:35	33.45	OK
1261	2026-09-21 07:36	32.14	OK	1262	2026-09-21 07:37	32.92	OK
1263	2026-09-21 07:38	32.50	OK	1264	2026-09-21 07:39	31.90	OK
1265	2026-09-21 07:40	32.10	OK	1266	2026-09-21 07:41	30.84	OK
1267	2026-09-21 07:42	32.84	OK	1268	2026-09-21 07:43	30.24	OK
1269	2026-09-21 07:44	31.20	OK	1270	2026-09-21 07:45	31.80	OK
1271	2026-09-21 07:46	33.54	OK	1272	2026-09-21 07:47	33.03	OK
1273	2026-09-21 07:48	30.80	OK	1274	2026-09-21 07:49	31.93	OK
1275	2026-09-21 07:50	31.05	OK	1276	2026-09-21 07:51	31.23	OK
1277	2026-09-21 07:52	30.80	OK	1278	2026-09-21 07:53	31.96	OK
1279	2026-09-21 07:54	31.07	OK	1280	2026-09-21 07:55	31.71	OK
1281	2026-09-21 07:56	31.42	OK	1282	2026-09-21 07:57	31.57	OK
1283	2026-09-21 07:58	31.58	OK	1284	2026-09-21 07:59	32.17	OK
1285	2026-09-21 08:00	31.62	OK	1286	2026-09-21 08:01	32.66	OK
1287	2026-09-21 08:02	31.76	OK	1288	2026-09-21 08:03	32.01	OK
1289	2026-09-21 08:04	30.54	OK	1290	2026-09-21 08:05	31.61	OK
1291	2026-09-21 08:06	32.85	OK	1292	2026-09-21 08:07	32.46	OK
1293	2026-09-21 08:08	31.75	OK	1294	2026-09-21 08:09	31.47	OK
1295	2026-09-21 08:10	32.13	OK	1296	2026-09-21 08:11	30.73	OK
1297	2026-09-21 08:12	30.87	OK	1298	2026-09-21 08:13	32.56	OK
1299	2026-09-21 08:14	31.21	OK	1300	2026-09-21 08:15	31.79	OK
1301	2026-09-21 08:16	31.00	OK	1302	2026-09-21 08:17	30.58	OK
1303	2026-09-21 08:18	32.81	OK	1304	2026-09-21 08:19	32.37	OK
1305	2026-09-21 08:20	32.25	OK	1306	2026-09-21 08:21	30.96	OK
1307	2026-09-21 08:22	31.36	OK	1308	2026-09-21 08:23	30.46	OK
1309	2026-09-21 08:24	32.03	OK	1310	2026-09-21 08:25	30.33	OK
1311	2026-09-21 08:26	33.33	OK	1312	2026-09-21 08:27	33.06	OK
1313	2026-09-21 08:28	30.53	OK	1314	2026-09-21 08:29	33.29	OK
1315	2026-09-21 08:30	31.68	OK	1316	2026-09-21 08:31	30.34	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1317	2026-09-21 08:32	31.78	OK	1318	2026-09-21 08:33	30.71	OK
1319	2026-09-21 08:34	32.30	OK	1320	2026-09-21 08:35	31.45	OK
1321	2026-09-21 08:36	31.46	OK	1322	2026-09-21 08:37	31.98	OK
1323	2026-09-21 08:38	31.01	OK	1324	2026-09-21 08:39	32.79	OK
1325	2026-09-21 08:40	31.93	OK	1326	2026-09-21 08:41	32.69	OK
1327	2026-09-21 08:42	30.23	OK	1328	2026-09-21 08:43	32.60	OK
1329	2026-09-21 08:44	30.89	OK	1330	2026-09-21 08:45	32.19	OK
1331	2026-09-21 08:46	32.01	OK	1332	2026-09-21 08:47	30.77	OK
1333	2026-09-21 08:48	30.31	OK	1334	2026-09-21 08:49	31.40	OK
1335	2026-09-21 08:50	31.70	OK	1336	2026-09-21 08:51	31.34	OK
1337	2026-09-21 08:52	31.51	OK	1338	2026-09-21 08:53	29.58	OK
1339	2026-09-21 08:54	29.46	OK	1340	2026-09-21 08:55	30.10	OK
1341	2026-09-21 08:56	30.46	OK	1342	2026-09-21 08:57	31.56	OK
1343	2026-09-21 08:58	32.13	OK	1344	2026-09-21 08:59	30.61	OK
1345	2026-09-21 09:00	31.42	OK	1346	2026-09-21 09:01	31.53	OK
1347	2026-09-21 09:02	29.98	OK	1348	2026-09-21 09:03	31.52	OK
1349	2026-09-21 09:04	29.30	OK	1350	2026-09-21 09:05	30.46	OK
1351	2026-09-21 09:06	32.41	OK	1352	2026-09-21 09:07	32.74	OK
1353	2026-09-21 09:08	29.46	OK	1354	2026-09-21 09:09	31.31	OK
1355	2026-09-21 09:10	30.70	OK	1356	2026-09-21 09:11	31.60	OK
1357	2026-09-21 09:12	29.71	OK	1358	2026-09-21 09:13	30.53	OK
1359	2026-09-21 09:14	30.63	OK	1360	2026-09-21 09:15	31.40	OK
1361	2026-09-21 09:16	31.31	OK	1362	2026-09-21 09:17	31.37	OK
1363	2026-09-21 09:18	31.72	OK	1364	2026-09-21 09:19	30.16	OK
1365	2026-09-21 09:20	30.01	OK	1366	2026-09-21 09:21	33.02	OK
1367	2026-09-21 09:22	31.94	OK	1368	2026-09-21 09:23	31.99	OK
1369	2026-09-21 09:24	30.94	OK	1370	2026-09-21 09:25	32.23	OK
1371	2026-09-21 09:26	31.63	OK	1372	2026-09-21 09:27	30.49	OK
1373	2026-09-21 09:28	31.64	OK	1374	2026-09-21 09:29	29.89	OK
1375	2026-09-21 09:30	31.19	OK	1376	2026-09-21 09:31	30.72	OK
1377	2026-09-21 09:32	31.93	OK	1378	2026-09-21 09:33	30.92	OK
1379	2026-09-21 09:34	30.24	OK	1380	2026-09-21 09:35	31.28	OK
1381	2026-09-21 09:36	29.31	OK	1382	2026-09-21 09:37	29.78	OK
1383	2026-09-21 09:38	30.80	OK	1384	2026-09-21 09:39	32.26	OK
1385	2026-09-21 09:40	31.84	OK	1386	2026-09-21 09:41	30.27	OK
1387	2026-09-21 09:42	30.55	OK	1388	2026-09-21 09:43	30.05	OK
1389	2026-09-21 09:44	31.14	OK	1390	2026-09-21 09:45	31.13	OK
1391	2026-09-21 09:46	30.36	OK	1392	2026-09-21 09:47	29.61	OK
1393	2026-09-21 09:48	31.56	OK	1394	2026-09-21 09:49	31.78	OK
1395	2026-09-21 09:50	29.97	OK	1396	2026-09-21 09:51	30.06	OK
1397	2026-09-21 09:52	30.49	OK	1398	2026-09-21 09:53	31.95	OK
1399	2026-09-21 09:54	30.36	OK	1400	2026-09-21 09:55	28.92	OK
1401	2026-09-21 09:56	29.01	OK	1402	2026-09-21 09:57	30.66	OK
1403	2026-09-21 09:58	31.13	OK	1404	2026-09-21 09:59	30.76	OK
1405	2026-09-21 10:00	32.53	OK	1406	2026-09-21 10:01	29.39	OK
1407	2026-09-21 10:02	30.62	OK	1408	2026-09-21 10:03	30.61	OK
1409	2026-09-21 10:04	31.05	OK	1410	2026-09-21 10:05	30.72	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1411	2026-09-21 10:06	30.37	OK	1412	2026-09-21 10:07	29.69	OK
1413	2026-09-21 10:08	30.28	OK	1414	2026-09-21 10:09	29.65	OK
1415	2026-09-21 10:10	30.92	OK	1416	2026-09-21 10:11	30.35	OK
1417	2026-09-21 10:12	31.02	OK	1418	2026-09-21 10:13	30.68	OK
1419	2026-09-21 10:14	31.28	OK	1420	2026-09-21 10:15	31.85	OK
1421	2026-09-21 10:16	30.73	OK	1422	2026-09-21 10:17	31.60	OK
1423	2026-09-21 10:18	31.42	OK	1424	2026-09-21 10:19	30.40	OK
1425	2026-09-21 10:20	30.46	OK	1426	2026-09-21 10:21	30.81	OK
1427	2026-09-21 10:22	31.79	OK	1428	2026-09-21 10:23	30.52	OK
1429	2026-09-21 10:24	30.82	OK	1430	2026-09-21 10:25	31.15	OK
1431	2026-09-21 10:26	29.57	OK	1432	2026-09-21 10:27	30.08	OK
1433	2026-09-21 10:28	31.87	OK	1434	2026-09-21 10:29	29.97	OK
1435	2026-09-21 10:30	30.08	OK	1436	2026-09-21 10:31	29.13	OK
1437	2026-09-21 10:32	31.09	OK	1438	2026-09-21 10:33	30.22	OK
1439	2026-09-21 10:34	30.65	OK	1440	2026-09-21 10:35	31.03	OK
1441	2026-09-21 10:36	31.90	OK	1442	2026-09-21 10:37	30.35	OK
1443	2026-09-21 10:38	29.78	OK	1444	2026-09-21 10:39	32.17	OK
1445	2026-09-21 10:40	31.18	OK	1446	2026-09-21 10:41	29.84	OK
1447	2026-09-21 10:42	30.59	OK	1448	2026-09-21 10:43	29.47	OK
1449	2026-09-21 10:44	30.19	OK	1450	2026-09-21 10:45	31.54	OK
1451	2026-09-21 10:46	29.65	OK	1452	2026-09-21 10:47	30.93	OK
1453	2026-09-21 10:48	30.95	OK	1454	2026-09-21 10:49	29.47	OK
1455	2026-09-21 10:50	30.20	OK	1456	2026-09-21 10:51	31.27	OK
1457	2026-09-21 10:52	30.89	OK	1458	2026-09-21 10:53	30.34	OK
1459	2026-09-21 10:54	28.87	OK	1460	2026-09-21 10:55	31.09	OK
1461	2026-09-21 10:56	30.30	OK	1462	2026-09-21 10:57	30.52	OK
1463	2026-09-21 10:58	29.55	OK	1464	2026-09-21 10:59	30.43	OK
1465	2026-09-21 11:00	30.74	OK	1466	2026-09-21 11:01	29.68	OK
1467	2026-09-21 11:02	29.32	OK	1468	2026-09-21 11:03	31.29	OK
1469	2026-09-21 11:04	30.12	OK	1470	2026-09-21 11:05	30.24	OK
1471	2026-09-21 11:06	31.27	OK	1472	2026-09-21 11:07	31.38	OK
1473	2026-09-21 11:08	28.83	OK	1474	2026-09-21 11:09	30.24	OK
1475	2026-09-21 11:10	29.10	OK	1476	2026-09-21 11:11	30.99	OK
1477	2026-09-21 11:12	30.26	OK	1478	2026-09-21 11:13	30.71	OK
1479	2026-09-21 11:14	29.86	OK	1480	2026-09-21 11:15	28.99	OK
1481	2026-09-21 11:16	30.71	OK	1482	2026-09-21 11:17	30.10	OK
1483	2026-09-21 11:18	31.78	OK	1484	2026-09-21 11:19	30.43	OK
1485	2026-09-21 11:20	30.13	OK	1486	2026-09-21 11:21	29.16	OK
1487	2026-09-21 11:22	30.07	OK	1488	2026-09-21 11:23	29.52	OK
1489	2026-09-21 11:24	29.83	OK	1490	2026-09-21 11:25	30.07	OK
1491	2026-09-21 11:26	29.70	OK	1492	2026-09-21 11:27	28.26	OK
1493	2026-09-21 11:28	30.41	OK	1494	2026-09-21 11:29	29.33	OK
1495	2026-09-21 11:30	31.27	OK	1496	2026-09-21 11:31	30.18	OK
1497	2026-09-21 11:32	31.65	OK	1498	2026-09-21 11:33	29.79	OK
1499	2026-09-21 11:34	30.42	OK	1500	2026-09-21 11:35	30.59	OK
1501	2026-09-21 11:36	29.99	OK	1502	2026-09-21 11:37	29.55	OK
1503	2026-09-21 11:38	29.61	OK	1504	2026-09-21 11:39	28.33	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1505	2026-09-21 11:40	30.08	OK	1506	2026-09-21 11:41	30.10	OK
1507	2026-09-21 11:42	28.88	OK	1508	2026-09-21 11:43	29.51	OK
1509	2026-09-21 11:44	30.80	OK	1510	2026-09-21 11:45	28.81	OK
1511	2026-09-21 11:46	31.41	OK	1512	2026-09-21 11:47	28.34	OK
1513	2026-09-21 11:48	29.13	OK	1514	2026-09-21 11:49	30.35	OK
1515	2026-09-21 11:50	29.85	OK	1516	2026-09-21 11:51	28.09	OK
1517	2026-09-21 11:52	29.28	OK	1518	2026-09-21 11:53	30.12	OK
1519	2026-09-21 11:54	30.06	OK	1520	2026-09-21 11:55	30.16	OK
1521	2026-09-21 11:56	30.32	OK	1522	2026-09-21 11:57	27.54	OK
1523	2026-09-21 11:58	28.93	OK	1524	2026-09-21 11:59	29.12	OK
1525	2026-09-21 12:00	29.67	OK	1526	2026-09-21 12:01	29.52	OK
1527	2026-09-21 12:02	29.95	OK	1528	2026-09-21 12:03	29.98	OK
1529	2026-09-21 12:04	28.80	OK	1530	2026-09-21 12:05	29.47	OK
1531	2026-09-21 12:06	28.37	OK	1532	2026-09-21 12:07	30.76	OK
1533	2026-09-21 12:08	29.72	OK	1534	2026-09-21 12:09	28.22	OK
1535	2026-09-21 12:10	28.87	OK	1536	2026-09-21 12:11	29.49	OK
1537	2026-09-21 12:12	28.57	OK	1538	2026-09-21 12:13	28.41	OK
1539	2026-09-21 12:14	29.37	OK	1540	2026-09-21 12:15	29.98	OK
1541	2026-09-21 12:16	30.06	OK	1542	2026-09-21 12:17	28.67	OK
1543	2026-09-21 12:18	29.72	OK	1544	2026-09-21 12:19	28.83	OK
1545	2026-09-21 12:20	28.88	OK	1546	2026-09-21 12:21	28.46	OK
1547	2026-09-21 12:22	28.67	OK	1548	2026-09-21 12:23	28.32	OK
1549	2026-09-21 12:24	29.93	OK	1550	2026-09-21 12:25	29.46	OK
1551	2026-09-21 12:26	29.06	OK	1552	2026-09-21 12:27	28.66	OK
1553	2026-09-21 12:28	30.12	OK	1554	2026-09-21 12:29	29.23	OK
1555	2026-09-21 12:30	29.07	OK	1556	2026-09-21 12:31	30.05	OK
1557	2026-09-21 12:32	27.82	OK	1558	2026-09-21 12:33	29.75	OK
1559	2026-09-21 12:34	28.93	OK	1560	2026-09-21 12:35	28.46	OK
1561	2026-09-21 12:36	29.29	OK	1562	2026-09-21 12:37	29.88	OK
1563	2026-09-21 12:38	28.28	OK	1564	2026-09-21 12:39	28.54	OK
1565	2026-09-21 12:40	30.48	OK	1566	2026-09-21 12:41	28.12	OK
1567	2026-09-21 12:42	28.68	OK	1568	2026-09-21 12:43	29.57	OK
1569	2026-09-21 12:44	29.44	OK	1570	2026-09-21 12:45	29.34	OK
1571	2026-09-21 12:46	28.48	OK	1572	2026-09-21 12:47	28.10	OK
1573	2026-09-21 12:48	30.87	OK	1574	2026-09-21 12:49	29.31	OK
1575	2026-09-21 12:50	27.97	OK	1576	2026-09-21 12:51	27.79	OK
1577	2026-09-21 12:52	28.40	OK	1578	2026-09-21 12:53	29.03	OK
1579	2026-09-21 12:54	29.50	OK	1580	2026-09-21 12:55	28.16	OK
1581	2026-09-21 12:56	26.93	OK	1582	2026-09-21 12:57	27.99	OK
1583	2026-09-21 12:58	28.21	OK	1584	2026-09-21 12:59	29.67	OK
1585	2026-09-21 13:00	29.23	OK	1586	2026-09-21 13:01	28.64	OK
1587	2026-09-21 13:02	27.68	OK	1588	2026-09-21 13:03	29.86	OK
1589	2026-09-21 13:04	28.91	OK	1590	2026-09-21 13:05	30.46	OK
1591	2026-09-21 13:06	28.99	OK	1592	2026-09-21 13:07	29.01	OK
1593	2026-09-21 13:08	29.95	OK	1594	2026-09-21 13:09	29.40	OK
1595	2026-09-21 13:10	28.20	OK	1596	2026-09-21 13:11	29.11	OK
1597	2026-09-21 13:12	30.15	OK	1598	2026-09-21 13:13	29.78	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1599	2026-09-21 13:14	28.71	OK	1600	2026-09-21 13:15	29.16	OK
1601	2026-09-21 13:16	27.21	OK	1602	2026-09-21 13:17	28.47	OK
1603	2026-09-21 13:18	28.66	OK	1604	2026-09-21 13:19	28.73	OK
1605	2026-09-21 13:20	29.87	OK	1606	2026-09-21 13:21	27.56	OK
1607	2026-09-21 13:22	27.63	OK	1608	2026-09-21 13:23	28.03	OK
1609	2026-09-21 13:24	27.95	OK	1610	2026-09-21 13:25	30.02	OK
1611	2026-09-21 13:26	28.18	OK	1612	2026-09-21 13:27	29.90	OK
1613	2026-09-21 13:28	28.59	OK	1614	2026-09-21 13:29	28.37	OK
1615	2026-09-21 13:30	29.78	OK	1616	2026-09-21 13:31	29.05	OK
1617	2026-09-21 13:32	27.85	OK	1618	2026-09-21 13:33	28.56	OK
1619	2026-09-21 13:34	27.95	OK	1620	2026-09-21 13:35	27.82	OK
1621	2026-09-21 13:36	28.42	OK	1622	2026-09-21 13:37	27.63	OK
1623	2026-09-21 13:38	27.11	OK	1624	2026-09-21 13:39	28.66	OK
1625	2026-09-21 13:40	29.36	OK	1626	2026-09-21 13:41	29.43	OK
1627	2026-09-21 13:42	29.72	OK	1628	2026-09-21 13:43	28.22	OK
1629	2026-09-21 13:44	28.46	OK	1630	2026-09-21 13:45	28.48	OK
1631	2026-09-21 13:46	28.50	OK	1632	2026-09-21 13:47	28.09	OK
1633	2026-09-21 13:48	29.69	OK	1634	2026-09-21 13:49	27.59	OK
1635	2026-09-21 13:50	27.77	OK	1636	2026-09-21 13:51	26.35	OK
1637	2026-09-21 13:52	29.42	OK	1638	2026-09-21 13:53	28.83	OK
1639	2026-09-21 13:54	28.89	OK	1640	2026-09-21 13:55	29.04	OK
1641	2026-09-21 13:56	29.47	OK	1642	2026-09-21 13:57	30.32	OK
1643	2026-09-21 13:58	27.47	OK	1644	2026-09-21 13:59	28.55	OK
1645	2026-09-21 14:00	28.63	OK	1646	2026-09-21 14:01	27.41	OK
1647	2026-09-21 14:02	28.06	OK	1648	2026-09-21 14:03	29.21	OK
1649	2026-09-21 14:04	28.37	OK	1650	2026-09-21 14:05	28.88	OK
1651	2026-09-21 14:06	26.91	OK	1652	2026-09-21 14:07	26.99	OK
1653	2026-09-21 14:08	27.18	OK	1654	2026-09-21 14:09	29.20	OK
1655	2026-09-21 14:10	28.19	OK	1656	2026-09-21 14:11	29.32	OK
1657	2026-09-21 14:12	28.23	OK	1658	2026-09-21 14:13	29.67	OK
1659	2026-09-21 14:14	27.90	OK	1660	2026-09-21 14:15	27.34	OK
1661	2026-09-21 14:16	27.22	OK	1662	2026-09-21 14:17	27.40	OK
1663	2026-09-21 14:18	28.92	OK	1664	2026-09-21 14:19	28.19	OK
1665	2026-09-21 14:20	28.81	OK	1666	2026-09-21 14:21	28.68	OK
1667	2026-09-21 14:22	28.41	OK	1668	2026-09-21 14:23	28.21	OK
1669	2026-09-21 14:24	27.60	OK	1670	2026-09-21 14:25	28.55	OK
1671	2026-09-21 14:26	28.02	OK	1672	2026-09-21 14:27	27.62	OK
1673	2026-09-21 14:28	28.55	OK	1674	2026-09-21 14:29	28.51	OK
1675	2026-09-21 14:30	28.09	OK	1676	2026-09-21 14:31	27.58	OK
1677	2026-09-21 14:32	26.72	OK	1678	2026-09-21 14:33	28.47	OK
1679	2026-09-21 14:34	27.23	OK	1680	2026-09-21 14:35	28.83	OK
1681	2026-09-21 14:36	28.83	OK	1682	2026-09-21 14:37	26.94	OK
1683	2026-09-21 14:38	29.47	OK	1684	2026-09-21 14:39	28.99	OK
1685	2026-09-21 14:40	28.32	OK	1686	2026-09-21 14:41	27.29	OK
1687	2026-09-21 14:42	28.64	OK	1688	2026-09-21 14:43	27.35	OK
1689	2026-09-21 14:44	28.79	OK	1690	2026-09-21 14:45	29.02	OK
1691	2026-09-21 14:46	28.45	OK	1692	2026-09-21 14:47	27.94	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1693	2026-09-21 14:48	28.93	OK	1694	2026-09-21 14:49	28.19	OK
1695	2026-09-21 14:50	27.63	OK	1696	2026-09-21 14:51	28.98	OK
1697	2026-09-21 14:52	28.22	OK	1698	2026-09-21 14:53	27.84	OK
1699	2026-09-21 14:54	28.28	OK	1700	2026-09-21 14:55	28.54	OK
1701	2026-09-21 14:56	27.83	OK	1702	2026-09-21 14:57	29.04	OK
1703	2026-09-21 14:58	26.74	OK	1704	2026-09-21 14:59	26.80	OK
1705	2026-09-21 15:00	28.30	OK	1706	2026-09-21 15:01	28.05	OK
1707	2026-09-21 15:02	27.11	OK	1708	2026-09-21 15:03	26.07	OK
1709	2026-09-21 15:04	28.74	OK	1710	2026-09-21 15:05	28.77	OK
1711	2026-09-21 15:06	27.20	OK	1712	2026-09-21 15:07	26.85	OK
1713	2026-09-21 15:08	27.29	OK	1714	2026-09-21 15:09	27.48	OK
1715	2026-09-21 15:10	26.82	OK	1716	2026-09-21 15:11	27.01	OK
1717	2026-09-21 15:12	26.76	OK	1718	2026-09-21 15:13	26.41	OK
1719	2026-09-21 15:14	28.64	OK	1720	2026-09-21 15:15	28.63	OK
1721	2026-09-21 15:16	26.08	OK	1722	2026-09-21 15:17	27.27	OK
1723	2026-09-21 15:18	27.68	OK	1724	2026-09-21 15:19	26.70	OK
1725	2026-09-21 15:20	28.28	OK	1726	2026-09-21 15:21	26.70	OK
1727	2026-09-21 15:22	27.12	OK	1728	2026-09-21 15:23	28.64	OK
1729	2026-09-21 15:24	27.72	OK	1730	2026-09-21 15:25	27.14	OK
1731	2026-09-21 15:26	27.92	OK	1732	2026-09-21 15:27	27.53	OK
1733	2026-09-21 15:28	27.67	OK	1734	2026-09-21 15:29	26.92	OK
1735	2026-09-21 15:30	26.63	OK	1736	2026-09-21 15:31	27.04	OK
1737	2026-09-21 15:32	26.69	OK	1738	2026-09-21 15:33	27.70	OK
1739	2026-09-21 15:34	28.40	OK	1740	2026-09-21 15:35	27.37	OK
1741	2026-09-21 15:36	26.92	OK	1742	2026-09-21 15:37	27.35	OK
1743	2026-09-21 15:38	26.91	OK	1744	2026-09-21 15:39	27.80	OK
1745	2026-09-21 15:40	26.97	OK	1746	2026-09-21 15:41	28.56	OK
1747	2026-09-21 15:42	27.01	OK	1748	2026-09-21 15:43	26.95	OK
1749	2026-09-21 15:44	27.79	OK	1750	2026-09-21 15:45	26.45	OK
1751	2026-09-21 15:46	27.73	OK	1752	2026-09-21 15:47	27.54	OK
1753	2026-09-21 15:48	28.94	OK	1754	2026-09-21 15:49	27.04	OK
1755	2026-09-21 15:50	27.25	OK	1756	2026-09-21 15:51	26.86	OK
1757	2026-09-21 15:52	28.58	OK	1758	2026-09-21 15:53	26.40	OK
1759	2026-09-21 15:54	27.54	OK	1760	2026-09-21 15:55	25.78	OK
1761	2026-09-21 15:56	27.27	OK	1762	2026-09-21 15:57	27.11	OK
1763	2026-09-21 15:58	26.97	OK	1764	2026-09-21 15:59	28.67	OK
1765	2026-09-21 16:00	26.89	OK	1766	2026-09-21 16:01	26.97	OK
1767	2026-09-21 16:02	27.07	OK	1768	2026-09-21 16:03	26.14	OK
1769	2026-09-21 16:04	27.41	OK	1770	2026-09-21 16:05	28.26	OK
1771	2026-09-21 16:06	26.37	OK	1772	2026-09-21 16:07	27.30	OK
1773	2026-09-21 16:08	26.76	OK	1774	2026-09-21 16:09	28.54	OK
1775	2026-09-21 16:10	28.54	OK	1776	2026-09-21 16:11	26.95	OK
1777	2026-09-21 16:12	26.37	OK	1778	2026-09-21 16:13	26.05	OK
1779	2026-09-21 16:14	26.65	OK	1780	2026-09-21 16:15	26.59	OK
1781	2026-09-21 16:16	26.57	OK	1782	2026-09-21 16:17	28.19	OK
1783	2026-09-21 16:18	27.27	OK	1784	2026-09-21 16:19	27.35	OK
1785	2026-09-21 16:20	25.32	OK	1786	2026-09-21 16:21	29.02	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1787	2026-09-21 16:22	26.27	OK	1788	2026-09-21 16:23	27.66	OK
1789	2026-09-21 16:24	26.52	OK	1790	2026-09-21 16:25	27.46	OK
1791	2026-09-21 16:26	27.08	OK	1792	2026-09-21 16:27	26.01	OK
1793	2026-09-21 16:28	27.08	OK	1794	2026-09-21 16:29	28.51	OK
1795	2026-09-21 16:30	27.95	OK	1796	2026-09-21 16:31	27.92	OK
1797	2026-09-21 16:32	26.92	OK	1798	2026-09-21 16:33	27.97	OK
1799	2026-09-21 16:34	26.33	OK	1800	2026-09-21 16:35	26.87	OK
1801	2026-09-21 16:36	26.98	OK	1802	2026-09-21 16:37	27.18	OK
1803	2026-09-21 16:38	26.95	OK	1804	2026-09-21 16:39	26.22	OK
1805	2026-09-21 16:40	27.71	OK	1806	2026-09-21 16:41	28.00	OK
1807	2026-09-21 16:42	27.40	OK	1808	2026-09-21 16:43	26.07	OK
1809	2026-09-21 16:44	26.00	OK	1810	2026-09-21 16:45	25.69	OK
1811	2026-09-21 16:46	27.15	OK	1812	2026-09-21 16:47	27.40	OK
1813	2026-09-21 16:48	26.91	OK	1814	2026-09-21 16:49	27.97	OK
1815	2026-09-21 16:50	26.33	OK	1816	2026-09-21 16:51	26.04	OK
1817	2026-09-21 16:52	26.81	OK	1818	2026-09-21 16:53	27.72	OK
1819	2026-09-21 16:54	28.09	OK	1820	2026-09-21 16:55	27.56	OK
1821	2026-09-21 16:56	25.77	OK	1822	2026-09-21 16:57	26.81	OK
1823	2026-09-21 16:58	26.91	OK	1824	2026-09-21 16:59	26.05	OK
1825	2026-09-21 17:00	27.80	OK	1826	2026-09-21 17:01	24.84	OK
1827	2026-09-21 17:02	26.99	OK	1828	2026-09-21 17:03	26.16	OK
1829	2026-09-21 17:04	26.38	OK	1830	2026-09-21 17:05	28.18	OK
1831	2026-09-21 17:06	27.46	OK	1832	2026-09-21 17:07	26.40	OK
1833	2026-09-21 17:08	27.37	OK	1834	2026-09-21 17:09	28.34	OK
1835	2026-09-21 17:10	28.38	OK	1836	2026-09-21 17:11	27.12	OK
1837	2026-09-21 17:12	26.79	OK	1838	2026-09-21 17:13	25.95	OK
1839	2026-09-21 17:14	25.89	OK	1840	2026-09-21 17:15	26.41	OK
1841	2026-09-21 17:16	27.04	OK	1842	2026-09-21 17:17	28.32	OK
1843	2026-09-21 17:18	25.95	OK	1844	2026-09-21 17:19	27.52	OK
1845	2026-09-21 17:20	25.86	OK	1846	2026-09-21 17:21	27.82	OK
1847	2026-09-21 17:22	26.56	OK	1848	2026-09-21 17:23	26.40	OK
1849	2026-09-21 17:24	26.94	OK	1850	2026-09-21 17:25	25.97	OK
1851	2026-09-21 17:26	26.97	OK	1852	2026-09-21 17:27	25.73	OK
1853	2026-09-21 17:28	28.42	OK	1854	2026-09-21 17:29	25.31	OK
1855	2026-09-21 17:30	26.88	OK	1856	2026-09-21 17:31	26.14	OK
1857	2026-09-21 17:32	26.45	OK	1858	2026-09-21 17:33	25.80	OK
1859	2026-09-21 17:34	26.87	OK	1860	2026-09-21 17:35	27.63	OK
1861	2026-09-21 17:36	26.14	OK	1862	2026-09-21 17:37	27.06	OK
1863	2026-09-21 17:38	25.38	OK	1864	2026-09-21 17:39	27.68	OK
1865	2026-09-21 17:40	25.93	OK	1866	2026-09-21 17:41	26.95	OK
1867	2026-09-21 17:42	25.66	OK	1868	2026-09-21 17:43	28.51	OK
1869	2026-09-21 17:44	26.57	OK	1870	2026-09-21 17:45	27.60	OK
1871	2026-09-21 17:46	25.89	OK	1872	2026-09-21 17:47	26.75	OK
1873	2026-09-21 17:48	25.73	OK	1874	2026-09-21 17:49	25.98	OK
1875	2026-09-21 17:50	27.70	OK	1876	2026-09-21 17:51	27.99	OK
1877	2026-09-21 17:52	27.14	OK	1878	2026-09-21 17:53	27.03	OK
1879	2026-09-21 17:54	25.35	OK	1880	2026-09-21 17:55	28.11	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1881	2026-09-21 17:56	26.23	OK	1882	2026-09-21 17:57	26.75	OK
1883	2026-09-21 17:58	27.45	OK	1884	2026-09-21 17:59	26.95	OK
1885	2026-09-21 18:00	27.64	OK	1886	2026-09-21 18:01	27.15	OK
1887	2026-09-21 18:02	28.00	OK	1888	2026-09-21 18:03	25.88	OK
1889	2026-09-21 18:04	27.18	OK	1890	2026-09-21 18:05	26.27	OK
1891	2026-09-21 18:06	26.62	OK	1892	2026-09-21 18:07	26.58	OK
1893	2026-09-21 18:08	26.73	OK	1894	2026-09-21 18:09	27.52	OK
1895	2026-09-21 18:10	26.65	OK	1896	2026-09-21 18:11	26.12	OK
1897	2026-09-21 18:12	25.21	OK	1898	2026-09-21 18:13	26.65	OK
1899	2026-09-21 18:14	26.22	OK	1900	2026-09-21 18:15	26.08	OK
1901	2026-09-21 18:16	24.61	OK	1902	2026-09-21 18:17	25.98	OK
1903	2026-09-21 18:18	27.10	OK	1904	2026-09-21 18:19	26.37	OK
1905	2026-09-21 18:20	26.85	OK	1906	2026-09-21 18:21	26.38	OK
1907	2026-09-21 18:22	25.87	OK	1908	2026-09-21 18:23	27.51	OK
1909	2026-09-21 18:24	27.93	OK	1910	2026-09-21 18:25	26.06	OK
1911	2026-09-21 18:26	26.57	OK	1912	2026-09-21 18:27	26.42	OK
1913	2026-09-21 18:28	25.95	OK	1914	2026-09-21 18:29	25.87	OK
1915	2026-09-21 18:30	28.17	OK	1916	2026-09-21 18:31	27.22	OK
1917	2026-09-21 18:32	28.40	OK	1918	2026-09-21 18:33	26.84	OK
1919	2026-09-21 18:34	26.17	OK	1920	2026-09-21 18:35	25.13	OK
1921	2026-09-21 18:36	25.99	OK	1922	2026-09-21 18:37	26.61	OK
1923	2026-09-21 18:38	27.42	OK	1924	2026-09-21 18:39	26.73	OK
1925	2026-09-21 18:40	28.13	OK	1926	2026-09-21 18:41	26.67	OK
1927	2026-09-21 18:42	25.86	OK	1928	2026-09-21 18:43	26.67	OK
1929	2026-09-21 18:44	25.75	OK	1930	2026-09-21 18:45	26.20	OK
1931	2026-09-21 18:46	26.12	OK	1932	2026-09-21 18:47	25.76	OK
1933	2026-09-21 18:48	25.69	OK	1934	2026-09-21 18:49	26.40	OK
1935	2026-09-21 18:50	28.66	OK	1936	2026-09-21 18:51	26.68	OK
1937	2026-09-21 18:52	26.94	OK	1938	2026-09-21 18:53	28.77	OK
1939	2026-09-21 18:54	26.33	OK	1940	2026-09-21 18:55	26.75	OK
1941	2026-09-21 18:56	26.19	OK	1942	2026-09-21 18:57	28.30	OK
1943	2026-09-21 18:58	26.04	OK	1944	2026-09-21 18:59	27.20	OK
1945	2026-09-21 19:00	27.37	OK	1946	2026-09-21 19:01	26.29	OK
1947	2026-09-21 19:02	26.58	OK	1948	2026-09-21 19:03	26.68	OK
1949	2026-09-21 19:04	25.87	OK	1950	2026-09-21 19:05	26.18	OK
1951	2026-09-21 19:06	25.34	OK	1952	2026-09-21 19:07	26.14	OK
1953	2026-09-21 19:08	26.21	OK	1954	2026-09-21 19:09	26.01	OK
1955	2026-09-21 19:10	25.32	OK	1956	2026-09-21 19:11	25.71	OK
1957	2026-09-21 19:12	26.96	OK	1958	2026-09-21 19:13	27.17	OK
1959	2026-09-21 19:14	26.36	OK	1960	2026-09-21 19:15	26.31	OK
1961	2026-09-21 19:16	27.12	OK	1962	2026-09-21 19:17	27.41	OK
1963	2026-09-21 19:18	25.98	OK	1964	2026-09-21 19:19	26.33	OK
1965	2026-09-21 19:20	25.72	OK	1966	2026-09-21 19:21	27.54	OK
1967	2026-09-21 19:22	27.69	OK	1968	2026-09-21 19:23	25.59	OK
1969	2026-09-21 19:24	26.24	OK	1970	2026-09-21 19:25	26.76	OK
1971	2026-09-21 19:26	26.80	OK	1972	2026-09-21 19:27	26.19	OK
1973	2026-09-21 19:28	27.55	OK	1974	2026-09-21 19:29	27.31	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
1975	2026-09-21 19:30	26.01	OK	1976	2026-09-21 19:31	27.91	OK
1977	2026-09-21 19:32	25.31	OK	1978	2026-09-21 19:33	27.98	OK
1979	2026-09-21 19:34	26.75	OK	1980	2026-09-21 19:35	25.74	OK
1981	2026-09-21 19:36	26.23	OK	1982	2026-09-21 19:37	26.70	OK
1983	2026-09-21 19:38	26.96	OK	1984	2026-09-21 19:39	26.95	OK
1985	2026-09-21 19:40	27.10	OK	1986	2026-09-21 19:41	26.83	OK
1987	2026-09-21 19:42	27.41	OK	1988	2026-09-21 19:43	26.87	OK
1989	2026-09-21 19:44	26.87	OK	1990	2026-09-21 19:45	27.40	OK
1991	2026-09-21 19:46	26.00	OK	1992	2026-09-21 19:47	25.29	OK
1993	2026-09-21 19:48	26.49	OK	1994	2026-09-21 19:49	27.89	OK
1995	2026-09-21 19:50	26.70	OK	1996	2026-09-21 19:51	26.59	OK
1997	2026-09-21 19:52	25.67	OK	1998	2026-09-21 19:53	27.81	OK
1999	2026-09-21 19:54	27.55	OK	2000	2026-09-21 19:55	26.58	OK
2001	2026-09-21 19:56	26.80	OK	2002	2026-09-21 19:57	26.96	OK
2003	2026-09-21 19:58	26.99	OK	2004	2026-09-21 19:59	26.33	OK
2005	2026-09-21 20:00	26.58	OK	2006	2026-09-21 20:01	26.03	OK
2007	2026-09-21 20:02	26.99	OK	2008	2026-09-21 20:03	26.87	OK
2009	2026-09-21 20:04	26.94	OK	2010	2026-09-21 20:05	26.55	OK
2011	2026-09-21 20:06	27.12	OK	2012	2026-09-21 20:07	26.72	OK
2013	2026-09-21 20:08	27.37	OK	2014	2026-09-21 20:09	25.72	OK
2015	2026-09-21 20:10	27.97	OK	2016	2026-09-21 20:11	25.72	OK
2017	2026-09-21 20:12	27.89	OK	2018	2026-09-21 20:13	28.30	OK
2019	2026-09-21 20:14	27.23	OK	2020	2026-09-21 20:15	25.89	OK
2021	2026-09-21 20:16	26.93	OK	2022	2026-09-21 20:17	26.94	OK
2023	2026-09-21 20:18	26.16	OK	2024	2026-09-21 20:19	28.35	OK
2025	2026-09-21 20:20	28.09	OK	2026	2026-09-21 20:21	25.80	OK
2027	2026-09-21 20:22	26.14	OK	2028	2026-09-21 20:23	27.88	OK
2029	2026-09-21 20:24	27.90	OK	2030	2026-09-21 20:25	27.29	OK
2031	2026-09-21 20:26	27.32	OK	2032	2026-09-21 20:27	27.03	OK
2033	2026-09-21 20:28	26.56	OK	2034	2026-09-21 20:29	27.09	OK
2035	2026-09-21 20:30	26.61	OK	2036	2026-09-21 20:31	28.05	OK
2037	2026-09-21 20:32	27.95	OK	2038	2026-09-21 20:33	26.50	OK
2039	2026-09-21 20:34	27.00	OK	2040	2026-09-21 20:35	26.83	OK
2041	2026-09-21 20:36	26.09	OK	2042	2026-09-21 20:37	27.87	OK
2043	2026-09-21 20:38	26.44	OK	2044	2026-09-21 20:39	26.70	OK
2045	2026-09-21 20:40	27.60	OK	2046	2026-09-21 20:41	27.86	OK
2047	2026-09-21 20:42	27.61	OK	2048	2026-09-21 20:43	27.39	OK
2049	2026-09-21 20:44	27.41	OK	2050	2026-09-21 20:45	26.48	OK
2051	2026-09-21 20:46	25.89	OK	2052	2026-09-21 20:47	27.75	OK
2053	2026-09-21 20:48	27.27	OK	2054	2026-09-21 20:49	27.24	OK
2055	2026-09-21 20:50	26.40	OK	2056	2026-09-21 20:51	27.45	OK
2057	2026-09-21 20:52	28.78	OK	2058	2026-09-21 20:53	28.67	OK
2059	2026-09-21 20:54	26.52	OK	2060	2026-09-21 20:55	27.03	OK
2061	2026-09-21 20:56	26.84	OK	2062	2026-09-21 20:57	27.53	OK
2063	2026-09-21 20:58	26.88	OK	2064	2026-09-21 20:59	27.40	OK
2065	2026-09-21 21:00	27.99	OK	2066	2026-09-21 21:01	27.41	OK
2067	2026-09-21 21:02	27.95	OK	2068	2026-09-21 21:03	26.87	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2069	2026-09-21 21:04	26.76	OK	2070	2026-09-21 21:05	25.84	OK
2071	2026-09-21 21:06	28.04	OK	2072	2026-09-21 21:07	28.04	OK
2073	2026-09-21 21:08	26.74	OK	2074	2026-09-21 21:09	27.37	OK
2075	2026-09-21 21:10	25.88	OK	2076	2026-09-21 21:11	28.17	OK
2077	2026-09-21 21:12	26.59	OK	2078	2026-09-21 21:13	27.11	OK
2079	2026-09-21 21:14	26.86	OK	2080	2026-09-21 21:15	27.42	OK
2081	2026-09-21 21:16	27.99	OK	2082	2026-09-21 21:17	26.83	OK
2083	2026-09-21 21:18	27.23	OK	2084	2026-09-21 21:19	27.47	OK
2085	2026-09-21 21:20	27.32	OK	2086	2026-09-21 21:21	26.25	OK
2087	2026-09-21 21:22	27.15	OK	2088	2026-09-21 21:23	28.11	OK
2089	2026-09-21 21:24	28.26	OK	2090	2026-09-21 21:25	27.79	OK
2091	2026-09-21 21:26	27.13	OK	2092	2026-09-21 21:27	27.93	OK
2093	2026-09-21 21:28	26.60	OK	2094	2026-09-21 21:29	28.03	OK
2095	2026-09-21 21:30	28.91	OK	2096	2026-09-21 21:31	28.20	OK
2097	2026-09-21 21:32	27.14	OK	2098	2026-09-21 21:33	27.29	OK
2099	2026-09-21 21:34	26.89	OK	2100	2026-09-21 21:35	27.66	OK
2101	2026-09-21 21:36	28.65	OK	2102	2026-09-21 21:37	27.84	OK
2103	2026-09-21 21:38	26.11	OK	2104	2026-09-21 21:39	28.78	OK
2105	2026-09-21 21:40	27.19	OK	2106	2026-09-21 21:41	27.85	OK
2107	2026-09-21 21:42	27.63	OK	2108	2026-09-21 21:43	26.95	OK
2109	2026-09-21 21:44	27.92	OK	2110	2026-09-21 21:45	27.56	OK
2111	2026-09-21 21:46	26.04	OK	2112	2026-09-21 21:47	27.83	OK
2113	2026-09-21 21:48	27.35	OK	2114	2026-09-21 21:49	29.42	OK
2115	2026-09-21 21:50	27.08	OK	2116	2026-09-21 21:51	27.79	OK
2117	2026-09-21 21:52	27.14	OK	2118	2026-09-21 21:53	28.20	OK
2119	2026-09-21 21:54	28.05	OK	2120	2026-09-21 21:55	28.40	OK
2121	2026-09-21 21:56	27.59	OK	2122	2026-09-21 21:57	28.27	OK
2123	2026-09-21 21:58	25.77	OK	2124	2026-09-21 21:59	27.82	OK
2125	2026-09-21 22:00	26.30	OK	2126	2026-09-21 22:01	28.83	OK
2127	2026-09-21 22:02	28.55	OK	2128	2026-09-21 22:03	28.47	OK
2129	2026-09-21 22:04	28.01	OK	2130	2026-09-21 22:05	26.60	OK
2131	2026-09-21 22:06	27.85	OK	2132	2026-09-21 22:07	27.06	OK
2133	2026-09-21 22:08	28.20	OK	2134	2026-09-21 22:09	27.23	OK
2135	2026-09-21 22:10	29.17	OK	2136	2026-09-21 22:11	27.81	OK
2137	2026-09-21 22:12	27.74	OK	2138	2026-09-21 22:13	26.58	OK
2139	2026-09-21 22:14	28.86	OK	2140	2026-09-21 22:15	26.98	OK
2141	2026-09-21 22:16	28.36	OK	2142	2026-09-21 22:17	28.37	OK
2143	2026-09-21 22:18	27.06	OK	2144	2026-09-21 22:19	28.90	OK
2145	2026-09-21 22:20	29.06	OK	2146	2026-09-21 22:21	28.71	OK
2147	2026-09-21 22:22	26.64	OK	2148	2026-09-21 22:23	29.08	OK
2149	2026-09-21 22:24	28.20	OK	2150	2026-09-21 22:25	26.24	OK
2151	2026-09-21 22:26	27.90	OK	2152	2026-09-21 22:27	28.37	OK
2153	2026-09-21 22:28	28.62	OK	2154	2026-09-21 22:29	27.31	OK
2155	2026-09-21 22:30	27.40	OK	2156	2026-09-21 22:31	29.84	OK
2157	2026-09-21 22:32	26.71	OK	2158	2026-09-21 22:33	28.06	OK
2159	2026-09-21 22:34	27.96	OK	2160	2026-09-21 22:35	28.88	OK
2161	2026-09-21 22:36	29.22	OK	2162	2026-09-21 22:37	28.07	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2163	2026-09-21 22:38	29.03	OK	2164	2026-09-21 22:39	27.62	OK
2165	2026-09-21 22:40	28.01	OK	2166	2026-09-21 22:41	28.34	OK
2167	2026-09-21 22:42	28.31	OK	2168	2026-09-21 22:43	29.76	OK
2169	2026-09-21 22:44	29.01	OK	2170	2026-09-21 22:45	28.26	OK
2171	2026-09-21 22:46	28.95	OK	2172	2026-09-21 22:47	27.97	OK
2173	2026-09-21 22:48	27.96	OK	2174	2026-09-21 22:49	29.47	OK
2175	2026-09-21 22:50	29.44	OK	2176	2026-09-21 22:51	29.28	OK
2177	2026-09-21 22:52	28.62	OK	2178	2026-09-21 22:53	27.13	OK
2179	2026-09-21 22:54	28.30	OK	2180	2026-09-21 22:55	29.93	OK
2181	2026-09-21 22:56	28.02	OK	2182	2026-09-21 22:57	28.42	OK
2183	2026-09-21 22:58	27.55	OK	2184	2026-09-21 22:59	28.53	OK
2185	2026-09-21 23:00	27.30	OK	2186	2026-09-21 23:01	29.29	OK
2187	2026-09-21 23:02	28.85	OK	2188	2026-09-21 23:03	29.64	OK
2189	2026-09-21 23:04	27.97	OK	2190	2026-09-21 23:05	29.04	OK
2191	2026-09-21 23:06	28.75	OK	2192	2026-09-21 23:07	30.21	OK
2193	2026-09-21 23:08	27.52	OK	2194	2026-09-21 23:09	27.65	OK
2195	2026-09-21 23:10	27.43	OK	2196	2026-09-21 23:11	28.42	OK
2197	2026-09-21 23:12	28.00	OK	2198	2026-09-21 23:13	28.77	OK
2199	2026-09-21 23:14	28.30	OK	2200	2026-09-21 23:15	28.23	OK
2201	2026-09-21 23:16	27.51	OK	2202	2026-09-21 23:17	28.77	OK
2203	2026-09-21 23:18	27.23	OK	2204	2026-09-21 23:19	28.06	OK
2205	2026-09-21 23:20	28.41	OK	2206	2026-09-21 23:21	29.55	OK
2207	2026-09-21 23:22	29.52	OK	2208	2026-09-21 23:23	27.65	OK
2209	2026-09-21 23:24	27.89	OK	2210	2026-09-21 23:25	28.80	OK
2211	2026-09-21 23:26	28.78	OK	2212	2026-09-21 23:27	29.47	OK
2213	2026-09-21 23:28	27.95	OK	2214	2026-09-21 23:29	30.21	OK
2215	2026-09-21 23:30	29.31	OK	2216	2026-09-21 23:31	29.70	OK
2217	2026-09-21 23:32	29.01	OK	2218	2026-09-21 23:33	28.96	OK
2219	2026-09-21 23:34	28.49	OK	2220	2026-09-21 23:35	28.26	OK
2221	2026-09-21 23:36	27.62	OK	2222	2026-09-21 23:37	27.84	OK
2223	2026-09-21 23:38	29.11	OK	2224	2026-09-21 23:39	28.01	OK
2225	2026-09-21 23:40	28.79	OK	2226	2026-09-21 23:41	28.20	OK
2227	2026-09-21 23:42	28.09	OK	2228	2026-09-21 23:43	27.72	OK
2229	2026-09-21 23:44	29.51	OK	2230	2026-09-21 23:45	29.54	OK
2231	2026-09-21 23:46	29.02	OK	2232	2026-09-21 23:47	27.16	OK
2233	2026-09-21 23:48	29.76	OK	2234	2026-09-21 23:49	28.89	OK
2235	2026-09-21 23:50	28.41	OK	2236	2026-09-21 23:51	28.93	OK
2237	2026-09-21 23:52	28.92	OK	2238	2026-09-21 23:53	28.88	OK
2239	2026-09-21 23:54	29.52	OK	2240	2026-09-21 23:55	29.53	OK
2241	2026-09-21 23:56	29.33	OK	2242	2026-09-21 23:57	29.39	OK
2243	2026-09-21 23:58	27.26	OK	2244	2026-09-21 23:59	29.10	OK
2245	2026-09-22 00:00	30.57	OK	2246	2026-09-22 00:01	29.45	OK
2247	2026-09-22 00:02	30.61	OK	2248	2026-09-22 00:03	28.11	OK
2249	2026-09-22 00:04	27.84	OK	2250	2026-09-22 00:05	27.74	OK
2251	2026-09-22 00:06	30.29	OK	2252	2026-09-22 00:07	28.74	OK
2253	2026-09-22 00:08	28.92	OK	2254	2026-09-22 00:09	28.13	OK
2255	2026-09-22 00:10	28.73	OK	2256	2026-09-22 00:11	29.91	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2257	2026-09-22 00:12	28.93	OK	2258	2026-09-22 00:13	28.59	OK
2259	2026-09-22 00:14	29.64	OK	2260	2026-09-22 00:15	29.14	OK
2261	2026-09-22 00:16	28.97	OK	2262	2026-09-22 00:17	29.08	OK
2263	2026-09-22 00:18	28.42	OK	2264	2026-09-22 00:19	28.79	OK
2265	2026-09-22 00:20	29.15	OK	2266	2026-09-22 00:21	28.66	OK
2267	2026-09-22 00:22	29.37	OK	2268	2026-09-22 00:23	28.60	OK
2269	2026-09-22 00:24	28.43	OK	2270	2026-09-22 00:25	29.12	OK
2271	2026-09-22 00:26	29.73	OK	2272	2026-09-22 00:27	30.22	OK
2273	2026-09-22 00:28	29.14	OK	2274	2026-09-22 00:29	29.66	OK
2275	2026-09-22 00:30	27.68	OK	2276	2026-09-22 00:31	27.88	OK
2277	2026-09-22 00:32	28.03	OK	2278	2026-09-22 00:33	29.03	OK
2279	2026-09-22 00:34	29.39	OK	2280	2026-09-22 00:35	29.44	OK
2281	2026-09-22 00:36	29.85	OK	2282	2026-09-22 00:37	29.57	OK
2283	2026-09-22 00:38	28.19	OK	2284	2026-09-22 00:39	31.15	OK
2285	2026-09-22 00:40	29.70	OK	2286	2026-09-22 00:41	30.80	OK
2287	2026-09-22 00:42	28.28	OK	2288	2026-09-22 00:43	29.38	OK
2289	2026-09-22 00:44	29.22	OK	2290	2026-09-22 00:45	28.19	OK
2291	2026-09-22 00:46	28.06	OK	2292	2026-09-22 00:47	29.31	OK
2293	2026-09-22 00:48	30.43	OK	2294	2026-09-22 00:49	28.16	OK
2295	2026-09-22 00:50	29.82	OK	2296	2026-09-22 00:51	30.04	OK
2297	2026-09-22 00:52	30.69	OK	2298	2026-09-22 00:53	29.30	OK
2299	2026-09-22 00:54	29.89	OK	2300	2026-09-22 00:55	30.69	OK
2301	2026-09-22 00:56	29.48	OK	2302	2026-09-22 00:57	30.23	OK
2303	2026-09-22 00:58	28.84	OK	2304	2026-09-22 00:59	28.53	OK
2305	2026-09-22 01:00	30.42	OK	2306	2026-09-22 01:01	28.35	OK
2307	2026-09-22 01:02	30.26	OK	2308	2026-09-22 01:03	30.71	OK
2309	2026-09-22 01:04	30.21	OK	2310	2026-09-22 01:05	28.60	OK
2311	2026-09-22 01:06	28.95	OK	2312	2026-09-22 01:07	28.88	OK
2313	2026-09-22 01:08	28.91	OK	2314	2026-09-22 01:09	28.15	OK
2315	2026-09-22 01:10	30.19	OK	2316	2026-09-22 01:11	30.19	OK
2317	2026-09-22 01:12	27.60	OK	2318	2026-09-22 01:13	29.49	OK
2319	2026-09-22 01:14	30.64	OK	2320	2026-09-22 01:15	30.49	OK
2321	2026-09-22 01:16	30.00	OK	2322	2026-09-22 01:17	29.37	OK
2323	2026-09-22 01:18	28.49	OK	2324	2026-09-22 01:19	30.21	OK
2325	2026-09-22 01:20	29.83	OK	2326	2026-09-22 01:21	31.49	OK
2327	2026-09-22 01:22	29.97	OK	2328	2026-09-22 01:23	29.50	OK
2329	2026-09-22 01:24	29.13	OK	2330	2026-09-22 01:25	29.94	OK
2331	2026-09-22 01:26	29.75	OK	2332	2026-09-22 01:27	30.12	OK
2333	2026-09-22 01:28	28.58	OK	2334	2026-09-22 01:29	30.70	OK
2335	2026-09-22 01:30	31.13	OK	2336	2026-09-22 01:31	29.14	OK
2337	2026-09-22 01:32	30.04	OK	2338	2026-09-22 01:33	30.58	OK
2339	2026-09-22 01:34	30.50	OK	2340	2026-09-22 01:35	28.96	OK
2341	2026-09-22 01:36	30.94	OK	2342	2026-09-22 01:37	28.67	OK
2343	2026-09-22 01:38	28.94	OK	2344	2026-09-22 01:39	29.94	OK
2345	2026-09-22 01:40	29.75	OK	2346	2026-09-22 01:41	31.21	OK
2347	2026-09-22 01:42	30.69	OK	2348	2026-09-22 01:43	29.51	OK
2349	2026-09-22 01:44	30.32	OK	2350	2026-09-22 01:45	30.29	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2351	2026-09-22 01:46	28.92	OK	2352	2026-09-22 01:47	29.69	OK
2353	2026-09-22 01:48	29.24	OK	2354	2026-09-22 01:49	29.50	OK
2355	2026-09-22 01:50	30.56	OK	2356	2026-09-22 01:51	31.12	OK
2357	2026-09-22 01:52	29.70	OK	2358	2026-09-22 01:53	29.59	OK
2359	2026-09-22 01:54	29.97	OK	2360	2026-09-22 01:55	29.28	OK
2361	2026-09-22 01:56	28.80	OK	2362	2026-09-22 01:57	30.71	OK
2363	2026-09-22 01:58	30.36	OK	2364	2026-09-22 01:59	30.67	OK
2365	2026-09-22 02:00	29.50	OK	2366	2026-09-22 02:01	29.78	OK
2367	2026-09-22 02:02	31.15	OK	2368	2026-09-22 02:03	29.08	OK
2369	2026-09-22 02:04	31.09	OK	2370	2026-09-22 02:05	29.00	OK
2371	2026-09-22 02:06	30.71	OK	2372	2026-09-22 02:07	31.77	OK
2373	2026-09-22 02:08	30.63	OK	2374	2026-09-22 02:09	30.95	OK
2375	2026-09-22 02:10	30.37	OK	2376	2026-09-22 02:11	31.83	OK
2377	2026-09-22 02:12	30.85	OK	2378	2026-09-22 02:13	30.67	OK
2379	2026-09-22 02:14	29.37	OK	2380	2026-09-22 02:15	29.75	OK
2381	2026-09-22 02:16	30.68	OK	2382	2026-09-22 02:17	30.86	OK
2383	2026-09-22 02:18	29.31	OK	2384	2026-09-22 02:19	30.95	OK
2385	2026-09-22 02:20	31.10	OK	2386	2026-09-22 02:21	30.51	OK
2387	2026-09-22 02:22	29.43	OK	2388	2026-09-22 02:23	31.23	OK
2389	2026-09-22 02:24	29.66	OK	2390	2026-09-22 02:25	30.45	OK
2391	2026-09-22 02:26	31.24	OK	2392	2026-09-22 02:27	29.96	OK
2393	2026-09-22 02:28	30.64	OK	2394	2026-09-22 02:29	30.26	OK
2395	2026-09-22 02:30	30.54	OK	2396	2026-09-22 02:31	31.42	OK
2397	2026-09-22 02:32	31.59	OK	2398	2026-09-22 02:33	30.04	OK
2399	2026-09-22 02:34	30.27	OK	2400	2026-09-22 02:35	30.11	OK
2401	2026-09-22 02:36	31.19	OK	2402	2026-09-22 02:37	30.73	OK
2403	2026-09-22 02:38	31.65	OK	2404	2026-09-22 02:39	29.88	OK
2405	2026-09-22 02:40	31.15	OK	2406	2026-09-22 02:41	30.72	OK
2407	2026-09-22 02:42	30.53	OK	2408	2026-09-22 02:43	31.18	OK
2409	2026-09-22 02:44	30.77	OK	2410	2026-09-22 02:45	30.17	OK
2411	2026-09-22 02:46	29.85	OK	2412	2026-09-22 02:47	29.37	OK
2413	2026-09-22 02:48	31.92	OK	2414	2026-09-22 02:49	31.39	OK
2415	2026-09-22 02:50	30.16	OK	2416	2026-09-22 02:51	30.76	OK
2417	2026-09-22 02:52	31.67	OK	2418	2026-09-22 02:53	30.80	OK
2419	2026-09-22 02:54	30.64	OK	2420	2026-09-22 02:55	31.94	OK
2421	2026-09-22 02:56	31.24	OK	2422	2026-09-22 02:57	30.80	OK
2423	2026-09-22 02:58	31.67	OK	2424	2026-09-22 02:59	31.27	OK
2425	2026-09-22 03:00	31.53	OK	2426	2026-09-22 03:01	29.88	OK
2427	2026-09-22 03:02	31.33	OK	2428	2026-09-22 03:03	30.33	OK
2429	2026-09-22 03:04	31.25	OK	2430	2026-09-22 03:05	30.59	OK
2431	2026-09-22 03:06	31.34	OK	2432	2026-09-22 03:07	31.77	OK
2433	2026-09-22 03:08	30.28	OK	2434	2026-09-22 03:09	29.81	OK
2435	2026-09-22 03:10	29.63	OK	2436	2026-09-22 03:11	30.16	OK
2437	2026-09-22 03:12	31.42	OK	2438	2026-09-22 03:13	30.05	OK
2439	2026-09-22 03:14	30.56	OK	2440	2026-09-22 03:15	31.75	OK
2441	2026-09-22 03:16	30.22	OK	2442	2026-09-22 03:17	30.75	OK
2443	2026-09-22 03:18	32.20	OK	2444	2026-09-22 03:19	30.06	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2445	2026-09-22 03:20	31.07	OK	2446	2026-09-22 03:21	31.63	OK
2447	2026-09-22 03:22	30.83	OK	2448	2026-09-22 03:23	32.34	OK
2449	2026-09-22 03:24	29.48	OK	2450	2026-09-22 03:25	30.18	OK
2451	2026-09-22 03:26	31.72	OK	2452	2026-09-22 03:27	30.03	OK
2453	2026-09-22 03:28	31.74	OK	2454	2026-09-22 03:29	29.72	OK
2455	2026-09-22 03:30	33.15	OK	2456	2026-09-22 03:31	31.09	OK
2457	2026-09-22 03:32	30.31	OK	2458	2026-09-22 03:33	30.32	OK
2459	2026-09-22 03:34	30.36	OK	2460	2026-09-22 03:35	30.12	OK
2461	2026-09-22 03:36	31.69	OK	2462	2026-09-22 03:37	32.48	OK
2463	2026-09-22 03:38	30.81	OK	2464	2026-09-22 03:39	29.74	OK
2465	2026-09-22 03:40	30.16	OK	2466	2026-09-22 03:41	31.45	OK
2467	2026-09-22 03:42	31.56	OK	2468	2026-09-22 03:43	31.38	OK
2469	2026-09-22 03:44	31.19	OK	2470	2026-09-22 03:45	29.78	OK
2471	2026-09-22 03:46	31.70	OK	2472	2026-09-22 03:47	31.92	OK
2473	2026-09-22 03:48	31.63	OK	2474	2026-09-22 03:49	31.32	OK
2475	2026-09-22 03:50	31.97	OK	2476	2026-09-22 03:51	30.78	OK
2477	2026-09-22 03:52	30.84	OK	2478	2026-09-22 03:53	32.17	OK
2479	2026-09-22 03:54	30.31	OK	2480	2026-09-22 03:55	30.96	OK
2481	2026-09-22 03:56	29.94	OK	2482	2026-09-22 03:57	30.27	OK
2483	2026-09-22 03:58	31.04	OK	2484	2026-09-22 03:59	30.38	OK
2485	2026-09-22 04:00	31.53	OK	2486	2026-09-22 04:01	30.29	OK
2487	2026-09-22 04:02	30.86	OK	2488	2026-09-22 04:03	30.95	OK
2489	2026-09-22 04:04	30.20	OK	2490	2026-09-22 04:05	31.21	OK
2491	2026-09-22 04:06	31.03	OK	2492	2026-09-22 04:07	30.46	OK
2493	2026-09-22 04:08	30.96	OK	2494	2026-09-22 04:09	31.48	OK
2495	2026-09-22 04:10	31.41	OK	2496	2026-09-22 04:11	30.88	OK
2497	2026-09-22 04:12	32.20	OK	2498	2026-09-22 04:13	31.11	OK
2499	2026-09-22 04:14	31.48	OK	2500	2026-09-22 04:15	33.07	OK
2501	2026-09-22 04:16	32.99	OK	2502	2026-09-22 04:17	31.90	OK
2503	2026-09-22 04:18	31.63	OK	2504	2026-09-22 04:19	32.53	OK
2505	2026-09-22 04:20	32.07	OK	2506	2026-09-22 04:21	30.89	OK
2507	2026-09-22 04:22	33.29	OK	2508	2026-09-22 04:23	30.84	OK
2509	2026-09-22 04:24	30.85	OK	2510	2026-09-22 04:25	30.29	OK
2511	2026-09-22 04:26	30.83	OK	2512	2026-09-22 04:27	31.97	OK
2513	2026-09-22 04:28	32.31	OK	2514	2026-09-22 04:29	33.00	OK
2515	2026-09-22 04:30	32.63	OK	2516	2026-09-22 04:31	31.41	OK
2517	2026-09-22 04:32	31.13	OK	2518	2026-09-22 04:33	29.78	OK
2519	2026-09-22 04:34	31.84	OK	2520	2026-09-22 04:35	31.52	OK
2521	2026-09-22 04:36	29.84	OK	2522	2026-09-22 04:37	30.75	OK
2523	2026-09-22 04:38	31.59	OK	2524	2026-09-22 04:39	32.41	OK
2525	2026-09-22 04:40	31.51	OK	2526	2026-09-22 04:41	32.27	OK
2527	2026-09-22 04:42	31.77	OK	2528	2026-09-22 04:43	31.58	OK
2529	2026-09-22 04:44	30.36	OK	2530	2026-09-22 04:45	31.72	OK
2531	2026-09-22 04:46	31.88	OK	2532	2026-09-22 04:47	31.07	OK
2533	2026-09-22 04:48	32.10	OK	2534	2026-09-22 04:49	31.94	OK
2535	2026-09-22 04:50	31.80	OK	2536	2026-09-22 04:51	31.93	OK
2537	2026-09-22 04:52	30.41	OK	2538	2026-09-22 04:53	30.29	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2539	2026-09-22 04:54	32.16	OK	2540	2026-09-22 04:55	30.98	OK
2541	2026-09-22 04:56	33.20	OK	2542	2026-09-22 04:57	31.34	OK
2543	2026-09-22 04:58	30.92	OK	2544	2026-09-22 04:59	31.09	OK
2545	2026-09-22 05:00	32.10	OK	2546	2026-09-22 05:01	33.27	OK
2547	2026-09-22 05:02	32.02	OK	2548	2026-09-22 05:03	31.73	OK
2549	2026-09-22 05:04	33.11	OK	2550	2026-09-22 05:05	30.83	OK
2551	2026-09-22 05:06	31.07	OK	2552	2026-09-22 05:07	32.16	OK
2553	2026-09-22 05:08	30.82	OK	2554	2026-09-22 05:09	31.97	OK
2555	2026-09-22 05:10	31.28	OK	2556	2026-09-22 05:11	31.30	OK
2557	2026-09-22 05:12	31.53	OK	2558	2026-09-22 05:13	32.17	OK
2559	2026-09-22 05:14	30.44	OK	2560	2026-09-22 05:15	31.43	OK
2561	2026-09-22 05:16	32.62	OK	2562	2026-09-22 05:17	31.06	OK
2563	2026-09-22 05:18	31.22	OK	2564	2026-09-22 05:19	30.98	OK
2565	2026-09-22 05:20	32.68	OK	2566	2026-09-22 05:21	32.18	OK
2567	2026-09-22 05:22	30.74	OK	2568	2026-09-22 05:23	32.42	OK
2569	2026-09-22 05:24	32.30	OK	2570	2026-09-22 05:25	31.94	OK
2571	2026-09-22 05:26	31.38	OK	2572	2026-09-22 05:27	31.48	OK
2573	2026-09-22 05:28	31.95	OK	2574	2026-09-22 05:29	31.23	OK
2575	2026-09-22 05:30	31.07	OK	2576	2026-09-22 05:31	32.37	OK
2577	2026-09-22 05:32	31.73	OK	2578	2026-09-22 05:33	32.87	OK
2579	2026-09-22 05:34	32.01	OK	2580	2026-09-22 05:35	30.78	OK
2581	2026-09-22 05:36	30.68	OK	2582	2026-09-22 05:37	32.53	OK
2583	2026-09-22 05:38	32.67	OK	2584	2026-09-22 05:39	31.97	OK
2585	2026-09-22 05:40	30.63	OK	2586	2026-09-22 05:41	31.63	OK
2587	2026-09-22 05:42	32.34	OK	2588	2026-09-22 05:43	32.36	OK
2589	2026-09-22 05:44	32.70	OK	2590	2026-09-22 05:45	31.92	OK
2591	2026-09-22 05:46	31.47	OK	2592	2026-09-22 05:47	32.33	OK
2593	2026-09-22 05:48	32.51	OK	2594	2026-09-22 05:49	32.87	OK
2595	2026-09-22 05:50	32.58	OK	2596	2026-09-22 05:51	31.35	OK
2597	2026-09-22 05:52	32.45	OK	2598	2026-09-22 05:53	31.66	OK
2599	2026-09-22 05:54	30.71	OK	2600	2026-09-22 05:55	31.43	OK
2601	2026-09-22 05:56	31.68	OK	2602	2026-09-22 05:57	32.40	OK
2603	2026-09-22 05:58	31.57	OK	2604	2026-09-22 05:59	32.17	OK
2605	2026-09-22 06:00	30.50	OK	2606	2026-09-22 06:01	32.18	OK
2607	2026-09-22 06:02	30.43	OK	2608	2026-09-22 06:03	31.11	OK
2609	2026-09-22 06:04	33.14	OK	2610	2026-09-22 06:05	31.25	OK
2611	2026-09-22 06:06	31.59	OK	2612	2026-09-22 06:07	31.47	OK
2613	2026-09-22 06:08	30.40	OK	2614	2026-09-22 06:09	30.68	OK
2615	2026-09-22 06:10	30.33	OK	2616	2026-09-22 06:11	31.56	OK
2617	2026-09-22 06:12	30.91	OK	2618	2026-09-22 06:13	32.78	OK
2619	2026-09-22 06:14	32.55	OK	2620	2026-09-22 06:15	31.88	OK
2621	2026-09-22 06:16	31.56	OK	2622	2026-09-22 06:17	31.07	OK
2623	2026-09-22 06:18	32.60	OK	2624	2026-09-22 06:19	31.72	OK
2625	2026-09-22 06:20	30.74	OK	2626	2026-09-22 06:21	31.23	OK
2627	2026-09-22 06:22	33.02	OK	2628	2026-09-22 06:23	33.14	OK
2629	2026-09-22 06:24	32.34	OK	2630	2026-09-22 06:25	32.78	OK
2631	2026-09-22 06:26	30.54	OK	2632	2026-09-22 06:27	31.10	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2633	2026-09-22 06:28	32.08	OK	2634	2026-09-22 06:29	33.05	OK
2635	2026-09-22 06:30	30.34	OK	2636	2026-09-22 06:31	31.79	OK
2637	2026-09-22 06:32	32.27	OK	2638	2026-09-22 06:33	32.75	OK
2639	2026-09-22 06:34	31.51	OK	2640	2026-09-22 06:35	32.07	OK
2641	2026-09-22 06:36	29.94	OK	2642	2026-09-22 06:37	32.75	OK
2643	2026-09-22 06:38	33.34	OK	2644	2026-09-22 06:39	32.43	OK
2645	2026-09-22 06:40	31.51	OK	2646	2026-09-22 06:41	31.38	OK
2647	2026-09-22 06:42	31.67	OK	2648	2026-09-22 06:43	31.33	OK
2649	2026-09-22 06:44	31.45	OK	2650	2026-09-22 06:45	30.67	OK
2651	2026-09-22 06:46	32.38	OK	2652	2026-09-22 06:47	31.51	OK
2653	2026-09-22 06:48	31.97	OK	2654	2026-09-22 06:49	30.61	OK
2655	2026-09-22 06:50	31.00	OK	2656	2026-09-22 06:51	30.99	OK
2657	2026-09-22 06:52	31.26	OK	2658	2026-09-22 06:53	32.85	OK
2659	2026-09-22 06:54	31.72	OK	2660	2026-09-22 06:55	30.73	OK
2661	2026-09-22 06:56	30.45	OK	2662	2026-09-22 06:57	32.52	OK
2663	2026-09-22 06:58	32.27	OK	2664	2026-09-22 06:59	31.76	OK
2665	2026-09-22 07:00	32.47	OK	2666	2026-09-22 07:01	32.87	OK
2667	2026-09-22 07:02	30.88	OK	2668	2026-09-22 07:03	31.53	OK
2669	2026-09-22 07:04	31.75	OK	2670	2026-09-22 07:05	32.21	OK
2671	2026-09-22 07:06	31.56	OK	2672	2026-09-22 07:07	30.86	OK
2673	2026-09-22 07:08	31.56	OK	2674	2026-09-22 07:09	30.78	OK
2675	2026-09-22 07:10	30.96	OK	2676	2026-09-22 07:11	30.79	OK
2677	2026-09-22 07:12	32.86	OK	2678	2026-09-22 07:13	31.41	OK
2679	2026-09-22 07:14	31.42	OK	2680	2026-09-22 07:15	32.10	OK
2681	2026-09-22 07:16	31.28	OK	2682	2026-09-22 07:17	31.78	OK
2683	2026-09-22 07:18	32.11	OK	2684	2026-09-22 07:19	32.88	OK
2685	2026-09-22 07:20	31.88	OK	2686	2026-09-22 07:21	32.17	OK
2687	2026-09-22 07:22	30.54	OK	2688	2026-09-22 07:23	30.90	OK
2689	2026-09-22 07:24	32.26	OK	2690	2026-09-22 07:25	30.77	OK
2691	2026-09-22 07:26	31.46	OK	2692	2026-09-22 07:27	32.72	OK
2693	2026-09-22 07:28	31.96	OK	2694	2026-09-22 07:29	30.99	OK
2695	2026-09-22 07:30	32.04	OK	2696	2026-09-22 07:31	32.34	OK
2697	2026-09-22 07:32	32.72	OK	2698	2026-09-22 07:33	31.10	OK
2699	2026-09-22 07:34	32.30	OK	2700	2026-09-22 07:35	32.46	OK
2701	2026-09-22 07:36	30.51	OK	2702	2026-09-22 07:37	32.38	OK
2703	2026-09-22 07:38	31.80	OK	2704	2026-09-22 07:39	31.61	OK
2705	2026-09-22 07:40	31.81	OK	2706	2026-09-22 07:41	32.45	OK
2707	2026-09-22 07:42	32.00	OK	2708	2026-09-22 07:43	31.82	OK
2709	2026-09-22 07:44	31.71	OK	2710	2026-09-22 07:45	31.03	OK
2711	2026-09-22 07:46	31.54	OK	2712	2026-09-22 07:47	30.86	OK
2713	2026-09-22 07:48	32.30	OK	2714	2026-09-22 07:49	32.65	OK
2715	2026-09-22 07:50	29.82	OK	2716	2026-09-22 07:51	30.50	OK
2717	2026-09-22 07:52	31.18	OK	2718	2026-09-22 07:53	33.44	OK
2719	2026-09-22 07:54	32.17	OK	2720	2026-09-22 07:55	30.02	OK
2721	2026-09-22 07:56	32.16	OK	2722	2026-09-22 07:57	31.87	OK
2723	2026-09-22 07:58	31.91	OK	2724	2026-09-22 07:59	31.59	OK
2725	2026-09-22 08:00	32.26	OK	2726	2026-09-22 08:01	30.28	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2727	2026-09-22 08:02	31.22	OK	2728	2026-09-22 08:03	31.35	OK
2729	2026-09-22 08:04	31.31	OK	2730	2026-09-22 08:05	31.87	OK
2731	2026-09-22 08:06	31.10	OK	2732	2026-09-22 08:07	31.91	OK
2733	2026-09-22 08:08	30.54	OK	2734	2026-09-22 08:09	31.95	OK
2735	2026-09-22 08:10	32.13	OK	2736	2026-09-22 08:11	31.43	OK
2737	2026-09-22 08:12	33.27	OK	2738	2026-09-22 08:13	31.52	OK
2739	2026-09-22 08:14	31.87	OK	2740	2026-09-22 08:15	32.81	OK
2741	2026-09-22 08:16	31.36	OK	2742	2026-09-22 08:17	32.41	OK
2743	2026-09-22 08:18	31.80	OK	2744	2026-09-22 08:19	31.35	OK
2745	2026-09-22 08:20	31.88	OK	2746	2026-09-22 08:21	31.89	OK
2747	2026-09-22 08:22	32.66	OK	2748	2026-09-22 08:23	32.67	OK
2749	2026-09-22 08:24	31.43	OK	2750	2026-09-22 08:25	31.66	OK
2751	2026-09-22 08:26	31.37	OK	2752	2026-09-22 08:27	31.97	OK
2753	2026-09-22 08:28	31.40	OK	2754	2026-09-22 08:29	31.65	OK
2755	2026-09-22 08:30	30.67	OK	2756	2026-09-22 08:31	30.81	OK
2757	2026-09-22 08:32	32.39	OK	2758	2026-09-22 08:33	31.98	OK
2759	2026-09-22 08:34	30.99	OK	2760	2026-09-22 08:35	33.26	OK
2761	2026-09-22 08:36	31.12	OK	2762	2026-09-22 08:37	31.45	OK
2763	2026-09-22 08:38	31.35	OK	2764	2026-09-22 08:39	33.03	OK
2765	2026-09-22 08:40	32.21	OK	2766	2026-09-22 08:41	31.64	OK
2767	2026-09-22 08:42	32.04	OK	2768	2026-09-22 08:43	32.31	OK
2769	2026-09-22 08:44	31.29	OK	2770	2026-09-22 08:45	31.64	OK
2771	2026-09-22 08:46	33.26	OK	2772	2026-09-22 08:47	31.77	OK
2773	2026-09-22 08:48	31.24	OK	2774	2026-09-22 08:49	31.63	OK
2775	2026-09-22 08:50	30.40	OK	2776	2026-09-22 08:51	30.20	OK
2777	2026-09-22 08:52	30.69	OK	2778	2026-09-22 08:53	31.44	OK
2779	2026-09-22 08:54	31.33	OK	2780	2026-09-22 08:55	30.86	OK
2781	2026-09-22 08:56	31.35	OK	2782	2026-09-22 08:57	29.76	OK
2783	2026-09-22 08:58	31.01	OK	2784	2026-09-22 08:59	31.33	OK
2785	2026-09-22 09:00	31.07	OK	2786	2026-09-22 09:01	31.94	OK
2787	2026-09-22 09:02	30.93	OK	2788	2026-09-22 09:03	30.82	OK
2789	2026-09-22 09:04	31.82	OK	2790	2026-09-22 09:05	30.58	OK
2791	2026-09-22 09:06	31.61	OK	2792	2026-09-22 09:07	30.96	OK
2793	2026-09-22 09:08	32.28	OK	2794	2026-09-22 09:09	31.10	OK
2795	2026-09-22 09:10	30.68	OK	2796	2026-09-22 09:11	32.40	OK
2797	2026-09-22 09:12	31.88	OK	2798	2026-09-22 09:13	30.75	OK
2799	2026-09-22 09:14	31.25	OK	2800	2026-09-22 09:15	29.53	OK
2801	2026-09-22 09:16	31.96	OK	2802	2026-09-22 09:17	31.96	OK
2803	2026-09-22 09:18	30.08	OK	2804	2026-09-22 09:19	29.60	OK
2805	2026-09-22 09:20	32.09	OK	2806	2026-09-22 09:21	31.03	OK
2807	2026-09-22 09:22	30.93	OK	2808	2026-09-22 09:23	30.70	OK
2809	2026-09-22 09:24	31.62	OK	2810	2026-09-22 09:25	31.83	OK
2811	2026-09-22 09:26	30.66	OK	2812	2026-09-22 09:27	30.23	OK
2813	2026-09-22 09:28	29.44	OK	2814	2026-09-22 09:29	31.91	OK
2815	2026-09-22 09:30	28.97	OK	2816	2026-09-22 09:31	31.38	OK
2817	2026-09-22 09:32	31.79	OK	2818	2026-09-22 09:33	30.83	OK
2819	2026-09-22 09:34	30.88	OK	2820	2026-09-22 09:35	30.73	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2821	2026-09-22 09:36	32.37	OK	2822	2026-09-22 09:37	29.07	OK
2823	2026-09-22 09:38	31.77	OK	2824	2026-09-22 09:39	31.41	OK
2825	2026-09-22 09:40	30.88	OK	2826	2026-09-22 09:41	32.54	OK
2827	2026-09-22 09:42	31.01	OK	2828	2026-09-22 09:43	30.62	OK
2829	2026-09-22 09:44	30.78	OK	2830	2026-09-22 09:45	32.48	OK
2831	2026-09-22 09:46	30.74	OK	2832	2026-09-22 09:47	30.94	OK
2833	2026-09-22 09:48	31.45	OK	2834	2026-09-22 09:49	31.00	OK
2835	2026-09-22 09:50	30.96	OK	2836	2026-09-22 09:51	32.45	OK
2837	2026-09-22 09:52	31.31	OK	2838	2026-09-22 09:53	30.40	OK
2839	2026-09-22 09:54	32.48	OK	2840	2026-09-22 09:55	29.87	OK
2841	2026-09-22 09:56	30.36	OK	2842	2026-09-22 09:57	30.85	OK
2843	2026-09-22 09:58	30.50	OK	2844	2026-09-22 09:59	30.49	OK
2845	2026-09-22 10:00	30.05	OK	2846	2026-09-22 10:01	30.89	OK
2847	2026-09-22 10:02	30.49	OK	2848	2026-09-22 10:03	30.76	OK
2849	2026-09-22 10:04	31.32	OK	2850	2026-09-22 10:05	31.23	OK
2851	2026-09-22 10:06	30.84	OK	2852	2026-09-22 10:07	29.41	OK
2853	2026-09-22 10:08	29.99	OK	2854	2026-09-22 10:09	31.47	OK
2855	2026-09-22 10:10	29.50	OK	2856	2026-09-22 10:11	30.85	OK
2857	2026-09-22 10:12	30.15	OK	2858	2026-09-22 10:13	29.77	OK
2859	2026-09-22 10:14	32.04	OK	2860	2026-09-22 10:15	30.29	OK
2861	2026-09-22 10:16	30.62	OK	2862	2026-09-22 10:17	29.25	OK
2863	2026-09-22 10:18	30.66	OK	2864	2026-09-22 10:19	31.28	OK
2865	2026-09-22 10:20	31.15	OK	2866	2026-09-22 10:21	30.56	OK
2867	2026-09-22 10:22	29.59	OK	2868	2026-09-22 10:23	30.77	OK
2869	2026-09-22 10:24	30.93	OK	2870	2026-09-22 10:25	30.16	OK
2871	2026-09-22 10:26	31.46	OK	2872	2026-09-22 10:27	30.06	OK
2873	2026-09-22 10:28	31.32	OK	2874	2026-09-22 10:29	30.37	OK
2875	2026-09-22 10:30	29.89	OK	2876	2026-09-22 10:31	30.91	OK
2877	2026-09-22 10:32	31.06	OK	2878	2026-09-22 10:33	31.75	OK
2879	2026-09-22 10:34	29.19	OK	2880	2026-09-22 10:35	29.63	OK
2881	2026-09-22 10:36	31.14	OK	2882	2026-09-22 10:37	31.22	OK
2883	2026-09-22 10:38	32.77	OK	2884	2026-09-22 10:39	30.46	OK
2885	2026-09-22 10:40	29.43	OK	2886	2026-09-22 10:41	31.50	OK
2887	2026-09-22 10:42	30.68	OK	2888	2026-09-22 10:43	30.77	OK
2889	2026-09-22 10:44	30.77	OK	2890	2026-09-22 10:45	30.35	OK
2891	2026-09-22 10:46	30.82	OK	2892	2026-09-22 10:47	31.22	OK
2893	2026-09-22 10:48	30.51	OK	2894	2026-09-22 10:49	29.89	OK
2895	2026-09-22 10:50	29.47	OK	2896	2026-09-22 10:51	29.73	OK
2897	2026-09-22 10:52	30.90	OK	2898	2026-09-22 10:53	30.52	OK
2899	2026-09-22 10:54	29.00	OK	2900	2026-09-22 10:55	28.71	OK
2901	2026-09-22 10:56	30.01	OK	2902	2026-09-22 10:57	30.93	OK
2903	2026-09-22 10:58	29.67	OK	2904	2026-09-22 10:59	29.24	OK
2905	2026-09-22 11:00	30.59	OK	2906	2026-09-22 11:01	28.86	OK
2907	2026-09-22 11:02	30.31	OK	2908	2026-09-22 11:03	29.06	OK
2909	2026-09-22 11:04	29.90	OK	2910	2026-09-22 11:05	29.84	OK
2911	2026-09-22 11:06	30.96	OK	2912	2026-09-22 11:07	31.14	OK
2913	2026-09-22 11:08	30.09	OK	2914	2026-09-22 11:09	30.71	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
2915	2026-09-22 11:10	30.62	OK	2916	2026-09-22 11:11	29.60	OK
2917	2026-09-22 11:12	29.77	OK	2918	2026-09-22 11:13	29.64	OK
2919	2026-09-22 11:14	29.58	OK	2920	2026-09-22 11:15	30.10	OK
2921	2026-09-22 11:16	30.47	OK	2922	2026-09-22 11:17	31.66	OK
2923	2026-09-22 11:18	29.64	OK	2924	2026-09-22 11:19	29.34	OK
2925	2026-09-22 11:20	30.48	OK	2926	2026-09-22 11:21	29.04	OK
2927	2026-09-22 11:22	30.62	OK	2928	2026-09-22 11:23	29.65	OK
2929	2026-09-22 11:24	28.47	OK	2930	2026-09-22 11:25	29.69	OK
2931	2026-09-22 11:26	29.16	OK	2932	2026-09-22 11:27	28.75	OK
2933	2026-09-22 11:28	30.73	OK	2934	2026-09-22 11:29	28.97	OK
2935	2026-09-22 11:30	29.10	OK	2936	2026-09-22 11:31	30.11	OK
2937	2026-09-22 11:32	30.32	OK	2938	2026-09-22 11:33	30.38	OK
2939	2026-09-22 11:34	30.00	OK	2940	2026-09-22 11:35	29.78	OK
2941	2026-09-22 11:36	29.62	OK	2942	2026-09-22 11:37	29.97	OK
2943	2026-09-22 11:38	30.66	OK	2944	2026-09-22 11:39	30.46	OK
2945	2026-09-22 11:40	28.03	OK	2946	2026-09-22 11:41	29.41	OK
2947	2026-09-22 11:42	29.54	OK	2948	2026-09-22 11:43	30.17	OK
2949	2026-09-22 11:44	29.72	OK	2950	2026-09-22 11:45	28.73	OK
2951	2026-09-22 11:46	30.77	OK	2952	2026-09-22 11:47	30.90	OK
2953	2026-09-22 11:48	30.68	OK	2954	2026-09-22 11:49	28.55	OK
2955	2026-09-22 11:50	27.98	OK	2956	2026-09-22 11:51	30.14	OK
2957	2026-09-22 11:52	28.34	OK	2958	2026-09-22 11:53	28.84	OK
2959	2026-09-22 11:54	29.49	OK	2960	2026-09-22 11:55	29.27	OK
2961	2026-09-22 11:56	29.84	OK	2962	2026-09-22 11:57	29.12	OK
2963	2026-09-22 11:58	28.40	OK	2964	2026-09-22 11:59	29.66	OK
2965	2026-09-22 12:00	29.96	OK	2966	2026-09-22 12:01	29.49	OK
2967	2026-09-22 12:02	29.31	OK	2968	2026-09-22 12:03	29.21	OK
2969	2026-09-22 12:04	29.00	OK	2970	2026-09-22 12:05	28.55	OK
2971	2026-09-22 12:06	29.79	OK	2972	2026-09-22 12:07	28.18	OK
2973	2026-09-22 12:08	28.27	OK	2974	2026-09-22 12:09	30.00	OK
2975	2026-09-22 12:10	29.36	OK	2976	2026-09-22 12:11	29.32	OK
2977	2026-09-22 12:12	28.59	OK	2978	2026-09-22 12:13	29.96	OK
2979	2026-09-22 12:14	29.72	OK	2980	2026-09-22 12:15	28.97	OK
2981	2026-09-22 12:16	30.21	OK	2982	2026-09-22 12:17	28.35	OK
2983	2026-09-22 12:18	31.02	OK	2984	2026-09-22 12:19	29.24	OK
2985	2026-09-22 12:20	29.30	OK	2986	2026-09-22 12:21	30.00	OK
2987	2026-09-22 12:22	30.71	OK	2988	2026-09-22 12:23	29.40	OK
2989	2026-09-22 12:24	29.00	OK	2990	2026-09-22 12:25	29.15	OK
2991	2026-09-22 12:26	28.66	OK	2992	2026-09-22 12:27	30.21	OK
2993	2026-09-22 12:28	28.08	OK	2994	2026-09-22 12:29	29.45	OK
2995	2026-09-22 12:30	29.60	OK	2996	2026-09-22 12:31	29.05	OK
2997	2026-09-22 12:32	29.28	OK	2998	2026-09-22 12:33	28.99	OK
2999	2026-09-22 12:34	30.31	OK	3000	2026-09-22 12:35	29.18	OK
3001	2026-09-22 12:36	28.96	OK	3002	2026-09-22 12:37	30.98	OK
3003	2026-09-22 12:38	30.08	OK	3004	2026-09-22 12:39	29.09	OK
3005	2026-09-22 12:40	29.16	OK	3006	2026-09-22 12:41	28.92	OK
3007	2026-09-22 12:42	28.47	OK	3008	2026-09-22 12:43	29.56	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3009	2026-09-22 12:44	28.90	OK	3010	2026-09-22 12:45	29.10	OK
3011	2026-09-22 12:46	28.72	OK	3012	2026-09-22 12:47	29.15	OK
3013	2026-09-22 12:48	28.97	OK	3014	2026-09-22 12:49	28.37	OK
3015	2026-09-22 12:50	29.26	OK	3016	2026-09-22 12:51	29.33	OK
3017	2026-09-22 12:52	29.00	OK	3018	2026-09-22 12:53	30.38	OK
3019	2026-09-22 12:54	28.13	OK	3020	2026-09-22 12:55	29.20	OK
3021	2026-09-22 12:56	27.79	OK	3022	2026-09-22 12:57	29.62	OK
3023	2026-09-22 12:58	28.88	OK	3024	2026-09-22 12:59	28.27	OK
3025	2026-09-22 13:00	28.28	OK	3026	2026-09-22 13:01	28.36	OK
3027	2026-09-22 13:02	28.34	OK	3028	2026-09-22 13:03	28.81	OK
3029	2026-09-22 13:04	29.46	OK	3030	2026-09-22 13:05	28.53	OK
3031	2026-09-22 13:06	30.58	OK	3032	2026-09-22 13:07	30.27	OK
3033	2026-09-22 13:08	29.90	OK	3034	2026-09-22 13:09	29.38	OK
3035	2026-09-22 13:10	29.60	OK	3036	2026-09-22 13:11	29.04	OK
3037	2026-09-22 13:12	29.90	OK	3038	2026-09-22 13:13	27.91	OK
3039	2026-09-22 13:14	28.00	OK	3040	2026-09-22 13:15	27.99	OK
3041	2026-09-22 13:16	28.65	OK	3042	2026-09-22 13:17	29.15	OK
3043	2026-09-22 13:18	29.75	OK	3044	2026-09-22 13:19	29.21	OK
3045	2026-09-22 13:20	29.86	OK	3046	2026-09-22 13:21	28.90	OK
3047	2026-09-22 13:22	28.85	OK	3048	2026-09-22 13:23	28.83	OK
3049	2026-09-22 13:24	29.38	OK	3050	2026-09-22 13:25	29.03	OK
3051	2026-09-22 13:26	28.04	OK	3052	2026-09-22 13:27	28.56	OK
3053	2026-09-22 13:28	27.73	OK	3054	2026-09-22 13:29	28.11	OK
3055	2026-09-22 13:30	30.16	OK	3056	2026-09-22 13:31	29.69	OK
3057	2026-09-22 13:32	28.47	OK	3058	2026-09-22 13:33	27.85	OK
3059	2026-09-22 13:34	27.94	OK	3060	2026-09-22 13:35	28.97	OK
3061	2026-09-22 13:36	28.79	OK	3062	2026-09-22 13:37	27.56	OK
3063	2026-09-22 13:38	29.24	OK	3064	2026-09-22 13:39	29.52	OK
3065	2026-09-22 13:40	27.33	OK	3066	2026-09-22 13:41	29.08	OK
3067	2026-09-22 13:42	29.20	OK	3068	2026-09-22 13:43	26.95	OK
3069	2026-09-22 13:44	26.80	OK	3070	2026-09-22 13:45	29.37	OK
3071	2026-09-22 13:46	27.75	OK	3072	2026-09-22 13:47	28.44	OK
3073	2026-09-22 13:48	27.30	OK	3074	2026-09-22 13:49	28.06	OK
3075	2026-09-22 13:50	26.84	OK	3076	2026-09-22 13:51	28.89	OK
3077	2026-09-22 13:52	26.64	OK	3078	2026-09-22 13:53	28.37	OK
3079	2026-09-22 13:54	28.03	OK	3080	2026-09-22 13:55	28.92	OK
3081	2026-09-22 13:56	26.83	OK	3082	2026-09-22 13:57	28.78	OK
3083	2026-09-22 13:58	26.78	OK	3084	2026-09-22 13:59	29.46	OK
3085	2026-09-22 14:00	28.39	OK	3086	2026-09-22 14:01	29.28	OK
3087	2026-09-22 14:02	27.51	OK	3088	2026-09-22 14:03	28.65	OK
3089	2026-09-22 14:04	28.84	OK	3090	2026-09-22 14:05	28.29	OK
3091	2026-09-22 14:06	28.13	OK	3092	2026-09-22 14:07	28.39	OK
3093	2026-09-22 14:08	27.22	OK	3094	2026-09-22 14:09	28.92	OK
3095	2026-09-22 14:10	28.78	OK	3096	2026-09-22 14:11	28.54	OK
3097	2026-09-22 14:12	28.92	OK	3098	2026-09-22 14:13	28.06	OK
3099	2026-09-22 14:14	26.62	OK	3100	2026-09-22 14:15	27.92	OK
3101	2026-09-22 14:16	29.40	OK	3102	2026-09-22 14:17	27.60	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3103	2026-09-22 14:18	28.97	OK	3104	2026-09-22 14:19	29.23	OK
3105	2026-09-22 14:20	28.45	OK	3106	2026-09-22 14:21	27.33	OK
3107	2026-09-22 14:22	28.00	OK	3108	2026-09-22 14:23	27.82	OK
3109	2026-09-22 14:24	28.60	OK	3110	2026-09-22 14:25	28.22	OK
3111	2026-09-22 14:26	28.41	OK	3112	2026-09-22 14:27	27.99	OK
3113	2026-09-22 14:28	27.70	OK	3114	2026-09-22 14:29	27.81	OK
3115	2026-09-22 14:30	27.62	OK	3116	2026-09-22 14:31	29.40	OK
3117	2026-09-22 14:32	27.77	OK	3118	2026-09-22 14:33	28.20	OK
3119	2026-09-22 14:34	28.48	OK	3120	2026-09-22 14:35	27.20	OK
3121	2026-09-22 14:36	28.25	OK	3122	2026-09-22 14:37	28.39	OK
3123	2026-09-22 14:38	27.31	OK	3124	2026-09-22 14:39	26.54	OK
3125	2026-09-22 14:40	27.85	OK	3126	2026-09-22 14:41	28.04	OK
3127	2026-09-22 14:42	28.09	OK	3128	2026-09-22 14:43	27.94	OK
3129	2026-09-22 14:44	27.34	OK	3130	2026-09-22 14:45	28.02	OK
3131	2026-09-22 14:46	29.23	OK	3132	2026-09-22 14:47	27.54	OK
3133	2026-09-22 14:48	28.77	OK	3134	2026-09-22 14:49	28.07	OK
3135	2026-09-22 14:50	27.51	OK	3136	2026-09-22 14:51	28.22	OK
3137	2026-09-22 14:52	28.97	OK	3138	2026-09-22 14:53	28.21	OK
3139	2026-09-22 14:54	27.20	OK	3140	2026-09-22 14:55	28.81	OK
3141	2026-09-22 14:56	27.38	OK	3142	2026-09-22 14:57	27.15	OK
3143	2026-09-22 14:58	27.60	OK	3144	2026-09-22 14:59	28.60	OK
3145	2026-09-22 15:00	28.63	OK	3146	2026-09-22 15:01	28.02	OK
3147	2026-09-22 15:02	27.50	OK	3148	2026-09-22 15:03	26.95	OK
3149	2026-09-22 15:04	26.34	OK	3150	2026-09-22 15:05	27.90	OK
3151	2026-09-22 15:06	27.28	OK	3152	2026-09-22 15:07	28.09	OK
3153	2026-09-22 15:08	28.60	OK	3154	2026-09-22 15:09	28.21	OK
3155	2026-09-22 15:10	27.62	OK	3156	2026-09-22 15:11	27.41	OK
3157	2026-09-22 15:12	28.67	OK	3158	2026-09-22 15:13	26.68	OK
3159	2026-09-22 15:14	29.02	OK	3160	2026-09-22 15:15	26.73	OK
3161	2026-09-22 15:16	27.13	OK	3162	2026-09-22 15:17	28.92	OK
3163	2026-09-22 15:18	27.94	OK	3164	2026-09-22 15:19	27.66	OK
3165	2026-09-22 15:20	27.25	OK	3166	2026-09-22 15:21	26.53	OK
3167	2026-09-22 15:22	27.09	OK	3168	2026-09-22 15:23	27.99	OK
3169	2026-09-22 15:24	27.18	OK	3170	2026-09-22 15:25	28.79	OK
3171	2026-09-22 15:26	27.81	OK	3172	2026-09-22 15:27	28.06	OK
3173	2026-09-22 15:28	26.27	OK	3174	2026-09-22 15:29	26.84	OK
3175	2026-09-22 15:30	28.06	OK	3176	2026-09-22 15:31	28.09	OK
3177	2026-09-22 15:32	28.03	OK	3178	2026-09-22 15:33	27.09	OK
3179	2026-09-22 15:34	28.29	OK	3180	2026-09-22 15:35	28.73	OK
3181	2026-09-22 15:36	26.63	OK	3182	2026-09-22 15:37	26.44	OK
3183	2026-09-22 15:38	27.67	OK	3184	2026-09-22 15:39	27.97	OK
3185	2026-09-22 15:40	28.23	OK	3186	2026-09-22 15:41	28.60	OK
3187	2026-09-22 15:42	27.11	OK	3188	2026-09-22 15:43	27.79	OK
3189	2026-09-22 15:44	26.30	OK	3190	2026-09-22 15:45	27.52	OK
3191	2026-09-22 15:46	27.57	OK	3192	2026-09-22 15:47	29.21	OK
3193	2026-09-22 15:48	27.74	OK	3194	2026-09-22 15:49	27.54	OK
3195	2026-09-22 15:50	27.03	OK	3196	2026-09-22 15:51	27.05	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3197	2026-09-22 15:52	28.50	OK	3198	2026-09-22 15:53	27.12	OK
3199	2026-09-22 15:54	28.94	OK	3200	2026-09-22 15:55	26.47	OK
3201	2026-09-22 15:56	27.66	OK	3202	2026-09-22 15:57	27.31	OK
3203	2026-09-22 15:58	27.78	OK	3204	2026-09-22 15:59	26.78	OK
3205	2026-09-22 16:00	27.03	OK	3206	2026-09-22 16:01	27.18	OK
3207	2026-09-22 16:02	28.62	OK	3208	2026-09-22 16:03	27.39	OK
3209	2026-09-22 16:04	29.02	OK	3210	2026-09-22 16:05	28.06	OK
3211	2026-09-22 16:06	26.54	OK	3212	2026-09-22 16:07	27.30	OK
3213	2026-09-22 16:08	25.73	OK	3214	2026-09-22 16:09	25.35	OK
3215	2026-09-22 16:10	26.60	OK	3216	2026-09-22 16:11	26.75	OK
3217	2026-09-22 16:12	27.71	OK	3218	2026-09-22 16:13	27.18	OK
3219	2026-09-22 16:14	26.32	OK	3220	2026-09-22 16:15	27.60	OK
3221	2026-09-22 16:16	26.84	OK	3222	2026-09-22 16:17	25.74	OK
3223	2026-09-22 16:18	27.83	OK	3224	2026-09-22 16:19	26.91	OK
3225	2026-09-22 16:20	26.82	OK	3226	2026-09-22 16:21	27.40	OK
3227	2026-09-22 16:22	28.57	OK	3228	2026-09-22 16:23	26.19	OK
3229	2026-09-22 16:24	28.39	OK	3230	2026-09-22 16:25	26.37	OK
3231	2026-09-22 16:26	26.55	OK	3232	2026-09-22 16:27	26.32	OK
3233	2026-09-22 16:28	28.40	OK	3234	2026-09-22 16:29	27.09	OK
3235	2026-09-22 16:30	27.10	OK	3236	2026-09-22 16:31	27.78	OK
3237	2026-09-22 16:32	27.48	OK	3238	2026-09-22 16:33	26.85	OK
3239	2026-09-22 16:34	26.83	OK	3240	2026-09-22 16:35	26.18	OK
3241	2026-09-22 16:36	26.20	OK	3242	2026-09-22 16:37	25.85	OK
3243	2026-09-22 16:38	25.65	OK	3244	2026-09-22 16:39	28.81	OK
3245	2026-09-22 16:40	26.91	OK	3246	2026-09-22 16:41	26.60	OK
3247	2026-09-22 16:42	28.14	OK	3248	2026-09-22 16:43	26.52	OK
3249	2026-09-22 16:44	26.21	OK	3250	2026-09-22 16:45	25.73	OK
3251	2026-09-22 16:46	27.05	OK	3252	2026-09-22 16:47	26.94	OK
3253	2026-09-22 16:48	26.57	OK	3254	2026-09-22 16:49	27.09	OK
3255	2026-09-22 16:50	26.26	OK	3256	2026-09-22 16:51	27.35	OK
3257	2026-09-22 16:52	25.93	OK	3258	2026-09-22 16:53	26.99	OK
3259	2026-09-22 16:54	26.85	OK	3260	2026-09-22 16:55	28.08	OK
3261	2026-09-22 16:56	26.64	OK	3262	2026-09-22 16:57	26.49	OK
3263	2026-09-22 16:58	27.23	OK	3264	2026-09-22 16:59	27.58	OK
3265	2026-09-22 17:00	26.91	OK	3266	2026-09-22 17:01	26.09	OK
3267	2026-09-22 17:02	26.40	OK	3268	2026-09-22 17:03	27.65	OK
3269	2026-09-22 17:04	26.96	OK	3270	2026-09-22 17:05	27.36	OK
3271	2026-09-22 17:06	26.93	OK	3272	2026-09-22 17:07	26.96	OK
3273	2026-09-22 17:08	27.83	OK	3274	2026-09-22 17:09	27.60	OK
3275	2026-09-22 17:10	28.13	OK	3276	2026-09-22 17:11	26.27	OK
3277	2026-09-22 17:12	26.50	OK	3278	2026-09-22 17:13	27.11	OK
3279	2026-09-22 17:14	27.68	OK	3280	2026-09-22 17:15	27.79	OK
3281	2026-09-22 17:16	26.83	OK	3282	2026-09-22 17:17	27.30	OK
3283	2026-09-22 17:18	26.43	OK	3284	2026-09-22 17:19	26.80	OK
3285	2026-09-22 17:20	26.03	OK	3286	2026-09-22 17:21	25.97	OK
3287	2026-09-22 17:22	26.29	OK	3288	2026-09-22 17:23	26.07	OK
3289	2026-09-22 17:24	28.11	OK	3290	2026-09-22 17:25	26.67	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3291	2026-09-22 17:26	26.52	OK	3292	2026-09-22 17:27	26.74	OK
3293	2026-09-22 17:28	27.34	OK	3294	2026-09-22 17:29	26.59	OK
3295	2026-09-22 17:30	27.58	OK	3296	2026-09-22 17:31	27.22	OK
3297	2026-09-22 17:32	27.99	OK	3298	2026-09-22 17:33	27.07	OK
3299	2026-09-22 17:34	26.41	OK	3300	2026-09-22 17:35	26.89	OK
3301	2026-09-22 17:36	26.33	OK	3302	2026-09-22 17:37	27.23	OK
3303	2026-09-22 17:38	27.59	OK	3304	2026-09-22 17:39	25.32	OK
3305	2026-09-22 17:40	28.40	OK	3306	2026-09-22 17:41	25.68	OK
3307	2026-09-22 17:42	27.08	OK	3308	2026-09-22 17:43	25.25	OK
3309	2026-09-22 17:44	25.82	OK	3310	2026-09-22 17:45	26.63	OK
3311	2026-09-22 17:46	25.59	OK	3312	2026-09-22 17:47	26.83	OK
3313	2026-09-22 17:48	27.45	OK	3314	2026-09-22 17:49	27.31	OK
3315	2026-09-22 17:50	28.03	OK	3316	2026-09-22 17:51	26.44	OK
3317	2026-09-22 17:52	25.10	OK	3318	2026-09-22 17:53	26.71	OK
3319	2026-09-22 17:54	28.11	OK	3320	2026-09-22 17:55	26.17	OK
3321	2026-09-22 17:56	26.55	OK	3322	2026-09-22 17:57	27.50	OK
3323	2026-09-22 17:58	26.97	OK	3324	2026-09-22 17:59	25.60	OK
3325	2026-09-22 18:00	26.22	OK	3326	2026-09-22 18:01	26.10	OK
3327	2026-09-22 18:02	27.65	OK	3328	2026-09-22 18:03	25.55	OK
3329	2026-09-22 18:04	27.27	OK	3330	2026-09-22 18:05	27.74	OK
3331	2026-09-22 18:06	27.61	OK	3332	2026-09-22 18:07	26.97	OK
3333	2026-09-22 18:08	25.79	OK	3334	2026-09-22 18:09	27.50	OK
3335	2026-09-22 18:10	25.85	OK	3336	2026-09-22 18:11	27.61	OK
3337	2026-09-22 18:12	25.18	OK	3338	2026-09-22 18:13	26.41	OK
3339	2026-09-22 18:14	26.67	OK	3340	2026-09-22 18:15	28.60	OK
3341	2026-09-22 18:16	25.87	OK	3342	2026-09-22 18:17	26.92	OK
3343	2026-09-22 18:18	26.52	OK	3344	2026-09-22 18:19	26.42	OK
3345	2026-09-22 18:20	27.64	OK	3346	2026-09-22 18:21	25.64	OK
3347	2026-09-22 18:22	27.41	OK	3348	2026-09-22 18:23	27.51	OK
3349	2026-09-22 18:24	25.39	OK	3350	2026-09-22 18:25	27.38	OK
3351	2026-09-22 18:26	28.52	OK	3352	2026-09-22 18:27	25.45	OK
3353	2026-09-22 18:28	27.76	OK	3354	2026-09-22 18:29	27.29	OK
3355	2026-09-22 18:30	26.59	OK	3356	2026-09-22 18:31	27.49	OK
3357	2026-09-22 18:32	27.31	OK	3358	2026-09-22 18:33	27.06	OK
3359	2026-09-22 18:34	27.02	OK	3360	2026-09-22 18:35	26.72	OK
3361	2026-09-22 18:36	26.48	OK	3362	2026-09-22 18:37	28.54	OK
3363	2026-09-22 18:38	26.60	OK	3364	2026-09-22 18:39	26.31	OK
3365	2026-09-22 18:40	26.63	OK	3366	2026-09-22 18:41	28.00	OK
3367	2026-09-22 18:42	25.18	OK	3368	2026-09-22 18:43	25.94	OK
3369	2026-09-22 18:44	27.72	OK	3370	2026-09-22 18:45	27.35	OK
3371	2026-09-22 18:46	26.30	OK	3372	2026-09-22 18:47	26.40	OK
3373	2026-09-22 18:48	27.36	OK	3374	2026-09-22 18:49	27.57	OK
3375	2026-09-22 18:50	25.88	OK	3376	2026-09-22 18:51	26.36	OK
3377	2026-09-22 18:52	28.07	OK	3378	2026-09-22 18:53	26.62	OK
3379	2026-09-22 18:54	27.37	OK	3380	2026-09-22 18:55	25.21	OK
3381	2026-09-22 18:56	26.45	OK	3382	2026-09-22 18:57	25.84	OK
3383	2026-09-22 18:58	27.07	OK	3384	2026-09-22 18:59	25.46	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3385	2026-09-22 19:00	27.57	OK	3386	2026-09-22 19:01	25.97	OK
3387	2026-09-22 19:02	26.06	OK	3388	2026-09-22 19:03	27.27	OK
3389	2026-09-22 19:04	27.71	OK	3390	2026-09-22 19:05	27.56	OK
3391	2026-09-22 19:06	26.31	OK	3392	2026-09-22 19:07	26.20	OK
3393	2026-09-22 19:08	25.52	OK	3394	2026-09-22 19:09	26.12	OK
3395	2026-09-22 19:10	27.45	OK	3396	2026-09-22 19:11	25.89	OK
3397	2026-09-22 19:12	26.22	OK	3398	2026-09-22 19:13	26.96	OK
3399	2026-09-22 19:14	28.06	OK	3400	2026-09-22 19:15	26.45	OK
3401	2026-09-22 19:16	26.33	OK	3402	2026-09-22 19:17	25.99	OK
3403	2026-09-22 19:18	27.63	OK	3404	2026-09-22 19:19	27.31	OK
3405	2026-09-22 19:20	26.51	OK	3406	2026-09-22 19:21	27.96	OK
3407	2026-09-22 19:22	26.84	OK	3408	2026-09-22 19:23	25.62	OK
3409	2026-09-22 19:24	26.74	OK	3410	2026-09-22 19:25	27.19	OK
3411	2026-09-22 19:26	26.37	OK	3412	2026-09-22 19:27	26.94	OK
3413	2026-09-22 19:28	27.98	OK	3414	2026-09-22 19:29	27.05	OK
3415	2026-09-22 19:30	26.88	OK	3416	2026-09-22 19:31	27.60	OK
3417	2026-09-22 19:32	26.32	OK	3418	2026-09-22 19:33	27.43	OK
3419	2026-09-22 19:34	26.62	OK	3420	2026-09-22 19:35	26.21	OK
3421	2026-09-22 19:36	27.27	OK	3422	2026-09-22 19:37	25.57	OK
3423	2026-09-22 19:38	28.08	OK	3424	2026-09-22 19:39	27.91	OK
3425	2026-09-22 19:40	27.24	OK	3426	2026-09-22 19:41	26.43	OK
3427	2026-09-22 19:42	28.46	OK	3428	2026-09-22 19:43	24.94	OK
3429	2026-09-22 19:44	26.37	OK	3430	2026-09-22 19:45	26.77	OK
3431	2026-09-22 19:46	26.34	OK	3432	2026-09-22 19:47	28.51	OK
3433	2026-09-22 19:48	27.64	OK	3434	2026-09-22 19:49	26.84	OK
3435	2026-09-22 19:50	27.33	OK	3436	2026-09-22 19:51	27.62	OK
3437	2026-09-22 19:52	27.38	OK	3438	2026-09-22 19:53	27.95	OK
3439	2026-09-22 19:54	26.48	OK	3440	2026-09-22 19:55	27.63	OK
3441	2026-09-22 19:56	27.55	OK	3442	2026-09-22 19:57	27.84	OK
3443	2026-09-22 19:58	26.91	OK	3444	2026-09-22 19:59	27.42	OK
3445	2026-09-22 20:00	26.65	OK	3446	2026-09-22 20:01	26.17	OK
3447	2026-09-22 20:02	27.21	OK	3448	2026-09-22 20:03	27.41	OK
3449	2026-09-22 20:04	26.35	OK	3450	2026-09-22 20:05	26.01	OK
3451	2026-09-22 20:06	26.18	OK	3452	2026-09-22 20:07	27.58	OK
3453	2026-09-22 20:08	27.16	OK	3454	2026-09-22 20:09	26.16	OK
3455	2026-09-22 20:10	26.23	OK	3456	2026-09-22 20:11	26.80	OK
3457	2026-09-22 20:12	28.47	OK	3458	2026-09-22 20:13	27.58	OK
3459	2026-09-22 20:14	25.96	OK	3460	2026-09-22 20:15	26.84	OK
3461	2026-09-22 20:16	24.97	OK	3462	2026-09-22 20:17	28.34	OK
3463	2026-09-22 20:18	27.49	OK	3464	2026-09-22 20:19	27.41	OK
3465	2026-09-22 20:20	27.40	OK	3466	2026-09-22 20:21	25.70	OK
3467	2026-09-22 20:22	27.74	OK	3468	2026-09-22 20:23	26.85	OK
3469	2026-09-22 20:24	26.80	OK	3470	2026-09-22 20:25	27.41	OK
3471	2026-09-22 20:26	27.49	OK	3472	2026-09-22 20:27	28.58	OK
3473	2026-09-22 20:28	26.52	OK	3474	2026-09-22 20:29	25.86	OK
3475	2026-09-22 20:30	27.59	OK	3476	2026-09-22 20:31	26.41	OK
3477	2026-09-22 20:32	27.12	OK	3478	2026-09-22 20:33	26.60	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3479	2026-09-22 20:34	27.36	OK	3480	2026-09-22 20:35	26.81	OK
3481	2026-09-22 20:36	25.18	OK	3482	2026-09-22 20:37	27.58	OK
3483	2026-09-22 20:38	27.15	OK	3484	2026-09-22 20:39	28.39	OK
3485	2026-09-22 20:40	26.18	OK	3486	2026-09-22 20:41	27.37	OK
3487	2026-09-22 20:42	27.63	OK	3488	2026-09-22 20:43	27.04	OK
3489	2026-09-22 20:44	28.40	OK	3490	2026-09-22 20:45	26.33	OK
3491	2026-09-22 20:46	27.96	OK	3492	2026-09-22 20:47	26.46	OK
3493	2026-09-22 20:48	26.30	OK	3494	2026-09-22 20:49	27.25	OK
3495	2026-09-22 20:50	26.57	OK	3496	2026-09-22 20:51	26.87	OK
3497	2026-09-22 20:52	27.45	OK	3498	2026-09-22 20:53	26.64	OK
3499	2026-09-22 20:54	27.96	OK	3500	2026-09-22 20:55	27.79	OK
3501	2026-09-22 20:56	27.94	OK	3502	2026-09-22 20:57	27.99	OK
3503	2026-09-22 20:58	27.75	OK	3504	2026-09-22 20:59	25.35	OK
3505	2026-09-22 21:00	25.75	OK	3506	2026-09-22 21:01	27.69	OK
3507	2026-09-22 21:02	26.24	OK	3508	2026-09-22 21:03	26.74	OK
3509	2026-09-22 21:04	27.22	OK	3510	2026-09-22 21:05	27.90	OK
3511	2026-09-22 21:06	28.63	OK	3512	2026-09-22 21:07	26.91	OK
3513	2026-09-22 21:08	28.07	OK	3514	2026-09-22 21:09	28.16	OK
3515	2026-09-22 21:10	28.60	OK	3516	2026-09-22 21:11	27.18	OK
3517	2026-09-22 21:12	27.45	OK	3518	2026-09-22 21:13	27.14	OK
3519	2026-09-22 21:14	26.69	OK	3520	2026-09-22 21:15	28.11	OK
3521	2026-09-22 21:16	27.45	OK	3522	2026-09-22 21:17	28.85	OK
3523	2026-09-22 21:18	26.21	OK	3524	2026-09-22 21:19	27.35	OK
3525	2026-09-22 21:20	26.86	OK	3526	2026-09-22 21:21	28.01	OK
3527	2026-09-22 21:22	28.30	OK	3528	2026-09-22 21:23	27.45	OK
3529	2026-09-22 21:24	28.19	OK	3530	2026-09-22 21:25	26.45	OK
3531	2026-09-22 21:26	27.88	OK	3532	2026-09-22 21:27	28.21	OK
3533	2026-09-22 21:28	27.04	OK	3534	2026-09-22 21:29	27.50	OK
3535	2026-09-22 21:30	27.35	OK	3536	2026-09-22 21:31	27.06	OK
3537	2026-09-22 21:32	27.94	OK	3538	2026-09-22 21:33	27.91	OK
3539	2026-09-22 21:34	27.54	OK	3540	2026-09-22 21:35	27.78	OK
3541	2026-09-22 21:36	26.65	OK	3542	2026-09-22 21:37	28.35	OK
3543	2026-09-22 21:38	27.71	OK	3544	2026-09-22 21:39	28.25	OK
3545	2026-09-22 21:40	27.96	OK	3546	2026-09-22 21:41	27.75	OK
3547	2026-09-22 21:42	27.70	OK	3548	2026-09-22 21:43	26.65	OK
3549	2026-09-22 21:44	27.12	OK	3550	2026-09-22 21:45	27.98	OK
3551	2026-09-22 21:46	27.41	OK	3552	2026-09-22 21:47	27.66	OK
3553	2026-09-22 21:48	26.94	OK	3554	2026-09-22 21:49	27.84	OK
3555	2026-09-22 21:50	26.66	OK	3556	2026-09-22 21:51	27.48	OK
3557	2026-09-22 21:52	27.78	OK	3558	2026-09-22 21:53	28.05	OK
3559	2026-09-22 21:54	28.09	OK	3560	2026-09-22 21:55	27.73	OK
3561	2026-09-22 21:56	26.10	OK	3562	2026-09-22 21:57	28.01	OK
3563	2026-09-22 21:58	26.94	OK	3564	2026-09-22 21:59	28.28	OK
3565	2026-09-22 22:00	28.58	OK	3566	2026-09-22 22:01	26.19	OK
3567	2026-09-22 22:02	27.85	OK	3568	2026-09-22 22:03	26.11	OK
3569	2026-09-22 22:04	27.57	OK	3570	2026-09-22 22:05	27.64	OK
3571	2026-09-22 22:06	27.18	OK	3572	2026-09-22 22:07	27.74	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3573	2026-09-22 22:08	27.39	OK	3574	2026-09-22 22:09	27.63	OK
3575	2026-09-22 22:10	28.54	OK	3576	2026-09-22 22:11	28.21	OK
3577	2026-09-22 22:12	27.06	OK	3578	2026-09-22 22:13	27.51	OK
3579	2026-09-22 22:14	28.55	OK	3580	2026-09-22 22:15	28.65	OK
3581	2026-09-22 22:16	28.90	OK	3582	2026-09-22 22:17	27.06	OK
3583	2026-09-22 22:18	27.55	OK	3584	2026-09-22 22:19	28.60	OK
3585	2026-09-22 22:20	26.53	OK	3586	2026-09-22 22:21	27.69	OK
3587	2026-09-22 22:22	28.37	OK	3588	2026-09-22 22:23	26.43	OK
3589	2026-09-22 22:24	26.26	OK	3590	2026-09-22 22:25	29.17	OK
3591	2026-09-22 22:26	28.24	OK	3592	2026-09-22 22:27	27.33	OK
3593	2026-09-22 22:28	27.71	OK	3594	2026-09-22 22:29	28.57	OK
3595	2026-09-22 22:30	27.54	OK	3596	2026-09-22 22:31	28.90	OK
3597	2026-09-22 22:32	28.73	OK	3598	2026-09-22 22:33	27.22	OK
3599	2026-09-22 22:34	28.48	OK	3600	2026-09-22 22:35	29.15	OK
3601	2026-09-22 22:36	27.05	OK	3602	2026-09-22 22:37	27.31	OK
3603	2026-09-22 22:38	27.57	OK	3604	2026-09-22 22:39	27.92	OK
3605	2026-09-22 22:40	27.95	OK	3606	2026-09-22 22:41	27.90	OK
3607	2026-09-22 22:42	27.53	OK	3608	2026-09-22 22:43	29.68	OK
3609	2026-09-22 22:44	29.22	OK	3610	2026-09-22 22:45	28.85	OK
3611	2026-09-22 22:46	27.68	OK	3612	2026-09-22 22:47	28.20	OK
3613	2026-09-22 22:48	29.14	OK	3614	2026-09-22 22:49	29.11	OK
3615	2026-09-22 22:50	29.44	OK	3616	2026-09-22 22:51	26.89	OK
3617	2026-09-22 22:52	27.52	OK	3618	2026-09-22 22:53	27.93	OK
3619	2026-09-22 22:54	27.78	OK	3620	2026-09-22 22:55	27.25	OK
3621	2026-09-22 22:56	29.23	OK	3622	2026-09-22 22:57	27.73	OK
3623	2026-09-22 22:58	27.02	OK	3624	2026-09-22 22:59	28.43	OK
3625	2026-09-22 23:00	28.44	OK	3626	2026-09-22 23:01	29.49	OK
3627	2026-09-22 23:02	27.92	OK	3628	2026-09-22 23:03	27.49	OK
3629	2026-09-22 23:04	29.64	OK	3630	2026-09-22 23:05	27.77	OK
3631	2026-09-22 23:06	28.57	OK	3632	2026-09-22 23:07	28.42	OK
3633	2026-09-22 23:08	28.71	OK	3634	2026-09-22 23:09	27.82	OK
3635	2026-09-22 23:10	29.48	OK	3636	2026-09-22 23:11	28.81	OK
3637	2026-09-22 23:12	28.52	OK	3638	2026-09-22 23:13	26.63	OK
3639	2026-09-22 23:14	27.79	OK	3640	2026-09-22 23:15	28.71	OK
3641	2026-09-22 23:16	30.22	OK	3642	2026-09-22 23:17	29.11	OK
3643	2026-09-22 23:18	29.54	OK	3644	2026-09-22 23:19	29.32	OK
3645	2026-09-22 23:20	29.13	OK	3646	2026-09-22 23:21	28.29	OK
3647	2026-09-22 23:22	30.12	OK	3648	2026-09-22 23:23	28.02	OK
3649	2026-09-22 23:24	28.76	OK	3650	2026-09-22 23:25	28.49	OK
3651	2026-09-22 23:26	29.22	OK	3652	2026-09-22 23:27	29.09	OK
3653	2026-09-22 23:28	29.09	OK	3654	2026-09-22 23:29	29.04	OK
3655	2026-09-22 23:30	28.57	OK	3656	2026-09-22 23:31	27.04	OK
3657	2026-09-22 23:32	29.61	OK	3658	2026-09-22 23:33	27.29	OK
3659	2026-09-22 23:34	29.63	OK	3660	2026-09-22 23:35	29.06	OK
3661	2026-09-22 23:36	27.59	OK	3662	2026-09-22 23:37	30.00	OK
3663	2026-09-22 23:38	30.19	OK	3664	2026-09-22 23:39	29.20	OK
3665	2026-09-22 23:40	28.85	OK	3666	2026-09-22 23:41	28.77	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3667	2026-09-22 23:42	29.77	OK	3668	2026-09-22 23:43	29.01	OK
3669	2026-09-22 23:44	30.16	OK	3670	2026-09-22 23:45	29.10	OK
3671	2026-09-22 23:46	28.31	OK	3672	2026-09-22 23:47	27.89	OK
3673	2026-09-22 23:48	28.51	OK	3674	2026-09-22 23:49	27.64	OK
3675	2026-09-22 23:50	29.41	OK	3676	2026-09-22 23:51	29.07	OK
3677	2026-09-22 23:52	28.18	OK	3678	2026-09-22 23:53	28.46	OK
3679	2026-09-22 23:54	27.83	OK	3680	2026-09-22 23:55	28.26	OK
3681	2026-09-22 23:56	28.30	OK	3682	2026-09-22 23:57	28.96	OK
3683	2026-09-22 23:58	30.22	OK	3684	2026-09-22 23:59	29.94	OK
3685	2026-09-23 00:00	27.43	OK	3686	2026-09-23 00:01	30.11	OK
3687	2026-09-23 00:02	28.58	OK	3688	2026-09-23 00:03	27.98	OK
3689	2026-09-23 00:04	29.42	OK	3690	2026-09-23 00:05	29.88	OK
3691	2026-09-23 00:06	28.44	OK	3692	2026-09-23 00:07	28.24	OK
3693	2026-09-23 00:08	29.52	OK	3694	2026-09-23 00:09	28.97	OK
3695	2026-09-23 00:10	28.82	OK	3696	2026-09-23 00:11	29.88	OK
3697	2026-09-23 00:12	28.84	OK	3698	2026-09-23 00:13	29.57	OK
3699	2026-09-23 00:14	28.63	OK	3700	2026-09-23 00:15	29.73	OK
3701	2026-09-23 00:16	29.24	OK	3702	2026-09-23 00:17	29.17	OK
3703	2026-09-23 00:18	28.55	OK	3704	2026-09-23 00:19	28.64	OK
3705	2026-09-23 00:20	28.34	OK	3706	2026-09-23 00:21	27.44	OK
3707	2026-09-23 00:22	29.76	OK	3708	2026-09-23 00:23	29.35	OK
3709	2026-09-23 00:24	29.26	OK	3710	2026-09-23 00:25	27.57	OK
3711	2026-09-23 00:26	28.26	OK	3712	2026-09-23 00:27	30.13	OK
3713	2026-09-23 00:28	29.15	OK	3714	2026-09-23 00:29	28.98	OK
3715	2026-09-23 00:30	28.91	OK	3716	2026-09-23 00:31	27.96	OK
3717	2026-09-23 00:32	28.97	OK	3718	2026-09-23 00:33	29.90	OK
3719	2026-09-23 00:34	29.91	OK	3720	2026-09-23 00:35	28.48	OK
3721	2026-09-23 00:36	29.75	OK	3722	2026-09-23 00:37	28.13	OK
3723	2026-09-23 00:38	30.11	OK	3724	2026-09-23 00:39	28.91	OK
3725	2026-09-23 00:40	28.15	OK	3726	2026-09-23 00:41	27.99	OK
3727	2026-09-23 00:42	29.39	OK	3728	2026-09-23 00:43	28.95	OK
3729	2026-09-23 00:44	28.59	OK	3730	2026-09-23 00:45	29.27	OK
3731	2026-09-23 00:46	30.41	OK	3732	2026-09-23 00:47	28.76	OK
3733	2026-09-23 00:48	30.06	OK	3734	2026-09-23 00:49	29.11	OK
3735	2026-09-23 00:50	30.99	OK	3736	2026-09-23 00:51	29.75	OK
3737	2026-09-23 00:52	29.76	OK	3738	2026-09-23 00:53	30.30	OK
3739	2026-09-23 00:54	29.82	OK	3740	2026-09-23 00:55	30.26	OK
3741	2026-09-23 00:56	30.49	OK	3742	2026-09-23 00:57	29.09	OK
3743	2026-09-23 00:58	30.31	OK	3744	2026-09-23 00:59	29.97	OK
3745	2026-09-23 01:00	30.46	OK	3746	2026-09-23 01:01	28.34	OK
3747	2026-09-23 01:02	27.48	OK	3748	2026-09-23 01:03	30.22	OK
3749	2026-09-23 01:04	29.19	OK	3750	2026-09-23 01:05	29.43	OK
3751	2026-09-23 01:06	29.45	OK	3752	2026-09-23 01:07	30.16	OK
3753	2026-09-23 01:08	29.83	OK	3754	2026-09-23 01:09	28.30	OK
3755	2026-09-23 01:10	30.58	OK	3756	2026-09-23 01:11	29.44	OK
3757	2026-09-23 01:12	30.15	OK	3758	2026-09-23 01:13	29.62	OK
3759	2026-09-23 01:14	30.37	OK	3760	2026-09-23 01:15	30.16	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3761	2026-09-23 01:16	29.36	OK	3762	2026-09-23 01:17	29.44	OK
3763	2026-09-23 01:18	29.81	OK	3764	2026-09-23 01:19	31.06	OK
3765	2026-09-23 01:20	29.42	OK	3766	2026-09-23 01:21	29.95	OK
3767	2026-09-23 01:22	30.03	OK	3768	2026-09-23 01:23	29.24	OK
3769	2026-09-23 01:24	29.66	OK	3770	2026-09-23 01:25	29.02	OK
3771	2026-09-23 01:26	29.68	OK	3772	2026-09-23 01:27	29.84	OK
3773	2026-09-23 01:28	29.92	OK	3774	2026-09-23 01:29	29.75	OK
3775	2026-09-23 01:30	29.42	OK	3776	2026-09-23 01:31	30.40	OK
3777	2026-09-23 01:32	29.84	OK	3778	2026-09-23 01:33	29.97	OK
3779	2026-09-23 01:34	29.22	OK	3780	2026-09-23 01:35	30.35	OK
3781	2026-09-23 01:36	29.64	OK	3782	2026-09-23 01:37	30.27	OK
3783	2026-09-23 01:38	31.02	OK	3784	2026-09-23 01:39	30.17	OK
3785	2026-09-23 01:40	31.41	OK	3786	2026-09-23 01:41	28.69	OK
3787	2026-09-23 01:42	29.92	OK	3788	2026-09-23 01:43	30.50	OK
3789	2026-09-23 01:44	29.85	OK	3790	2026-09-23 01:45	29.47	OK
3791	2026-09-23 01:46	30.94	OK	3792	2026-09-23 01:47	29.06	OK
3793	2026-09-23 01:48	30.90	OK	3794	2026-09-23 01:49	29.29	OK
3795	2026-09-23 01:50	30.68	OK	3796	2026-09-23 01:51	29.79	OK
3797	2026-09-23 01:52	31.21	OK	3798	2026-09-23 01:53	28.96	OK
3799	2026-09-23 01:54	32.40	OK	3800	2026-09-23 01:55	30.25	OK
3801	2026-09-23 01:56	31.77	OK	3802	2026-09-23 01:57	30.07	OK
3803	2026-09-23 01:58	30.66	OK	3804	2026-09-23 01:59	31.08	OK
3805	2026-09-23 02:00	29.41	OK	3806	2026-09-23 02:01	30.34	OK
3807	2026-09-23 02:02	30.01	OK	3808	2026-09-23 02:03	31.60	OK
3809	2026-09-23 02:04	29.37	OK	3810	2026-09-23 02:05	30.84	OK
3811	2026-09-23 02:06	31.35	OK	3812	2026-09-23 02:07	28.98	OK
3813	2026-09-23 02:08	30.06	OK	3814	2026-09-23 02:09	31.33	OK
3815	2026-09-23 02:10	30.69	OK	3816	2026-09-23 02:11	30.54	OK
3817	2026-09-23 02:12	30.70	OK	3818	2026-09-23 02:13	29.41	OK
3819	2026-09-23 02:14	31.14	OK	3820	2026-09-23 02:15	30.43	OK
3821	2026-09-23 02:16	30.55	OK	3822	2026-09-23 02:17	28.41	OK
3823	2026-09-23 02:18	30.65	OK	3824	2026-09-23 02:19	31.00	OK
3825	2026-09-23 02:20	29.32	OK	3826	2026-09-23 02:21	30.54	OK
3827	2026-09-23 02:22	30.01	OK	3828	2026-09-23 02:23	31.07	OK
3829	2026-09-23 02:24	31.74	OK	3830	2026-09-23 02:25	31.50	OK
3831	2026-09-23 02:26	29.44	OK	3832	2026-09-23 02:27	29.77	OK
3833	2026-09-23 02:28	31.12	OK	3834	2026-09-23 02:29	31.30	OK
3835	2026-09-23 02:30	30.92	OK	3836	2026-09-23 02:31	29.58	OK
3837	2026-09-23 02:32	30.01	OK	3838	2026-09-23 02:33	30.71	OK
3839	2026-09-23 02:34	31.30	OK	3840	2026-09-23 02:35	29.05	OK
3841	2026-09-23 02:36	30.70	OK	3842	2026-09-23 02:37	31.18	OK
3843	2026-09-23 02:38	30.36	OK	3844	2026-09-23 02:39	30.84	OK
3845	2026-09-23 02:40	30.58	OK	3846	2026-09-23 02:41	30.88	OK
3847	2026-09-23 02:42	29.85	OK	3848	2026-09-23 02:43	30.64	OK
3849	2026-09-23 02:44	29.33	OK	3850	2026-09-23 02:45	29.49	OK
3851	2026-09-23 02:46	31.69	OK	3852	2026-09-23 02:47	31.10	OK
3853	2026-09-23 02:48	32.23	OK	3854	2026-09-23 02:49	30.34	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3855	2026-09-23 02:50	30.31	OK	3856	2026-09-23 02:51	31.95	OK
3857	2026-09-23 02:52	29.42	OK	3858	2026-09-23 02:53	31.11	OK
3859	2026-09-23 02:54	31.27	OK	3860	2026-09-23 02:55	29.23	OK
3861	2026-09-23 02:56	30.76	OK	3862	2026-09-23 02:57	30.13	OK
3863	2026-09-23 02:58	31.61	OK	3864	2026-09-23 02:59	30.92	OK
3865	2026-09-23 03:00	29.28	OK	3866	2026-09-23 03:01	30.76	OK
3867	2026-09-23 03:02	28.90	OK	3868	2026-09-23 03:03	30.43	OK
3869	2026-09-23 03:04	31.47	OK	3870	2026-09-23 03:05	29.95	OK
3871	2026-09-23 03:06	32.05	OK	3872	2026-09-23 03:07	30.87	OK
3873	2026-09-23 03:08	29.03	OK	3874	2026-09-23 03:09	30.18	OK
3875	2026-09-23 03:10	30.01	OK	3876	2026-09-23 03:11	30.53	OK
3877	2026-09-23 03:12	30.33	OK	3878	2026-09-23 03:13	30.35	OK
3879	2026-09-23 03:14	31.73	OK	3880	2026-09-23 03:15	31.02	OK
3881	2026-09-23 03:16	31.44	OK	3882	2026-09-23 03:17	32.13	OK
3883	2026-09-23 03:18	31.04	OK	3884	2026-09-23 03:19	32.04	OK
3885	2026-09-23 03:20	29.39	OK	3886	2026-09-23 03:21	31.21	OK
3887	2026-09-23 03:22	30.95	OK	3888	2026-09-23 03:23	28.74	OK
3889	2026-09-23 03:24	31.53	OK	3890	2026-09-23 03:25	32.93	OK
3891	2026-09-23 03:26	30.98	OK	3892	2026-09-23 03:27	30.52	OK
3893	2026-09-23 03:28	29.93	OK	3894	2026-09-23 03:29	31.76	OK
3895	2026-09-23 03:30	31.07	OK	3896	2026-09-23 03:31	30.52	OK
3897	2026-09-23 03:32	30.88	OK	3898	2026-09-23 03:33	30.24	OK
3899	2026-09-23 03:34	31.37	OK	3900	2026-09-23 03:35	31.57	OK
3901	2026-09-23 03:36	32.56	OK	3902	2026-09-23 03:37	33.01	OK
3903	2026-09-23 03:38	31.14	OK	3904	2026-09-23 03:39	30.38	OK
3905	2026-09-23 03:40	30.15	OK	3906	2026-09-23 03:41	31.48	OK
3907	2026-09-23 03:42	30.68	OK	3908	2026-09-23 03:43	31.01	OK
3909	2026-09-23 03:44	31.14	OK	3910	2026-09-23 03:45	31.67	OK
3911	2026-09-23 03:46	30.80	OK	3912	2026-09-23 03:47	30.69	OK
3913	2026-09-23 03:48	30.99	OK	3914	2026-09-23 03:49	31.59	OK
3915	2026-09-23 03:50	31.20	OK	3916	2026-09-23 03:51	31.94	OK
3917	2026-09-23 03:52	31.95	OK	3918	2026-09-23 03:53	31.86	OK
3919	2026-09-23 03:54	31.03	OK	3920	2026-09-23 03:55	30.25	OK
3921	2026-09-23 03:56	31.64	OK	3922	2026-09-23 03:57	31.45	OK
3923	2026-09-23 03:58	29.39	OK	3924	2026-09-23 03:59	31.43	OK
3925	2026-09-23 04:00	31.21	OK	3926	2026-09-23 04:01	30.10	OK
3927	2026-09-23 04:02	30.22	OK	3928	2026-09-23 04:03	32.06	OK
3929	2026-09-23 04:04	30.38	OK	3930	2026-09-23 04:05	29.94	OK
3931	2026-09-23 04:06	30.83	OK	3932	2026-09-23 04:07	29.81	OK
3933	2026-09-23 04:08	32.74	OK	3934	2026-09-23 04:09	32.10	OK
3935	2026-09-23 04:10	31.45	OK	3936	2026-09-23 04:11	29.50	OK
3937	2026-09-23 04:12	31.68	OK	3938	2026-09-23 04:13	32.53	OK
3939	2026-09-23 04:14	30.94	OK	3940	2026-09-23 04:15	30.98	OK
3941	2026-09-23 04:16	31.08	OK	3942	2026-09-23 04:17	31.28	OK
3943	2026-09-23 04:18	30.25	OK	3944	2026-09-23 04:19	31.40	OK
3945	2026-09-23 04:20	32.15	OK	3946	2026-09-23 04:21	31.48	OK
3947	2026-09-23 04:22	30.87	OK	3948	2026-09-23 04:23	30.38	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
3949	2026-09-23 04:24	32.43	OK	3950	2026-09-23 04:25	31.98	OK
3951	2026-09-23 04:26	29.89	OK	3952	2026-09-23 04:27	31.27	OK
3953	2026-09-23 04:28	31.15	OK	3954	2026-09-23 04:29	31.30	OK
3955	2026-09-23 04:30	31.89	OK	3956	2026-09-23 04:31	31.09	OK
3957	2026-09-23 04:32	31.07	OK	3958	2026-09-23 04:33	32.57	OK
3959	2026-09-23 04:34	32.06	OK	3960	2026-09-23 04:35	30.91	OK
3961	2026-09-23 04:36	31.67	OK	3962	2026-09-23 04:37	31.50	OK
3963	2026-09-23 04:38	30.64	OK	3964	2026-09-23 04:39	31.59	OK
3965	2026-09-23 04:40	30.66	OK	3966	2026-09-23 04:41	30.01	OK
3967	2026-09-23 04:42	32.41	OK	3968	2026-09-23 04:43	30.97	OK
3969	2026-09-23 04:44	32.65	OK	3970	2026-09-23 04:45	32.29	OK
3971	2026-09-23 04:46	32.22	OK	3972	2026-09-23 04:47	31.23	OK
3973	2026-09-23 04:48	31.73	OK	3974	2026-09-23 04:49	32.28	OK
3975	2026-09-23 04:50	32.44	OK	3976	2026-09-23 04:51	32.42	OK
3977	2026-09-23 04:52	31.64	OK	3978	2026-09-23 04:53	32.68	OK
3979	2026-09-23 04:54	31.46	OK	3980	2026-09-23 04:55	31.56	OK
3981	2026-09-23 04:56	30.74	OK	3982	2026-09-23 04:57	31.40	OK
3983	2026-09-23 04:58	30.18	OK	3984	2026-09-23 04:59	30.26	OK
3985	2026-09-23 05:00	30.76	OK	3986	2026-09-23 05:01	31.84	OK
3987	2026-09-23 05:02	30.78	OK	3988	2026-09-23 05:03	31.06	OK
3989	2026-09-23 05:04	32.05	OK	3990	2026-09-23 05:05	32.21	OK
3991	2026-09-23 05:06	32.57	OK	3992	2026-09-23 05:07	30.45	OK
3993	2026-09-23 05:08	32.18	OK	3994	2026-09-23 05:09	31.39	OK
3995	2026-09-23 05:10	31.70	OK	3996	2026-09-23 05:11	31.23	OK
3997	2026-09-23 05:12	30.75	OK	3998	2026-09-23 05:13	31.77	OK
3999	2026-09-23 05:14	32.17	OK	4000	2026-09-23 05:15	32.91	OK
4001	2026-09-23 05:16	30.58	OK	4002	2026-09-23 05:17	31.45	OK
4003	2026-09-23 05:18	31.17	OK	4004	2026-09-23 05:19	32.37	OK
4005	2026-09-23 05:20	32.64	OK	4006	2026-09-23 05:21	30.09	OK
4007	2026-09-23 05:22	32.01	OK	4008	2026-09-23 05:23	32.10	OK
4009	2026-09-23 05:24	31.79	OK	4010	2026-09-23 05:25	31.45	OK
4011	2026-09-23 05:26	31.47	OK	4012	2026-09-23 05:27	31.64	OK
4013	2026-09-23 05:28	31.90	OK	4014	2026-09-23 05:29	31.74	OK
4015	2026-09-23 05:30	30.71	OK	4016	2026-09-23 05:31	31.00	OK
4017	2026-09-23 05:32	32.67	OK	4018	2026-09-23 05:33	31.11	OK
4019	2026-09-23 05:34	31.95	OK	4020	2026-09-23 05:35	31.20	OK
4021	2026-09-23 05:36	31.36	OK	4022	2026-09-23 05:37	30.64	OK
4023	2026-09-23 05:38	33.28	OK	4024	2026-09-23 05:39	31.95	OK
4025	2026-09-23 05:40	30.97	OK	4026	2026-09-23 05:41	32.34	OK
4027	2026-09-23 05:42	31.63	OK	4028	2026-09-23 05:43	32.04	OK
4029	2026-09-23 05:44	31.27	OK	4030	2026-09-23 05:45	32.09	OK
4031	2026-09-23 05:46	32.07	OK	4032	2026-09-23 05:47	32.29	OK
4033	2026-09-23 05:48	31.59	OK	4034	2026-09-23 05:49	32.08	OK
4035	2026-09-23 05:50	32.28	OK	4036	2026-09-23 05:51	29.95	OK
4037	2026-09-23 05:52	31.49	OK	4038	2026-09-23 05:53	30.48	OK
4039	2026-09-23 05:54	31.40	OK	4040	2026-09-23 05:55	31.04	OK
4041	2026-09-23 05:56	33.18	OK	4042	2026-09-23 05:57	31.18	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4043	2026-09-23 05:58	31.68	OK	4044	2026-09-23 05:59	32.91	OK
4045	2026-09-23 06:00	31.98	OK	4046	2026-09-23 06:01	30.91	OK
4047	2026-09-23 06:02	30.74	OK	4048	2026-09-23 06:03	31.19	OK
4049	2026-09-23 06:04	31.58	OK	4050	2026-09-23 06:05	30.96	OK
4051	2026-09-23 06:06	31.20	OK	4052	2026-09-23 06:07	30.55	OK
4053	2026-09-23 06:08	31.92	OK	4054	2026-09-23 06:09	32.86	OK
4055	2026-09-23 06:10	30.80	OK	4056	2026-09-23 06:11	30.53	OK
4057	2026-09-23 06:12	31.86	OK	4058	2026-09-23 06:13	31.34	OK
4059	2026-09-23 06:14	30.91	OK	4060	2026-09-23 06:15	32.11	OK
4061	2026-09-23 06:16	32.61	OK	4062	2026-09-23 06:17	31.20	OK
4063	2026-09-23 06:18	31.00	OK	4064	2026-09-23 06:19	32.22	OK
4065	2026-09-23 06:20	32.46	OK	4066	2026-09-23 06:21	32.89	OK
4067	2026-09-23 06:22	31.56	OK	4068	2026-09-23 06:23	31.07	OK
4069	2026-09-23 06:24	32.07	OK	4070	2026-09-23 06:25	29.51	OK
4071	2026-09-23 06:26	31.08	OK	4072	2026-09-23 06:27	30.84	OK
4073	2026-09-23 06:28	31.89	OK	4074	2026-09-23 06:29	31.05	OK
4075	2026-09-23 06:30	30.83	OK	4076	2026-09-23 06:31	30.94	OK
4077	2026-09-23 06:32	32.50	OK	4078	2026-09-23 06:33	32.78	OK
4079	2026-09-23 06:34	31.72	OK	4080	2026-09-23 06:35	31.18	OK
4081	2026-09-23 06:36	32.46	OK	4082	2026-09-23 06:37	31.42	OK
4083	2026-09-23 06:38	31.30	OK	4084	2026-09-23 06:39	30.37	OK
4085	2026-09-23 06:40	31.67	OK	4086	2026-09-23 06:41	31.27	OK
4087	2026-09-23 06:42	31.91	OK	4088	2026-09-23 06:43	31.02	OK
4089	2026-09-23 06:44	32.55	OK	4090	2026-09-23 06:45	32.27	OK
4091	2026-09-23 06:46	31.17	OK	4092	2026-09-23 06:47	32.78	OK
4093	2026-09-23 06:48	31.37	OK	4094	2026-09-23 06:49	31.59	OK
4095	2026-09-23 06:50	32.69	OK	4096	2026-09-23 06:51	32.26	OK
4097	2026-09-23 06:52	31.72	OK	4098	2026-09-23 06:53	31.36	OK
4099	2026-09-23 06:54	31.77	OK	4100	2026-09-23 06:55	31.46	OK
4101	2026-09-23 06:56	31.18	OK	4102	2026-09-23 06:57	31.70	OK
4103	2026-09-23 06:58	31.71	OK	4104	2026-09-23 06:59	32.48	OK
4105	2026-09-23 07:00	32.40	OK	4106	2026-09-23 07:01	32.04	OK
4107	2026-09-23 07:02	32.22	OK	4108	2026-09-23 07:03	31.33	OK
4109	2026-09-23 07:04	31.21	OK	4110	2026-09-23 07:05	31.24	OK
4111	2026-09-23 07:06	31.21	OK	4112	2026-09-23 07:07	32.36	OK
4113	2026-09-23 07:08	32.57	OK	4114	2026-09-23 07:09	31.01	OK
4115	2026-09-23 07:10	32.62	OK	4116	2026-09-23 07:11	31.12	OK
4117	2026-09-23 07:12	30.82	OK	4118	2026-09-23 07:13	31.82	OK
4119	2026-09-23 07:14	32.16	OK	4120	2026-09-23 07:15	31.50	OK
4121	2026-09-23 07:16	31.95	OK	4122	2026-09-23 07:17	31.28	OK
4123	2026-09-23 07:18	33.15	OK	4124	2026-09-23 07:19	31.27	OK
4125	2026-09-23 07:20	33.37	OK	4126	2026-09-23 07:21	31.51	OK
4127	2026-09-23 07:22	30.54	OK	4128	2026-09-23 07:23	31.97	OK
4129	2026-09-23 07:24	30.33	OK	4130	2026-09-23 07:25	31.29	OK
4131	2026-09-23 07:26	30.15	OK	4132	2026-09-23 07:27	31.91	OK
4133	2026-09-23 07:28	32.63	OK	4134	2026-09-23 07:29	32.87	OK
4135	2026-09-23 07:30	30.49	OK	4136	2026-09-23 07:31	31.30	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4137	2026-09-23 07:32	31.87	OK	4138	2026-09-23 07:33	31.74	OK
4139	2026-09-23 07:34	32.12	OK	4140	2026-09-23 07:35	30.25	OK
4141	2026-09-23 07:36	32.21	OK	4142	2026-09-23 07:37	31.31	OK
4143	2026-09-23 07:38	30.55	OK	4144	2026-09-23 07:39	31.72	OK
4145	2026-09-23 07:40	31.39	OK	4146	2026-09-23 07:41	32.01	OK
4147	2026-09-23 07:42	32.42	OK	4148	2026-09-23 07:43	29.66	OK
4149	2026-09-23 07:44	30.93	OK	4150	2026-09-23 07:45	33.50	OK
4151	2026-09-23 07:46	32.38	OK	4152	2026-09-23 07:47	31.23	OK
4153	2026-09-23 07:48	32.60	OK	4154	2026-09-23 07:49	30.99	OK
4155	2026-09-23 07:50	32.50	OK	4156	2026-09-23 07:51	29.80	OK
4157	2026-09-23 07:52	30.44	OK	4158	2026-09-23 07:53	32.02	OK
4159	2026-09-23 07:54	31.59	OK	4160	2026-09-23 07:55	31.21	OK
4161	2026-09-23 07:56	33.52	OK	4162	2026-09-23 07:57	32.40	OK
4163	2026-09-23 07:58	31.00	OK	4164	2026-09-23 07:59	33.01	OK
4165	2026-09-23 08:00	31.03	OK	4166	2026-09-23 08:01	30.77	OK
4167	2026-09-23 08:02	30.69	OK	4168	2026-09-23 08:03	31.56	OK
4169	2026-09-23 08:04	31.08	OK	4170	2026-09-23 08:05	30.62	OK
4171	2026-09-23 08:06	31.78	OK	4172	2026-09-23 08:07	30.55	OK
4173	2026-09-23 08:08	31.06	OK	4174	2026-09-23 08:09	31.79	OK
4175	2026-09-23 08:10	32.43	OK	4176	2026-09-23 08:11	31.33	OK
4177	2026-09-23 08:12	32.36	OK	4178	2026-09-23 08:13	31.84	OK
4179	2026-09-23 08:14	30.66	OK	4180	2026-09-23 08:15	32.24	OK
4181	2026-09-23 08:16	32.39	OK	4182	2026-09-23 08:17	30.77	OK
4183	2026-09-23 08:18	33.09	OK	4184	2026-09-23 08:19	32.07	OK
4185	2026-09-23 08:20	30.42	OK	4186	2026-09-23 08:21	30.29	OK
4187	2026-09-23 08:22	31.85	OK	4188	2026-09-23 08:23	31.75	OK
4189	2026-09-23 08:24	31.32	OK	4190	2026-09-23 08:25	32.06	OK
4191	2026-09-23 08:26	31.28	OK	4192	2026-09-23 08:27	33.19	OK
4193	2026-09-23 08:28	32.85	OK	4194	2026-09-23 08:29	31.15	OK
4195	2026-09-23 08:30	31.57	OK	4196	2026-09-23 08:31	31.35	OK
4197	2026-09-23 08:32	30.41	OK	4198	2026-09-23 08:33	32.45	OK
4199	2026-09-23 08:34	29.90	OK	4200	2026-09-23 08:35	32.84	OK
4201	2026-09-23 08:36	29.74	OK	4202	2026-09-23 08:37	31.02	OK
4203	2026-09-23 08:38	31.82	OK	4204	2026-09-23 08:39	31.34	OK
4205	2026-09-23 08:40	31.67	OK	4206	2026-09-23 08:41	32.07	OK
4207	2026-09-23 08:42	32.29	OK	4208	2026-09-23 08:43	30.80	OK
4209	2026-09-23 08:44	30.66	OK	4210	2026-09-23 08:45	31.87	OK
4211	2026-09-23 08:46	31.02	OK	4212	2026-09-23 08:47	30.85	OK
4213	2026-09-23 08:48	32.04	OK	4214	2026-09-23 08:49	30.73	OK
4215	2026-09-23 08:50	30.90	OK	4216	2026-09-23 08:51	30.69	OK
4217	2026-09-23 08:52	31.01	OK	4218	2026-09-23 08:53	32.26	OK
4219	2026-09-23 08:54	31.68	OK	4220	2026-09-23 08:55	31.15	OK
4221	2026-09-23 08:56	31.98	OK	4222	2026-09-23 08:57	31.70	OK
4223	2026-09-23 08:58	31.05	OK	4224	2026-09-23 08:59	30.43	OK
4225	2026-09-23 09:00	30.77	OK	4226	2026-09-23 09:01	31.77	OK
4227	2026-09-23 09:02	31.83	OK	4228	2026-09-23 09:03	30.28	OK
4229	2026-09-23 09:04	30.99	OK	4230	2026-09-23 09:05	31.03	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4231	2026-09-23 09:06	30.38	OK	4232	2026-09-23 09:07	32.87	OK
4233	2026-09-23 09:08	30.76	OK	4234	2026-09-23 09:09	32.64	OK
4235	2026-09-23 09:10	31.41	OK	4236	2026-09-23 09:11	31.23	OK
4237	2026-09-23 09:12	31.38	OK	4238	2026-09-23 09:13	30.48	OK
4239	2026-09-23 09:14	32.22	OK	4240	2026-09-23 09:15	32.17	OK
4241	2026-09-23 09:16	32.21	OK	4242	2026-09-23 09:17	30.19	OK
4243	2026-09-23 09:18	32.84	OK	4244	2026-09-23 09:19	31.49	OK
4245	2026-09-23 09:20	31.22	OK	4246	2026-09-23 09:21	31.90	OK
4247	2026-09-23 09:22	31.34	OK	4248	2026-09-23 09:23	29.93	OK
4249	2026-09-23 09:24	29.40	OK	4250	2026-09-23 09:25	30.62	OK
4251	2026-09-23 09:26	31.42	OK	4252	2026-09-23 09:27	30.93	OK
4253	2026-09-23 09:28	30.38	OK	4254	2026-09-23 09:29	30.56	OK
4255	2026-09-23 09:30	31.61	OK	4256	2026-09-23 09:31	32.16	OK
4257	2026-09-23 09:32	29.86	OK	4258	2026-09-23 09:33	31.73	OK
4259	2026-09-23 09:34	30.75	OK	4260	2026-09-23 09:35	30.84	OK
4261	2026-09-23 09:36	30.76	OK	4262	2026-09-23 09:37	30.86	OK
4263	2026-09-23 09:38	30.24	OK	4264	2026-09-23 09:39	31.46	OK
4265	2026-09-23 09:40	30.31	OK	4266	2026-09-23 09:41	30.27	OK
4267	2026-09-23 09:42	30.59	OK	4268	2026-09-23 09:43	30.74	OK
4269	2026-09-23 09:44	31.57	OK	4270	2026-09-23 09:45	30.90	OK
4271	2026-09-23 09:46	29.25	OK	4272	2026-09-23 09:47	30.59	OK
4273	2026-09-23 09:48	31.16	OK	4274	2026-09-23 09:49	31.18	OK
4275	2026-09-23 09:50	31.43	OK	4276	2026-09-23 09:51	29.43	OK
4277	2026-09-23 09:52	30.11	OK	4278	2026-09-23 09:53	32.53	OK
4279	2026-09-23 09:54	31.32	OK	4280	2026-09-23 09:55	30.58	OK
4281	2026-09-23 09:56	32.36	OK	4282	2026-09-23 09:57	29.74	OK
4283	2026-09-23 09:58	31.56	OK	4284	2026-09-23 09:59	30.78	OK
4285	2026-09-23 10:00	30.68	OK	4286	2026-09-23 10:01	31.53	OK
4287	2026-09-23 10:02	30.73	OK	4288	2026-09-23 10:03	29.13	OK
4289	2026-09-23 10:04	29.99	OK	4290	2026-09-23 10:05	31.11	OK
4291	2026-09-23 10:06	31.82	OK	4292	2026-09-23 10:07	29.62	OK
4293	2026-09-23 10:08	29.81	OK	4294	2026-09-23 10:09	31.50	OK
4295	2026-09-23 10:10	31.47	OK	4296	2026-09-23 10:11	30.89	OK
4297	2026-09-23 10:12	30.92	OK	4298	2026-09-23 10:13	31.46	OK
4299	2026-09-23 10:14	30.91	OK	4300	2026-09-23 10:15	30.62	OK
4301	2026-09-23 10:16	29.23	OK	4302	2026-09-23 10:17	30.38	OK
4303	2026-09-23 10:18	30.66	OK	4304	2026-09-23 10:19	31.72	OK
4305	2026-09-23 10:20	30.15	OK	4306	2026-09-23 10:21	30.10	OK
4307	2026-09-23 10:22	31.69	OK	4308	2026-09-23 10:23	31.98	OK
4309	2026-09-23 10:24	30.58	OK	4310	2026-09-23 10:25	31.83	OK
4311	2026-09-23 10:26	31.31	OK	4312	2026-09-23 10:27	30.38	OK
4313	2026-09-23 10:28	31.72	OK	4314	2026-09-23 10:29	30.63	OK
4315	2026-09-23 10:30	30.75	OK	4316	2026-09-23 10:31	29.70	OK
4317	2026-09-23 10:32	30.12	OK	4318	2026-09-23 10:33	31.57	OK
4319	2026-09-23 10:34	29.82	OK	4320	2026-09-23 10:35	31.73	OK
4321	2026-09-23 10:36	30.31	OK	4322	2026-09-23 10:37	29.86	OK
4323	2026-09-23 10:38	29.95	OK	4324	2026-09-23 10:39	31.09	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4325	2026-09-23 10:40	30.92	OK	4326	2026-09-23 10:41	29.48	OK
4327	2026-09-23 10:42	30.15	OK	4328	2026-09-23 10:43	29.46	OK
4329	2026-09-23 10:44	30.79	OK	4330	2026-09-23 10:45	30.64	OK
4331	2026-09-23 10:46	30.32	OK	4332	2026-09-23 10:47	29.83	OK
4333	2026-09-23 10:48	30.01	OK	4334	2026-09-23 10:49	29.00	OK
4335	2026-09-23 10:50	29.68	OK	4336	2026-09-23 10:51	29.66	OK
4337	2026-09-23 10:52	30.40	OK	4338	2026-09-23 10:53	30.17	OK
4339	2026-09-23 10:54	28.75	OK	4340	2026-09-23 10:55	30.14	OK
4341	2026-09-23 10:56	31.10	OK	4342	2026-09-23 10:57	30.79	OK
4343	2026-09-23 10:58	31.25	OK	4344	2026-09-23 10:59	31.12	OK
4345	2026-09-23 11:00	29.97	OK	4346	2026-09-23 11:01	30.07	OK
4347	2026-09-23 11:02	31.09	OK	4348	2026-09-23 11:03	28.85	OK
4349	2026-09-23 11:04	29.59	OK	4350	2026-09-23 11:05	29.86	OK
4351	2026-09-23 11:06	30.72	OK	4352	2026-09-23 11:07	30.09	OK
4353	2026-09-23 11:08	30.00	OK	4354	2026-09-23 11:09	28.69	OK
4355	2026-09-23 11:10	30.24	OK	4356	2026-09-23 11:11	29.59	OK
4357	2026-09-23 11:12	30.83	OK	4358	2026-09-23 11:13	31.24	OK
4359	2026-09-23 11:14	30.62	OK	4360	2026-09-23 11:15	31.83	OK
4361	2026-09-23 11:16	29.82	OK	4362	2026-09-23 11:17	29.35	OK
4363	2026-09-23 11:18	29.88	OK	4364	2026-09-23 11:19	30.51	OK
4365	2026-09-23 11:20	29.00	OK	4366	2026-09-23 11:21	30.28	OK
4367	2026-09-23 11:22	29.28	OK	4368	2026-09-23 11:23	29.19	OK
4369	2026-09-23 11:24	30.04	OK	4370	2026-09-23 11:25	28.49	OK
4371	2026-09-23 11:26	30.92	OK	4372	2026-09-23 11:27	29.71	OK
4373	2026-09-23 11:28	29.07	OK	4374	2026-09-23 11:29	29.50	OK
4375	2026-09-23 11:30	30.54	OK	4376	2026-09-23 11:31	31.85	OK
4377	2026-09-23 11:32	30.29	OK	4378	2026-09-23 11:33	30.75	OK
4379	2026-09-23 11:34	29.44	OK	4380	2026-09-23 11:35	29.83	OK
4381	2026-09-23 11:36	30.67	OK	4382	2026-09-23 11:37	29.99	OK
4383	2026-09-23 11:38	28.84	OK	4384	2026-09-23 11:39	29.41	OK
4385	2026-09-23 11:40	30.29	OK	4386	2026-09-23 11:41	29.43	OK
4387	2026-09-23 11:42	30.50	OK	4388	2026-09-23 11:43	31.53	OK
4389	2026-09-23 11:44	30.34	OK	4390	2026-09-23 11:45	29.39	OK
4391	2026-09-23 11:46	28.44	OK	4392	2026-09-23 11:47	30.07	OK
4393	2026-09-23 11:48	30.59	OK	4394	2026-09-23 11:49	30.48	OK
4395	2026-09-23 11:50	29.28	OK	4396	2026-09-23 11:51	28.78	OK
4397	2026-09-23 11:52	29.84	OK	4398	2026-09-23 11:53	30.02	OK
4399	2026-09-23 11:54	28.82	OK	4400	2026-09-23 11:55	29.33	OK
4401	2026-09-23 11:56	30.38	OK	4402	2026-09-23 11:57	30.29	OK
4403	2026-09-23 11:58	28.96	OK	4404	2026-09-23 11:59	29.05	OK
4405	2026-09-23 12:00	28.45	OK	4406	2026-09-23 12:01	30.11	OK
4407	2026-09-23 12:02	28.96	OK	4408	2026-09-23 12:03	28.81	OK
4409	2026-09-23 12:04	29.03	OK	4410	2026-09-23 12:05	28.69	OK
4411	2026-09-23 12:06	28.77	OK	4412	2026-09-23 12:07	29.19	OK
4413	2026-09-23 12:08	29.37	OK	4414	2026-09-23 12:09	29.72	OK
4415	2026-09-23 12:10	29.10	OK	4416	2026-09-23 12:11	28.48	OK
4417	2026-09-23 12:12	28.39	OK	4418	2026-09-23 12:13	29.06	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4419	2026-09-23 12:14	29.36	OK	4420	2026-09-23 12:15	29.32	OK
4421	2026-09-23 12:16	28.35	OK	4422	2026-09-23 12:17	27.72	OK
4423	2026-09-23 12:18	28.23	OK	4424	2026-09-23 12:19	28.54	OK
4425	2026-09-23 12:20	28.44	OK	4426	2026-09-23 12:21	29.74	OK
4427	2026-09-23 12:22	30.08	OK	4428	2026-09-23 12:23	28.79	OK
4429	2026-09-23 12:24	29.92	OK	4430	2026-09-23 12:25	29.50	OK
4431	2026-09-23 12:26	29.64	OK	4432	2026-09-23 12:27	28.30	OK
4433	2026-09-23 12:28	28.32	OK	4434	2026-09-23 12:29	29.94	OK
4435	2026-09-23 12:30	29.65	OK	4436	2026-09-23 12:31	29.67	OK
4437	2026-09-23 12:32	29.17	OK	4438	2026-09-23 12:33	28.95	OK
4439	2026-09-23 12:34	29.11	OK	4440	2026-09-23 12:35	29.45	OK
4441	2026-09-23 12:36	30.52	OK	4442	2026-09-23 12:37	28.31	OK
4443	2026-09-23 12:38	29.02	OK	4444	2026-09-23 12:39	28.38	OK
4445	2026-09-23 12:40	29.04	OK	4446	2026-09-23 12:41	29.09	OK
4447	2026-09-23 12:42	29.19	OK	4448	2026-09-23 12:43	29.22	OK
4449	2026-09-23 12:44	28.08	OK	4450	2026-09-23 12:45	29.53	OK
4451	2026-09-23 12:46	29.29	OK	4452	2026-09-23 12:47	28.16	OK
4453	2026-09-23 12:48	29.87	OK	4454	2026-09-23 12:49	28.36	OK
4455	2026-09-23 12:50	28.97	OK	4456	2026-09-23 12:51	28.02	OK
4457	2026-09-23 12:52	28.85	OK	4458	2026-09-23 12:53	29.19	OK
4459	2026-09-23 12:54	29.74	OK	4460	2026-09-23 12:55	28.84	OK
4461	2026-09-23 12:56	28.13	OK	4462	2026-09-23 12:57	28.47	OK
4463	2026-09-23 12:58	29.20	OK	4464	2026-09-23 12:59	27.79	OK
4465	2026-09-23 13:00	27.03	OK	4466	2026-09-23 13:01	30.05	OK
4467	2026-09-23 13:02	29.88	OK	4468	2026-09-23 13:03	27.97	OK
4469	2026-09-23 13:04	28.61	OK	4470	2026-09-23 13:05	27.87	OK
4471	2026-09-23 13:06	28.64	OK	4472	2026-09-23 13:07	27.89	OK
4473	2026-09-23 13:08	27.79	OK	4474	2026-09-23 13:09	29.52	OK
4475	2026-09-23 13:10	27.09	OK	4476	2026-09-23 13:11	28.69	OK
4477	2026-09-23 13:12	30.13	OK	4478	2026-09-23 13:13	29.54	OK
4479	2026-09-23 13:14	29.21	OK	4480	2026-09-23 13:15	29.19	OK
4481	2026-09-23 13:16	28.31	OK	4482	2026-09-23 13:17	28.87	OK
4483	2026-09-23 13:18	28.46	OK	4484	2026-09-23 13:19	28.36	OK
4485	2026-09-23 13:20	28.60	OK	4486	2026-09-23 13:21	28.19	OK
4487	2026-09-23 13:22	29.78	OK	4488	2026-09-23 13:23	28.29	OK
4489	2026-09-23 13:24	28.02	OK	4490	2026-09-23 13:25	26.96	OK
4491	2026-09-23 13:26	29.96	OK	4492	2026-09-23 13:27	28.98	OK
4493	2026-09-23 13:28	29.12	OK	4494	2026-09-23 13:29	28.60	OK
4495	2026-09-23 13:30	29.11	OK	4496	2026-09-23 13:31	28.24	OK
4497	2026-09-23 13:32	28.64	OK	4498	2026-09-23 13:33	29.02	OK
4499	2026-09-23 13:34	29.29	OK	4500	2026-09-23 13:35	29.43	OK
4501	2026-09-23 13:36	29.25	OK	4502	2026-09-23 13:37	28.62	OK
4503	2026-09-23 13:38	27.31	OK	4504	2026-09-23 13:39	28.38	OK
4505	2026-09-23 13:40	28.48	OK	4506	2026-09-23 13:41	29.66	OK
4507	2026-09-23 13:42	29.38	OK	4508	2026-09-23 13:43	29.24	OK
4509	2026-09-23 13:44	27.64	OK	4510	2026-09-23 13:45	28.51	OK
4511	2026-09-23 13:46	28.62	OK	4512	2026-09-23 13:47	28.42	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4513	2026-09-23 13:48	29.67	OK	4514	2026-09-23 13:49	28.94	OK
4515	2026-09-23 13:50	29.63	OK	4516	2026-09-23 13:51	28.99	OK
4517	2026-09-23 13:52	27.87	OK	4518	2026-09-23 13:53	28.84	OK
4519	2026-09-23 13:54	29.17	OK	4520	2026-09-23 13:55	28.50	OK
4521	2026-09-23 13:56	27.39	OK	4522	2026-09-23 13:57	27.35	OK
4523	2026-09-23 13:58	27.31	OK	4524	2026-09-23 13:59	28.93	OK
4525	2026-09-23 14:00	27.14	OK	4526	2026-09-23 14:01	27.81	OK
4527	2026-09-23 14:02	29.26	OK	4528	2026-09-23 14:03	28.30	OK
4529	2026-09-23 14:04	28.58	OK	4530	2026-09-23 14:05	28.07	OK
4531	2026-09-23 14:06	29.19	OK	4532	2026-09-23 14:07	26.99	OK
4533	2026-09-23 14:08	29.49	OK	4534	2026-09-23 14:09	27.87	OK
4535	2026-09-23 14:10	27.18	OK	4536	2026-09-23 14:11	29.67	OK
4537	2026-09-23 14:12	29.02	OK	4538	2026-09-23 14:13	28.68	OK
4539	2026-09-23 14:14	28.85	OK	4540	2026-09-23 14:15	29.10	OK
4541	2026-09-23 14:16	28.11	OK	4542	2026-09-23 14:17	28.52	OK
4543	2026-09-23 14:18	27.83	OK	4544	2026-09-23 14:19	28.94	OK
4545	2026-09-23 14:20	26.99	OK	4546	2026-09-23 14:21	28.14	OK
4547	2026-09-23 14:22	28.88	OK	4548	2026-09-23 14:23	27.87	OK
4549	2026-09-23 14:24	28.12	OK	4550	2026-09-23 14:25	28.21	OK
4551	2026-09-23 14:26	27.73	OK	4552	2026-09-23 14:27	28.22	OK
4553	2026-09-23 14:28	27.48	OK	4554	2026-09-23 14:29	28.81	OK
4555	2026-09-23 14:30	29.75	OK	4556	2026-09-23 14:31	27.82	OK
4557	2026-09-23 14:32	28.34	OK	4558	2026-09-23 14:33	28.13	OK
4559	2026-09-23 14:34	27.95	OK	4560	2026-09-23 14:35	29.34	OK
4561	2026-09-23 14:36	27.38	OK	4562	2026-09-23 14:37	27.46	OK
4563	2026-09-23 14:38	27.62	OK	4564	2026-09-23 14:39	28.43	OK
4565	2026-09-23 14:40	28.15	OK	4566	2026-09-23 14:41	27.99	OK
4567	2026-09-23 14:42	28.44	OK	4568	2026-09-23 14:43	27.86	OK
4569	2026-09-23 14:44	29.18	OK	4570	2026-09-23 14:45	27.81	OK
4571	2026-09-23 14:46	28.49	OK	4572	2026-09-23 14:47	26.83	OK
4573	2026-09-23 14:48	28.09	OK	4574	2026-09-23 14:49	28.26	OK
4575	2026-09-23 14:50	26.62	OK	4576	2026-09-23 14:51	29.25	OK
4577	2026-09-23 14:52	27.62	OK	4578	2026-09-23 14:53	26.93	OK
4579	2026-09-23 14:54	27.10	OK	4580	2026-09-23 14:55	27.01	OK
4581	2026-09-23 14:56	27.33	OK	4582	2026-09-23 14:57	28.82	OK
4583	2026-09-23 14:58	28.01	OK	4584	2026-09-23 14:59	28.38	OK
4585	2026-09-23 15:00	29.21	OK	4586	2026-09-23 15:01	29.50	OK
4587	2026-09-23 15:02	26.21	OK	4588	2026-09-23 15:03	27.02	OK
4589	2026-09-23 15:04	27.77	OK	4590	2026-09-23 15:05	28.11	OK
4591	2026-09-23 15:06	27.93	OK	4592	2026-09-23 15:07	27.97	OK
4593	2026-09-23 15:08	26.48	OK	4594	2026-09-23 15:09	27.37	OK
4595	2026-09-23 15:10	27.97	OK	4596	2026-09-23 15:11	27.77	OK
4597	2026-09-23 15:12	29.45	OK	4598	2026-09-23 15:13	27.29	OK
4599	2026-09-23 15:14	27.24	OK	4600	2026-09-23 15:15	27.45	OK
4601	2026-09-23 15:16	27.13	OK	4602	2026-09-23 15:17	28.40	OK
4603	2026-09-23 15:18	28.05	OK	4604	2026-09-23 15:19	27.15	OK
4605	2026-09-23 15:20	28.97	OK	4606	2026-09-23 15:21	27.24	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4607	2026-09-23 15:22	27.82	OK	4608	2026-09-23 15:23	27.95	OK
4609	2026-09-23 15:24	27.15	OK	4610	2026-09-23 15:25	28.37	OK
4611	2026-09-23 15:26	26.44	OK	4612	2026-09-23 15:27	27.56	OK
4613	2026-09-23 15:28	27.65	OK	4614	2026-09-23 15:29	26.67	OK
4615	2026-09-23 15:30	28.64	OK	4616	2026-09-23 15:31	28.37	OK
4617	2026-09-23 15:32	27.31	OK	4618	2026-09-23 15:33	26.19	OK
4619	2026-09-23 15:34	25.98	OK	4620	2026-09-23 15:35	27.74	OK
4621	2026-09-23 15:36	27.21	OK	4622	2026-09-23 15:37	28.53	OK
4623	2026-09-23 15:38	28.12	OK	4624	2026-09-23 15:39	27.50	OK
4625	2026-09-23 15:40	28.88	OK	4626	2026-09-23 15:41	25.43	OK
4627	2026-09-23 15:42	26.55	OK	4628	2026-09-23 15:43	27.91	OK
4629	2026-09-23 15:44	28.53	OK	4630	2026-09-23 15:45	27.44	OK
4631	2026-09-23 15:46	27.17	OK	4632	2026-09-23 15:47	27.38	OK
4633	2026-09-23 15:48	29.04	OK	4634	2026-09-23 15:49	26.26	OK
4635	2026-09-23 15:50	28.04	OK	4636	2026-09-23 15:51	25.97	OK
4637	2026-09-23 15:52	27.41	OK	4638	2026-09-23 15:53	26.18	OK
4639	2026-09-23 15:54	28.20	OK	4640	2026-09-23 15:55	27.83	OK
4641	2026-09-23 15:56	25.92	OK	4642	2026-09-23 15:57	28.76	OK
4643	2026-09-23 15:58	27.64	OK	4644	2026-09-23 15:59	26.67	OK
4645	2026-09-23 16:00	25.79	OK	4646	2026-09-23 16:01	27.59	OK
4647	2026-09-23 16:02	25.85	OK	4648	2026-09-23 16:03	27.53	OK
4649	2026-09-23 16:04	27.83	OK	4650	2026-09-23 16:05	27.80	OK
4651	2026-09-23 16:06	27.77	OK	4652	2026-09-23 16:07	26.30	OK
4653	2026-09-23 16:08	25.46	OK	4654	2026-09-23 16:09	28.44	OK
4655	2026-09-23 16:10	28.12	OK	4656	2026-09-23 16:11	25.51	OK
4657	2026-09-23 16:12	27.73	OK	4658	2026-09-23 16:13	26.99	OK
4659	2026-09-23 16:14	27.51	OK	4660	2026-09-23 16:15	27.38	OK
4661	2026-09-23 16:16	27.20	OK	4662	2026-09-23 16:17	27.80	OK
4663	2026-09-23 16:18	26.57	OK	4664	2026-09-23 16:19	26.76	OK
4665	2026-09-23 16:20	28.40	OK	4666	2026-09-23 16:21	26.09	OK
4667	2026-09-23 16:22	27.21	OK	4668	2026-09-23 16:23	26.98	OK
4669	2026-09-23 16:24	27.45	OK	4670	2026-09-23 16:25	28.77	OK
4671	2026-09-23 16:26	27.06	OK	4672	2026-09-23 16:27	27.03	OK
4673	2026-09-23 16:28	25.92	OK	4674	2026-09-23 16:29	27.31	OK
4675	2026-09-23 16:30	26.34	OK	4676	2026-09-23 16:31	26.78	OK
4677	2026-09-23 16:32	27.87	OK	4678	2026-09-23 16:33	25.51	OK
4679	2026-09-23 16:34	28.02	OK	4680	2026-09-23 16:35	27.34	OK
4681	2026-09-23 16:36	26.90	OK	4682	2026-09-23 16:37	27.72	OK
4683	2026-09-23 16:38	27.00	OK	4684	2026-09-23 16:39	27.53	OK
4685	2026-09-23 16:40	25.94	OK	4686	2026-09-23 16:41	25.93	OK
4687	2026-09-23 16:42	26.84	OK	4688	2026-09-23 16:43	27.04	OK
4689	2026-09-23 16:44	26.87	OK	4690	2026-09-23 16:45	28.18	OK
4691	2026-09-23 16:46	27.30	OK	4692	2026-09-23 16:47	26.92	OK
4693	2026-09-23 16:48	27.98	OK	4694	2026-09-23 16:49	27.77	OK
4695	2026-09-23 16:50	26.93	OK	4696	2026-09-23 16:51	26.75	OK
4697	2026-09-23 16:52	26.59	OK	4698	2026-09-23 16:53	27.69	OK
4699	2026-09-23 16:54	28.32	OK	4700	2026-09-23 16:55	27.65	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4701	2026-09-23 16:56	28.04	OK	4702	2026-09-23 16:57	26.82	OK
4703	2026-09-23 16:58	28.05	OK	4704	2026-09-23 16:59	28.27	OK
4705	2026-09-23 17:00	27.92	OK	4706	2026-09-23 17:01	27.97	OK
4707	2026-09-23 17:02	25.95	OK	4708	2026-09-23 17:03	26.00	OK
4709	2026-09-23 17:04	26.37	OK	4710	2026-09-23 17:05	26.23	OK
4711	2026-09-23 17:06	26.44	OK	4712	2026-09-23 17:07	25.85	OK
4713	2026-09-23 17:08	27.61	OK	4714	2026-09-23 17:09	27.43	OK
4715	2026-09-23 17:10	26.65	OK	4716	2026-09-23 17:11	27.97	OK
4717	2026-09-23 17:12	27.70	OK	4718	2026-09-23 17:13	27.30	OK
4719	2026-09-23 17:14	27.14	OK	4720	2026-09-23 17:15	27.05	OK
4721	2026-09-23 17:16	26.42	OK	4722	2026-09-23 17:17	28.16	OK
4723	2026-09-23 17:18	25.47	OK	4724	2026-09-23 17:19	27.21	OK
4725	2026-09-23 17:20	27.08	OK	4726	2026-09-23 17:21	26.00	OK
4727	2026-09-23 17:22	28.14	OK	4728	2026-09-23 17:23	27.98	OK
4729	2026-09-23 17:24	28.07	OK	4730	2026-09-23 17:25	25.93	OK
4731	2026-09-23 17:26	27.23	OK	4732	2026-09-23 17:27	26.16	OK
4733	2026-09-23 17:28	28.76	OK	4734	2026-09-23 17:29	26.61	OK
4735	2026-09-23 17:30	26.67	OK	4736	2026-09-23 17:31	26.94	OK
4737	2026-09-23 17:32	26.90	OK	4738	2026-09-23 17:33	25.66	OK
4739	2026-09-23 17:34	27.94	OK	4740	2026-09-23 17:35	26.74	OK
4741	2026-09-23 17:36	27.76	OK	4742	2026-09-23 17:37	26.35	OK
4743	2026-09-23 17:38	26.46	OK	4744	2026-09-23 17:39	26.06	OK
4745	2026-09-23 17:40	27.07	OK	4746	2026-09-23 17:41	27.50	OK
4747	2026-09-23 17:42	26.09	OK	4748	2026-09-23 17:43	26.22	OK
4749	2026-09-23 17:44	26.74	OK	4750	2026-09-23 17:45	26.95	OK
4751	2026-09-23 17:46	27.84	OK	4752	2026-09-23 17:47	27.43	OK
4753	2026-09-23 17:48	26.96	OK	4754	2026-09-23 17:49	26.42	OK
4755	2026-09-23 17:50	27.86	OK	4756	2026-09-23 17:51	26.71	OK
4757	2026-09-23 17:52	26.94	OK	4758	2026-09-23 17:53	25.47	OK
4759	2026-09-23 17:54	25.52	OK	4760	2026-09-23 17:55	27.56	OK
4761	2026-09-23 17:56	27.23	OK	4762	2026-09-23 17:57	26.44	OK
4763	2026-09-23 17:58	27.17	OK	4764	2026-09-23 17:59	26.46	OK
4765	2026-09-23 18:00	26.97	OK	4766	2026-09-23 18:01	26.47	OK
4767	2026-09-23 18:02	27.49	OK	4768	2026-09-23 18:03	26.81	OK
4769	2026-09-23 18:04	27.56	OK	4770	2026-09-23 18:05	28.41	OK
4771	2026-09-23 18:06	27.04	OK	4772	2026-09-23 18:07	27.44	OK
4773	2026-09-23 18:08	26.76	OK	4774	2026-09-23 18:09	25.67	OK
4775	2026-09-23 18:10	26.50	OK	4776	2026-09-23 18:11	25.78	OK
4777	2026-09-23 18:12	26.40	OK	4778	2026-09-23 18:13	27.83	OK
4779	2026-09-23 18:14	27.26	OK	4780	2026-09-23 18:15	26.22	OK
4781	2026-09-23 18:16	26.78	OK	4782	2026-09-23 18:17	26.35	OK
4783	2026-09-23 18:18	25.97	OK	4784	2026-09-23 18:19	27.00	OK
4785	2026-09-23 18:20	26.03	OK	4786	2026-09-23 18:21	27.27	OK
4787	2026-09-23 18:22	27.79	OK	4788	2026-09-23 18:23	25.67	OK
4789	2026-09-23 18:24	25.99	OK	4790	2026-09-23 18:25	27.68	OK
4791	2026-09-23 18:26	27.00	OK	4792	2026-09-23 18:27	26.57	OK
4793	2026-09-23 18:28	26.73	OK	4794	2026-09-23 18:29	26.80	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4795	2026-09-23 18:30	26.62	OK	4796	2026-09-23 18:31	27.14	OK
4797	2026-09-23 18:32	25.62	OK	4798	2026-09-23 18:33	26.53	OK
4799	2026-09-23 18:34	28.31	OK	4800	2026-09-23 18:35	26.65	OK
4801	2026-09-23 18:36	26.93	OK	4802	2026-09-23 18:37	27.28	OK
4803	2026-09-23 18:38	27.37	OK	4804	2026-09-23 18:39	26.90	OK
4805	2026-09-23 18:40	25.07	OK	4806	2026-09-23 18:41	26.60	OK
4807	2026-09-23 18:42	25.76	OK	4808	2026-09-23 18:43	26.89	OK
4809	2026-09-23 18:44	27.63	OK	4810	2026-09-23 18:45	26.42	OK
4811	2026-09-23 18:46	25.86	OK	4812	2026-09-23 18:47	27.35	OK
4813	2026-09-23 18:48	27.26	OK	4814	2026-09-23 18:49	27.09	OK
4815	2026-09-23 18:50	25.78	OK	4816	2026-09-23 18:51	25.84	OK
4817	2026-09-23 18:52	27.53	OK	4818	2026-09-23 18:53	25.38	OK
4819	2026-09-23 18:54	26.25	OK	4820	2026-09-23 18:55	27.12	OK
4821	2026-09-23 18:56	27.93	OK	4822	2026-09-23 18:57	27.54	OK
4823	2026-09-23 18:58	26.01	OK	4824	2026-09-23 18:59	26.67	OK
4825	2026-09-23 19:00	26.76	OK	4826	2026-09-23 19:01	26.81	OK
4827	2026-09-23 19:02	25.84	OK	4828	2026-09-23 19:03	26.87	OK
4829	2026-09-23 19:04	27.78	OK	4830	2026-09-23 19:05	27.75	OK
4831	2026-09-23 19:06	26.17	OK	4832	2026-09-23 19:07	26.53	OK
4833	2026-09-23 19:08	27.84	OK	4834	2026-09-23 19:09	24.68	OK
4835	2026-09-23 19:10	28.26	OK	4836	2026-09-23 19:11	27.07	OK
4837	2026-09-23 19:12	27.27	OK	4838	2026-09-23 19:13	26.91	OK
4839	2026-09-23 19:14	26.91	OK	4840	2026-09-23 19:15	26.70	OK
4841	2026-09-23 19:16	26.13	OK	4842	2026-09-23 19:17	27.01	OK
4843	2026-09-23 19:18	25.47	OK	4844	2026-09-23 19:19	27.72	OK
4845	2026-09-23 19:20	26.73	OK	4846	2026-09-23 19:21	26.31	OK
4847	2026-09-23 19:22	25.76	OK	4848	2026-09-23 19:23	25.26	OK
4849	2026-09-23 19:24	28.08	OK	4850	2026-09-23 19:25	26.51	OK
4851	2026-09-23 19:26	27.35	OK	4852	2026-09-23 19:27	27.30	OK
4853	2026-09-23 19:28	27.46	OK	4854	2026-09-23 19:29	27.26	OK
4855	2026-09-23 19:30	25.90	OK	4856	2026-09-23 19:31	27.75	OK
4857	2026-09-23 19:32	26.66	OK	4858	2026-09-23 19:33	28.00	OK
4859	2026-09-23 19:34	27.54	OK	4860	2026-09-23 19:35	26.90	OK
4861	2026-09-23 19:36	28.22	OK	4862	2026-09-23 19:37	26.79	OK
4863	2026-09-23 19:38	27.88	OK	4864	2026-09-23 19:39	25.72	OK
4865	2026-09-23 19:40	28.29	OK	4866	2026-09-23 19:41	26.67	OK
4867	2026-09-23 19:42	27.19	OK	4868	2026-09-23 19:43	25.59	OK
4869	2026-09-23 19:44	25.90	OK	4870	2026-09-23 19:45	28.31	OK
4871	2026-09-23 19:46	27.46	OK	4872	2026-09-23 19:47	26.13	OK
4873	2026-09-23 19:48	26.86	OK	4874	2026-09-23 19:49	25.93	OK
4875	2026-09-23 19:50	28.08	OK	4876	2026-09-23 19:51	28.13	OK
4877	2026-09-23 19:52	27.85	OK	4878	2026-09-23 19:53	26.81	OK
4879	2026-09-23 19:54	27.43	OK	4880	2026-09-23 19:55	26.65	OK
4881	2026-09-23 19:56	27.28	OK	4882	2026-09-23 19:57	28.69	OK
4883	2026-09-23 19:58	27.21	OK	4884	2026-09-23 19:59	26.74	OK
4885	2026-09-23 20:00	27.02	OK	4886	2026-09-23 20:01	26.77	OK
4887	2026-09-23 20:02	27.10	OK	4888	2026-09-23 20:03	27.43	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4889	2026-09-23 20:04	26.79	OK	4890	2026-09-23 20:05	28.61	OK
4891	2026-09-23 20:06	27.74	OK	4892	2026-09-23 20:07	25.59	OK
4893	2026-09-23 20:08	28.16	OK	4894	2026-09-23 20:09	27.31	OK
4895	2026-09-23 20:10	25.98	OK	4896	2026-09-23 20:11	25.87	OK
4897	2026-09-23 20:12	25.44	OK	4898	2026-09-23 20:13	26.75	OK
4899	2026-09-23 20:14	27.99	OK	4900	2026-09-23 20:15	28.11	OK
4901	2026-09-23 20:16	27.51	OK	4902	2026-09-23 20:17	27.89	OK
4903	2026-09-23 20:18	26.66	OK	4904	2026-09-23 20:19	25.58	OK
4905	2026-09-23 20:20	26.10	OK	4906	2026-09-23 20:21	27.78	OK
4907	2026-09-23 20:22	27.56	OK	4908	2026-09-23 20:23	26.97	OK
4909	2026-09-23 20:24	26.33	OK	4910	2026-09-23 20:25	28.79	OK
4911	2026-09-23 20:26	27.91	OK	4912	2026-09-23 20:27	27.56	OK
4913	2026-09-23 20:28	27.52	OK	4914	2026-09-23 20:29	26.73	OK
4915	2026-09-23 20:30	26.89	OK	4916	2026-09-23 20:31	27.03	OK
4917	2026-09-23 20:32	27.39	OK	4918	2026-09-23 20:33	27.47	OK
4919	2026-09-23 20:34	25.86	OK	4920	2026-09-23 20:35	26.87	OK
4921	2026-09-23 20:36	28.67	OK	4922	2026-09-23 20:37	26.66	OK
4923	2026-09-23 20:38	26.73	OK	4924	2026-09-23 20:39	27.42	OK
4925	2026-09-23 20:40	27.34	OK	4926	2026-09-23 20:41	25.99	OK
4927	2026-09-23 20:42	27.83	OK	4928	2026-09-23 20:43	26.60	OK
4929	2026-09-23 20:44	27.38	OK	4930	2026-09-23 20:45	26.91	OK
4931	2026-09-23 20:46	25.70	OK	4932	2026-09-23 20:47	27.40	OK
4933	2026-09-23 20:48	27.17	OK	4934	2026-09-23 20:49	28.29	OK
4935	2026-09-23 20:50	27.57	OK	4936	2026-09-23 20:51	27.83	OK
4937	2026-09-23 20:52	28.37	OK	4938	2026-09-23 20:53	28.78	OK
4939	2026-09-23 20:54	26.75	OK	4940	2026-09-23 20:55	26.76	OK
4941	2026-09-23 20:56	26.50	OK	4942	2026-09-23 20:57	26.41	OK
4943	2026-09-23 20:58	27.62	OK	4944	2026-09-23 20:59	25.13	OK
4945	2026-09-23 21:00	27.30	OK	4946	2026-09-23 21:01	26.46	OK
4947	2026-09-23 21:02	26.57	OK	4948	2026-09-23 21:03	27.90	OK
4949	2026-09-23 21:04	27.14	OK	4950	2026-09-23 21:05	27.00	OK
4951	2026-09-23 21:06	28.60	OK	4952	2026-09-23 21:07	26.89	OK
4953	2026-09-23 21:08	27.20	OK	4954	2026-09-23 21:09	27.03	OK
4955	2026-09-23 21:10	27.60	OK	4956	2026-09-23 21:11	27.38	OK
4957	2026-09-23 21:12	28.44	OK	4958	2026-09-23 21:13	28.30	OK
4959	2026-09-23 21:14	26.72	OK	4960	2026-09-23 21:15	26.46	OK
4961	2026-09-23 21:16	28.21	OK	4962	2026-09-23 21:17	27.79	OK
4963	2026-09-23 21:18	27.64	OK	4964	2026-09-23 21:19	27.58	OK
4965	2026-09-23 21:20	26.80	OK	4966	2026-09-23 21:21	26.75	OK
4967	2026-09-23 21:22	27.32	OK	4968	2026-09-23 21:23	29.10	OK
4969	2026-09-23 21:24	26.75	OK	4970	2026-09-23 21:25	27.32	OK
4971	2026-09-23 21:26	28.81	OK	4972	2026-09-23 21:27	27.85	OK
4973	2026-09-23 21:28	26.69	OK	4974	2026-09-23 21:29	27.20	OK
4975	2026-09-23 21:30	26.93	OK	4976	2026-09-23 21:31	28.48	OK
4977	2026-09-23 21:32	26.87	OK	4978	2026-09-23 21:33	29.52	OK
4979	2026-09-23 21:34	27.73	OK	4980	2026-09-23 21:35	29.09	OK
4981	2026-09-23 21:36	26.75	OK	4982	2026-09-23 21:37	26.26	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
4983	2026-09-23 21:38	28.46	OK	4984	2026-09-23 21:39	27.61	OK
4985	2026-09-23 21:40	26.56	OK	4986	2026-09-23 21:41	27.76	OK
4987	2026-09-23 21:42	27.63	OK	4988	2026-09-23 21:43	28.36	OK
4989	2026-09-23 21:44	27.96	OK	4990	2026-09-23 21:45	28.26	OK
4991	2026-09-23 21:46	27.28	OK	4992	2026-09-23 21:47	27.76	OK
4993	2026-09-23 21:48	27.53	OK	4994	2026-09-23 21:49	29.41	OK
4995	2026-09-23 21:50	26.60	OK	4996	2026-09-23 21:51	27.91	OK
4997	2026-09-23 21:52	26.75	OK	4998	2026-09-23 21:53	27.00	OK
4999	2026-09-23 21:54	27.41	OK	5000	2026-09-23 21:55	27.59	OK
5001	2026-09-23 21:56	27.49	OK	5002	2026-09-23 21:57	27.33	OK
5003	2026-09-23 21:58	28.76	OK	5004	2026-09-23 21:59	27.97	OK
5005	2026-09-23 22:00	28.32	OK	5006	2026-09-23 22:01	27.76	OK
5007	2026-09-23 22:02	27.60	OK	5008	2026-09-23 22:03	27.70	OK
5009	2026-09-23 22:04	26.08	OK	5010	2026-09-23 22:05	28.74	OK
5011	2026-09-23 22:06	28.93	OK	5012	2026-09-23 22:07	28.23	OK
5013	2026-09-23 22:08	27.27	OK	5014	2026-09-23 22:09	29.62	OK
5015	2026-09-23 22:10	28.37	OK	5016	2026-09-23 22:11	27.28	OK
5017	2026-09-23 22:12	27.61	OK	5018	2026-09-23 22:13	28.92	OK
5019	2026-09-23 22:14	27.15	OK	5020	2026-09-23 22:15	27.85	OK
5021	2026-09-23 22:16	27.90	OK	5022	2026-09-23 22:17	28.06	OK
5023	2026-09-23 22:18	29.45	OK	5024	2026-09-23 22:19	27.36	OK
5025	2026-09-23 22:20	28.40	OK	5026	2026-09-23 22:21	26.82	OK
5027	2026-09-23 22:22	28.00	OK	5028	2026-09-23 22:23	28.38	OK
5029	2026-09-23 22:24	29.04	OK	5030	2026-09-23 22:25	27.79	OK
5031	2026-09-23 22:26	29.11	OK	5032	2026-09-23 22:27	28.23	OK
5033	2026-09-23 22:28	28.43	OK	5034	2026-09-23 22:29	28.03	OK
5035	2026-09-23 22:30	28.51	OK	5036	2026-09-23 22:31	28.79	OK
5037	2026-09-23 22:32	27.62	OK	5038	2026-09-23 22:33	27.24	OK
5039	2026-09-23 22:34	27.81	OK	5040	2026-09-23 22:35	28.48	OK
5041	2026-09-23 22:36	28.67	OK	5042	2026-09-23 22:37	28.71	OK
5043	2026-09-23 22:38	28.41	OK	5044	2026-09-23 22:39	29.17	OK
5045	2026-09-23 22:40	27.79	OK	5046	2026-09-23 22:41	27.09	OK
5047	2026-09-23 22:42	28.42	OK	5048	2026-09-23 22:43	28.01	OK
5049	2026-09-23 22:44	30.41	OK	5050	2026-09-23 22:45	27.54	OK
5051	2026-09-23 22:46	28.08	OK	5052	2026-09-23 22:47	29.51	OK
5053	2026-09-23 22:48	28.31	OK	5054	2026-09-23 22:49	29.43	OK
5055	2026-09-23 22:50	28.65	OK	5056	2026-09-23 22:51	28.10	OK
5057	2026-09-23 22:52	28.50	OK	5058	2026-09-23 22:53	28.34	OK
5059	2026-09-23 22:54	27.18	OK	5060	2026-09-23 22:55	27.57	OK
5061	2026-09-23 22:56	29.04	OK	5062	2026-09-23 22:57	29.11	OK
5063	2026-09-23 22:58	29.01	OK	5064	2026-09-23 22:59	28.57	OK
5065	2026-09-23 23:00	28.61	OK	5066	2026-09-23 23:01	28.80	OK
5067	2026-09-23 23:02	28.51	OK	5068	2026-09-23 23:03	26.32	OK
5069	2026-09-23 23:04	28.31	OK	5070	2026-09-23 23:05	28.44	OK
5071	2026-09-23 23:06	28.38	OK	5072	2026-09-23 23:07	28.10	OK
5073	2026-09-23 23:08	29.51	OK	5074	2026-09-23 23:09	27.36	OK
5075	2026-09-23 23:10	27.60	OK	5076	2026-09-23 23:11	28.76	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5077	2026-09-23 23:12	28.78	OK	5078	2026-09-23 23:13	28.47	OK
5079	2026-09-23 23:14	28.56	OK	5080	2026-09-23 23:15	28.82	OK
5081	2026-09-23 23:16	28.13	OK	5082	2026-09-23 23:17	29.26	OK
5083	2026-09-23 23:18	28.93	OK	5084	2026-09-23 23:19	28.68	OK
5085	2026-09-23 23:20	28.79	OK	5086	2026-09-23 23:21	28.69	OK
5087	2026-09-23 23:22	29.03	OK	5088	2026-09-23 23:23	28.86	OK
5089	2026-09-23 23:24	27.29	OK	5090	2026-09-23 23:25	27.82	OK
5091	2026-09-23 23:26	28.76	OK	5092	2026-09-23 23:27	28.13	OK
5093	2026-09-23 23:28	30.00	OK	5094	2026-09-23 23:29	29.49	OK
5095	2026-09-23 23:30	29.56	OK	5096	2026-09-23 23:31	27.49	OK
5097	2026-09-23 23:32	29.06	OK	5098	2026-09-23 23:33	28.98	OK
5099	2026-09-23 23:34	26.82	OK	5100	2026-09-23 23:35	26.89	OK
5101	2026-09-23 23:36	27.80	OK	5102	2026-09-23 23:37	27.56	OK
5103	2026-09-23 23:38	28.65	OK	5104	2026-09-23 23:39	29.04	OK
5105	2026-09-23 23:40	28.90	OK	5106	2026-09-23 23:41	28.21	OK
5107	2026-09-23 23:42	28.45	OK	5108	2026-09-23 23:43	29.58	OK
5109	2026-09-23 23:44	27.95	OK	5110	2026-09-23 23:45	28.86	OK
5111	2026-09-23 23:46	29.71	OK	5112	2026-09-23 23:47	29.46	OK
5113	2026-09-23 23:48	27.47	OK	5114	2026-09-23 23:49	29.49	OK
5115	2026-09-23 23:50	28.07	OK	5116	2026-09-23 23:51	29.11	OK
5117	2026-09-23 23:52	28.64	OK	5118	2026-09-23 23:53	30.37	OK
5119	2026-09-23 23:54	28.36	OK	5120	2026-09-23 23:55	28.12	OK
5121	2026-09-23 23:56	27.55	OK	5122	2026-09-23 23:57	29.16	OK
5123	2026-09-23 23:58	27.71	OK	5124	2026-09-23 23:59	28.14	OK
5125	2026-09-24 00:00	29.07	OK	5126	2026-09-24 00:01	29.07	OK
5127	2026-09-24 00:02	29.57	OK	5128	2026-09-24 00:03	29.85	OK
5129	2026-09-24 00:04	27.37	OK	5130	2026-09-24 00:05	28.29	OK
5131	2026-09-24 00:06	28.68	OK	5132	2026-09-24 00:07	29.56	OK
5133	2026-09-24 00:08	29.57	OK	5134	2026-09-24 00:09	29.52	OK
5135	2026-09-24 00:10	30.08	OK	5136	2026-09-24 00:11	29.64	OK
5137	2026-09-24 00:12	29.22	OK	5138	2026-09-24 00:13	28.29	OK
5139	2026-09-24 00:14	28.76	OK	5140	2026-09-24 00:15	28.10	OK
5141	2026-09-24 00:16	27.69	OK	5142	2026-09-24 00:17	28.13	OK
5143	2026-09-24 00:18	27.05	OK	5144	2026-09-24 00:19	29.89	OK
5145	2026-09-24 00:20	29.34	OK	5146	2026-09-24 00:21	28.32	OK
5147	2026-09-24 00:22	29.97	OK	5148	2026-09-24 00:23	28.90	OK
5149	2026-09-24 00:24	28.59	OK	5150	2026-09-24 00:25	28.44	OK
5151	2026-09-24 00:26	28.11	OK	5152	2026-09-24 00:27	29.09	OK
5153	2026-09-24 00:28	28.82	OK	5154	2026-09-24 00:29	28.58	OK
5155	2026-09-24 00:30	29.70	OK	5156	2026-09-24 00:31	31.38	OK
5157	2026-09-24 00:32	28.22	OK	5158	2026-09-24 00:33	29.87	OK
5159	2026-09-24 00:34	29.04	OK	5160	2026-09-24 00:35	29.03	OK
5161	2026-09-24 00:36	28.86	OK	5162	2026-09-24 00:37	29.48	OK
5163	2026-09-24 00:38	29.37	OK	5164	2026-09-24 00:39	28.89	OK
5165	2026-09-24 00:40	28.43	OK	5166	2026-09-24 00:41	29.66	OK
5167	2026-09-24 00:42	29.73	OK	5168	2026-09-24 00:43	29.42	OK
5169	2026-09-24 00:44	30.54	OK	5170	2026-09-24 00:45	30.14	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5171	2026-09-24 00:46	28.11	OK	5172	2026-09-24 00:47	29.68	OK
5173	2026-09-24 00:48	28.40	OK	5174	2026-09-24 00:49	29.12	OK
5175	2026-09-24 00:50	28.86	OK	5176	2026-09-24 00:51	30.13	OK
5177	2026-09-24 00:52	29.73	OK	5178	2026-09-24 00:53	29.82	OK
5179	2026-09-24 00:54	29.35	OK	5180	2026-09-24 00:55	29.08	OK
5181	2026-09-24 00:56	30.28	OK	5182	2026-09-24 00:57	29.84	OK
5183	2026-09-24 00:58	30.57	OK	5184	2026-09-24 00:59	29.36	OK
5185	2026-09-24 01:00	30.35	OK	5186	2026-09-24 01:01	28.47	OK
5187	2026-09-24 01:02	28.02	OK	5188	2026-09-24 01:03	30.56	OK
5189	2026-09-24 01:04	29.31	OK	5190	2026-09-24 01:05	30.14	OK
5191	2026-09-24 01:06	29.64	OK	5192	2026-09-24 01:07	30.09	OK
5193	2026-09-24 01:08	29.06	OK	5194	2026-09-24 01:09	28.30	OK
5195	2026-09-24 01:10	30.11	OK	5196	2026-09-24 01:11	29.97	OK
5197	2026-09-24 01:12	30.36	OK	5198	2026-09-24 01:13	30.26	OK
5199	2026-09-24 01:14	28.94	OK	5200	2026-09-24 01:15	29.51	OK
5201	2026-09-24 01:16	29.51	OK	5202	2026-09-24 01:17	29.84	OK
5203	2026-09-24 01:18	31.04	OK	5204	2026-09-24 01:19	29.85	OK
5205	2026-09-24 01:20	29.47	OK	5206	2026-09-24 01:21	29.85	OK
5207	2026-09-24 01:22	28.73	OK	5208	2026-09-24 01:23	29.48	OK
5209	2026-09-24 01:24	29.39	OK	5210	2026-09-24 01:25	30.34	OK
5211	2026-09-24 01:26	29.24	OK	5212	2026-09-24 01:27	30.50	OK
5213	2026-09-24 01:28	29.86	OK	5214	2026-09-24 01:29	30.43	OK
5215	2026-09-24 01:30	29.69	OK	5216	2026-09-24 01:31	30.59	OK
5217	2026-09-24 01:32	30.82	OK	5218	2026-09-24 01:33	30.31	OK
5219	2026-09-24 01:34	29.15	OK	5220	2026-09-24 01:35	30.05	OK
5221	2026-09-24 01:36	29.48	OK	5222	2026-09-24 01:37	29.49	OK
5223	2026-09-24 01:38	28.38	OK	5224	2026-09-24 01:39	29.86	OK
5225	2026-09-24 01:40	30.10	OK	5226	2026-09-24 01:41	30.38	OK
5227	2026-09-24 01:42	30.78	OK	5228	2026-09-24 01:43	29.50	OK
5229	2026-09-24 01:44	30.05	OK	5230	2026-09-24 01:45	29.78	OK
5231	2026-09-24 01:46	30.66	OK	5232	2026-09-24 01:47	31.11	OK
5233	2026-09-24 01:48	30.83	OK	5234	2026-09-24 01:49	29.48	OK
5235	2026-09-24 01:50	30.10	OK	5236	2026-09-24 01:51	28.59	OK
5237	2026-09-24 01:52	31.07	OK	5238	2026-09-24 01:53	30.57	OK
5239	2026-09-24 01:54	30.54	OK	5240	2026-09-24 01:55	30.35	OK
5241	2026-09-24 01:56	31.60	OK	5242	2026-09-24 01:57	31.50	OK
5243	2026-09-24 01:58	31.17	OK	5244	2026-09-24 01:59	29.35	OK
5245	2026-09-24 02:00	29.60	OK	5246	2026-09-24 02:01	30.90	OK
5247	2026-09-24 02:02	31.32	OK	5248	2026-09-24 02:03	30.64	OK
5249	2026-09-24 02:04	29.39	OK	5250	2026-09-24 02:05	30.31	OK
5251	2026-09-24 02:06	30.72	OK	5252	2026-09-24 02:07	29.76	OK
5253	2026-09-24 02:08	30.24	OK	5254	2026-09-24 02:09	30.08	OK
5255	2026-09-24 02:10	30.79	OK	5256	2026-09-24 02:11	31.31	OK
5257	2026-09-24 02:12	31.01	OK	5258	2026-09-24 02:13	31.04	OK
5259	2026-09-24 02:14	29.95	OK	5260	2026-09-24 02:15	29.91	OK
5261	2026-09-24 02:16	30.74	OK	5262	2026-09-24 02:17	30.70	OK
5263	2026-09-24 02:18	29.69	OK	5264	2026-09-24 02:19	30.33	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5265	2026-09-24 02:20	30.35	OK	5266	2026-09-24 02:21	28.99	OK
5267	2026-09-24 02:22	31.55	OK	5268	2026-09-24 02:23	30.71	OK
5269	2026-09-24 02:24	31.58	OK	5270	2026-09-24 02:25	30.41	OK
5271	2026-09-24 02:26	30.73	OK	5272	2026-09-24 02:27	29.95	OK
5273	2026-09-24 02:28	32.26	OK	5274	2026-09-24 02:29	31.50	OK
5275	2026-09-24 02:30	30.51	OK	5276	2026-09-24 02:31	31.73	OK
5277	2026-09-24 02:32	30.46	OK	5278	2026-09-24 02:33	29.05	OK
5279	2026-09-24 02:34	30.05	OK	5280	2026-09-24 02:35	30.36	OK
5281	2026-09-24 02:36	30.75	OK	5282	2026-09-24 02:37	30.58	OK
5283	2026-09-24 02:38	29.48	OK	5284	2026-09-24 02:39	30.31	OK
5285	2026-09-24 02:40	31.02	OK	5286	2026-09-24 02:41	31.32	OK
5287	2026-09-24 02:42	32.06	OK	5288	2026-09-24 02:43	31.18	OK
5289	2026-09-24 02:44	30.61	OK	5290	2026-09-24 02:45	30.42	OK
5291	2026-09-24 02:46	29.43	OK	5292	2026-09-24 02:47	30.72	OK
5293	2026-09-24 02:48	30.54	OK	5294	2026-09-24 02:49	30.27	OK
5295	2026-09-24 02:50	29.89	OK	5296	2026-09-24 02:51	31.44	OK
5297	2026-09-24 02:52	31.69	OK	5298	2026-09-24 02:53	31.18	OK
5299	2026-09-24 02:54	30.39	OK	5300	2026-09-24 02:55	31.61	OK
5301	2026-09-24 02:56	31.09	OK	5302	2026-09-24 02:57	30.18	OK
5303	2026-09-24 02:58	30.87	OK	5304	2026-09-24 02:59	30.39	OK
5305	2026-09-24 03:00	32.16	OK	5306	2026-09-24 03:01	30.64	OK
5307	2026-09-24 03:02	31.52	OK	5308	2026-09-24 03:03	30.54	OK
5309	2026-09-24 03:04	31.15	OK	5310	2026-09-24 03:05	31.56	OK
5311	2026-09-24 03:06	31.68	OK	5312	2026-09-24 03:07	29.99	OK
5313	2026-09-24 03:08	30.79	OK	5314	2026-09-24 03:09	29.83	OK
5315	2026-09-24 03:10	31.41	OK	5316	2026-09-24 03:11	31.61	OK
5317	2026-09-24 03:12	31.03	OK	5318	2026-09-24 03:13	30.86	OK
5319	2026-09-24 03:14	30.55	OK	5320	2026-09-24 03:15	31.76	OK
5321	2026-09-24 03:16	30.00	OK	5322	2026-09-24 03:17	29.68	OK
5323	2026-09-24 03:18	31.08	OK	5324	2026-09-24 03:19	30.92	OK
5325	2026-09-24 03:20	29.87	OK	5326	2026-09-24 03:21	30.78	OK
5327	2026-09-24 03:22	31.53	OK	5328	2026-09-24 03:23	30.70	OK
5329	2026-09-24 03:24	32.19	OK	5330	2026-09-24 03:25	31.75	OK
5331	2026-09-24 03:26	31.37	OK	5332	2026-09-24 03:27	29.37	OK
5333	2026-09-24 03:28	32.15	OK	5334	2026-09-24 03:29	29.41	OK
5335	2026-09-24 03:30	30.76	OK	5336	2026-09-24 03:31	31.50	OK
5337	2026-09-24 03:32	33.19	OK	5338	2026-09-24 03:33	32.45	OK
5339	2026-09-24 03:34	29.44	OK	5340	2026-09-24 03:35	30.47	OK
5341	2026-09-24 03:36	30.55	OK	5342	2026-09-24 03:37	30.55	OK
5343	2026-09-24 03:38	31.05	OK	5344	2026-09-24 03:39	30.96	OK
5345	2026-09-24 03:40	30.53	OK	5346	2026-09-24 03:41	31.22	OK
5347	2026-09-24 03:42	32.04	OK	5348	2026-09-24 03:43	31.13	OK
5349	2026-09-24 03:44	32.11	OK	5350	2026-09-24 03:45	30.15	OK
5351	2026-09-24 03:46	29.75	OK	5352	2026-09-24 03:47	31.31	OK
5353	2026-09-24 03:48	31.24	OK	5354	2026-09-24 03:49	30.91	OK
5355	2026-09-24 03:50	31.01	OK	5356	2026-09-24 03:51	32.23	OK
5357	2026-09-24 03:52	31.46	OK	5358	2026-09-24 03:53	31.83	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5359	2026-09-24 03:54	31.08	OK	5360	2026-09-24 03:55	30.94	OK
5361	2026-09-24 03:56	30.94	OK	5362	2026-09-24 03:57	29.78	OK
5363	2026-09-24 03:58	30.82	OK	5364	2026-09-24 03:59	31.12	OK
5365	2026-09-24 04:00	31.00	OK	5366	2026-09-24 04:01	29.85	OK
5367	2026-09-24 04:02	31.26	OK	5368	2026-09-24 04:03	31.78	OK
5369	2026-09-24 04:04	30.76	OK	5370	2026-09-24 04:05	30.17	OK
5371	2026-09-24 04:06	30.79	OK	5372	2026-09-24 04:07	32.63	OK
5373	2026-09-24 04:08	30.77	OK	5374	2026-09-24 04:09	30.70	OK
5375	2026-09-24 04:10	29.76	OK	5376	2026-09-24 04:11	32.39	OK
5377	2026-09-24 04:12	30.43	OK	5378	2026-09-24 04:13	32.84	OK
5379	2026-09-24 04:14	31.00	OK	5380	2026-09-24 04:15	32.49	OK
5381	2026-09-24 04:16	31.06	OK	5382	2026-09-24 04:17	32.31	OK
5383	2026-09-24 04:18	32.12	OK	5384	2026-09-24 04:19	30.38	OK
5385	2026-09-24 04:20	31.05	OK	5386	2026-09-24 04:21	32.10	OK
5387	2026-09-24 04:22	32.16	OK	5388	2026-09-24 04:23	29.96	OK
5389	2026-09-24 04:24	31.51	OK	5390	2026-09-24 04:25	30.06	OK
5391	2026-09-24 04:26	31.93	OK	5392	2026-09-24 04:27	30.81	OK
5393	2026-09-24 04:28	32.27	OK	5394	2026-09-24 04:29	32.21	OK
5395	2026-09-24 04:30	32.24	OK	5396	2026-09-24 04:31	30.35	OK
5397	2026-09-24 04:32	32.04	OK	5398	2026-09-24 04:33	30.86	OK
5399	2026-09-24 04:34	31.06	OK	5400	2026-09-24 04:35	32.66	OK
5401	2026-09-24 04:36	31.13	OK	5402	2026-09-24 04:37	32.28	OK
5403	2026-09-24 04:38	31.69	OK	5404	2026-09-24 04:39	31.13	OK
5405	2026-09-24 04:40	31.55	OK	5406	2026-09-24 04:41	31.61	OK
5407	2026-09-24 04:42	30.60	OK	5408	2026-09-24 04:43	31.82	OK
5409	2026-09-24 04:44	32.54	OK	5410	2026-09-24 04:45	31.29	OK
5411	2026-09-24 04:46	31.52	OK	5412	2026-09-24 04:47	31.19	OK
5413	2026-09-24 04:48	31.33	OK	5414	2026-09-24 04:49	30.02	OK
5415	2026-09-24 04:50	33.31	OK	5416	2026-09-24 04:51	32.31	OK
5417	2026-09-24 04:52	30.79	OK	5418	2026-09-24 04:53	31.17	OK
5419	2026-09-24 04:54	32.05	OK	5420	2026-09-24 04:55	30.01	OK
5421	2026-09-24 04:56	31.34	OK	5422	2026-09-24 04:57	29.67	OK
5423	2026-09-24 04:58	33.08	OK	5424	2026-09-24 04:59	31.06	OK
5425	2026-09-24 05:00	32.20	OK	5426	2026-09-24 05:01	30.92	OK
5427	2026-09-24 05:02	31.86	OK	5428	2026-09-24 05:03	31.34	OK
5429	2026-09-24 05:04	31.02	OK	5430	2026-09-24 05:05	31.32	OK
5431	2026-09-24 05:06	32.21	OK	5432	2026-09-24 05:07	31.23	OK
5433	2026-09-24 05:08	30.73	OK	5434	2026-09-24 05:09	31.90	OK
5435	2026-09-24 05:10	30.84	OK	5436	2026-09-24 05:11	30.90	OK
5437	2026-09-24 05:12	32.96	OK	5438	2026-09-24 05:13	30.24	OK
5439	2026-09-24 05:14	32.03	OK	5440	2026-09-24 05:15	31.44	OK
5441	2026-09-24 05:16	31.54	OK	5442	2026-09-24 05:17	31.06	OK
5443	2026-09-24 05:18	31.59	OK	5444	2026-09-24 05:19	32.19	OK
5445	2026-09-24 05:20	32.01	OK	5446	2026-09-24 05:21	30.92	OK
5447	2026-09-24 05:22	29.67	OK	5448	2026-09-24 05:23	32.62	OK
5449	2026-09-24 05:24	32.68	OK	5450	2026-09-24 05:25	30.54	OK
5451	2026-09-24 05:26	32.04	OK	5452	2026-09-24 05:27	32.84	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5453	2026-09-24 05:28	31.14	OK	5454	2026-09-24 05:29	32.84	OK
5455	2026-09-24 05:30	30.35	OK	5456	2026-09-24 05:31	30.33	OK
5457	2026-09-24 05:32	31.70	OK	5458	2026-09-24 05:33	31.68	OK
5459	2026-09-24 05:34	31.30	OK	5460	2026-09-24 05:35	31.18	OK
5461	2026-09-24 05:36	30.33	OK	5462	2026-09-24 05:37	30.50	OK
5463	2026-09-24 05:38	32.81	OK	5464	2026-09-24 05:39	31.75	OK
5465	2026-09-24 05:40	32.33	OK	5466	2026-09-24 05:41	32.15	OK
5467	2026-09-24 05:42	31.28	OK	5468	2026-09-24 05:43	31.46	OK
5469	2026-09-24 05:44	31.81	OK	5470	2026-09-24 05:45	31.18	OK
5471	2026-09-24 05:46	31.97	OK	5472	2026-09-24 05:47	31.61	OK
5473	2026-09-24 05:48	32.16	OK	5474	2026-09-24 05:49	31.32	OK
5475	2026-09-24 05:50	33.06	OK	5476	2026-09-24 05:51	32.14	OK
5477	2026-09-24 05:52	31.08	OK	5478	2026-09-24 05:53	31.35	OK
5479	2026-09-24 05:54	31.50	OK	5480	2026-09-24 05:55	32.33	OK
5481	2026-09-24 05:56	30.81	OK	5482	2026-09-24 05:57	30.96	OK
5483	2026-09-24 05:58	31.77	OK	5484	2026-09-24 05:59	31.46	OK
5485	2026-09-24 06:00	31.80	OK	5486	2026-09-24 06:01	31.78	OK
5487	2026-09-24 06:02	32.59	OK	5488	2026-09-24 06:03	32.21	OK
5489	2026-09-24 06:04	31.74	OK	5490	2026-09-24 06:05	31.72	OK
5491	2026-09-24 06:06	32.90	OK	5492	2026-09-24 06:07	32.12	OK
5493	2026-09-24 06:08	31.81	OK	5494	2026-09-24 06:09	32.12	OK
5495	2026-09-24 06:10	31.49	OK	5496	2026-09-24 06:11	31.05	OK
5497	2026-09-24 06:12	30.92	OK	5498	2026-09-24 06:13	32.34	OK
5499	2026-09-24 06:14	31.33	OK	5500	2026-09-24 06:15	31.48	OK
5501	2026-09-24 06:16	31.30	OK	5502	2026-09-24 06:17	31.54	OK
5503	2026-09-24 06:18	32.32	OK	5504	2026-09-24 06:19	32.54	OK
5505	2026-09-24 06:20	31.60	OK	5506	2026-09-24 06:21	30.99	OK
5507	2026-09-24 06:22	31.79	OK	5508	2026-09-24 06:23	32.32	OK
5509	2026-09-24 06:24	31.07	OK	5510	2026-09-24 06:25	31.77	OK
5511	2026-09-24 06:26	30.95	OK	5512	2026-09-24 06:27	32.77	OK
5513	2026-09-24 06:28	30.99	OK	5514	2026-09-24 06:29	30.88	OK
5515	2026-09-24 06:30	31.19	OK	5516	2026-09-24 06:31	30.58	OK
5517	2026-09-24 06:32	30.85	OK	5518	2026-09-24 06:33	31.90	OK
5519	2026-09-24 06:34	32.28	OK	5520	2026-09-24 06:35	30.90	OK
5521	2026-09-24 06:36	31.15	OK	5522	2026-09-24 06:37	32.33	OK
5523	2026-09-24 06:38	31.86	OK	5524	2026-09-24 06:39	31.86	OK
5525	2026-09-24 06:40	32.87	OK	5526	2026-09-24 06:41	32.26	OK
5527	2026-09-24 06:42	30.86	OK	5528	2026-09-24 06:43	31.86	OK
5529	2026-09-24 06:44	31.66	OK	5530	2026-09-24 06:45	31.10	OK
5531	2026-09-24 06:46	31.13	OK	5532	2026-09-24 06:47	31.83	OK
5533	2026-09-24 06:48	30.16	OK	5534	2026-09-24 06:49	32.87	OK
5535	2026-09-24 06:50	32.30	OK	5536	2026-09-24 06:51	32.40	OK
5537	2026-09-24 06:52	32.04	OK	5538	2026-09-24 06:53	32.61	OK
5539	2026-09-24 06:54	30.71	OK	5540	2026-09-24 06:55	32.03	OK
5541	2026-09-24 06:56	32.34	OK	5542	2026-09-24 06:57	32.99	OK
5543	2026-09-24 06:58	32.11	OK	5544	2026-09-24 06:59	30.91	OK
5545	2026-09-24 07:00	32.31	OK	5546	2026-09-24 07:01	31.37	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5547	2026-09-24 07:02	30.40	OK	5548	2026-09-24 07:03	30.67	OK
5549	2026-09-24 07:04	31.83	OK	5550	2026-09-24 07:05	31.16	OK
5551	2026-09-24 07:06	30.77	OK	5552	2026-09-24 07:07	30.64	OK
5553	2026-09-24 07:08	31.60	OK	5554	2026-09-24 07:09	33.19	OK
5555	2026-09-24 07:10	31.38	OK	5556	2026-09-24 07:11	33.11	OK
5557	2026-09-24 07:12	30.10	OK	5558	2026-09-24 07:13	31.28	OK
5559	2026-09-24 07:14	32.26	OK	5560	2026-09-24 07:15	31.11	OK
5561	2026-09-24 07:16	30.73	OK	5562	2026-09-24 07:17	31.61	OK
5563	2026-09-24 07:18	32.65	OK	5564	2026-09-24 07:19	32.52	OK
5565	2026-09-24 07:20	30.94	OK	5566	2026-09-24 07:21	31.72	OK
5567	2026-09-24 07:22	32.38	OK	5568	2026-09-24 07:23	31.78	OK
5569	2026-09-24 07:24	30.83	OK	5570	2026-09-24 07:25	33.13	OK
5571	2026-09-24 07:26	32.90	OK	5572	2026-09-24 07:27	33.98	OK
5573	2026-09-24 07:28	33.01	OK	5574	2026-09-24 07:29	33.58	OK
5575	2026-09-24 07:30	31.55	OK	5576	2026-09-24 07:31	32.06	OK
5577	2026-09-24 07:32	30.53	OK	5578	2026-09-24 07:33	30.76	OK
5579	2026-09-24 07:34	31.77	OK	5580	2026-09-24 07:35	31.58	OK
5581	2026-09-24 07:36	31.85	OK	5582	2026-09-24 07:37	30.81	OK
5583	2026-09-24 07:38	30.31	OK	5584	2026-09-24 07:39	31.81	OK
5585	2026-09-24 07:40	30.64	OK	5586	2026-09-24 07:41	32.27	OK
5587	2026-09-24 07:42	32.31	OK	5588	2026-09-24 07:43	32.68	OK
5589	2026-09-24 07:44	30.52	OK	5590	2026-09-24 07:45	33.16	OK
5591	2026-09-24 07:46	32.14	OK	5592	2026-09-24 07:47	32.72	OK
5593	2026-09-24 07:48	33.74	OK	5594	2026-09-24 07:49	31.96	OK
5595	2026-09-24 07:50	31.81	OK	5596	2026-09-24 07:51	32.34	OK
5597	2026-09-24 07:52	32.09	OK	5598	2026-09-24 07:53	31.31	OK
5599	2026-09-24 07:54	30.38	OK	5600	2026-09-24 07:55	31.90	OK
5601	2026-09-24 07:56	33.20	OK	5602	2026-09-24 07:57	30.96	OK
5603	2026-09-24 07:58	30.84	OK	5604	2026-09-24 07:59	32.37	OK
5605	2026-09-24 08:00	32.54	OK	5606	2026-09-24 08:01	31.80	OK
5607	2026-09-24 08:02	31.44	OK	5608	2026-09-24 08:03	30.79	OK
5609	2026-09-24 08:04	31.97	OK	5610	2026-09-24 08:05	32.22	OK
5611	2026-09-24 08:06	30.12	OK	5612	2026-09-24 08:07	31.87	OK
5613	2026-09-24 08:08	32.01	OK	5614	2026-09-24 08:09	31.83	OK
5615	2026-09-24 08:10	30.12	OK	5616	2026-09-24 08:11	30.24	OK
5617	2026-09-24 08:12	30.78	OK	5618	2026-09-24 08:13	29.27	OK
5619	2026-09-24 08:14	30.26	OK	5620	2026-09-24 08:15	31.00	OK
5621	2026-09-24 08:16	32.10	OK	5622	2026-09-24 08:17	31.38	OK
5623	2026-09-24 08:18	31.49	OK	5624	2026-09-24 08:19	31.60	OK
5625	2026-09-24 08:20	32.16	OK	5626	2026-09-24 08:21	30.87	OK
5627	2026-09-24 08:22	30.83	OK	5628	2026-09-24 08:23	31.45	OK
5629	2026-09-24 08:24	31.45	OK	5630	2026-09-24 08:25	30.71	OK
5631	2026-09-24 08:26	31.74	OK	5632	2026-09-24 08:27	30.75	OK
5633	2026-09-24 08:28	31.29	OK	5634	2026-09-24 08:29	32.12	OK
5635	2026-09-24 08:30	31.76	OK	5636	2026-09-24 08:31	31.33	OK
5637	2026-09-24 08:32	30.79	OK	5638	2026-09-24 08:33	31.43	OK
5639	2026-09-24 08:34	31.13	OK	5640	2026-09-24 08:35	31.05	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5641	2026-09-24 08:36	31.37	OK	5642	2026-09-24 08:37	33.26	OK
5643	2026-09-24 08:38	32.34	OK	5644	2026-09-24 08:39	31.88	OK
5645	2026-09-24 08:40	31.05	OK	5646	2026-09-24 08:41	32.95	OK
5647	2026-09-24 08:42	31.12	OK	5648	2026-09-24 08:43	30.70	OK
5649	2026-09-24 08:44	31.46	OK	5650	2026-09-24 08:45	31.00	OK
5651	2026-09-24 08:46	31.91	OK	5652	2026-09-24 08:47	30.53	OK
5653	2026-09-24 08:48	31.43	OK	5654	2026-09-24 08:49	30.49	OK
5655	2026-09-24 08:50	31.29	OK	5656	2026-09-24 08:51	31.89	OK
5657	2026-09-24 08:52	31.74	OK	5658	2026-09-24 08:53	30.88	OK
5659	2026-09-24 08:54	31.77	OK	5660	2026-09-24 08:55	31.98	OK
5661	2026-09-24 08:56	30.12	OK	5662	2026-09-24 08:57	29.93	OK
5663	2026-09-24 08:58	30.53	OK	5664	2026-09-24 08:59	31.48	OK
5665	2026-09-24 09:00	30.95	OK	5666	2026-09-24 09:01	30.11	OK
5667	2026-09-24 09:02	30.60	OK	5668	2026-09-24 09:03	31.40	OK
5669	2026-09-24 09:04	30.75	OK	5670	2026-09-24 09:05	30.66	OK
5671	2026-09-24 09:06	30.53	OK	5672	2026-09-24 09:07	30.17	OK
5673	2026-09-24 09:08	30.56	OK	5674	2026-09-24 09:09	31.15	OK
5675	2026-09-24 09:10	32.14	OK	5676	2026-09-24 09:11	31.45	OK
5677	2026-09-24 09:12	31.07	OK	5678	2026-09-24 09:13	31.66	OK
5679	2026-09-24 09:14	32.53	OK	5680	2026-09-24 09:15	32.29	OK
5681	2026-09-24 09:16	31.40	OK	5682	2026-09-24 09:17	30.18	OK
5683	2026-09-24 09:18	31.02	OK	5684	2026-09-24 09:19	31.57	OK
5685	2026-09-24 09:20	30.01	OK	5686	2026-09-24 09:21	30.55	OK
5687	2026-09-24 09:22	31.86	OK	5688	2026-09-24 09:23	30.10	OK
5689	2026-09-24 09:24	32.55	OK	5690	2026-09-24 09:25	30.78	OK
5691	2026-09-24 09:26	32.51	OK	5692	2026-09-24 09:27	31.87	OK
5693	2026-09-24 09:28	31.49	OK	5694	2026-09-24 09:29	30.95	OK
5695	2026-09-24 09:30	31.22	OK	5696	2026-09-24 09:31	32.04	OK
5697	2026-09-24 09:32	30.21	OK	5698	2026-09-24 09:33	29.61	OK
5699	2026-09-24 09:34	30.66	OK	5700	2026-09-24 09:35	31.88	OK
5701	2026-09-24 09:36	30.29	OK	5702	2026-09-24 09:37	30.40	OK
5703	2026-09-24 09:38	30.73	OK	5704	2026-09-24 09:39	31.06	OK
5705	2026-09-24 09:40	30.84	OK	5706	2026-09-24 09:41	30.68	OK
5707	2026-09-24 09:42	31.06	OK	5708	2026-09-24 09:43	30.35	OK
5709	2026-09-24 09:44	31.42	OK	5710	2026-09-24 09:45	30.23	OK
5711	2026-09-24 09:46	30.76	OK	5712	2026-09-24 09:47	30.97	OK
5713	2026-09-24 09:48	32.27	OK	5714	2026-09-24 09:49	30.85	OK
5715	2026-09-24 09:50	29.58	OK	5716	2026-09-24 09:51	31.66	OK
5717	2026-09-24 09:52	29.51	OK	5718	2026-09-24 09:53	31.08	OK
5719	2026-09-24 09:54	31.87	OK	5720	2026-09-24 09:55	29.95	OK
5721	2026-09-24 09:56	30.67	OK	5722	2026-09-24 09:57	30.50	OK
5723	2026-09-24 09:58	31.14	OK	5724	2026-09-24 09:59	29.68	OK
5725	2026-09-24 10:00	30.77	OK	5726	2026-09-24 10:01	31.58	OK
5727	2026-09-24 10:02	30.17	OK	5728	2026-09-24 10:03	30.37	OK
5729	2026-09-24 10:04	31.14	OK	5730	2026-09-24 10:05	30.88	OK
5731	2026-09-24 10:06	31.59	OK	5732	2026-09-24 10:07	30.52	OK
5733	2026-09-24 10:08	32.03	OK	5734	2026-09-24 10:09	30.59	OK

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-317168

84% HEALTH (GOOD)

Air Compressor Motor • Compressor Room

Timeframe: 2026-09-20 10:35 to 2026-09-24 10:35 (UTC)

#	Time (UTC)	Value (°C)	Status	#	Time (UTC)	Value (°C)	Status
5735	2026-09-24 10:10	29.79	OK	5736	2026-09-24 10:11	30.98	OK
5737	2026-09-24 10:12	30.03	OK	5738	2026-09-24 10:13	30.56	OK
5739	2026-09-24 10:14	31.04	OK	5740	2026-09-24 10:15	30.78	OK
5741	2026-09-24 10:16	30.51	OK	5742	2026-09-24 10:17	30.79	OK
5743	2026-09-24 10:18	30.13	OK	5744	2026-09-24 10:19	31.93	OK
5745	2026-09-24 10:20	31.86	OK	5746	2026-09-24 10:21	30.19	OK
5747	2026-09-24 10:22	30.29	OK	5748	2026-09-24 10:23	30.58	OK
5749	2026-09-24 10:24	30.46	OK	5750	2026-09-24 10:25	30.92	OK
5751	2026-09-24 10:26	30.49	OK	5752	2026-09-24 10:27	30.56	OK
5753	2026-09-24 10:28	30.05	OK	5754	2026-09-24 10:29	30.98	OK
5755	2026-09-24 10:30	30.09	OK	5756	2026-09-24 10:31	30.90	OK
5757	2026-09-24 10:32	30.36	OK	5758	2026-09-24 10:33	30.64	OK
5759	2026-09-24 10:34	30.53	OK	5760	2026-09-24 10:35	31.32	OK