

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-550588

Boiler Feed Pump Motor • Boiler House

97% HEALTH (OPTIMAL)

Timeframe: 2026-09-23 10:35 to 2026-09-24 10:35 (UTC)

Signals Monitored

6

Threshold Breaches

0

Excursion Events

1

System Alerts

0


DIAGNOSTIC & ENGINEERING INSIGHTS

- Operating Health Score is evaluated at 97% (Optimal).
- Zero critical severity threshold events were triggered during this inspection interval.
- All monitored telemetry channels remained within manufacturer engineering boundaries.

TELEMETRY SIGNALS SUMMARY & STATISTICAL LIMITS

Signal / Channel	Unit	Safe Limits	Min	Max	Mean	Samples	Status
Winding_Temp_U	°C	10 - 130	65.1	84.3	74.9	1,441	NORMAL
Winding_Temp_V	°C	10 - 130	59.2	75.3	67.2	1,441	NORMAL
Winding_Temp_W	°C	10 - 130	71.7	88.1	79.5	1,441	NORMAL
Bearing_Temp_DE	°C	10 - 95	52.7	63.1	57.8	1,441	NORMAL
Bearing_Temp_NDE	°C	10 - 95	51.2	62.6	57.0	1,441	NORMAL
Ambient_Temp	°C	0 - 50	26.2	32.0	29.2	1,441	NORMAL

SIGNAL TREND OVERVIEW (UNAGGREGATED PROFILES)

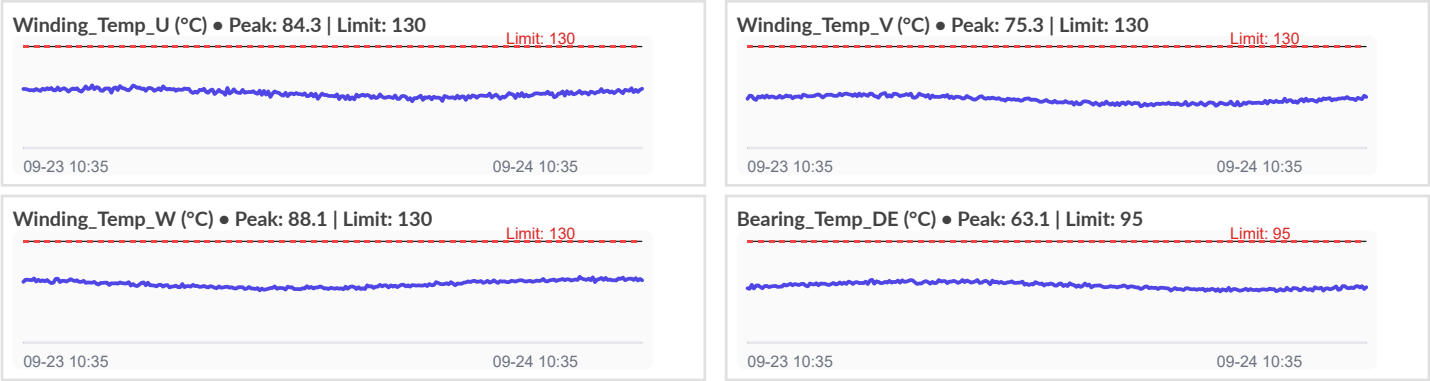

EXCURSION EVENTS LOG (1 Recorded)


Signal	Type	Start (UTC)	Duration	Peak	Limit
Current_H3_L2	HIGH_EXCURSION	2026-09-24 07:20	46.0 m	6.3	6.0

VISUAL TELEMETRY TRENDS & ANALYSIS DASHBOARD

Graphical summary mode enabled. Displaying full-resolution trend curves, safe threshold boundaries, and peak statistical envelopes for all selected signals.


Signal Trend: Winding_Temp_U (°C)

Design Limit: 10.0 - 130.0 | Peak: 84.3 | Avg: 74.9

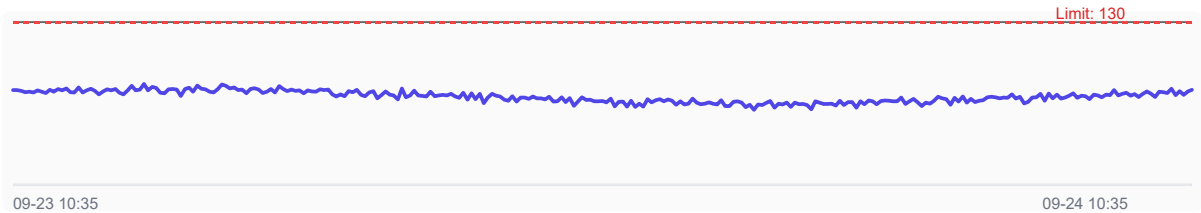


Signal Trend: Winding_Temp_V (°C)

Design Limit: 10.0 - 130.0 | Peak: 75.3 | Avg: 67.2

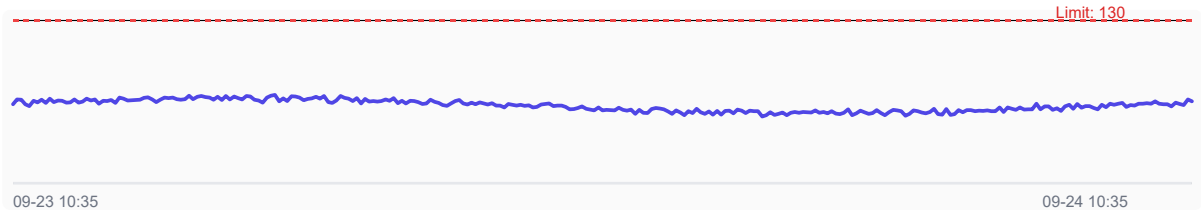


Signal Trend: Winding_Temp_W (°C)

Design Limit: 10.0 - 130.0 | Peak: 88.1 | Avg: 79.5

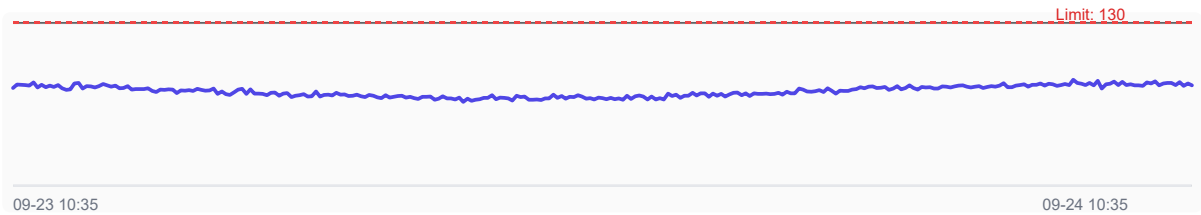


Signal Trend: Bearing_Temp_DE (°C)

Design Limit: 10.0 - 95.0 | Peak: 63.1 | Avg: 57.8

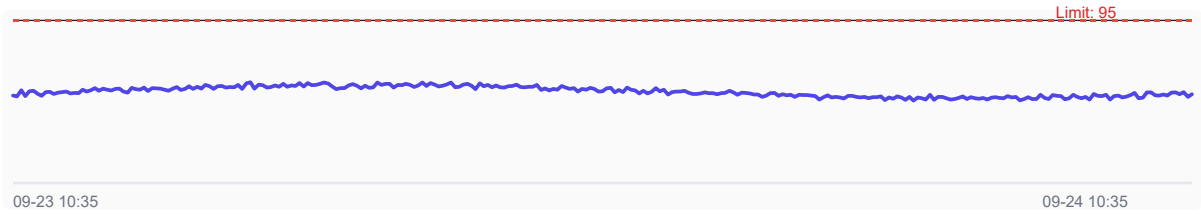

Signal Trend: Bearing_Temp_NDE (°C)

Design Limit: 10.0 - 95.0 | Peak: 62.6 | Avg: 57.0

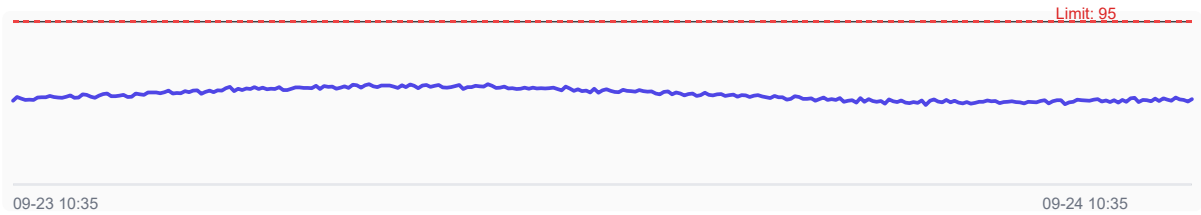

Signal Trend: Ambient_Temp (°C)

Design Limit: 0.0 - 50.0 | Peak: 32.0 | Avg: 29.2

INDUSTRIAL ASSET TELEMETRY REPORT

Report ID: REP-550588

Boiler Feed Pump Motor • Boiler House

97% HEALTH (OPTIMAL)

Timeframe: 2026-09-23 10:35 to 2026-09-24 10:35 (UTC)

