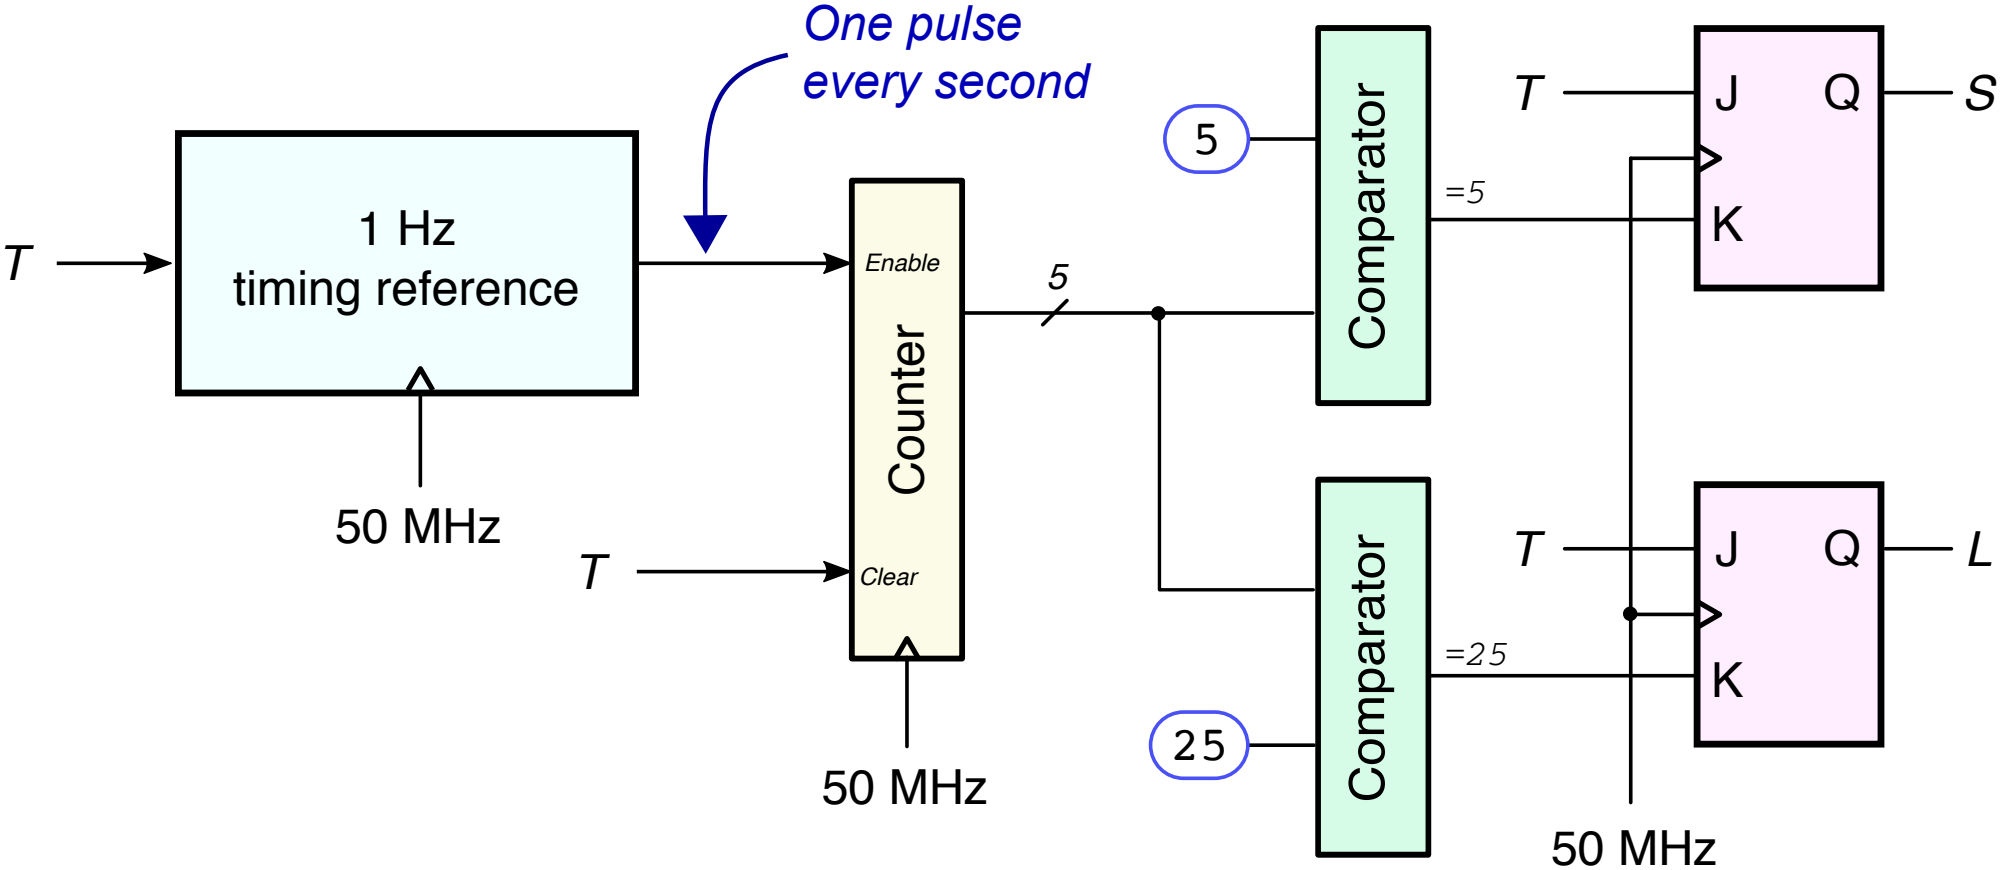
One pulse
every second
T
1 Hz
timing reference
50 MHz
Enable
Counter
Clear
T
50 MHz
5
5
Comparator
=5
5
T
J
Q
S
K
Comparator
=25
25
T
J
Q
L
K
50 MHz