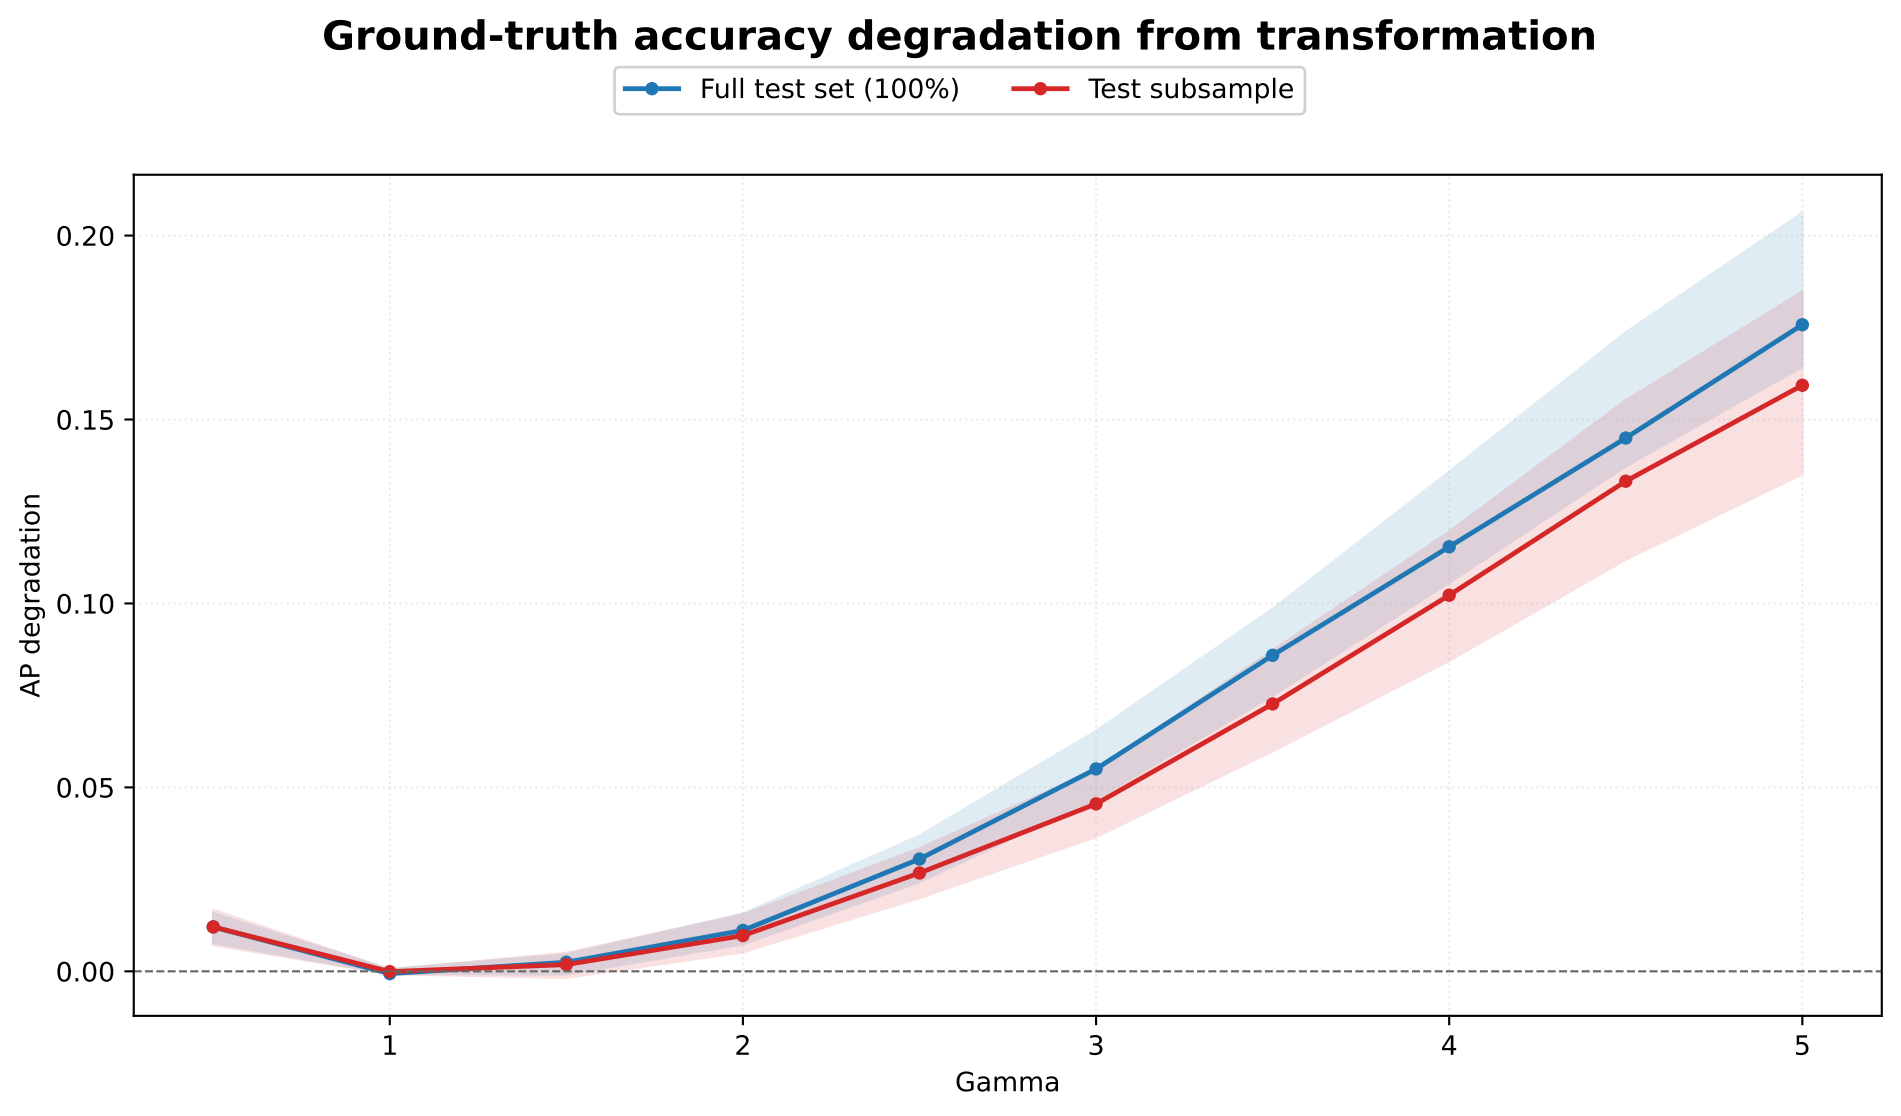
Ground-truth accuracy degradation from transformation
Full test set (100%)
Test subsample
AP degradation
0.20
0.15
0.10
0.05
0.00
1
2
3
4
5
Gamma