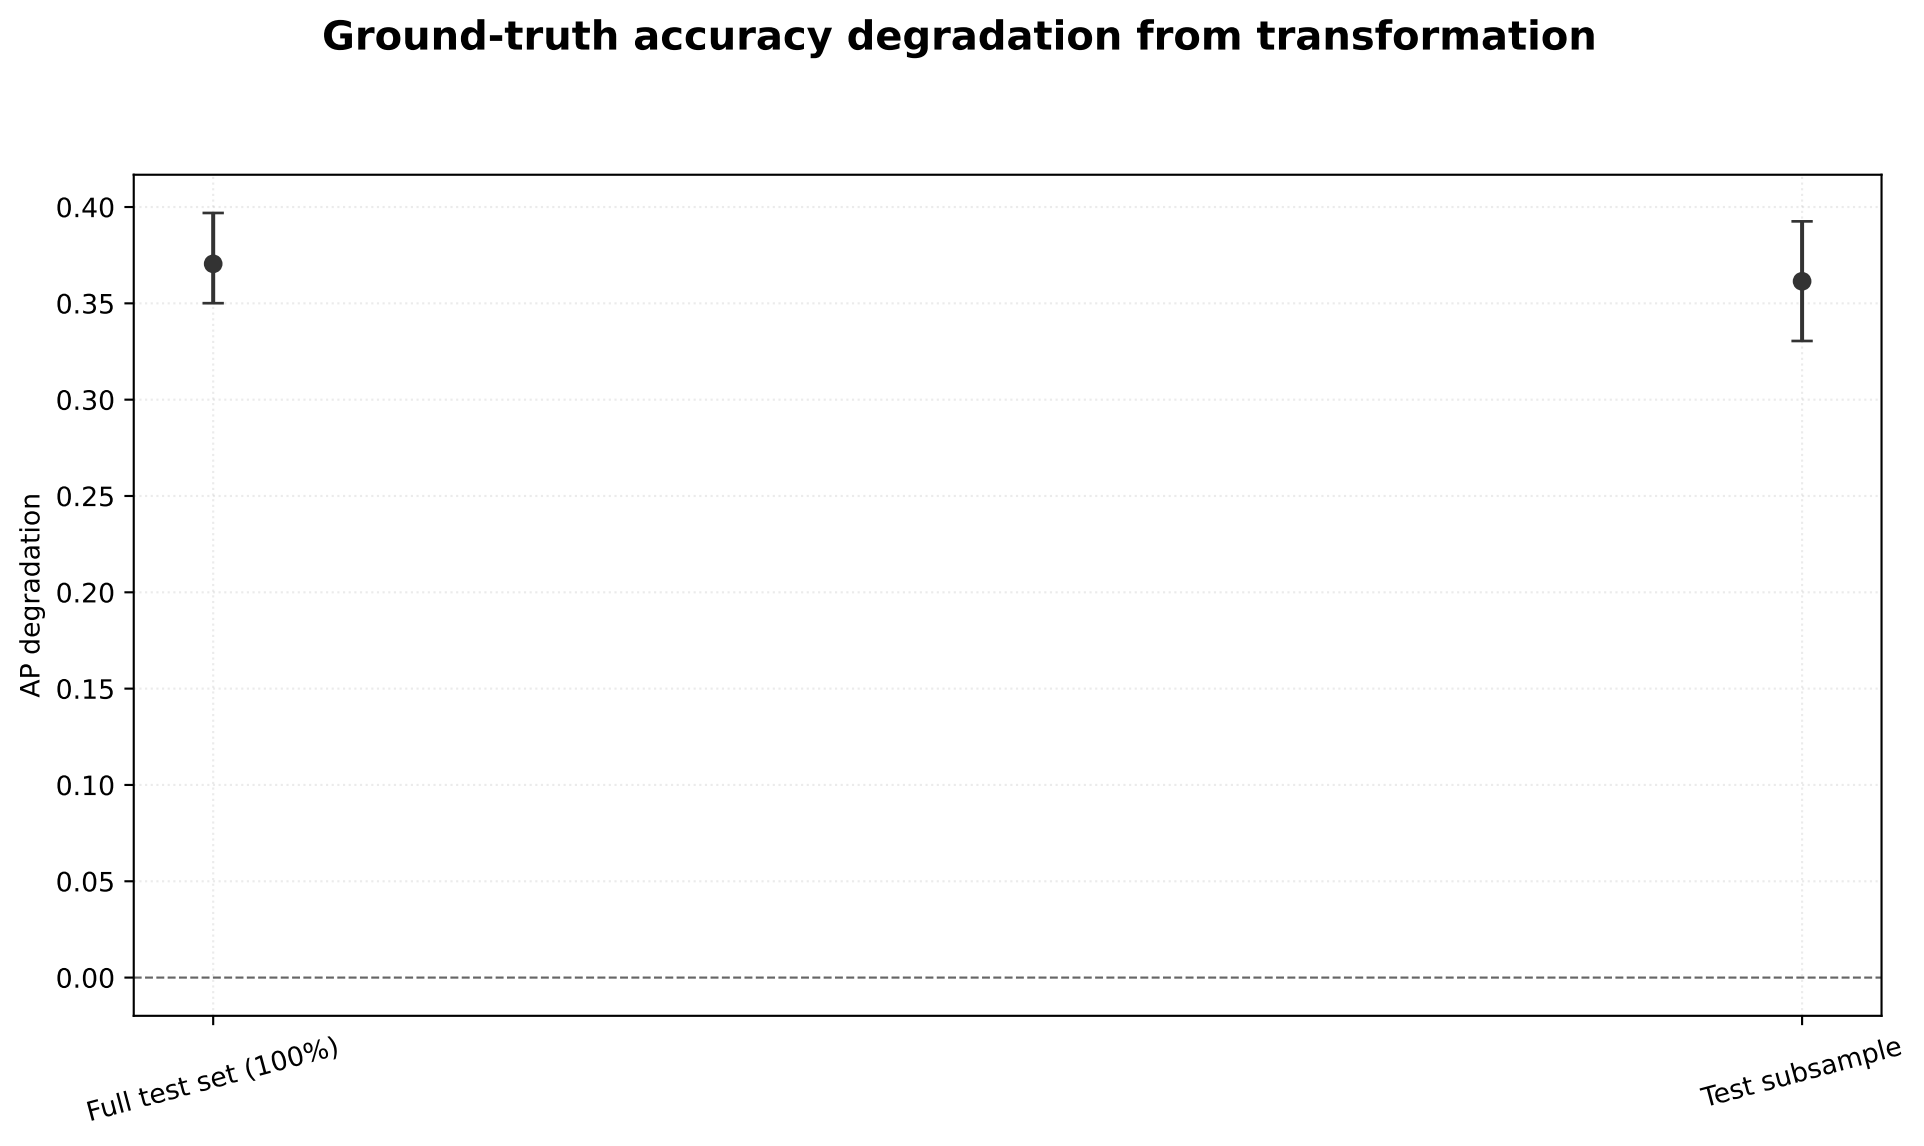
Ground-truth accuracy degradation from transformation
AP degradation
0.40
0.35
0.30
0.25
0.20
0.15
0.10
0.05
0.00
Full test set (100%)
Test subsample