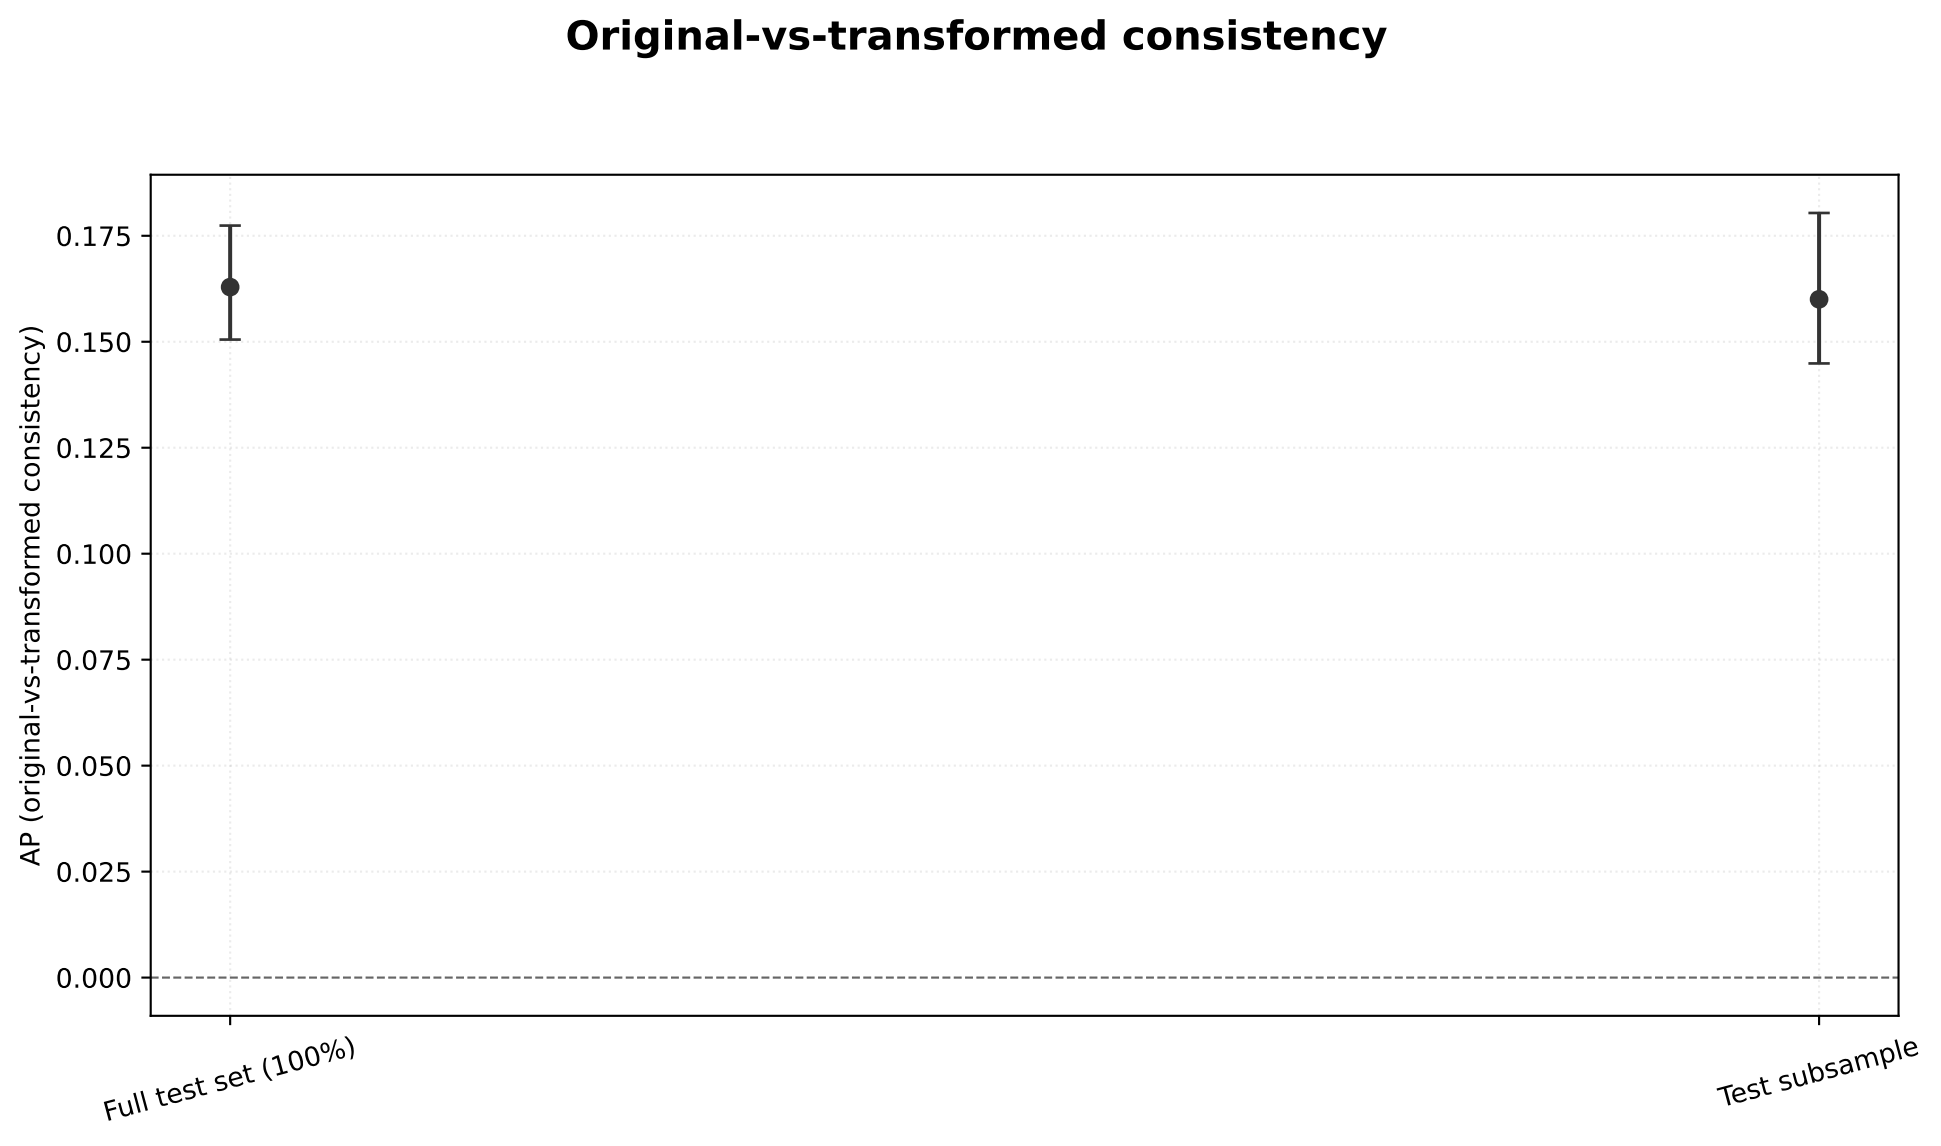
Original-vs-transformed consistency
AP (original-vs-transformed consistency)
0.175
0.150
0.125
0.100
0.075
0.050
0.025
0.000
Full test set (100%)
Test subsample