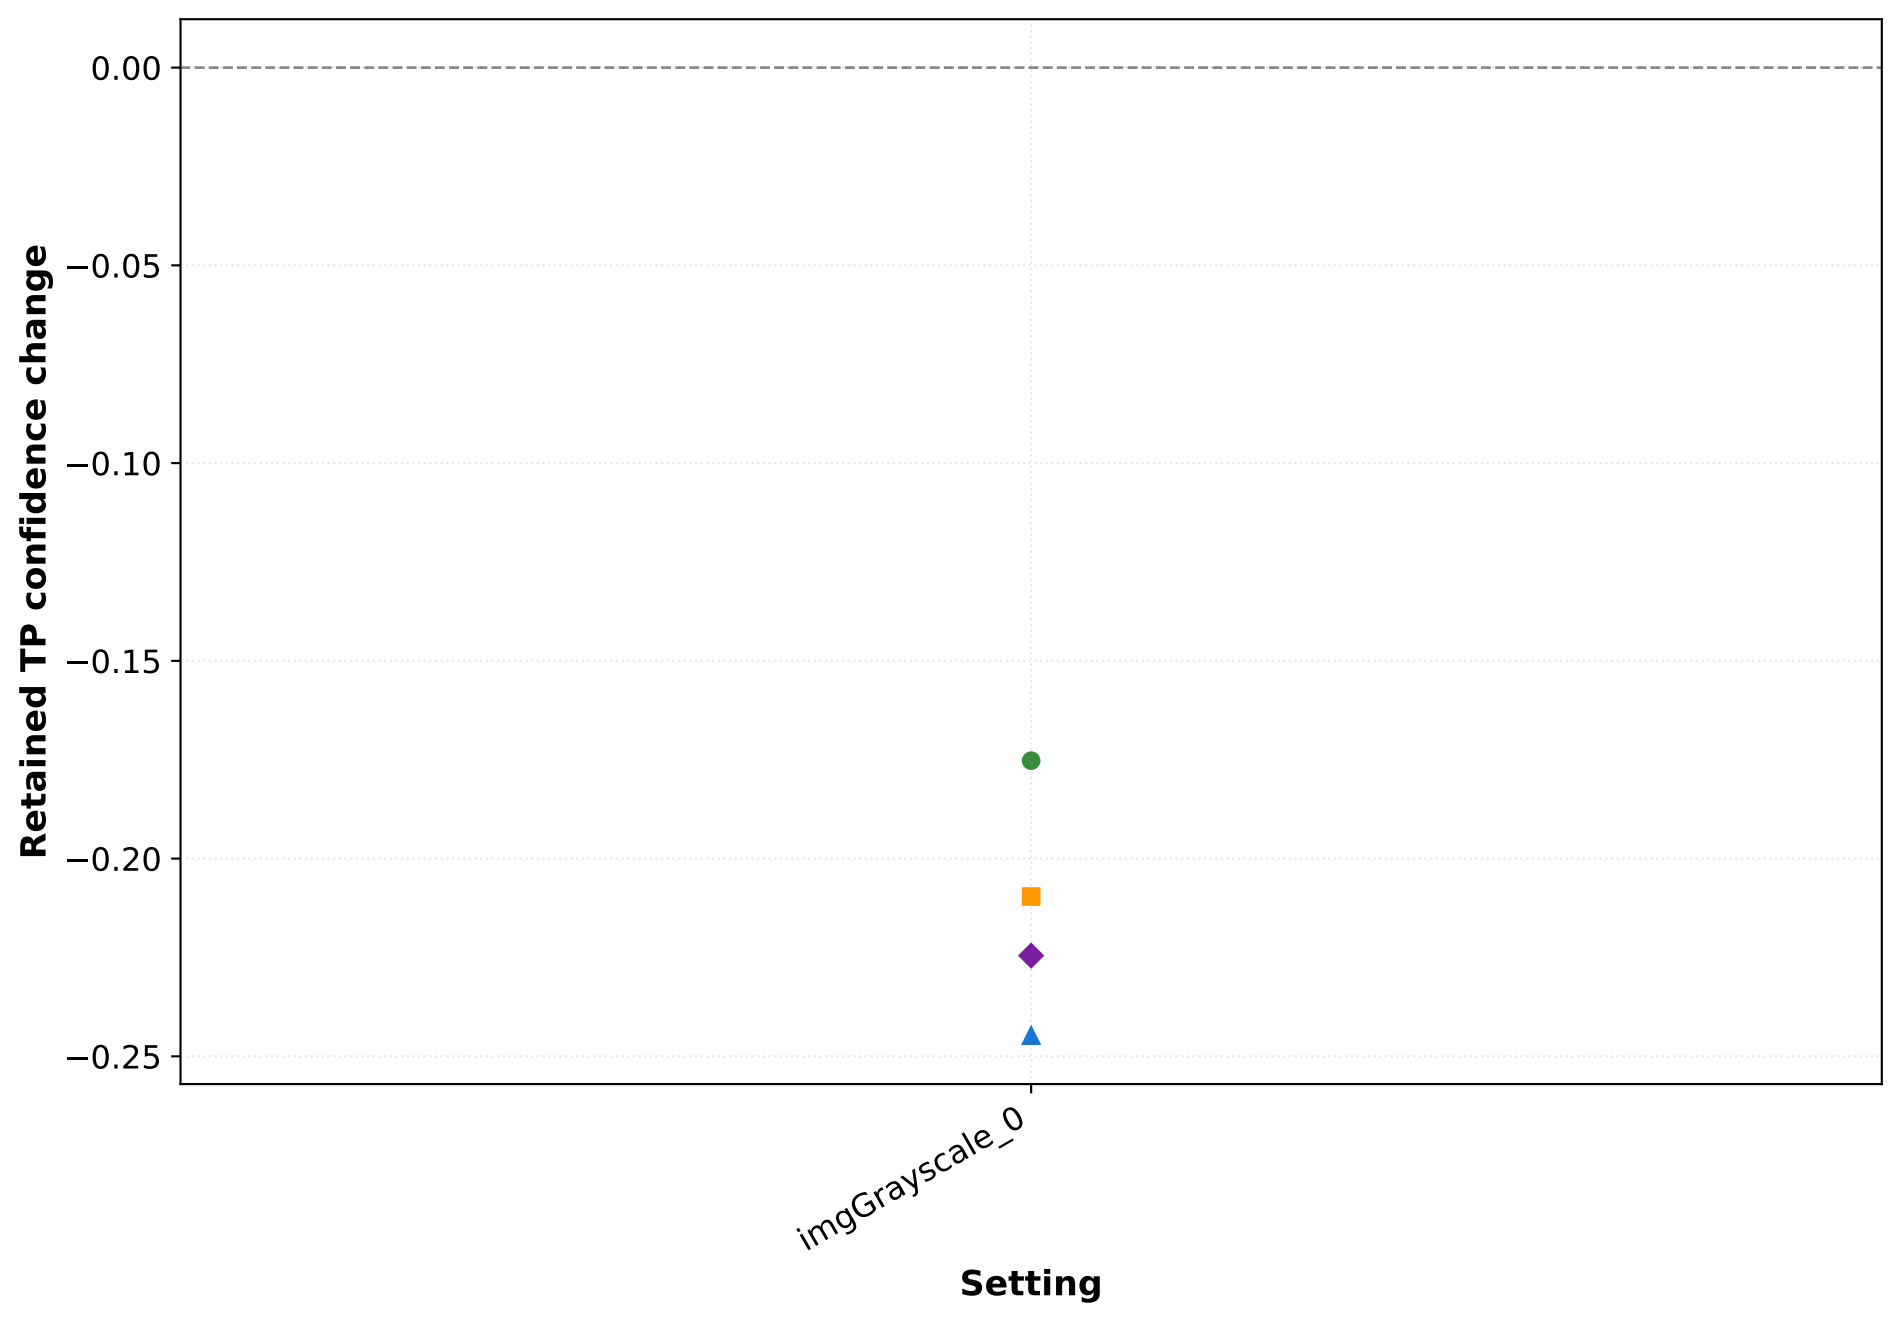
0.00
−0.05
−0.10
−0.15
−0.20
−0.25
Retained TP confidence change
imgGrayscale_0
Setting