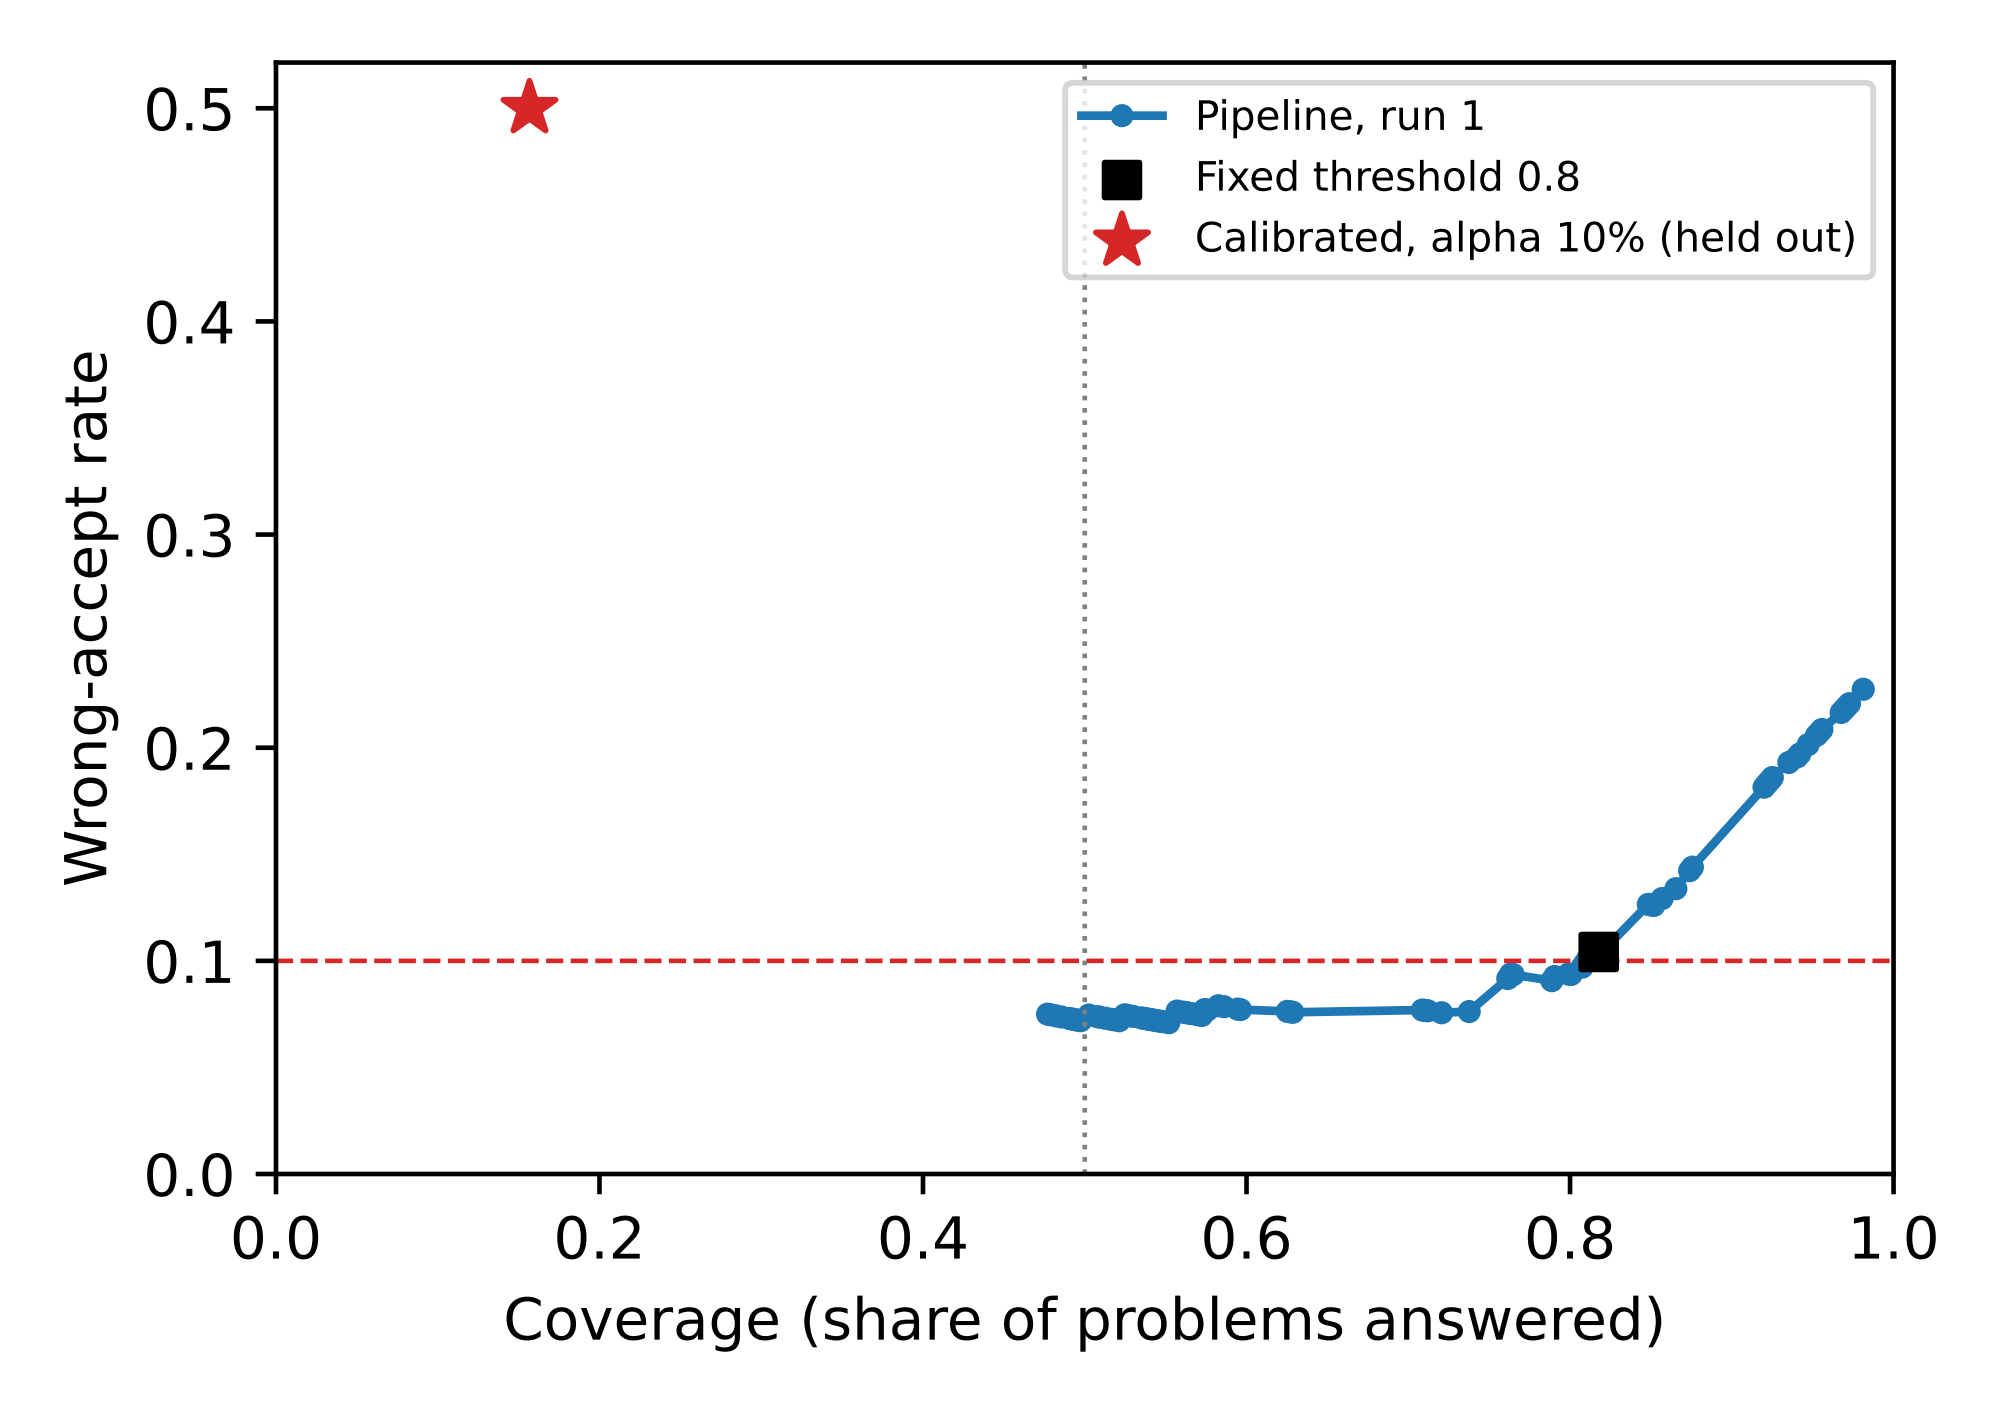
Pipeline, run 1
Fixed threshold 0.8
Calibrated, alpha 10% (held out)
Wrong-accept rate
Coverage (share of problems answered)
0.0
0.1
0.2
0.3
0.4
0.5
0.0
0.2
0.4
0.6
0.8
1.0