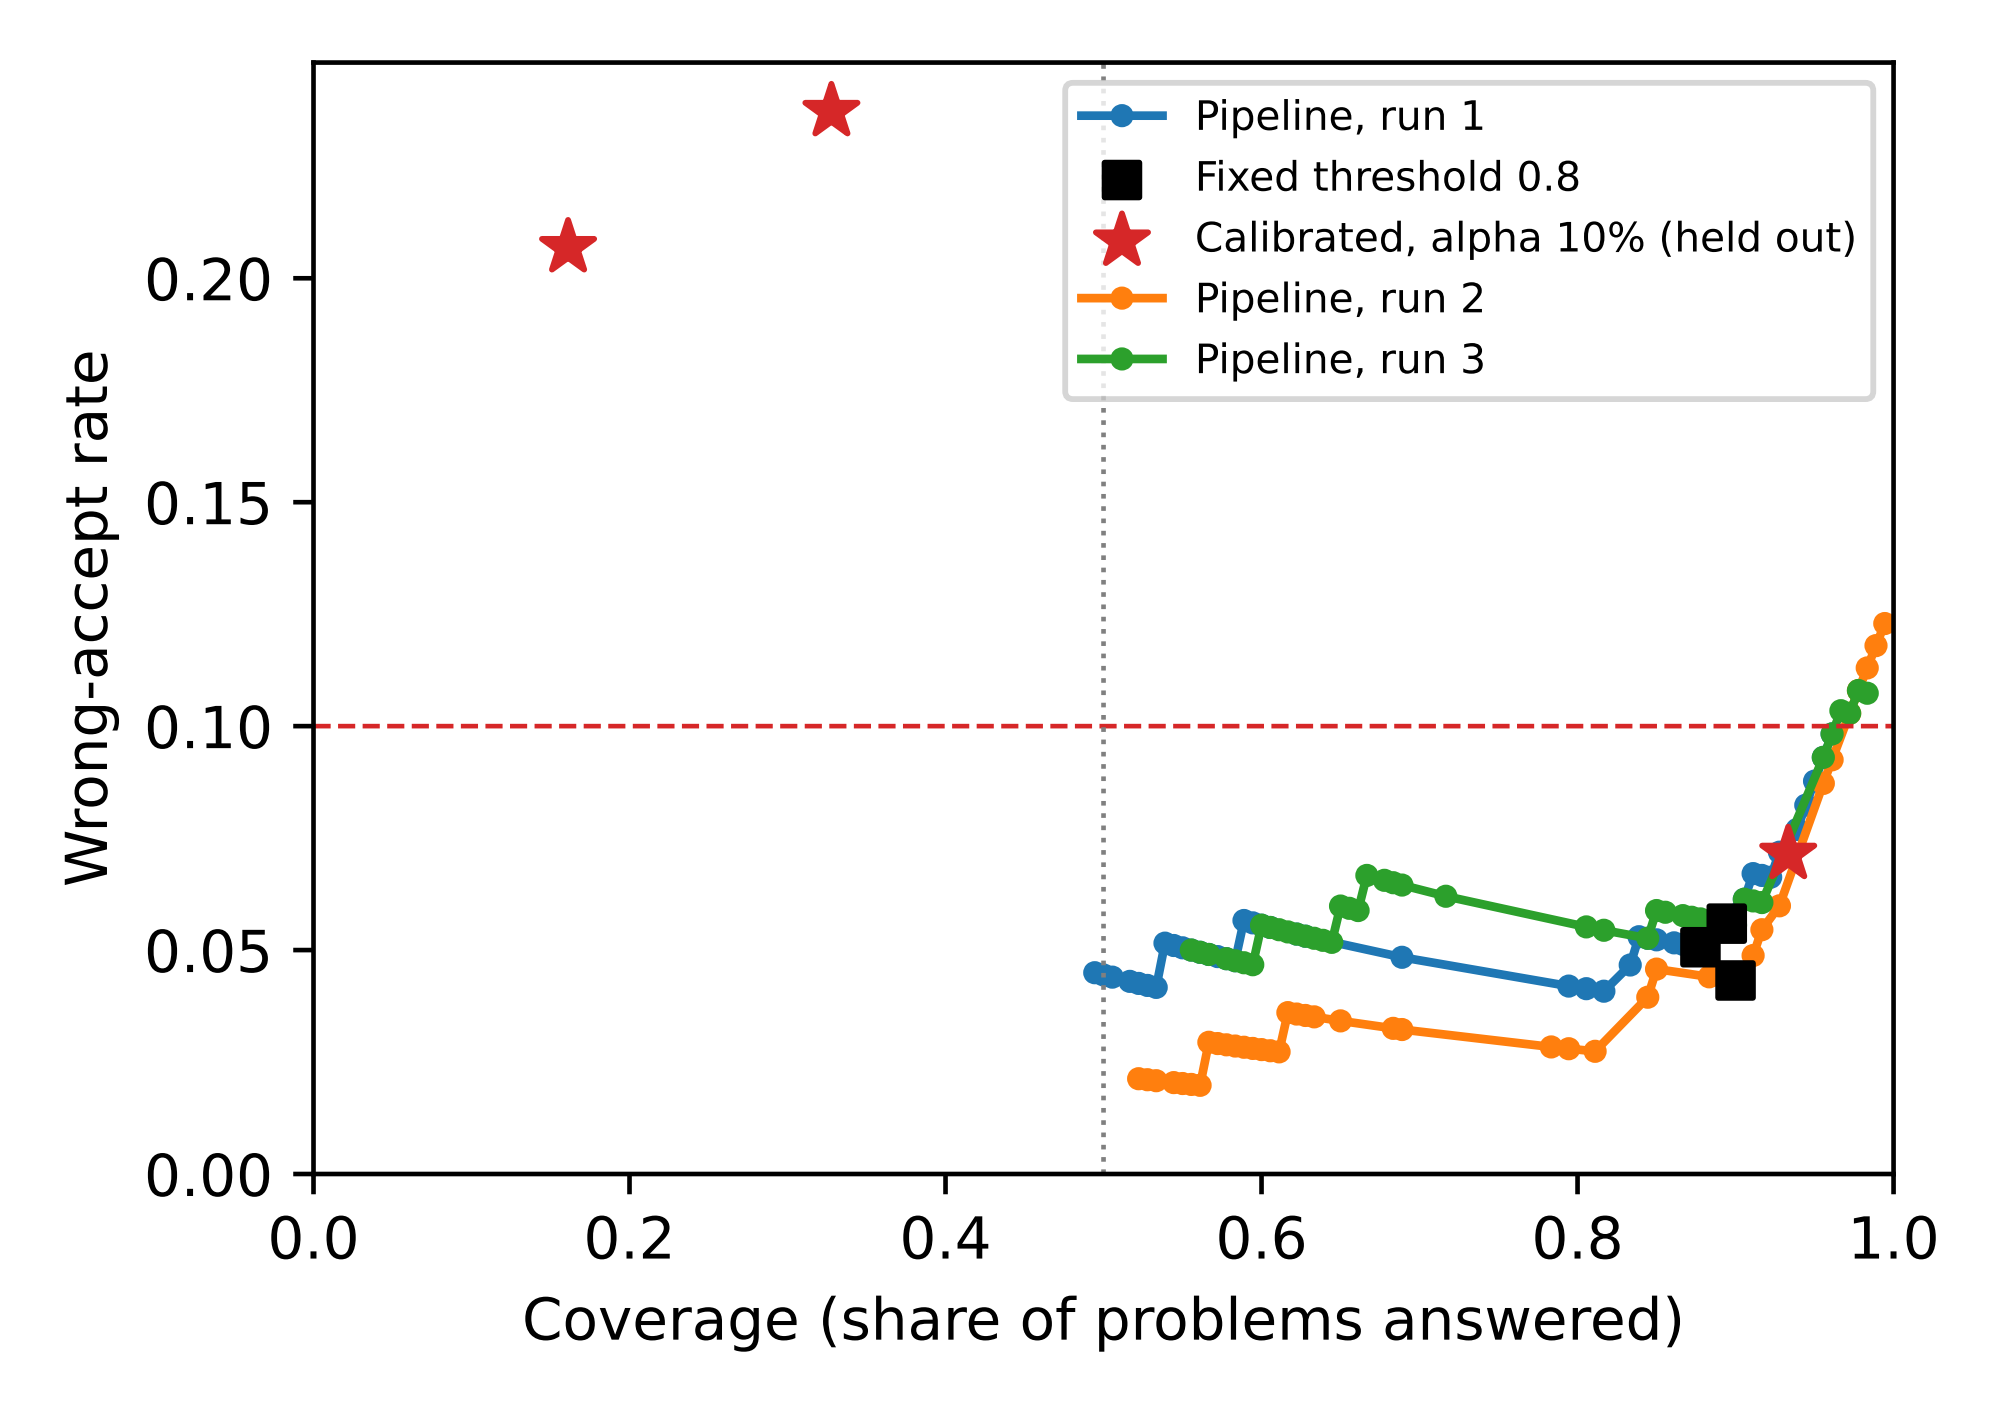
Pipeline, run 1
Fixed threshold 0.8
Calibrated, alpha 10% (held out)
Pipeline, run 2
Pipeline, run 3
Wrong-accept rate
0.00
0.05
0.10
0.15
0.20
0.0
0.2
0.4
0.6
0.8
1.0
Coverage (share of problems answered)