

FIGURE 21 - Single Natural Gas Meter Recess Guidelines


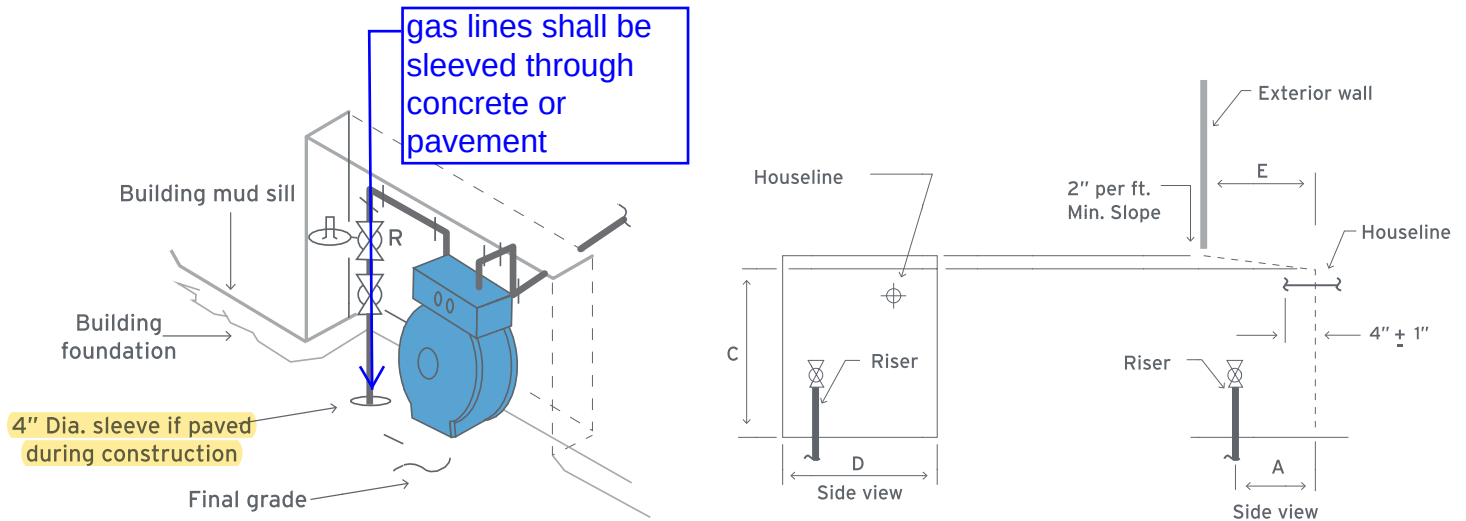


FIGURE 22 - Natural Gas Meter Enclosure - Single Meter Surface Mount

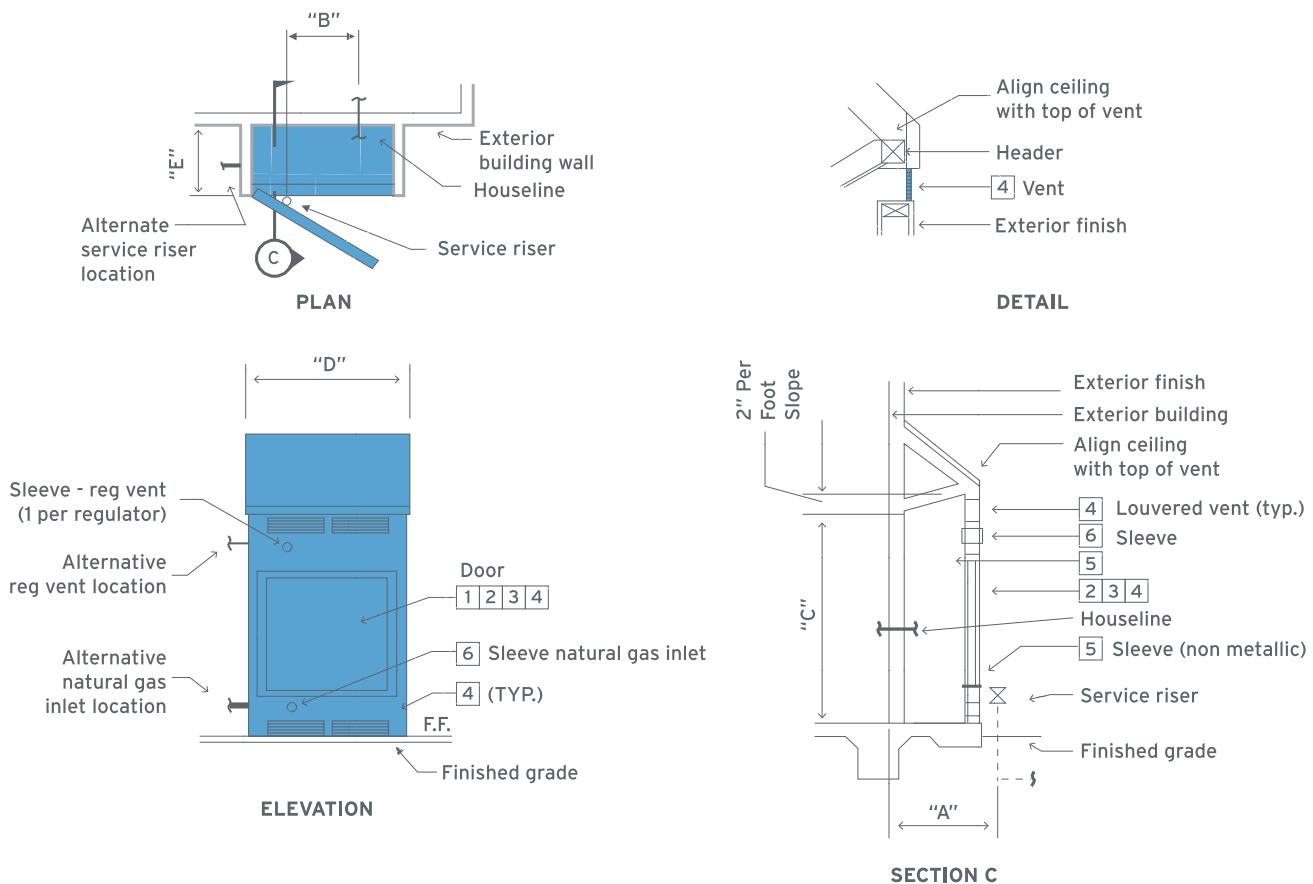

1. Enclosure doors may be full opening doors or they must meet the minimum size requirements established by SoCalGas. In all cases the maximum door is 48". Multiple doors are required for enclosures with door requirements exceeding 48" in width.
2. Provide 1 pair butt hinges per door.
3. Access door with padlock latch.
4. Louver vent top and bottom each door and enclosure for required ventilation area shown in Table 2.
5. Provide sealed joints throughout interior of enclosure.
6. Sleeve size and location per SoCalGas instruction.