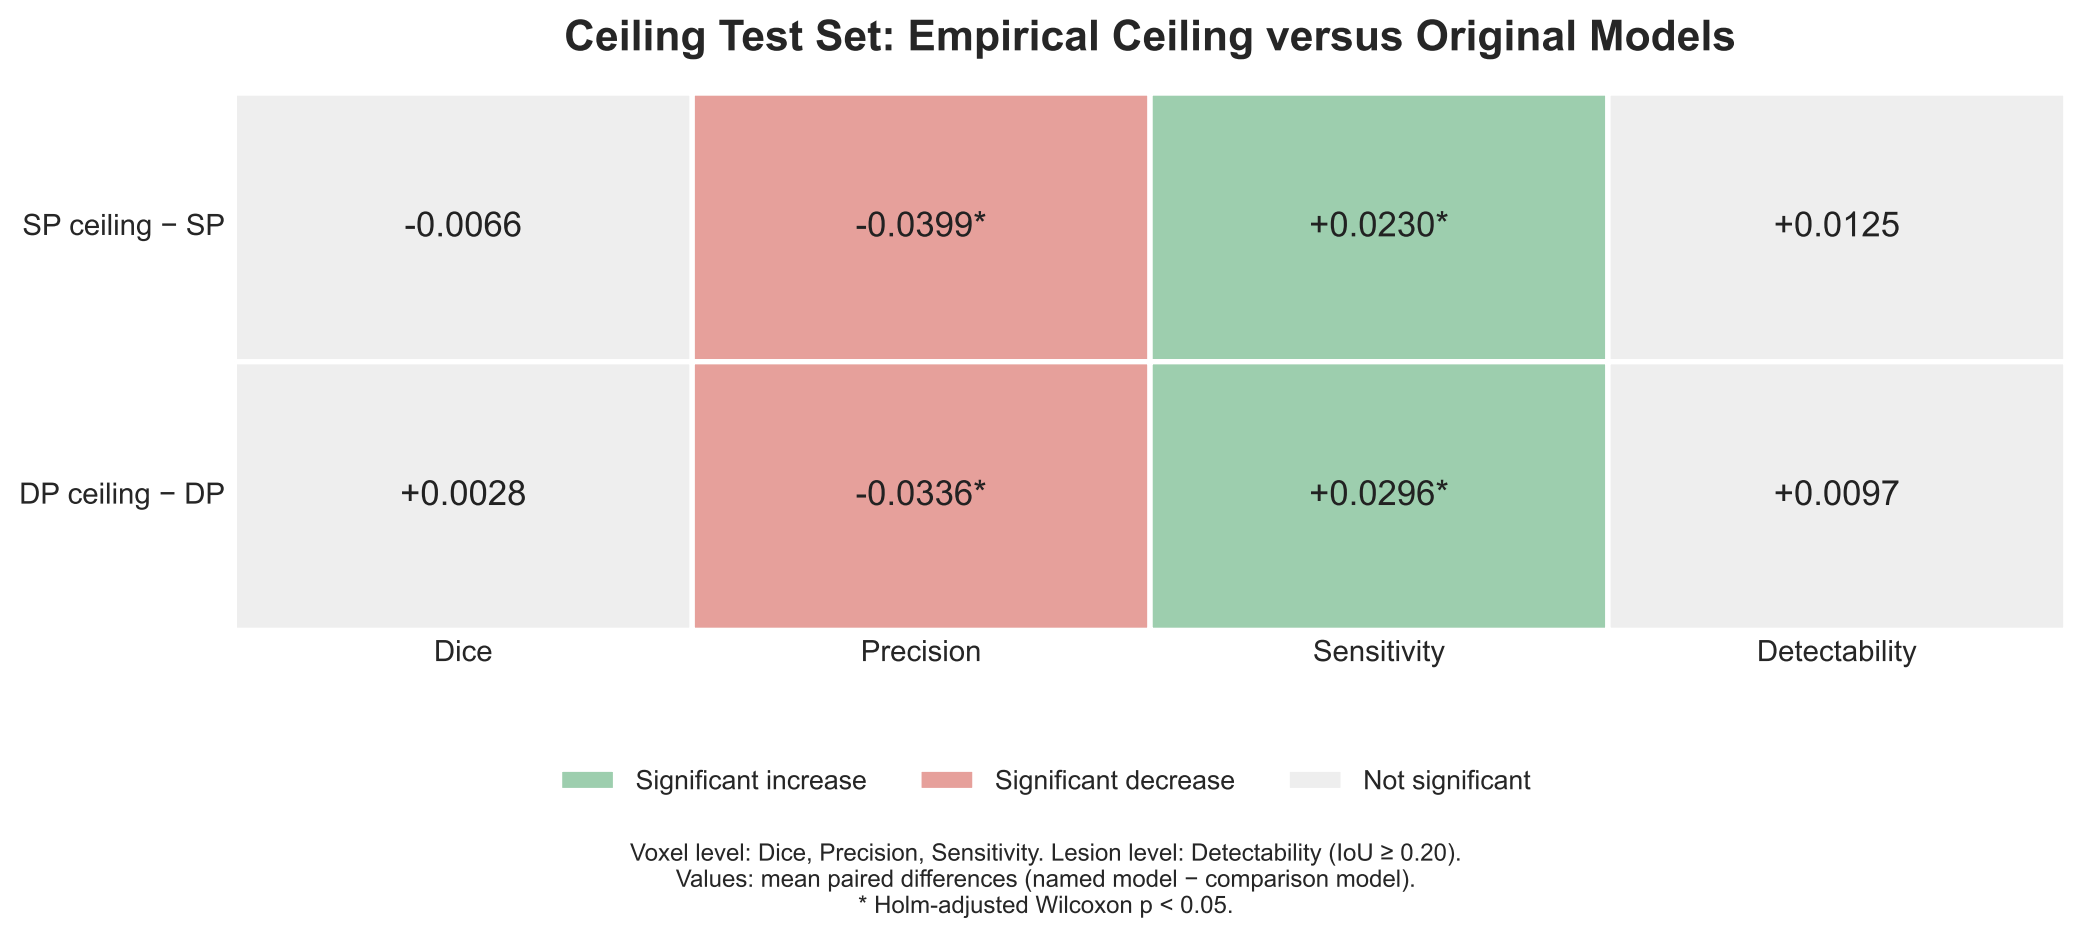
Ceiling Test Set: Empirical Ceiling versus Original Models
SP ceiling − SP
DP ceiling − DP
-0.0066
-0.0399*
+0.0230*
+0.0125
+0.0028
-0.0336*
+0.0296*
+0.0097
Dice
Precision
Sensitivity
Detectability
Significant increase
Significant decrease
Not significant
Voxel level: Dice, Precision, Sensitivity. Lesion level: Detectability (IoU ≥ 0.20).
Values: mean paired differences (named model − comparison model).
* Holm-adjusted Wilcoxon p < 0.05.