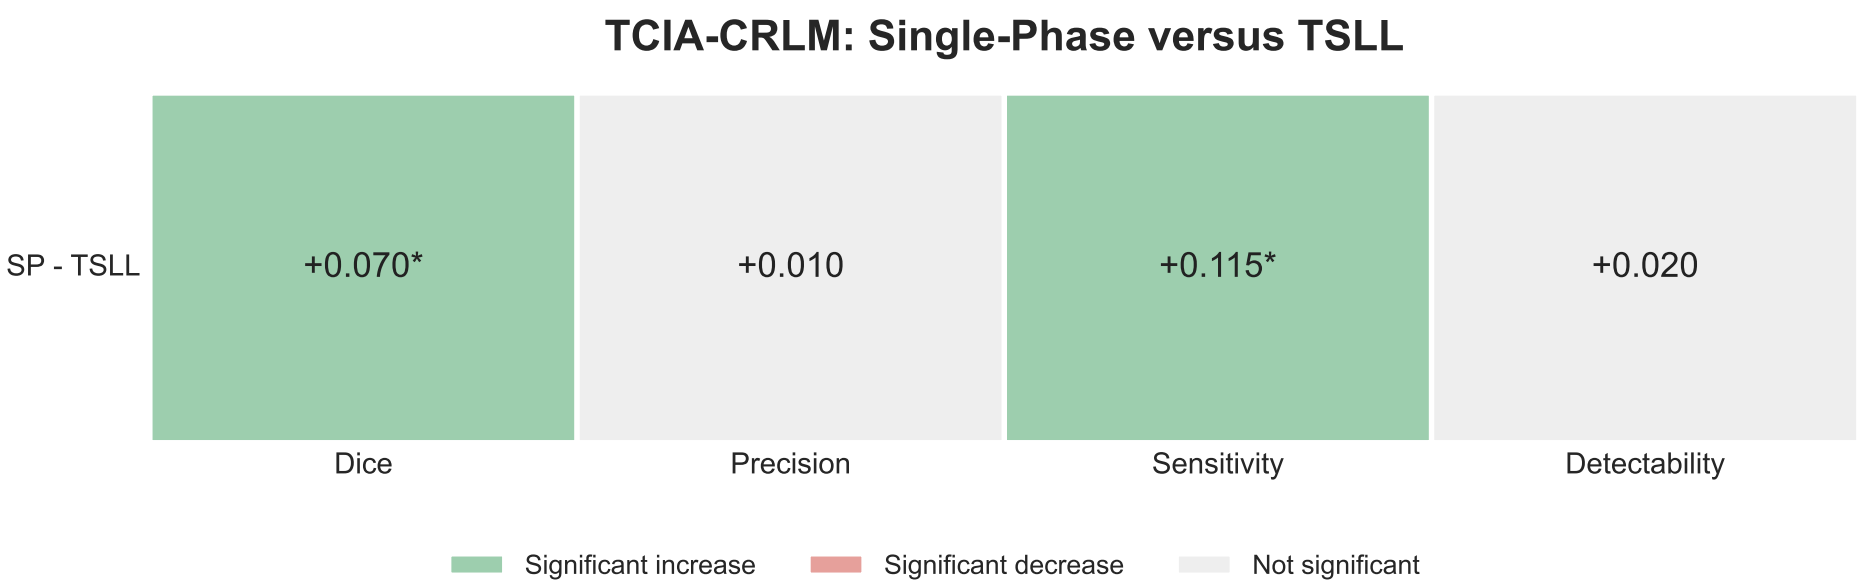
TCIA-CRLM: Single-Phase versus TSLL
SP - TSLL
+0.070*
+0.010
+0.115*
+0.020
Dice
Precision
Sensitivity
Detectability
Significant increase
Significant decrease
Not significant
Voxel level: Dice, Precision, Sensitivity. Lesion level: Detectability (IoU ≥ 0.20).
Values: mean paired differences (SP - TSLL).
* Holm-adjusted Wilcoxon < 0.05.