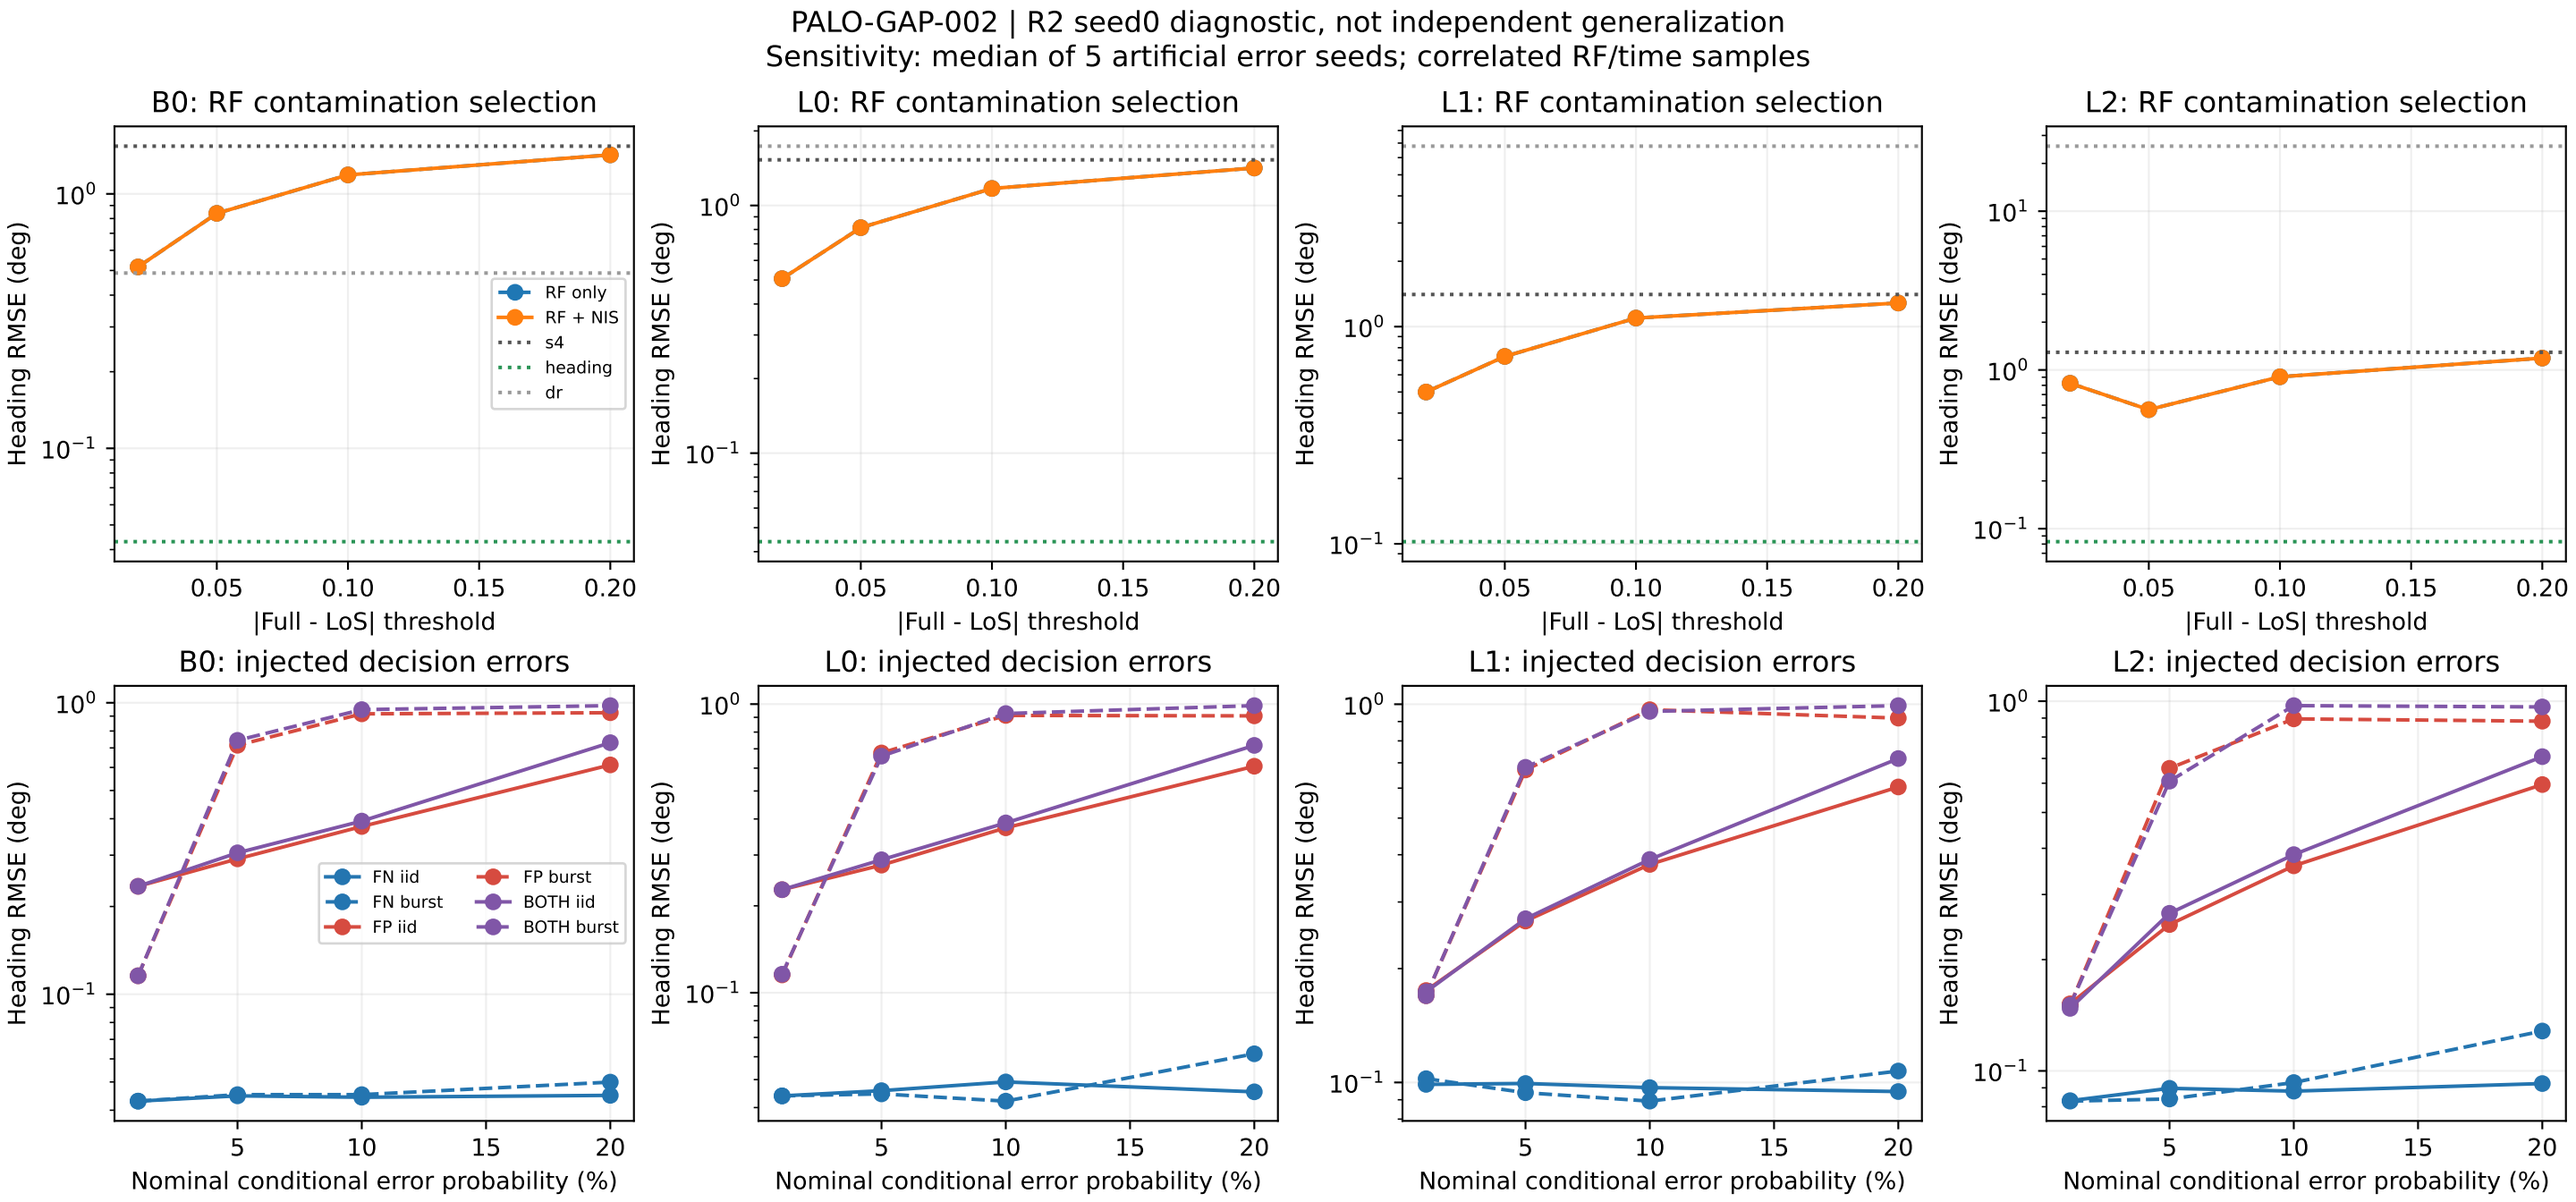
PALO-GAP-002 | R2 seed0 diagnostic, not independent generalization
Sensitivity: median of 5 artificial error seeds; correlated RF/time samples
B0: RF contamination selection
L0: RF contamination selection
L1: RF contamination selection
L2: RF contamination selection
Heading RMSE (deg)
|Full - LoS| threshold
RF only
RF + NIS
s4
heading
dr
B0: injected decision errors
L0: injected decision errors
L1: injected decision errors
L2: injected decision errors
Nominal conditional error probability (%)
FN iid
FN burst
FP iid
FP burst
BOTH iid
BOTH burst