

GRID SYSTEM OPERATOR



Substation: ABU BAKAR BAGINDA

Mnemonic: ABBA

Voltage: 132kV

Drawing No: 1-A-ABBA-335

PMU Comm. Date: 2nd. JAN. 2000

Date Updated: 10th. OCT. 2023

Revision: 2/23

Area: KUALA LUMPUR


PLC: 3530

Telephone: —

Drawn by: YUSFAUZAN

Checked by: HAMIZAH

Approved by: HAFZANIZAM

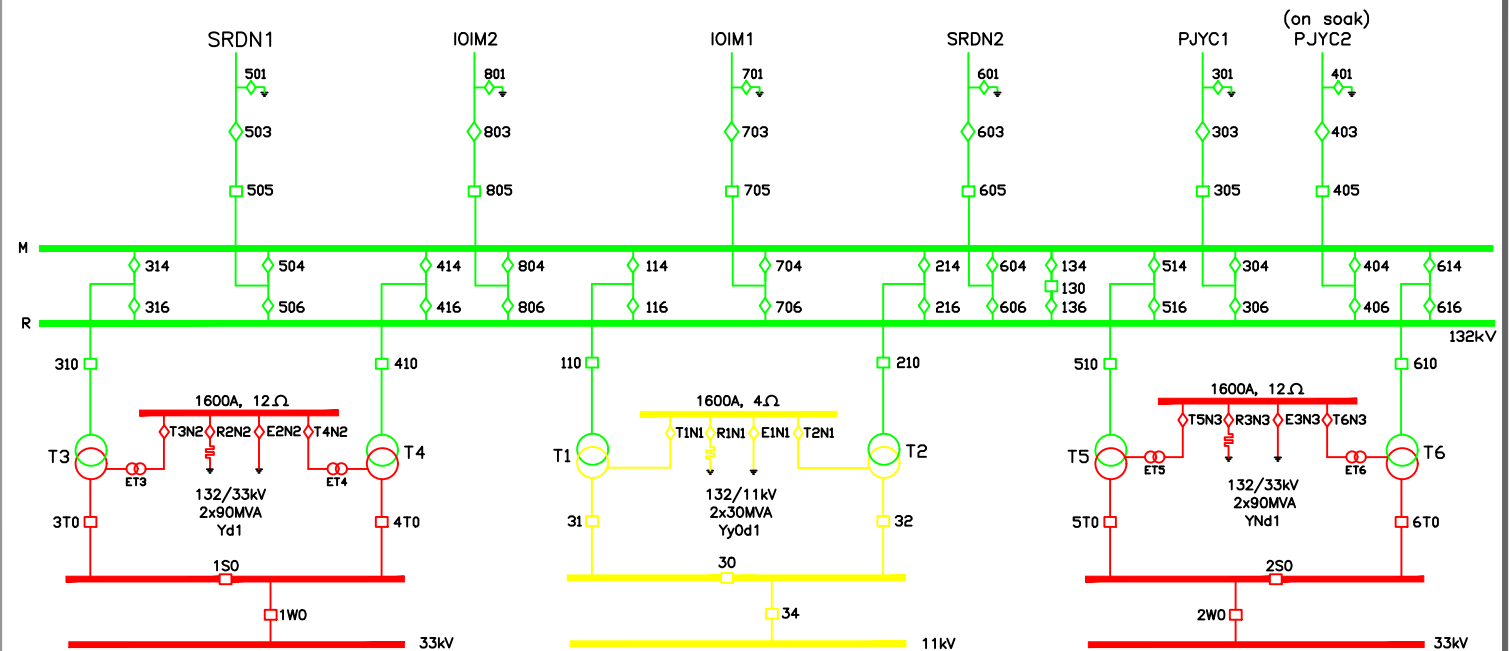

Transformer Rating

132/33kV	2x90 MVA	180	Yd1
132/33kV	2x90 MVA	Total Cap.: 180	Vector Group: YNd1
132/11kV	2x30 MVA	60	Yy0d1

Commissioning Date

T1	29/03/00	T2	29/03/00
T3	29/03/00	T4	29/03/00
T5	27/09/13	T6	27/09/13

REMARKS:

- 1/13- Feeder to SRDN2 was comm. on 24/6/12.
- 2/13- Feeder to SRDN1 was comm. on 22/3/13.
- 3/13- Future T5 & T6 added.
- 4/13- T5 & T6 was comm.(on soak bay) on 27/9/13.
- 1/15- T5 & T6 was fully comm.on 20/1/15.
- 1/22- SLD has been updated as per new format.
- 2/22- Future IOIM has been added.
- 1/23- Line ABBA-IOIM2 has been successfully comm. on 29Sep23
- 2/23- Line ABBA-IOIM1 has been successfully comm. on 9/10/23

1-A-ABBA-335

RESTRICTED