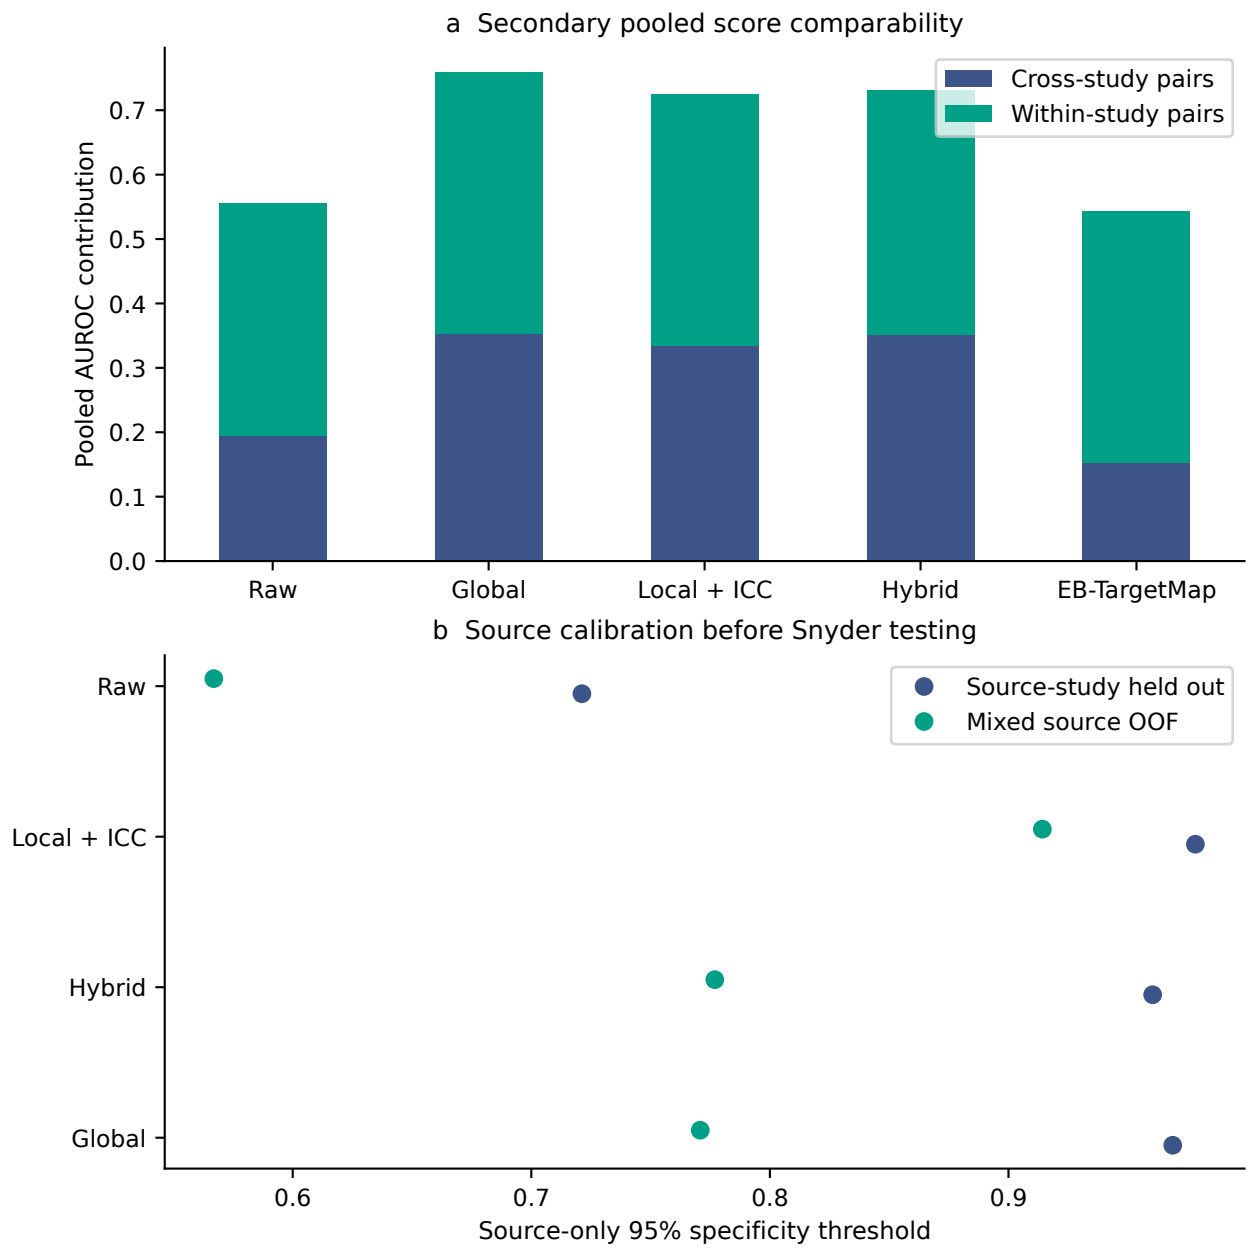
a Secondary pooled score comparability
Cross-study pairs
Within-study pairs
Pooled AUROC contribution
0.0
0.1
0.2
0.3
0.4
0.5
0.6
0.7
Raw
Global
Local + ICC
Hybrid
EB-TargetMap
b Source calibration before Snyder testing
Source-study held out
Mixed source OOF
Raw
Local + ICC
Hybrid
Global
0.6
0.7
0.8
0.9
Source-only 95% specificity threshold