

BESS OPERATIONS REPORT

March 2026

Site / Project:	Tashkent BESS
Reporting Period:	01 March 2026 — 01 April 2026
Total Devices:	140 containers (LC200 units)
Report Generated:	2026-05-15 10:34
Report Type:	Monthly Operations & Performance Summary

This report has been automatically generated from SCADA system exports.

Summary Executive Summary

89.6%

Raw Availability

90.8%

Technical Availability

140

Active Containers

0 MWh

Energy Exported

0.54%

Fault Rate

0

Production Alarms

0

Warnings

0

Comm. Alarms

During **01 March 2026 — 01 April 2026**, the Tashkent BESS BESS system maintained an overall technical availability of **90.82%** (below the 95% target). **140 LC200 containers** were monitored. Energy exported: **0.0 MWh**, imported: **0.0 MWh**. Net export: **0.0 MWh**. Total alarm events: **0**.

Availability System Availability

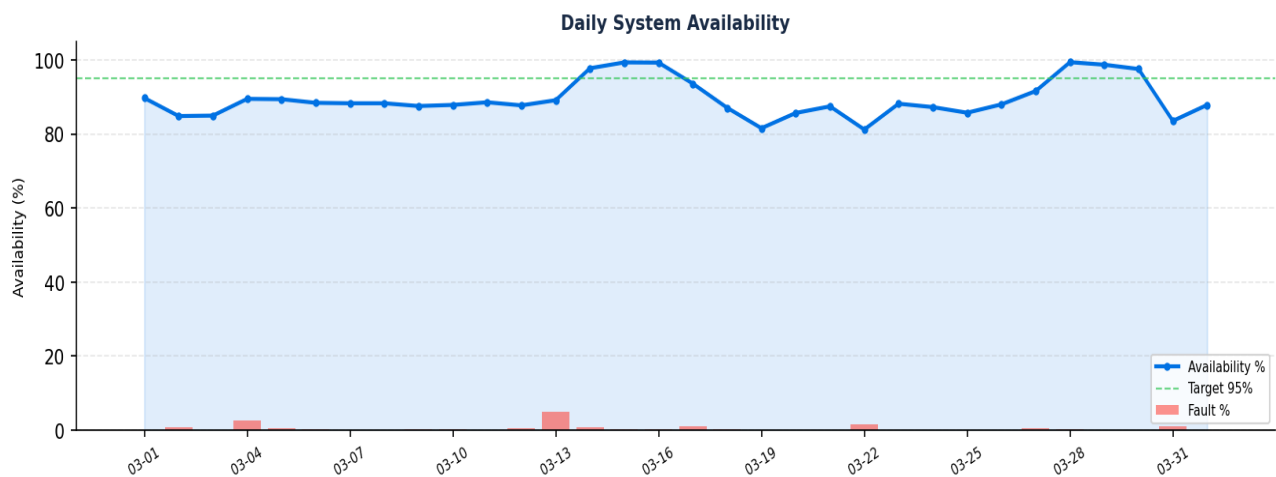


Figure 1: Daily system availability (%) and fault rate (%)

Status	% of Time	Avg Hours/Device	Description
RUNNING	49.3%	367 hrs	Active operation
STANDBY	40.3%	299 hrs	Ready, not operating
FAULT	0.54%	4 hrs	System fault
STOPPED	1.22%	9 hrs	Manually stopped
AVAILABILITY	89.59%	—	Running + Standby

Date	Availability	Fault Rate	Status
2026-03-01	89.7%	0.00%	Low
2026-03-02	84.9%	0.68%	Low

Date	Availability	Fault Rate	Status
2026-03-03	85.0%	0.00%	Low
2026-03-04	89.5%	2.74%	Low
2026-03-05	89.4%	0.48%	Low
2026-03-06	88.4%	0.36%	Low
2026-03-07	88.3%	0.06%	Low
2026-03-08	88.3%	0.00%	Low
2026-03-09	87.6%	0.39%	Low
2026-03-10	87.9%	0.33%	Low
2026-03-11	88.6%	0.00%	Low
2026-03-12	87.7%	0.54%	Low
2026-03-13	89.1%	5.09%	Low
2026-03-14	97.8%	0.77%	OK
2026-03-15	99.3%	0.30%	OK
2026-03-16	99.3%	0.42%	OK
2026-03-17	93.6%	1.04%	Low
2026-03-18	87.1%	0.21%	Low
2026-03-19	81.6%	0.00%	Low
2026-03-20	85.7%	0.00%	Low
2026-03-21	87.5%	0.00%	Low
2026-03-22	81.2%	1.61%	Low
2026-03-23	88.2%	0.06%	Low
2026-03-24	87.3%	0.00%	Low
2026-03-25	85.7%	0.00%	Low
2026-03-26	88.0%	0.00%	Low
2026-03-27	91.6%	0.62%	Low
2026-03-28	99.4%	0.18%	OK
2026-03-29	98.7%	0.00%	OK
2026-03-30	97.6%	0.06%	OK
2026-03-31	83.5%	0.95%	Low

Exclusions Availability Exclusions

2 exclusion event(s) recorded during the period, totaling **1,404** excluded device-hours. These hours are removed from the technical availability calculation as they represent downtime caused by external factors or planned activities.

Exclusion Breakdown by Type

Exclusion Type	Device-Hours	% of Excluded
Scheduled Maintenance	562 device-hours	40.1%
Grid Outage	842 device-hours	60.0%

Exclusion Event Detail

Type	From	To	Blocks	Description
Scheduled Maintenance	2026-03-10 08:00	2026-03-10 12:00	All blocks	Q1 BMS firmware update
Grid Outage	2026-03-18 22:00	2026-03-19 04:00	All blocks	Utility-side trip

Capacity Capacity Availability (per LC, per cycle)

This metric assesses whether each LC delivered its contracted charge / discharge cycles. **Cycles completed** per LC per day = min(daily charge, daily discharge) ÷ per-cycle capacity. Two divisors are shown side-by-side: **operational** (4,954 kWh, 5–95% SOC, current operating window) and **nameplate** (5,504 kWh, 0–100% SOC). Daily cycle target is sourced from the cycle-targets file (default: 1). Per-day availability is capped at 100% so multi-cycle days do not inflate the metric.

76.7%	71.0%	1.37	140
Capacity Avail. (Operational, 5–95%)	Capacity Avail. (Nameplate, 0–100%)	Avg cycles / LC / day	LCs analysed

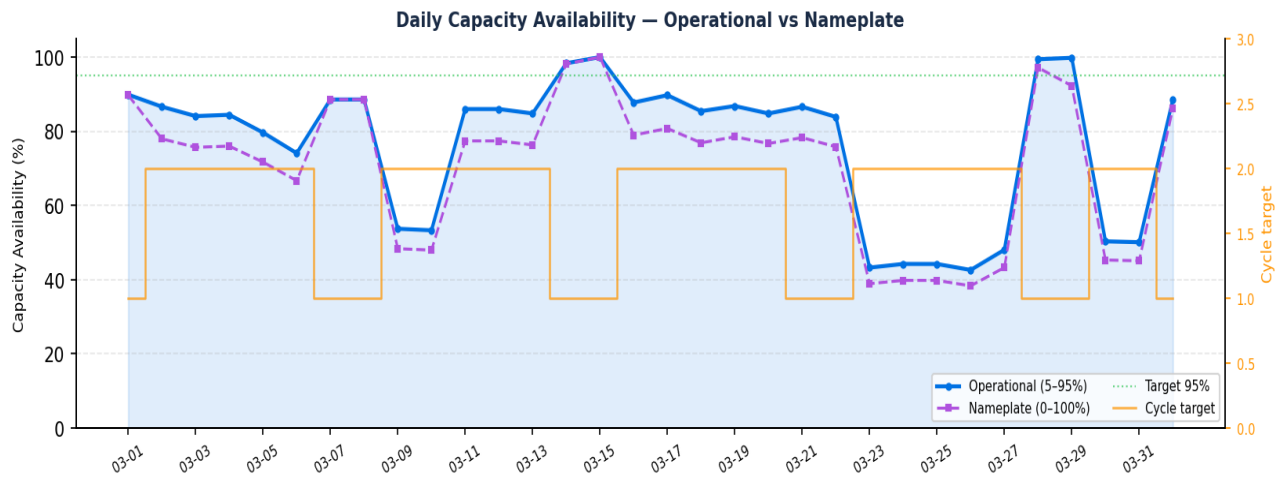


Figure 1b: Daily fleet-wide capacity availability — operational (5–95%) and nameplate (0–100%) divisors, with cycle target on the right axis.

Daily Capacity Detail (fleet average)

Date	Target	Charge MWh	Discharge MWh	Cycles done/target	Avail Op.	Avail Np.	Status
2026-03-01	1	1,274.7	1,194.2	1.72 / 1	89.9%	89.8%	Low
2026-03-02	2	1,289.2	1,201.5	1.73 / 2	86.6%	78.0%	Low

Date	Target	Charge MWh	Discharge MWh	Cycles done/target	Avail Op.	Avail Np.	Status
2026-03-03	2	1,327.9	1,166.3	1.68 / 2	84.1%	75.7%	Low
2026-03-04	2	1,327.0	1,171.2	1.69 / 2	84.4%	76.0%	Low
2026-03-05	2	1,189.3	1,112.1	1.59 / 2	79.7%	71.7%	Low
2026-03-06	2	1,112.2	1,027.8	1.48 / 2	74.1%	66.7%	Low
2026-03-07	1	1,117.2	1,020.3	1.47 / 1	88.6%	88.6%	Low
2026-03-08	1	1,117.3	1,018.5	1.47 / 1	88.6%	88.6%	Low
2026-03-09	2	788.8	745.2	1.07 / 2	53.7%	48.4%	Low
2026-03-10	2	823.5	742.3	1.07 / 2	53.3%	48.0%	Low
2026-03-11	2	1,236.9	1,192.8	1.72 / 2	86.0%	77.4%	Low
2026-03-12	2	1,236.9	1,192.8	1.72 / 2	86.0%	77.4%	Low
2026-03-13	2	1,213.5	1,199.6	1.70 / 2	84.8%	76.3%	Low
2026-03-14	1	1,386.5	1,319.3	1.89 / 1	98.3%	98.1%	OK
2026-03-15	1	1,415.8	1,296.0	1.87 / 1	100.0%	100.0%	OK
2026-03-16	2	1,347.3	1,221.8	1.76 / 2	87.8%	79.0%	Low
2026-03-17	2	1,349.4	1,244.7	1.79 / 2	89.7%	80.8%	Low
2026-03-18	2	1,307.3	1,184.9	1.71 / 2	85.4%	76.9%	Low
2026-03-19	2	1,318.3	1,210.0	1.74 / 2	86.8%	78.5%	Low
2026-03-20	2	1,295.5	1,182.1	1.70 / 2	84.8%	76.7%	Low
2026-03-21	1	658.7	605.6	0.87 / 1	86.6%	78.3%	Low
2026-03-22	1	668.7	611.5	0.84 / 1	83.9%	75.8%	Low
2026-03-23	2	672.2	600.5	0.87 / 2	43.3%	38.9%	Low
2026-03-24	2	667.7	613.8	0.89 / 2	44.3%	39.8%	Low
2026-03-25	2	665.0	613.6	0.88 / 2	44.2%	39.8%	Low
2026-03-26	2	659.7	591.1	0.85 / 2	42.6%	38.4%	Low
2026-03-27	2	876.6	668.9	0.96 / 2	48.1%	43.3%	Low
2026-03-28	1	901.4	749.8	1.08 / 1	99.4%	97.2%	OK
2026-03-29	1	754.1	711.9	1.03 / 1	99.8%	92.3%	OK
2026-03-30	2	755.2	698.2	1.01 / 2	50.3%	45.3%	Low
2026-03-31	2	759.3	857.6	1.00 / 2	50.1%	45.1%	Low
2026-04-01	1	666.1	901.7	0.96 / 1	88.6%	86.1%	Low

Lowest-availability LCs over the period (operational, 5–95%)

LC	Avg Avail Op.	Avg Avail Np.	Period Charge (MWh)	Period Discharge (MWh)
LC200 45.02	60.6%	55.7%	179.68	168.74

LC	Avg Avail Op.	Avg Avail Np.	Period Charge (MWh)	Period Discharge (MWh)
LC200 45.01	61.0%	56.1%	181.03	169.96
LC200 41.01	61.5%	56.8%	186.28	174.77
LC200 47.01	61.6%	56.8%	186.02	174.82
LC200 46.02	61.7%	56.9%	186.28	175.03
LC200 44.02	61.7%	56.9%	185.87	174.70
LC200 42.01	61.7%	56.9%	186.36	175.25
LC200 46.01	61.7%	56.9%	186.39	175.24
LC200 41.02	61.7%	57.0%	186.79	175.57
LC200 44.01	61.7%	57.0%	186.16	174.83

Charge/Discharge Charge / Discharge Operations

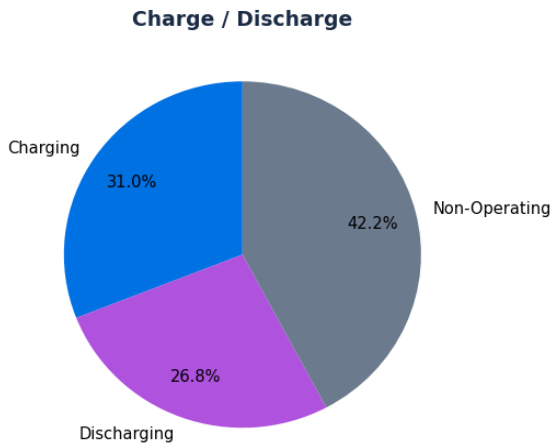
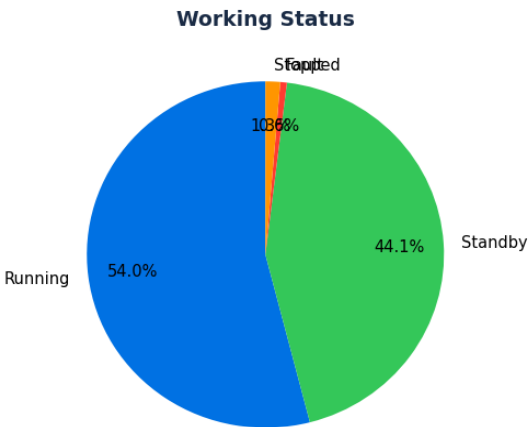


Figure 2: Working status and charge/discharge distribution

Mode	% of Time	Avg Hours/Device	Description
CHARGING	31.0%	230 hrs	Grid to battery
DISCHARGING	26.8%	200 hrs	Battery to grid
NON-OPERATING	42.2%	—	Idle / standby mode

Energy Energy Performance

0.0 Total Exported (MWh)	0.0 Total Imported (MWh)	0.0 Net Export (MWh)
------------------------------------	------------------------------------	--------------------------------

Alarms Alarm & Fault Analysis

0	0	0	0
Production Alarms	Warning Alarms	Comm. Alarms	Total Events

Conclusions Conclusions & Observations

- 1. System availability of **89.59%** was recorded — below the 95% target.
- 2. All **140 LC200 containers** monitored. Fault rate: **0.54%**.
- 3. Energy: **0.0 MWh exported, 0.0 MWh imported**. Net: 0.0 MWh export.
- 4. Total alarm events: **0**. Production: 0, Warnings: 0, Comms: 0.