

BESS OPERATIONS REPORT

March 2026

Site / Project:	Tashkent BESS
Reporting Period:	01 March 2026 — 01 April 2026
Total Devices:	140 containers (LC200 units)
Report Generated:	2026-05-05 06:30
Report Type:	Monthly Operations & Performance Summary

This report has been automatically generated from SCADA system exports. All data reflects actual measurements recorded by the system monitoring platform.

■ Executive Summary

89.6% System Availability	140 Active Containers	0 MWh Energy Exported	0 MWh Energy Imported
0.54% Fault Rate	0 Production Alarms	0 Warnings	0 Comm. Alarms
76.7% Capacity Avail. (Operational, 5–95%)	71.0% Capacity Avail. (Nameplate, 0–100%)	1.37 Avg cycles / LC / day	30,868 MWh Total Fleet Discharge

During the reporting period **01 March 2026 — 01 April 2026**, the Tashkent BESS BESS system maintained an overall availability of **89.59%**, which is below the 95% target threshold. A total of **140 LC200 containers** were monitored. The system exported **0.0 MWh** and imported **0.0 MWh** of energy, resulting in a net export of **0.0 MWh**. A total of **0** alarm events were recorded, including 0 production-impacting alarms.

■ System Availability

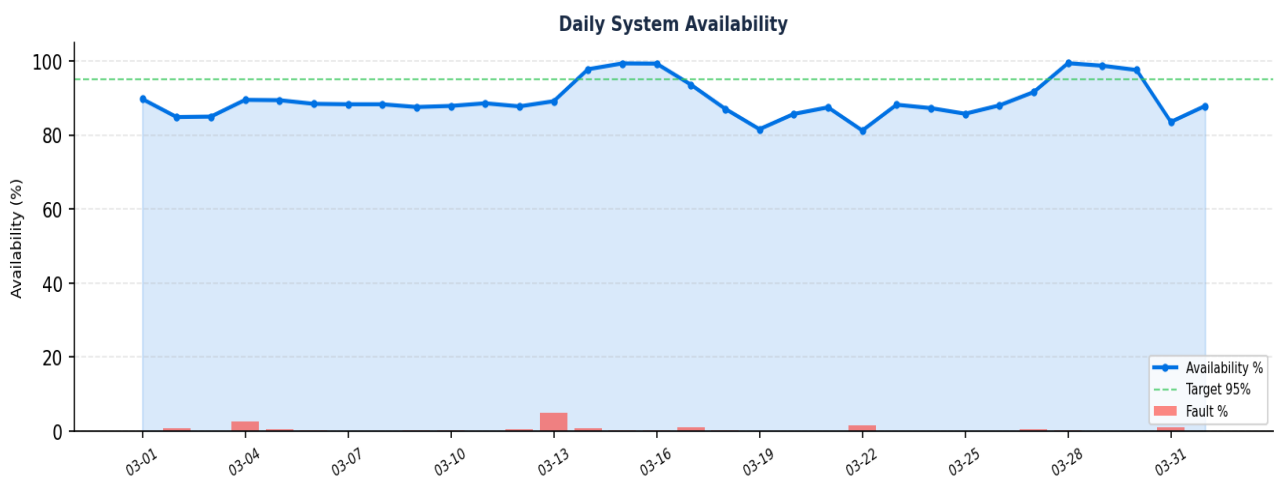


Figure 1: Daily system availability (%) and fault rate (%)

Status	% of Time	Avg Hours/Device	Description
RUNNING	49.3%	367 hrs	Active operation
STANDBY	40.3%	299 hrs	Ready, not operating

Status	% of Time	Avg Hours/Device	Description
FAULT	0.54%	4 hrs	System fault detected
STOPPED	1.22%	9 hrs	Manually stopped
AVAILABILITY	89.59%	—	Running + Standby

Daily Availability Detail

Date	Availability	Fault Rate	Status
2026-03-01	89.7%	0.00%	■ Low
2026-03-02	84.9%	0.68%	■ Low
2026-03-03	85.0%	0.00%	■ Low
2026-03-04	89.5%	2.74%	■ Low
2026-03-05	89.4%	0.48%	■ Low
2026-03-06	88.4%	0.36%	■ Low
2026-03-07	88.3%	0.06%	■ Low
2026-03-08	88.3%	0.00%	■ Low
2026-03-09	87.6%	0.39%	■ Low
2026-03-10	87.9%	0.33%	■ Low
2026-03-11	88.6%	0.00%	■ Low
2026-03-12	87.7%	0.54%	■ Low
2026-03-13	89.1%	5.09%	■ Low
2026-03-14	97.8%	0.77%	✓ OK
2026-03-15	99.3%	0.30%	✓ OK
2026-03-16	99.3%	0.42%	✓ OK
2026-03-17	93.6%	1.04%	■ Low
2026-03-18	87.1%	0.21%	■ Low
2026-03-19	81.6%	0.00%	■ Low
2026-03-20	85.7%	0.00%	■ Low
2026-03-21	87.5%	0.00%	■ Low
2026-03-22	81.2%	1.61%	■ Low
2026-03-23	88.2%	0.06%	■ Low
2026-03-24	87.3%	0.00%	■ Low
2026-03-25	85.7%	0.00%	■ Low
2026-03-26	88.0%	0.00%	■ Low
2026-03-27	91.6%	0.62%	■ Low
2026-03-28	99.4%	0.18%	✓ OK

Date	Availability	Fault Rate	Status
2026-03-29	98.7%	0.00%	✓ OK
2026-03-30	97.6%	0.06%	✓ OK
2026-03-31	83.5%	0.95%	■ Low

■ Charge / Discharge Operations

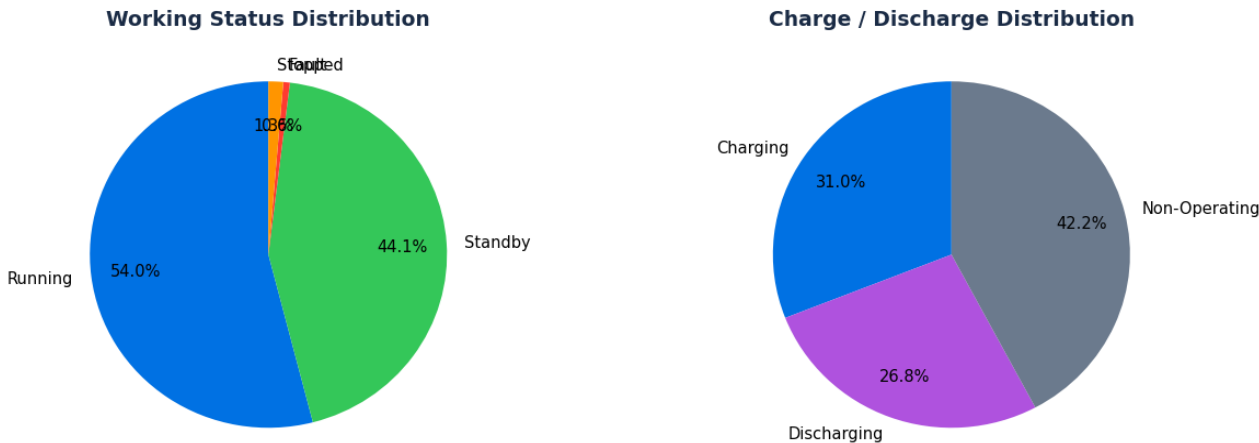


Figure 2: Working status distribution and charge/discharge split

Mode	% of Time	Avg Hours/Device	Description
CHARGING	31.0%	230 hrs	Grid to battery
DISCHARGING	26.8%	200 hrs	Battery to grid
NON-OPERATING	42.2%	—	Standby / idle mode

■ Capacity Availability (per LC, per cycle)

This metric assesses whether each LC delivered its contracted daily charge / discharge cycles. **Cycles completed** per LC per day = $\min(\text{daily charge, daily discharge}) \div \text{per-cycle capacity}$. Two divisors are shown side-by-side: **operational** (4,954 kWh, 5–95% SOC, current operating window) and **nameplate** (5,504 kWh, 0–100% SOC). Daily cycle target is sourced from the cycle-targets file (default: 1). Per-day availability is capped at 100% so multi-cycle days do not inflate the metric.

76.7% Capacity Avail. (Operational, 5–95%)	71.0% Capacity Avail. (Nameplate, 0–100%)	1.37 Avg cycles/LC/day (operational)	140 LCs analysed
---	--	---	----------------------------

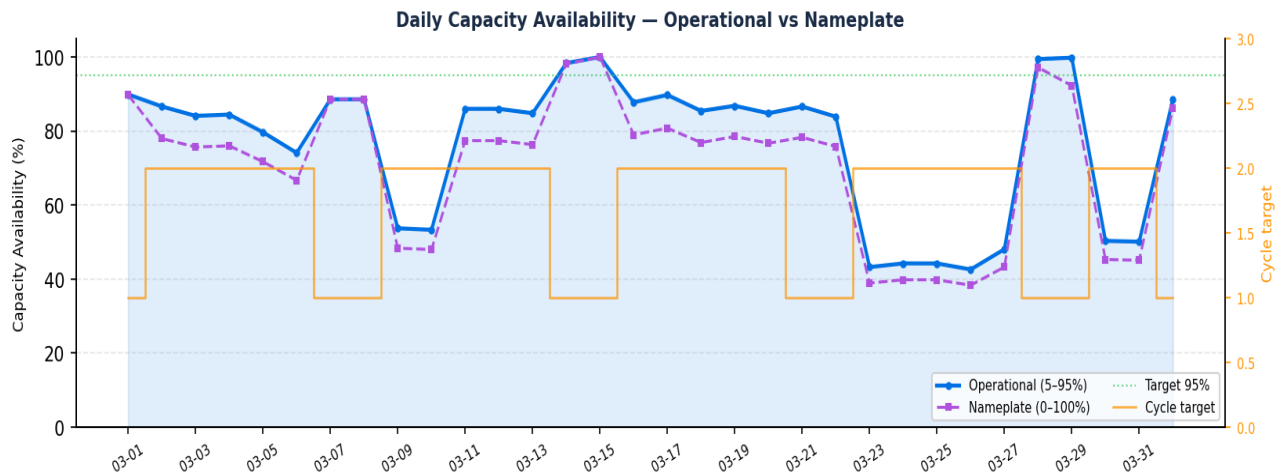


Figure 2b: Daily fleet-wide capacity availability — operational (5–95%) and nameplate (0–100%) divisors, with daily cycle target shown on the right axis.

Daily Capacity Detail (fleet average)

Date	Target	Charge MWh	Discharge MWh	Cycles done/target	Avail Op.	Avail Np.	Status
2026-03-01	1	1,274.7	1,194.2	1.72 / 1	89.9%	89.8%	■ Low
2026-03-02	2	1,289.2	1,201.5	1.73 / 2	86.6%	78.0%	■ Low
2026-03-03	2	1,327.9	1,166.3	1.68 / 2	84.1%	75.7%	■ Low
2026-03-04	2	1,327.0	1,171.2	1.69 / 2	84.4%	76.0%	■ Low
2026-03-05	2	1,189.3	1,112.1	1.59 / 2	79.7%	71.7%	■ Low
2026-03-06	2	1,112.2	1,027.8	1.48 / 2	74.1%	66.7%	■ Low
2026-03-07	1	1,117.2	1,020.3	1.47 / 1	88.6%	88.6%	■ Low
2026-03-08	1	1,117.3	1,018.5	1.47 / 1	88.6%	88.6%	■ Low
2026-03-09	2	788.8	745.2	1.07 / 2	53.7%	48.4%	■ Low
2026-03-10	2	823.5	742.3	1.07 / 2	53.3%	48.0%	■ Low
2026-03-11	2	1,236.9	1,192.8	1.72 / 2	86.0%	77.4%	■ Low
2026-03-12	2	1,236.9	1,192.8	1.72 / 2	86.0%	77.4%	■ Low
2026-03-13	2	1,213.5	1,199.6	1.70 / 2	84.8%	76.3%	■ Low
2026-03-14	1	1,386.5	1,319.3	1.89 / 1	98.3%	98.1%	✓ OK
2026-03-15	1	1,415.8	1,296.0	1.87 / 1	100.0%	100.0%	✓ OK
2026-03-16	2	1,347.3	1,221.8	1.76 / 2	87.8%	79.0%	■ Low
2026-03-17	2	1,349.4	1,244.7	1.79 / 2	89.7%	80.8%	■ Low
2026-03-18	2	1,307.3	1,184.9	1.71 / 2	85.4%	76.9%	■ Low
2026-03-19	2	1,318.3	1,210.0	1.74 / 2	86.8%	78.5%	■ Low
2026-03-20	2	1,295.5	1,182.1	1.70 / 2	84.8%	76.7%	■ Low
2026-03-21	1	658.7	605.6	0.87 / 1	86.6%	78.3%	■ Low

Date	Target	Charge MWh	Discharge MWh	Cycles done/target	Avail Op.	Avail Np.	Status
2026-03-22	1	668.7	611.5	0.84 / 1	83.9%	75.8%	■ Low
2026-03-23	2	672.2	600.5	0.87 / 2	43.3%	38.9%	■ Low
2026-03-24	2	667.7	613.8	0.89 / 2	44.3%	39.8%	■ Low
2026-03-25	2	665.0	613.6	0.88 / 2	44.2%	39.8%	■ Low
2026-03-26	2	659.7	591.1	0.85 / 2	42.6%	38.4%	■ Low
2026-03-27	2	876.6	668.9	0.96 / 2	48.1%	43.3%	■ Low
2026-03-28	1	901.4	749.8	1.08 / 1	99.4%	97.2%	✓ OK
2026-03-29	1	754.1	711.9	1.03 / 1	99.8%	92.3%	✓ OK
2026-03-30	2	755.2	698.2	1.01 / 2	50.3%	45.3%	■ Low
2026-03-31	2	759.3	857.6	1.00 / 2	50.1%	45.1%	■ Low
2026-04-01	1	666.1	901.7	0.96 / 1	88.6%	86.1%	■ Low

Lowest-availability LCs over the period (operational, 5–95%)

LC	Avg Avail Op.	Avg Avail Np.	Period Charge (MWh)	Period Discharge (MWh)
LC200 45.02	60.6%	55.7%	179.68	168.74
LC200 45.01	61.0%	56.1%	181.03	169.96
LC200 41.01	61.5%	56.8%	186.28	174.77
LC200 47.01	61.6%	56.8%	186.02	174.82
LC200 46.02	61.7%	56.9%	186.28	175.03
LC200 44.02	61.7%	56.9%	185.87	174.70
LC200 42.01	61.7%	56.9%	186.36	175.25
LC200 46.01	61.7%	56.9%	186.39	175.24
LC200 41.02	61.7%	57.0%	186.79	175.57
LC200 44.01	61.7%	57.0%	186.16	174.83

■ Energy Performance

0.0 Total Exported (MWh)	0.0 Total Imported (MWh)	0.0 Net Export (MWh)
-----------------------------	-----------------------------	-------------------------

■ Alarm & Fault Analysis

0	0	0	0
Production Alarms	Warning Alarms	Communication Alarms	Total Events

■ Conclusions & Observations

1. System availability of **89.59%** was recorded for the period — below the 95% contractual target.
2. All **140 LC200 containers** were monitored throughout the period. Fault rate was maintained at **0.54%**.
3. Capacity availability — **76.68%** (operational, 5–95%) and **71.02%** (nameplate, 0–100%). Fleet averaged **1.37** cycles per LC per day. Total discharge across the fleet: **30,868 MWh**.
4. Energy performance: **0.0 MWh exported** and **0.0 MWh imported**. Net export: 0.0 MWh.
5. A total of **0 alarm events** were recorded. Production-impacting alarms: 0. Warning alarms: 0.
6. Communication events: 0 brief connection drops recorded, all self-recovered without manual intervention.