# Hotel Schematic Proposal

Program, planning-level layout, code screen and open questions

RNGD side project — prototype output, not for construction

October 5, 2026

## 1 Summary

Program: 117 guest keys in 21 rows, 59,350 SF net shared/BOH/guest area, across six levels. Source gross area: 74,195 SF. Planning-level schematic: five upper levels of double-loaded corridor, each with a core at the west end. The schematic fails two screens from RNGD's own IBC rule set: six stories above grade (rule limit five) and a dead-end corridor of about 183 ft (limit 50 ft). These are design findings, not code determinations.

## 2 Program

| Room type | Count | Area (SF) | Category |
|---|---|---|---|
| ADA Corner Suite | 1 | 852 | guest |
| ADA King Spa | 2 | 920 | guest |
| ADA QQ | 2 | 892 | guest |
| ADA Suite | 2 | 1,278 | guest |
| Corner Suite | 2 | 1,728 | guest |
| King | 69 | 23,692 | guest |
| King Spa | 3 | 1,379 | guest |
| QQ | 33 | 11,342 | guest |
| Suite | 3 | 1,920 | guest |
| Corridor | 1 | 1,335 | shared |
| Gym | 1 | 968 | shared |
| Lobby | 1 | 2,865 | shared |
| Restrooms (M/W) | 1 | 405 | shared |
| Luggage | 1 | 122 | shared |
| BOH / Bus | 1 | 1,718 | boh |
| Hotel Kitchen / Pantry | 1 | 331 | boh |
| BOH storage (BOH, Housekeeping, Janitor, Ice, IT, Supplies) | 1 | 1,611 | boh |
| Loading | 1 | 282 | boh |
| MEP Service | 1 | 309 | boh |
| Stairs | 1 | 1,868 | core |
| White Box Retail (tenant) | 1 | 3,533 | tenant |

Source: Project Renegade Living + Lodging Prototype, cover sheet (06/20/25). Guest-room areas are type averages (type total divided by count). Source subtotals reconcile to 59,350 SF; the table sums to 59,350 SF because of one-square-foot rounding in the source.

# 3 Gross area and net-to-gross

| Level | Gross SF (source) |
|---|---|
| Level 1 | 12,485 |
| Level 2 | 12,342 |
| Level 3 | 12,342 |
| Level 4 | 12,342 |
| Level 5 | 12,342 |
| Level 6 | 12,342 |
| Total | 74,195 |

Source ratio gross/net: 1.25. Meeting-derived rule (33% circulation, 8% wall burden, rounded up to 100 SF): 85,300 SF. These rules were stated in the kickoff meeting, not confirmed by RNGD, and are shown as a comparison only.

# 4 Schematic

Envelope: 170 x 265 ft (synthetic, pending the real lot). Each upper level is one double-loaded wing: rooms on both sides of a 6-ft corridor, room depth 26 ft, width from the type area, core (two stairs and elevators) at the west end. Guest-room types are placed in the order of area, so suites are spread across levels.

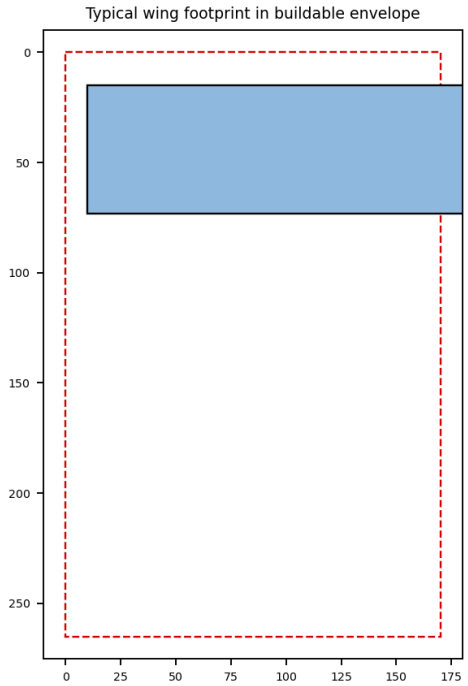



Figure 1: Wing footprint in the buildable envelope.

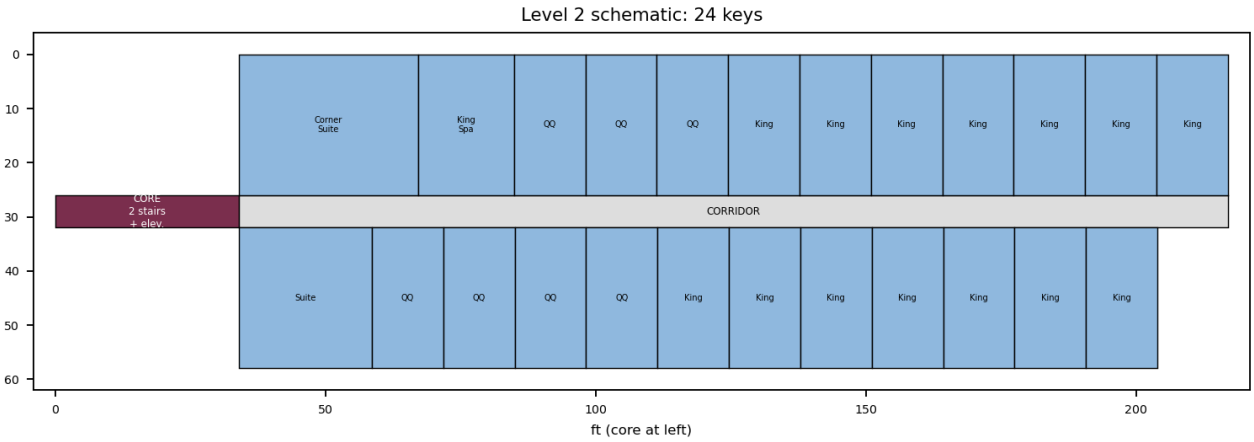



Figure 2: Level 2: 24 guest keys, wing 217 x 58 ft.

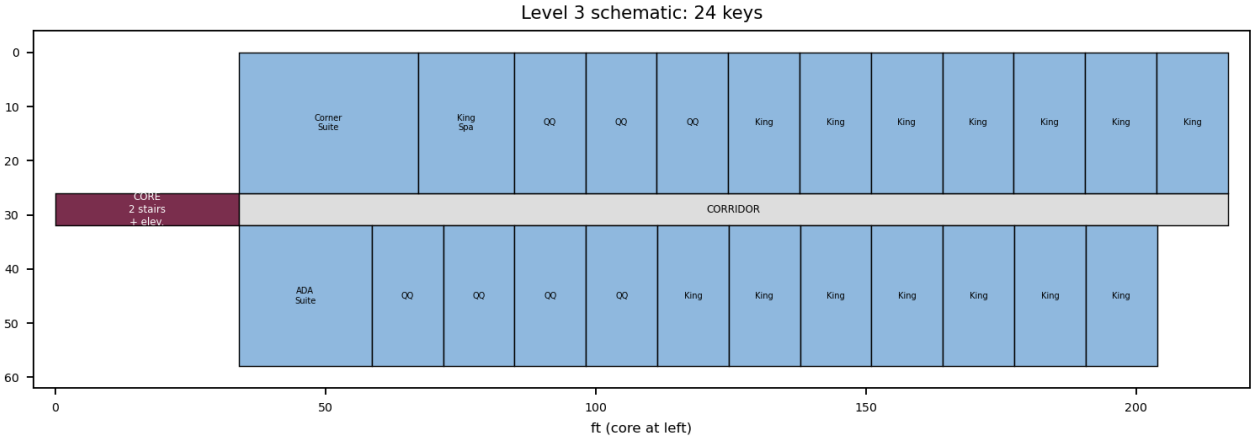



Figure 3: Level 3: 24 guest keys, wing 217 x 58 ft.

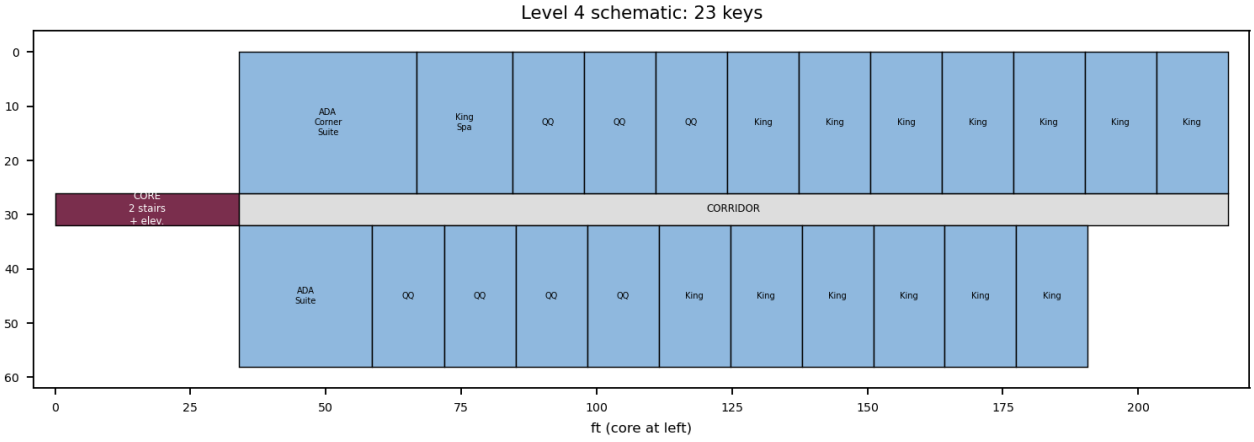



Figure 4: Level 4: 23 guest keys, wing 217 x 58 ft.

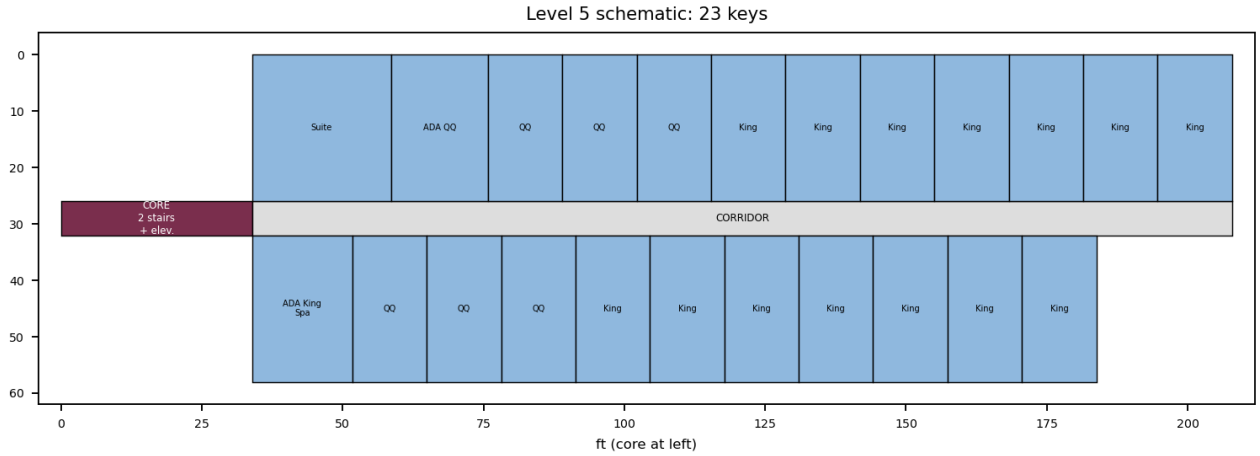



Figure 5: Level 5: 23 guest keys, wing 208 x 58 ft.

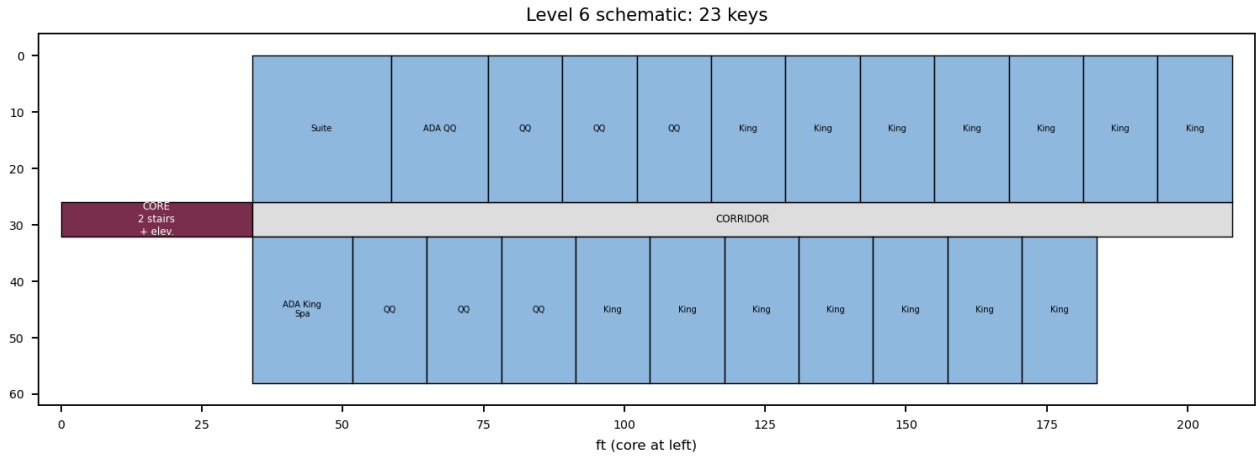



Figure 6: Level 6: 23 guest keys, wing 208 x 58 ft.

# 5 Code and program screen

Checks use the IBC rule subset in RNGD's rule database (2021 IBC, Type IIA sprinklered R-1 hotel). The overall planning screen is not a code determination.

| Check | Required | Provided | Status |
|---|---|---|---|
| Keys placed | 117 | 117 | PASS |
| Stories above grade | $\leq$ 5 (IBC-R1-007, Type IIA sprinklered R-1) | 6 | FAIL |
| Building height (ft) | $\leq$ 85 (IBC-R1-005, Type IIA) | 66.5 | PASS |
| Dead-end corridor (ft) | $\leq$ 50 (IBC-R1-027) | 183 | FAIL |
| Exit travel distance (ft) | $\leq$ 250 (IBC-R1-023) | 183 | PASS |
| Fits buildable envelope | 170 x 265 ft | 217 x 58 ft | PASS |

# 6 Assumptions

- Synthetic lot and envelope (170 x 265 ft). The real site and setbacks are not yet supplied.
- Corridor double-loaded, 6 ft clear; room depth 26 ft; core 34 x 24 ft; two stairs per core.
- Ground level shows program area only (no room layout). Parking is not modeled.
- Accessible rooms, fire lane and fire access are not modeled. Code parameters from the R-1 rule set only.
- Keys are split evenly across five upper levels in order of area.

# 7 Open questions

1. **Which area of the Level 1 and Level 2 drawing was meant?** The reference coordinate note (scale 1.08 to original image) did not identify a room, stair or gridline. Please mark the spot.
2. Confirm circulation (33%) and wall burden (8%) percentages, or give RNGD's own factors.
3. Confirm the real lot geometry, setbacks and fire-lane requirements.
4. Confirm story limit: the prototype shows six levels above grade, and the R-1 rule set allows five for Type IIA.
5. Confirm dead-end corridor treatment: a second core or a shorter corridor.
6. Confirm whether the program should include parking and which ADA room counts apply.

# 8 Sources

- Project Renegade Living + Lodging Prototype, cover sheet and plans, 06/20/25 (Scheme 2 folder).
- RNGD IBC 2021 R1 five-story rule database (docs/RNGD_IBC_2021_R1_Five_Story_AI_Rules_v0_2.csv).
- Kickoff meeting transcript (circulation and wall-burden rules; egress and column-grid discussion).
- RNGD Product Requirements Document (hotels as first use case).