ScienceX

Battery Storage Market Notes, April 2026 issue

Science X Inc. Published November 5, 2026

A grid-scale battery (a large battery connected to the transmission grid that stores electricity and releases it) earns money in two ways. It sells the "capability" to fix electricity surpluses and shortages. It also uses the price differences that come from electricity prices changing by time of day. These notes use published figures and our own records to show this month's movements in figures and tables. This issue is a back issue, produced in November 2026. The grid connection study totals are as of when we produced it (October 19, 2026).

1. Three income streams for a battery storage plant (how to read these notes)

A battery storage plant (grid-scale battery) earns income from three markets. ① The balancing market (EPRX) is where the plant sells the capability to fix electricity surpluses and shortages to grid operators. ② Wholesale electricity (JEPX) is where it buys electricity when it is cheap, stores it, and sells it when it is expensive. ③ The capacity market (OCCTO) is where the country buys future electricity supply capacity in advance. These notes present the figures in that order. The ①, ② or ③ at the start of each section title shows which market the section covers.

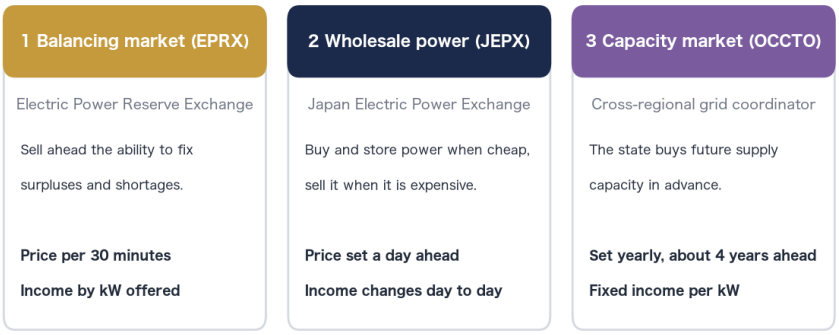


Figure 1 Three income streams for a battery storage plant

Source: Rules of the Japan Electric Power Exchange (JEPX), the Electric Power Reserve Exchange (EPRX) and the Organization for Cross-regional Coordination of Transmission Operators (OCCTO).

ScienceX

2. Three trends this month

We picked three movements this month from the figures of the three markets.

- In the balancing market (EPRX), the bid ratio for Primary reserve (online) was 74.3% this month. No month has gone above 100% yet. The average winning price was 4.27 yen/kW per 30 min.
- In the balancing market (EPRX), the top 10% of 30-minute slots by revenue accounted for 60.2% of the month's revenue for Tertiary reserve 2.
- In wholesale electricity (JEPX), the monthly average spread between the 4 most expensive hours and the 4 cheapest hours in April 2026 was 23.12 yen/kWh in Tokyo and 13.02 yen/kWh in Kyushu.

3. ① Balancing market (EPRX) | Seven products and prices by area

The balancing market is where grid operators buy the capability to fix electricity surpluses and shortages, every 30 minutes. Products are split by how fast output must change (Primary reserve responds to changes in frequency; Secondary and Tertiary reserves respond to instructions from the grid operator). Primary reserve is the fastest, and Tertiary reserve 2 is the slowest. Primary reserve senses frequency changes by itself and responds. It has two categories, "online" and "offline". Online means the grid operator monitors the response over a dedicated line. Offline means no dedicated line is installed, and a record of the response is submitted afterwards. The two categories are tendered and traded separately, so we show them separately. A Composite product is a bid that combines several products. Prices are set in yen per 1 kW of available capability per 30 minutes. kW is a unit for how much power can be delivered. It is different from kWh, which measures an amount of electricity. Each 30-minute trading round is called a "30-minute slot". The figure shows the range of winning prices by area (by the area where the power source is located). The thin line runs from the cheapest to the most expensive winning bid in the month. The thick band is the price range that holds 8 out of every 10 slots with winning bids. The dot is the average winning price. Nationwide figures are in the tables in the "Market figures" section.

By area where the power source is located, the highest average winning price in the balancing market was Primary reserve (offline) in Chubu, at 14.57 yen/kW per 30 min. The lowest was Tertiary reserve 2 in Shikoku, at 0.37 yen/kW per 30 min.



© Science X Inc. · https://www.scix.co.jp

Figure 2 Range and average of winning prices by area in the balancing market (April 2026 (1st–30th), by area where the power source is located)

Source: Trading results (preliminary) published by the Electric Power Reserve Exchange (EPRX). Our aggregation.

Product	Response time	Duration
Primary reserve (online)	Within 10 seconds	5 minutes or more
Primary reserve (offline)	Within 30 seconds	No set duration
Secondary reserve 1	Within 5 minutes	30 minutes
Secondary reserve 2	Within 5 minutes	30 minutes
Tertiary reserve 1	Within 15 minutes	30 minutes
Tertiary reserve 2	Within 60 minutes	30 minutes
Composite product	Requirements of the combined products	Requirements of the combined products

4. ① Balancing market (EPRX) | Grid areas and times where bids win more easily

The award rate is the share of the bid volume that won. The higher it is, the more easily bids win. The figure shows the award rate of each product by time of day (every 30 minutes), for each grid area (area where the power source is located). Where a line is broken, there were no bids at that time.

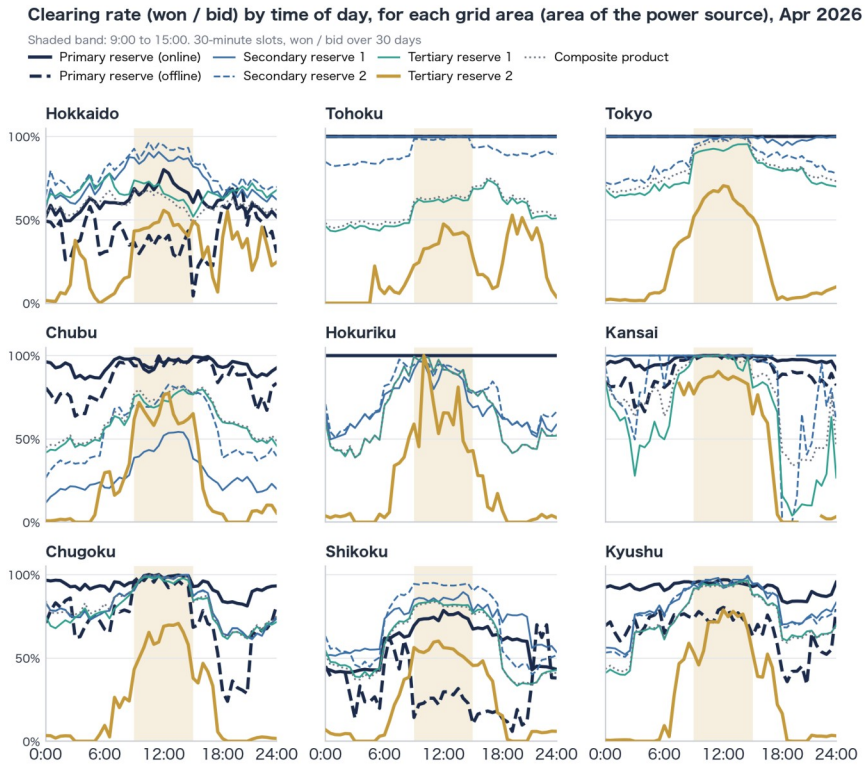


Figure 3 Award rate in the balancing market (grid area (area where the power source is located) × time of day, April 2026 (1st–30th))

Source: Trading results (preliminary) published by the Electric Power Reserve Exchange (EPRX). Our aggregation.

5. ① Balancing market (EPRX) | How full are the Primary reserve seats?

Primary reserve is the fastest product. It responds to frequency changes by changing output within 10 seconds (online) or within 30 seconds (offline). Batteries are often used for it. The left side shows the online category and the right side the offline category. The bars show the bid ratio (bid volume ÷ volume requested by grid operators). Above 100% means more bids came in than were requested. Even below 100%, some bids do not win (see the award rate in the "Market figures" table). The bars rise when bids increase, and also when the requested volume falls. The line is the average winning price. These are monthly figures from April 2025, the data we have.

For Primary reserve (online) in the balancing market, this month's bid ratio was 74.3% (no month has gone above 100% yet), and the average winning price was 4.27 yen/kW per 30 min. The requested volume was 3,066.1 MW in April 2025 and 1,598.4 MW this month. For Primary reserve (offline), this month's bid ratio was 30.9%, and the average winning price was 12.29 yen/kW per 30 min. The requested volume was 1,122.5 MW in April 2025 and 500.6 MW this month.

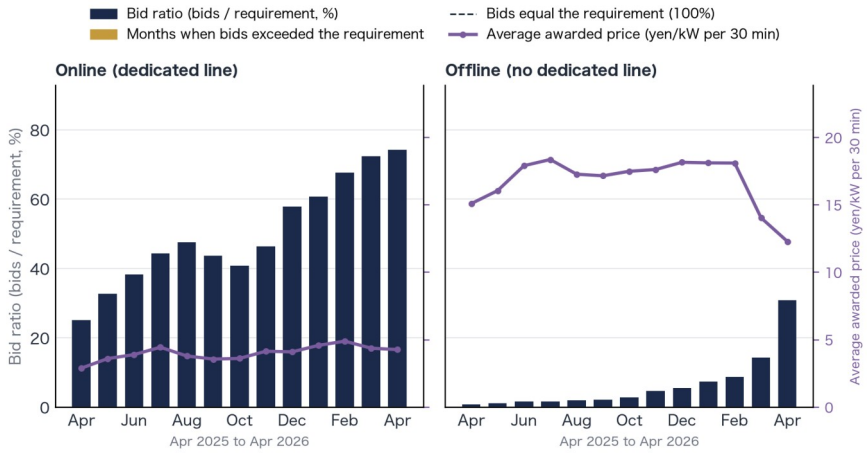


Figure 4 Bid ratio (bars) and average winning price (line) for Primary reserve (monthly; online on the left, offline on the right; gold bars are months when bids exceeded the requested volume)

Source: Trading results (preliminary) published by the Electric Power Reserve Exchange (EPRX). Our aggregation.

6. ① Balancing market (EPRX) | How prices have moved by product

These are the average winning prices by product since April 2025 (monthly averages weighted by winning volume). From March 14, 2026, Primary reserve through Tertiary reserve 1 and the Composite product switched from trading every 3 hours to trading every 30 minutes (Tertiary reserve 2 was already traded every 30 minutes).

The average winning price of Primary reserve (online) in the balancing market was 2.89 yen in April 2025 and 4.27 yen this month. The highest was 4.90 yen in February 2026 (yen/kW per 30 min). Tertiary reserve 2 was 1.12 yen in April 2025 and 3.03 yen this month (yen/kW per 30 min), with this month the highest. For the other products, the highest month was July 2025.

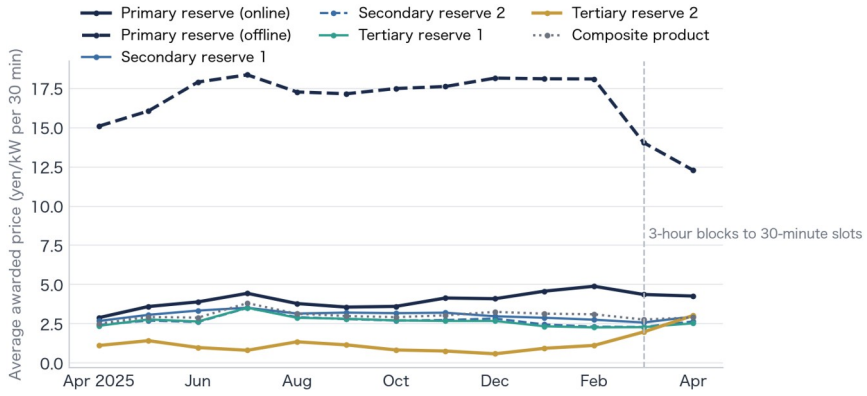


Figure 5 Average winning price by product in the balancing market (yen/kW per 30 min, monthly)

Source: Trading results (preliminary) published by the Electric Power Reserve Exchange (EPRX). Our aggregation.

© Science X Inc. · https://www.scix.co.jp

7. ① Balancing market (EPRX) | Which hours of the day are expensive

These are the average winning prices by hour for each product in April 2026 (1st–30th).

For Primary reserve (online) in the balancing market, the most expensive hour was around 18:00 at 5.37 yen, and the cheapest was around 0:00 at 3.17 yen (yen/kW per 30 min). For Tertiary reserve 2, the highest was 5.29 yen around 6:00, and the lowest was 0.84 yen around 3:00 (yen/kW per 30 min).

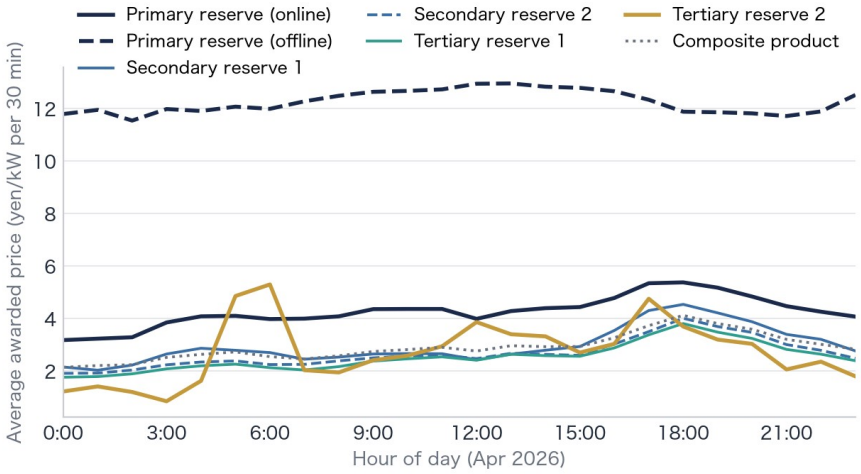


Figure 6 Average winning price by time of day in the balancing market (April 2026 (1st–30th), yen/kW per 30 min)

Source: Trading results (preliminary) published by the Electric Power Reserve Exchange (EPRX). Our aggregation.

8. ① Balancing market (EPRX) | Which products use batteries

The figure shows the share of the winning volume held by batteries. The table compares the average winning price of the volume won by batteries with the average winning price of the product as a whole.

In the balancing market, the battery share was 98.2% for Primary reserve (offline), 22.0% for Primary reserve (online) and 0.3% for Tertiary reserve 2. The average winning price of the volume won by batteries was 9.02 yen for Primary reserve (online) (overall 4.27 yen) and 46.42 yen for Tertiary reserve 2 (overall 3.03 yen) (yen/kW per 30 min).

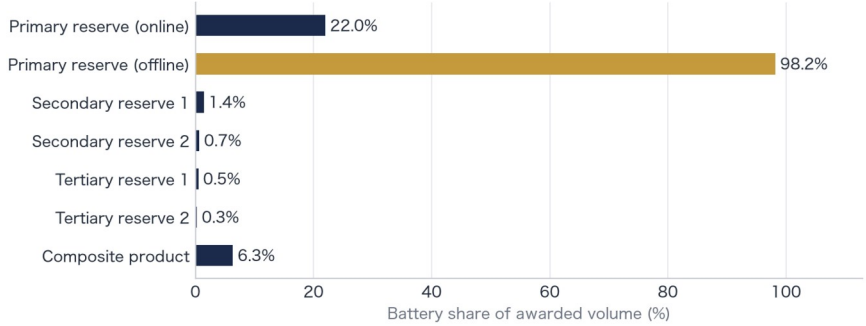


Figure 7 Share of batteries in the balancing market (%)

Source: Trading results (preliminary) by power source type published by the Electric Power Reserve Exchange (EPRX). Our aggregation.

Product	Volume won by batteries (yen/kW per 30 min)	Product as a whole (yen/kW per 30 min)
Primary reserve (online)	9.02	4.27
Primary reserve (offline)	12.25	12.29
Secondary reserve 1	9.54	2.96
Secondary reserve 2	9.91	2.65
Tertiary reserve 1	9.46	2.53
Tertiary reserve 2	46.42	3.03
Composite product	9.00	2.91

Both are averages weighted by winning volume (April 2026, preliminary, nationwide). Batteries account for only 0.3% of the winning volume of Tertiary reserve 2. In the slots where batteries won, the nationwide average winning price, weighted by the batteries' winning volume, was 5.41 yen. The batteries' average is high not because they are concentrated in high-priced slots. It is high because the batteries' own bid prices are high (each winning bid is settled at its own bid price).

9. ① Balancing market (EPRX) | Revenue is concentrated in a few slots

We ranked the month's 30-minute slots with winning bids by revenue (average winning price × winning volume, nationwide). For each product, we plotted what share of the month's revenue the top slots account for. The further the curve bulges above the dotted line, the more revenue is concentrated in a few slots. Tertiary reserve 2 is a product that covers errors in forecasting renewable generation caused by the weather. Its price is low in most slots and high in only a few.

In the balancing market, the top 10% of slots by revenue accounted for 60.2% of the month's revenue for Tertiary reserve 2, and 16.0% for Primary reserve (online). The top 1% of slots accounted for 9.0% for Tertiary reserve 2 and 1.9% for Primary reserve (online).

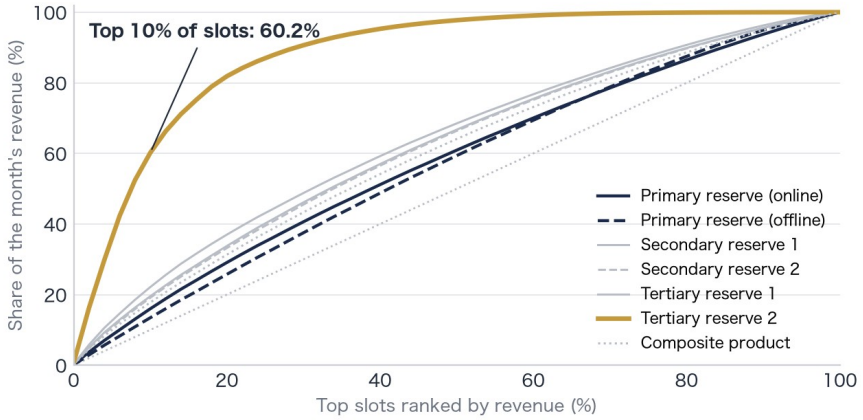


Figure 8 Share of balancing market revenue concentrated in the top slots (April 2026 (1st–30th), nationwide)

Source: Trading results (preliminary) published by the Electric Power Reserve Exchange (EPRX). Our aggregation.

In April 2026, there were 1,259 slots with winning bids. The top 1% of them by revenue (average winning price × winning volume) accounted for 9.0% of the month's revenue. There were 72 slots where the nationwide average winning price was 10 yen/kW per 30 min or more, and 181 slots with no winning bids.

Slots with the highest maximum winning prices (by area where the power source is located). The maximum winning price is the price of the single highest winning bid. The average winning price for the same slot and area is shown to its right:

Date	Time	Area	Maximum winning price (yen/kW per 30 min)	Average winning price for the same slot and area (yen/kW per 30 min)
April 1	14:30	Chubu	200.00	49.49
April 2	11:30	Chubu	200.00	11.05
April 2	12:00	Chubu	200.00	11.17
April 2	13:00	Chubu	200.00	47.39
April 2	13:30	Chubu	200.00	46.42

Source: Tertiary reserve 2 trading results (preliminary) published by the Electric Power Reserve Exchange (EPRX). Our aggregation.

10. ② Wholesale electricity (JEPX) | Average prices

Wholesale electricity is the electricity that power companies and retailers buy and sell. Its price is set on the "spot market" of the Japan Electric Power Exchange (JEPX), where electricity for the next day is traded the day before. "System (nationwide)" is the price when all of Japan is treated as one market (the system price). When the transmission lines between regions are congested, prices split by area, from Hokkaido to Kyushu (area prices).

The monthly average wholesale price for System (nationwide) was 14.77 yen/kWh this month (April 2026), and 9.82 yen/kWh in the same month last year.

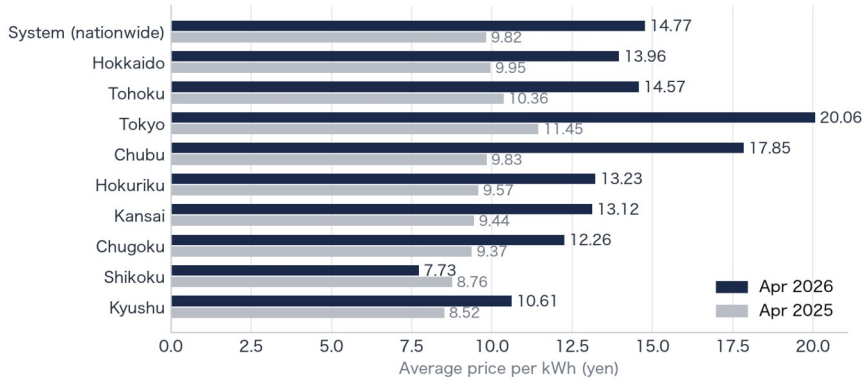


Figure 9 Average wholesale electricity price (yen/kWh). Navy is April 2026, grey is the same month last year

Source: Spot market trading results published by the Japan Electric Power Exchange (JEPX). Simple average of 30-minute prices. Our aggregation.

11. ② Wholesale electricity (JEPX) | How prices move during the day

Wholesale prices change every 30 minutes. The figure shows the shape of a day, averaging prices at the same time of day across the month. If a battery charges at cheap times and discharges at expensive times, the difference becomes its income.

On the daily average, both Tokyo and Kyushu hit their low around 12:30 and their peak around 18:30. Tokyo was 11.42 yen/kWh and 33.06 yen/kWh, and Kyushu was 3.50 yen/kWh and 17.19 yen/kWh.

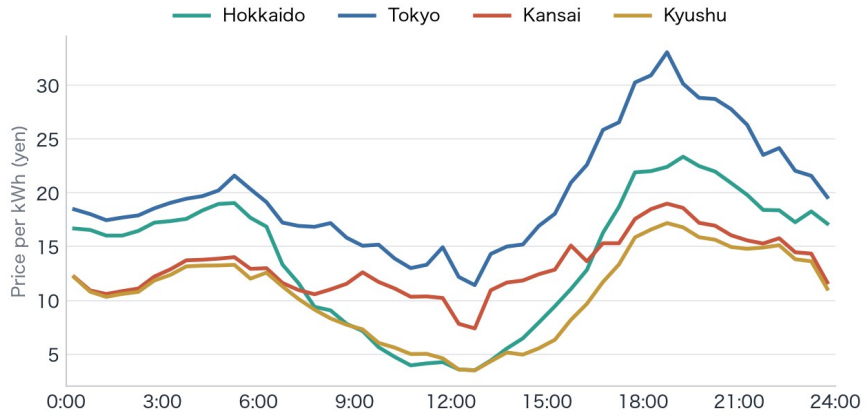


Figure 10 Daily peaks and troughs of wholesale prices (April 2026 average, yen/kWh)

Source: JEPX spot market. Our aggregation.

12. ② Wholesale electricity (JEPX) | How much is the spread per kWh?

For each area, we took the average price of the day's 4 most expensive hours minus the average price of its 4 cheapest hours, and show the monthly average. This is the difference per kWh if you buy 1 kWh in the 4 cheapest hours and sell it in the 4 most expensive hours. It is a simple difference. Electricity lost in charging and discharging and fees are not deducted, and the order of the cheap and expensive hours is not considered.

By area, the monthly average spread between the 4 most expensive and 4 cheapest hours was largest in Tokyo, at 23.12 yen/kWh, and smallest in Shikoku, at 9.41 yen/kWh.

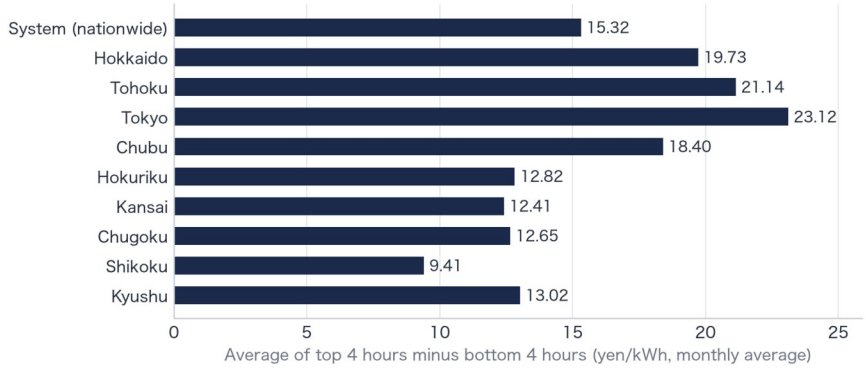


Figure 11 Wholesale price spread: average of the 4 most expensive hours − average of the 4 cheapest hours (April 2026, yen/kWh, monthly average)

Source: JEPX spot market. Our aggregation.

Area	2-hour spread (yen/kWh)	4-hour spread (yen/kWh)	Days with a 4-hour spread of 10 yen or more
System (nationwide)	16.89	15.32	24
Hokkaido	21.76	19.73	26
Tohoku	23.11	21.14	26
Tokyo	28.72	23.12	29
Chubu	20.67	18.40	27
Hokuriku	14.74	12.82	20
Kansai	14.29	12.41	20
Chugoku	14.31	12.65	20
Shikoku	10.82	9.41	11
Kyushu	14.07	13.02	21

The spread is the monthly average of the daily differences. April 2026 covers 30 days.

13. ② Wholesale electricity (JEPX) | There is a spread every day

This is the same 4-hour spread, shown day by day. The bigger the spread on a day, the more room a battery has to earn from it.

The 4-hour spread was 10 yen/kWh or more on 24 of 30 days for System (nationwide). By area, Tokyo had the most such days, at 29, and Shikoku the fewest, at 11.

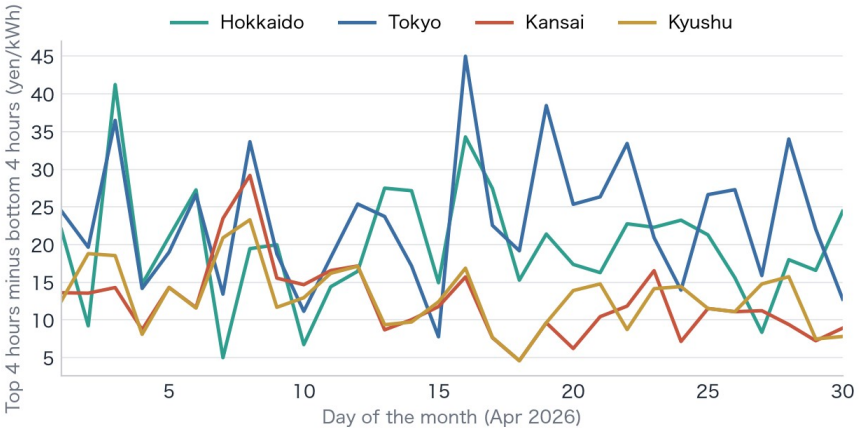


Figure 12 Daily wholesale price spread (average of the day's 4 most expensive hours − average of the 4 cheapest hours, yen/kWh)

Source: JEPX spot market. Our aggregation.

14. ③ Capacity market (OCCTO) | A market that buys future supply capacity

The capacity market buys electricity supply capacity for 4 years ahead through an auction held once a year. Prices are set in yen per kW per year. The left figure shows past main auction clearing prices. The right figure shows the capacity of batteries and pumped hydro contracted in the Long-Term Decarbonization Power Source Auction (a separate auction that promises capacity income, in principle for 20 years, for things such as new decarbonized power sources). These are published once a year, so they do not change every month. The latest is for delivery FY2029 (published January 2026).

The Tokyo clearing price in the capacity market main auction was 14,137 yen/kW for delivery FY2024, 3,495 yen/kW for FY2025 and 15,111 yen/kW for FY2029. In the Long-Term Decarbonization Power Source Auction, the contracted capacity of batteries and pumped hydro in the FY2025 auction was 819 MW for lithium-ion batteries and pumped hydro (excluding new builds), and 886 MW for non-lithium-ion batteries, pumped hydro (new builds) and LDES. Both are the latest annual figures, so they do not change every month.

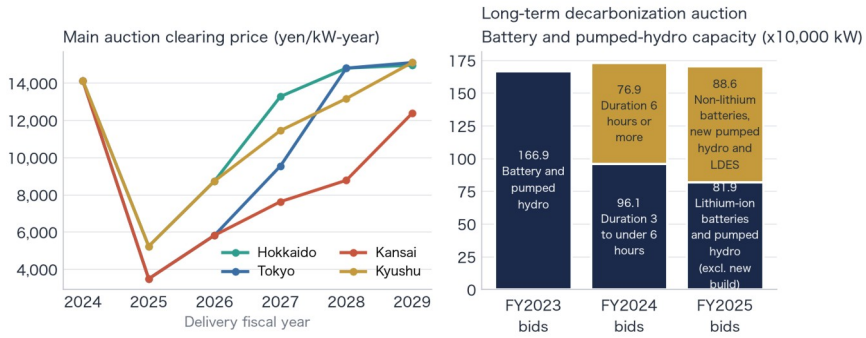


Figure 13 Capacity market clearing prices (left, yen/kW) and contracted capacity of batteries and pumped hydro in the Long-Term Decarbonization Power Source Auction (right, in units of 10,000 kW)

Source: Clearing results and capacity assurance contract documents published by the Organization for Cross-regional Coordination of Transmission Operators (OCCTO) (links in the last section (Assumptions and terms)). As published.

15. Our records | Where are battery storage projects increasing?

We have no records for this month, because it is before we started DealRoom (our data room for buyers) (from May 2026).

16. Our records | How many months and how much does it cost to connect to the grid?

A grid connection study is the procedure where you ask the grid operator to check "whether you can connect at this site, and how much the work will cost". The grid connection cost contribution is the part of the connection work cost paid by the applicant. From the response letters we received, we took only the high-voltage cases (connecting to 6,600 V distribution lines) and grouped them by grid area. Extra-high voltage is not included. Grid areas with fewer than 5 cases are not shown.

In the grid connection study responses (high voltage only, as of October 19, 2026), the median construction period was shortest in Tokyo, at 8.0 months, and longest in Tohoku, at 17.0 months. The grid connection cost contribution was smallest in Tokyo, at ¥3.02 million, and largest in Tohoku, at ¥32.35 million.

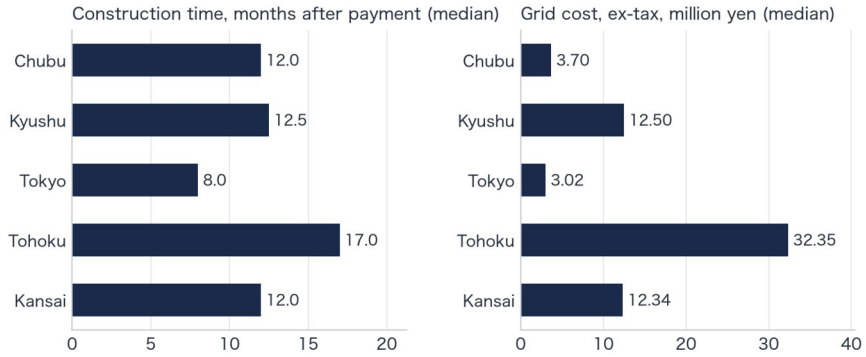


Figure 15 Median of grid connection study responses (high voltage) by grid area (left: months of construction work, right: grid connection cost contribution, excluding tax)

Source: Our aggregation of the high-voltage grid connection study response letters we received from general transmission and distribution operators (as of October 19, 2026).

17. Market figures (tables ready to use in your materials)

We have put the numbers behind the figures above into tables you can use in your materials: ① nationwide figures by product for the balancing market (bid ratio, award rate, price, battery share), ② figures by area and trading volume for wholesale electricity (JEPX), and ③ capacity market clearing prices.

Balancing market (April 2026, preliminary, nationwide)

Product	Requested volume (MW)	Bid volume (MW)	Winning volume (MW)	Bid ratio (bids ÷ requested)	Award rate (won ÷ bids)	Average winning price (yen/kW per 30 min)	Battery share
Primary reserve (online)	1,598.4	1,187.4	1,041.7	74.3%	87.7%	4.27	22.0%
Primary reserve (offline)	500.6	154.8	132.3	30.9%	85.5%	12.29	98.2%
Secondary reserve 1	1,385.2	2,046.6	1,226.1	147.7%	59.9%	2.96	1.4%
Secondary reserve 2	1,452.3	3,098.5	2,306.9	213.3%	74.5%	2.65	0.7%
Tertiary reserve 1	3,446.8	4,956.2	3,381.0	143.8%	68.2%	2.53	0.5%
Tertiary reserve 2	861.7	1,926.8	793.2	223.6%	41.2%	3.03	0.3%
Composite product	4,276.4	5,259.2	3,681.3	123.0%	70.0%	2.91	6.3%

Volumes are averages per 30-minute slot. Products with a bid ratio below 100% did not get enough bids for the requested volume. The award rate is the share of the bid volume that won.

Source: Trading results (preliminary) and trading results by power source type published by the Electric Power Reserve Exchange (EPRX). Our aggregation.

Wholesale electricity, JEPX spot market (April 2026, by area, yen/kWh)

Area	Monthly average	Same month last year	Daytime (8:00–16:00)	Evening (16:00–20:00)	4-hour spread	Maximum	Slots at 30 yen or more	Slots at 0.01 yen
System (nationwide)	14.77	9.82	9.20	20.31	15.32	35.00	21	89
Hokkaido	13.96	9.95	6.18	20.00	19.73	50.00	37	184
Tohoku	14.57	10.36	6.37	21.08	21.14	50.00	54	184
Tokyo	20.06	11.45	15.16	28.53	23.12	64.28	159	28
Chubu	17.85	9.83	12.88	22.72	18.40	44.70	92	58
Hokuriku	13.23	9.57	11.47	17.00	12.82	44.70	32	60
Kansai	13.12	9.44	11.19	16.89	12.41	37.54	22	61
Chugoku	12.26	9.37	9.18	15.86	12.65	37.54	7	82
Shikoku	7.73	8.76	4.79	8.99	9.41	31.03	2	169
Kyushu	10.61	8.52	5.71	14.63	13.02	35.00	1	180

Trading volume (April 2026, total for 30 days): total contracted volume 27,138 million kWh (same month last year 20,785 million kWh), sell bids 44,311 million kWh, buy bids 33,363 million kWh.

Source: Spot market trading results published by the Japan Electric Power Exchange (JEPX). Prices are simple averages of 30-minute slots. Our aggregation.

Capacity market main auction area prices (yen/kW per year)

Delivery fiscal year	Hokkaido	Tohoku	Tokyo	Chubu	Hokuriku	Kansai	Chugoku	Shikoku	Kyushu
FY2024	14,137	14,137	14,137	14,137	14,137	14,137	14,137	14,137	14,137
FY2025	5,242	3,495	3,495	3,495	3,495	3,495	3,495	3,495	5,242
FY2026	8,749	5,833	5,834	5,832	5,832	5,832	5,832	5,832	8,748
FY2027	13,287	9,044	9,555	7,823	7,638	7,638	7,638	7,638	11,457
FY2028	14,812	14,812	14,812	10,280	8,785	8,785	8,785	8,785	13,177
FY2029	14,972	15,111	15,111	12,388	12,388	12,388	12,388	12,388	15,112

Contracted capacity of batteries and pumped hydro in the Long-Term Decarbonization Power Source Auction (10,000 kW)

Auction year	Category	Contracted capacity (10,000 kW)
FY2023 auction	Batteries and pumped hydro	166.9
FY2024 auction	Continuous operation of 3 hours or more and less than 6 hours	96.1
FY2024 auction	Continuous operation of 6 hours or more	76.9
FY2025 auction	Lithium-ion batteries and pumped hydro (excluding new builds)	81.9
FY2025 auction	Non-lithium-ion batteries, pumped hydro (new builds) and LDES	88.6

Source: Clearing results and capacity assurance contract documents published by the Organization for Cross-regional Coordination of Transmission Operators (OCCTO) (links in the last section (Assumptions and terms)). As published.

© Science X Inc. · https://www.scix.co.jp

18. Assumptions and terms

- The figures are our aggregation of the values published by the sources. We have not added up several months or converted anything to annual figures. We do not show revenue amounts for any single battery storage plant.
- Months covered: for the balancing market (EPRX), preliminary figures for April 2026 (delivery dates up to the 30th); for wholesale electricity (JEPX), April 2026 (30 days). For the balancing market, the month differs until the published values for April 2026 are included in our aggregation.
- Balancing market: nationwide figures (total column) from EPRX preliminary results. Requested volume is by grid operator (TSO). Bid volume, winning volume and average winning price are by area where the power source is located. Volumes are averages per 30-minute slot. Average winning prices are weighted by winning volume. Bid ratio = bid volume ÷ requested volume; award rate = winning volume ÷ bid volume. The 3-hour blocks up to March 13, 2026 were counted as six 30-minute slots per block.
- Range of winning prices: the thin line runs from the cheapest bid (lowest winning price) to the most expensive bid (highest winning price) among the month's slots with winning bids (published values by area where the power source is located). The published values for Primary reserve (online), Secondary reserve 1 and 2, and Tertiary reserve 1 also include Composite product bids (one price for several products combined). So we removed from the thin line bids above the 15 yen price cap (for deliveries up to August 31, 2026) for Primary reserve (online) and Secondary reserve 1, and above 10 yen for Secondary reserve 2 and Tertiary reserve 1, where a Composite product bid in the same slot and area explains them. For Primary reserve (offline), we removed from the thin line bids above the price cap (15 yen this month) (the balancing market system also awards bids above the cap, and cuts them down to the cap at settlement). The thick band is the range from the bottom 10% to 90% when the average winning prices of slots with winning bids are sorted from cheapest. The dot is the average weighted by winning volume.
- Award rate by grid area × time of day: total winning volume ÷ total bid volume for slots at the same time of day across the month (by area where the power source is located).
- The response time and duration of balancing market products are the FY2026 specifications (Electric Power Reserve Exchange "Product Requirements", 6th edition). Primary reserve senses frequency changes by itself and responds. Online is the category where the grid operator monitors the response over a dedicated line. Offline is the category where no dedicated line is installed and a record of the response is submitted afterwards. The offline response time is within 30 seconds, and there is no set duration.
- High-priced slots in Tertiary reserve 2: slots where the nationwide average winning price was 10 yen/kW per 30 min or more. The top 1% are the top 1% of slots ranked by revenue (average winning price × winning volume) (1% of the number of slots, rounded). The maximum winning price is the published value by area where the power source is located, and is the price of the single highest winning bid. In the balancing market, each winning bid is settled at its own bid price (pay-as-bid (multi-price)), so the average winning price for the same slot and area is lower than this.
- Average prices are simple averages of 30-minute slots (not weighted by trading volume). Daytime is the slots from 8:00 to 16:00, and evening is the slots from 16:00 to 20:00.
- Spread: the day's 30-minute slots are sorted by price, and the average of the 8 cheapest slots is subtracted from the average of the 8 most expensive slots (4 hours) (4 slots for 2 hours). It does not consider the order of cheap and expensive times, electricity lost in charging and discharging, or fees, taxes and transmission charges. It does not show actual revenue.

Sources (OCCTO, capacity market clearing results): delivery FY2024 https://www.occto.or.jp/iinkai/youryou/kentoukai/2020/files/youryou_kentoukai_27_05.pdf / delivery FY2025 https://www.occto.or.jp/iinkai/youryou/kentoukai/2021/files/youryou_kentoukai_35_03_1.pdf / delivery FY2026 https://www.occto.or.jp/iinkai/youryou/kentoukai/2022/files/youryou_kentoukai_43_03.pdf / delivery FY2027 https://www.occto.or.jp/market-board/market/oshirase/2023/files/240124_mainauction_youryouyakujokekka_kouhyou_jitsujukyu2027.pdf / delivery FY2028 https://www.occto.or.jp/market-board/market/oshirase/2024/files/250129_mainauction_youryouyakujokekka_kouhyou_jitsujukyu2028.pdf / delivery FY2029 https://www.occto.or.jp/assets/news/capacity-market/260120_mainauction_youryouyakujokekka_kouhyou_jitsujukyu2029.pdf

Sources (OCCTO, Long-Term Decarbonization Power Source Auction): FY2023 auction https://www.occto.or.jp/assets/260605_auction_keiyakujyoukyou_kouhyou.pdf / FY2024 auction https://www.occto.or.jp/market-board/market/jitsujukyukanren/files/longauction_keiyakukekka_2024.pdf / FY2025 auction https://www.occto.or.jp/assets/various/capacity-market/jitsujukyukanren/yoryokakuhokeiyaku/longauction_keiyakukekka_2025.pdf

- Capacity market clearing results are published in a different year for each delivery fiscal year (FY2024 in 2020, FY2029 in January 2026). We do not show the number of battery projects in the Long-Term Decarbonization Power Source Auction, because it is not in the published summary tables.

Sources: Japan Electric Power Exchange (JEPX) spot market trading results / Electric Power Reserve Exchange (EPRX) trading results (preliminary) and trading results by power source type / Organization for Cross-regional Coordination of Transmission Operators (OCCTO) capacity market main auction clearing results and Long-Term Decarbonization Power Source Auction capacity assurance contract documents / our aggregation of the grid connection study response letters we received / our records from DealRoom (our data room for buyers).

Terms: system price (System, nationwide) = the wholesale electricity price when all of Japan is treated as one market. Area price = the price that splits by area depending on how congested the transmission lines are. The grid = the power companies' transmission network. Grid connection = connecting to the transmission network. MW = a measure of power (1 MW = 1,000 kW). MWh = the amount of electricity that can be stored. yen/kWh = the price per 1 kWh of electricity.

Science X Inc. https://www.scix.co.jp Contact s@scix.co.jp

Newsletter "Japan grid-scale BESS: primary data":
https://www.linkedin.com/newsletters/7521830530569445376/

You may use the figures, tables and numbers as long as you credit the source (citation guide https://www.scix.co.jp/press).